



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908  
www.buildingcodeonline.com

## NOTICE OF ACCEPTANCE (NOA)

Jeld-Wen, Inc.  
31725 Highway 97 North  
Chiloquin, OR 97624

### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION:** The Jeld-Wen Series "Premium Wood Doors" – Single Inswing Opaque Wood Doors w/wo Sidelites and w/wo Surface bolts

**APPROVAL DOCUMENT:** Drawing No. S-2037, titled "Wood stile & rail door" Sheets 1 through 9 of 9, prepared by manufacture dated 07/24/00 and last revised on 08-22-2005, signed and sealed by James Dobrowski, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING:** None: Approved Hurricane Protection devices, complying with FBC, as applicable, are required

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 04-0714.05 and, consists of this page 1 and evidence pages E-1and E-2-, as well as approval document mentioned above.

The submitted documentation was reviewed by Ishaq I. Chanda, P. E.

NOA No 05-0830.19  
Expiration Date: August 28, 2009  
Approval Date: September 22, 2005  
Page 1



4  
9/2/5

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

- A. DRAWINGS** (transferred from files #04-0714.05/ #02-0722.10)
1. Manufacturer's die drawings and sections.
  2. Drawing No. **S-2037**, titled "Wood stile & rail door" Sheets 1 through 9 of 9, prepared by manufacture dated 07/24/00 and last revised on 08-22-2005, signed and sealed by James Dobrowski, P.E.
- B. TESTS** (transferred from files #04-0714.05/ #02-0722.10) Test conducted per SFBC, PA202-94, now termed as FBC, TAS 202-94.
1. Test reports on
    - 1) Air Infiltration Test, per FBC, TAS 202-94
    - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
    - 3) Water Resistance Test, per FBC, TAS 202-94 (Not performed)
    - 4) Forced Entry Test, per FBC 2411 3.2.1 (b) and TAS 202-94Along with marked-up drawings and installation diagram of single outswing/inswing opaque wood doors with sidelites, prepared by Certified Testing Laboratories, Test Report No. **CTLA570W**, and **572WC** dated July 22,2000 and July 15, 2000 and **revised** on May 1st, 2001 and May 3<sup>rd</sup>, 2001 respectively, signed and sealed by Ramesh Patel, P.E
- C. CALCULATIONS** (transferred from files #04-0714.05/ #02-0722.10)
1. Wood strength referenced properties data from, "Wood Handbook" and table prepared by manufacturer
  2. Photocopies of anchor verification calculations, dated 7-26-00 prepared, signed and sealed by Mark Fetherman, P.E.
- D. QUALITY ASSURANCE**
1. Miami Dade Building Code Compliance Office (BCCO).
- E. MATERIAL CERTIFICATIONS**
1. None
- F. STATEMENTS** (transferred from files #04-0714.05/ #02-0722.10)
1. Addendum letter dated July 12, 2005, issued by Certified Testing Lab, clarifying in-swing bolts installation for test reports # CTLA572W, CTLA570W & CTLA572WA.
  2. Statement letter of "No financial interest" dated August 22, 2005, signed & sealed by James J. Dobrowski, P.E
  3. Photocopies of Statement letter of conformance, dated October 2, 1999, signed and sealed by Mark C. Fetherman, P.E.
  4. Letter of explanation dated May 22, 2001, issued by Certified Testing Laboratories for test reports CTLA-570 W, CTLA-570 WB, CTLA-570 WC and CTLA-572 WA, signed by Jim Blakely.

*Ishaq I. Chanda*

Ishaq I. Chanda, P. E.  
Product Control Examiner  
NOA No 05-0830.19

Expiration Date: August 28, 2009  
Approval Date: September 22, 2005

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

- F STATEMENTS: Continue** (transferred from files #04-0714.05/ #02-0722.10)
5. Letter of explanation dated May 23, 2001, issued by Ramesh Patel, P. E., witnessing engineer Certified Testing Laboratories for test reports CTLA-570 W, CTLA-570 WB, CTLA-570 WC and CTLA-572 WA, signed and sealed by Ramesh Patel, P. E.
  6. Letter of clarification for laboratory data, issued by Certified Testing Laboratories , signed by Christopher Benett (Lab Manager) for test reports CTLA-570 W, CTLA-570 WB, CTLA-570 WC and CTLA-572 WA, signed & sealed by Ramesh Patel, P. E. (witnessing engineer).
  7. Letter dated July 19, 2001, issued by Ramesh Patel, P.E. Consulting Engineer outlining corrective action for future test report submittal, signed and sealed by Ramesh Patel, P. E.
  8. Addendum letter dated July 16, 2001, issued by Certified Testing Laboratories for clarification of issues related to test reports CTLA-570W & CTLA-570WC, signed by Christopher Bennett (Lab Manager) and signed and sealed by Ramesh Patel, P. E.
- G. OTHER** (transferred from files #04-0714.05/ #02-0722.10)
1. This NOA revises/renews # **04-0714.05**, expired on August 28, 2009.
  2. Addendum letter dated July 12, 2005, issued by Certified Testing Lab, clarifying in-swing bolts installation for test reports # CTLA572W, CTLA570W & CTLA572WA
  3. Jeld-Wen proposal letter dated May 09, 2002 and BCCO response dated 05-18-02
  4. Revised test reports CTLA-570 W, CTLA-570 WB, CTLA-570 WB, CTLA-572W and CTLA-572 WA, issued by Certified Testing Laboratories, signed and sealed by Ramesh Patel, P. E.
  5. Faxed Laboratory Worksheet data dated July 05, 2001 supplied by Certified Testing Laboratories and thru manufacturer, for test reports CTLA-570 W, CTLA-570 WB, CTLA-570 WC and CTLA-572 WA.
  6. Various letter of explanation and addendum letter referenced above.
  7. Manufacturing plant address of Jeld-Wen series "Nord / Morgan".
  8. Glazing complies w/ASTME-1300-98.
  9. Letter from the consultant stating that the product is in compliance with the Florida Building Code (FBC), from files #04-0714.05.

*Ishaq I. Chanda*

Ishaq I. Chanda, P. E.  
Product Control Examiner  
NOA No 05-0830.19

Expiration Date: August 28, 2009  
Approval Date: September 22, 2005

**JELD-WEN®**  
 PREMIUM WOOD DOORS  
 6-8 AND 8-0 OPAQUE INSWING  
 SINGLE DOOR W/ AND W/O SIDELITES

**GENERAL NOTES**

1. THIS PRODUCT IS DESIGNED TO MEET THE FLORIDA BUILDING CODE 2001 INCLUDING "HVHZ". INSTALLATION OF THIS SYSTEM IN "HVHZ" AREA REQUIRES THE USE OF APPROVED SHUTTER/EXTERNAL PROTECTION DEVICE, COMPLYING WITH "HVHZ" REQUIREMENTS. INSTALLATION OF THIS SYSTEM OUTSIDE OF "HVHZ", SHALL MEET THE APPLICABLE CODE REQUIREMENTS FOR WINDBORNE DEBRIS PROTECTION.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS PER DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. FOR DESIGNED PRESSURE RATING SEE TABLE 1, PAGE 1.
5. SIDELITES ARE AN OPTION AND CAN BE A SINGLE OR DOUBLE CONFIGURATION.

**Frame Construction:** The head and side jambs are finger jointed ponderosa pine measuring 4.56" x 1.25". The head and side jambs are mortised, butted and joined using (3) 16GA. 2" X 1/2" crown staples at the top corners. The adjustable inswing threshold and sidelite sills are attached to the floor.

**Door Panel Construction:** The panel is a stile and rail construction. The stiles and rails are constructed from solid wood of either Douglas Fir or Western Hemlock. They are laminated with a .0625" thk. wood veneer of the following species: (See BOM Item #1 for species). The veneer face sheet is glued to the stiles and rails. The top and intermediary rails are connected to the perimeter stiles w/ (2) 1/2" dia. x 4" long wooden dowels and the bottom rail is connected to the perimeter stile w/ (3) 1/2" dia. x 4" long wooden dowels.




**Sidelite Construction:** Panel is a stile and rail construction same as the door panel. The glazing is captured between the wood cap on the exterior and the wood glass stop on the interior. The panels are wet glazed using PRC 365 silicone.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	COMMON (GENERAL NOTES, TYPICAL ELEVATION)
2	VERTICAL CROSS SECTIONS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS
5	ANCHORING LOCATIONS, ALL 6-8 DOORS
6	ANCHORING LOCATIONS, ALL 8-0 DOORS
7	GLAZING DETAILS & RAIL DETAILS
8	FRAME COMPONENTS & B.O.M.
9	DOOR MODELS

**ALL MODELS ARE VIEWED FROM THE INTERIOR.**

THE SURFACE BOLTS ARE AN OPTION USED TO ACHIEVE A HIGHER DESIGN PRESSURE RATING. SEE SHEET 3 AND SHEET 4 FOR SURFACE BOLT OPTIONS.

ANCHOR & MULLION ATTACHMENT SPACING FOR 6-8 DOORS, SEE SHEET 5 OF 9

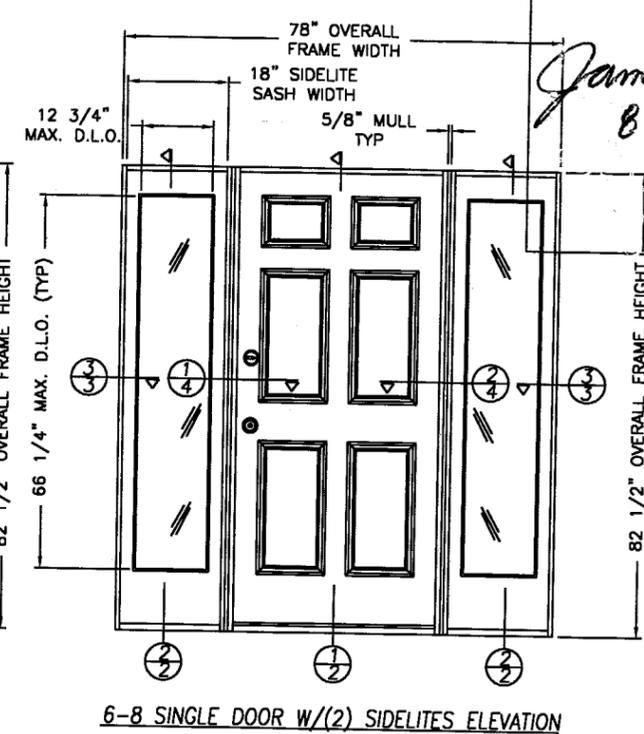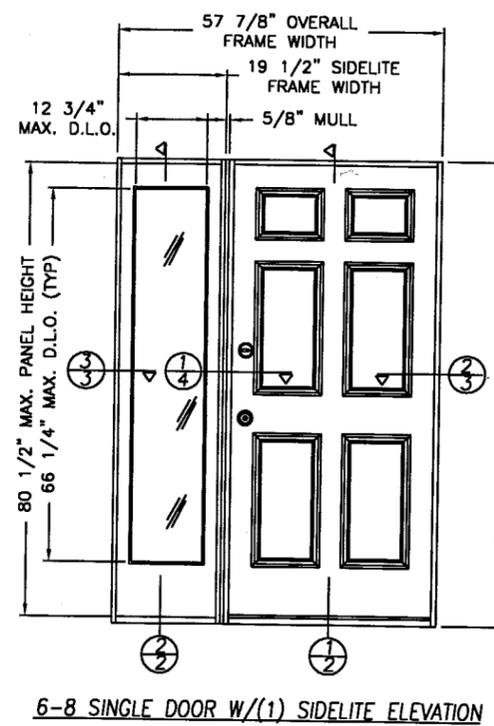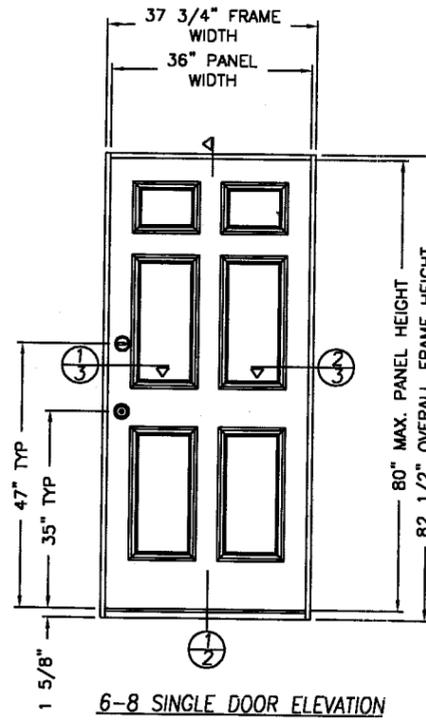




*James Dobrowski*  
 8-22-05

JELD-WEN, INC.  
 31725 HIGHWAY 97 N.  
 CHILOQUIN, OR. 97624  
 PH. 541.783.2057

PRODUCT: WOOD STILE & RAIL DOOR  
 6-8 & 8-0 OPAQUE INSWING  
 SINGLE W/ & W/O SIDELITES  
 PART OR ASSEMBLY:

ELEVATIONS &  
 GENERAL NOTES

ANCHOR & MULLION ATTACHMENT SPACING FOR 8-0 DOORS, SEE SHEET 6 OF 9

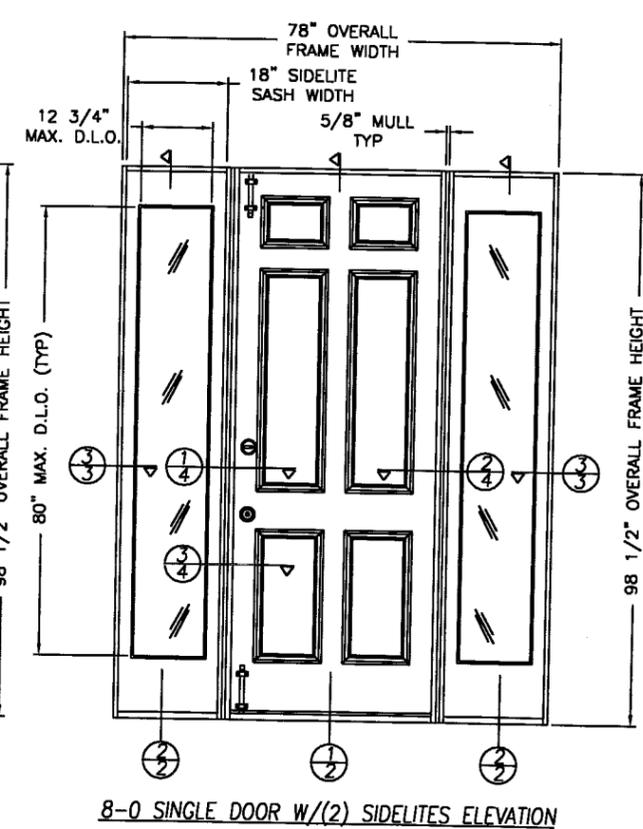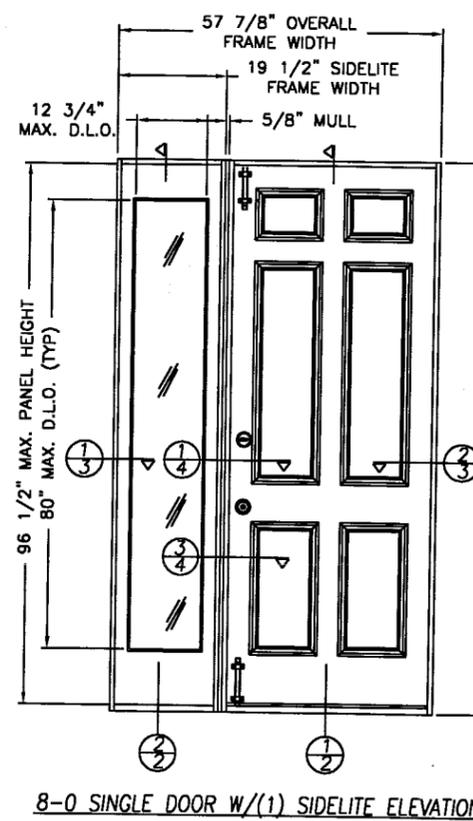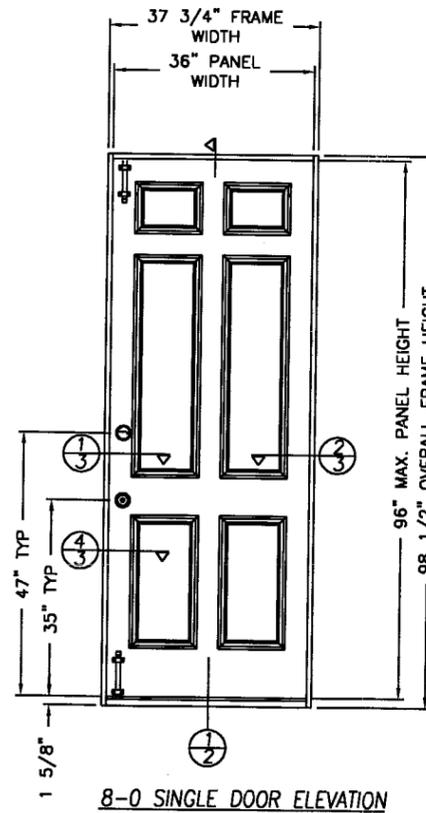


DESIGN PRESSURE RATING (INSWING DOORS)		
	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED	
6-8 MODELS	+65.0 psf	-70.0 psf
8-0 MODELS W/OUT BOLTS	+55.0 psf	-55.0 psf
8-0 MODELS W/BOLTS	+65.0 psf	-70.0 psf

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 05-0830.19 Expiration Date AUGUST 28, 2009  
 By *Ishag I. Chaudh*  
 Miami Dade Product Control Division


DATE: 7-24-00  
 SCALE: 1 : 32  
 DWG. BY: TJH  
 CHK. BY: SS  
 DRAWING NO.: S-2037  
 SHEET 1 OF 9

NO.	DATE	REVISIONS	BY
5	04-20-05	GENERAL REVISIONS	WAR
4	07/15/02	GENERAL REVISION	KMN
3	07/13/01	GENERAL REVISION	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/19/01	GENERAL REVISION	TJH

*James D. Olmstead*  
8-22-05

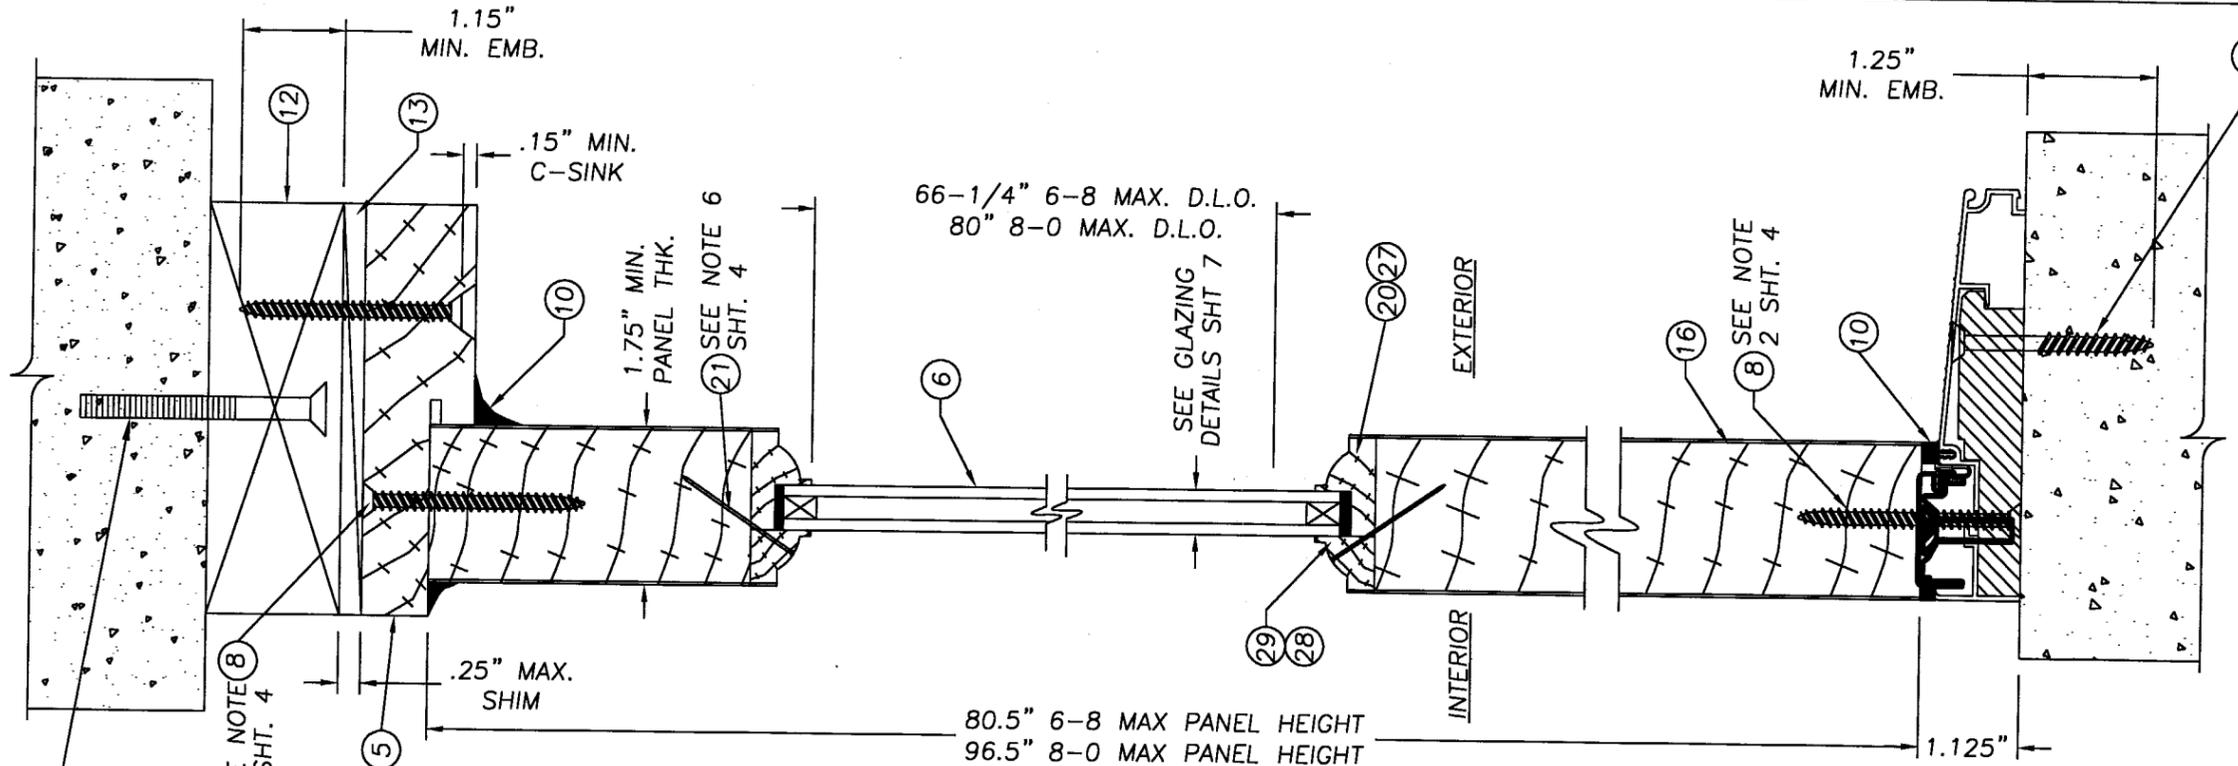

2 VERTICAL CROSS SECTION  
2 THRU SIDELITE

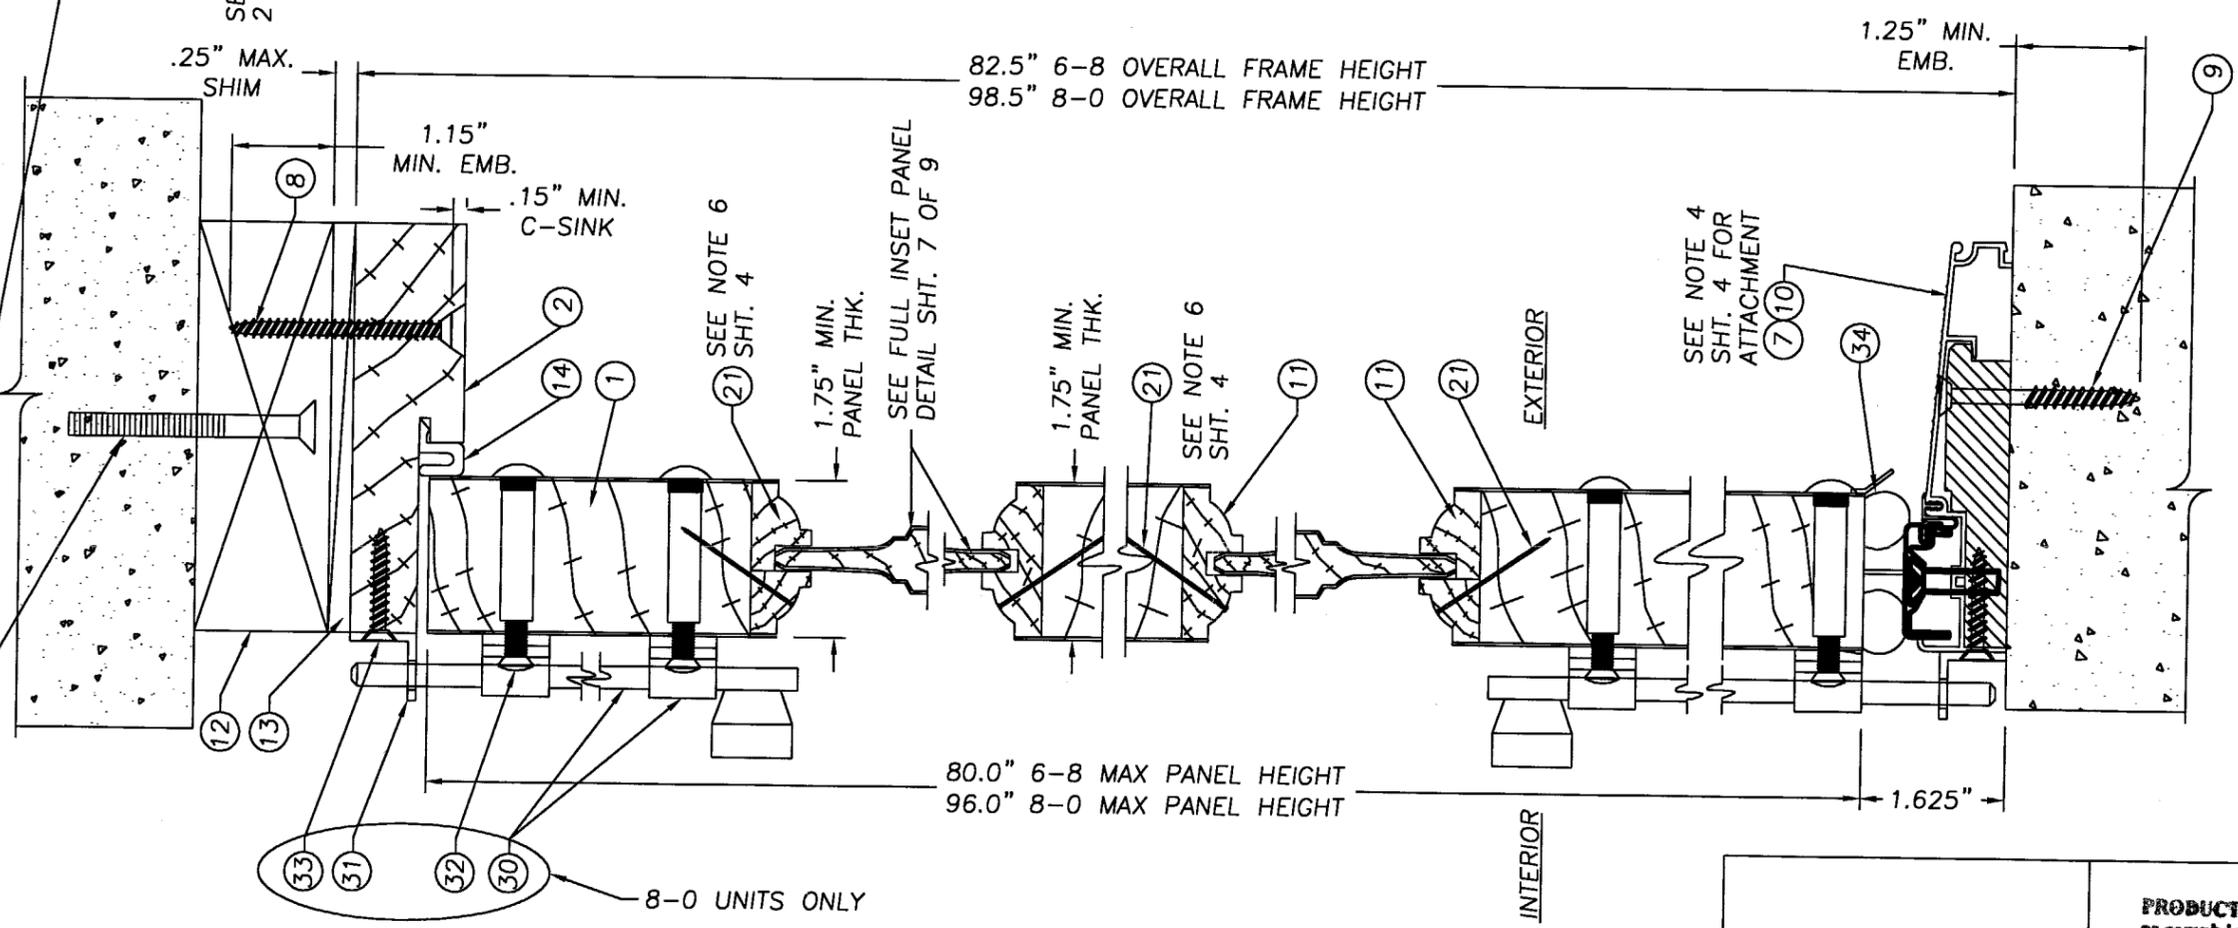

1 VERTICAL CROSS SECTION  
2 THRU ACTIVE DOOR

2x BUCK TO SUBSTRATE FASTENING  
TO BE ENGINEERED SEPERATLY

8-0 UNITS ONLY

JELD-WEN, INC.  
31725 HIGHWAY 97 N.  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT: WOOD STILE & RAIL DOOR  
6-8 & 8-0 OPAQUE INSWING  
SINGLE W/ & W/O SIDELITES  
PART OR ASSEMBLY:  
VERTICAL CROSS SECTIONS

NO.	DATE	REVISIONS	BY
5	04-20-05	GENERAL REVISIONS	WAR
4	07/15/02	GENERAL REVISION	KMN
3	07/13/01	GENERAL REVISION	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/19/01	GENERAL REVISION	TJH

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 05-0830.19  
Expiration Date Aug 28, 2009  
By Ishag I. Claude  
Miami Dade Product Control  
Division

DATE: 7-24-00  
SCALE: 1 : 2  
DWG. BY: TJH  
CHK. BY: SS  
DRAWING NO.:  
S-2037  
SHEET 2 OF 9


James Dobrowski  
8-22-05

JELD-WEN, INC.  
31725 HIGHWAY 97 N.  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT: WOOD STILE & RAIL DOOR  
6-8 & 8-0 OPAQUE INSWING  
SINGLE W/ & W/O SIDELITES  
PART OR ASSEMBLY:  
HORIZONTAL CROSS  
SECTIONS 1/3, 2/3, 3/3 & 4/3

NO.	DATE	REVISIONS	BY
3	04-20-05	GENERAL REVISIONS	WAR
3	07/13/01	GENERAL REVISIONS	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/19/01	GENERAL REVISION	TJH


DATE: 7-24-00  
SCALE: 1 : 2  
DWG. BY: TJH  
CHK. BY: SS  
DRAWING NO.: S-2037  
SHEET 3 OF 9

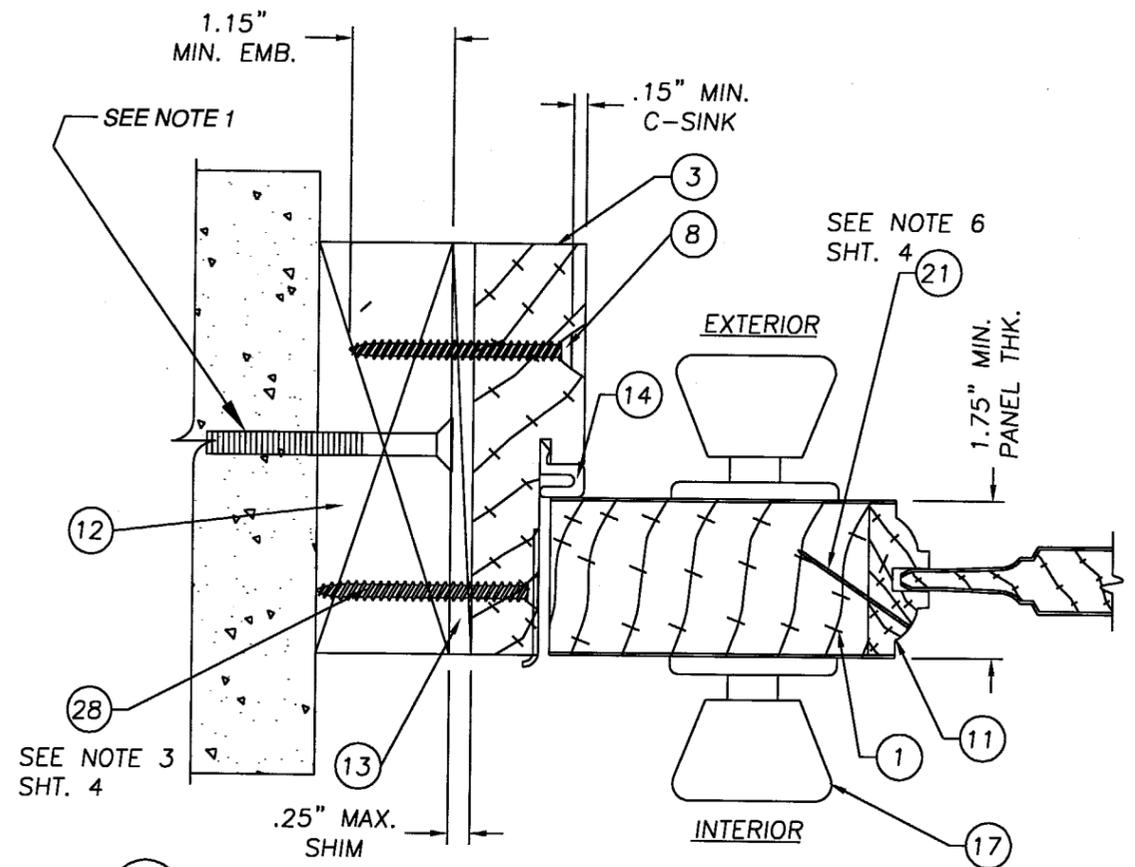


1 HORIZONTAL CROSS SECTION  
3 @ LATCH JAMB TO BUCK

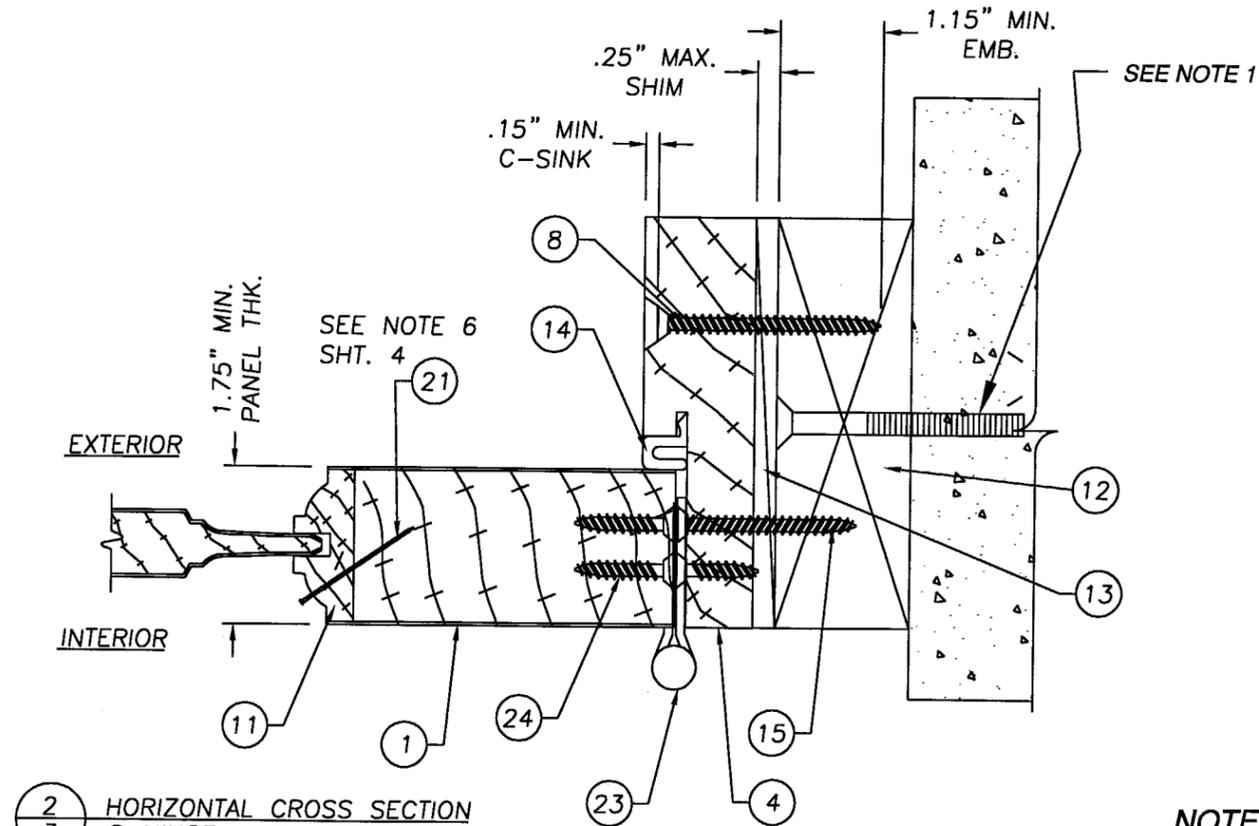

2 HORIZONTAL CROSS SECTION  
3 @ HINGE JAMB TO BUCK

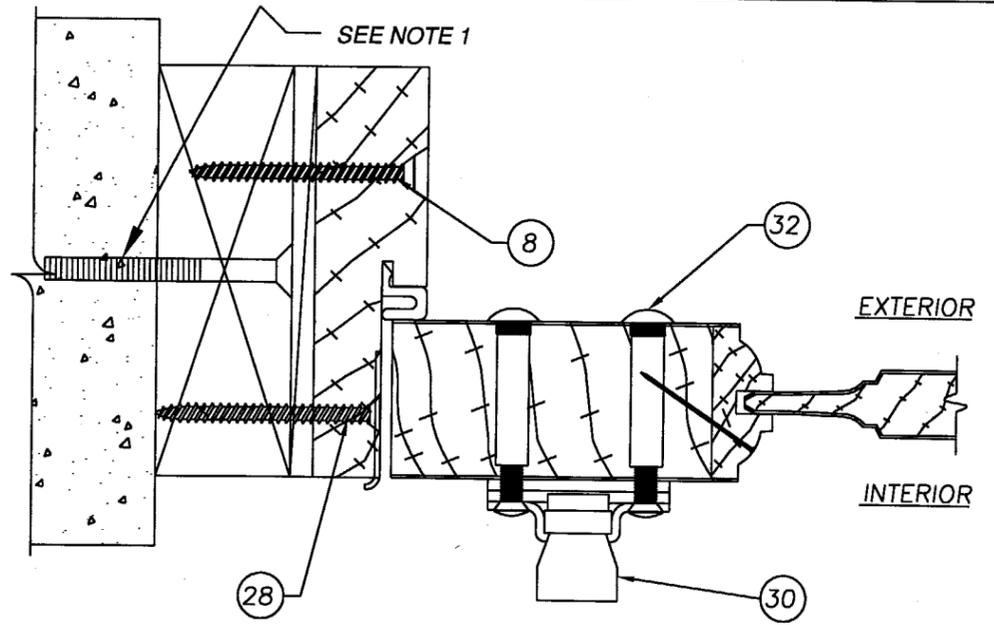

4 HORIZONTAL CROSS SECTION (SURFACE BOLT VIEW)  
3 SEE SECTION 1/3 FOR ALL OTHER PART CALLOUTS. THE SURFACE BOLTS ARE AN OPTION TO ACHIEVE HIGHER PRESSURES ON 8-0 DOORS ONLY, SEE DESIGN PRESSURE TABLE ON SHT.1. ITEM 17 NOT SHOWN FOR CLARITY.

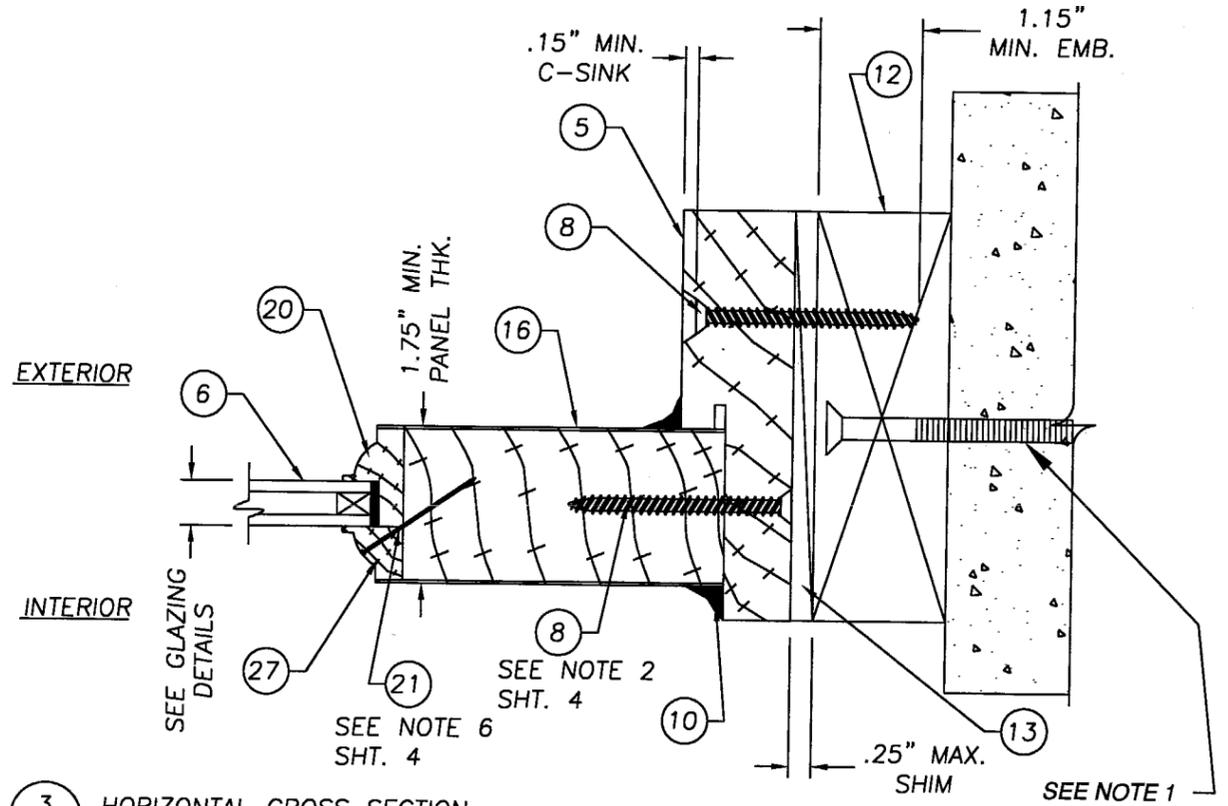


3 HORIZONTAL CROSS SECTION  
3 @ SIDELITE TO BUCK, TYP.

NOTE 1  
2x BUCK TO SUBSTRATE FASTENING  
TO BE ENGINEERED SEPERATLY

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 05-08-30-19  
Expiration Date AUG 29, 2009  
By Ishag I. Chanda  
Miami Dade Product Control  
Division

*Jama Dobrowski*  
8-22-05

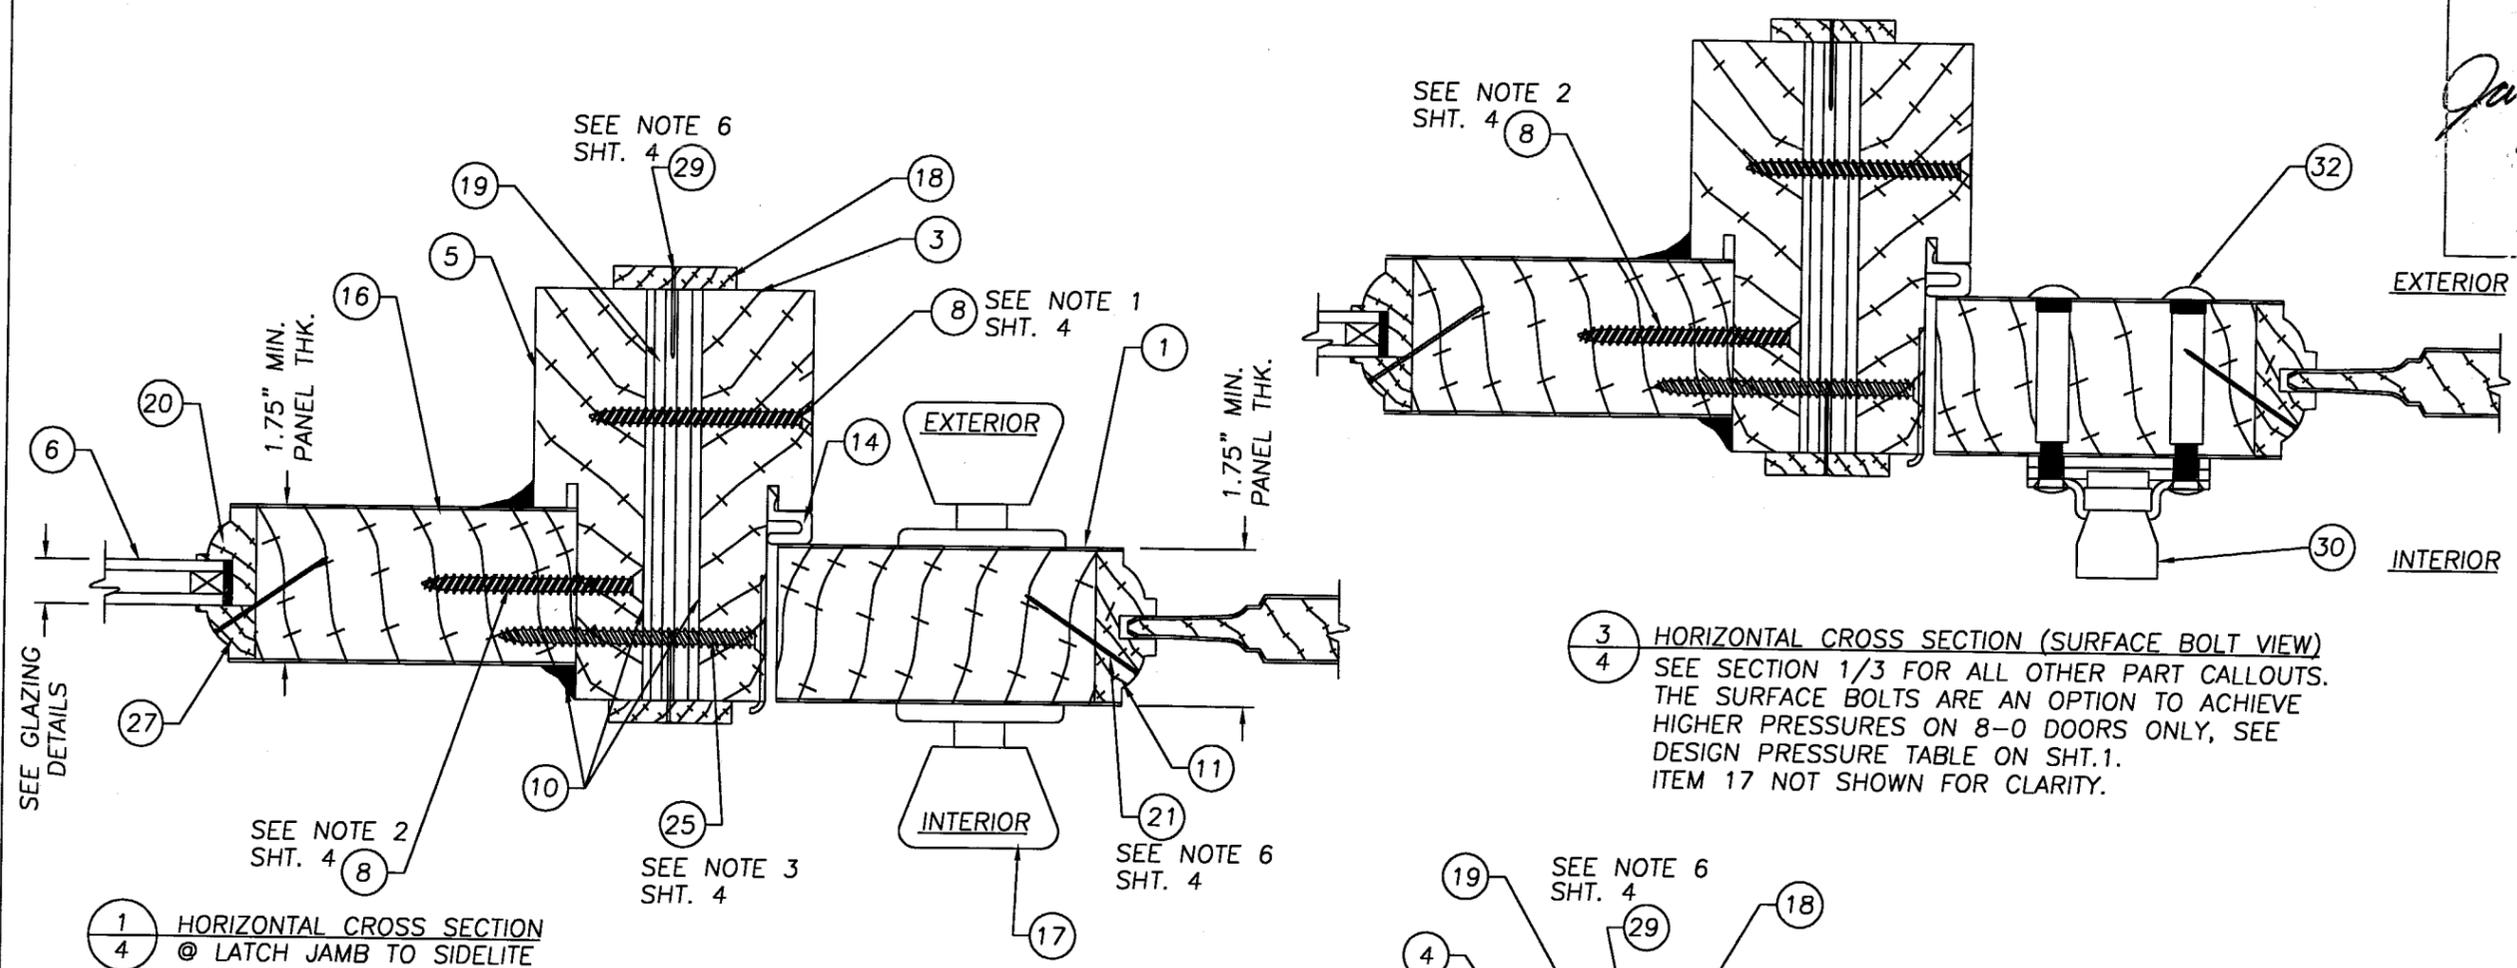

1 HORIZONTAL CROSS SECTION @ LATCH JAMB TO SIDELITE  
4

3 HORIZONTAL CROSS SECTION (SURFACE BOLT VIEW)  
4 SEE SECTION 1/3 FOR ALL OTHER PART CALLOUTS. THE SURFACE BOLTS ARE AN OPTION TO ACHIEVE HIGHER PRESSURES ON 8-0 DOORS ONLY, SEE DESIGN PRESSURE TABLE ON SHT.1. ITEM 17 NOT SHOWN FOR CLARITY.

2 HORIZONTAL CROSS SECTION @ HINGE JAMB TO SIDELITE  
4

- NOTES: (TYP. TO ALL FRAME CONFIGURATIONS)
1. SPACING FOR ITEM #8 AT THE MULLION AS FOLLOWS:  
8-0 UNITS: 6" DOWN FROM TOP & (6) MORE AT @ 14.375" O.C.  
6-8 UNITS: SAME AS THE PERIMETER SPACING FOR THE 6-8 UNITS.
  2. SIDELITE TO FRAME ATTACHMENT SPACING FOR ITEM #8: 6" FROM TOP AND BOTTOM CORNERS AND (2) MORE EVENLY SPACED FOR (4) TOTAL PER OCCURANCE.
  3. WHEN ATTACHING STRIKE & DEADBOLT PLATES TO JAMB ON SINGLE UNITS USE ITEM 30 (#10 x 2 1/2"). ON SINGLE UNITS W/SIDELITES ITEM 25 (#10 x 3").
  4. THE THRESHOLDS ARE NOT ATTACHED TO THE DOOR OR SIDELITE FRAMES. THEY ARE NOTCHED AND ATTACHED TO THE FLOOR WITH ITEM 9 (1/4" x 2 3/4") TAPCON AND ITEM 10 (CR LAWRENCE 33S SILICONE CAULK). APPLY A CONTINUOUS BEAD 1/8" THK. x .3/8" WD. AROUND ALL (4) OUTER EDGES WITH A MINIMUM OF (2) ROWS IN A ZIG ZAG PATTERN IN THE MIDDLE, FULL LENGTH OF THETHRESHOLD, 1/8" THK. x .3/8" WD.
  5. THE TOP CORNERS OF THE DOOR FRAME, AND THE TOP CORNERS OF THE SIDELITE FRAME ARE STAPLED TOGETHER USING (3) 16GA. x 2" LG. x 1/2" CROWN STAPLES.
  6. SPACING FOR ITEM #21 & #29 IS A MAX. OF 8" O.C.

JELD-WEN, INC.  
31725 HIGHWAY 97 N.  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT: WOOD STILE & RAIL DOOR  
6-8 & 8-0 GLAZED INSWING  
SINGLE W/ & W/O SIDELITES  
PART OR ASSEMBLY:  
HORIZONTAL CROSS  
SECTIONS 1/4, 2/4, & 3/4

NO.	DATE	REVISIONS	BY
4	04-20-05	GENERAL REVISIONS	WAR
3	07/13/01	GENERAL REVISIONS	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/19/01	GENERAL REVISION	TJH

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 05-0830-19  
Expiration Date: April 28, 2009  
By: *Ishaq I. Uqade*  
Miami Dade Product Control  
Division

DATE: 7-24-00  
SCALE: 1 : 2  
DWG. BY: TJH  
CHK. BY: SS  
DRAWING NO.: S-2037  
SHEET 4 OF 9

*James Dobrowski*  
B-22-05


JELD-WEN, INC.  
31725 HIGHWAY 97 N.  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT: WOOD STILE & RAIL DOOR  
6-8 & 8-0 OPAQUE INSWING  
SINGLE W/ & W/O SIDELITES  
PART OR ASSEMBLY:  
6-8 DOOR ANCHORING  
LOCATIONS AND DETAILS


NO.	DATE	REVISIONS	BY
4	04-20-05	GENERAL REVISION WAR	
3	07/13/01	GENERAL REVISION TJH	
2	05/03/01	GENERAL REVISION TJH	
1	04/19/01	GENERAL REVISION TJH	

DATE: 7-24-00  
SCALE: 1 : 24  
DWG. BY: TJH  
CHK. BY: SS  
DRAWING NO.: S-2037  
SHEET 5 OF 9


PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 05-0830-19  
Expiration Date Aug 28, 2007  
By Greg I. Lunde  
Miami Door/Product Control  
Division

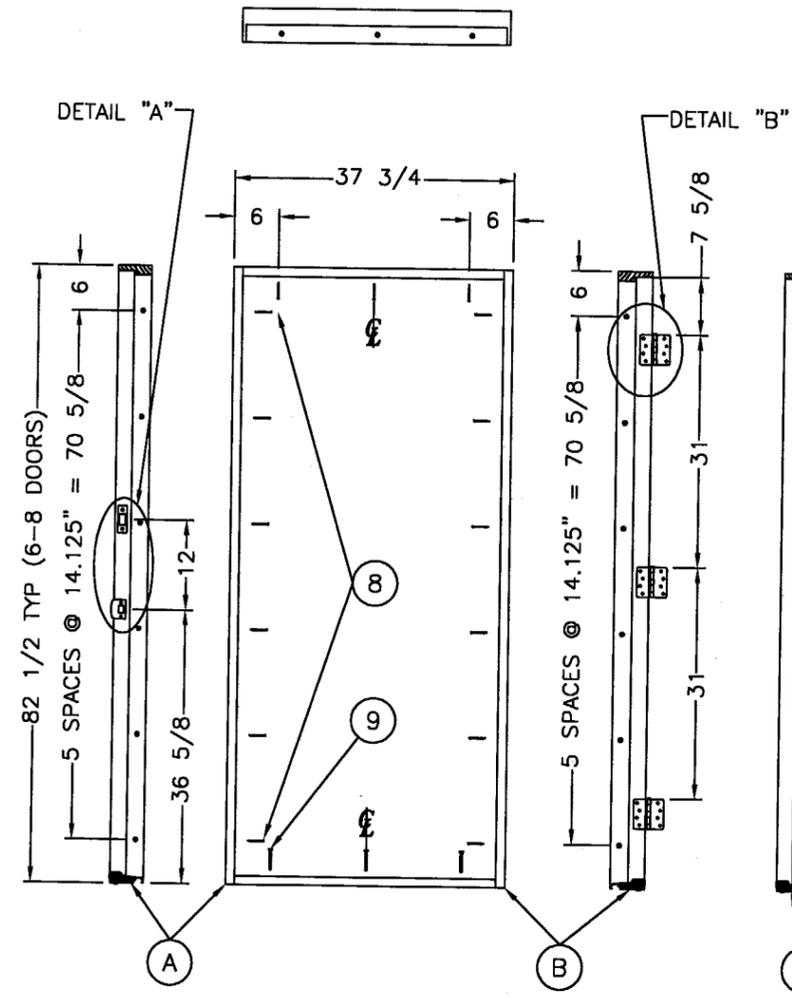


6-8 DOOR ANCHOR LOCATIONS  
SINGLE UNIT, NO SIDELITE  
(VIEWED FROM INTERIOR)

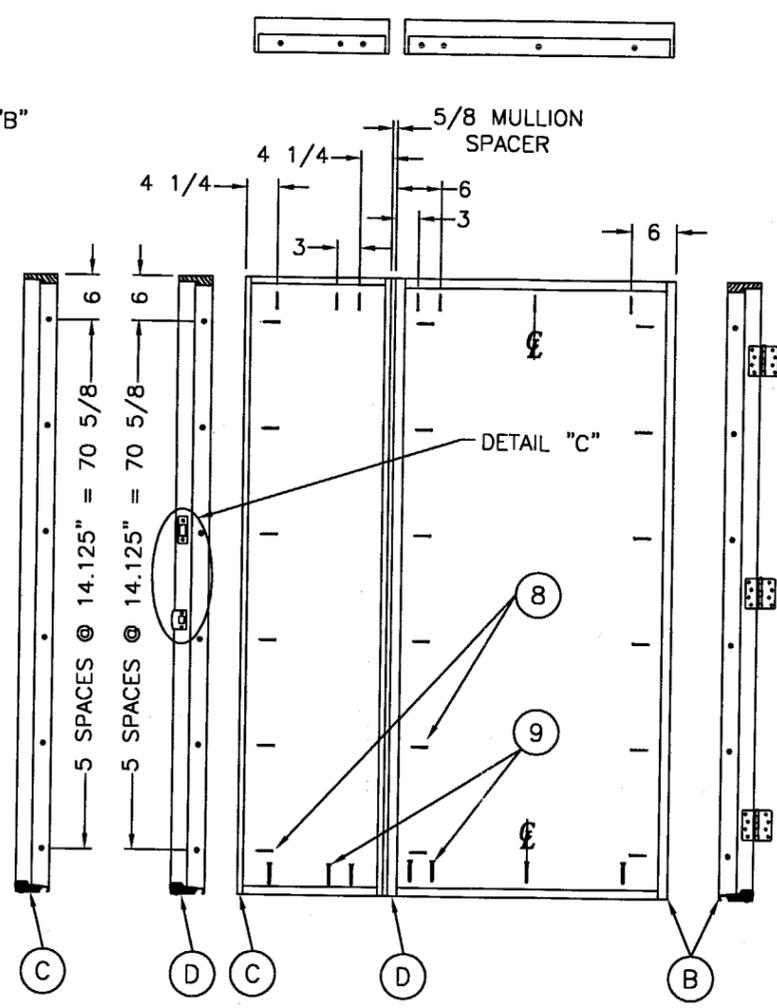


6-8 DOOR ANCHOR LOCATIONS  
SINGLE UNIT, ONE SIDELITE  
(VIEWED FROM INTERIOR)

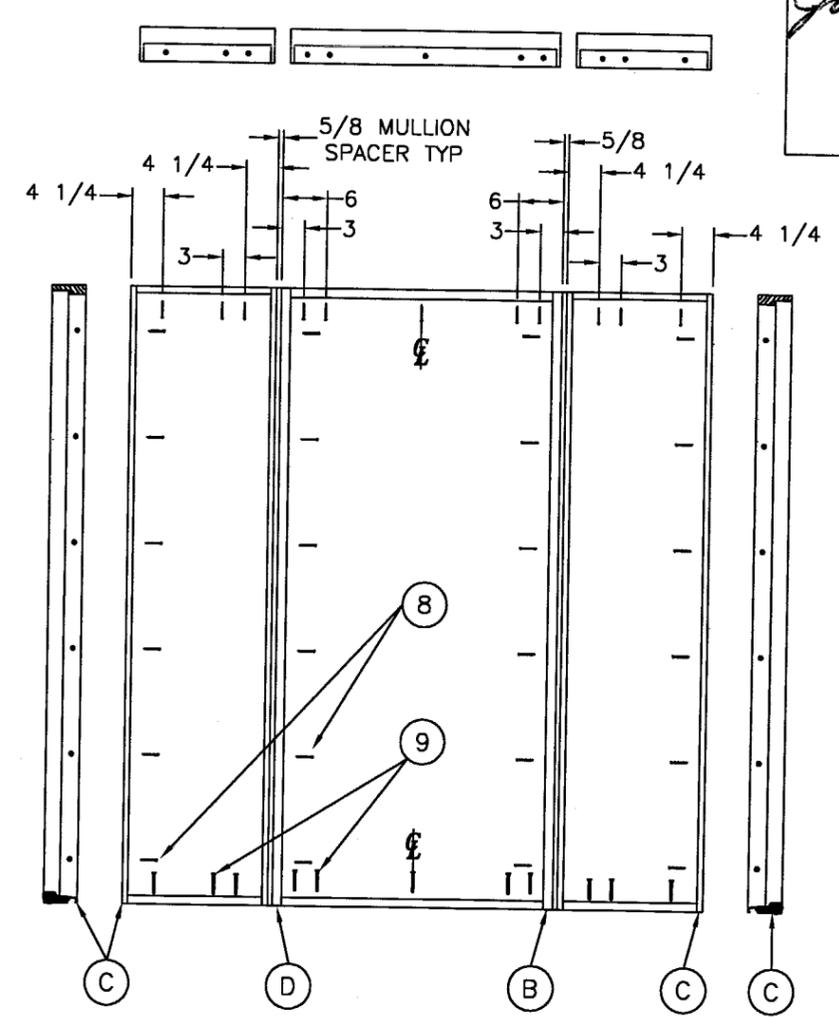


6-8 DOOR ANCHOR LOCATIONS  
SINGLE UNIT, TWO SIDELITES  
(VIEWED FROM INTERIOR)

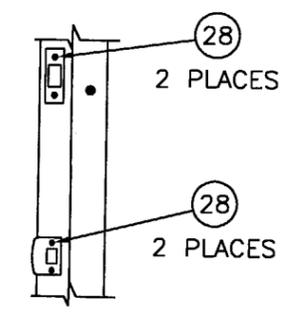

DETAIL 'A'  
STRIKES TO JAMB  
SINGLE UNIT, NO SIDELITE

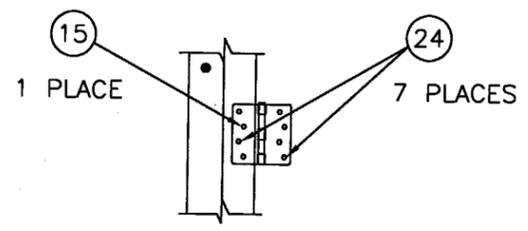


DETAIL 'B'  
HINGE SCREW DETAIL

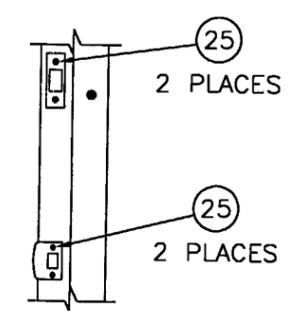

DETAIL 'C'  
STRIKES TO JAMB  
SINGLE UNIT, WITH SIDELITE


*James D. Otroush*  
8-22-05

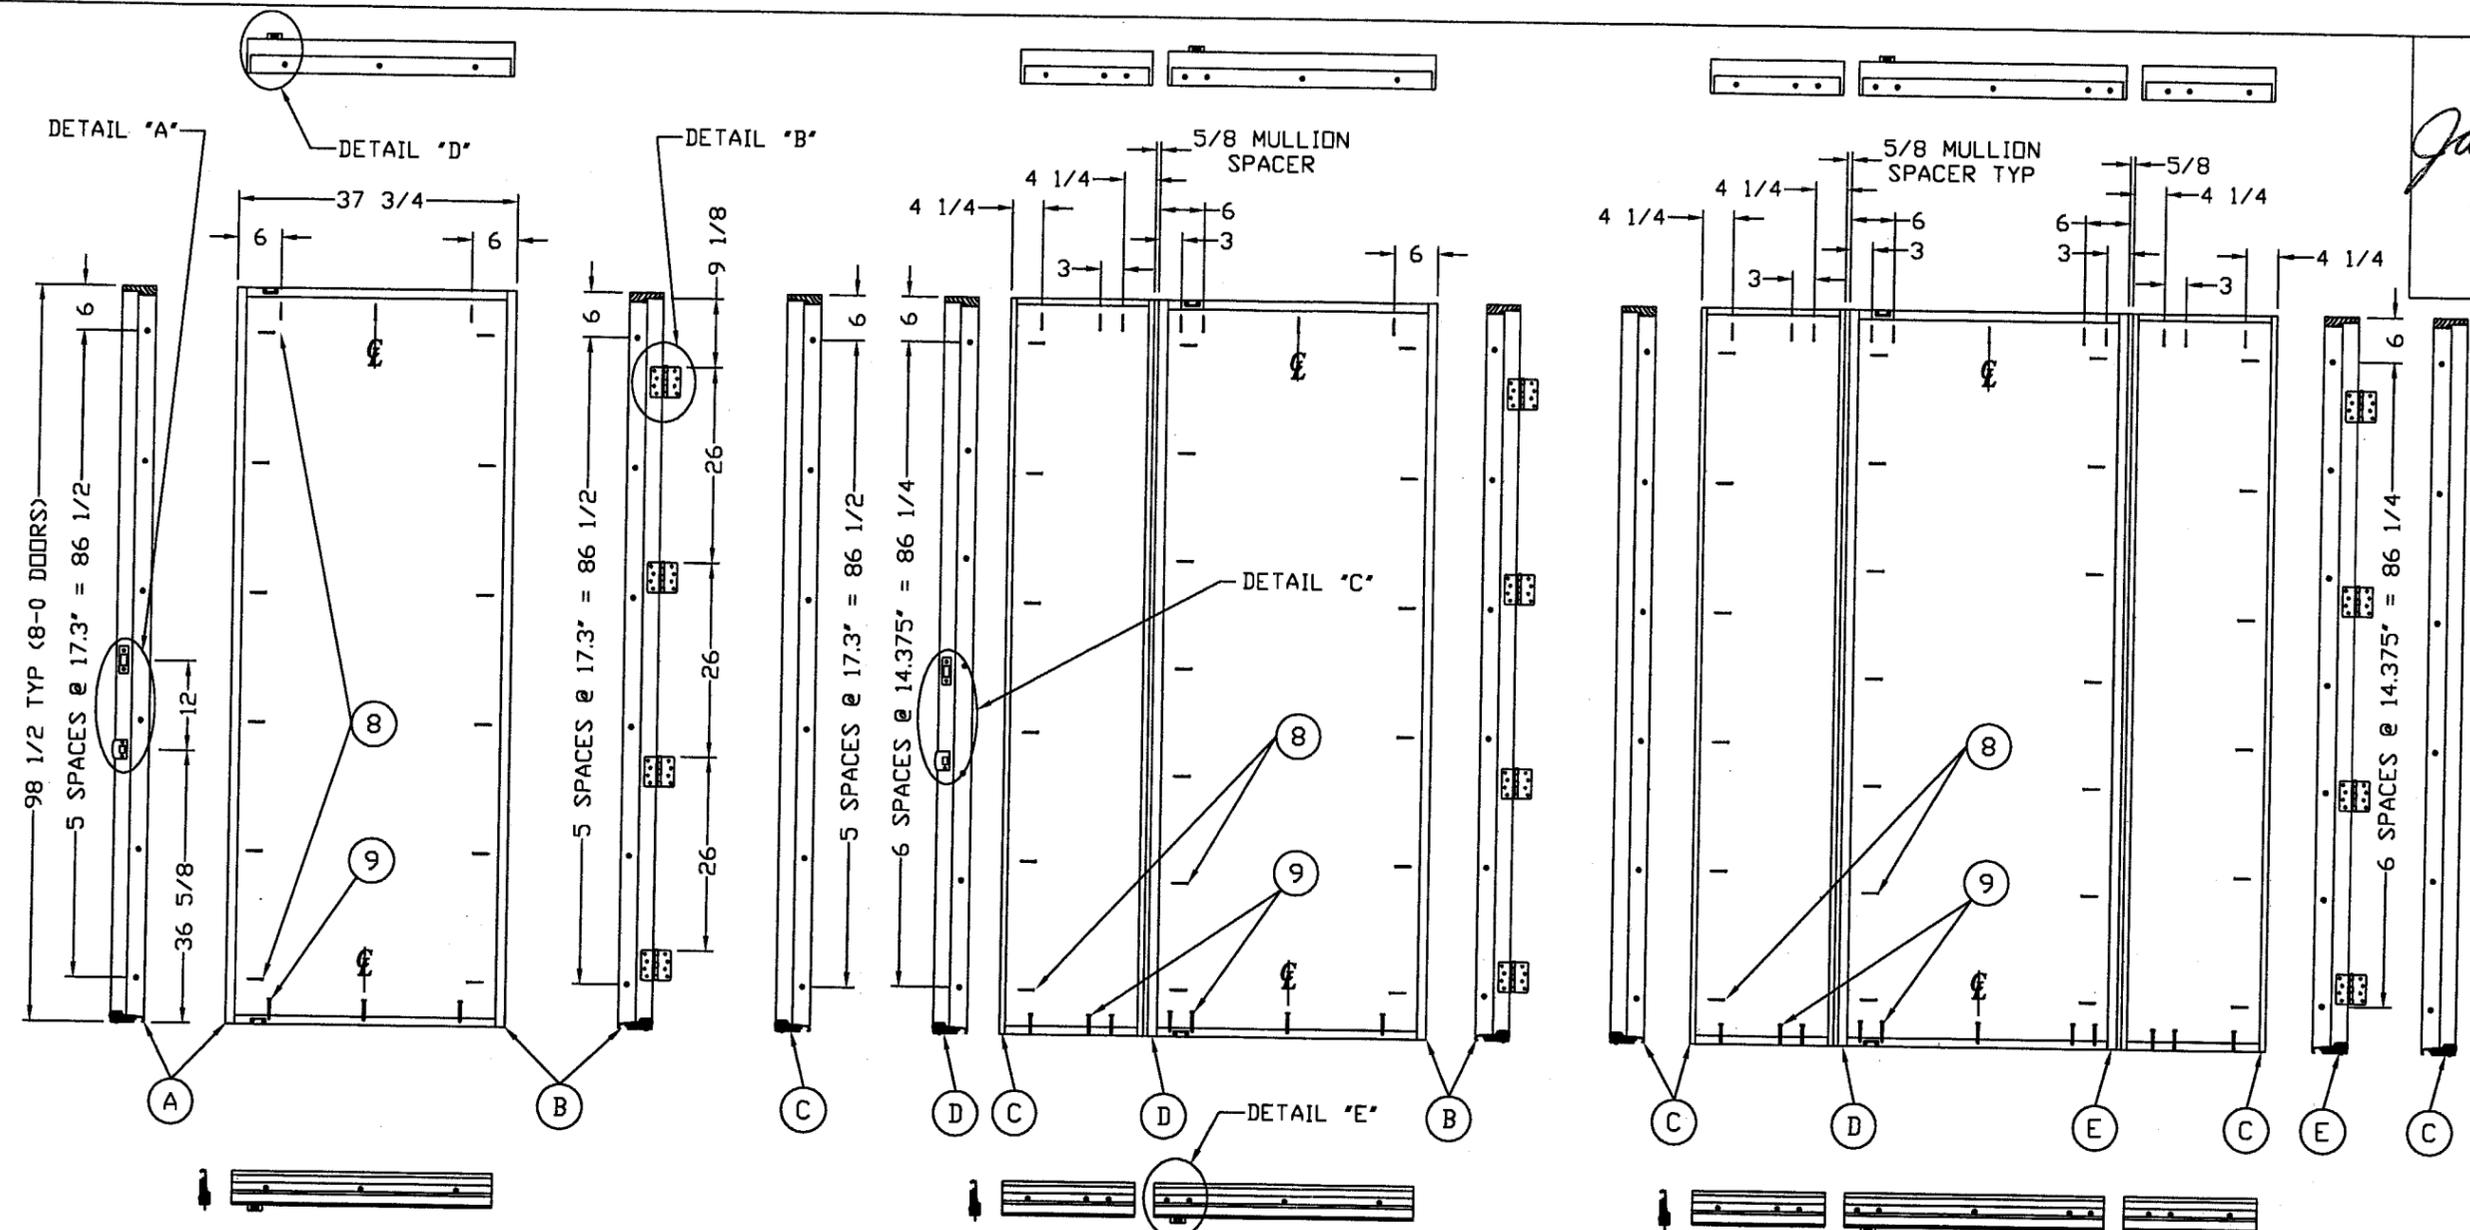


8-0 DOOR ANCHOR LOCATIONS  
SINGLE UNIT, NO SIDELITE  
(VIEWED FROM INTERIOR)

8-0 DOOR ANCHOR LOCATIONS  
SINGLE UNIT, ONE SIDELITE  
(VIEWED FROM INTERIOR)


8-0 DOOR ANCHOR LOCATIONS  
SINGLE UNIT, TWO SIDELITES  
(VIEWED FROM INTERIOR)

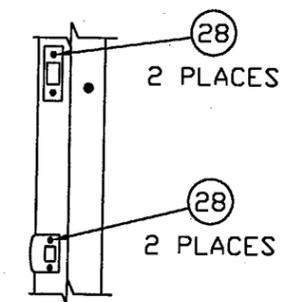


DETAIL 'A'  
STRIKES TO JAMB  
SINGLE UNIT, NO SIDELITE

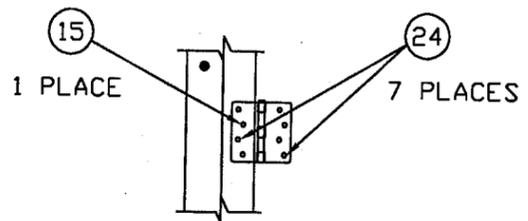


DETAIL 'B'  
HINGE SCREW DETAIL



DETAIL 'C'  
STRIKES TO JAMB  
SINGLE UNIT, WITH SIDELITE



DETAIL 'D'  
STRIKE PLATE TO JAMB



DETAIL 'E'  
STRIKE PLATE TO SILL

JELD-WEN, INC.  
31725 HIGHWAY 97 N.  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT: WOOD STILE & RAIL DOOR  
6-8 & 8-0 OPAQUE INSWING  
SINGLE W/ & W/O SIDELITES  
PART OR ASSEMBLY:  
8-0 DOOR ANCHORING  
LOCATIONS AND DETAILS

NO.	DATE	REVISIONS	BY
4	04-20-05	GENERAL REVISION	WAR
3	07/13/01	GENERAL REVISION	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/19/01	GENERAL REVISION	TJH


PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 05-0830.19  
Expiration Date AUG 28, 2009  
By *Iskay I. Chaudh*  
Miami Dade Product Control  
Division

DATE: 7-24-00
SCALE: 1 : 24
DWG. BY: TJH
CHK. BY: SS
DRAWING NO.: S-2037
SHEET 6 OF 9


*James D. Obrowski*  
9-22-05

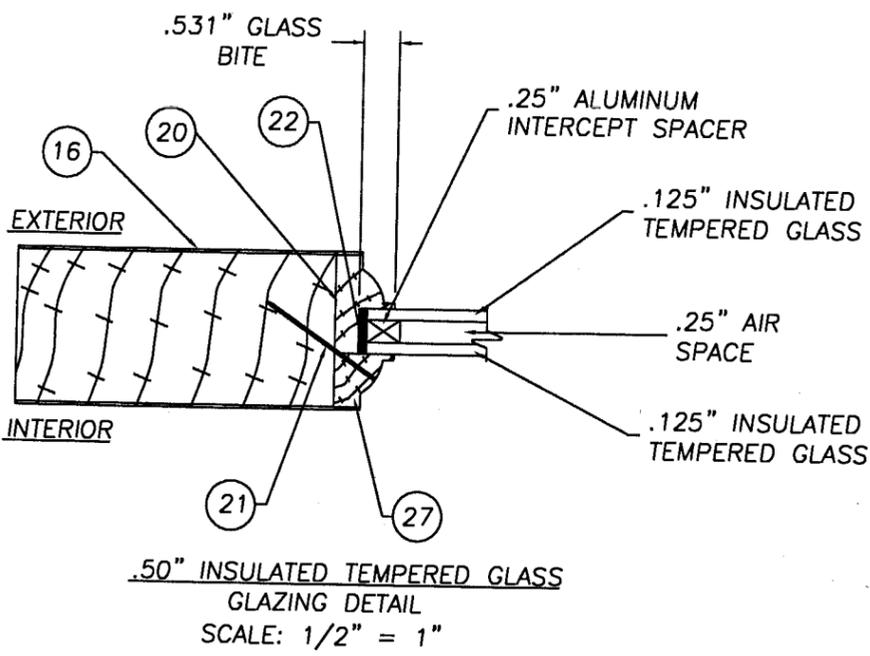


**.50\"/>**

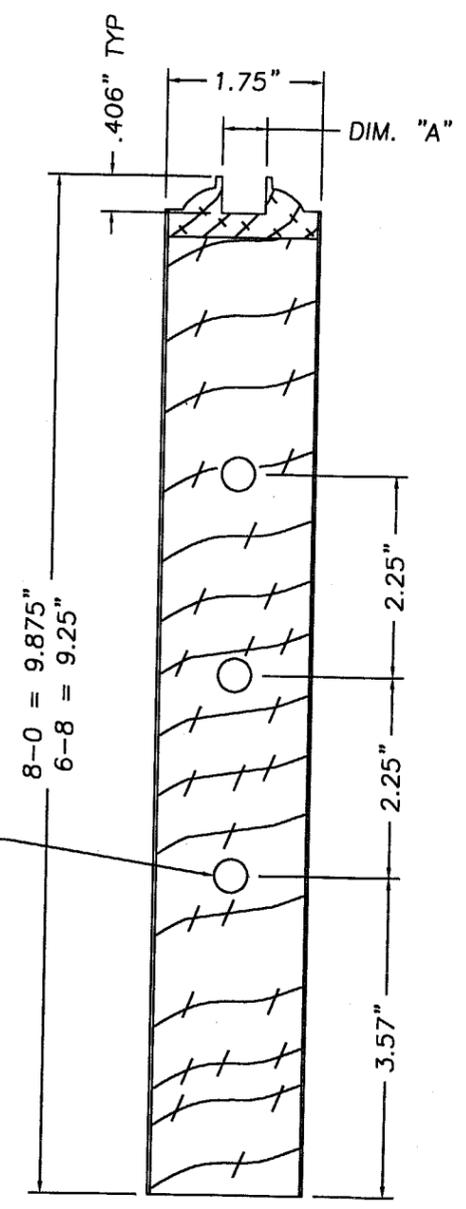

**BOTTOM RAIL**  
SCALE: 1/2\"/>

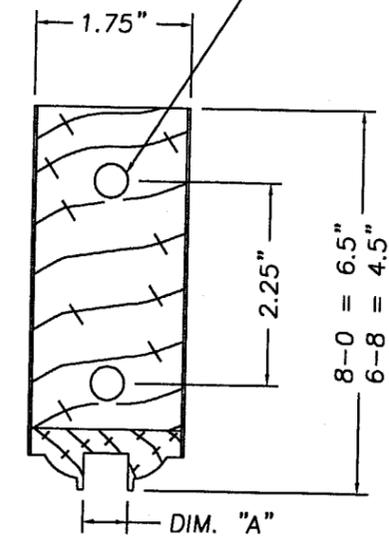


**TOP RAIL**  
SCALE: 1/2\"/>

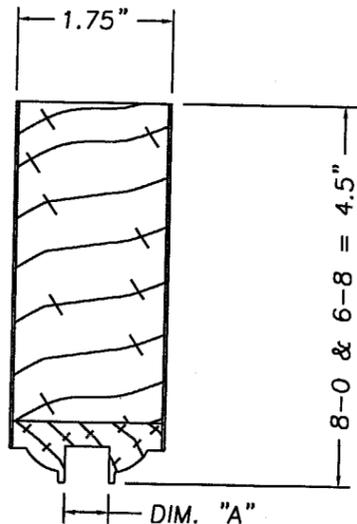

**SIDE STILE**  
SCALE: 1/2\"/>


PREMIUM DOOR .50\"/>

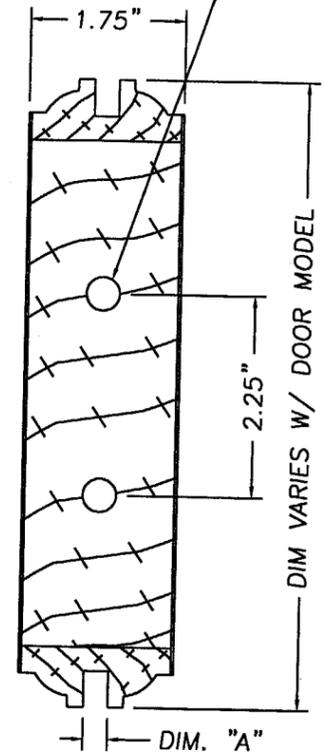

**LOCK RAIL MULLION**  
SCALE: 1/2\"/>

DIMENSION "A" CHART	
OPENING FOR	DIM. "A"
1/2" GLASS	.527"
INSET PANEL	.277"

PREMIUM DOOR .50\"/>

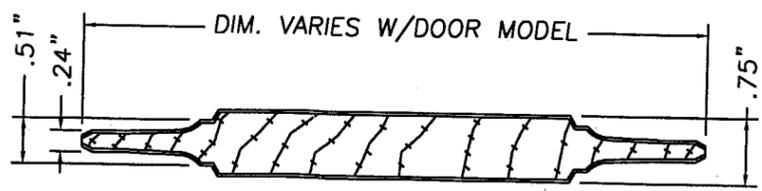

**INSET PANEL**  
SCALE: 1/2\"/>

- NOTES:
1. DOWELS ARE GLUED AND PRESSED 2.0" INTO THE RAILS AND STILES AT PANEL ASSEMBLY WITH PVA TYPE "1" EXTERIOR GLUE.
  2. THE INSET PANELS ARE NOT GLUED INTO THE STILES OR RAILS. THEY ARE LEFT TO FLOAT WITH THE DOOR AS IT EXPANDS AND CONTRACTS TO ELIMINATE DOOR CRACKING.


**JELD-WEN, INC.**  
31725 HIGHWAY 97 N.  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT: WOOD STILE & RAIL DOOR  
6-8 & 8-0 OPAGUE INSWING  
SINGLE W/ & W/O SIDELITES  
PART OR ASSEMBLY:  
GLAZING DETAILS  
& RAIL DETAILS


NO.	DATE	REVISIONS	BY
4	04-20-05	GENERAL REVISION WAR	
3	07/13/01	GENERAL REVISION TJH	
2	05/03/01	GENERAL REVISION TJH	
1	04/19/01	GENERAL REVISION TJH	

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No. **05-0830.19**  
Expiration Date **Aug 28, 2009**  
By **Chag I. Chanda**  
Miami Dade Product Control  
Division


DATE: 7-24-00
SCALE: 1 : 2
DWG. BY: TJH
CHK. BY: SS
DRAWING NO.: S-2037
SHEET 7 OF 9

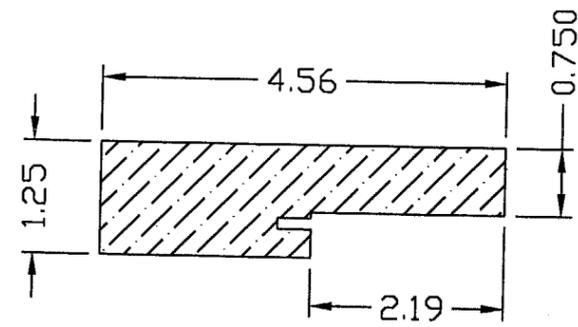


2 3 4 5 **WOOD JAMB**  
PONDEROSA PINE

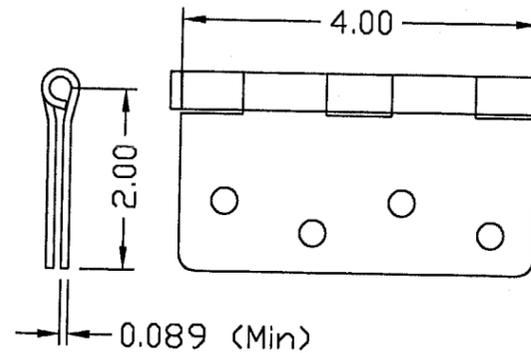


23 **BUTT HINGE**  
4 x 4 x 12GA STEEL

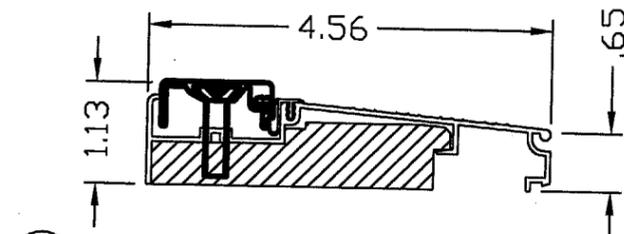


7 **ADJUSTABLE INSWING THRESHOLD**  
**AND SIDELITE SILL**  
.051" WALL THK.

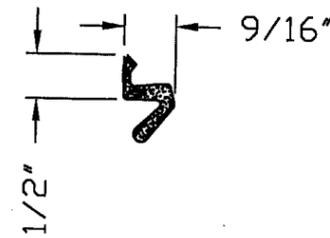


14 **COMPRESSION WEATHERSTRIP**  
QDS-650

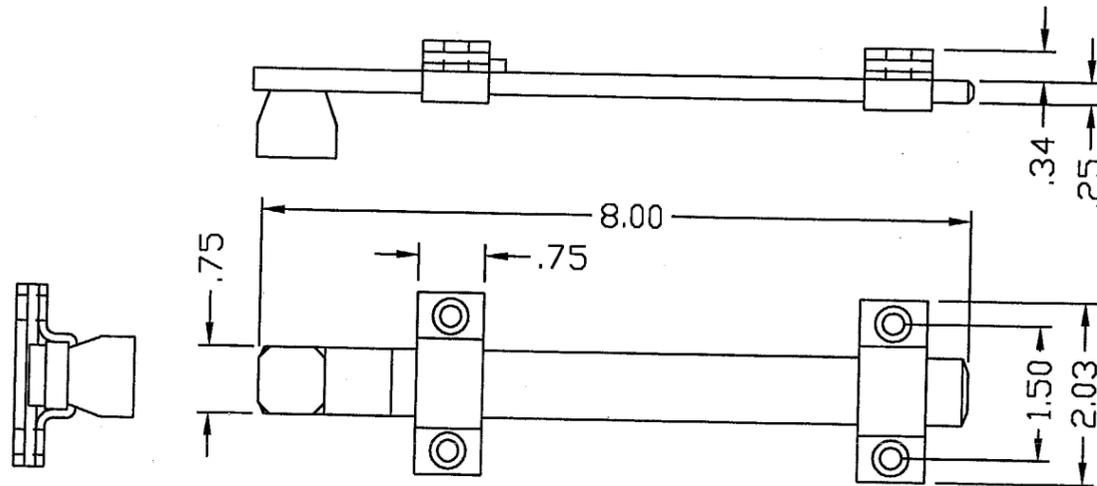

30 **SURFACE BOLT**  
IVES #455, (.25" STEEL)



34 **INSWING DOOR BOTTOM SWEEP**  
EXTRUDED VINYL

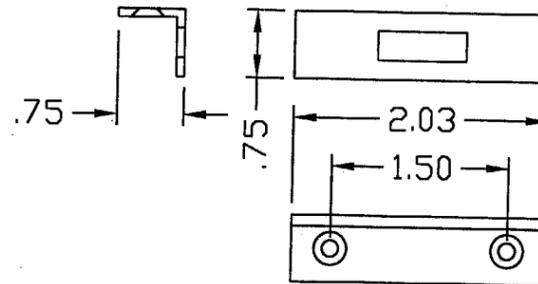

31 **SURFACE BOLT STRIKE**  
IVES .125" STEEL

Item	DESCRIPTION	Material
1	PREMIUM STILE & RAIL 6-8/8-0 WOOD DOOR (DOUGLAS FIR, WESTERN HEMLOCK, PONDEROSA PINE, NORTHERN RED OAK, RED MAPLE, BLACK CHERRY, YELLOW POPLAR, TRUE HICKORY, TRUE MAHOGANY, BLACK WALNUT, & RED ALDER)	PINE
2	HEAD JAMB (1 1/4" x 4 9/16" PONDEROSA PINE)	PINE
3	LATCH JAMB (1 1/4" x 4 9/16" PONDEROSA PINE)	PINE
4	HINGE JAMB (1 1/4" x 4 9/16" PONDEROSA PINE)	PINE
5	BLANK JAMB (1 1/4" x 4 9/16" PONDEROSA PINE)	PINE
6	1/2" INSULATED TEMPERED GLASS (BY PPG)	GLASS
7	INSWING ADJUSTABLE THRESHOLD (BY IMPERIAL .051" WALL)	ALUMINUM
8	#8 x 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
9	1/4" x 2 3/4" LG. TAPCON OR ITW BUILDDEX TAPCON, OR ELCO TAPCON	STEEL
10	SILICONE CAULK (CR LAWRENCE 33S)	SILICONE
11	WOOD CAP FOR OPAQUE INSET PANEL	WOOD
12	2x WOOD BUCK	WOOD
13	1/4" MAX. SHIMS	WOOD
14	COMPRESSION WEATHERSTRIP (Q-LON QDS-650)	FOAM
15	#10 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
16	PREMIUM STYLE & RAIL 6-8/8-0 WOOD SIDELITE	PINE
17	KWIKSET TITAN 400 SERIES LOCK	
18	1/4" x 1 3/8" WOOD MULLION CAP	PINE
19	LVL MULLION SPACER 5/8" x 4 9/16"	LVL
20	WOOD CAP FOR .50" THK. GLASS	PINE
21	BRAD TRIM NAIL 1 1/2" L.	STEEL
22	GLAZING COMPOUND (PRC 365 BY DE-SOTO INTER.)	SILICONE
23	4" x 4" BUTT HINGE 12GA. (.089" MIN)	STEEL
24	#9 x 1" PHILLIPS FLATHEAD WOOD SCREW	STEEL
25	#10 x 3" PHILLIPS FLATHEAD WOOD SCREW	STEEL
26	KWIKSET TITAN SERIES DEADBOLT	
27	WOOD GLASS STOP FOR .50" THK GLASS	PINE
28	#10 x 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
29	BRAD TRIM NAIL 1" L.	STEEL
30	SURFACE BOLT (IVES, .25" STEEL)	STEEL
31	SURFACE BOLT STRIKE PLATE (IVES, .125" STEEL)	STEEL
32	1/4-20 SEX BOLT W/1/4-20 FEMALE END x 1 1/2" L	STEEL
33	#10 x 1-1/4" PHILLIPS FLATHEAD WOOD SCREW	STEEL
34	INSWING DOOR BOTTOM SWEEP	VINYL

*James D. Obrowski*  
8-22-05









JELD-WEN, INC.  
31725 HIGHWAY 97 N.  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT: WOOD STILE & RAIL DOOR  
6-8 & 8-0 OPAQUE INSWING  
SINGLE W/ & W/O SIDELITES  
PART OR ASSEMBLY:  
FRAME COMPONENTS  
AND BILL OF MATERIAL

NO.	DATE	REVISIONS	BY
3	03-05-05	GENERAL REVISION	WAR
2	08/23/01	GENERAL REVISION	TJH
1	04/06/01	GENERAL REVISION	TJH










**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No 05-0830.19  
Expiration Date AUG 28, 2009  
By *Shawn L. Chanels*  
Miami Dade Product Control  
Division

DATE: 7-24-00  
SCALE: 1 : 2  
DWG. BY: TJH  
CHK. BY: SS  
DRAWING NO.:  
S-2037  
SHEET 8 of 9

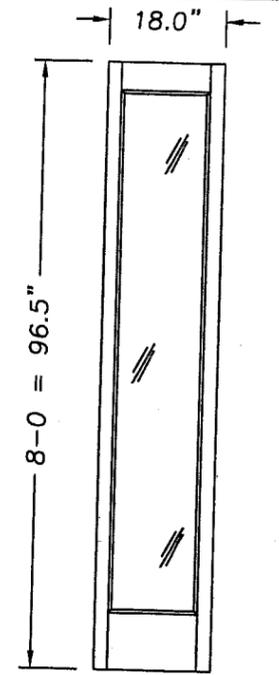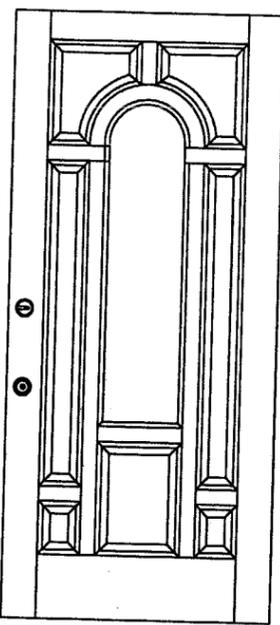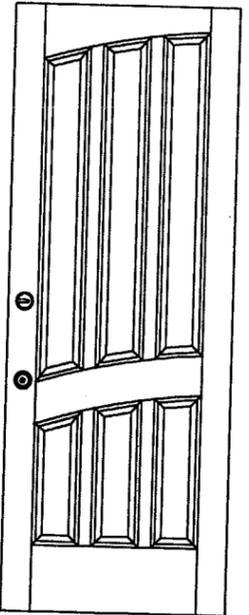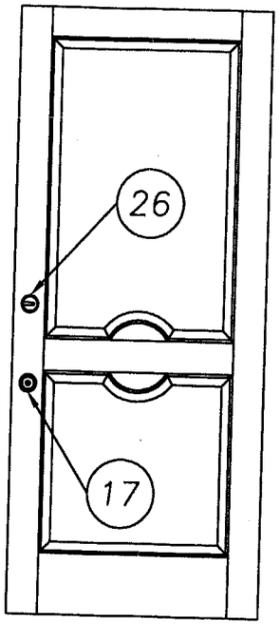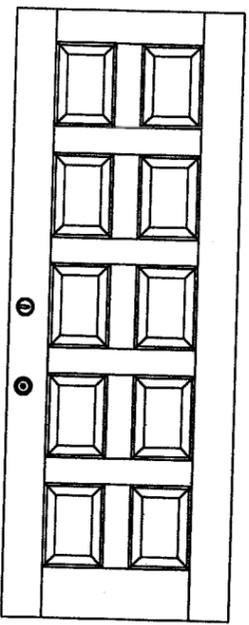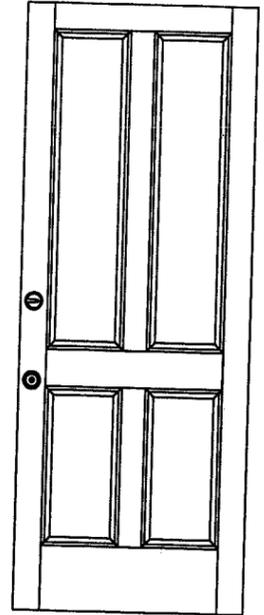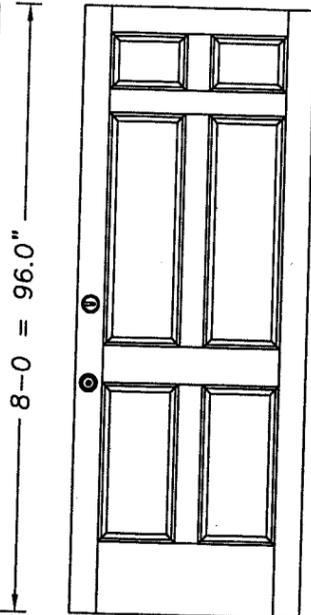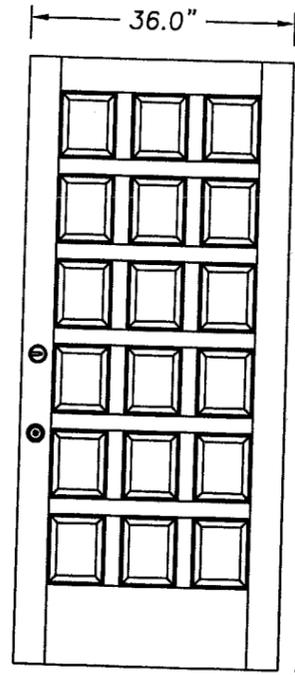




8-0 DOOR MODELS N.T.S. (OPAQUE)

8-0 SIDELITE MODEL

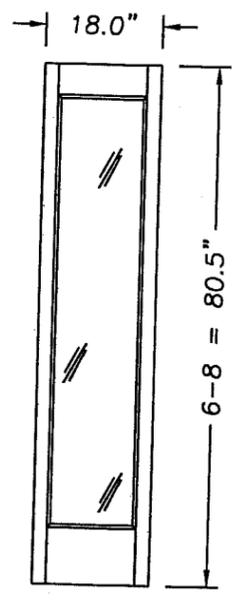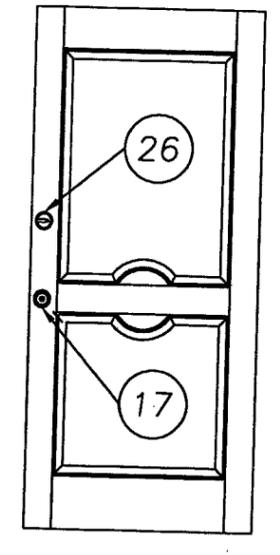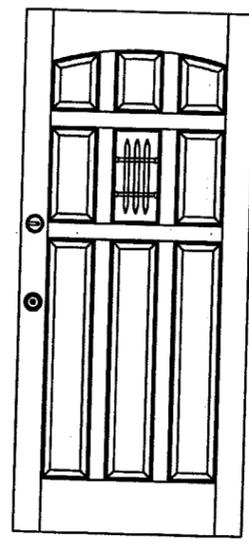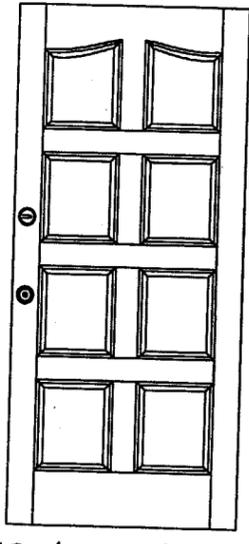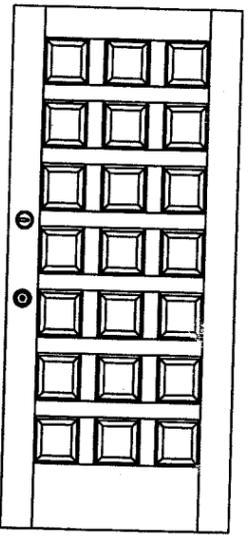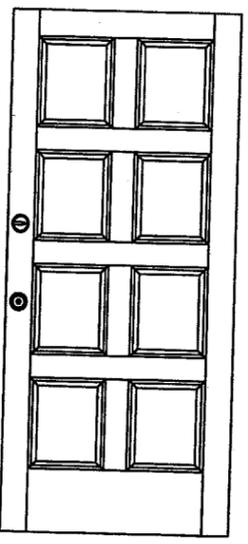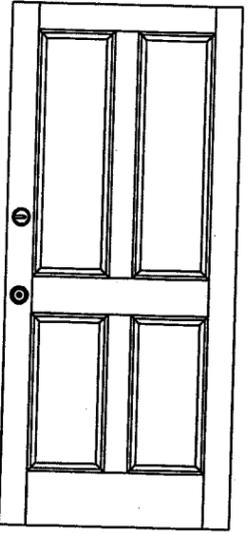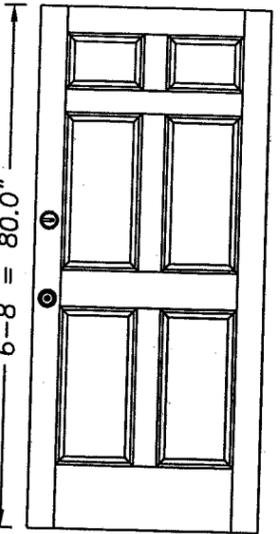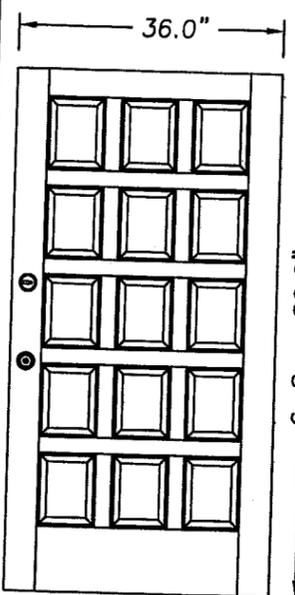

6-8 DOOR MODELS N.T.S. (OPAQUE)

6-8 SIDELITE MODEL

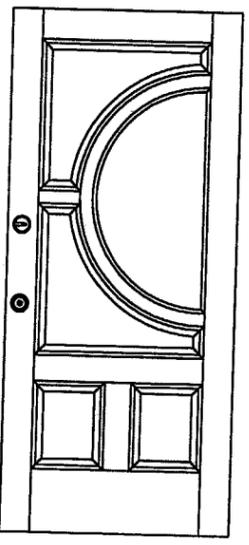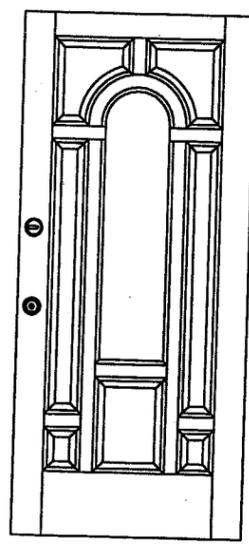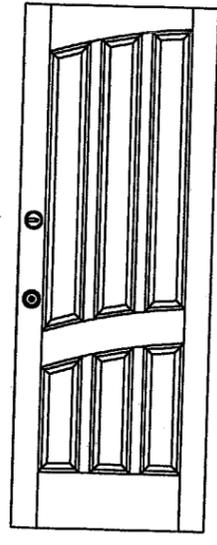

*James D. Otroubek*  
8-22-05

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No 05-0830.19  
Expiration Date *AVG 28, 2009*  
By *(Shag) I. Chanda*  
Miami Dade Product Control  
Division

DATE:	7/21/00
SCALE:	NTS
DWG. BY:	TJH
CHK. BY:	RW
DRAWING NO.:	S-2037
SHEET	9 of 9

PRODUCT: WOOD STILE & RAIL DOOR  
OPAQUE 6-8/8-0 INSWING  
SINGLE W/ & W/O SIDELITES  
PART OR ASSEMBLY:

NO.	DATE	REVISIONS	BY
3	07/13/01	GENERAL REVISION	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/19/01	GENERAL REVISION	TJH

JELD-WEN, INC.  
401 Harbor Isles Blvd  
Klamath Falls, OR 97601  
PH. 1.800.JELD.WEN

DOOR MODELS