



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

**Sun-Tek Manufacturing, Inc.  
10303 General Drive  
Orlando, Florida 32824**

**SCOPE:** This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone.

**DESCRIPTION: Curb Mount Aluminum-Dade Skylight.**

**APPROVAL DOCUMENT:** Drawing No. CMA-D 004, titled "Curb-Mount Aluminum-Dade Skylight", sheets 1 and 2, prepared by Sun-Tek Industries Inc, dated 05/18/00 with no revisions bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large & Small Missile Impact**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved or MDCPCA", unless otherwise noted herein and the dome shall be properly marked by the manufacturers of Lexan, GE Co. and/or IYZOD, DMM.

**RENEWAL** of this NOA shall not be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA n# 00-1024.03 consists of this page, evidence page and approval document mentioned above

The submitted documentation was reviewed by **Candido F. Font, P.E.**

*Candido F. Font*  
03/09/06



**NOA No. 05-1018.03  
Expiration Date: February 22, 2011  
Approval Date: March 9, 2006  
Page 1**

**Sun-Tek Manufacturing, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE PAGE**

**A. DRAWINGS**

1. Drawing prepared by Sun-Tek Industries, Inc., titled "Curb-Mount Aluminum-Dade Skylight", drawing No. CMA-D 004, dated 05/18/00, with no revisions, sheet 1 and 2, signed and sealed by M. Martinez PE.

**B. TEST REPORTS**

1. Test report on Large Missile Impact Test per TAS 201, Cyclic Wind Pressure Test per TAS 203 and Uniform Static Air Pressure Test per TAS 202 on "Model "CMA-D polycarbonate Dome Skylight (double dome utilizing 6" wood curb)", prepared by National Certified Testing Laboratories, Report No: NCTL 210-2364-1.2.3 dated 06/21/00, signed and sealed by B. D. Portnoy, PE.

**C. CALCULATIONS**

1. Anchor calculations of CMA-D Polycarbonate Dome Skylight, dated 09/05/00, pages 1 through 22 of 22, prepared by Product Application Engineering Inc, signed and sealed by M. Martinez PE.

**D. QUALITY ASSURANCE**

1. Building Code Compliance Office.

**E. MATERIAL CERTIFICATION**

1. Notice of Acceptance No. 03-1210.04 issued to General Electric on 12/03/04 reviewed by C. F. Font PE and expiring on 07/17/08.
2. Notice of Acceptance No. 01-0709.07 issued to Sheffield Plastics Inc, on 08/23/01, reviewed by C. F. font PE and expiring on 08/27/06.

**F. STATEMENTS**

1. Letter of Code compliance and No financial interest issued by Product & Application Engineering, on 10/13/00, signed and sealed by M. Martinez PE.



03/09/06

Candido F. Font, P. E.

Senior Product Control Examiner


NOA No. 05-1018.03

Expiration Date: February 22, 2011

Approval Date: March 9, 2006

FOR DETAILS SEE DRAWING  
# CMA-D-004 PAGE 2 OF 2

DESIGN PRESSURE RATING  
+- 60 PSF.  
LARGE MISSILE IMPACT RESISTANCE

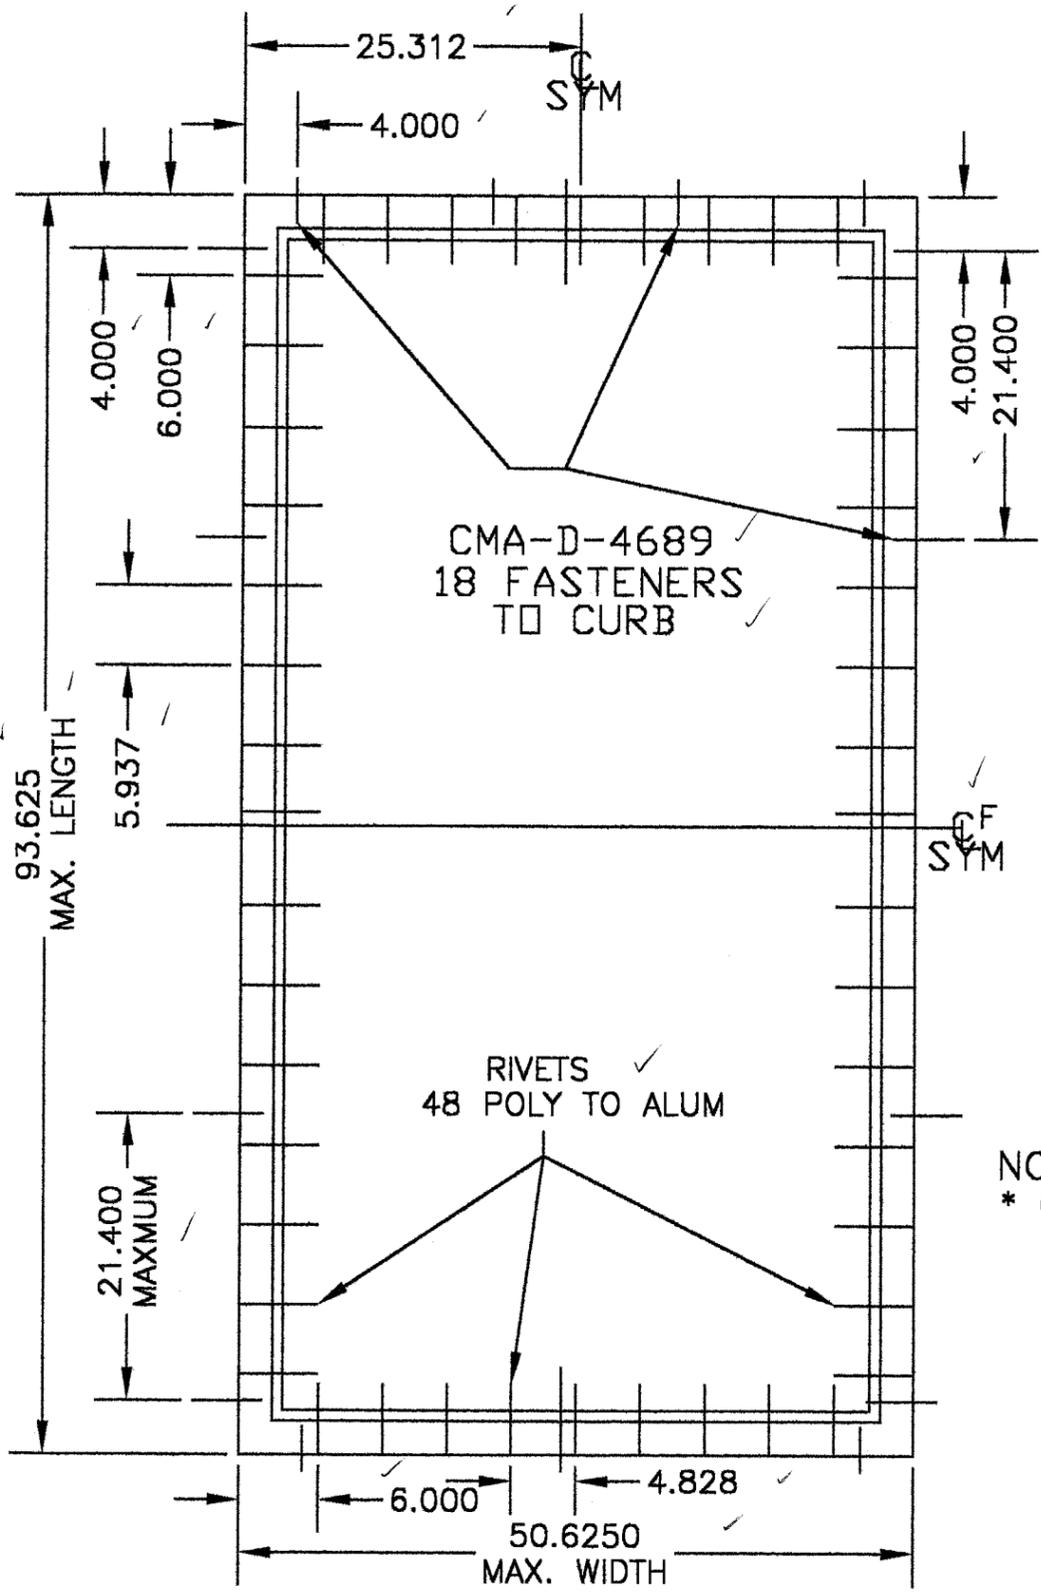


FASTENER SCHEDULE DOME TO CURB #12 X 2" PHILLIPS PAN HEAD SCREWS		RIVET SCHEDULE DOME TO DECO RING 3/16 X 3/4" POP RIVET		
MODEL	PER LONG SIDE	PER SHORT SIDE	PER LONG SIDE	PER SHORT SIDE
4689	5	4	15	9
4669	5	4	15	9
4646	4	4	9	9
3636	3	4	7	7
3069	6	3	12	6
3046	4	3	9	6
3030	3	3	6	6
2269	5	3	12	4

FASTENER SCHEDULE CURB TO DECK #10 X 2-1/2" DECK SCREWS		
MODEL	PER LONG SIDE	PER SHORT SIDE
4689	8	4
4669	7	4
4646	5	4
3636	4	4
3069	7	4
3046	5	3
3030	3	3
2269	7	3

NOTE:  
\* (1) ALL ROOFING DETAILS SHALL COMPLY WITH CHAPTER 15 OF THE FLORIDA BUILDING CODE  
(2) 4" MINIMUM DISTANCE FROM ANGLE LIP TO ROOF SURFACE IS FOR SHINGLE OR B.U.R. WITHOUT INSULATION. FOR INSULATION AND TILE ROOF ADD TILE HEIGHT AND INSULATION THICKNESS TO 4" MINIMUM HEIGHT.


PRODUCT RENEWED  
as complying with the Florida  
Building Code  
Approval No. 05-1018.03  
Expiration Date 02/22/11  
By [Signature]  
Product Control  
Division

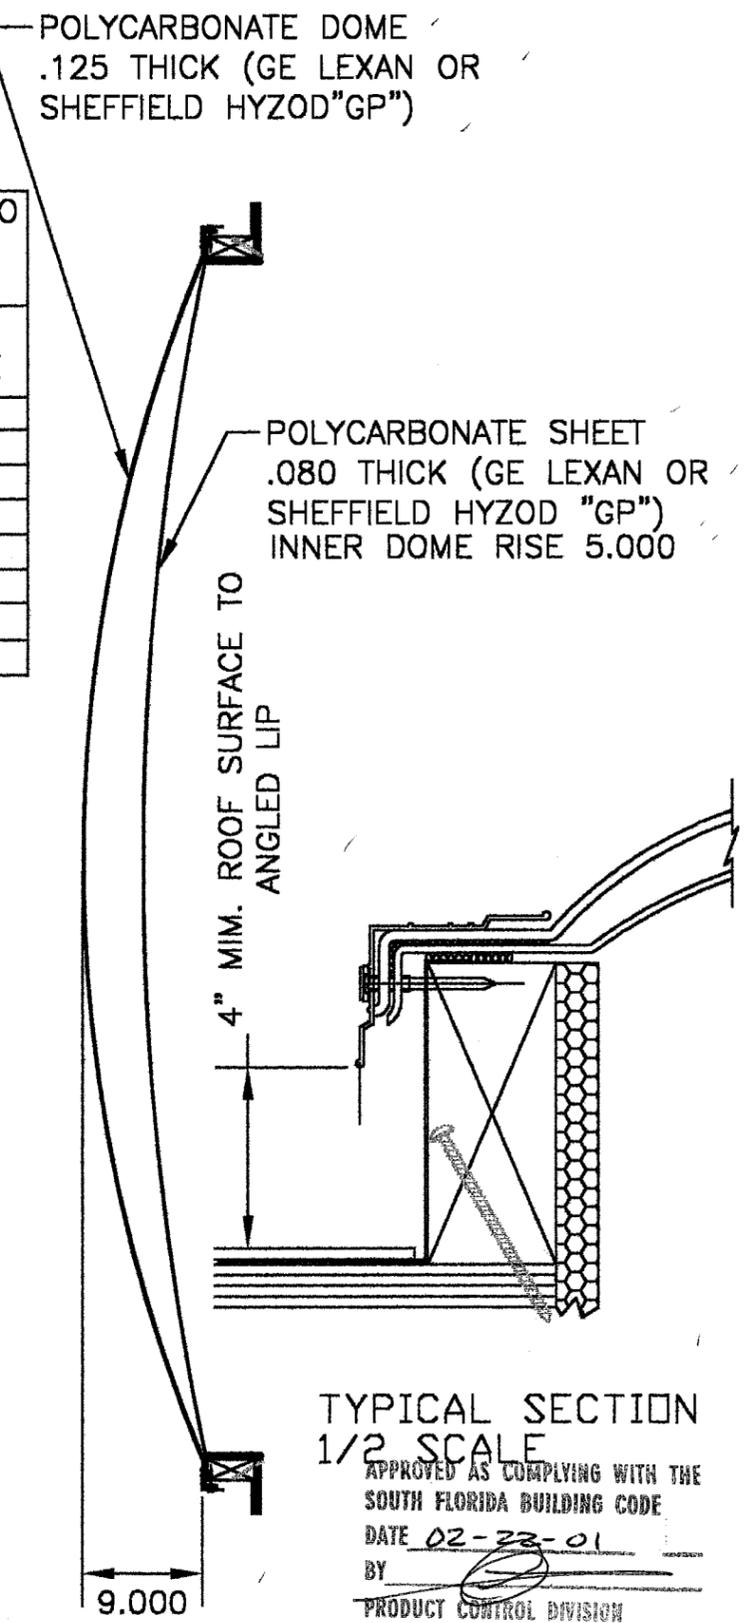

TYPICAL SECTION  
1/2 SCALE  
APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE 02-22-01  
BY [Signature]  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-1024.03

#12 X 2" PHILLIPS PAN HEAD SCREW  
(5) ON LONG SIDE & (4) ON SHORT SIDE

DESIGN PRESSURE RATING  
+- 60 PSF.  
LARGE MISSILE IMPACT RESISTANCE

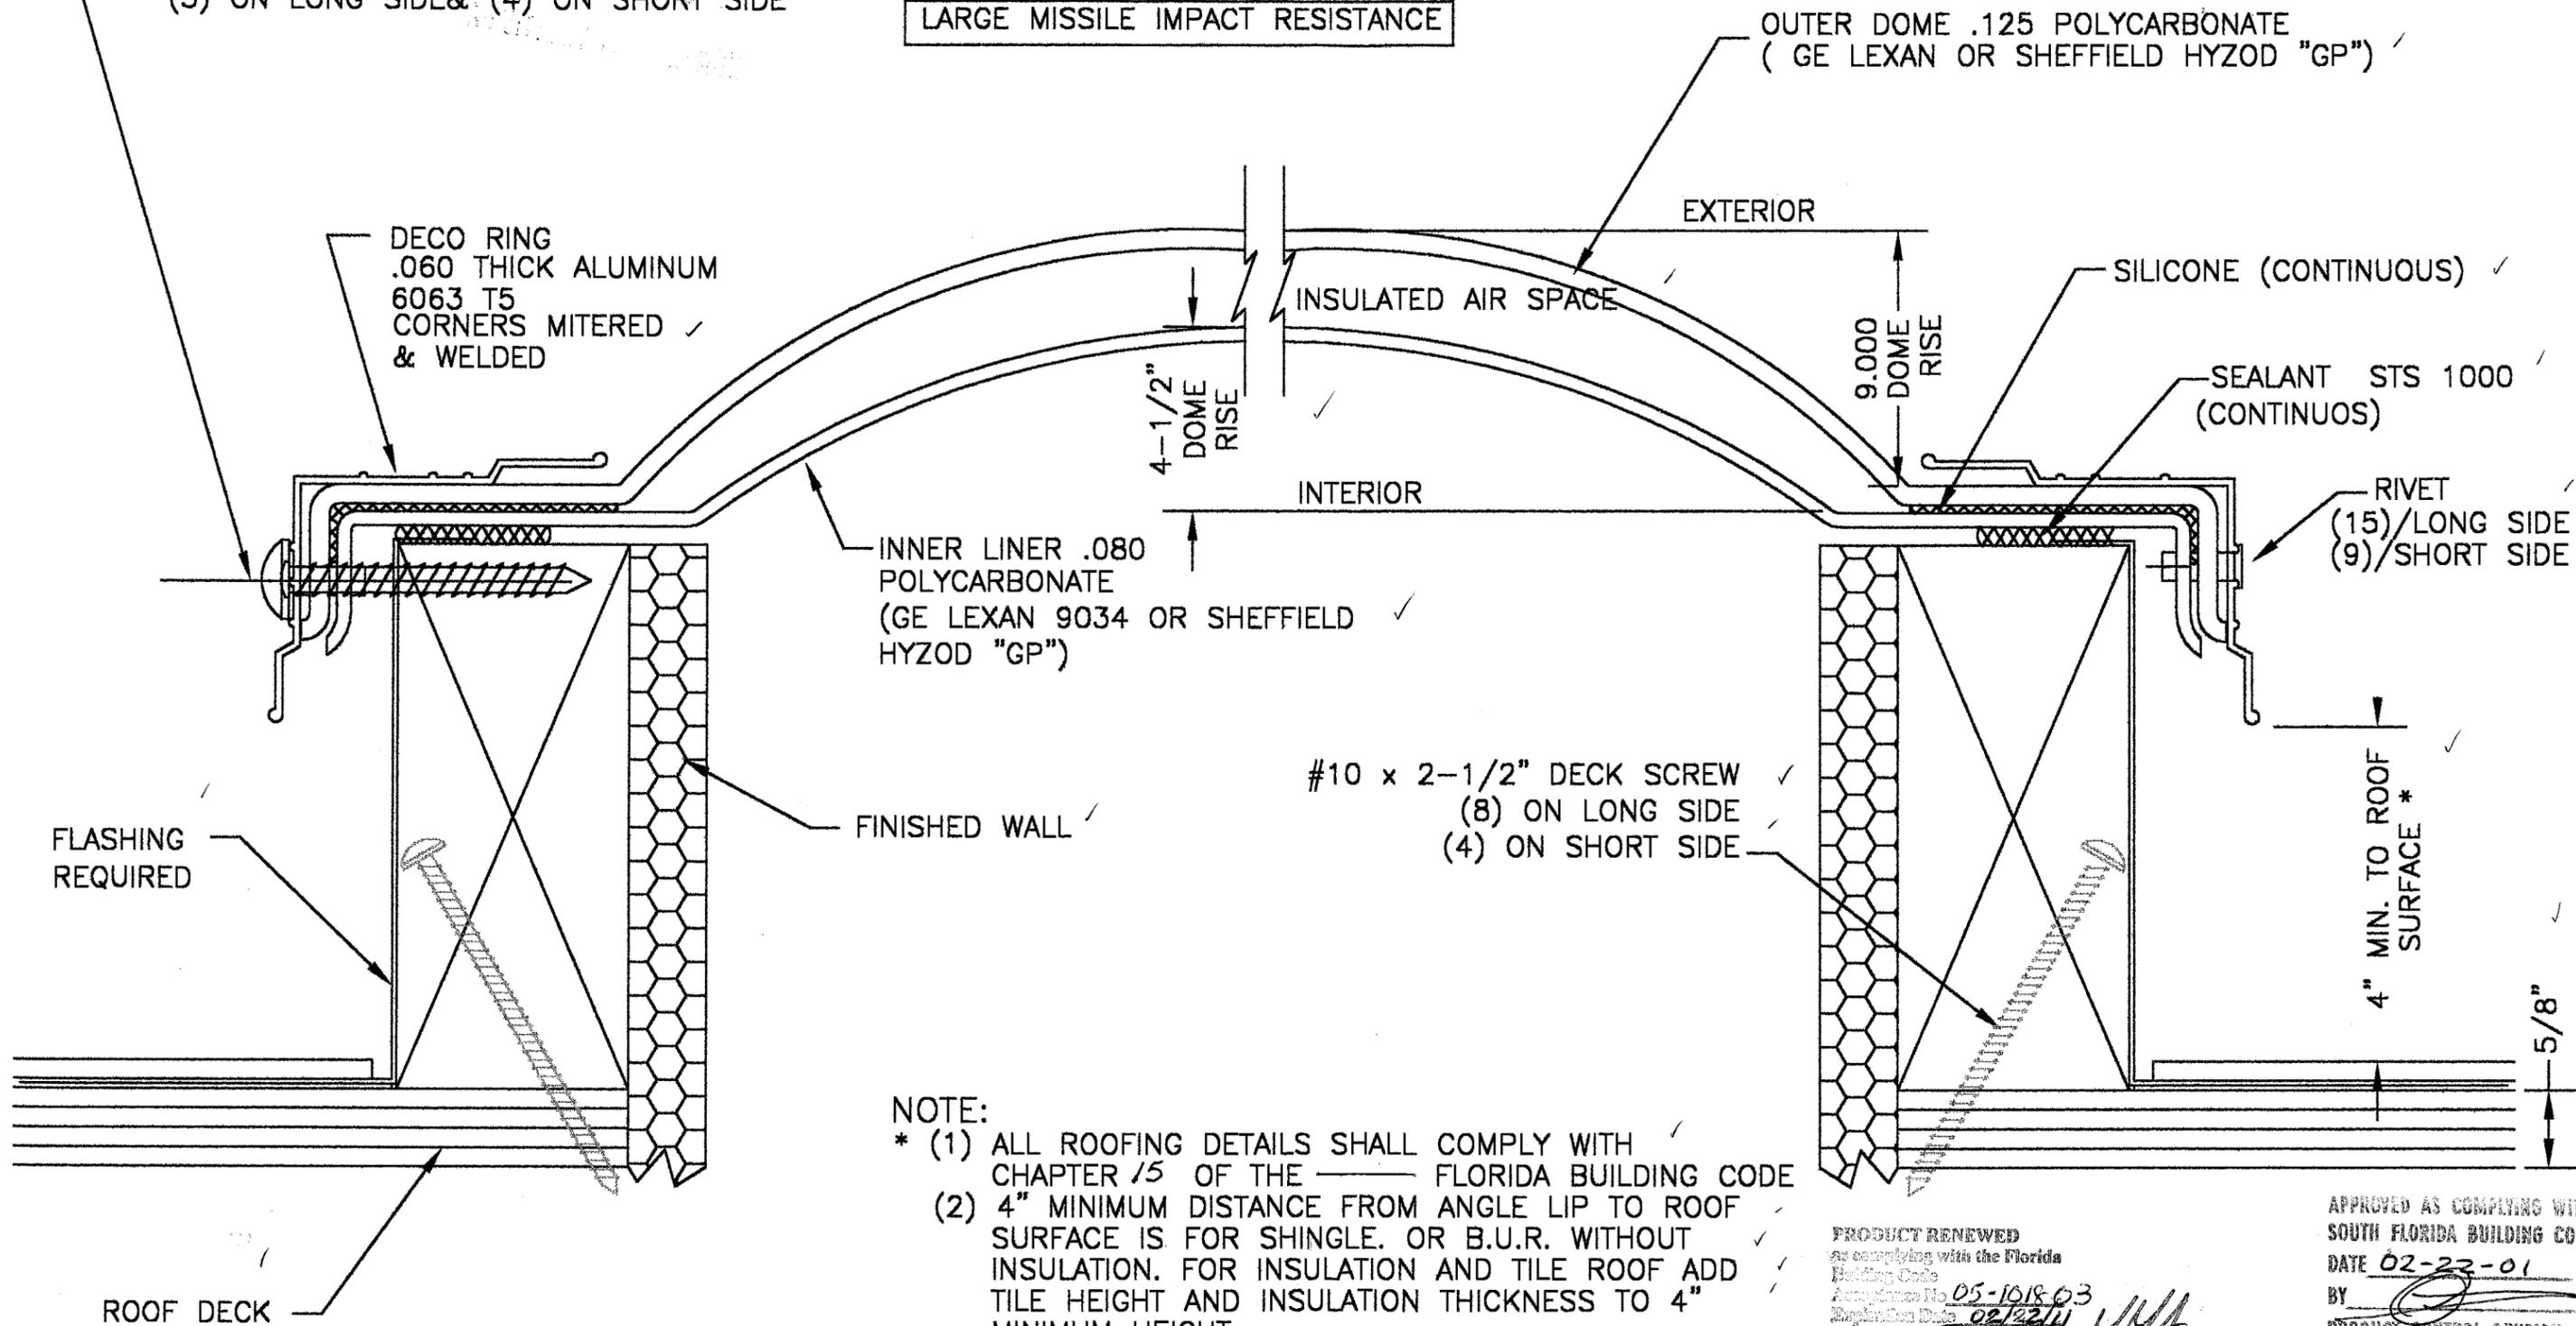

NOTE:  
 \* (1) ALL ROOFING DETAILS SHALL COMPLY WITH CHAPTER 15 OF THE FLORIDA BUILDING CODE  
 (2) 4" MINIMUM DISTANCE FROM ANGLE LIP TO ROOF SURFACE IS FOR SHINGLE. OR B.U.R. WITHOUT INSULATION. FOR INSULATION AND TILE ROOF ADD TILE HEIGHT AND INSULATION THICKNESS TO 4" MINIMUM HEIGHT.

PRODUCT RENEWED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 05-1018-03  
 Expiration Date 02/22/11  
 By: [Signature]  
 Division: Product Control

APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE 02-22-01  
 BY: [Signature]  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 00-1024.03

01-17-01

REVISION:	REVISION:	PRODUCT NAME:	CMA-D
INI:	DATE:	DATE:	05/18/00

SCALE:	DWG No. CMA-D-004
--------	-------------------

SUN-TEK INDUSTRIES, INC. 10303 GENERAL DRIVE ORLANDO, FL 32824