



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING

140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

www.buildingcodeonline.com

NOTICE OF ACCEPTANCE (NOA)

W. A. Brown & Son, Inc.
209 Long Meadow Drive
Salisbury, NC 28147

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Walk-In Cooler / Freezer

APPROVAL DOCUMENT: Drawing No. 04-075, titled "Walk-In Cooler / Freezer", sheets 1 through 5 of 5, prepared by Thornton Tomasetti Group, signed and sealed by John W. Knezevich, P.E., dated February 22, 2005, last revision #2 dated August 29, 2005, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises **NOA 03-0410.05** and consists of this page 1, evidence submitted pages E-1 & E-2 as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E.**

Helmy A. Makar
 06/01/2006

NOA No 05-1103.01
Expiration Date: 06/02/2010
Approval Date: 06/01/2006



W. A. Brown & Son, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 03-0410.05

A. DRAWINGS

1. *Drawing No. 04-075, titled "Walk-In Cooler / Freezer", sheets 1 through 5 of 5, prepared by Thornton Tomasetti Group, signed and sealed by John W. Knezevich, P.E., dated February 22, 2005, last revision #1 dated April 27, 2005.*

B. TESTS

1. *Test report on Large Missile Impact Test, Cyclic Load Test and Uniform Static air Pressure Test, Axial Load Test, and Racking load Test on Metal Sheathed Urethane Foam Filled Modular Panel Walk-in Coolers / Freezers, prepared by Construction Testing Corporation, Report No.04-019, dated December 17, 2004, signed and sealed by Yamil G. Kuri, P.E.*

C. CALCULATIONS


1. *Calculation titled "Walk-in Cooler / Freezer", dated March 01, 2005, pages 1 through 10 of 10, prepared by Thornton Tomasetti Group, signed and sealed by John W. Knezevich, P.E.*
2. *Revised calculation titled "Walk-in Cooler / Freezer", dated April 27, 2005, 6 pages, prepared by Thornton Tomasetti Group, signed and sealed by John W. Knezevich, P.E.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *Mill Certified Test Report issued by GalvTech, dated 12/19/2002, with the Chemical analysis and Mechanical Properties for (0.025") G-60 Steel conforming to ASTM A-653.*
2. *Mill Certified Test Report issued by Alcoa Mill Products, dated 12/16/2002, with the Chemical composition and Mechanical Properties for 0.030" thick 3105-H154 Aluminum Alloy.*
3. *Tensile Test Report No. CTL #1239, prepared by Certified Testing Laboratories, dated 12/17/2004, signed and sealed by Ramesh Patel, P.E.*
4. *Tensile Test Report No. CTL #1237, prepared by Certified Testing Laboratories, dated 12/17/2004, signed and sealed by Ramesh Patel, P.E.*



Helmy A. Makar, P. E.
Product Control Examiner
NOA No 05-1103.01
Expiration Date: 06/02/2010
Approval Date: 06/01/2006

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. *Drawing No. 04-075, titled "Walk-In Cooler / Freezer", sheets 1 through 5 of 5, prepared by Thornton Tomasetti Group, signed and sealed by John W. Knezevich, P.E., dated February 22, 2005, last revision #2 dated August 29, 2005.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *None.*



Helmy A. Makar, P. E.
Product Control Examiner
NOA No 05-1103.01
Expiration Date: 06/02/2010
Approval Date: 06/01/2006







Print Information: P:\FL1\Projects\KK4075.00\Drawings\R2-sub\04-075-01.dwg Mcentu 10/14/2005 10:32:24am 04/27/05 15:36

GENERAL NOTES:

- THESE APPROVAL DOCUMENTS REPRESENT A WALK-IN COOLER/FREEZER SYSTEM ANALYZED WITH THE PROVISION SET FOR THE ISSUANCE OF A NOTICE OF ACCEPTANCE (NOA) BY MIAMI-DADE COUNTY PRODUCT CONTROL DIVISION. THESE DOCUMENTS COMPLY WITH THE HIGH VELOCITY HURRICANE ZONE (HVHZ) PROVISIONS OF THE FLORIDA BUILDING CODE (FBC), 2004 EDITION.
- FOR AREAS OUTSIDE OF THE HVHZ, SITE SPECIFIC ENGINEERING IS REQUIRED TO VERIFY THE SITE SPECIFIC DESIGN WIND LOADS AND PANEL TESTING COMPLY WITH THE TESTING REQUIREMENTS OF FBC SECTION 1714.3.1.
- DESIGN LOADS:
 - ROOF:
 - DEAD LOAD: PANEL TYPE RP 3.50 PSF
 - LIVE LOAD: 30.00 PSF
 - WALLS:
 - DEAD LOAD: PANEL TYPE WP 2.60 PSF
 - FLOOR:
 - DEAD LOAD: FLOOR PANEL 5.00 PSF
 - LIVE LOAD: INSULATED FLOOR 250.00 PSF
"FLOORLESS" 250.00 PSF
 - WIND LOADS SHALL BE DETERMINED IN ACCORDANCE WITH ASCE 7-98 BASED ON THE SITE SPECIFIC CONDITIONS. SEE TABLE 3 ON SHEET 2 FOR ALLOWABLE WIND LOADS USED IN THE DESIGN OF THESE DOCUMENTS.
- THESE APPROVAL DOCUMENTS ARE GENERIC AND DO NOT INCLUDE INFORMATION FOR SITE-SPECIFIC APPLICATION OF THIS WALK-IN COOLER/FREEZER SYSTEM.
- THESE APPROVAL DOCUMENTS SHALL NOT BE APPLIED BY THE CONTRACTOR, ON A SPECIFIC SITE WITHOUT THE INVOLVEMENT OF AN ARCHITECT OR ENGINEER OF RECORD.
 - THE ARCHITECT/ENGINEER OF RECORD SHALL VERIFY THE SITE SPECIFIC WIND LOAD REQUIREMENTS ARE WITHIN THE CRITERIA USED TO DEVELOP THESE DOCUMENTS.
 - THE ARCHITECT/ENGINEER OF RECORD SHALL VERIFY THE FOUNDATION DESIGN IS ADEQUATE TO RESIST THE FOUNDATION LOADS IDENTIFIED IN TABLE 1.
- THESE APPROVAL DOCUMENTS COMPLY WITH CHAPTER 61G15-23 OF THE FLORIDA ADMINISTRATIVE CODE.
- ANY MODIFICATIONS OR ADDITIONS TO THESE APPROVAL DOCUMENTS WILL VOID THE APPROVAL DOCUMENTS.
- WHEN THE SITE CONDITIONS DEVIATE FROM THESE APPROVAL DOCUMENTS, THE BUILDING OFFICIAL MAY ELECT ONE OF THE FOLLOWING OPTIONS:
 - REQUIRE THAT SITE SPECIFIC DOCUMENTS BE PREPARED, SIGNED, DATED AND SEALED BY A LICENSED ENGINEER OR REGISTERED ARCHITECT, WHICH DETAIL AND JUSTIFY THE DEVIATION. SAID DOCUMENTS SHALL BE SUBMITTED TO THE PRODUCT ENGINEER FOR REVIEW AS A CONDITION TO THE BUILDING OFFICIAL GRANTING HIS/HER APPROVAL.
 - REQUIRE THAT A ONE-TIME SITE SPECIFIC APPROVAL BE APPLIED FOR AND SECURED FROM THE MIAMI-DADE COUNTY PRODUCT CONTROL DIVISION.
- WHEN THE SITE CONDITION DEVIATIONS OCCUR WITHIN THE HIGH VELOCITY HURRICANE ZONE AREAS ONLY OPTION "B", ABOVE, SHALL BE ACCEPTED BY THE BUILDING OFFICIAL.
- ALL BOLTS AND SCREWS SHALL BE 2024-T4 ALUMINUM ALLOY, ELECTRO-GALVANIZED STEEL, HOT DIPPED GALVANIZED STEEL OR 300 SERIES STAINLESS STEEL WITH A MIN. TENSILE STRENGTH OF 60 KSI.
- ALL CONCRETE ANCHORS SHALL BE AS SPECIFIED ON THE DRAWINGS. EMBEDMENT LENGTHS NOTED ON THE DRAWINGS SHALL NOT INCLUDE FINISH MATERIAL.
- DISSIMILAR METALS IN CONTACT WITH EACH OTHER SHALL BE PROTECTED IN ACCORDANCE WITH THE FBC CHAPTER 20, SECTION 2003.8.4.
- AN ALLOWABLE STRESS INCREASE IS NOT USED IN THE DESIGN OF THE COOLER/FREEZER UNIT NOR ITS ATTACHMENTS.

RIGID URETHANE FOAM SANDWICH PANEL SPECIFICATIONS

- WALL & ROOF COMPOSITE SANDWICH PANELS ARE COMPRISED OF ALUMINUM OR STEEL FACINGS WITH POURED URETHANE PLASTIC CORES. THICKNESS AND MATERIAL OF FACINGS SHALL BE AS SHOWN ON THE DRAWINGS.
- ALUMINUM FACINGS SHALL BE 0.032" 3105-H154 ALLOY WITH MIN. $F_y = 23.5$ KSI FOR INTERIOR AND EXTERIOR USE.
- STEEL FACINGS SHALL COMPLY WITH ASTM A 653 CQ WITH A MIN. $F_y 25.5$ KSI, MIN. THICKNESS OF 0.027" WITH G90 COATING.
- MINIMUM DENSITY OF URETHANE PANEL CORE SHALL BE 1.9 PCF
- URETHANE FOAM CORE SHALL HAVE A FLAME SPREAD RATING OF NOT MORE THAN 75 AND SHALL HAVE A SMOKE-DEVELOPED RATING OF NOT MORE THAN 450 IN ACCORDANCE WITH FBC 2603.3.
- FOAM APPLICATION AS PER MANUFACTURER'S SPECIFICATION AND QUALITY CONTROL.
- FOR SPECIFIC REQUIREMENTS OF WALK-IN COOLERS SEE FBC 2603.4.1.2.

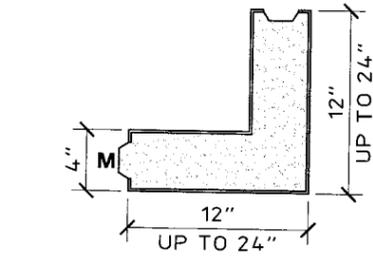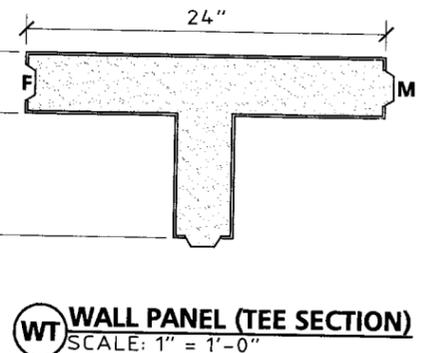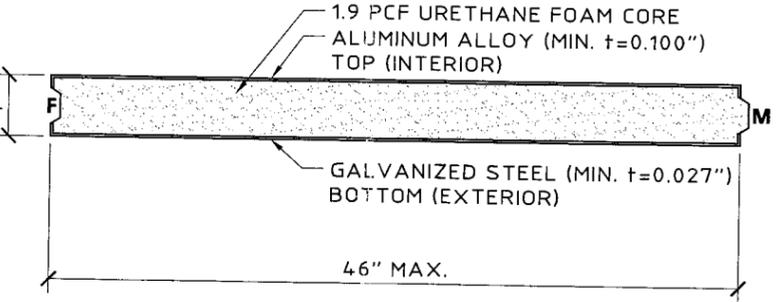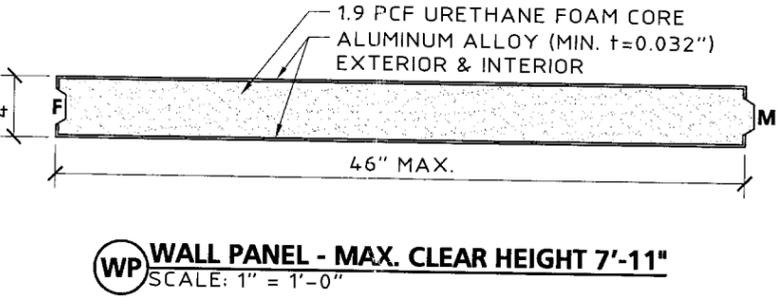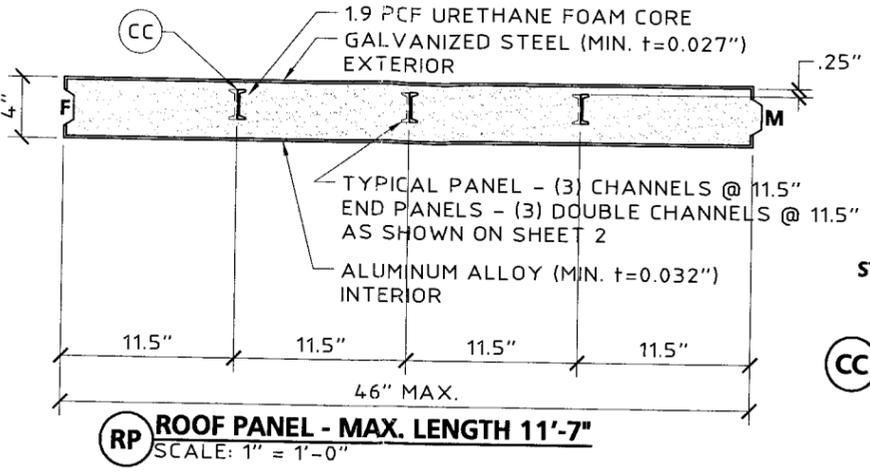

Thornton-Tomasetti Group
 330 N. Andrews Ave., Suite 450 • Ft. Lauderdale, FL 33301
 Tel. (954) 522-3690 • Fax (954) 572-3891 • COA # 7319
 Website: www.TheTTGroup.com
 Copyright © 2005 Thornton-Tomasetti Group, Inc.

WALK-IN COOLER/FREEZER

W.A. Brown & Son Inc.
 209 Long Meadow Dr.
 Salisbury, NC 28147
 tel: (800) 438-2316
 fax: (704) 637-0919

John W. Knezevich
 Professional Engineer
 FL License No.: PE 0041961

OCT 14 2005

no.	date	description
1	04/27/05ZMS	COUNTY COMMENTS
2	08/22/05JMS	FLORIDA BUILDING CODE 2004 UP-DA IE

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No. **05-1103.01**
 Expiration Date **06/02/2010**
 By *Helmut A. Mabe*
 Miami Dade Product Control Division


date **02/22/2005**

scale **AS NOTED** drawn by **MCR**


design by **ZMS** checked by **JWK**

drawing no. **04-075**


sheet 1 of 5

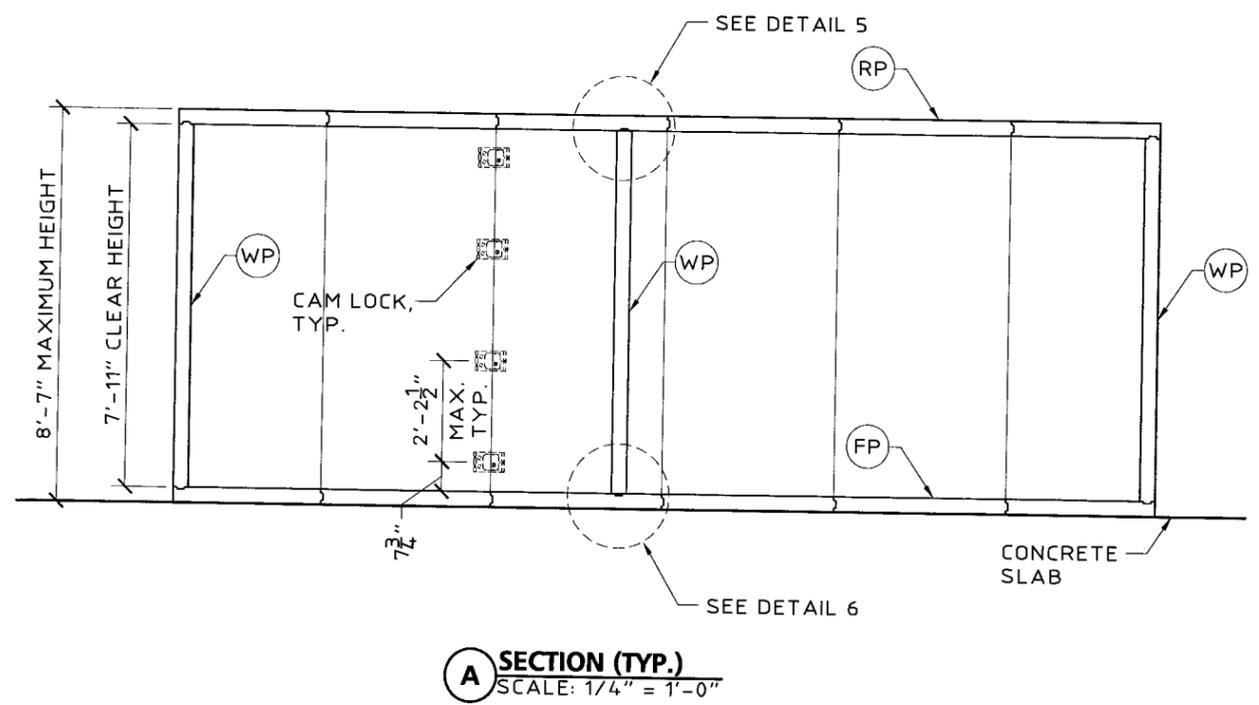


A SECTION (TYP.)
SCALE: 1/4" = 1'-0"

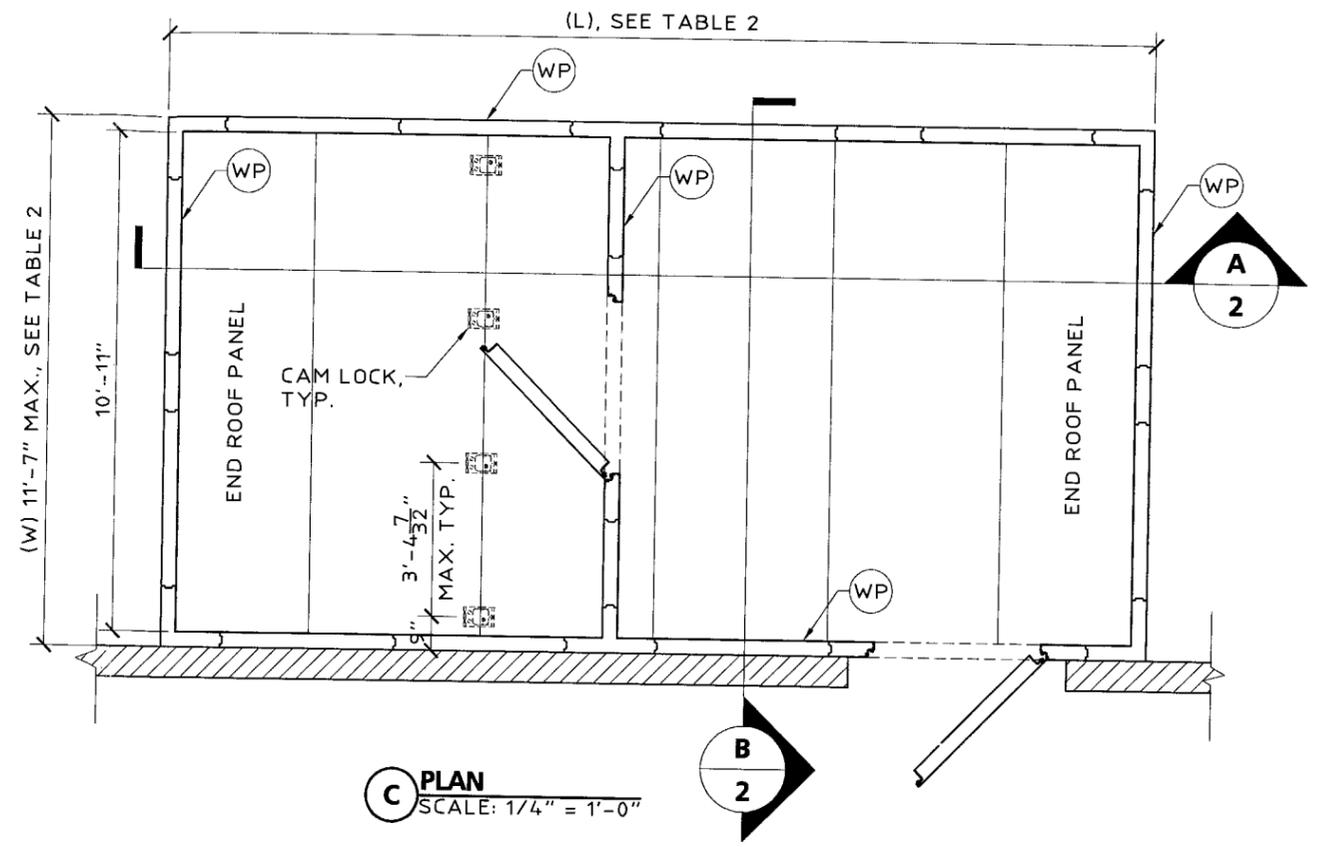


C PLAN
SCALE: 1/4" = 1'-0"

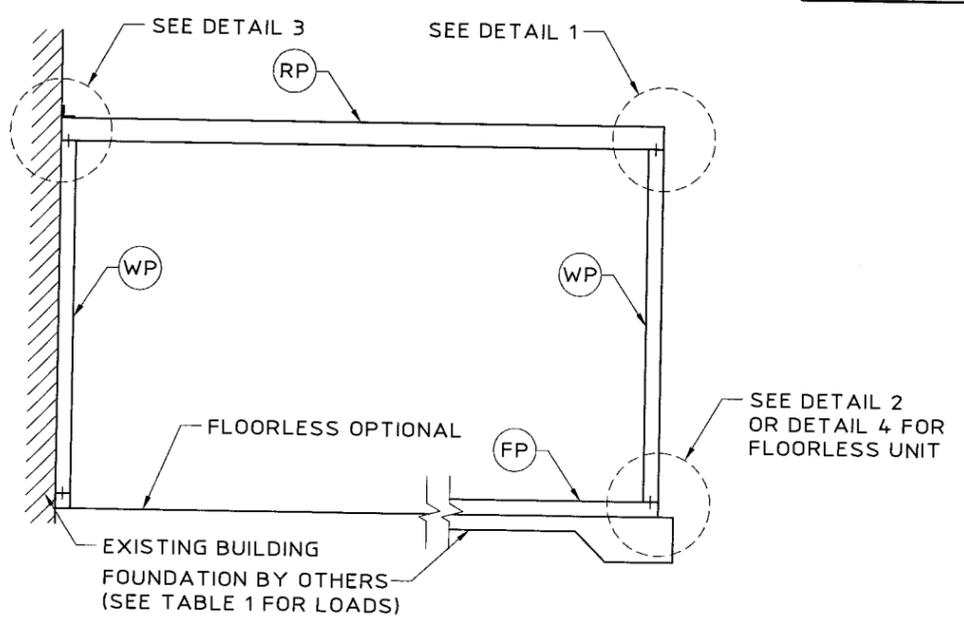

B SECTION (TYP.)
SCALE: 1/4" = 1'-0"

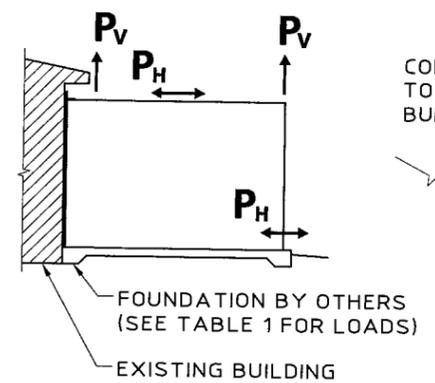

D ELEVATION
N.T.S.

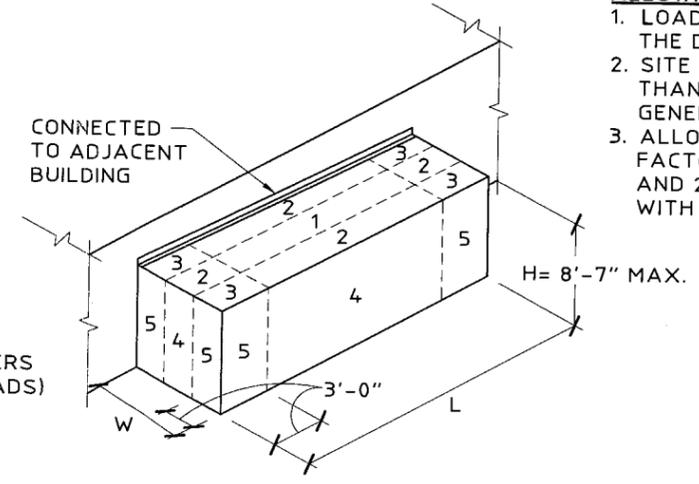

(SEE TABLE 2 FOR WIDTH/LENGTH LIMITATION)
E ISOMETRIC WITH WIND ZONES
N.T.S.

TABLE 1	LOADS FOR FOUNDATION DESIGN	NET WIND UPLIFT (P_v) AND SHEAR (P_h) FORCES	
		ROOF PANEL MAXIMUM SPAN 11'-7"	
	P_v	-282 # / FT	
	P_h	± 200 # / FT	

TABLE 2	UNIT WIDTH (W) FT - IN	UNIT LENGTH (L) MINIMUM NUMBER OF 4.6" PANELS ON EXTERIOR WALL FOR A GIVEN UNIT WIDTH (W) FT - IN
	LESS OR EQUAL TO 8'-0"	3
	GREATER THAN 8'-0" UP TO 10'-8"	4
	GREATER THAN 10'-8" UP TO 11'-7"	5

TABLE 3	ZONES	ALLOWABLE WIND LOADS (PSF)				
		1	2	3	4	5
	NEGATIVE	-43.8	-59.6	-72.8	-42.9	-50.4
	POSITIVE	+16.3		+39.4		

- ALLOWABLE WIND LOADS NOTES:**
- LOADS SHOWN REPRESENT WIND LOADS USED IN THE DESIGN OF THE UNIT.
 - SITE SPECIFIC WIND LOADS SHALL BE LESS THAN OR EQUAL TO THESE LOADS. SEE SHEET 1, GENERAL NOTE 4A.
 - ALLOWABLE WIND LOADS ARE BASED ON A FACTOR OF SAFETY OF 1.5 FOR WALL PANELS AND 2.0 FOR ROOF PANELS IN ACCORDANCE WITH THE HVHZ PROVISIONS OF THE FBC.

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No. 05-1103.01
 Expiration Date 06/02/2010
 By *Helmy A. Mohr*
 Miami Dade Product Control Division

Thornton-Tomasetti Group

330 N. Andrews Ave., Suite 450 • Ft. Lauderdale, FL 33301
 Tel. (954) 522-3690 • Fax (954) 522-3691 • COA # 7519
 Website: www.TheTTGroup.com

Copyright © 2005 Thornton-Tomasetti Group, Inc.

WALK-IN COOLER/FREEZER

W.A. Brown & Son Inc.
 209 Long Meadow Dr.
 Salisbury, NC 28147
 tel: (800) 438-2316
 fax: (704) 637-0919

BROWN
SALISBURY, NC

John W. Knezevich
 Professional Engineer
 FL License No.: PE 0041961

OCT 4 2005

no.	date	description
1	04/27/05	COUNTY COMMENTS
2	08/29/05	FLORIDA BUILDING CODE 2004 UPDATE

date: 02/22/2005

scale: AS NOTED


design by: ZMS

drawn by: MCR


checked by: JWK

drawing no.
04-075


sheet 2 of 5

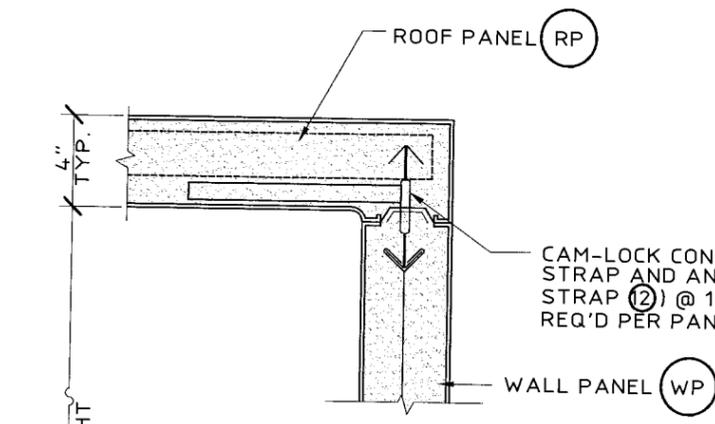


1 DETAIL 1
SCALE: 1-1/2" = 1'-0"

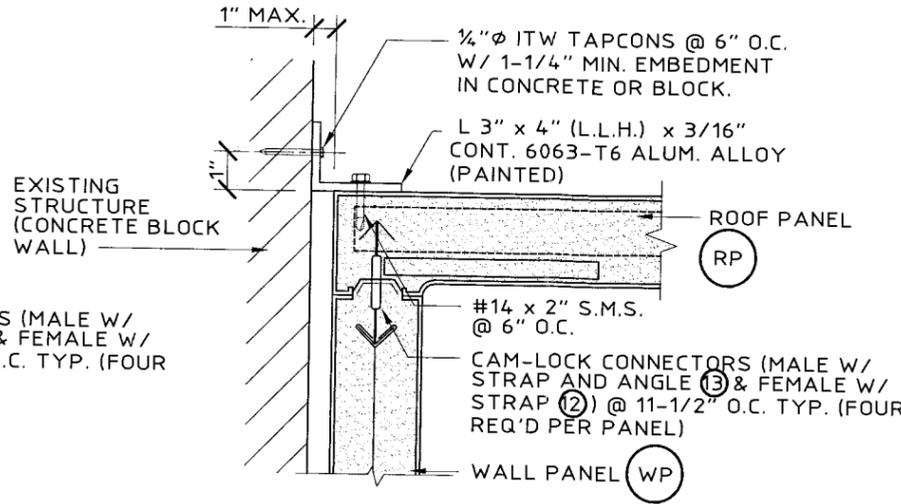


3 DETAIL 3
SCALE: 1-1/2" = 1'-0"

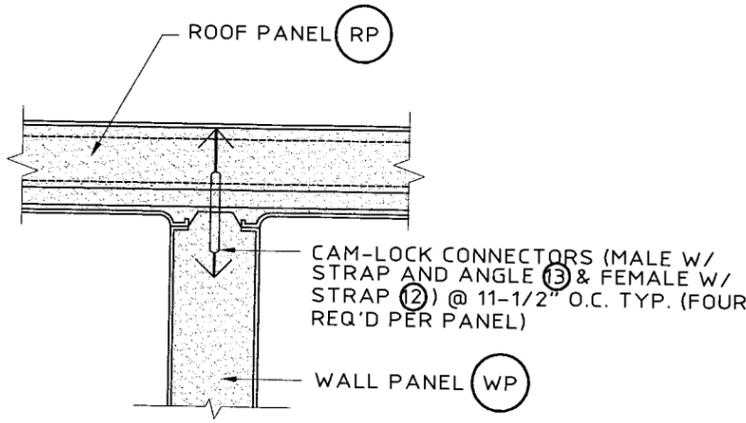


5 DETAIL 5
SCALE: 1-1/2" = 1'-0"

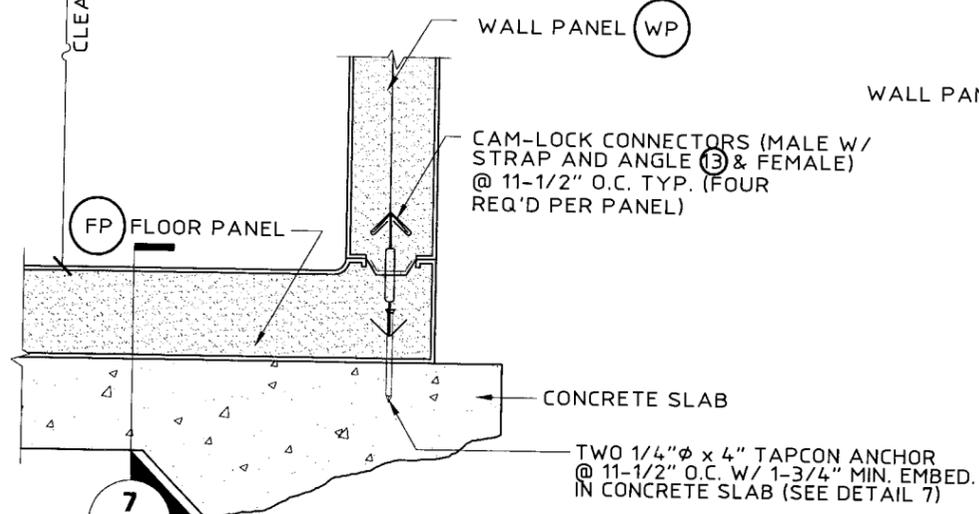


2 DETAIL 2
SCALE: 1-1/2" = 1'-0"

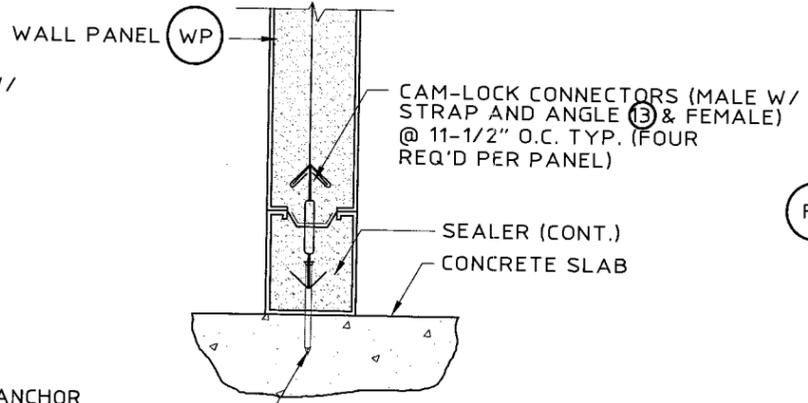

4 DETAIL 4
SCALE: 1-1/2" = 1'-0"

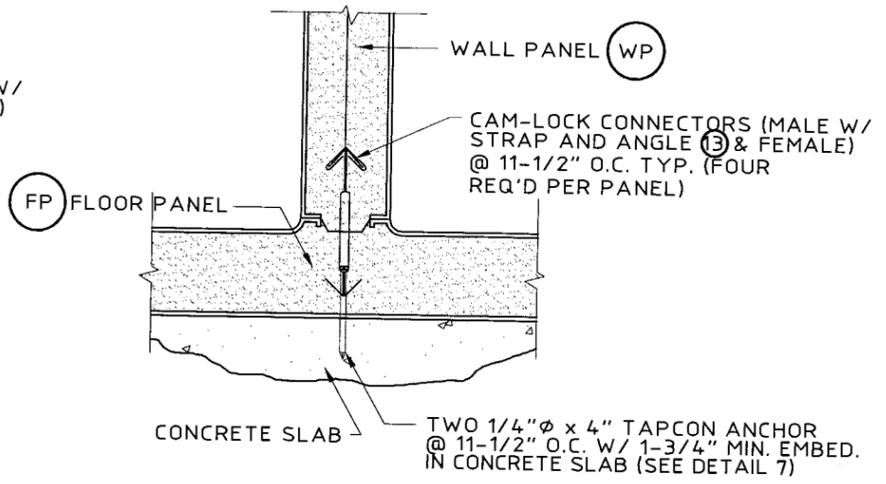

6 DETAIL 6
SCALE: 1-1/2" = 1'-0"

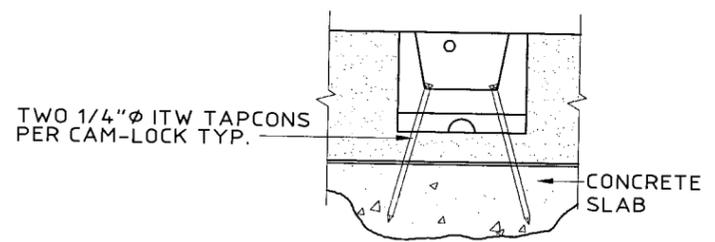

7 DETAIL 7
SCALE: 1-1/2" = 1'-0"

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 05-1103.01
Expiration Date 06/02/2010
By Helmy A. M. M.
Miami Dade Product Control
Division

Thornton-Tomasetti Group
330 N. Andrews Ave., Suite 450 • Ft. Lauderdale, FL 33301
Tel. (954) 522-3690 • Fax (954) 522-3691 • COA # 7319
Website: www.TheTTGroup.com
Copyright © 2005 Thornton-Tomasetti Group, Inc.

WALK-IN COOLER/FREEZER

W.A. Brown & Son Inc.
209 Long Meadow Dr.
Salisbury, NC 28147
tel: (800) 438-2316
fax: (704) 637-0919

BROWN
SALISBURY, NC

John W. Knezevich
Professional Engineer
FL License No.: PE 0041961

OCT 14 2005

no.	date	by	description
1	04/27/05	ZMS	COUNTY COMMENTS
2	08/29/05	ZMS	FLORIDA BUILDING CODE 2004 UPDATE

date: 02/22/2005
scale: AS NOTED
design by: ZMS
checked by: JWK
drawing no.: 04-075
sheet 3 of 5

