



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

www.buildingcodeonline.com

NOTICE OF ACCEPTANCE (NOA)

Master Security Doors, Inc.
702 South Military Trail
Deerfield Beach, FL 33442

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone.

DESCRIPTION: Series "EX3" Outswing Steel Security Door- L.M.I.

APPROVAL DOCUMENT: Drawing No. 05-370 titled "EX3 USA Outswing Door Large Missile Impact Resistant" Sheets 1 through 11 of 11, prepared by Tilteco, Inc., dated 09/15/05, with last revision on 02/27/06, signed and sealed by Walter A. Tillit Jr., P. E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence pages E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Jaime D. Gascon, P.E.**



J. Gascon
3/20/06

NOA No 05-1121.03
Expiration Date: April 20, 2011
Approval Date: April 20, 2006
Page 1

Master Security Doors, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturers die drawings and sections.
2. Drawing No. **05-370** titled "EX3 USA Outswing Door Large Missile Impact Resistant" Sheets 1 through 11 of 11, prepared by Tilteco, Inc., dated 09/15/05 with last revision on 02/27/06, signed and sealed by Walter A. Tillit Jr., P. E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test, FBC, TAS 201-94
 - 5) Cyclic Loading Test, per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94along with installation diagram of an EX3 USA Single Outswing Entrance Door, marked-up by American Test Lab of South Florida, Test Reports No. **ATL 0531.01-05**, dated 11/09/05, signed and sealed by William R. Mehner, P.E. and Henry Hattem, P.E.

C. CALCULATIONS

1. Anchor Calculations and structural analysis, complying with FBC-2004, prepared by Tilteco, Inc, dated 11/17/05, signed and sealed by Walter A. Tillit Jr., P.E.

D. QUALITY ASSURANCE BY:

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **04-0721.01** issued to Elco Textron, Inc. for "**Tapcon Concrete Anchors**" dated 03/09/06, expiring on 01/08/11.

F. STATEMENTS

1. Statement Letter of "no financial interest" issued by Tilteco, Inc., dated 10/11/05, signed and sealed by Walter A. Tillit Jr., P.E.
2. Statement letter of conformance, dated 10/11/05, signed and sealed by Walter A. Tillit Jr., P.E.

G. OTHER

1. Letter from the consultant, dated 03/22/06 stating that the product is in compliance with the Florida Building Code (FBC).



Jaime D. Gascon, P.E.
Chief, Product Control Division
NOA No 05-1121.03
Expiration Date: April 20, 2011
Approval Date: April 20, 2006

GENERAL NOTES

1. EX-3 USA, Outswing single door, large missile impact resistant shown on this Product Approval Document (P.A.D.) has been verified for compliance in accordance with the 2004 edition of the Florida Building Code with the 2005 supplement. Door may be installed at High Velocity Hurricane Zones (H.V.H.Z.). Design wind loads shall be determined as per section 1620 of the above mentioned code. In order to verify that anchors on this P.A.D., as tested, were not overstressed, a 33% increase in allowable stresses for wind loads was not used in their analysis. A duration factor $C_D = 1.60$ was used to verify fasteners in wood.
This door's adequacy for impact and cyclic resistance has been verified in accordance with section 1609.1.4 of the above mentioned code, as per TAS 201, 202 and 203 protocols, per ATL Report #0531.01-05, and as per submitted calculations performed as per section 1612 of the Florida Building Code.

2. **Max Design Pressure Rating: + 150, -200 psf**
This pressure rating is only valid if door is assembled with required hardware indicated on sheet 2 of this drawing.

3. **This Door is approved for Air and Water Infiltration.**
This approval is only valid if door is sealed with required gasketing and weather stripping as indicated on Bill of Materials on sheet 3, and sealant specified on General Note 10 below.

4. **This Door will not require a Hurricane Protective Device.**

5. Wood bucks by others, and must be properly anchored to transfer loads to the existing structure. Wood bucks must be Southern Pine #2, with specific Gravity G equal or greater than 0.55.

6. Anchors for fastening door subframe to existing structure must be as indicated on sheet 3.

7. All welding to conform to the 2004 American welding Society AWS D1.3 and AWS D1.9. Regulations. Use certified welders.

8. All screws used for assembly connections (metal to metal) to be stainless steel 304 or 316 series or corrosion resistant coated carbon steel as per DIN 50018 with 50 ksi minimum yield strength and 90 ksi tensile strength.

9. Remaining components for this door system shall be as indicated on Bill of Materials on sheet 2 of this drawing.

10. Sealing of door components shall be as follows:

Sealant:
Frame: The interior and exterior perimeter joints and all frame connections shall be sealed with silicone sealant. The two sheet metal 45° angle shaped sections at the corner key shall be sealed to each other and to the sheet metal fabricated corner section with silicone sealant. The two steel sections at the sill shall be sealed with silicone sealant. Hinges shall be also sealed to hinge jamb with silicone sealant.

Sub-frame: The interior and exterior perimeter joints and all sub-frame connections shall be sealed with silicone sealant. Sub-frame shall be also sealed to the frame with silicone sealant around the exterior perimeter. Sub-frame shall be sealed to the wood buck using silicone sealant.

Door: The interior and exterior perimeter joints and all door connections to the main casing at the top rail, bottom rail and stiles shall be sealed with silicone sealant. Hinges shall also be sealed to hinge stile with silicone sealant. The plywood panel on exterior side of door shall be sealed around perimeter of the top rail, bottom rail and stiles with silicone sealant.

11. **Frame and Sub-frame Material:** Hot rolled steel DD12 Reference EN 10111 with Tensile Strength = 59,100 psi; Yield Strength at 0.2% = 52,300 psi; Ultimate Elongation 33%.

12. **Door Material:** Hot rolled zinc plated DX51 + Z100 (275 G/M² 0.6 Oz/Ft²) Reference EN 10142 + A1-97 with Tensile Strength = 54300 psi, Yield Strength at 49,600 psi; Ultimate Elongation = 23%.

13. **ASTM Designation for Steel:** Equivalent to ASTM A 653 CQ Grade 50 at frame and ASTM A 653 CQ Grade 50 at door.

14. **Galvanizing type:** G60

15. **Decorative Wood Clad Panels:** 0.250 (1/4") thick plywood, oak, pine, mahogany, Douglas fir with 10-12% maximum moisture content, painted with minimum of two (2) coats of water based varnishes, protective impregnators and coatings for outdoor installations.

16. Door's manufacturer label shall be placed on the exposed surface of door's frame or sub-frame. One Label shall be placed for every door. Label shall read as follows:

Master Security Doors, Inc.
Deerfield Beach, Fl
Miami Dade County Product Control Approved.

17.
a. This P.A.D. prepared by this engineer is generic and does not provide information for a specific project; i.e., where the site conditions deviate from the P.A.D.
b. Contractor to be responsible for the selection, purchase and installation, including life safety of this product, based on this P.A.D., provide he/she does not deviate from the conditions detailed on this document. Construction safety at site is the contractor's responsibility.
c. This P.A.D. will be considered invalid if altered by any means.
d. This P.A.D. shall bear the date and original seal and signature of the professional engineer of record that prepared it.

18. Materials, included but not limited to steel / metal screws, that come in contact with other dissimilar materials shall meet the requirements of 2004 Florida Building Code section 2003.8.4.



EB LICENSE No. 00007179

MASTER SECURITY DOORS, INC
702 SOUTH MILITARY TRAIL
DEERFIELD BEACH, FL 33442
TELEPHONE: 561-499-7558
FAX: 561-499-7558

MODEL: EX3 USA OUTSWING DOOR LARGE MISSILE IMPACT RESISTANT	DRAWING: ELEVATION	SCALE: NONE
	Rev.: 2/27/06	General
	DRAWN BY: KP	DATE DWN: 09/15/05

Approved as complying with the Florida Building Code
Date 04/28/06
NOA# 05-1121-02
Miami Dade Product Control
Division
By

WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
FL. LIC.NO. 44167

FEB 27 2006

05-370
DRAWING N°
SHEET 1 OF 11

BILL OF MATERIALS

ITEM #	DESCRIPTION	MATERIAL	QTY	COMMENTS
1	HANDLE SET W/DEAD BOLT	MISC.	1	*
2	EXTERIOR PANEL (SEE NOTE 15)	0.250 THK. WOOD G >= 0.55	1	ATTACHED TO ITEM 11 WITH LIQUID NAIL GLUE
3	INTERIOR PANEL (SEE NOTE 15)	0.250 THK. WOOD G >= 0.55	1	ATTACHED TO ITEM 11 WITH LIQUID NAIL GLUE
4	FRAME JAMBS, HEAD	HR STL W/ A52 PVC FILM	3	*
5	FRAME CORNER KEY	GALV. STEEL	2	REFER TO SHEET 8
6	HINGE ASSEMBLY	STEEL	3	REFER TO SHEET 10
7	ROCKWOOL INSULATION	FIBERGLASS	A/R	PANEL CAVITY
8	REINF (MULTI-POINT LOCK HOUSING)	STEEL	1	AT LOCK STILE
9	9/16" X 1/8" THK OPEN CELL FOAM	EPS	A/R	W/ADHESIVE BACKING AND GLUED TO COMPRESSION GASKET
10	PANEL REINF (HINGE STILE)	STEEL	1	AT HINGE STILE
11	PANEL TOP, BOTTOM & STILE RAILS	HR STL W/ A52 PVC FILM	4	*
12	#5 X 1/2" PPHSMS	STEEL	19	PANEL ASS'Y SCREW
13	CISA CYLINDER ASSEMBLY LOCK	STEEL	1	REFER TO SHEET 9
14	BACKING TOBAR	GALV. STEEL	2	*
15	ELEVATED FRAME SILL	HR STL W/ A52 PVC FILM	1	REFER TO SHEET 6
16	FRONT PANEL PLATE	HOT ROLLED STEEL	1	0.059" THK, WELDED TO THE STEEL FORMED SECTION AROUND THE ENTIRE PERIMETER ON INTERIOR AND EXTERIOR SIDE, (20) WELDS AT EACH STILE, LOCATED AT (1) AT 1/1/8" FROM TOP RAIL, THEN (19) WELDS AT 4 3/4" O-C. (8) WELDS AT TOP AND BOTTOM RAIL, EACH LOCATED (1) AT 1' FROM LOCK STILE, THEN (7) AT 5' O-C.
17	REAR PANEL FORMED PLATE	HOT ROLLED STEEL	1	0.059" THK, SPOT WELDED TO ITEM 8 IN THE LOCK STILE WITH TWO ROWS OF SPOT WELDS, 4' APART, FIRST ROW AT 5/8" FROM LOCK STILE. EACH ROW WITH (8) WELDS, LOCATED (1) AT 1 1/2" FROM TOP RAIL, BALANCE AT 13 1/8", 17 1/4", 16", 3 3/4", 11", 10 3/4", 16" AND ALSO SPOT WELDED TO ITEM 10 IN THE HINGE STILE WITH ONE ROW OF (6) SPOT WELDS AT 2 1/2" FROM HINGE STILE, AND AT 2 1/2" FROM TOP RAIL, WITH BALANCE AT 14 1/2", 17", 17 7/8", 18" AND 19 1/2".
18	SUBFRAME HEAD	HOT ROLLED STEEL	1	REFER TO DETAIL 18, SHEET 7
19	SUBFRAME JAMBS	HOT ROLLED STEEL	2	REFER TO DETAIL 19, SHEET 7
20	LOWER FRAME SILL	HR STL W/ A52 PVC FILM	1	REFER TO DETAIL 20, SHEET 7
21	SUBFRAME CORNER KEY	GALV. STEEL	2	REFER TO DETAIL 21, SHEET 7 AND DETAIL 5, SHEET 8
22	FRAME GASKET	VINYL	A/R	REFER TO DETAIL 22, SHEET 11
23	COMPRESSION GASKET	VINYL	A/R	REFER TO DETAIL 23, SHEET 11
24	BLOT W/THREADED SLEEVE	STEEL	5	REF DET 24, SHEET 6 AND REF DET 28, SHEET 7. LOCATED AT 1 3/8" WIDE X 1 1/8" HIGH CUT OUTS COVERED WITH VINYL COVER (5) AT HINGE JAMB
25	RETENTION CLIP HOUSING	GALV STEEL	10	5 PER JAMB. SEE LOCATIONS ON SHEET 3. REF. DET 25, SHEET 11
26	RETENTION CLIP	GALV. STEEL	10	5 PER JAMB. SEE LOCATIONS ON SHEET 3. REF. DET 26, SHEET 11
27	M8 X 30MM ALLEN HEAD BOLT	STEEL	5	SEE SHEET 3 FOR LOCATIONS
28	BLOT KEEPER	PLASTIC	5	REF DET 28, SHEET 7. USE 5 AT HINGE JAMB AT ITEM 24.

WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
 FL. LIC. NO. 44167

[Signature]
 FEB 27 2006


TILECO INC.
 TILLIT TESTING & ENGINEERING COMPANY
 6355 NW 36th STREET, STE. 305
 MIAMI, FLORIDA 33166
 EB LICENSE No 0006719

MASTER SECURITY DOORS, INC
 702 SOUTH MILITARY TRAIL
 DEERFIELD BEACH, FL 33442
 TELEPHONE: 561-499-7558
 FAX: 561-499-7558

MODEL: EX3 USA
OUTSWING DOOR
LARGE MISSILE
IMPACT RESISTANT
DRAWING: ELEVATION
SCALE: NONE
DRAWN BY: KP
DATE DWN: 09/15/05

Approved as complying with the
 Florida Building Code
 Date 04/20/06
 NOA# 05-1121-03
 Miami-Dade Product Control
 Division
 By *[Signature]*

05-370
DRAWING N°
SHEET 2 OF 11

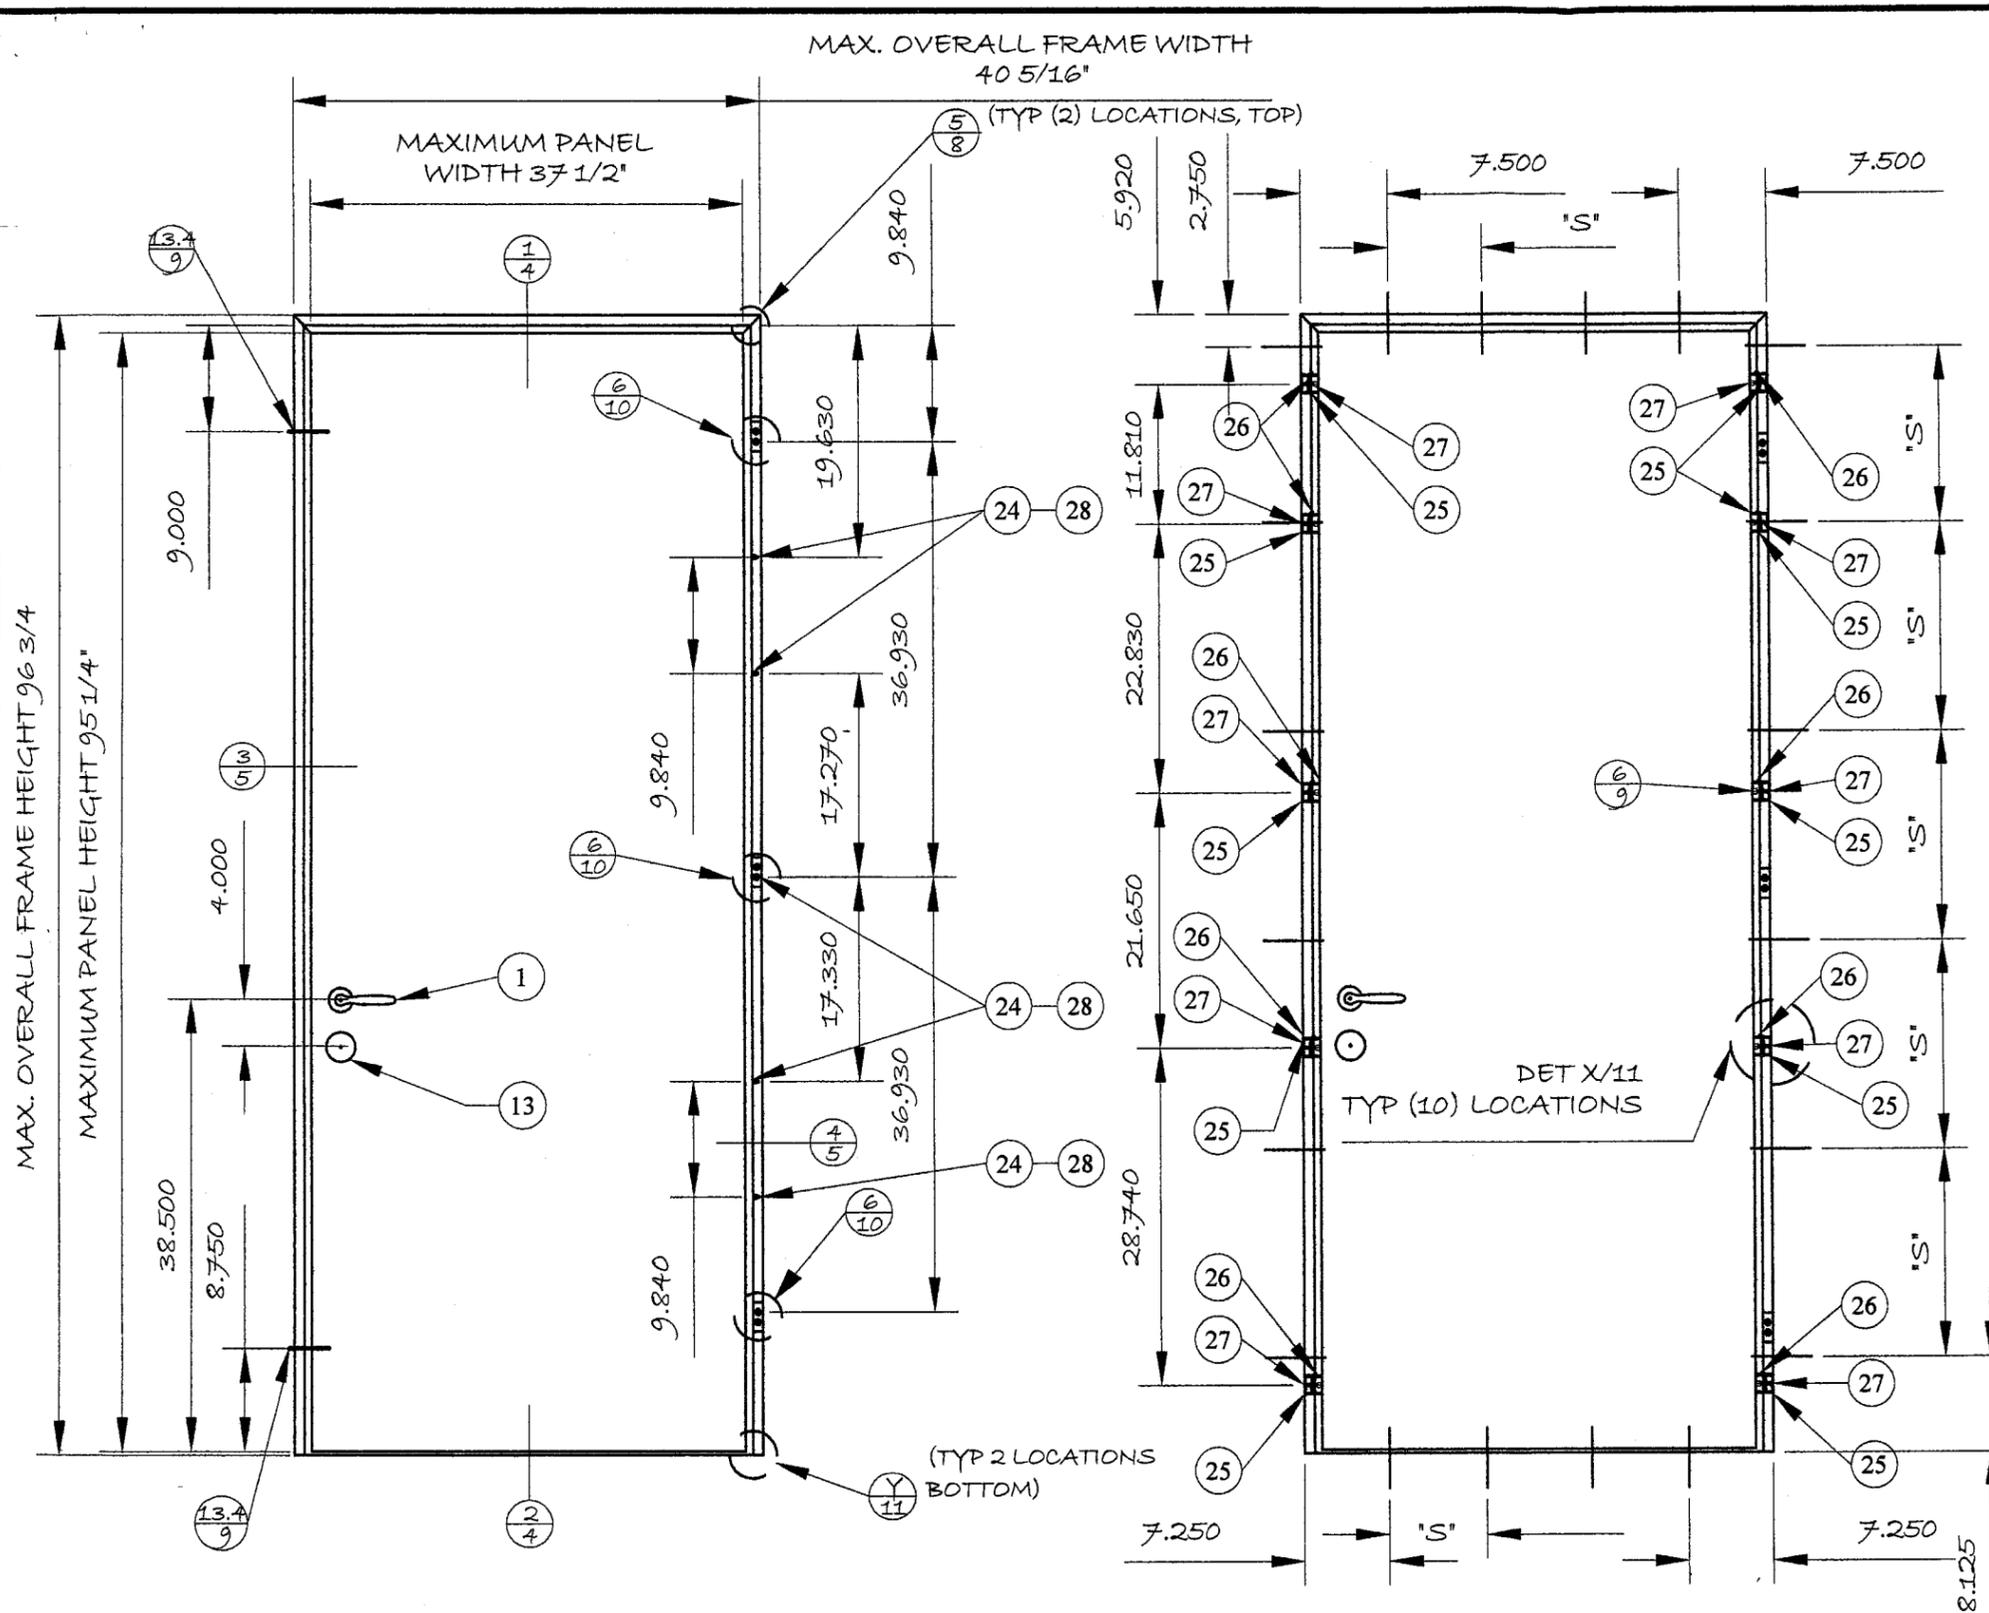

MAXIMUM ANCHOR SPACING 'S' SCHEDULE FOR SUBFRAME ANCHORAGE TO EXISTING STRUCTURE

DOOR FRAME	DESIGN LOAD	ANCHOR TYPE	
		1	2
JAMBS	UP TO 100 PSF	10' O.C.	17 3/4' O.C.
	>100 TO 200 PSF	5' O.C.	9' O.C.
HEAD & SILL	UP TO 100 PSF	12 3/4' O.C.	25' O.C.
	>100 TO 200 PSF	6 3/8' O.C.	8 3/8' O.C.

* VALID FOR EITHER POURED CONCRETE, CONCRETE BLOCK, OR WOOD SUBSTRATES (REFER TO ANCHOR LEGEND)

- ANCHOR LEGEND:
- 1/4" TAPCON ANCHORS, BY ELOCO TEXTRON W/ 1 1/4" MIN. EMBEDMENT TO F_c = 3.32 KSI CONCRETE, OR ASTM C-90 CONCRETE BLOCK AND WITH 3" MIN. EMBEDMENT TO WOOD SUBSTRATE W/ q ≥ 0.55 MIN. EDGE DISTANCE = 2 1/2" (MASONRY) AND MIN. EDGE DISTANCE 1" (WOOD).
 - 3/8" TAPPERS BY POWER FASTENERS, INC; W/ 1 1/4" MIN. EMBEDMENT TO F_c = 3.0 KSI CONCRETE OR ASTM C-90 CONCRETE BLOCK WALL AND WITH 3" MIN. EMBED. TO WOOD SUBSTRATE W/ q ≥ 0.55 MIN. EDGE DISTANCE = 4 1/2" (MASONRY), MIN. EDGE DISTANCE = 1 1/2" (WOOD).

TILTECO INC.
 TLLIT TESTING & ENGINEERING COMPANY
 6355 NW 36th STREET, STE. 305
 MIAMI, FLORIDA 33166

EB LICENSE No. 0006719

MASTER SECURITY DOORS, INC
 702 SOUTH MILITARY TRAIL
 DEERFIELD BEACH, FL 33442
 TELEPHONE: 561-499-7558
 FAX: 561-499-7558

MODEL: EX3 USA
 OUTSWING DOOR
 LARGE MISSILE
 IMPACT RESISTANT

DRAWING: ELEVATION

SCALE: NONE

DRAWN BY: KP

Rev.: 2/27/06
 General

DATE DWN: 09/15/05

Approved as complying with the
 Florida Building Code
 Date 04/28/06
 NOAB 05-1121-03
 Miami Dade Product Control
 Division
 By: *[Signature]*

DOOR ASSEMBLY/HARDWARE (EXTERIOR ELEVATION)

WALTER A. TILLIT JR., P.E. DOOR SUBFRAME CONNECTION
STRUCTURAL ENGINEER
FL. LIC. NO. 44167


TO DOOR FRAME & DOOR
 SUBFRAME CONNECTION TO EXISTING
 STRUCTURE (EXTERIOR ELEVATION)

[Signature]
 FEB 27 2006


— = PERIMETER FASTENER LOCATIONS (SEE ANCHOR LEGEND, THIS SHEET)

05-370
 DRAWING N°
 SHEET 3 OF 11

MASONRY INSTALLATION

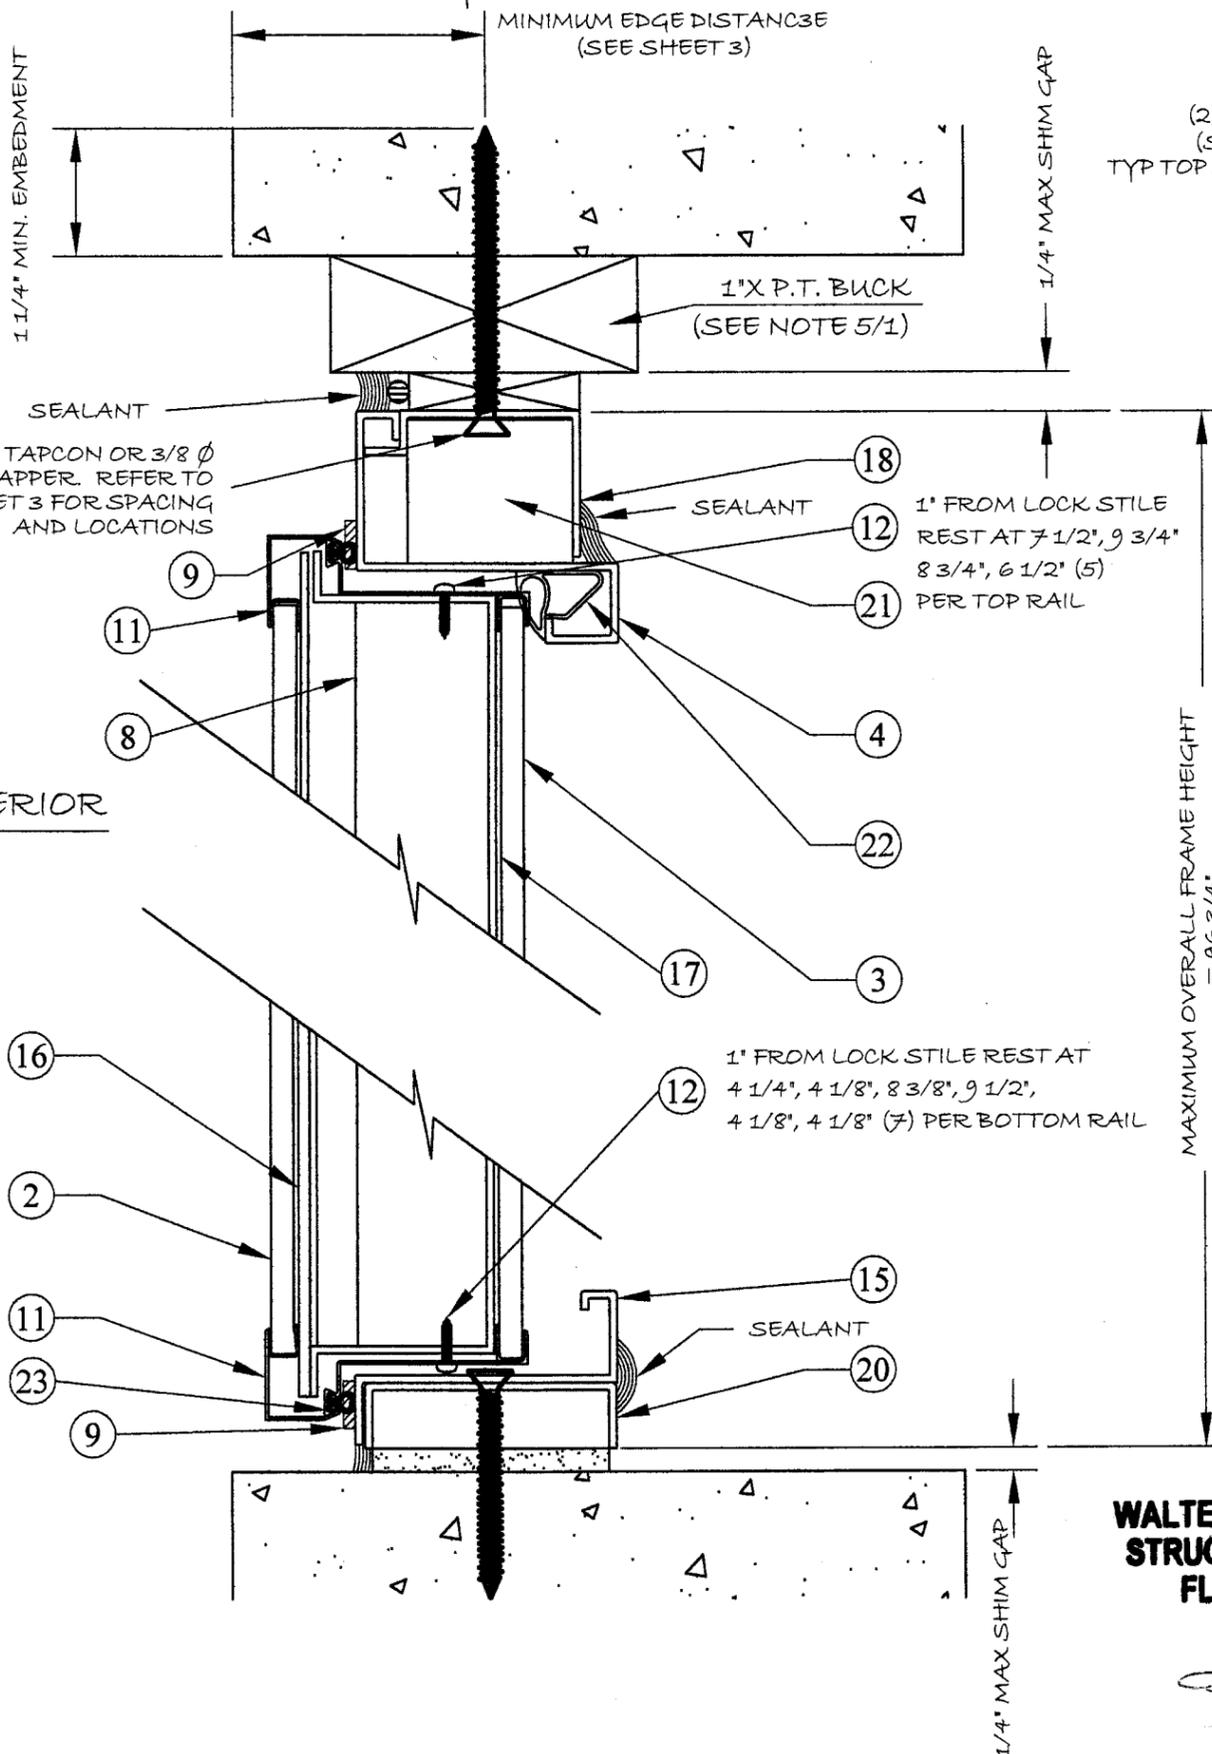

WOOD INSTALLATION

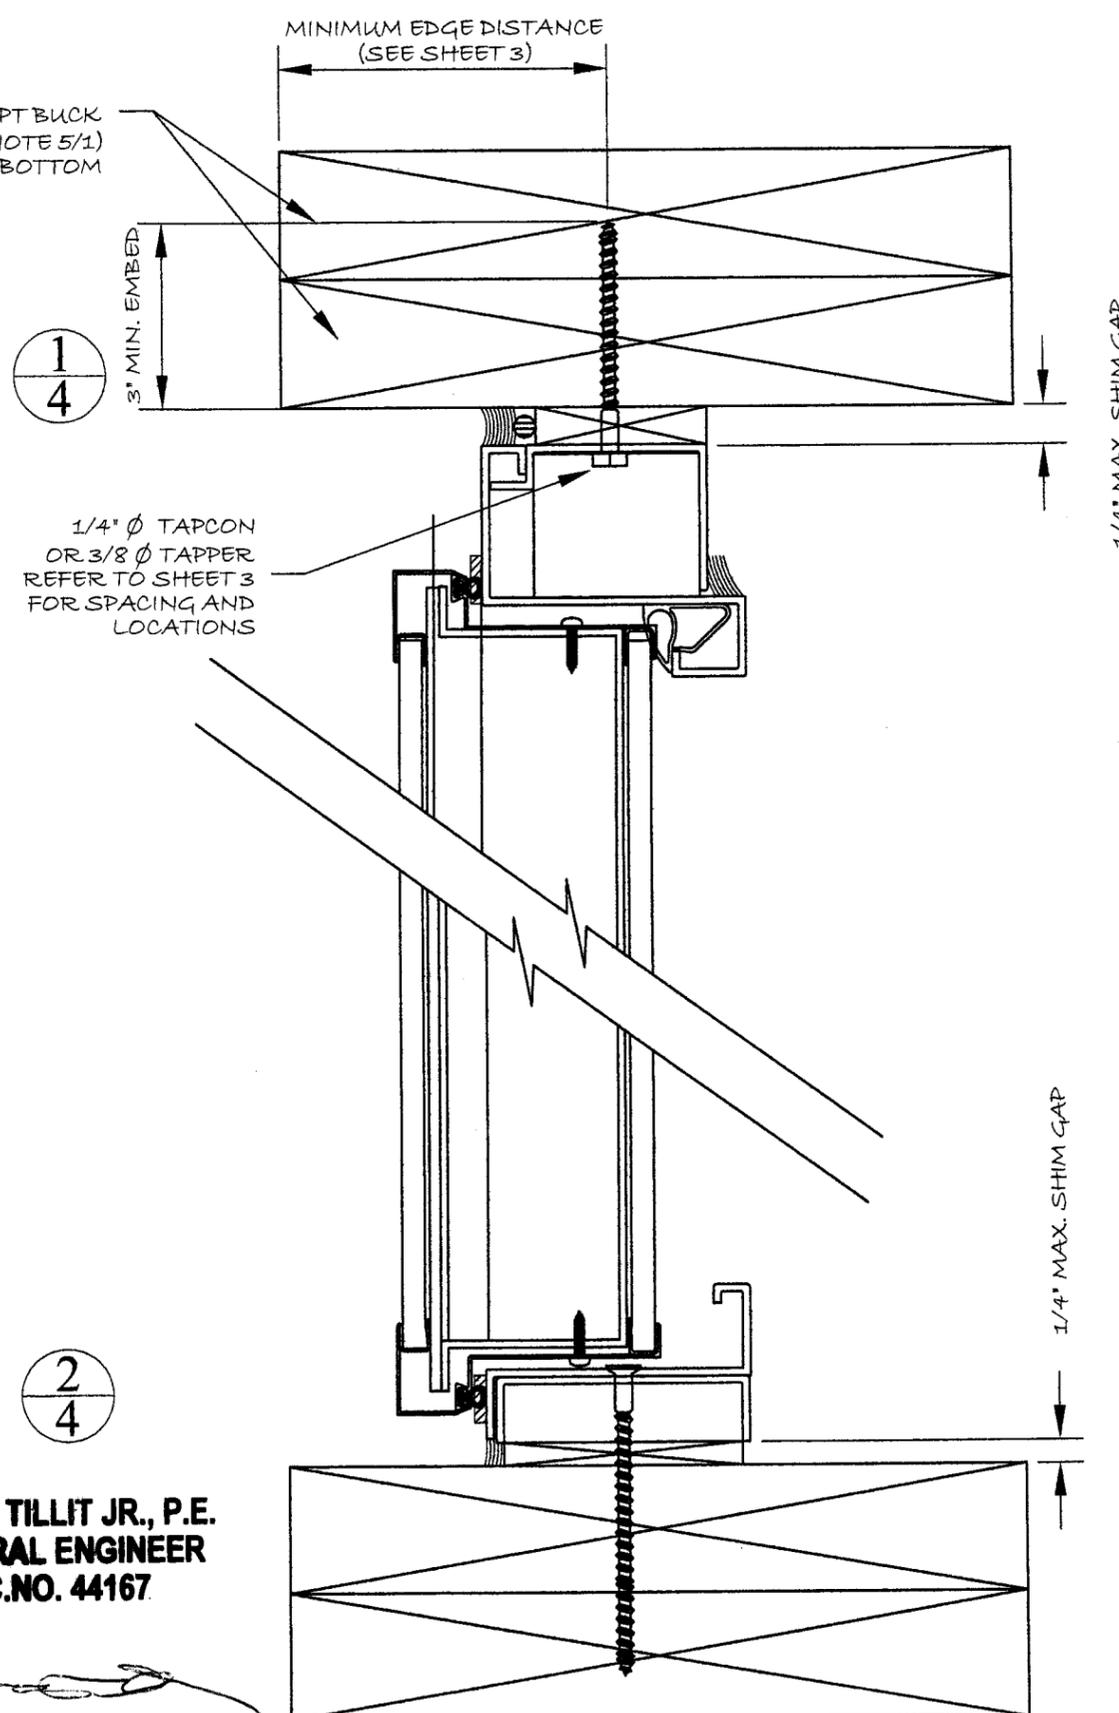

WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
FL. LIC. NO. 44167

[Signature]
 FEB 27 2006

TILECO INC.
 TILLIT TESTING & ENGINEERING COMPANY
 6355 NW 36th STREET, STE. 305
 MIAMI, FLORIDA 33168

EB LICENSE No 000219

MASTER SECURITY DOORS, INC.
 702 SOUTH MILITARY TRAIL
 DEERFIELD BEACH, FL 33442
 TELEPHONE: 561-499-7558
 FAX: 561-499-7558

MODEL:	EX3 USA OUTSWING DOOR LARGE MISSILE IMPACT RESISTANT
DRAWING:	VERT. CROSS SECT
SCALE:	NONE
DRAWN BY:	KP
DATE DWN:	09/15/05

Approved as complying with the
 Florida Building Code
 Date 04/20/06
 NOA# 05-1121.03
 Miami Dade Product Control
 Division
 By *[Signature]*

05-370
DRAWING N°
SHEET 4 OF 11

WALTER A. TILLIT JR., P.E.
 STRUCTURAL ENGINEER
 FL. LIC. NO. 44167

Walter A. Tillit Jr.
 FEB 27 2006

1 1/4" MIN EMBEDMENT

1/4" Ø TAPCON, OR
 3/8" Ø TAPPERS
 REFER TO SHEET
 3 FOR LOCATION

TILECO INC.
 TILLIT TESTING & ENGINEERING COMPANY
 6355 NW 36th STREET, STE. 305
 MIAMI, FLORIDA 33166
 EB LICENSE No. 0006719

3" MIN. EDGE DISTANCE
 (SEE SHEET 3)

MIN. EDGE
 DISTANCE

1" X PT BUCK
 (SEE NOTE 5/1)

3
4

MASONRY INSTALLATION

EXTERIOR

4
4

1/4" MAX SHIM GAP

MAX. OVERALL FRAME WIDTH = 40 5/16"

MIN. EDGE
 DISTANCE (SEE
 SHEET 3)

(2) 2" X PT BUCK
 (SEE NOTE 5/1)

1/4" Ø TAPCON OR
 3/8" Ø TAPPERS
 REFER TO SHEET 3
 FOR LOCATIONS

1 1/4" FROM BOTTOM RAIL
 16 3/4", 35" 13 5/8", 25 7/8"
 (5) PER LOCK STILE + (2) 1/4-28
 X 0.789" FH ALLEN M.S.; (1) @ 31 1/8"
 FROM BOTTOM RAIL, OTHER AT 10 3/4"

1" FROM TOP RAIL
 1" FROM BOTTOM RAIL
 (2) PER HINGE STILE

3" MIN. EMBEDMENT


EXTERIOR

WOOD INSTALLATION


MODEL:	EX3 USA OUTSWING DOOR LARGE MISSILE IMPACT RESISTANT
DRAWING:	HORIZ. CROSS SECT
SCALE:	NONE
DRAWN BY:	KP
DATE DWN:	09/15/05

Approved as complying with the
 Florida Building Code
 Date 04/20/06
 NOAH 05-1121-03
 Miami-Dade Product Control
 Division
 By *[Signature]*


05-370
 DRAWING N°
 SHEET 5 OF 11

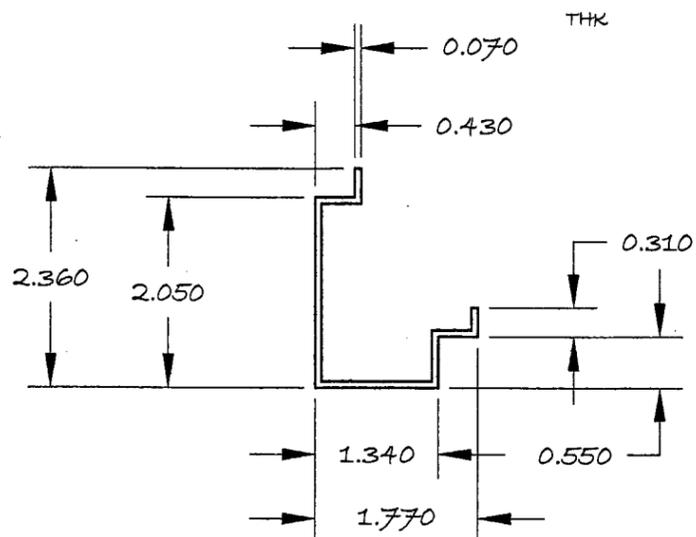


19
7 SUBFRAME JAMBS
SCALE: 1/2

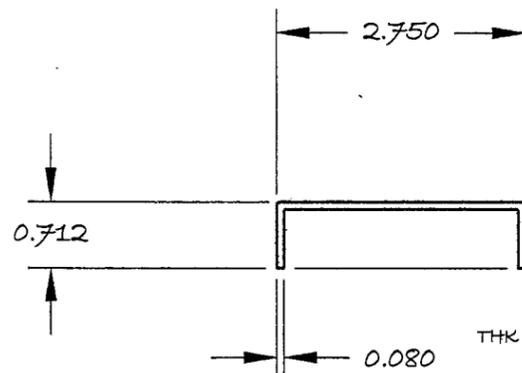


20
7 LOWER FRAME SILL
SCALE: 1/2

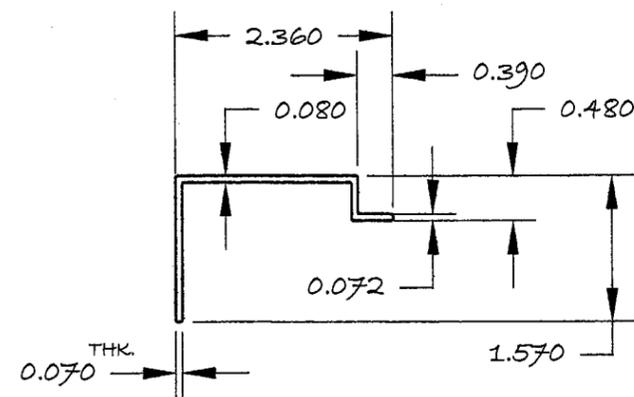

18
7 SUB FRAME HEAD
SCALE: 1/2

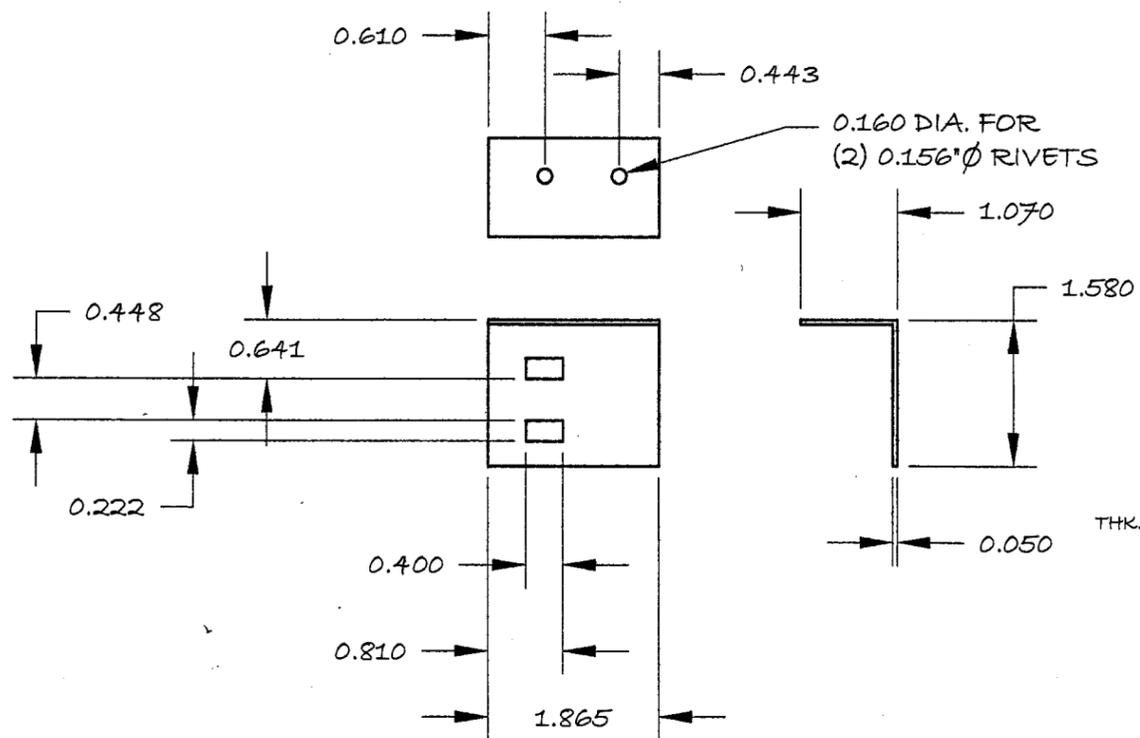

21
7 SUB FRAME CORNER KEY
SCALE: 1/2

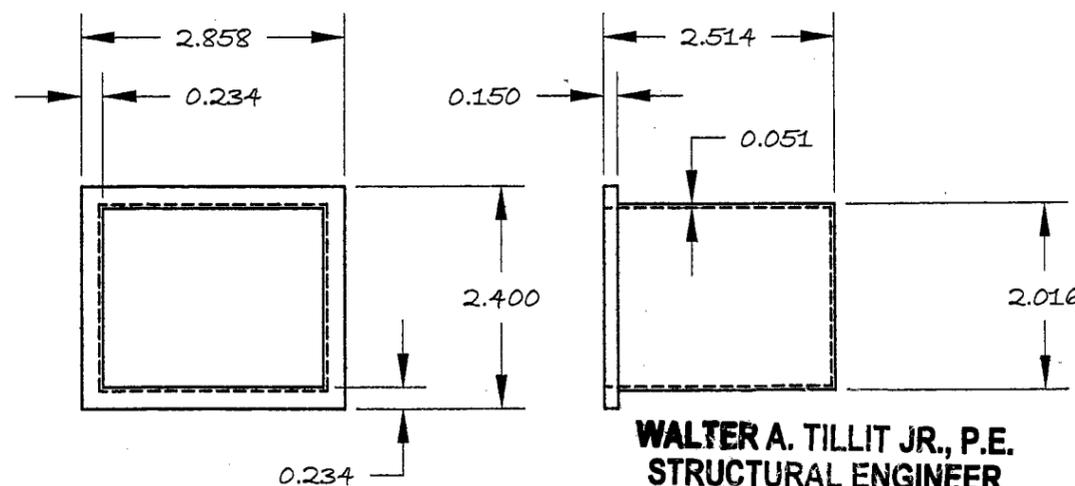

28
7 BLOT KEEPER
SCALE: FULL

WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
FL. LIC. NO. 44167

[Signature]
FEB 27 2006


TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 NW 36th STREET, STE. 305
MIAMI, FLORIDA 33166
EB LICENSE No. 0006719

MASTER SECURITY DOORS, INC.
702 SOUTH MILITARY TRAIL
DEERFIELD BEACH, FL 33442
TELEPHONE: 561-499-7558
FAX: 561-499-7558


MODEL: EX3 USA
OUTSWING DOOR
LARGE MISSILE
IMPACT RESISTANT
DRAWING: SUBFRM DETAILS
SCALE: NONE
DRAWN BY: KP
Rev.: 2/27/06
General
DATE DWN: 09/15/05

Approved as complying with the
Florida Building Code
Date: 04/20/06
NOA#: 05-1121-03
Miami Dade Product Control
Division
By: *[Signature]*


05-370
DRAWING N°
SHEET 7 OF 11

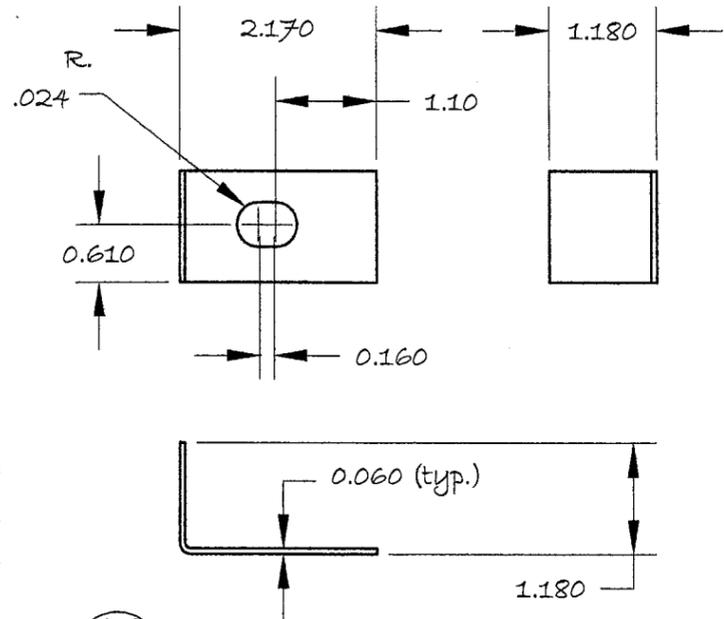


14/6 BACKING TOBAR

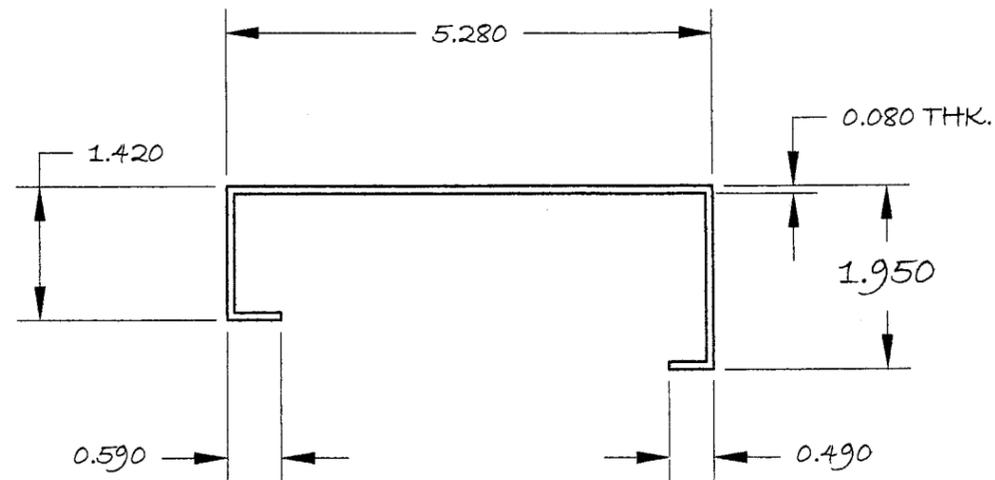


8/6 REINFORCEMENT LOCK STILE

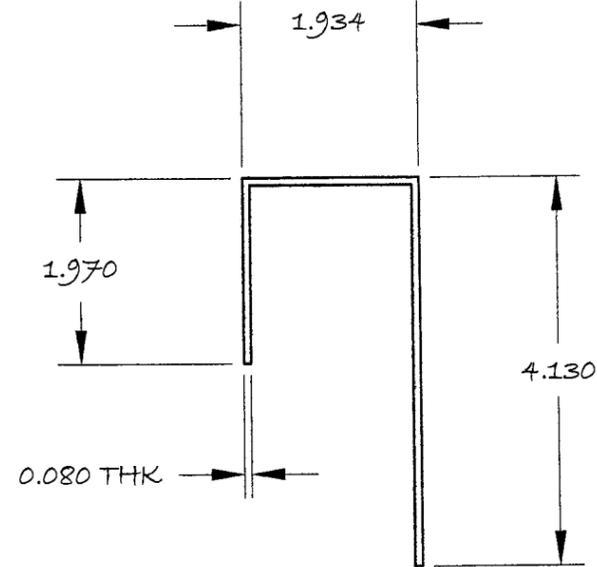

10/6 REINF HINGE STILE

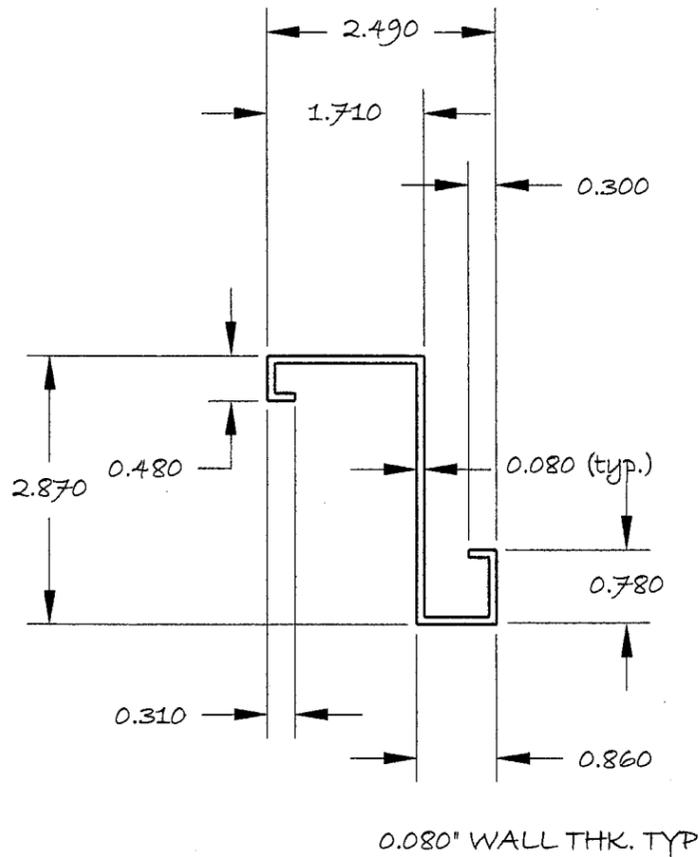


4/6 FRAME: JAMBS & HEAD

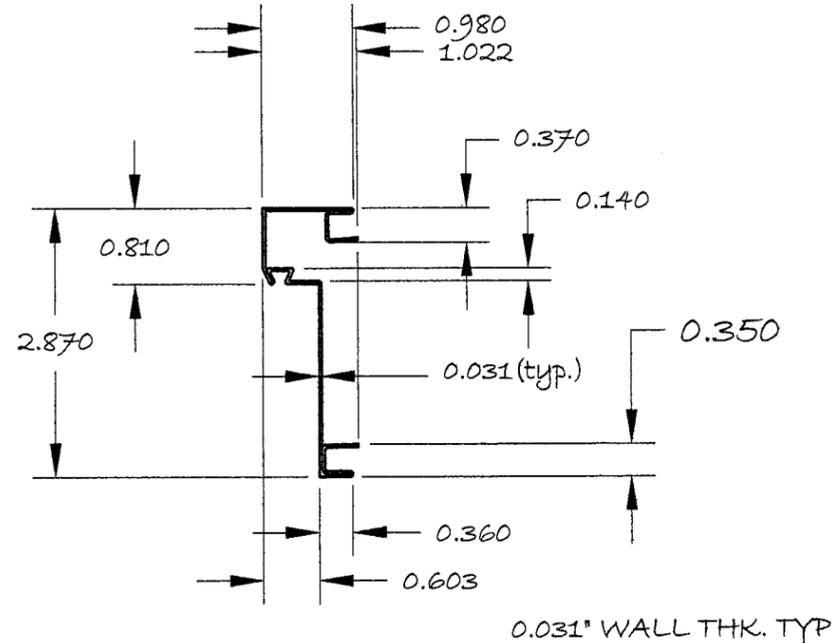


11/6 DOOR PANEL TOP RAIL
BOTTOM RAIL AND
VERTICAL STILES

WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
FL. LIC. NO. 44167

FEB 27 2006

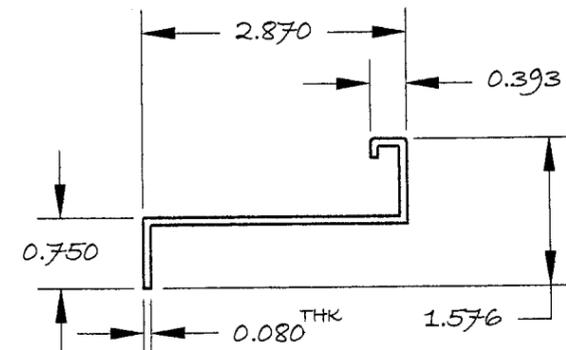

15/6 ELEVATED FRAME SILL

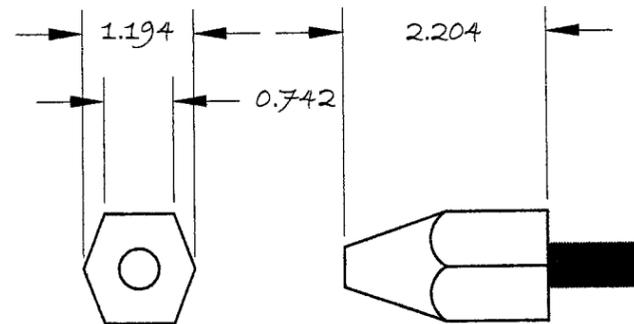

24/6 BLOT

TILECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 NW 36th STREET, STE. 305
MIAMI, FLORIDA 33166
EB LICENSE No. 0006719

MASTER SECURITY DOORS, INC.
702 SOUTH MILITARY TRAIL
DEERFIELD BEACH, FL 33442
TELEPHONE: 561-499-7558
FAX: 561-499-7558

MODEL: EX3 USA
OUTSWING DOOR
LARGE MISSILE
IMPACT RESISTANT
DRAWING: DETAILS
SCALE: NONE
DRAWN BY: KP
Rev.: 2/27/06
General
DATE DWN: 09/15/05


Approved as complying with the
Florida Building Code
Date 04/20/06
NOA# 05-1121-03
Miami Dade Product Control
Division
By *[Signature]*

05-370
DRAWING N°
SHEET 6 OF 11


WALTER A. TILLIT JR., P.E.
 STRUCTURAL ENGINEER
 FL. LIC. NO. 44167

TILTECO INC.
 TILLIT TESTING & ENGINEERING COMPANY
 6355 NW 36th STREET, STE. 305
 MIAMI, FLORIDA 33166


EB LICENSE N: 0006719
 FEB 27 2006

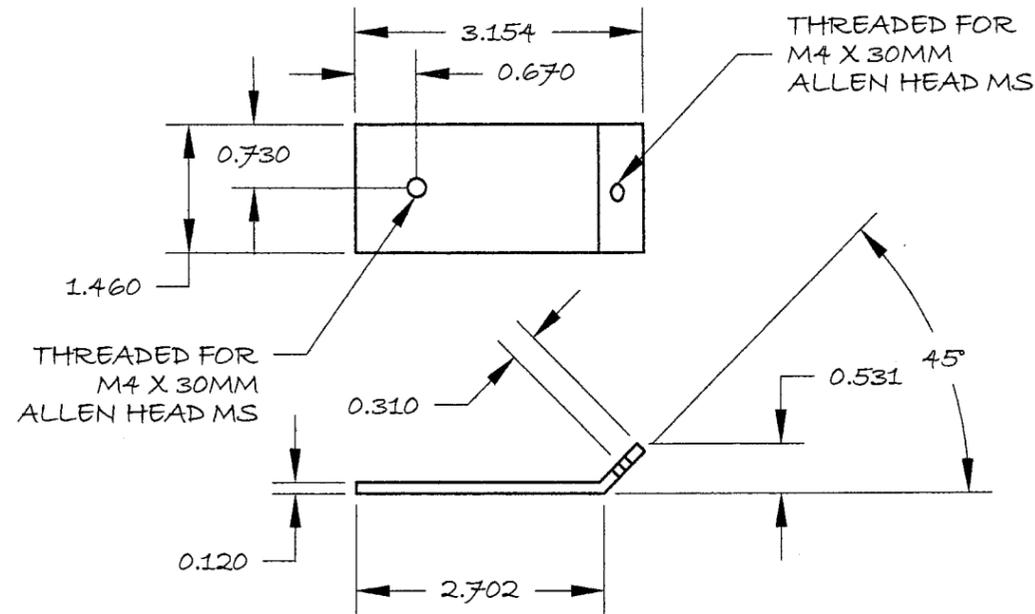


A
8 CORNER FRAME PLATE
 SCALE: HALF

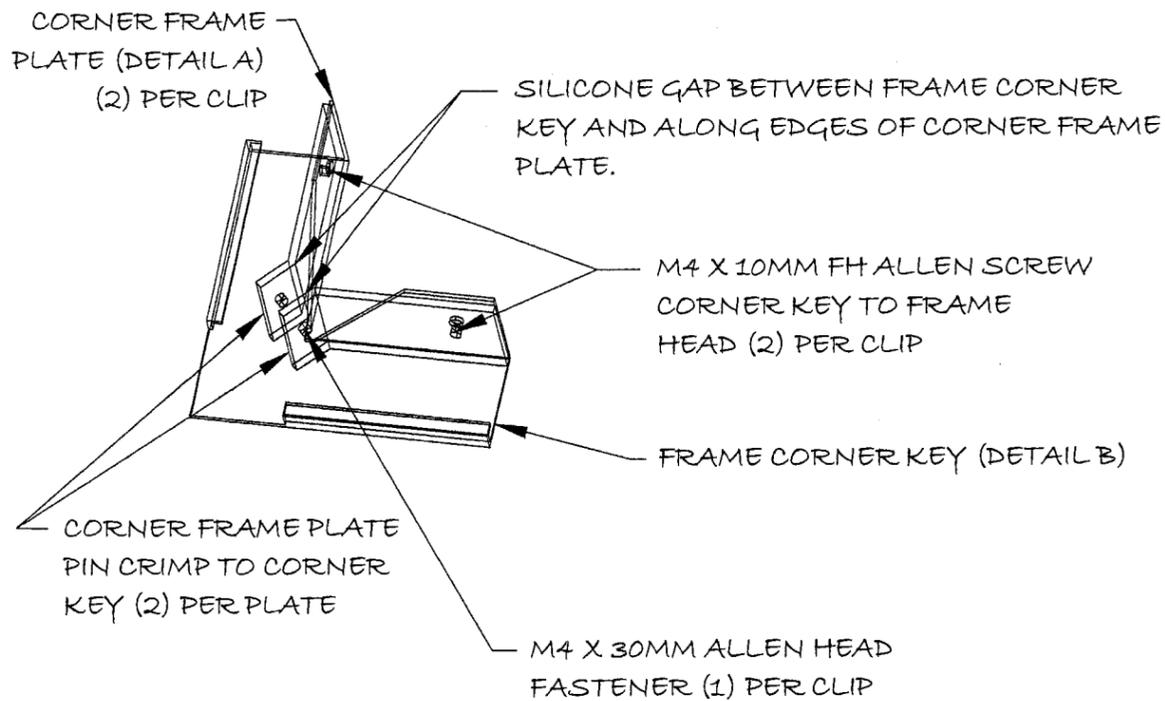

5
8 FRAME CORNER KEY ASS'Y

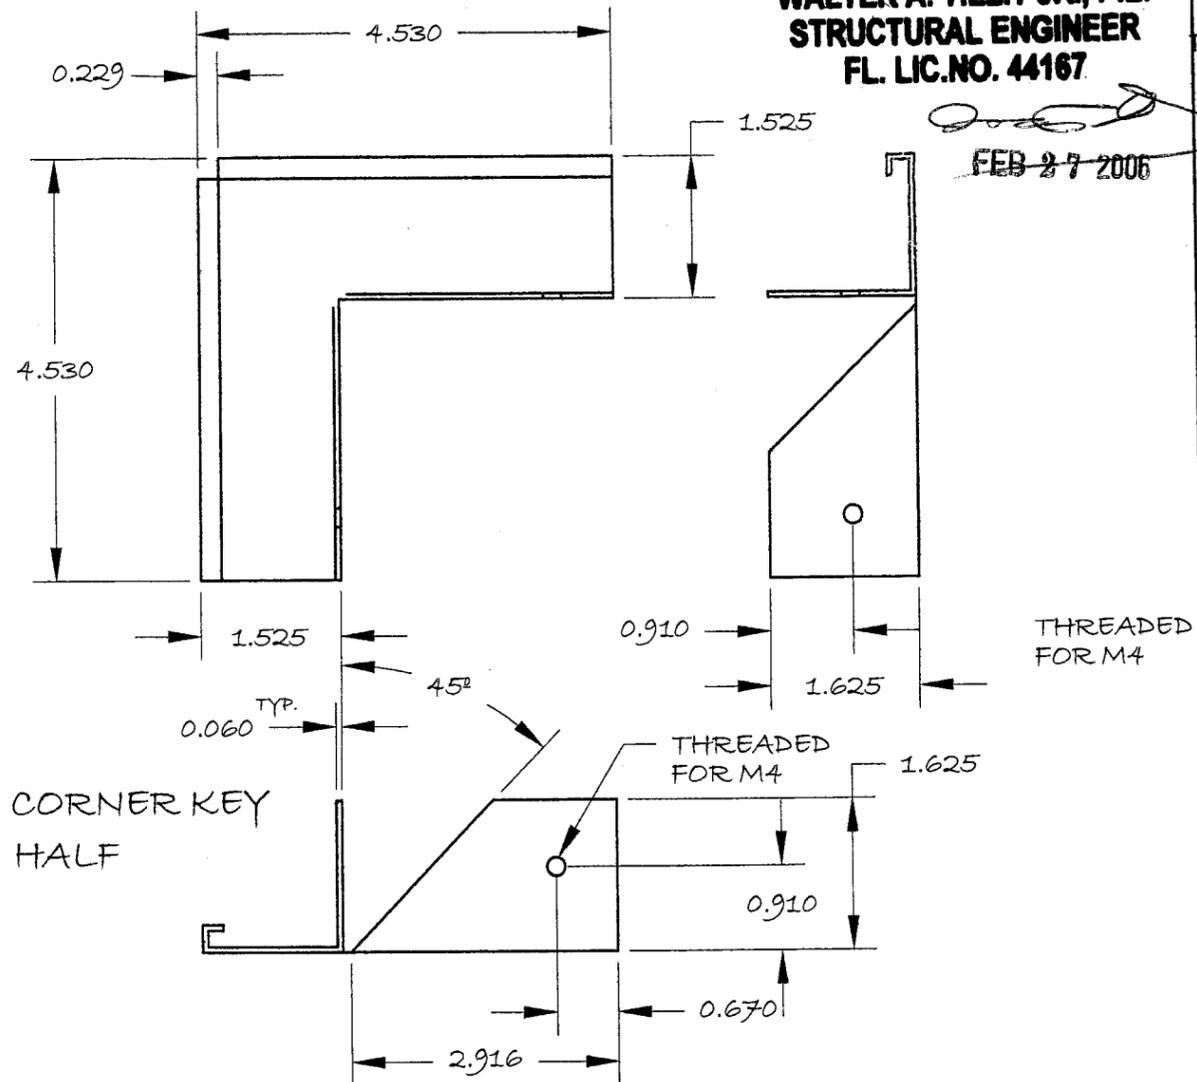

B
8 FRAME CORNER KEY
 SCALE: HALF

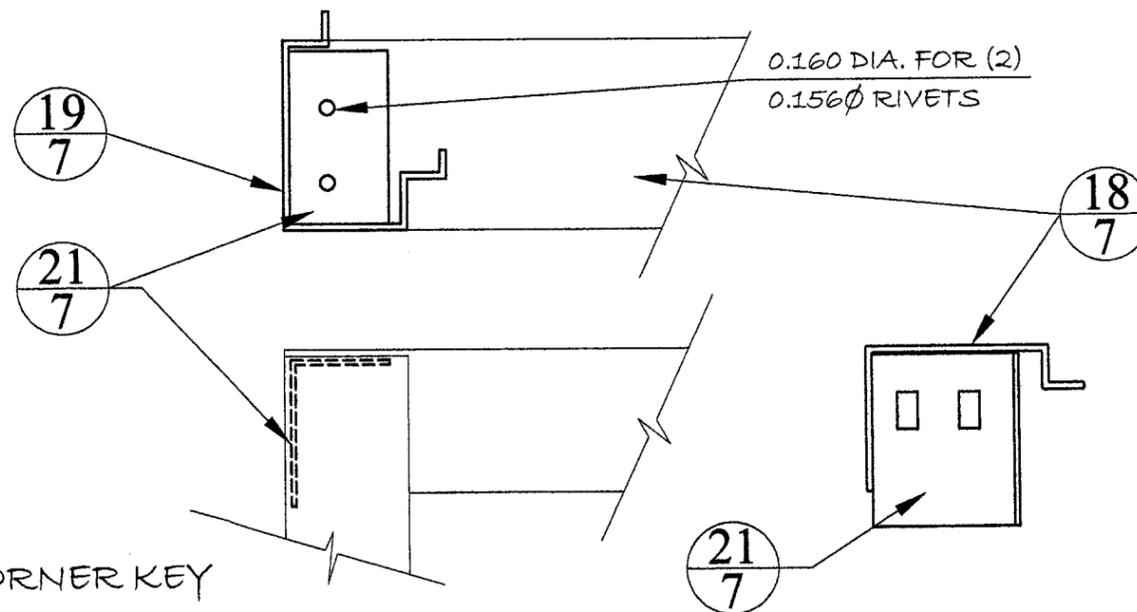



MASTER SECURITY DOORS, INC

702 SOUTH MILITARY TRAIL
 DEERFIELD BEACH, FL 33442
 TELEPHONE: 561-499-7558
 FAX: 561-499-7558

MODEL:	EX3 USA OUTSWING DOOR LARGE MISSILE IMPACT RESISTANT
DRAWING:	DETAILS
SCALE:	NONE
DRAWN BY:	KP
DATE DWN:	09/15/05
Rev.:	2/27/06 General

Approved as complying with the
 Florida Building Code
 Date 04/20/06
 NOA 05-1121-03
 Miami Dade Product Control
 Division

05-370
 DRAWING N°
 SHEET 8 OF 11

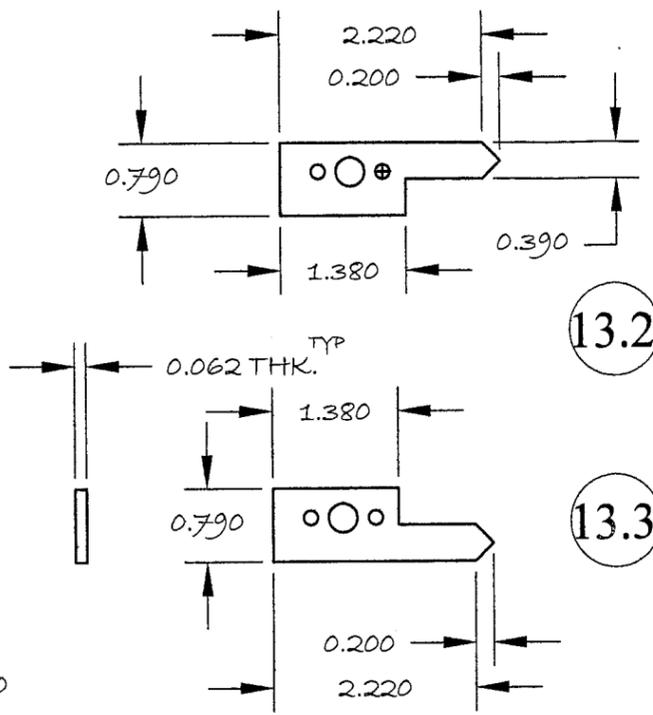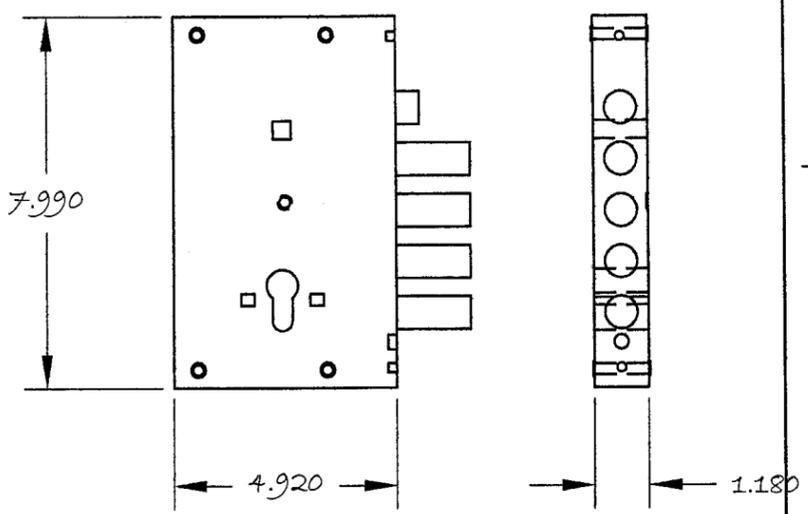



ITEM #	DESCRIPTION	QUANTITY
13.1	LOCK	1
13.2	TONQUE UPPER	1
13.3	TONQUE LOWER	1
13.4	LOCK SLIDE BOLTS	2
13.5	CONNECTOR ROD (NOT SHOWN)	2
13.6	LOCK STRIKE PLATE	1
*	*	*
*	*	*
*	*	*
*	*	*
*	*	*
*	*	*

13
9 MULTI-POINT LOCKING SYSTEM

MASTER SECURITY DOORS, INC.
 702 SOUTH MILITARY TRAIL
 DEERFIELD BEACH, FL 33442
 TELEPHONE: 561-499-7558
 FAX: 561-499-7558

13.1 LOCK
 SCALE: 1/4
 ATTACHED TO LOCK STILE W/ (2) 1/4-28 X 1/2" FH ALLEN SCR.

13.2
13.3
 TONGUE UPPER AND LOWER
 SCALE: 1/2

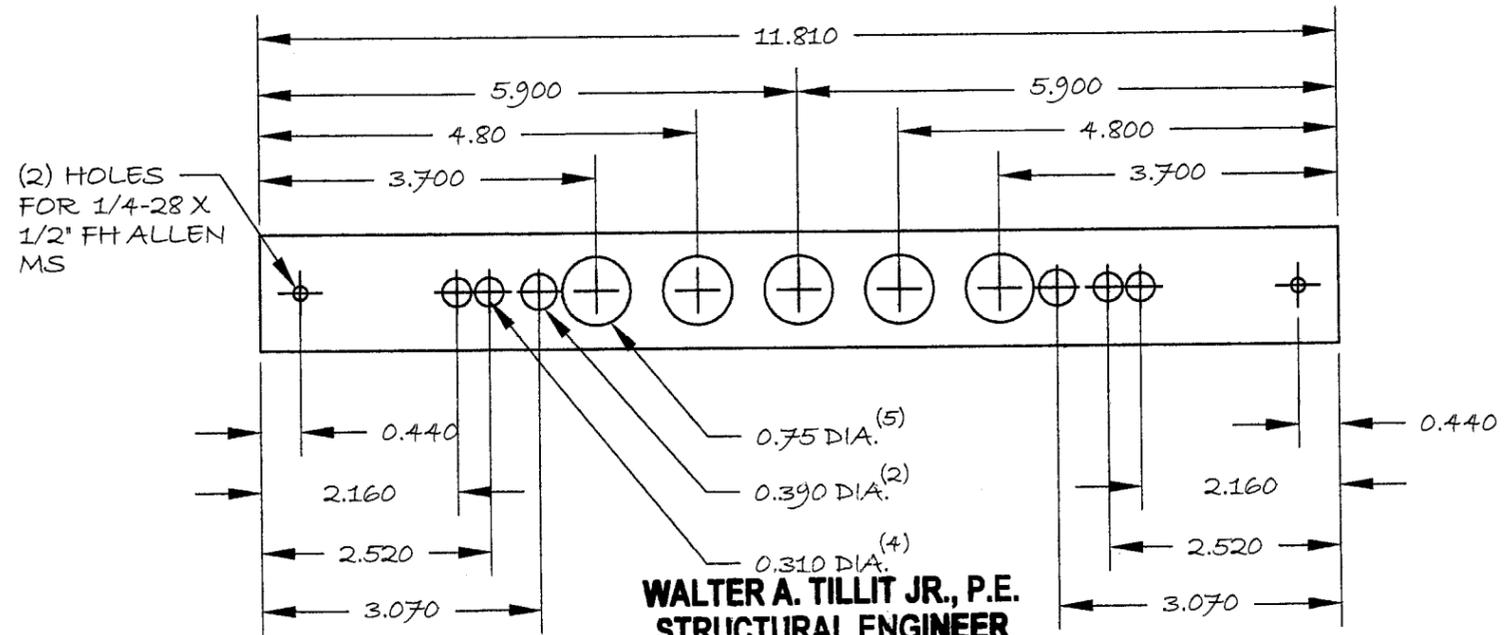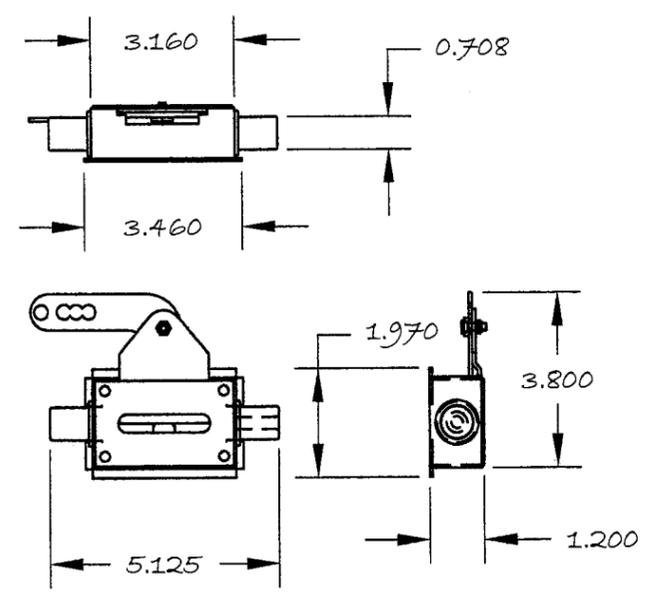

13.4 LOCK SLIDE BOLTS
 SCALE: 1/4
 (2) REQUIRED AT LOCK STILE

13.6 LOCK STRIKE PLATE
 SCALE: 1/2

WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
 FL. LIC. NO. 44167

[Signature]
 FEB 27 2006

MODEL: EX3 USA
 OUTSWING DOOR
 LARGE MISSILE
 IMPACT RESISTANT
 DRAWING: LOCK SYSTEM
 SCALE: NONE
 DRAWN BY: KP
 DATE DWN: 09/15/05

Approved as complying with the
 Florida Building Code
 Date **04/20/06**
 NOA# **05-1121-03**
 Miami-Dade Product Control
 Division
 By *[Signature]*

WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
FL. LIC. NO. 44167



[Signature]
FEB 27 2006

TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 NW 36th STREET, STE. 305
MIAMI, FLORIDA 33166


EB LICENSE No 0000719

6
10 HINGE ASSEMBLY


ITEM #	DESCRIPTION	QUANTITY
6.1	HINGE MALE	1/ ASSY
6.2	HINGE BACKER PLATE	1/ ASSY
6.3	HINGE FEMALE	1/ ASSY
6.4	M8 X 1.375 SOCKET HEAD	2/ ASSY
6.5	PIVOT ROD	1/ ASSY
6.6	M8 X 20.37 ALLEN FH	2/ ASSY
*	*	*
*	*	*
*	*	*
*	*	*
*	*	*
*	*	*

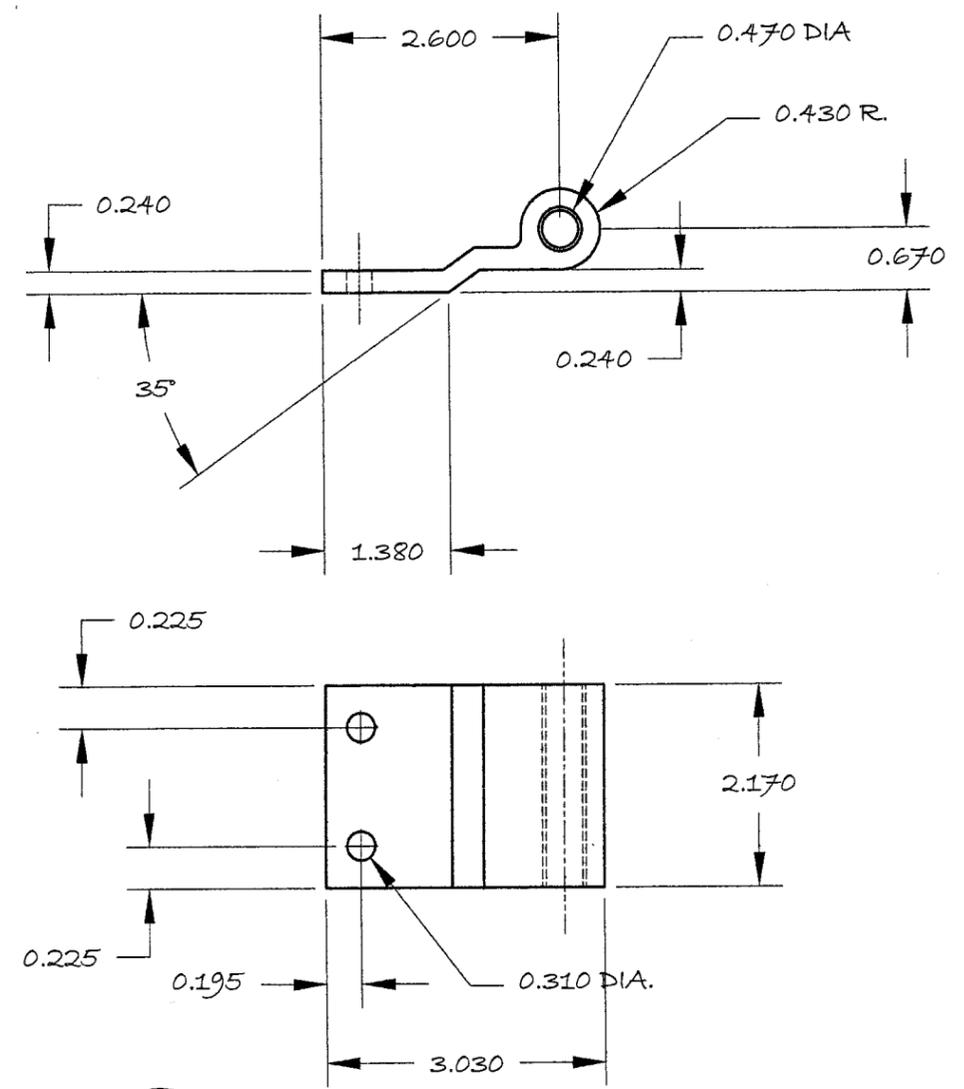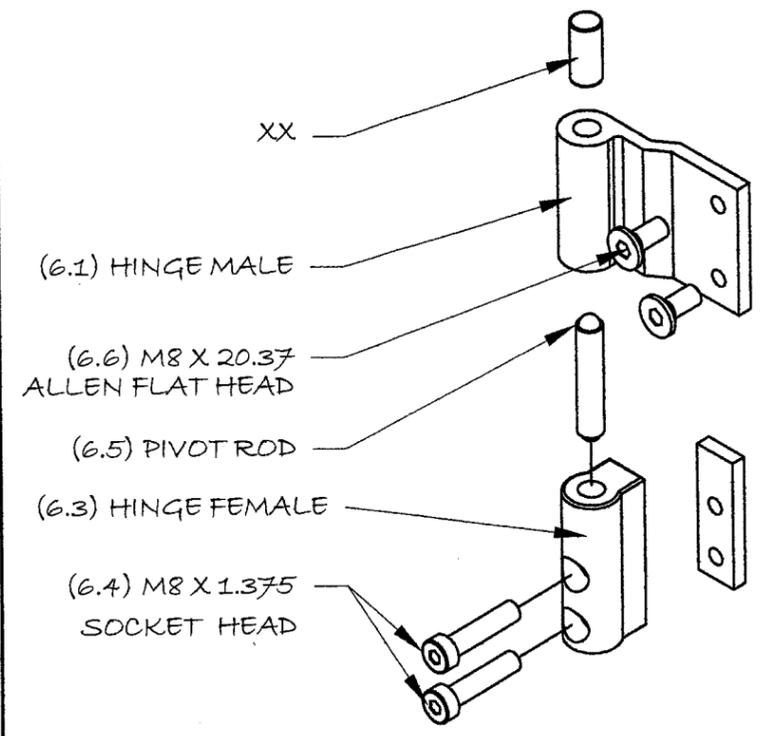

6.1 HINGE MALE
SCALE: HALF

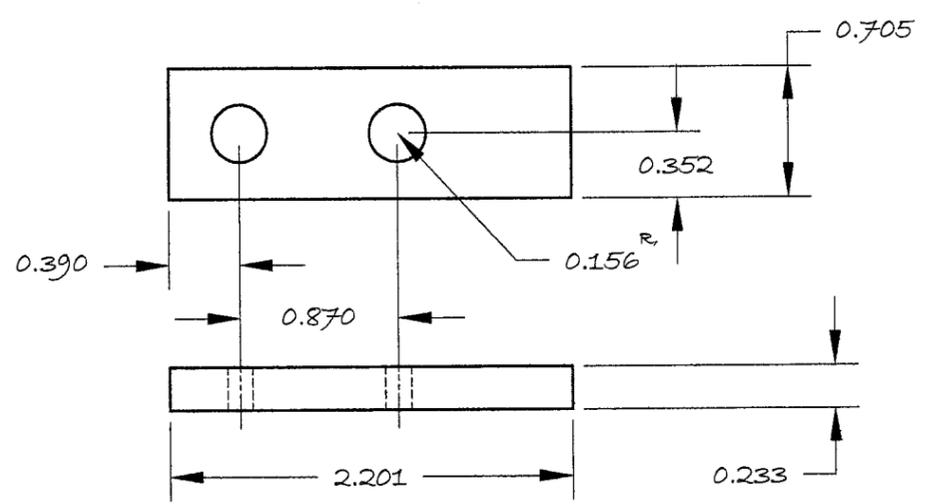

6.2 HINGE BACKER PLATE
SCALE: FULL

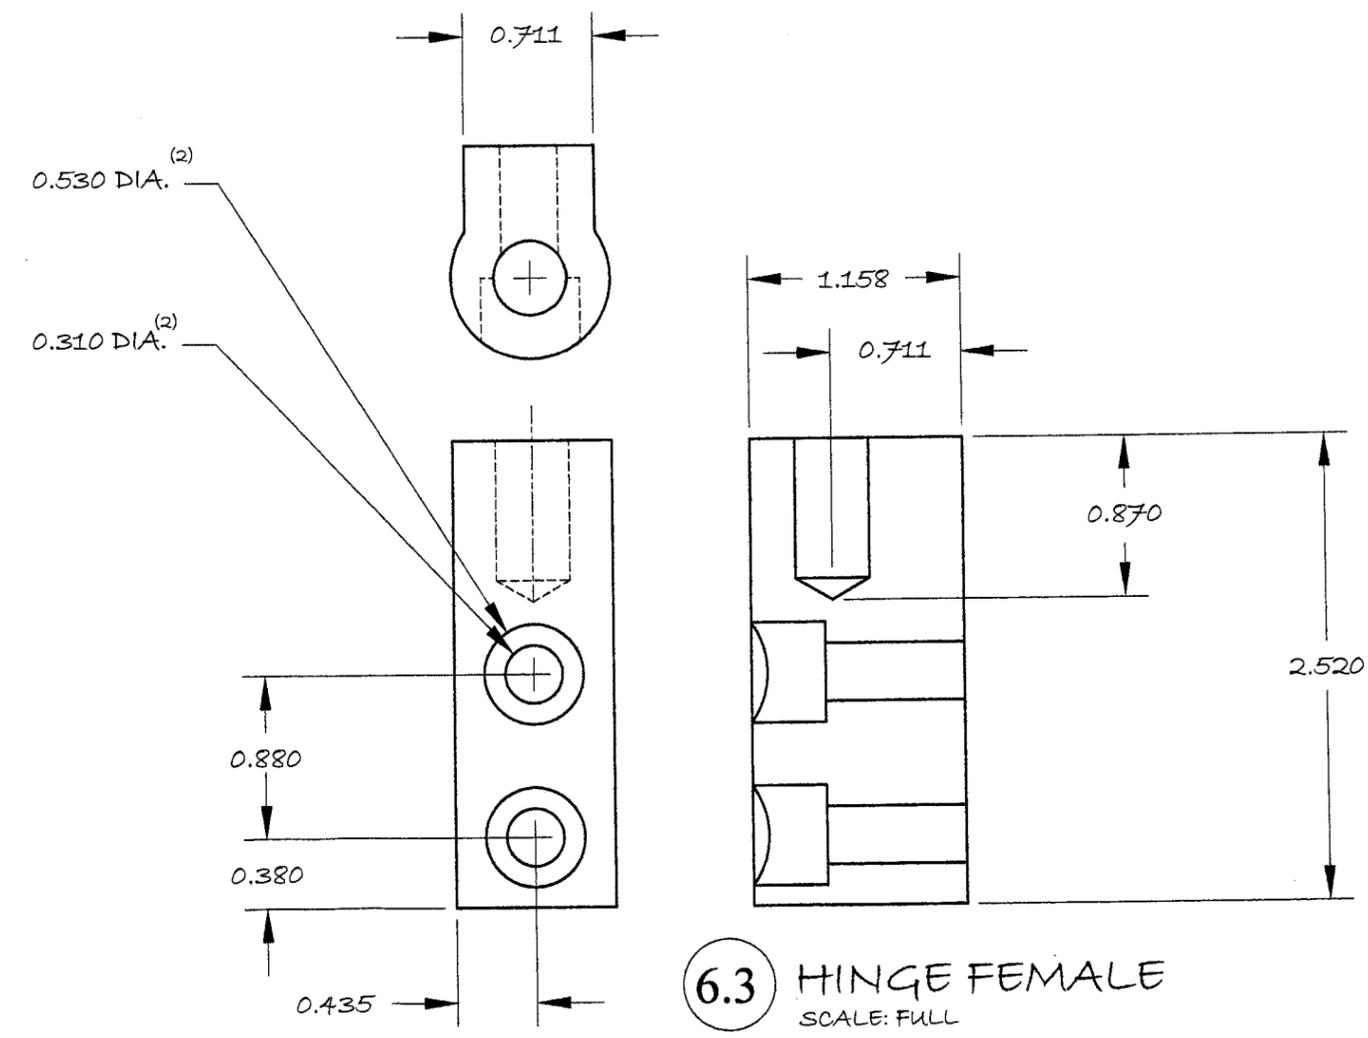


6.3 HINGE FEMALE
SCALE: FULL

MASTER SECURITY DOORS, INC
702 SOUTH MILITARY TRAIL
DEERFIELD BEACH, FL 33442
TELEPHONE: 561-499-7558
FAX: 561-499-7558


MODEL: EX3 USA
OUTSWING DOOR
LARGE MISSILE
IMPACT RESISTANT
DRAWING: HINGE ASSY
SCALE: NONE
DRAWN BY: KP
Rev.: 2/27/06
General
DATE DWN: 09/15/05

Approved as complying with the
Florida Building Code
Date: 04/20/06
NOA: 05-1121-03
Miami-Dade Product Control
By: *[Signature]*


05-370
DRAWING N°
SHEET 10 OF 11

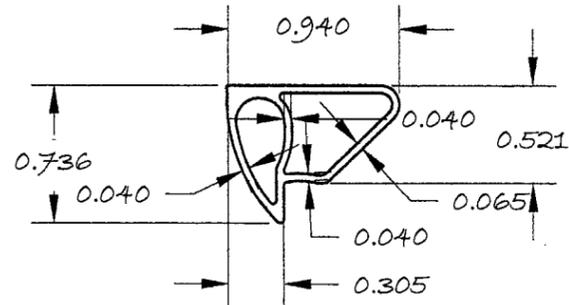


22/11 FRAME GASKET
SCALE: FULL

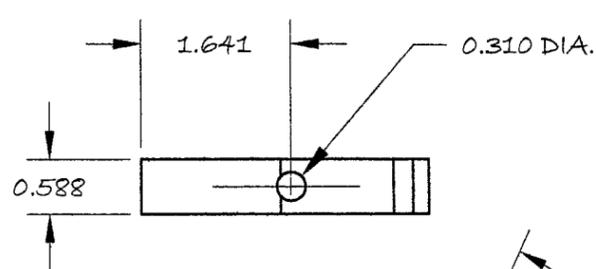



26/11 RETENTION CLIP
SCALE: HALF

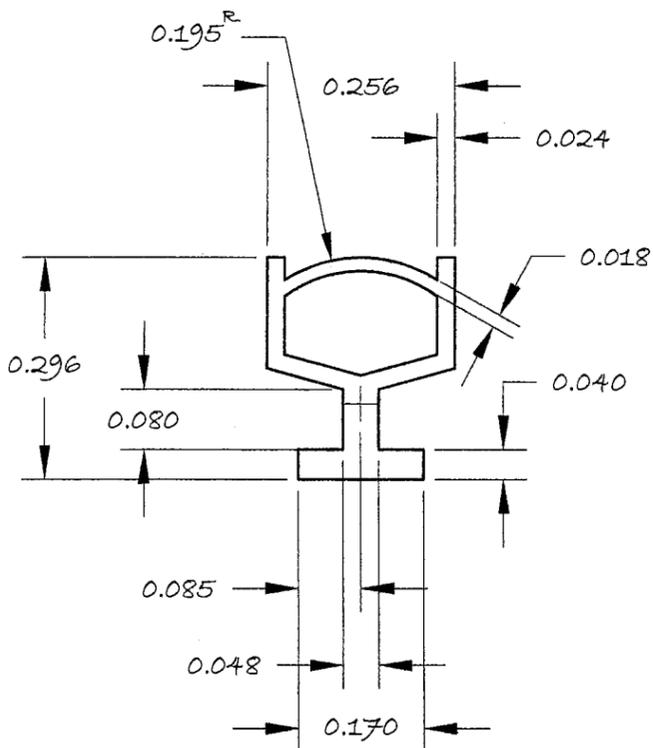

23/11 COMPRESSION GASKET
SCALE: 10X

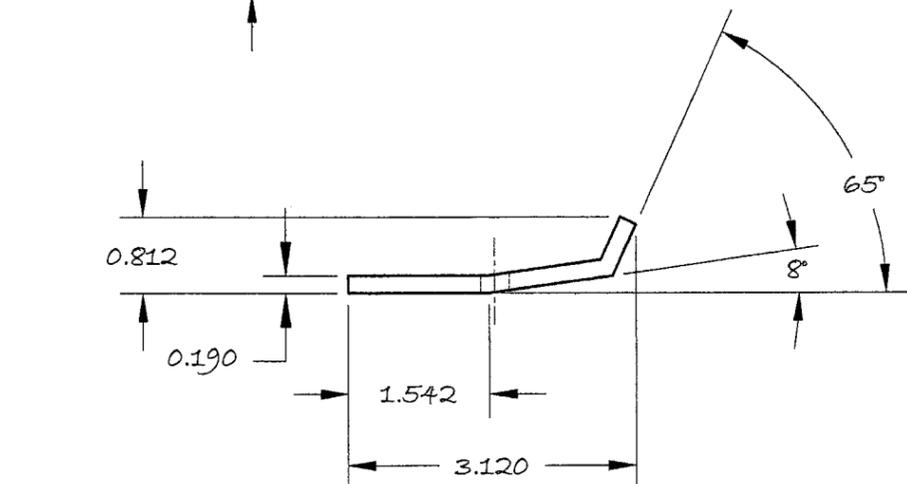

25/11 ADJ RETENTION CLIP HOUSING
SCALE: 1/2

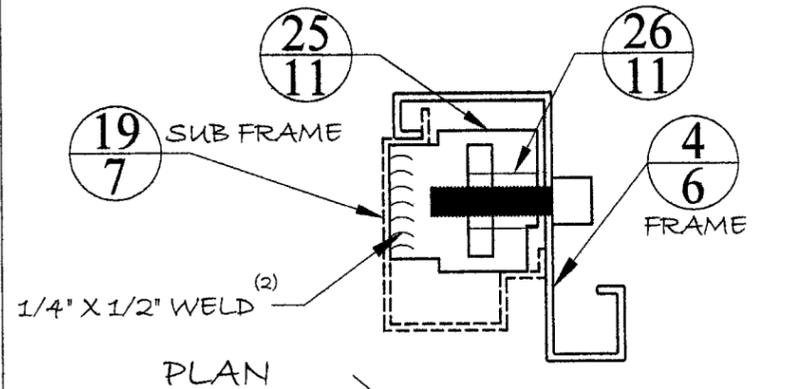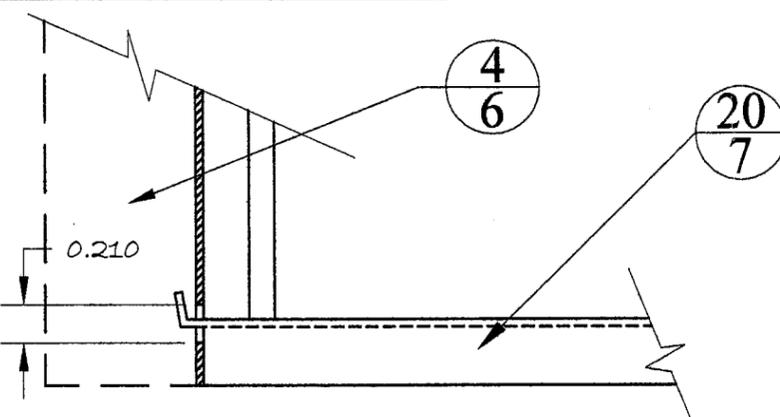



25/11 ELEVATION

X/11 SUBFRAME CONNECTION TO FRAME

WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
FL. LIC. NO. 44167

[Signature]
FEB 27 2006

Y/11 LOWER FRAME SILL
TO FRAME JAMB
CONNECTION

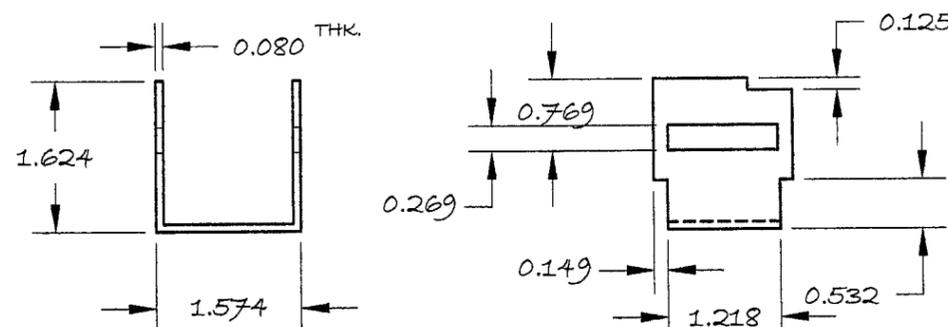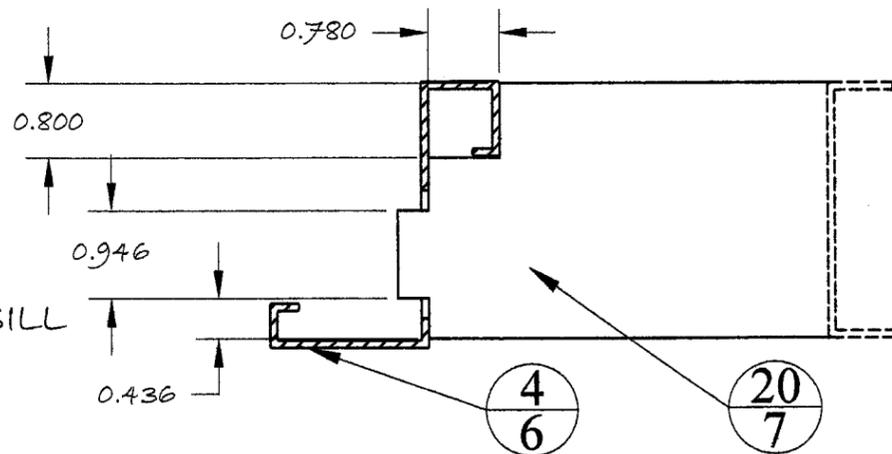

TILECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 NW 36th STREET, STE. 305
MIAMI, FLORIDA 33166
EB LICENSE # 0006719

MASTER SECURITY DOORS, INC.
702 SOUTH MILITARY TRAIL
DEERFIELD BEACH, FL 33442
TELEPHONE: 561-499-7558
FAX: 561-499-7558

MODEL: EX3 USA
OUTSWING DOOR
LARGE MISSILE
IMPACT RESISTANT
DRAWING: DETAILS
SCALE: NONE
DRAWN BY: KP
DATE DWN: 09/15/05

Approved as complying with the
Florida Building Code
Date 04/20/06
NOAH 05-1121-03
Miami Dade Product Control
Division
By: *[Signature]*

05-370
DRAWING N°
SHEET 11 OF 11