



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

[www.buildingcodeonline.com](http://www.buildingcodeonline.com)

**NOTICE OF ACCEPTANCE (NOA)**

**Luxbau, LLC  
2400 Centrepark West Dr. #150  
West Palm Beach, FL 33409**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone.

**DESCRIPTION: Luxbaum Windows & Doors Wood Fixed Window – L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **1188**, titled "Luxbaum Windows & Doors Wooden Fixed Window System", sheets 1 through 4 of 4, dated 11/18/02 with revision A2 dated 06/14/05, prepared by W.W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren Schaefer, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises and supersedes NOA# 03-0326.02** and consists of this page 1 as well as evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 05-1123.02  
Expiration Date: May 29, 2008  
Approval Date: May 11, 2006  
Page 1**


**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No. **1188**, titled "Luxbaum Windows & Doors Wooden Fixed Window System", sheets 1 through 4 of 4, dated 11/18/02 with revision A2 dated 06/14/05, prepared by W.W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren Schaefer, P.E.

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of a fixed wood window, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0271-0519-05** dated 5/24-25/05, signed and sealed by Vinu J. Abraham, P.E.
2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of a fixed wood window, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL 0271-0717.02** dated 7/24/02, signed and sealed by Vinu J. Abraham, P.E.  
**"Submitted under NOA #03-0326.02"**
3. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of a fixed wood window, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL 0271-0119-03** dated 3/17/03, signed and sealed by Vinu J. Abraham, P.E.  
**"Submitted under NOA #03-0326.02"**
4. Test reports on 1) Large Missile Impact Test per FBC, TAS 201-94  
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of a fixed wood window, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL 0271-1010-02** dated 10/16/02, signed and sealed by Vinu J. Abraham, P.E.  
**"Submitted under NOA #03-0326.02"**

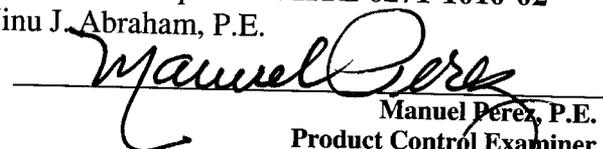


Manuel Perez, P.E.  
Product Control Examiner  
NOA No 05-1123.02  
Expiration Date: May 29, 2008  
Approval Date: May 11, 2006


**NOTICE OF ACCEPTANCE:EVIDENCE SUBMITTED**

- C. CALCULATIONS**
1. Revised Anchor Calculations and structural analysis, complying with the FBC 2004, dated 01/07/03, signed and sealed by Warren W. Schaefer, P.E.  
**Complies with ASTM E 1300-98**
- D. QUALITY ASSURANCE**
1. Miami Dade Building Code Compliance Office (BCCO).
- E. MATERIAL CERTIFICATIONS**
1. Notice of Acceptance No. **01-1204.01**, issued to E.I. DuPont DeNemours for their "Sentry Glass ® Plus", approved on 1/17/02 and expiring on 1/14/07.
  2. Notice of Acceptance No. **02-1205.03**, issued to Security Impact Glass Holdings for their "SAF-GLAS Polycarbonate Laminate", approved on 1/2/03 and expiring on 12/16/07.
- F. STATEMENTS**
1. Statement letter of conformance, dated 3/18/03, signed and sealed by Warren Schaefer, P.E.
  2. Statement letter of conformance, dated 3/18/03, signed and sealed by Warren Schaefer, P.E.  
*"Submitted under NOA #03-0326.02"*
  3. Statement letter of no financial interest, dated 3/18/03, signed and sealed by Warren Schaefer, P.E.  
*"Submitted under NOA #03-0326.02"*
  4. Laboratory compliance letter for Test Report no. **HTL 0271-0717.02, 0271-0119-03, 0271-1010-02**, issued by Hurricane Test Laboratory, Inc., dated 2/20/03, signed and sealed by Vinu Abraham, P.E.  
*"Submitted under NOA #03-0326.02"*
- G. OTHER**
1. Notice of Acceptance No. **03-0326.02**, issued to Luxbau, LLC, for Luxbaum Windows & Doors Wood Fixed Window, dated 05/29/03 and expiring on 05/29/08.


  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No 05-1123.02  
Expiration Date: May 29, 2008  
Approval Date: May 11, 2006

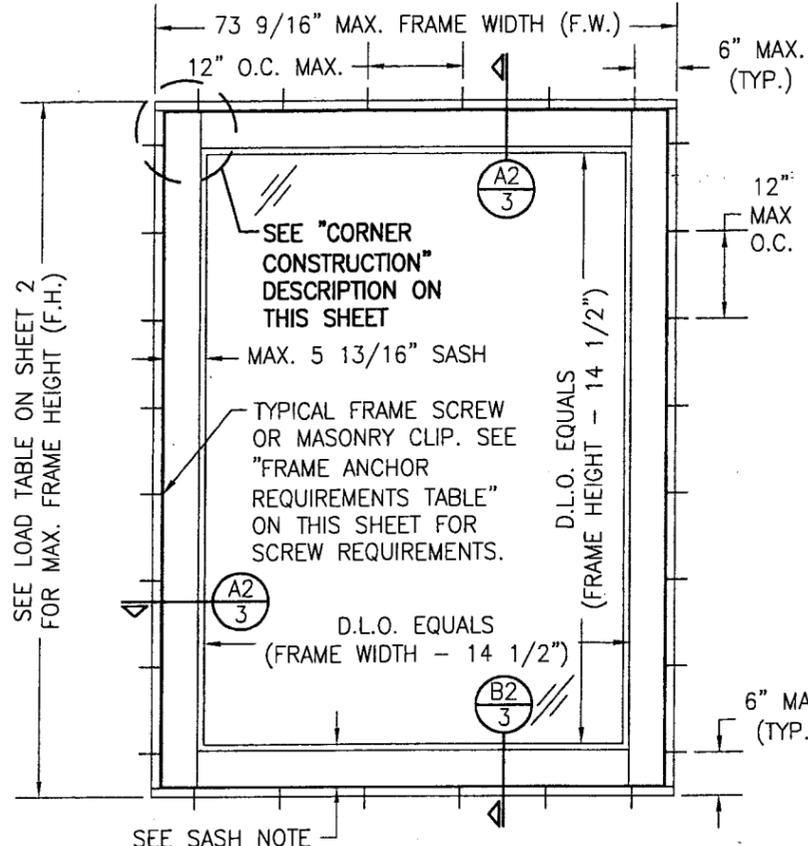

**EXTERIOR ELEVATION**  
**SINGLE WINDOW WITH 5 13/16" SASH**  
 SCALE: 1/2"=1'-0"

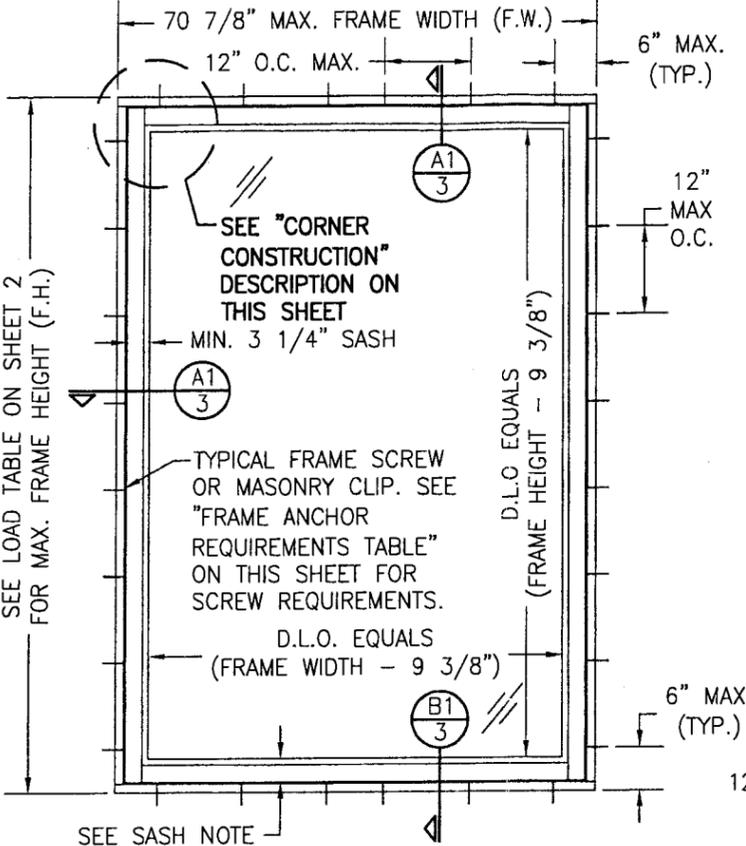

**EXTERIOR ELEVATION**  
**SINGLE WINDOW WITH 3 1/4" SASH**  
 SCALE: 1/2"=1'-0"

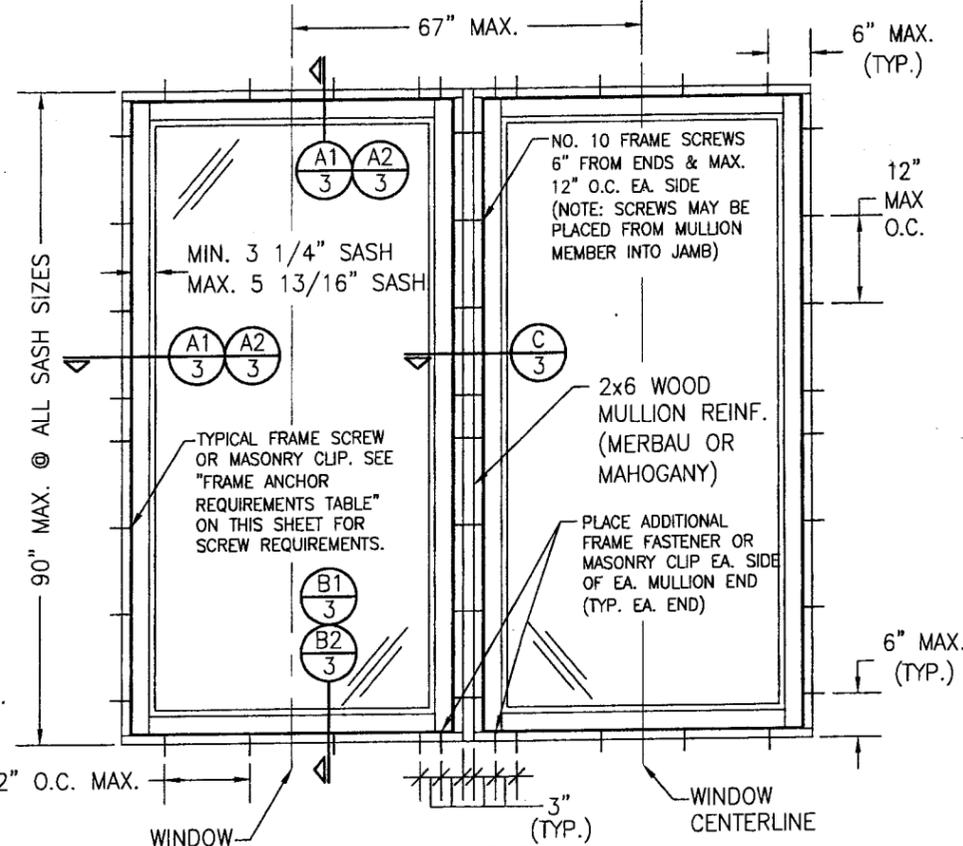

**EXTERIOR ELEVATION**  
**MULTIPLE WINDOW UNIT**  
 (MAX. FOUR UNITS MAY BE COMBINED)  
 SEE OTHER ELEVATIONS FOR WINDOW DETAILS  
 SCALE: 1/2"=1'-0"

**ALLOWABLE DESIGN LOADS**  
 SEE DESIGN LOAD TABLE  
 ON SHEET 2

RECTANGULAR WINDOWS SHOWN. ANCHORING OF SHAPED  
 WINDOWS IS THE SAME WITH REQUIRED ANCHOR SPACING  
 ALONG THE FRAME RADIUS CIRCUMFERENCE BEING THE  
 SAME AS SPECIFIED FOR A STRAIGHT FRAME.

LONG DIMENSION OF WINDOW MAY BE HORIZONTAL OR  
 VERTICAL (HEIGHT & WIDTH MAY BE INTERCHANGED).

**SASH NOTE:**  
 WHEN WINDOW IS USED AS A DOOR  
 SIDE LIGHT, THE SASH HEIGHT MAY  
 BE INCREASED TO EQUAL THE DOOR  
 PANEL BOTTOM RAIL HEIGHT.

**MULTIPLE UNIT NOTES:**

1. ALL WINDOWS ARE RESTRICTED BY THE DIMENSIONS SPECIFIED.
2. THE MAXIMUM ALLOWABLE PRESSURE FOR A COMBINED UNIT IS RESTRICTED BY THE LESSER OF THE INDIVIDUAL WINDOW ALLOWABLE PRESSURE (SEE LOAD TABLE ON SHEET 2) OR THE ALLOWABLE MULLION PRESSURE OF +65/-70 PSF
3. STACKING MAY BE HORIZONTAL OR VERTICAL.


**CORNER CONSTRUCTION**

JAMB CORNERS: VERTICAL JAMB ENDS ARE COPED AND BUTTED TO HORIZONTAL JAMBS WITH JOINT FULLY GLUED WITH WOOD GLUE AND DOWELED WITH (3) 1/2" DIA. x 3 5/16" LONG MERBAU WOOD DOWELS.

SASH CORNERS: HORIZONTAL SASH ENDS ARE COPED AND BUTTED TO VERTICAL SASH PROFILES WITH JOINT FULLY GLUED WITH WOOD GLUE AND DOWELED WITH (2) 1/2" DIA. x 3 7/16" AND (1) 5/8" DIA. x 3 1/4" MERBAU WOOD DOWELS.

**GENERAL NOTES**

1. THESE WINDOW SYSTEMS HAVE BEEN TESTED, ANALYZED AND APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN THE "ALLOWABLE DESIGN LOADS" TABLE.
2. BUCKING, OPENINGS & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
3. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & MAY NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS.
4. THE DETAILS & SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS TESTED & PROPOSED FOR WATER, AIR, IMPACT, CYCLIC & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH FLORIDA BUILDING CODE PROTOCOLS TAS 201, 202 & 203 FOR LARGE MISSILE IMPACT WINDOWS.
5. THESE WINDOW SYSTEMS HAVE BEEN DESIGNED IN ACCORDANCE WITH THE 2004 FLORIDA BUILDING CODE (F.B.C.).
6. IMPACT SHUTTERS ARE NOT REQUIRED WITH THESE WINDOWS.
7. ALL ANCHORS SHALL BE INSTALLED AS SPECIFIED ON THESE DRAWINGS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.

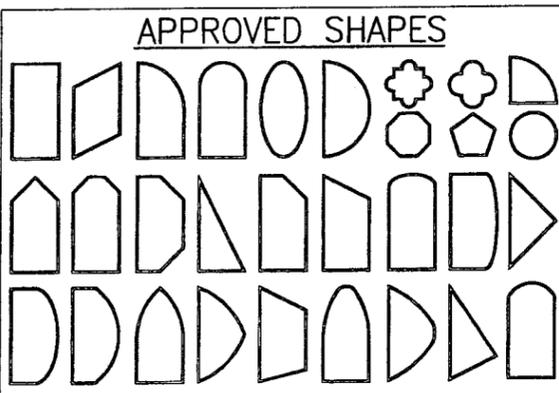

**NOTES:**  
 1. OTHER SHAPES MAY APPLY PROVIDING THEY ARE SIMILAR TO THOSE SHOWN & HAVE CORNER CONSTRUCTION AS DESCRIBED ON THIS SHEET.  
 2. ALL SHAPED UNITS MUST FIT INSCRIBED INTO THE ALLOWABLE RECTANGULAR UNITS & BE GOVERNED BY THE ALLOWABLE PRESSURE OF THE RESPECTIVE RECTANGULAR UNIT.

* FRAME ANCHOR REQUIREMENTS TABLE			
OPENING TYPE (SUBSTRATE)	JAMB TO OPENING FASTENER TYPE	MINIMUM EMBEDMENT	MINIMUM EDGE DIST.
2X_ WOOD FRAME OR BUCK	NO. 12 SMS SCREW	1 1/4"	1"
CMU/CONCRETE	(1) 1/4" CONCRETE SCREWS	1 1/4"	2 1/2"

(1) CONCRETE SCREWS SHALL BE ELCO OR ITW RAMSET/RED HEAD TAPCONS, HILTI KWIK-CON II OR POWERS RAWL TAPPER (HARDENED STEEL OR S.S.).

\* ANCHOR NOTE: FRAME MAY BE EITHER DIRECT MOUNTED TO THE OPENING, MOUNTED ONTO A CONTINUOUS WOOD SPACER, OR ANCHORED TO A MIN. 2x4 BUCK, NO. 12 SCREWS SHALL BE USED. WHEN DIRECT MOUNTED OR MOUNTED WITH SPACER, 1/4" CONCRETE SCREW SHALL BE USED. SEE "ANCHOR REQUIREMENTS TABLE" FOR EMBED REQUIREMENTS.


**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 05-1123.02  
 Expiration Date MAY 29, 2008  
 By *Manuel Perry*  
 Miami Made Product Control  
 Division

DRAWN BY: K.P.S.	CHECKED BY: W.W.S.
PLOT: 1-24	DATE: 11/18/02
DATE 6/14/05	BY WWS
DESCRIPTION ADDED DOUBLE SASH	DATE 6/14/05
NO. A1	DESCRIPTION WINDOW CONDITION
NO. A2	DESCRIPTION REVISED TO 2004 F.B.C.
DRAWING TITLE LUXBAUM WINDOWS & DOORS WOODEN FIXED WINDOW SYSTEM	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 8895 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903	
MANUFACTURER LUXBAU, LLC 2400 CENTERPARK WEST DRIVE, SUITE 150 WEST PALM BEACH, FL 33409 561-684-1500	
CERTIFICATION JUN 20 2005	WARREN W. SCHAEFER, P.E. P.E. NO. 44135
DRAWING NO. 1188	REV. A
SHEET NO. 1 OF 4	

**ALLOWABLE WINDOW SIZE & DESIGN PRESSURE TABLE  
(SINGLE WINDOWS)**

D.L.O.		FRAME SIZE				ALLOWABLE PRESSURE	
HEIGHT (IN.)	WIDTH (IN.)	3 1/4" SASH		5 3/4" SASH		GLASS OPTION 1 OR 3	GLASS OPTION 2 OR 4
		HEIGHT (IN.)	WIDTH (IN.)	HEIGHT (IN.)	WIDTH (IN.)	9/16" LAMINATED ANNEALED (PSF)	9/16" LAMINATED HEAT STRENGTHENED (PSF)
59	53	68.0	62.0	73.0	67.0	75.0	75.0
	59		68.0		73.0	69.9	75.0
65	47	74.0	56.0	79.0	61.0	75.0	75.0
	53		62.0		67.0	71.3	75.0
	59		68.0		73.0	62.3	75.0
71	47	80.0	56.0	85.0	61.0	75.0	75.0
	53		62.0		67.0	64.8	75.0
	59		68.0		73.0	57.8	75.0
83	41	92.0	50.0	97.0	55.0	75.0	75.0
	47		56.0		61.0	65.1	75.0
	53		62.0		67.0	56.3	75.0
	59		68.0		73.0	48.9	75.0
95	35	104.0	44.0	109.0	49.0	75.0	75.0
	41		50.0		55.0	73.1	75.0
	47		56.0		61.0	58.9	75.0
	53		62.0		67.0	49.5	75.0
107	59	116.0	68.0	121.0	73.0	43.0	75.0
	35		44.0		49.0	75.0	75.0
	41		50.0		55.0	68.5	75.0
119	47	128.0	56.0	133.0	61.0	54.6	75.0
	35		44.0		49.0	75.0	75.0
	41		50.0		55.0	64.9	75.0
	47		56.0		61.0	51.2	75.0


- NOTES:  
 1. ACTUAL FRAME SIZES = (D.L.O. + 9.5") AT 3.25" SASH UNITS & (D.L.O. + 14.25") AT 5.75" SASH UNITS.  
 2. ALL PRESSURES IN TABLE ARE FOR POSITIVE & NEGATIVE DIRECTIONS.  
 3. HEIGHT & WIDTH MAY BE INTERCHANGED SUCH THAT LONG DIMENSION IS HORIZONTAL OR VERTICAL.  
 4. ALL SIZES IN THIS TABLE ARE +/- 1/2".

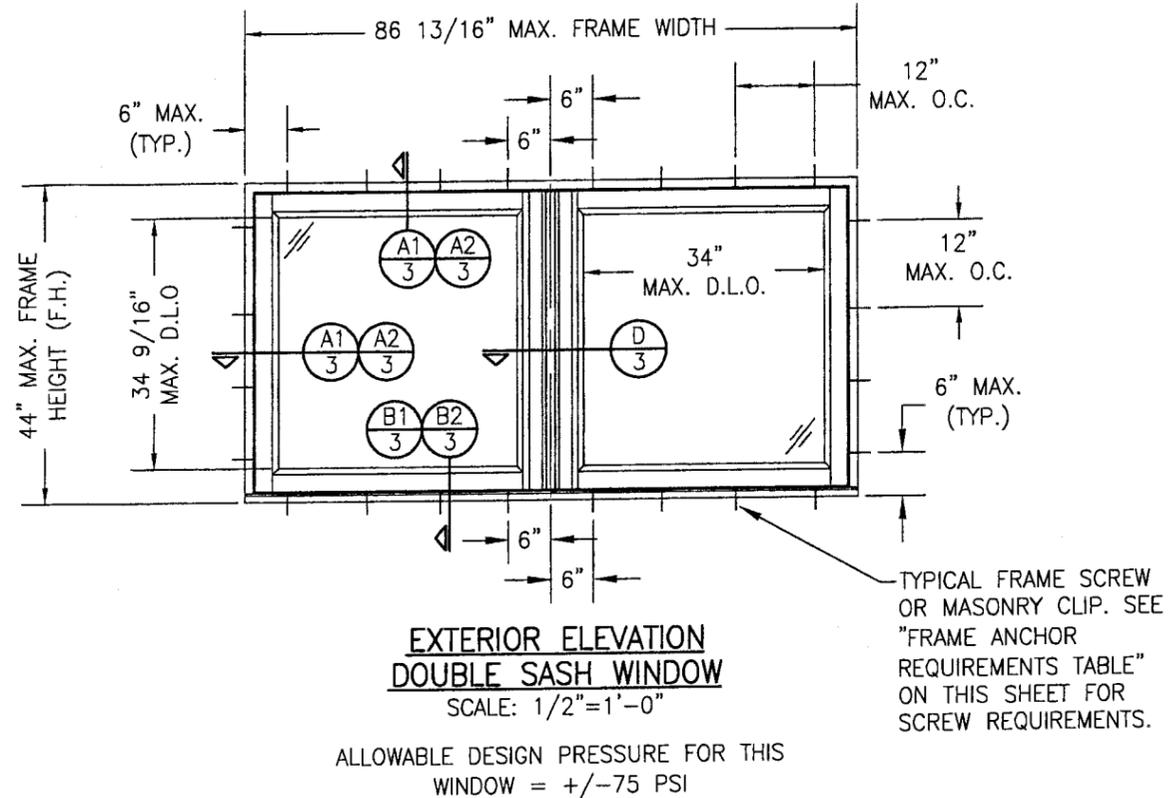

DRAWN BY: K.P.S.	CHECKED BY: W.W.S.
PLOT: 1=24	DATE: 11/18/02
NO.	REVISION DESCRIPTION
DATE	BY
DRAWING TITLE: LUXBAUM WINDOWS & DOORS WOODEN FIXED WINDOW SYSTEM	
MANUFACTURER: LUXBAU, LLC	
2400 CENTERPARK WEST DRIVE, SUITE 150 WEST PALM BEACH, FL 33409 561-684-1500	
CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 8895 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903	
CERTIFICATION	JUN 20 2005
WARREN W. SCHAEFER, P.E. P.E. NO. 44135	
DRAWING NO. 1188	REV. A
SHEET NO. 2	OF 4


**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 Acceptance No 05-1123.02  
 Expiration Date MAY 25, 2008

By *Manuel Serra*  
 Miami Dade Product Control  
 Division

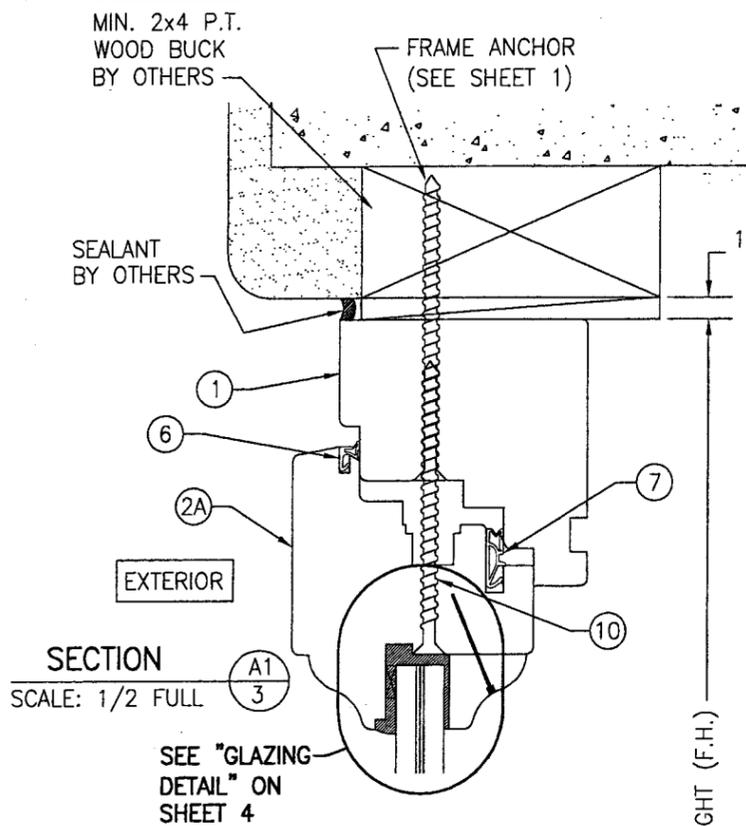


SECTION A1  
SCALE: 1/2 FULL

SEE "GLAZING DETAIL" ON SHEET 4

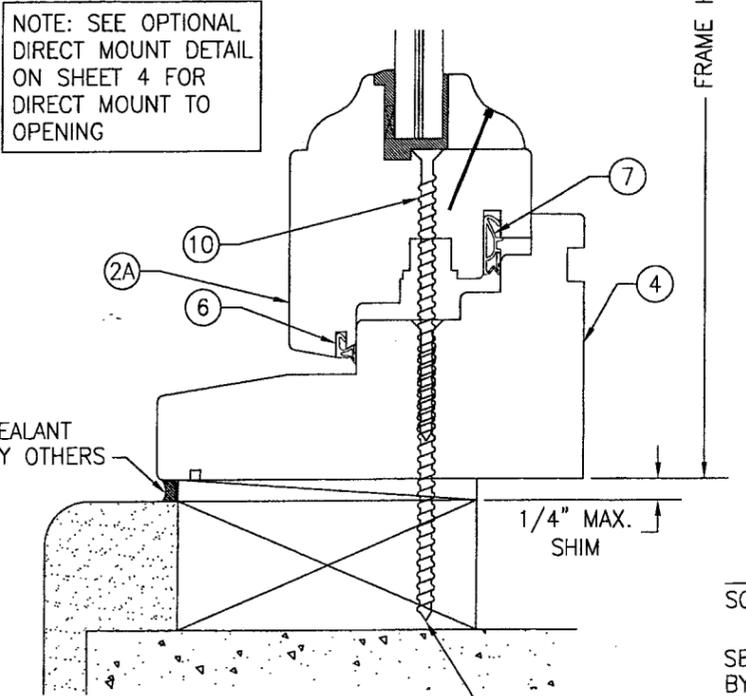


SECTION B1  
SCALE: 1/2 FULL

NOTE: BRICK MOLDS MAY BE PLACED WITH WINDOW & ARE OPTIONAL (NOT SHOWN)

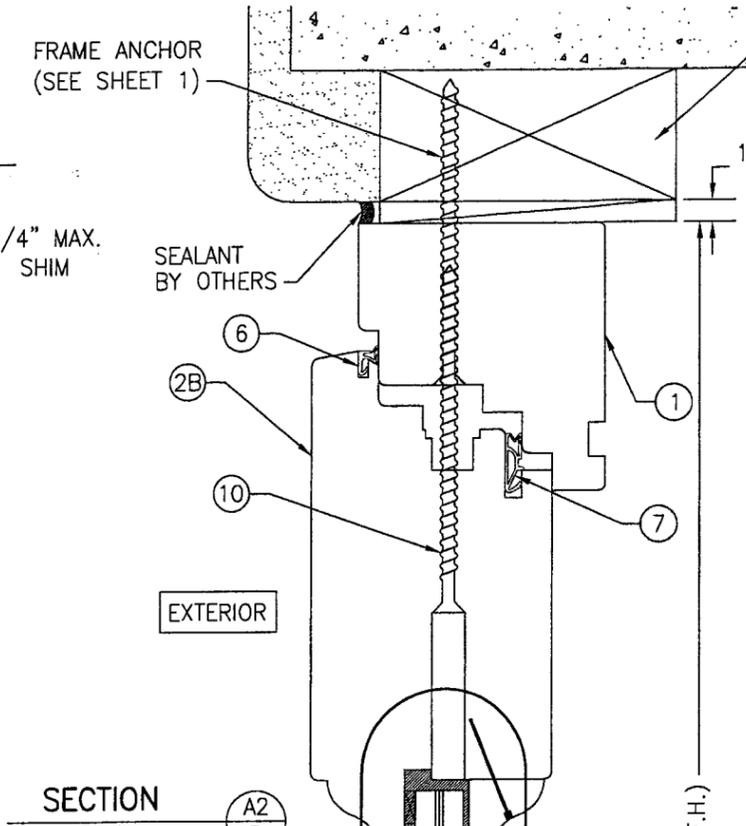


SECTION A2  
SCALE: 1/2 FULL

SEE "GLAZING DETAIL" ON SHEET 4

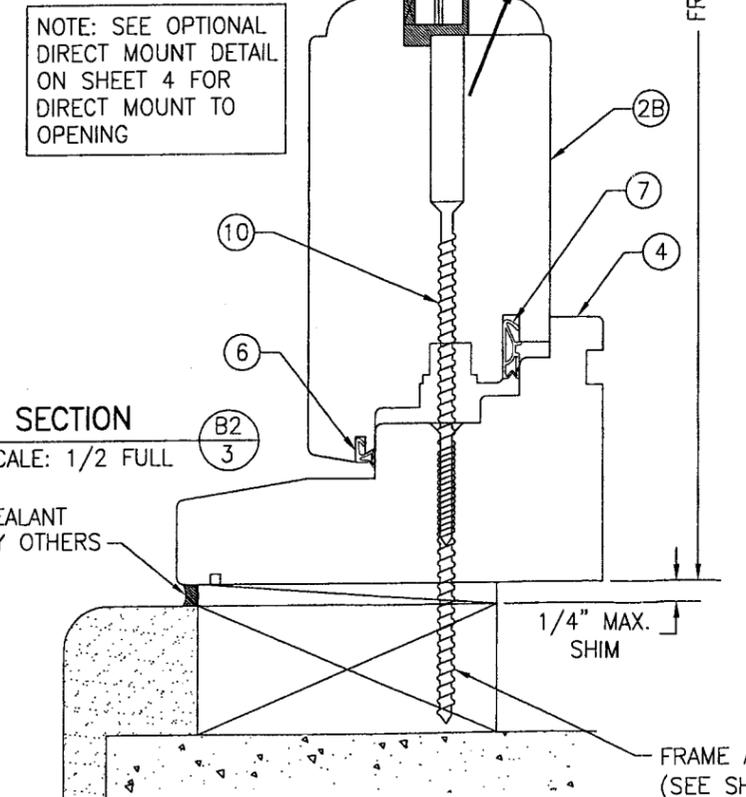


SECTION B2  
SCALE: 1/2 FULL

FRAME ANCHOR (SEE SHEET 1)

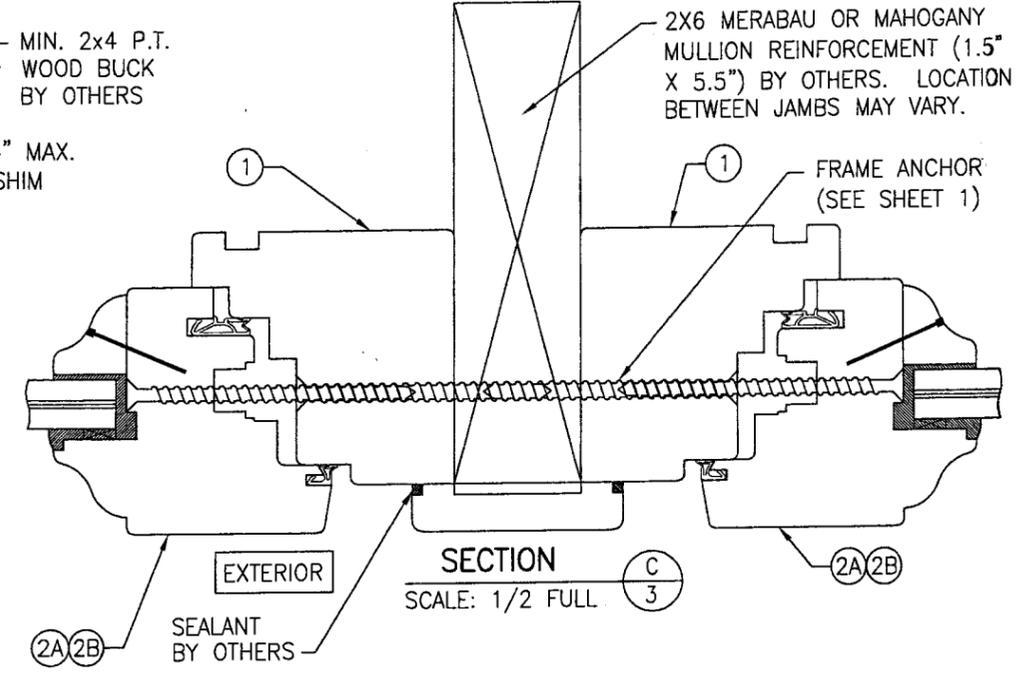

SECTION C  
SCALE: 1/2 FULL

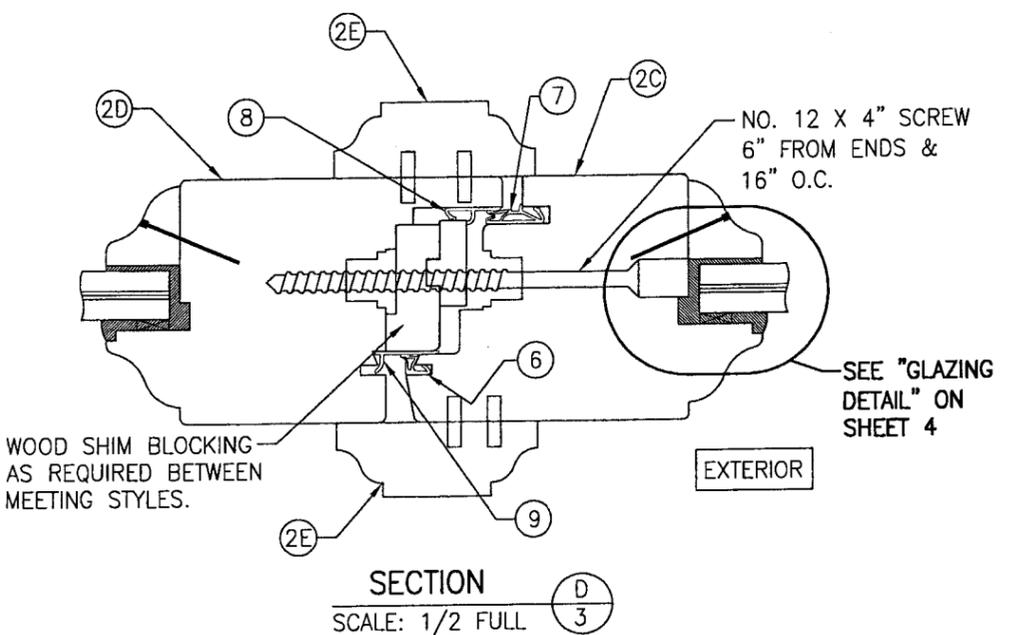

SECTION D  
SCALE: 1/2 FULL

WOOD SHIM BLOCKING AS REQUIRED BETWEEN MEETING STYLES.

SEE "GLAZING DETAIL" ON SHEET 4

PRODUCT REVISED as complying with the Florida Building Code  
Acceptance No. 05-1123.02  
Expiration Date MAY 25, 2008

By *Manuel Perez*  
Miami/Dade Product Control Division

DRAWN BY: K.P.S.	CHECKED BY: W.W.S.
PLLOT: 1-2	DATE: 11/18/02
DATE	
BY	
REVISION DESCRIPTION	
NO.	
DRAWING TITLE LUXBAUM WINDOWS & DOORS WOODEN FIXED WINDOW SYSTEM	
MANUFACTURER LUXBAU, LLC	
2400 CENTERPARK WEST DRIVE, SUITE 150 WEST PALM BEACH, FL 33409 561-684-1500	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 8895 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903	
CERTIFICATION JUN 20 2005	
WARREN W. SCHAEFER, P.E. P.E. NO. 44135	
DRAWING NO. 1188	REV. A
SHEET NO. 3 OF 4	

ITEM #	PART	ITEM DESCRIPTION	MANUFACTURER/NOTES
PARTS			
1	7478	FRAME HEAD & SIDE JAMB	MIN. SELECT STRUCTURAL MERBAU OR MAHOGANY
2A	7283	SMALL SASH	MIN. SELECT STRUCTURAL MERBAU OR MAHOGANY
2B	72148	LARGE SASH	MIN. SELECT STRUCTURAL MERBAU OR MAHOGANY
2C	72106	MEETING STYLE SASH	MIN. SELECT STRUCTURAL MERBAU OR MAHOGANY
2D	72118	MEETING STYLE SASH	MIN. SELECT STRUCTURAL MERBAU OR MAHOGANY
2E	2260	ASTRIGAL CAP	MIN. SELECT STRUCTURAL MERBAU OR MAHOGANY
3	2223	GLAZING BEAD	MIN. SELECT STRUCTURAL MERBAU OR MAHOGANY
4	78127	SILL JAMB	MIN. SELECT STRUCTURAL MERBAU OR MAHOGANY
5	-	1 5/8" WIDE x 0.05" THK. x MIN. 5" LONG MASONRY CLIP	ASTM A653 MIN. 33 KSI GALV. STEEL
SEALS AND SEALANTS			
6	SV-33/ACF-4527	COMPRESSION SEAL	DEVENTER/G-U
7	SV-12/ACF-6950	COMPRESSION SEAL	DEVENTER/G-U
8	S6544	COMPRESSION SEAL	DEVENTER/G-U
9	S6544	COMPRESSION SEAL	DEVENTER/G-U
MISCELLANEOUS FASTENERS			
10	-	#12 x 4" PFH SMS SCREW	4" FROM CORNERS & 12" O.C.
11	-	1/4" x 1 1/4" BRAD NAIL	2" FROM CORNERS & 4" O.C.






DRAWN BY:	K.P.S.	CHECKED BY:	W.W.S.
PLOT:	1=2	DATE:	11/18/02
REVISION	DESCRIPTION	DATE	BY
NO.			

LUXBAU, LLC  
 2400 CENTERPARK WEST DRIVE, SUITE 150  
 WEST PALM BEACH, FL 33409  
 561-684-1500

DRAWING TITLE: LUXBAUM WINDOWS & DOORS  
 WOODEN FIXED WINDOW SYSTEM  
 MANUFACTURER  
 CONSULTANTS  
 W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.  
 8885 N. MILITARY TRAIL, SUITE C-204  
 PALM BEACH GARDENS, FL 33410  
 PHONE: 561-775-4902 FAX: 561-775-4903

CERTIFICATION  
 JUN 20 2005  
 By: *Manuel Pera*  
 Miami Trade Product Control Division  
 WARREN W. SCHAEFER, P.E.  
 P.E. NO. 44135

DRAWING NO.	REV.
1188	A
SHEET NO.	
4	OF 4

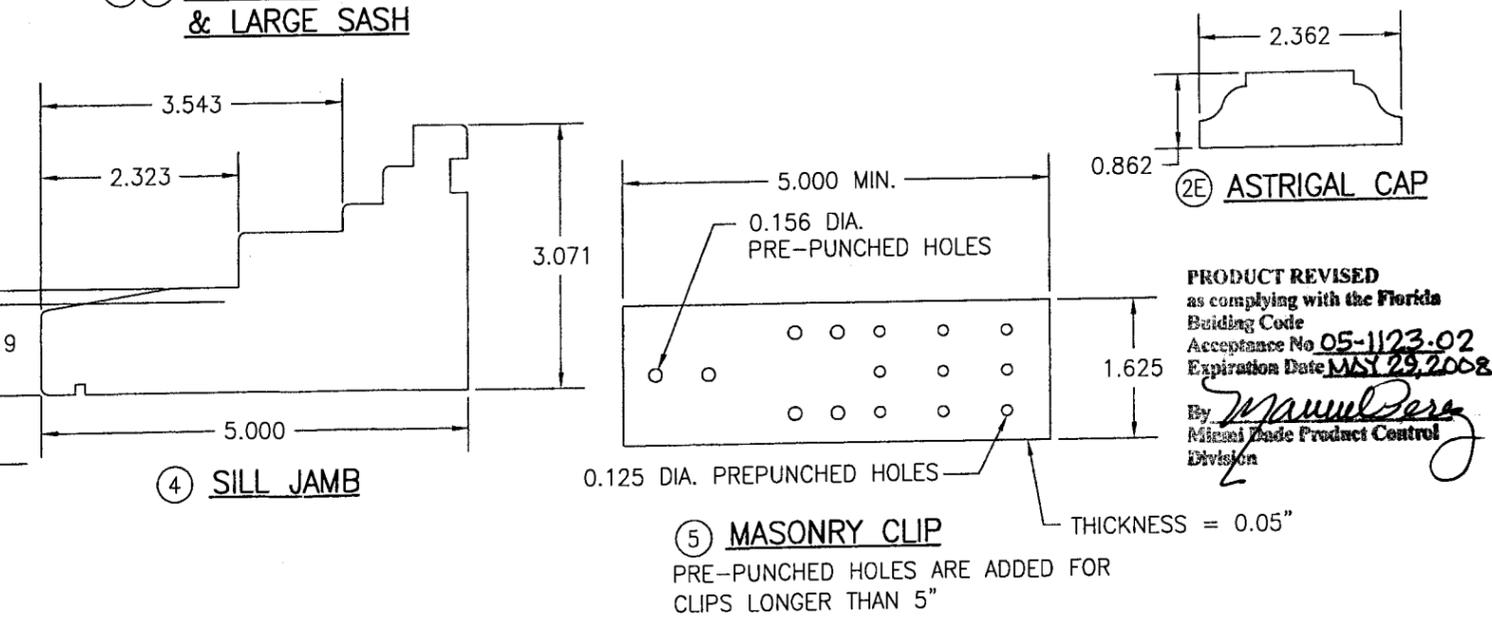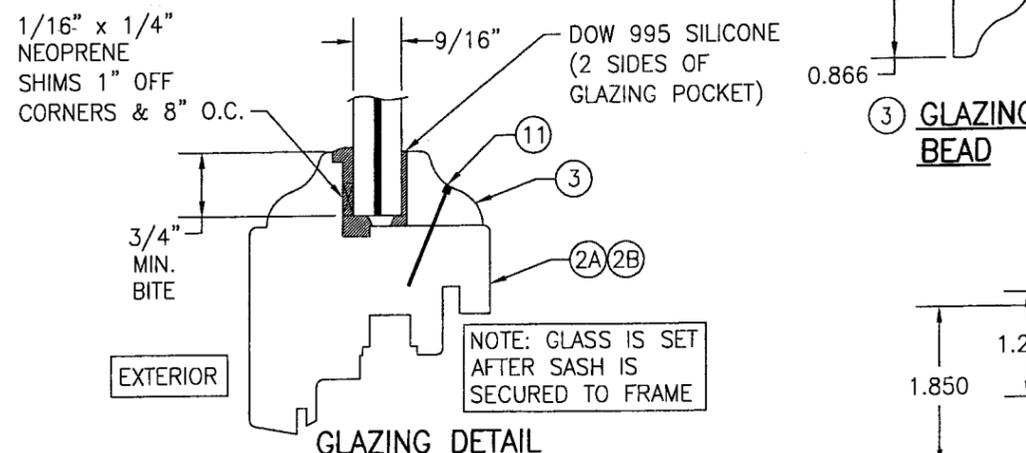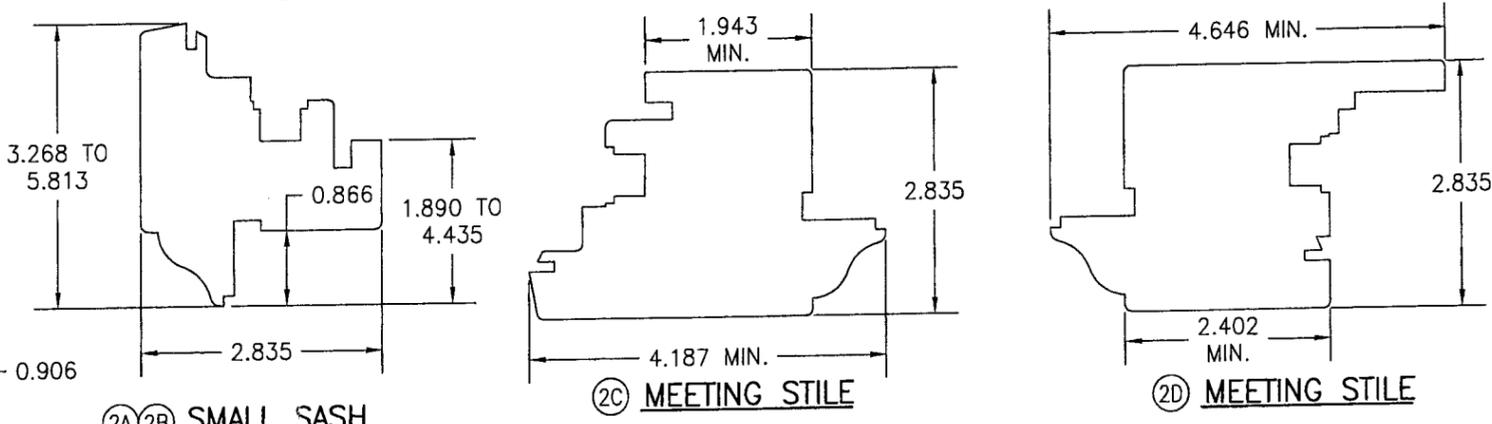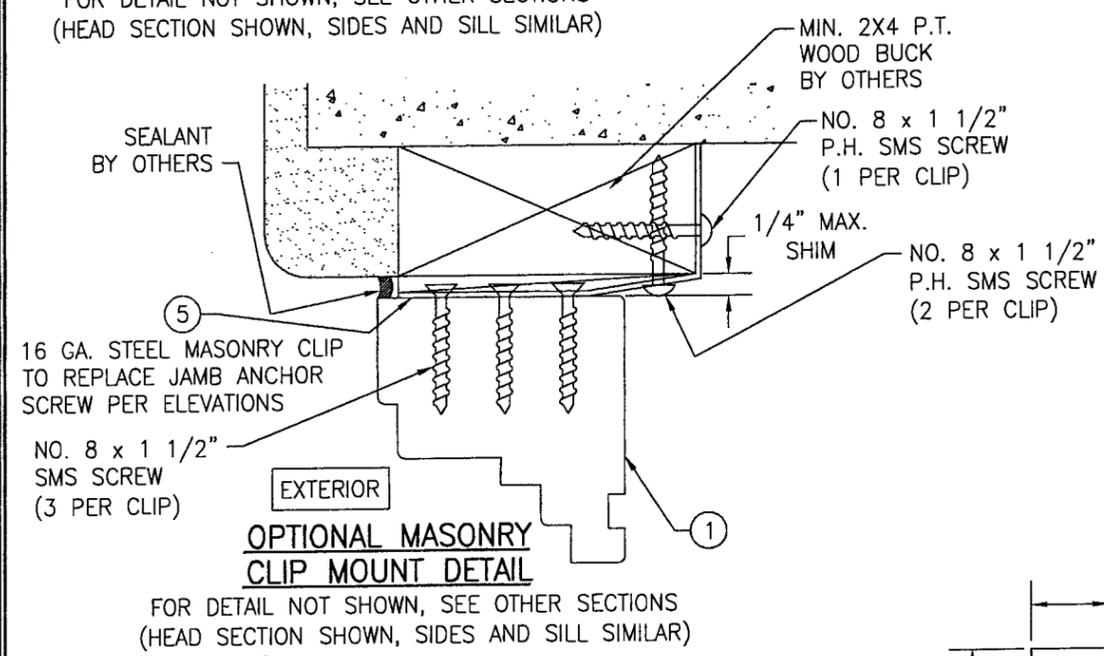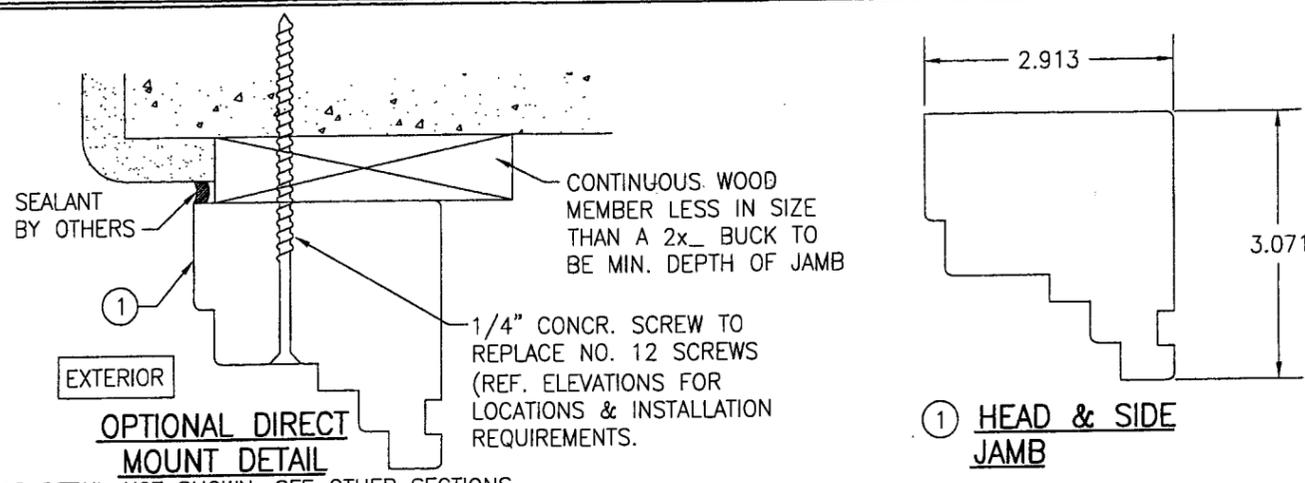

- OPTION 1: 9/16" SECURITY IMPACT GLASS SAF-GLASS LAMINATED GLASS (1/4" A.N./0.015 ADHESIVE/0.07 POLYCARBONITE/0.015 ADHESIVE/1/4" A.N.)
- OPTION 2: 9/16" SECURITY IMPACT GLASS SAF-GLASS LAMINATED GLASS (1/4" HT.ST./0.015 ADHESIVE/0.07 POLYCARBONITE/0.015 ADHESIVE/1/4" HT.ST.)
- OPTION 3: 9/16" SENTRY GLASS PLUS LAMINATED GLASS (1/4" A.N./0.09 SGP/1/4" A.N.)