



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

www.buildingcodeonline.com

Trinity Glass International
4621 192nd Street East
Tacoma, WA 98446

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: "Premium" 8' - 0" Inswing Glazed Fiberglass Door w/ and w/o Sidelites

APPROVAL DOCUMENT: Drawing No. S-2612, titled Glazed Premium Fiberglass Doors with & w/out Sidelite(s) Inswing "Non-Impact" sheets 1 through 7 of 7, dated 11/14/05 with revision #1 dated 3/16/06, prepared by R.W. Building Consultants, Inc., signed and sealed by Lyndon F. Schmidt, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No 05-1130.05
Expiration Date: April 13, 2011
Approval Date: April 13, 2006
Page 1

Trinity Glass International

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **S-2612**, Sheets 1 through 7 of 7, titled "Glazed Premium Fiberglass Doors with & w/out Sidelite(s) Inswing "Non-Impact" ", dated 11/14/05 with revision #1 dated 3/16/06, prepared by R.W. Building Consultants, Inc., signed and sealed by Lyndon F. Schmidt, P.E.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of inswing glazed premium fiberglass door, prepared by Testing Evaluation Laboratories, Inc., Test Report No. **TEL-05-1026-2**, dated 08/08-15/05, signed and sealed by Wendell W. Haney, P.E.

C. CALCULATIONS

1. Anchor verification calculations, complying with FBC-2004, dated 11/21/05, prepared by RW Building Consultants, Inc., signed and sealed by Lyndon F. Schmidt, P.E.
Complies with ASTM E1300-98

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Test Report No. **ETC-05-781-17122.0**, prepared by ETC Laboratories., issued to Trinity Glass International, dated 10/19/05, Polyurethane Foam, tested per **ASTM D2843** "Self Ignition Temperature"; **ASTM E84** "Flame Spread Index", **ASTM E84** "Smoke Developed Index", signed and sealed by Joseph Labora Doldan, P.E.
2. Notice of Acceptance No. **05-1206.01** issued to Trinity Glass International, for their Unfinished Fiberglass Door Skin approved on 03/02/06 and expiring on 03/02/11.
3. Notice of Acceptance No. **02-0429.11** issued to Trinity Glass International, for their Trinity Lite Frame approved on 07/3/02 and expiring on 07/03/07.

F. STATEMENTS

1. Statement letter of conformance and no financial interest, dated 11/21/05, signed and sealed by Lyndon F. Schmidt, P.E.
2. Statement letter of no financial interest, dated 07/21/05, signed by Andrew Na.

G. OTHER

1. Letter from the consultant, dated March 02, 2006, stating that the product is compliance with the Florida Building Code (FBC).

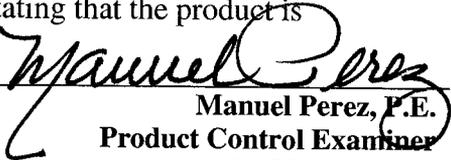
Manuel Perez, P.E.
Product Control Examiner
NOA No 05-1130.05
Expiration Date: April 13, 2011
Approval Date: April 13, 2006




4621 192nd STREET EAST TACOMA, WA 98446
 TEL: 253-875-7300 FAX: 253-875-7301

GLAZED PREMIUM FIBERGLASS DOORS WITH & W/OUT SIDELITE(S) - INSWING "NON-IMPACT"


GENERAL NOTES

1. THIS PRODUCT HAS BEEN EVALUATED AND IS IN COMPLIANCE WITH THE FLORIDA BUILDING CODE INCLUDING THE "HIGH VELOCITY HURRICANE ZONE".
2. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
3. WHEN USED IN THE "HIGH VELOCITY HURRICANE ZONE" THIS PRODUCT IS REQUIRED TO BE PROTECTED WITH AN IMPACT RESISTANT COVERING THAT COMPLIES WITH SECTION 1626 OF THE FLORIDA BUILDING CODE.
4. WHEN USED IN AREAS OUTSIDE OF THE "HVHZ" REQUIRING WIND-BORNE DEBRIS PROTECTION THIS PRODUCT IS REQUIRED TO BE PROTECTED WITH AN IMPACT RESISTANT COVERING THAT COMPLIES WITH SECTION 1609.1.4 OF THE FLORIDA BUILDING CODE.
5. FOR 2X STUD FRAMING CONSTRUCTION, THE ANCHORING OF THESE UNITS SHALL BE THE SAME AS THAT SHOWN FOR 2X BUCK MASONRY CONSTRUCTION.
6. CONDITIONS NOT COVERED BY THIS DRAWING ARE SUBJECT TO FURTHER ENGINEERING ANALYSIS.
7. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO STRUCTURE AND TO BE REVIEWED BY BUILDING OFFICIAL.
8. FOR DESIGN PRESSURE RATING SEE CHART UNDER EACH PRODUCT ELEVATION.
9. "THIS PRODUCT DOES NOT MEET THE WATER REQUIREMENTS FOR THE HIGH VELOCITY HURRICANE ZONE (HVHZ). UNIT SHALL BE INSTALLED ONLY IN NON-HABITABLE AREAS OR AT HABITABLE LOCATIONS PROTECTED BY AN OVERHANG OR CANOPY SUCH THAT THE ANGLE BETWEEN THE EDGE OF CANOPY OR OVERHANG TO SILL IS LESS THAN 45 DEGREES."

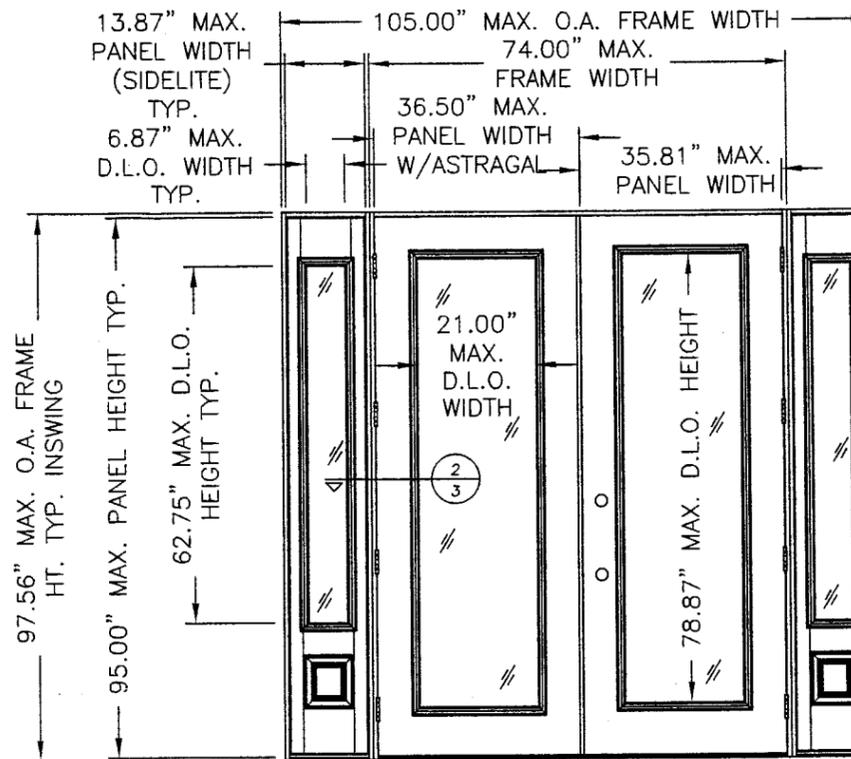


DOUBLE DOOR WITH SIDELITES (BOXED)

DESIGN PRESSURE (PSF.)	
+40.0	-40.0

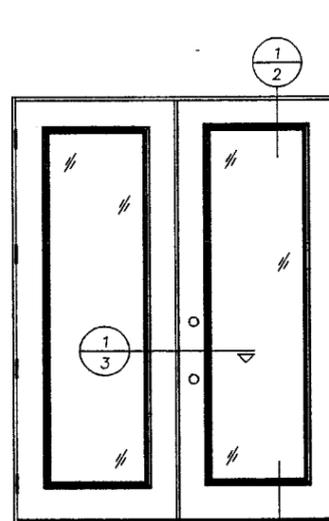


DOUBLE DOOR

DESIGN PRESSURE (PSF.)	
+40.0	-40.0

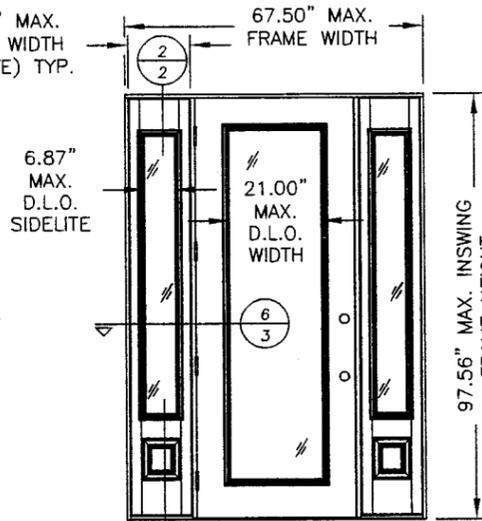


SINGLE DOOR WITH C.H.S. SIDELITES

DESIGN PRESSURE (PSF.)	
+47.0	-47.0

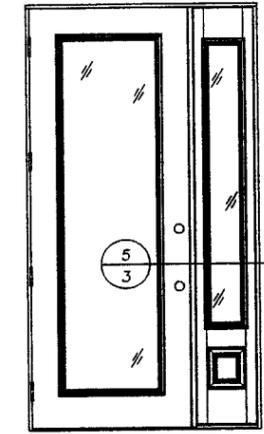

SINGLE DOOR WITH C.H.S. SIDELITE

DESIGN PRESSURE (PSF.)	
+47.0	-47.0

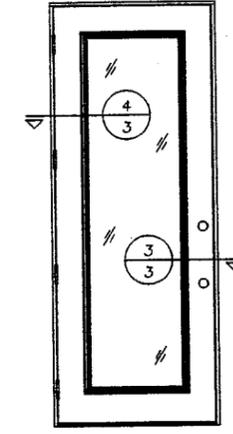

SINGLE DOOR

DESIGN PRESSURE (PSF.)	
+47.0	-47.0

TABLE OF CONTENTS	
1	TYPICAL ELEVATIONS, DESIGN PRESSURES & GENERAL NOTES
2	VERTICAL CROSS SECTIONS & ASSEMBLY NOTES
3	HORIZONTAL CROSS SECTIONS
4	FRAME ANCHORING SINGLE, SINGLE W/SIDELITE & SIDELITES
5	FRAME ANCHORING DOUBLE & DOUBLE W/SIDELITES
6	COMPONENTS
7	BILL OF MATERIALS & GLAZING DETAILS


Approved as complying with the Florida Building Code
 Date **APRIL 13, 2006**
 NOA# **05-1130.05**
 Miami Dade Product Control Division
 By *[Signature]*

DATE:	11/14/05
SCALE:	N.T.S.
DWG. BY:	AEM
CHK. BY:	LFS
DRAWING NO.:	S-2612
SHEET	1 OF 7


PRODUCT: GLAZED PREMIUM FIBERGLASS DOORS WITH & W/OUT SIDELITE(S)
 INSWING "NON-IMPACT"
 PART OR ASSEMBLY: TYPICAL ELEVATIONS, DESIGN PRESSURES & GENERAL NOTES

NO.	DATE	REVISIONS	EW	BY
1	03/16/06	REVISE PER DADE LETTER		

Documents Prepared By: *[Signature]*
 BUILDING CONSULTANTS, INC.
 P.O. Box 230 Valrico FL 33595
 Phone No.: 813.659.9197
 Florida Board of Professional Engineers
 Certificate Of Authorization No. 9813
 Lyndon, F. Schmidt, P.E. No. 43409
 3.17.06

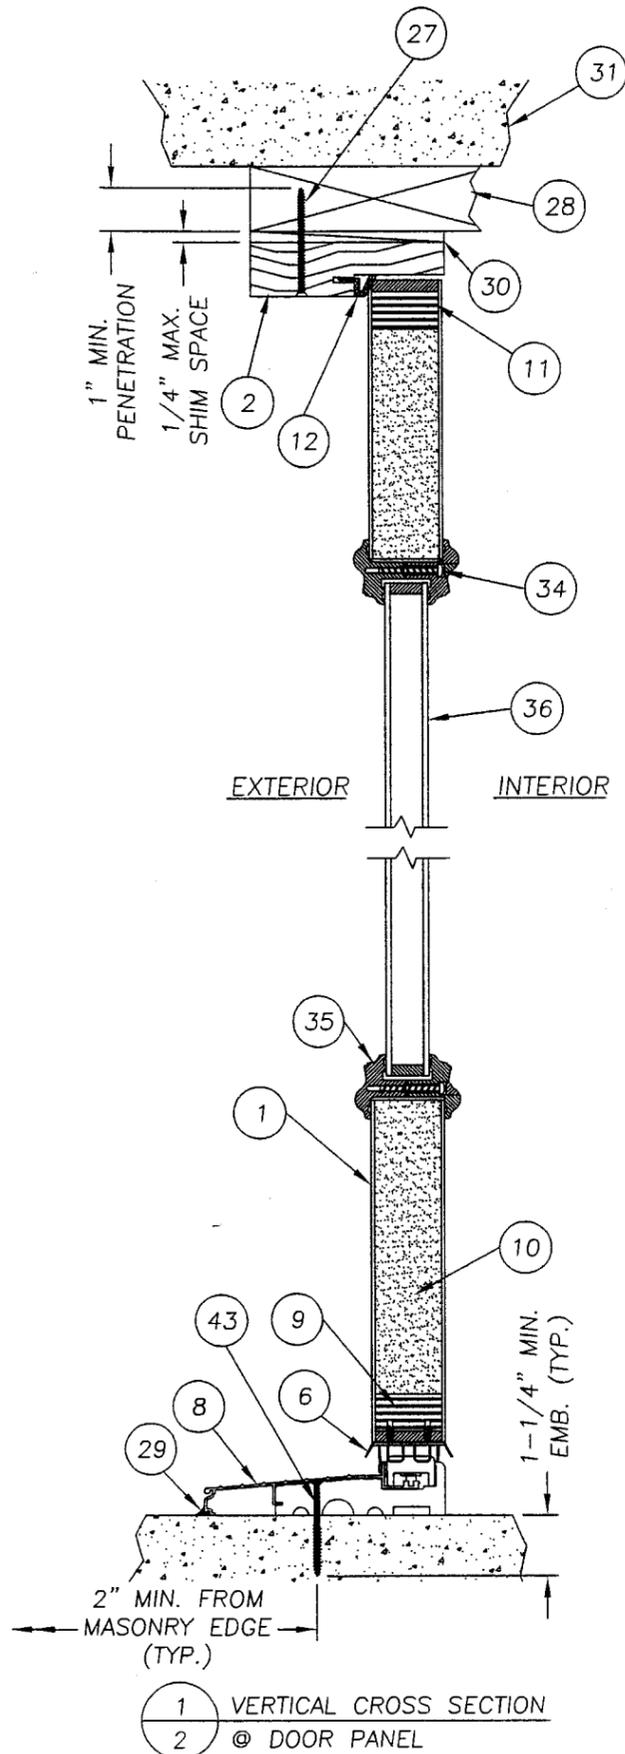

1 VERTICAL CROSS SECTION
2 @ DOOR PANEL

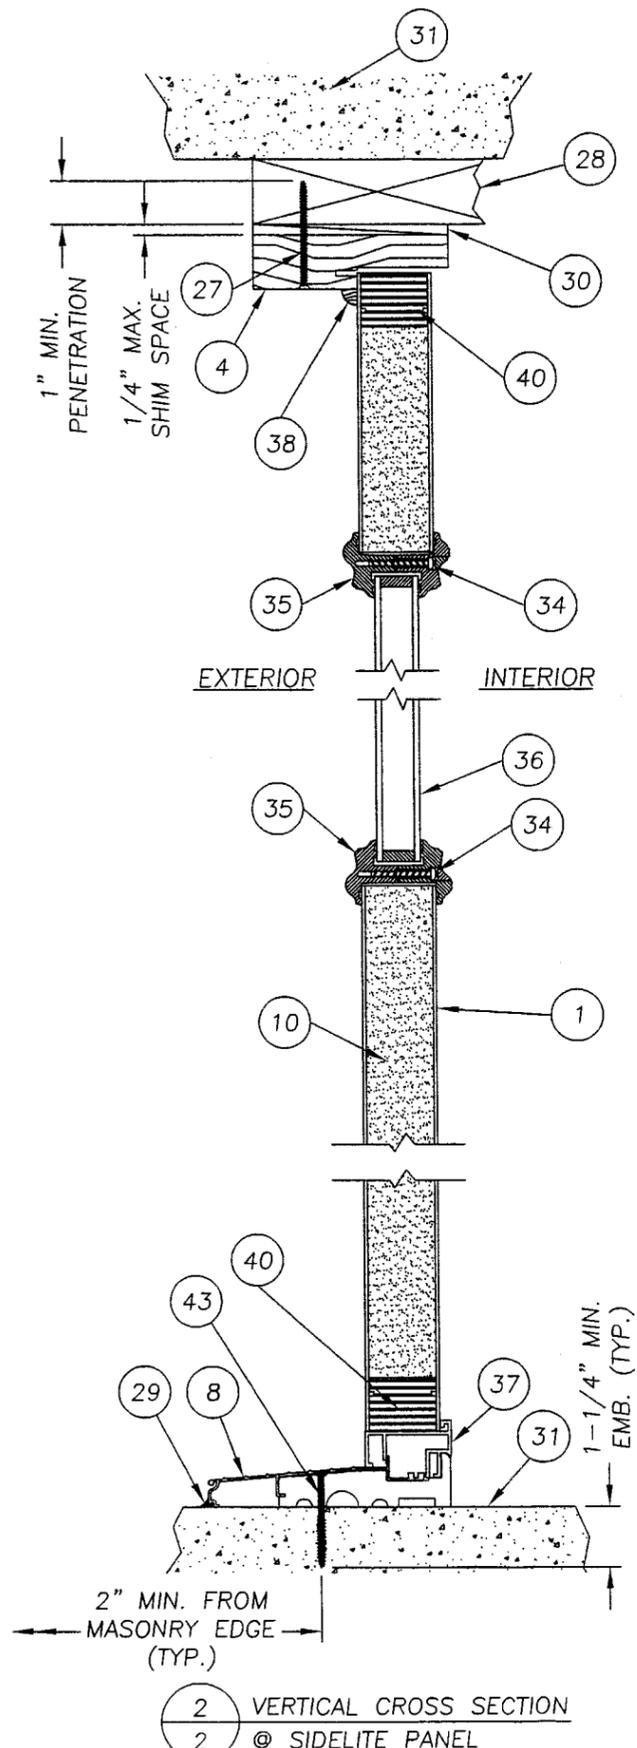

2 VERTICAL CROSS SECTION
2 @ SIDELITE PANEL

ASSEMBLY NOTES

1. DEADBOLT CENTER LINE LOCATED @ 49.00" FROM TOP OF DOOR PANEL.
2. LOCK CENTER LINE LOCATED @ 61.875" FROM TOP OF DOOR PANEL.
3. HINGES (4) LOCATED @ 8.5", 34.5", 60.5" AND 86.5" FROM TOP OF DOOR PANEL TO CENTER LINE OF HINGE. (SEE DETAIL "A" TOP HINGE & DETAIL "B" LOWER HINGES SHEET 4 OF 7 FOR HINGE ANCHORING)
4. ASTRAGAL ATTACHED WITH (14) #8 X 1" PFH DRYWALL SCREWS, (2) @ 2.5", (1) @ 3.5", (1) @ 10.375", (1) @ 18.375", (1) @ 26.25", (1) @ 34.25", (1) @ 44.25", (2) @ 77.25".
5. THE BOXED SIDELITES ARE ATTACHED TO THE DOOR JAMBS UTILIZING (6) #10 X 2.0" PFH WOOD SCREWS LOCATED 6.0" FROM THE TOP AND (5) MORE CONTINUOUS MAX. 13.625" ON CENTER.
6. THE SIDELITE PANELS ARE ATTACHED TO THE JAMBS UTILIZING (8) #9 X 2.25" PFH SCREWS (4) EACH SIDE 6.0" FROM THE TOP AND BOTTOM WITH 2 MORE EQUALLY SPACED.
7. 3/16" TAPCONS REQUIRE A MINIMUM 2" CLEARANCE TO MASONRY EDGES AND A MINIMUM 2-5/16" CLEARANCE TO ADJACENT TAPCONS.

Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
 P.O. Box 230 Valrico FL 33595
 Phone No.: 813.659.9197
 Florida Board of Professional Engineers
 Certificate Of Authorization No. 9813
 3-17-06
 Lyndon, F. Schmidt, P.E. No. 43409


PRODUCT:
 GLAZED PREMIUM FIBERGLASS
 DOORS WITH & W/O SIDELITE(S)
 INSWING "NON-IMPACT"
 PART OR ASSEMBLY:
 VERTICAL CROSS SECTIONS &
 ASSEMBLY NOTES

NO.	DATE	REVISIONS	EW	BY
1	03/16/06	REVISE PER DADE LETTER		


DATE: 11/14/05
 SCALE: N.T.S.
 DWG. BY: AEM
 CHK. BY: LFS
 DRAWING NO.: S-2612
 SHEET 2 OF 7

Approved as complying with the
 Florida Building Code
 Date **APRIL 13, 2006**
 NOA# **05-1130.05**
 Miami Dade Product Control
 Division
 By: *Manuel Perez*


\\PWB\SRV\RWBC\Proj 801 - 900\PF8261S-2612 IS GLAZED REV-1S-2612-3A.DWG

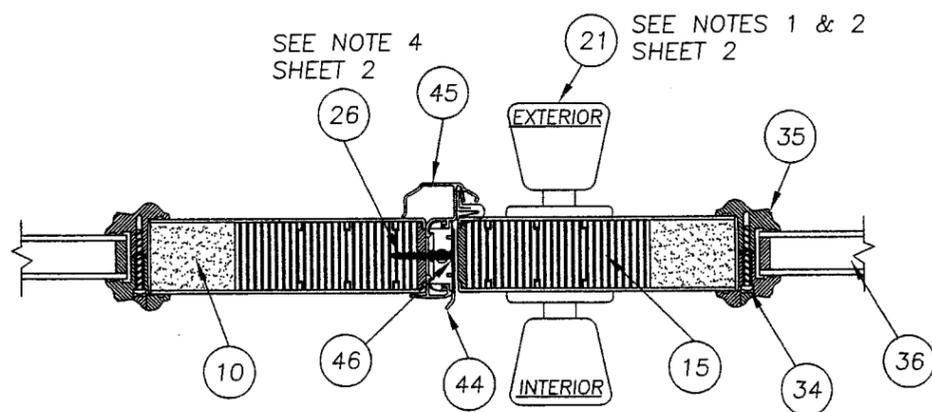


1 HORIZONTAL CROSS SECTION
3 DOUBLE DOOR with ASTRAGAL

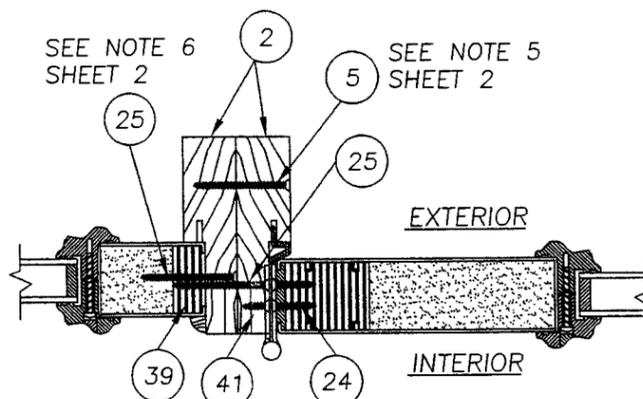


2 HORIZONTAL CROSS SECTION
3 HINGE JAMB TO BOXED SIDELITE

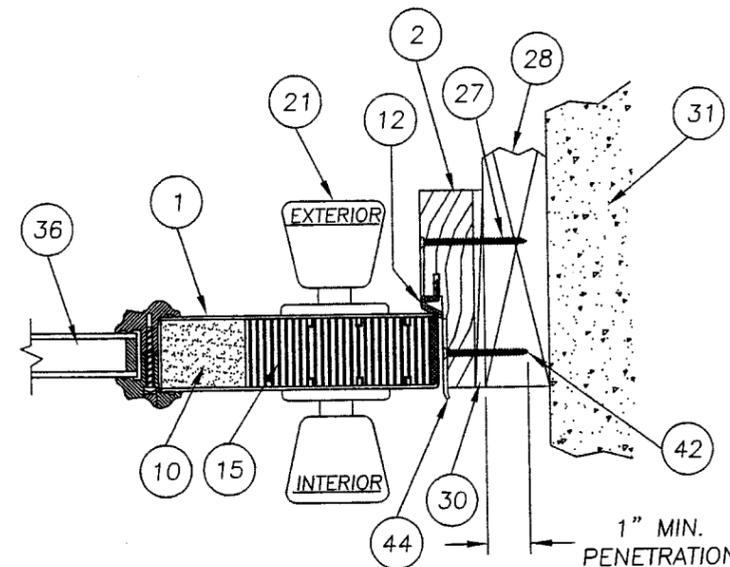


3 HORIZONTAL CROSS SECTION
3 LATCH JAMB

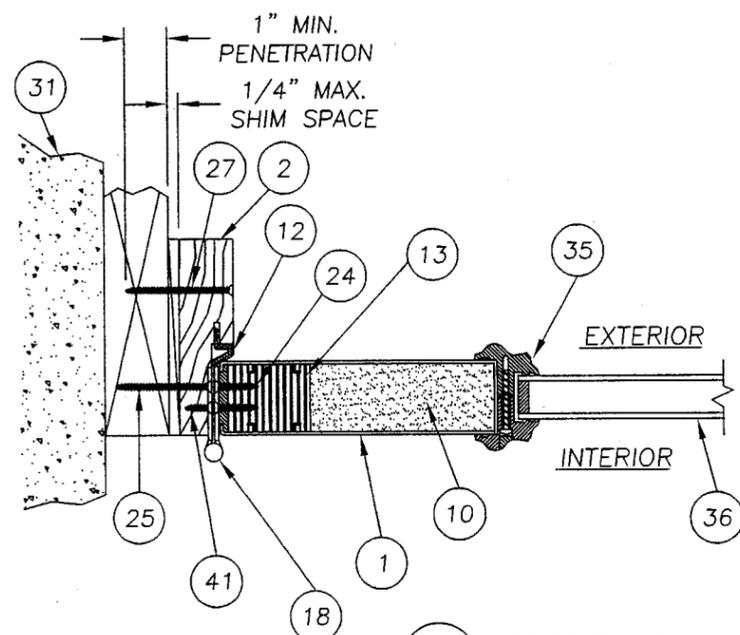

4 HORIZONTAL CROSS SECTION
3 HINGE TO JAMB

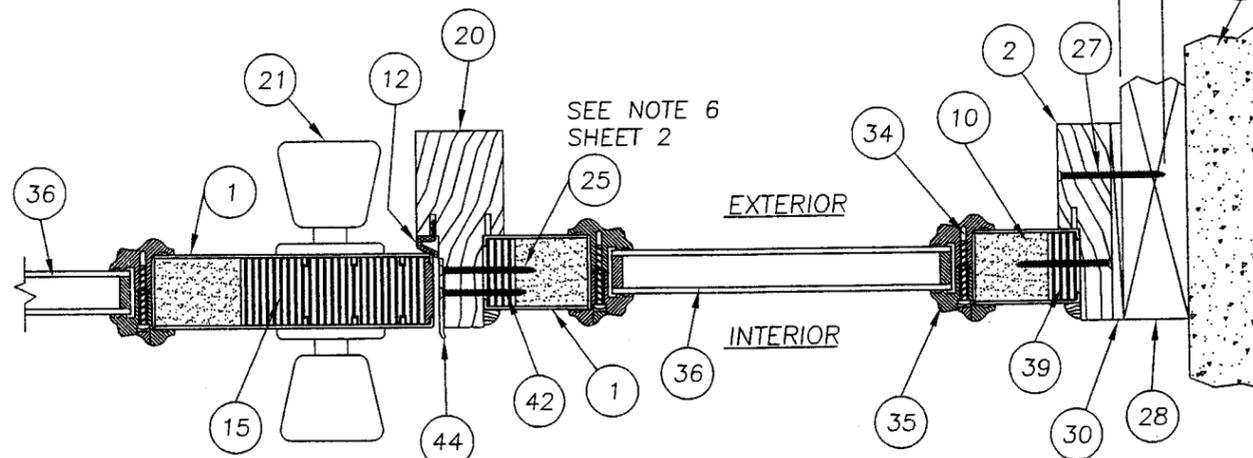

5 HORIZONTAL CROSS SECTION
3 LATCH TO SIDELITE C.H.S.

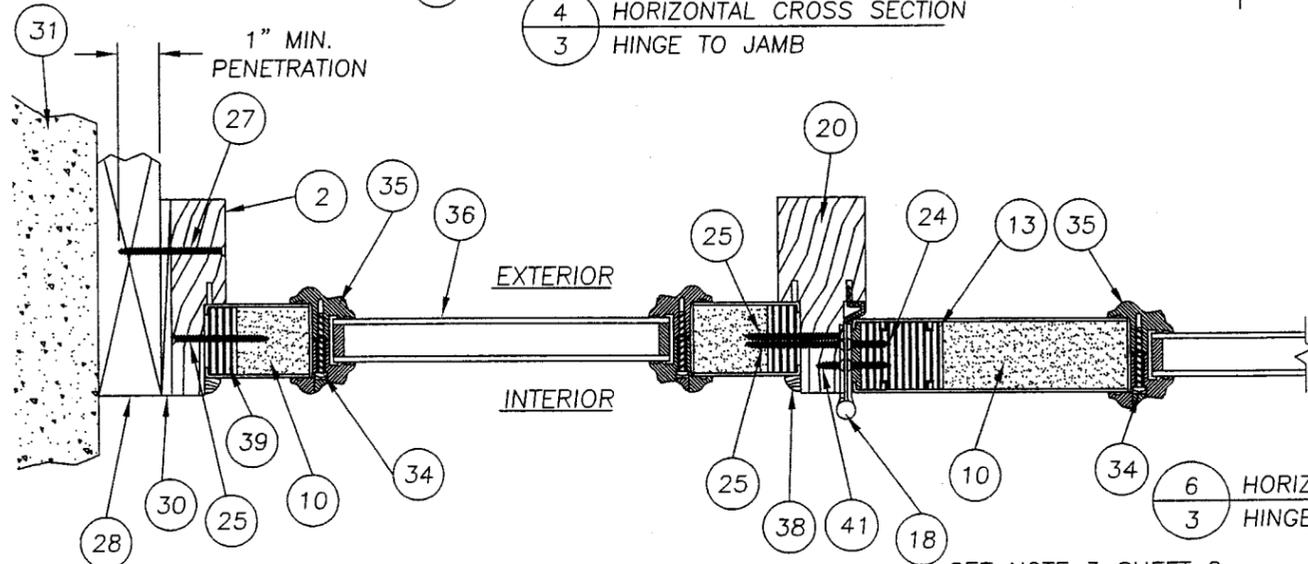

6 HORIZONTAL CROSS SECTION
3 HINGE TO SIDELITE C.H.S.

SEE NOTE 3 SHEET 2

Documents Prepared By:

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197
Florida Board of Professional Engineers
Certificate Of Authorization No. 9813

Lyndon, F. Schmidt, P.E. No. 43409

PRODUCT:
GLAZED PREMIUM FIBERGLASS
DOORS WITH & W/O SIDELITE(S)
INSWING "NON-IMPACT"


PART OR ASSEMBLY:
HORIZONTAL
CROSS SECTIONS

NO.	DATE	REVISIONS	EW	BY
1	03/16/06	REVISE PER DADE LETTER		


Approved as complying with the
Florida Building Code
Date APRIL 13, 2006
NOAH 05-1130.05
Miami Dade Product Control
Division
By: *Manuel Perez*

DATE: 11/14/05
SCALE: N.T.S.
DWG. BY: AEM
CHK. BY: LFS
DRAWING NO.: S-2612
SHEET 3 OF 7


\\RWB\SRV\RWB\PROJ\801 - 900\PF826\1S-2612 IS GLAZED REV-1\1S-2612-4A.DWG

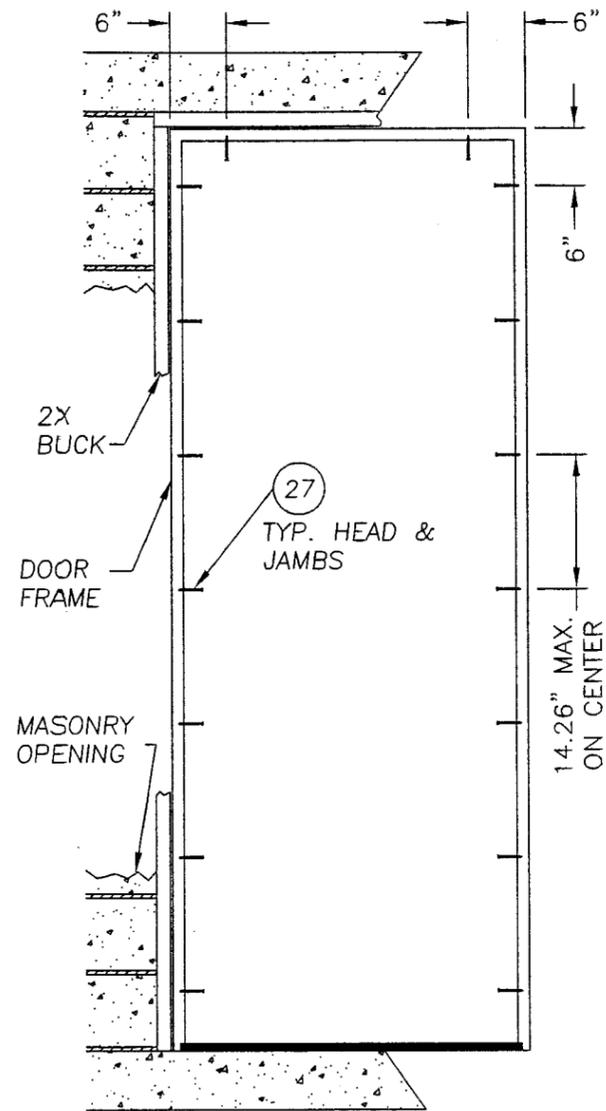


FRAME ANCHORING
SINGLE DOOR

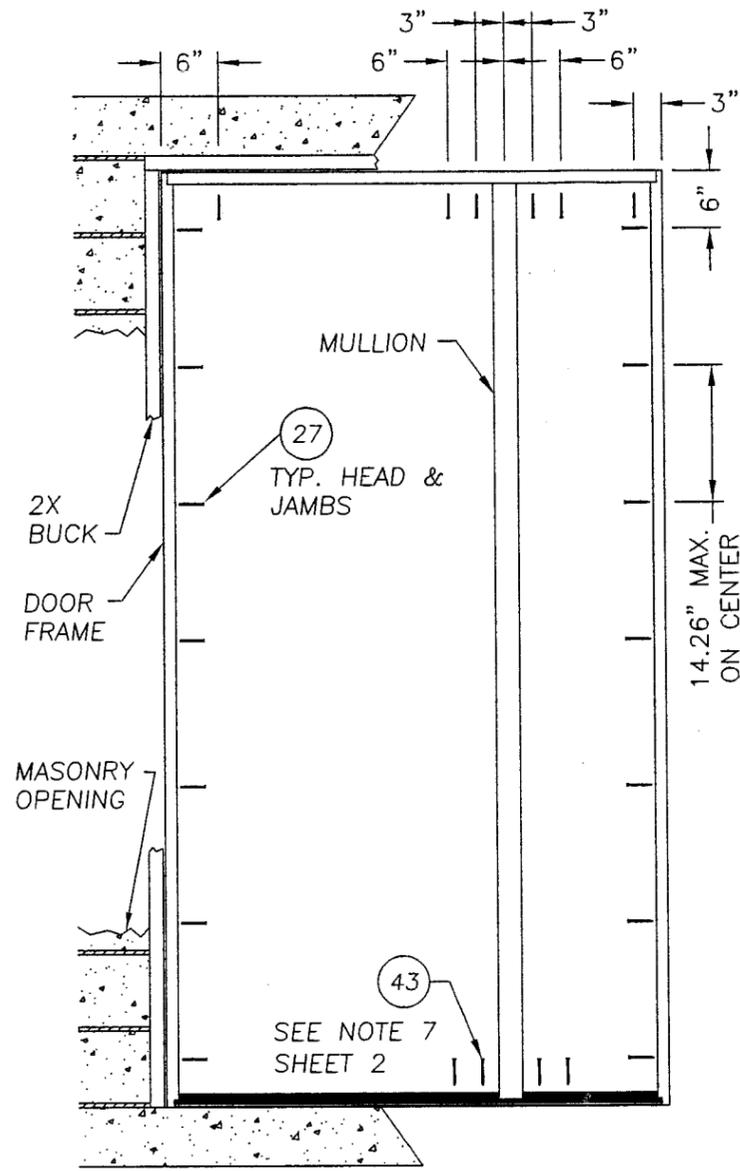


FRAME ANCHORING
SINGLE DOOR W/SIDELITE

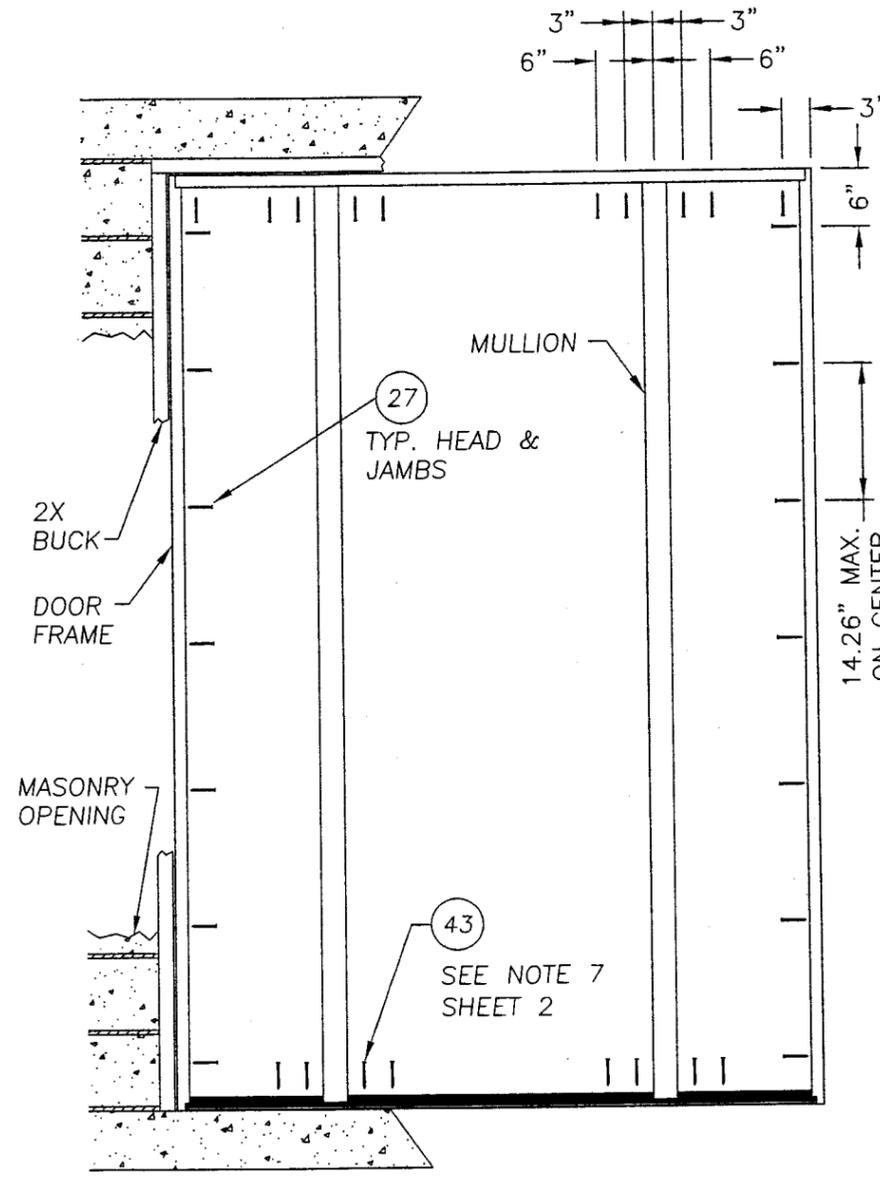


FRAME ANCHORING
SINGLE DOOR W/SIDELITES

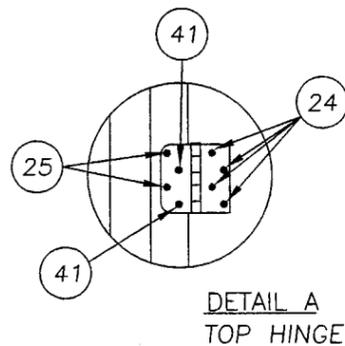

DETAIL A
TOP HINGE

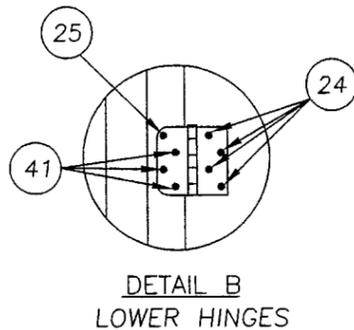


DETAIL B
LOWER HINGES

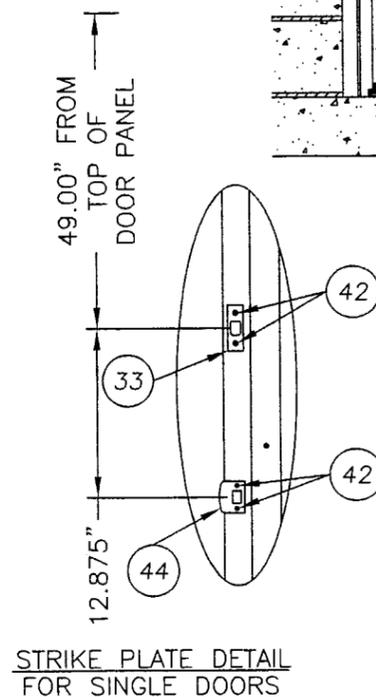


STRIKE PLATE DETAIL
FOR SINGLE DOORS

Documents Prepared By: RW BUILDING CONSULTANTS, INC. P.O. Box 230 Vairico FL 33595 Phone No.: 813.659.9197 Florida Board of Professional Engineers Certificate Of Authorization No. 9813 Lyndon, F. Schmidt, P.E. No. 43409	
PRODUCT: GLAZED PREMIUM FIBERGLASS DOORS WITH & W/OUT SIDELITE(S) INSWING "NON-IMPACT" PART OR ASSEMBLY: FRAME ANCHORING SINGLE SINGLE W/SIDELITE & SIDELITES	DATE: 11/14/05 SCALE: N.T.S. DWG. BY: AEM CHK. BY: LFS DRAWING NO.: S-2612 SHEET 4 OF 7
REVISIONS NO. DATE 1 03/16/06 REVISE PER DADE LETTER EW BY	SEE NOTE 7 SHEET 2


\\R\B\SRV\RWBC\PROJ 801 - 900\PE826\1S-2612 IS GLAZED REV-1\1S-2612-5A.DWG

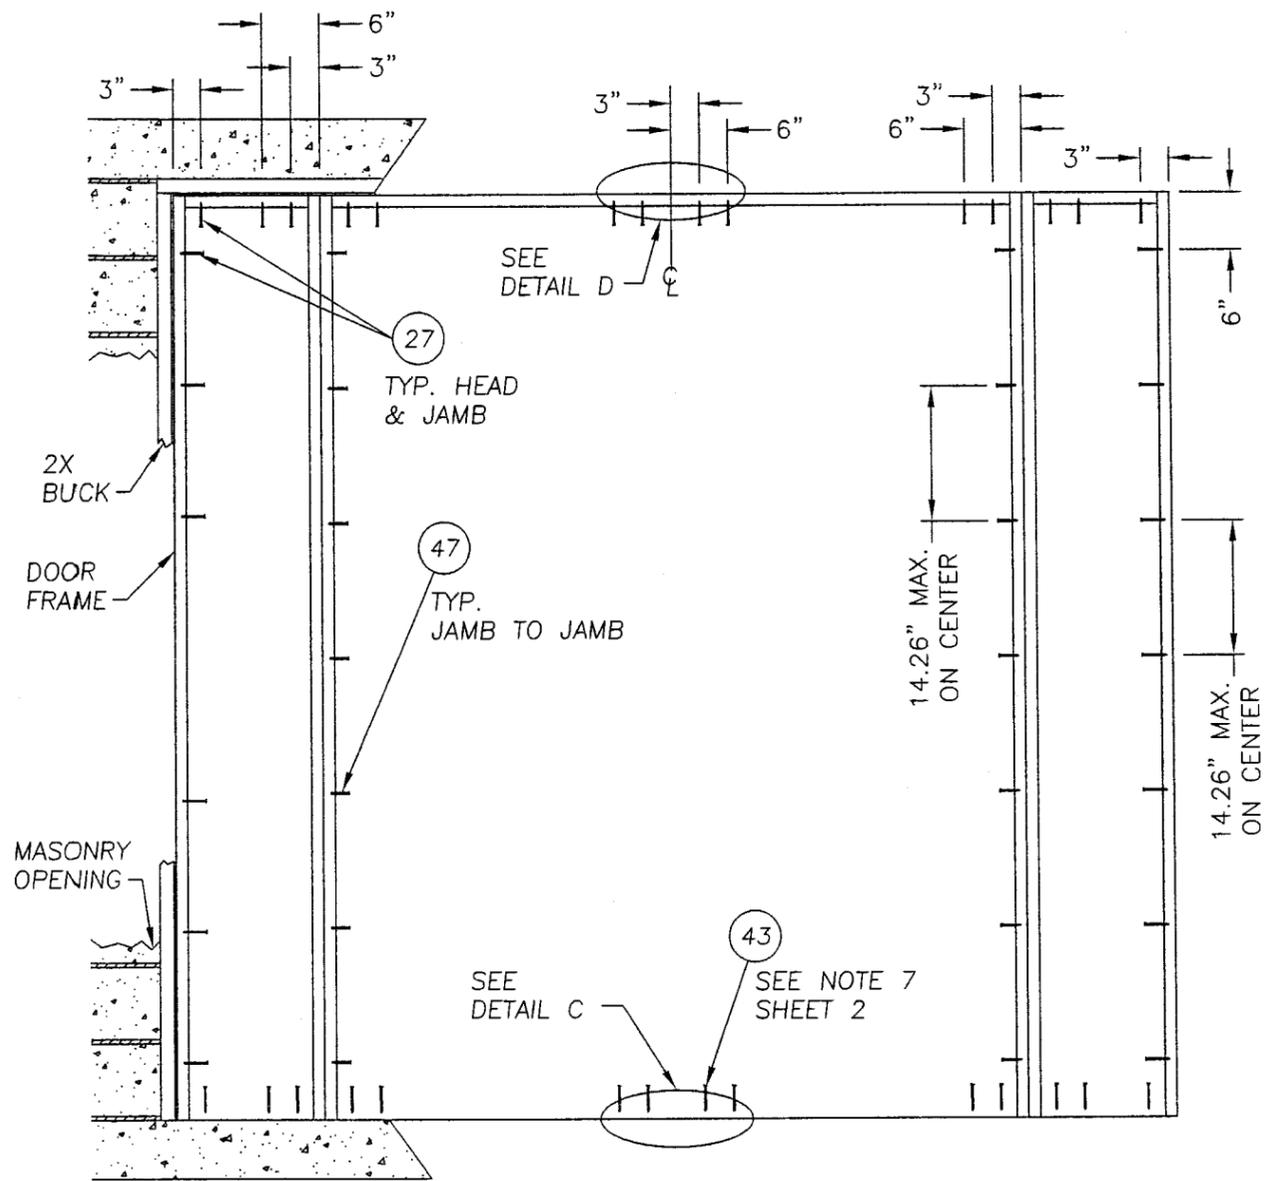


FRAME ANCHORING
DOUBLE DOOR W/SIDELITES

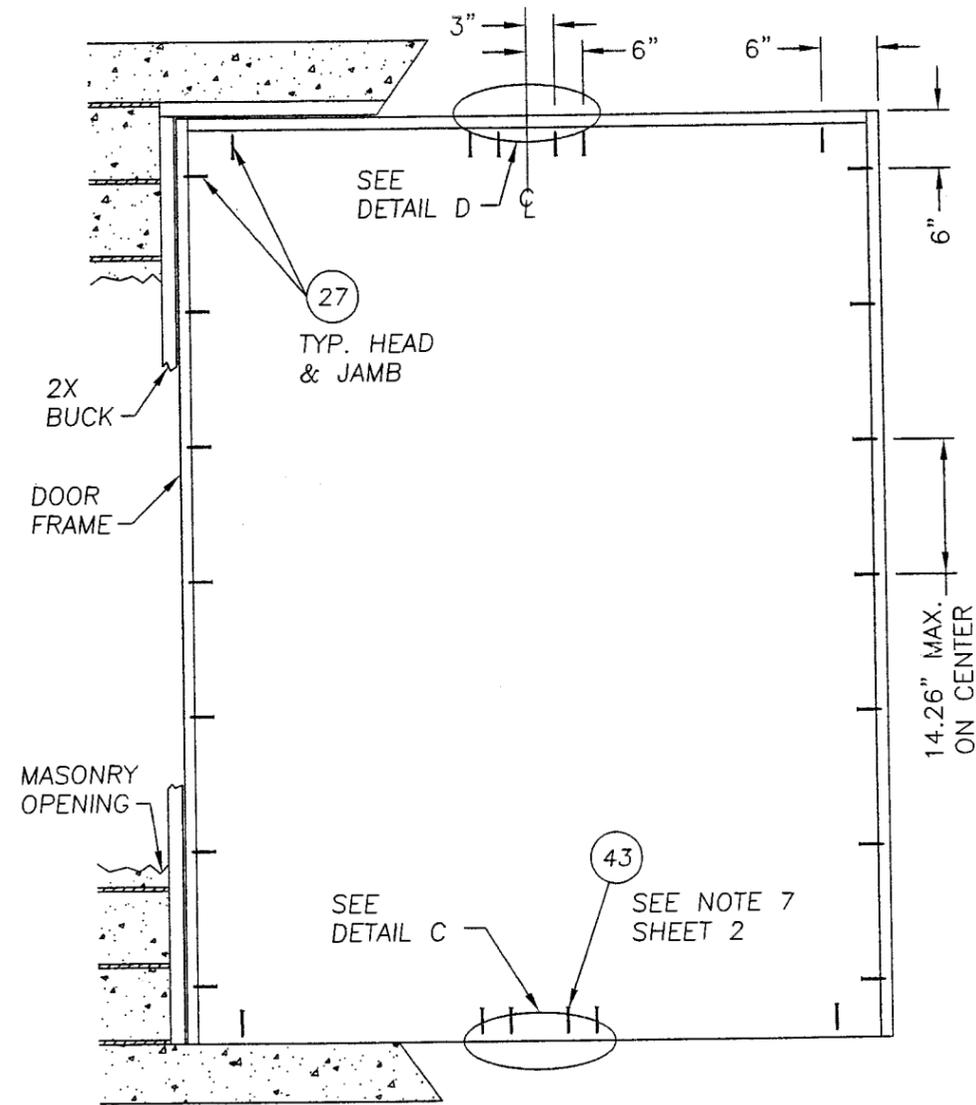


FRAME ANCHORING
DOUBLE DOOR

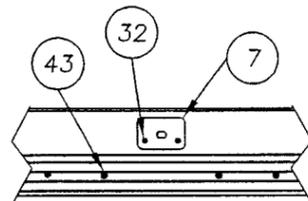

DETAIL C

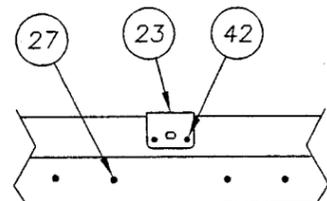

DETAIL D

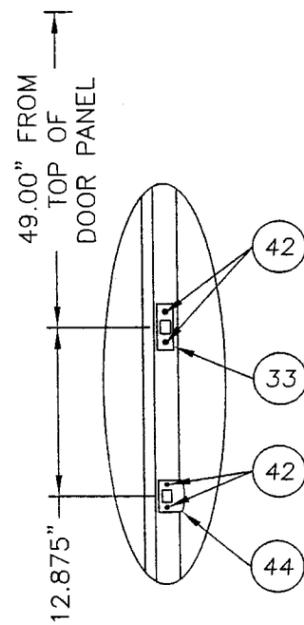

STRIKE PLATE DETAIL
FOR DOUBLE DOORS


Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
 P.O. Box 230 Valrico FL 33595
 Phone No.: 813.659.9197
 Florida Board of Professional Engineers
 Certificate Of Authorization No. 9813
 Lyndon, F. Schmidt, P.E. No. 43409
 3-17-06

PRODUCT:
 GLAZED PREMIUM FIBERGLASS
 DOORS WITH & W/OUT SIDELITE(S)
 INSURING "NON-IMPACT"
 PART OR ASSEMBLY:
 FRAME ANCHORING
 DOUBLE & DOUBLE W/SIDELITES


NO.	DATE	REVISIONS	EW	BY
1	03/16/06	REVISE PER DADE LETTER		

Approved as complying with the
 Florida Building Code
 Date APRIL 13, 2006
 NOA# 05-1130.05
 Miami Dade Product Control
 Division
 By Manuel Sery


DATE: 11/14/05
 SCALE: N.T.S.
 DWG. BY: AEM
 CHK. BY: LFS
 DRAWING NO.: S-2612
 SHEET 5 OF 7

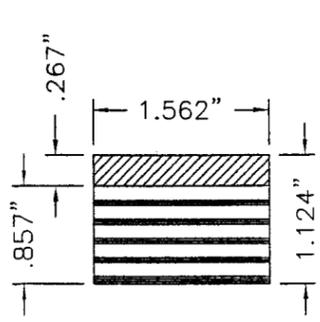


11 TOP RAIL

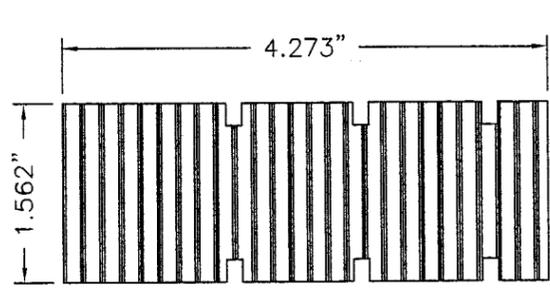


15 LATCH STILE SUPPORTER




16 LATCH STILE EDGE

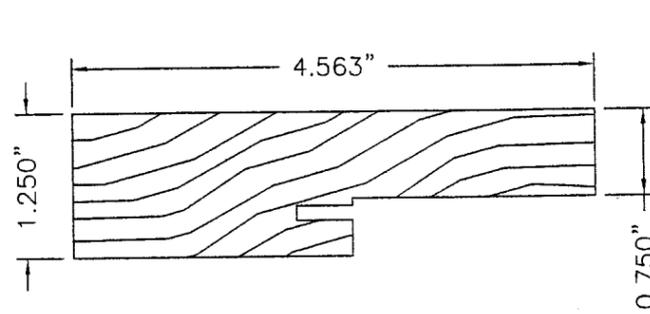


2 SIDE & HEAD JAMBS

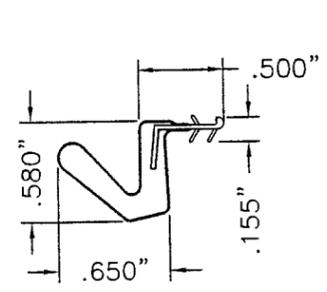


12 WEATHER-STRIPPING
QEBD-650

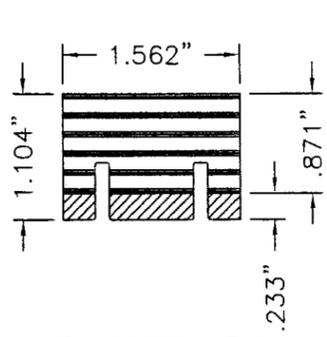


9 BOTTOM RAIL




14 HINGE STILE EDGE




13 HINGE STILE SUPPORTER




39 SIDELITE STILE




40 SIDELITE RAIL




6 DOOR SWEEP

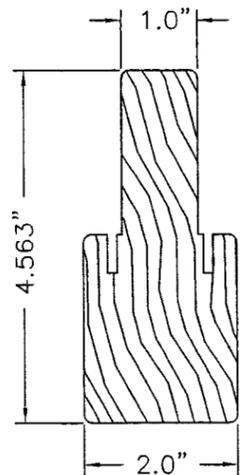

20 INTEGRAL MULLION

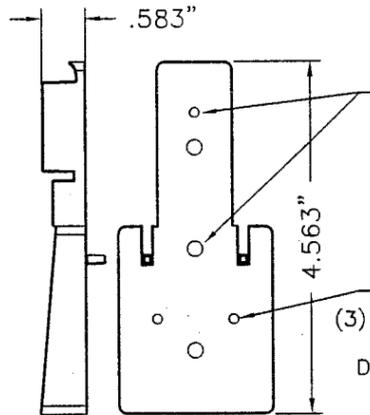


17 MULLION BASE KIT
INSWING UNIT




45A ALUMINUM ASTRAGAL
BY ENDURA PRODUCTS


45B SLIDE BOLT ROD
STEEL

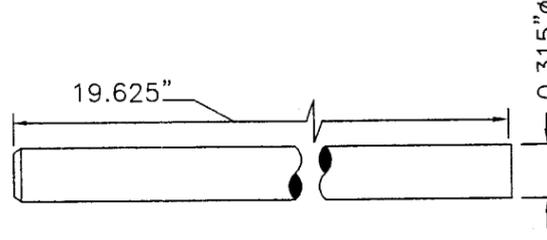


45A TOP / BOTTOM BOLT RETAINER
ALUMINUM 6063-T5

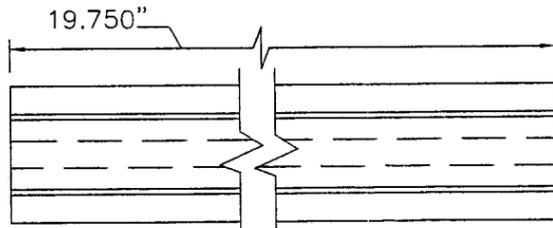

8 INSILING THRESHOLD

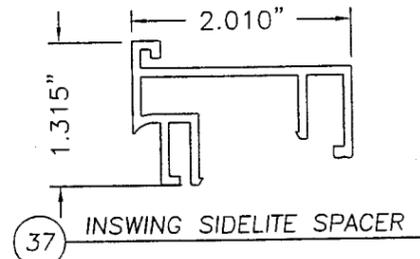

37 INSWING SIDELITE SPACER

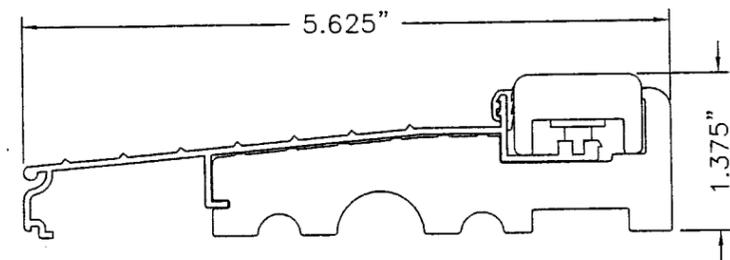

Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
 P.O. Box 230 Valrico FL 33595
 Phone No.: 813.659.9197
 Florida Board of Professional Engineers
 Certificate of Authorization No. 9813
 Lyndon, F. Schmidt, P.E. No. 43409
 3.17.06



PRODUCT:
 GLAZED PREMIUM FIBERGLASS
 DOORS WITH & W/OUT SIDELITE(S)
 INSWING "NON-IMPACT"
 PART OR ASSEMBLY:
 COMPONENTS

NO.	DATE	REVISION PER DADE LETTER	EW	BY
1	03/16/06	REVISE PER DADE LETTER		

DATE: 11/14/05
 SCALE: N.T.S.
 DWG. BY: AEM
 CHK. BY: LFS
 DRAWING NO.: S-2612
 SHEET 6 OF 7

Approved as complying with the
 Florida Building Code
 Date **APRIL 13, 2006**
 NCAP **05-1130.05**
 Miami Dade Product Control
 Division
 By *Manuel Perry*

ITEM	DESCRIPTION	MATERIAL
1	FIBERGLASS SKIN 0.079" MIN. THICKNESS	FIBERGLASS
2	JAMB	WOOD
3	NOT USED	-
4	NOT USED	-
5	#10 x 2" PFH WS	STEEL
6	DOOR BOTTOM SWEEP	PVC
7	STRIKE PLATE AT SILL	STEEL
8	INSWING THRESHOLD ALUMINUM W/ COMPOSITE SUBSTRATE	ALUM. / COMP.
9	PVC COMPOSITE & LVL BOTTOM RAIL	PVC / LVL
10	URETHANE CORE FOAMED IN PLACE 2.5 LBS. / cu.ft. DENSITY	POLYURETHANE
11	PVC COMPOSITE & LVL TOP RAIL	PVC / LVL
12	WEATHER-STRIP QEBD650 Q-LON	FOAM
13	LVL HINGE STILE SUPPORTER	POPLAR
14	COMPOSITE HINGE STILE EDGE	PVC
15	LVL LATCH STILE SUPPORTER	POPLAR
16	COMPOSITE LATCH STILE EDGE	PVC
17	MULLION BASE KIT (INSWING UNIT)	PVC
18	3.983" X 4.0" HINGE MIN 0.098" THICK	STEEL
19	SILL KEY	PC/ASA
20	INTEGRAL MULLION FOR CONTINUOUS HEAD & SILL ASSEMBLIES	WOOD
21	KWIKSET LATCH GRADE II	STEEL
22	KWIKSET DEADBOLT GRADE II	STEEL
23	STRIKE PLATE AT HEAD	STEEL
24	#9 X 1.0" PFHWS	STEEL
25	#9 X 2.25" PFHWS	STEEL
26	ASTRAGAL SCREW #8 X 1.0" PFH DRYWALL SCREW	STEEL
27	#8 X 2.5" PFH SMS	STEEL
28	2X BUCK	WOOD
29	LATEX CAULK	LATEX
30	MAX. 1/4" SHIM	WOOD
31	MASONRY	CONCRETE
32	3/16" X 2-3/4" TAPCON	STEEL
33	DEADBOLT STRIKE PLATE	STEEL
34	LITE FRAME SCREW #8 X 1-1/2" SELF THREADING	STEEL
35	LITE FRAME	PC/ASA
36	1" INSULATED GLASS - 1/8" TEMPERED - AIR - 1/8" TEMPERED	GLASS
37	INSWING SIDELITE SPACER	PVC
38	1/4" BEAD	WOOD
39	LVL SIDELITE STILE	POPLAR
40	LVL SIDELITE RAIL	POPLAR
41	HINGE TO JAMB #9 X 5/8" PFHWS	STEEL
42	#8 X 2" PFH WS	STEEL
43	3/16" X 2-1/4" TAPCON	STEEL
44	LATCH STRIKE PLATE	STEEL
45	ASTRAGAL BY ENDURA	ALUMINUM
46	10-32 X 5/8" MS	STEEL

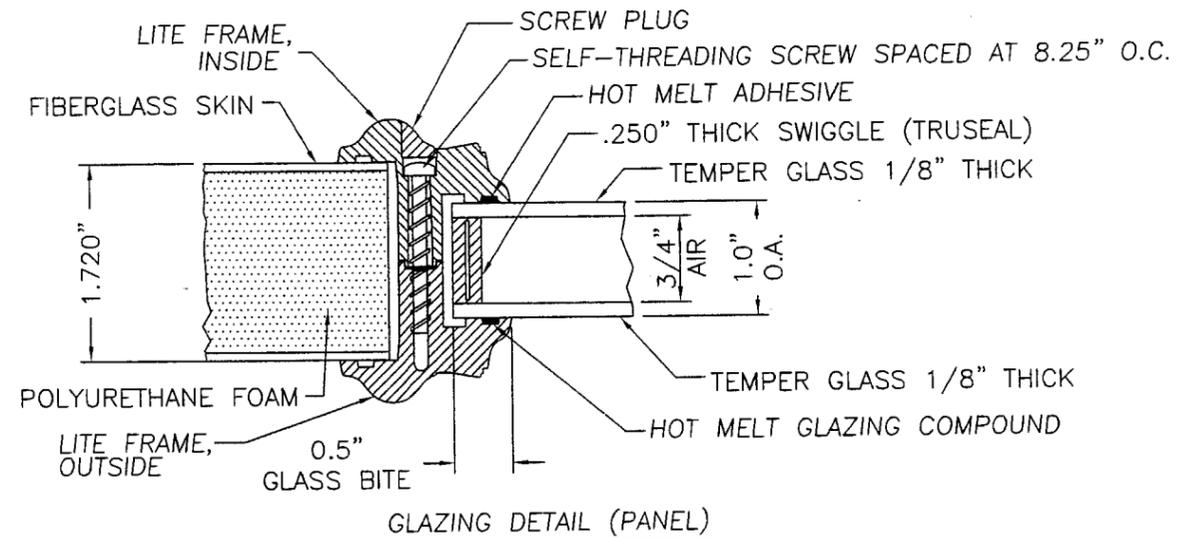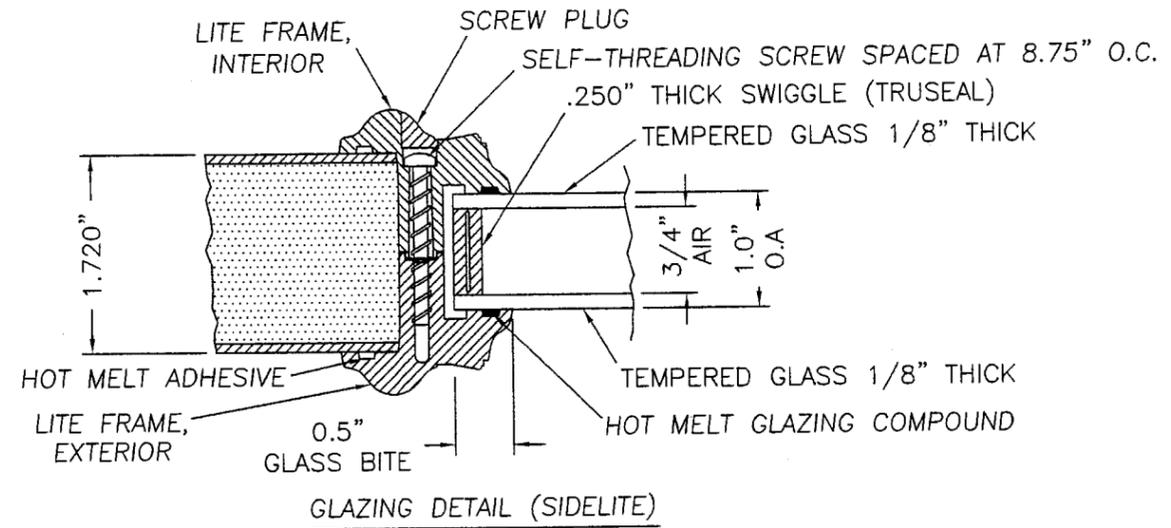

Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
 P.O. Box 230 Valrico FL, 33595
 Phone No.: 813.659.9197
 Florida Board of Professional Engineers
 Certificate of Authorization No. 9813
 Lyndon, F. Schmidt, P.E. No. 43409

PRODUCT:
 GLAZED PREMIUM FIBERGLASS
 DOORS WITH & W/O SIDELITE(S)
 INSWING "NON-IMPACT"
 PART OR ASSEMBLY:
 BILL OF MATERIALS
 & GLAZING DETAILS

NO.	DATE	REVISIONS	EW	BY
1	10/3/16/06	REVISE PER DATE LETTER		

DATE: 11/14/05
 SCALE: N.T.S.
 DWG. BY: AEM
 CHK. BY: LFS
 DRAWING NO.: S-2612
 SHEET 7 OF 7

Approved as complying with the Florida Building Code
 Date April 13, 2006
 NOA# 05-1130-05
 Miami Dade Product Control Division
 By [Signature]