



MIAMI-DADE COUNTY
 BUILDING CODE COMPLIANCE OFFICE (BCCO)
 PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
 METRO-DADE FLAGLER BUILDING

140 WEST FLAGLER STREET, SUITE 1603
 MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 375-2908

www.buildingcodeonline.com

NOTICE OF ACCEPTANCE (NOA)

Miami Dade Aluminum Supply, Inc.
 1615 West 31st Place
 Hialeah, Florida 33012

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: 0.0373" (min.) Galvanized Steel Storm Panel Shutter

APPROVAL DOCUMENT: Drawing No. 05-313, titled 0.0375" Thick Galvanized Storm Panel, sheets 1 through 4 of 4, and sheet 1A of 4, prepared by Tilteco, Inc., dated September 29, 2005, last revision #1 dated September 29, 2005, signed and sealed by Walter A. Tillit Jr., P.E., bearing Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each panel shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises NOA # 01-0718.07 and consists of this page 1, evidence submitted page E-1 as well as approval document mentioned above.

The submitted documentation was reviewed by Helmy A. Makar, P.E.




Helmy A. Makar
 04/13/2006

NOA No 05-1220.11
 Expiration Date: 09/03/2006
 Approval Date: 04/13/2006
 Page 1

Miami Dade Aluminum Supply, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. **EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL No. 01-0718.07**
 - A. **DRAWINGS**
 1. *See NOA No. 98-060819*
 - B. **TESTS**
 1. *See NOA No. 98-060819*
 - C. **CALCULATIONS**
 1. *See NOA No. 98-060819*
 - D. **MATERIAL CERTIFICATIONS**
 1. *See NOA No. 98-060819*
 - E. **OTHER**
 1. *NOA No. 98-0608.19*
 2. *Statement from manufacturer certifying that fabrication of product has not changed. (Missing as of 7/26/01)*
2. **NEW EVIDENCE SUBMITTED**
 - A. **DRAWINGS**
 1. *Drawing No. 05-313, titled 0.0375" Thick Galvanized Storm Panel, sheets 1 through 4 of 4, and sheet 1A of 4, prepared by Tilteco, Inc., dated September 29, 2005, last revision #1 dated September 29, 2005, signed and sealed by Walter A. Tillit Jr., P.E.*
 - B. **TESTS**
 1. *None.*
 - C. **CALCULATIONS**
 1. *Anchor calculations prepared by Tilteco, Inc., dated November 08, 2005, sheets 1 through 37 of 37, signed and sealed by Walter A. Tillit Jr., P.E.*
 - D. **QUALITY ASSURANCE**
 1. *By Miami-Dade County Building Code Compliance Office.*
 - E. **MATERIAL CERTIFICATIONS**
 1. *None.*



Helmy A. Makar, P. E.
Product Control Examiner
NOA No 05-1220.11
Expiration Date: 09/03/2006
Approval Date: 04/13/2006

GENERAL NOTES:

1. STORM PANEL SHOWN ON THIS PRODUCT APPROVAL DOCUMENT (P.A.D.) HAS BEEN VERIFIED FOR COMPLIANCE IN ACCORDANCE WITH THE 2004 EDITION OF THE FLORIDA BUILDING CODE. DESIGN WIND LOADS SHALL BE DETERMINED AS PER SECTION 1620 OF THE ABOVE MENTIONED CODE. IN ORDER TO VERIFY THAT COMPONENTS AND ANCHORS ON THIS P.A.D. AS TESTED WERE NOT OVER STRESSED, A 33% INCREASE IN ALLOWABLE STRESS FOR WIND LOADS WAS NOT USED IN THEIR ANALYSIS, A DURATION FACTOR $CD=1.60$ WAS USED FOR VERIFICATION OF FASTENERS IN WOOD.

STORM PANEL'S ADEQUACY FOR IMPACT AND FATIGUE RESISTANCE HAS BEEN VERIFIED IN ACCORDANCE WITH SECTION 1609.1.4 OF THE ABOVE MENTIONED CODE AS PER HETI LAB REPORTS # 98-710, 98-711 & 98-730, PER PROTOCOLS TAS-201, TAS-202 AND TAS-203.

- 2. ALL STEEL SHEET METAL PANELS TO BE STRUCTURAL QUALITY ASTM A-653 GRADE 40 WITH $F_y = 49.7$ k.s.i. (AFTER ROLLED), G-90 GALVANIZED AS PER HETI LAB REPORT # 98-T93.
- 3. ALL ALUMINUM EXTRUSIONS SHALL BE 6063-T5 ALLOY AND TEMPER UNLESS OTHERWISE NOTED
- 4. ALL SCREWS TO BE STAINLESS STEEL 304 OR 316 AISI SERIES OR CORROSION RESISTANT COATED CARBON STEEL AS PER DIN 50018 W/50ksi YIELD STRENGTH AND 90 ksi TENSILE STRENGTH.
- 5. BOLTS TO BE ASTM A-307 GALVANIZED STEEL, OR AISI 304 SERIES STAINLESS STEEL, WITH 36 ksi MINIMUM YIELD STRENGTH.
- 6. ANCHORS TO WALL SHALL BE AS FOLLOWS: (UNLESS OTHERWISE NOTED)
 - (A) TO EXISTING POURED CONCRETE:
 - 1/4" ϕ TAPCON ANCHORS, AS MANUFACTURED BY I.T.W. BUILDEX OR ELCO TEXTRON, INC.
 - 1/4" ELCO male/female PANELMATE ANCHORS, AS MANUFACTURED BY ELCO TEXTRON, INC.
 - 1/4" ϕ x 7/8" CALK-IN ANCHORS, AS MANUFACTURED BY POWERS FASTENERS, INC.

NOTES:

- A.1) MINIMUM EMBEDMENT OF TAPCON ANCHORS INTO CONCRETE SHALL BE 1 3/4", AND 1 7/8" FOR ELCO PANELMATE.
- A.2) 7/8" CALK-IN SHALL BE ENTIRELY EMBEDDED INTO THE POURED CONCRETE. NO EMBEDMENT INTO STUCCO SHALL BE PERMITTED. 1/4" ϕ -20 AISI 304 SERIES SCREWS USED SHALL BE 1 1/2" LONG MINIMUM SHOULD STUCCO EXIST, AND 1" MINIMUM FOR WALLS WITH NO STUCCO. SCREWS TO BE SIDEWALK BOLT TYPE WITH 3/4" DIAMETER HEAD.
- A.3) IN CASE THAT PRECAST STONE, PRECAST CONCRETE PANELS, OR PAVERS BE FOUND ON THE EXISTING WALL OR FLOOR, ANCHORS SHALL BE LONG ENOUGH TO REACH THE MAIN STRUCTURE BEHIND SUCH PANELS, ANCHORAGE SHALL BE 1 3/4" MINIMUM FOR ANCHORS MENTIONED IN A.1), & 7/8" FOR ANCHORS MENTIONED IN A.2).

(B) TO EXISTING CONCRETE BLOCK WALL:

- 1/4" ϕ TAPCON ANCHORS, AS MANUFACTURED BY I.T.W. BUILDEX OR ELCO TEXTRON, INC.
- 1/4" ELCO male/female PANELMATE ANCHORS, AS MANUFACTURED BY ELCO TEXTRON, INC.
- 1/4" ϕ x 7/8" CALK-IN ANCHORS, AS MANUFACTURED BY POWERS FASTENERS, INC.

NOTES:

- B.1) MINIMUM EMBEDMENT OF TAPCON ANCHORS AND ELCO PANELMATES, INTO THE CONCRETE BLOCK UNIT SHALL BE 1 1/4".
- B.2) 7/8" CALK-IN ANCHORS SHALL BE ENTERILY EMBEDDED INTO THE CONCRETE BLOCK UNIT. NO EMBEDMENT INTO STUCCO SHALL BE PERMITTED. 1/4" ϕ -20 AISI 304 SERIES SCREWS USED SHALL BE 1 1/2" LONG MINIMUM SHOULD STUCCO EXIST, AND 1" MINIMUM FOR WALLS WITH NO STUCCO. SCREWS TO BE SIDEWALK BOLT TYPE WITH 3/4" DIAMETER HEAD.
- B.3) IN CASE THAT PRECAST STONE OR PRECAST CONCRETE PANELS BE FOUND ON THE EXISTING WALL, ANCHORS SHALL BE LONG ENOUGH TO REACH THE MAIN STRUCTURE BEHIND SUCH PANELS. ANCHORAGE SHALL BE AS INDICATED ON NOTES B.1) & B.2) ABOVE.

(C) ANCHORS SHALL BE INSTALLED FOLLOWING ALL OF THE RECOMMENDATIONS AND SPECIFICATIONS OF THE ANCHOR'S MANUFACTURER.

7. PANELS MAY ALSO BE INSTALLED HORIZONTALLY FOLLOWING INSTALLATION DETAILS SHOWN ON SECTIONS 1, 2, 3 & 4 (SHEET 2 OF 4). EXCEPT THAT FOR SECTIONS 1 & 2 ONLY, COMPONENT # ④ SHALL BE USED AT BOTH ENDS.

8. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY THE SOUNDNESS OF THE STRUCTURE WHERE SHUTTER IS TO BE ATTACHED TO INSURE PROPER ANCHORAGE. THIS SHUTTER SHALL ONLY BE ATTACHED TO CONCRETE, BLOCK OR WOOD FRAME BUILDINGS.

9. THE INSTALLATION CONTRACTOR IS TO SEAL/CAULK ALL SHUTTER COMPONENT EDGES WHICH REMAIN IN CONTINUOUS CONTACT WITH THE BUILDING TO PREVENT WIND/RAIN INTRUSION, CAULK AND SEAL SHUTTER TRACKS ALL AROUND FULL LENGTH.

10. STORM PANEL INSTALLATION SHALL COMPLY WITH SPECS INDICATED IN THIS DRAWING PLUS ANY BUILDING AND ZONING REGULATIONS PROVIDED BY THE JURISDICTION WHERE PERMIT IS APPLIED TO.

11. (a) THIS PRODUC APPROVAL DOCUMENT (P.A.D.) PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT; i.e. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.A.D.

(b) CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION INCLUDING LIFE SAFETY OF THIS PRODUCT BASED ON THIS P.A.D. PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT. CONSTRUCTION SAFETY AT SITE IS THE CONTRACTOR'S RESPONSIBILITY.

(c) THIS PRODUCT APPROVAL DOCUMENT WILL BE CONSIDERED INVALID IF MODIFIED.

(d) SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME OF THE ENGINEER RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.A.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.A.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.

(e) THIS P.A.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.


12. SHUTTER MANUFACTURER'S LABEL SHALL BE PLACED ON A READILY AND VISIBLE LOCATION AT AT PANEL. ONE LABEL SHALL BE PLACED FOR EVERY OPENING. LABEL SHALL READ AS FOLLOWS:
MIAMI DADE ALUMINUM SUPPLY, INC.
 HIALEAH, FLORIDA
 MIAMI-DADE COUNTY PRODUCT APPROVED.

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 05-1220-11
 Expiration Date 09/03/2006
 By *Helmut M. Lake*
 Miami Dade Product Control
 Division


F.B.C. (High Velocity Hurricane Zone)

James D.
 11/5/05


 TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th. St., Ste. 305, MIAMI, FL 33166 Phone : (305)871-1530 . Fax : (305)871-1531 EB-0006719 WALTER A. TILLIT Jr., P. E. FLORIDA Lic. 44167	0.0375" THICK GALVANIZED STORM PANEL	Drawn by: J.J.V.																		
	MIAMI DADE ALUMINUM SUPPLY 1615 WEST 31st. PLACE HIALEAH, FLORIDA 33012 PH.:(305)823-0099, FAX:(305)823-2782	9/29/05 DATE																		
	05-313 DRAWING No																			
<table border="1"> <thead> <tr> <th>REV. NO</th> <th>DESCRIPTION</th> <th>DATE</th> <th>REV. No</th> <th>DESCRIPTION</th> <th>DATE</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>OLD 98-88</td> <td>9/29/05</td> <td>3</td> <td></td> <td></td> </tr> <tr> <td>2</td> <td></td> <td></td> <td>4</td> <td></td> <td></td> </tr> </tbody> </table>	REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE	1	OLD 98-88	9/29/05	3			2			4				SHEET 1 OF 4
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE															
1	OLD 98-88	9/29/05	3																	
2			4																	

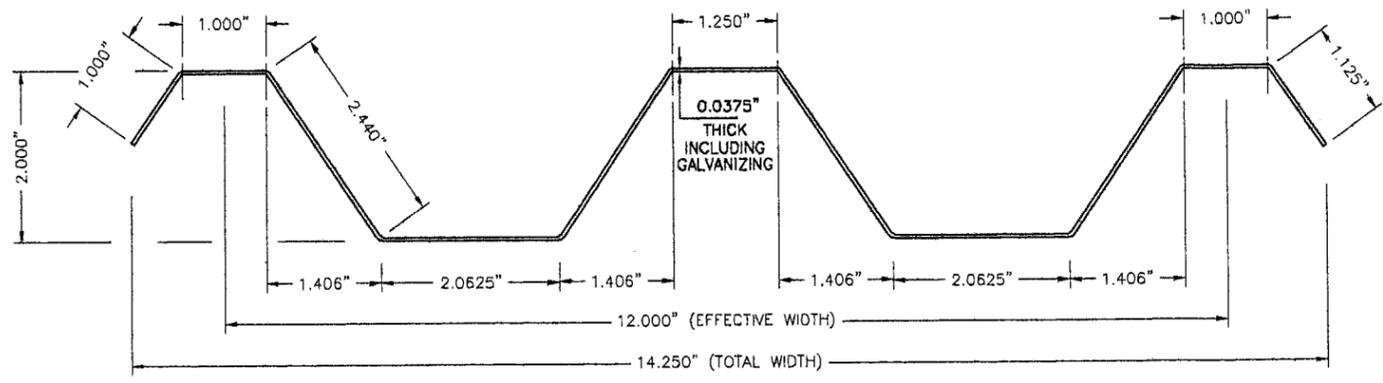


① PANEL
SCALE: 1/2" = 1"

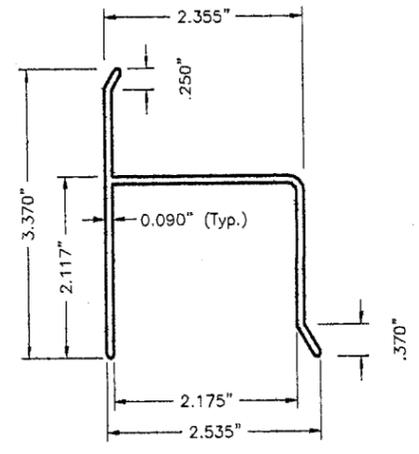


② HEADER
SCALE: 1/2" = 1"

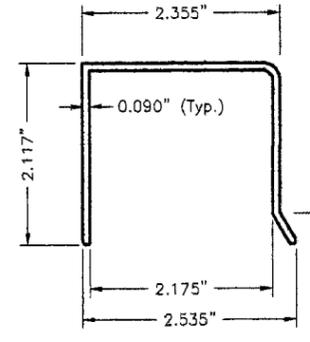


③ HEADER
SCALE: 1/2" = 1"

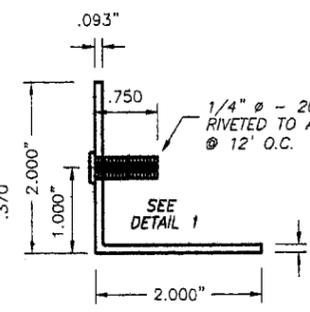


④ BASE ANGLE
SCALE: 1/2" = 1"

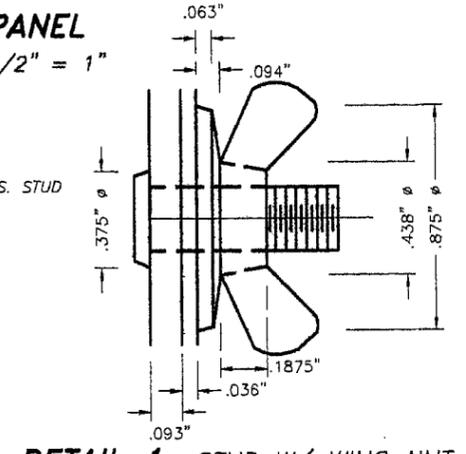


DETAIL 1: STUD W/ WING NUT
SCALE: 1 1/2" = 1"




⑤ "F" TRACK
6063-T6 ALLOY
SCALE: 1/2" = 1"

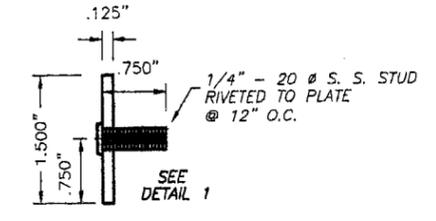


⑥ .125" PLATE
6063-T6 ALLOY
SCALE: 1/2" = 1"

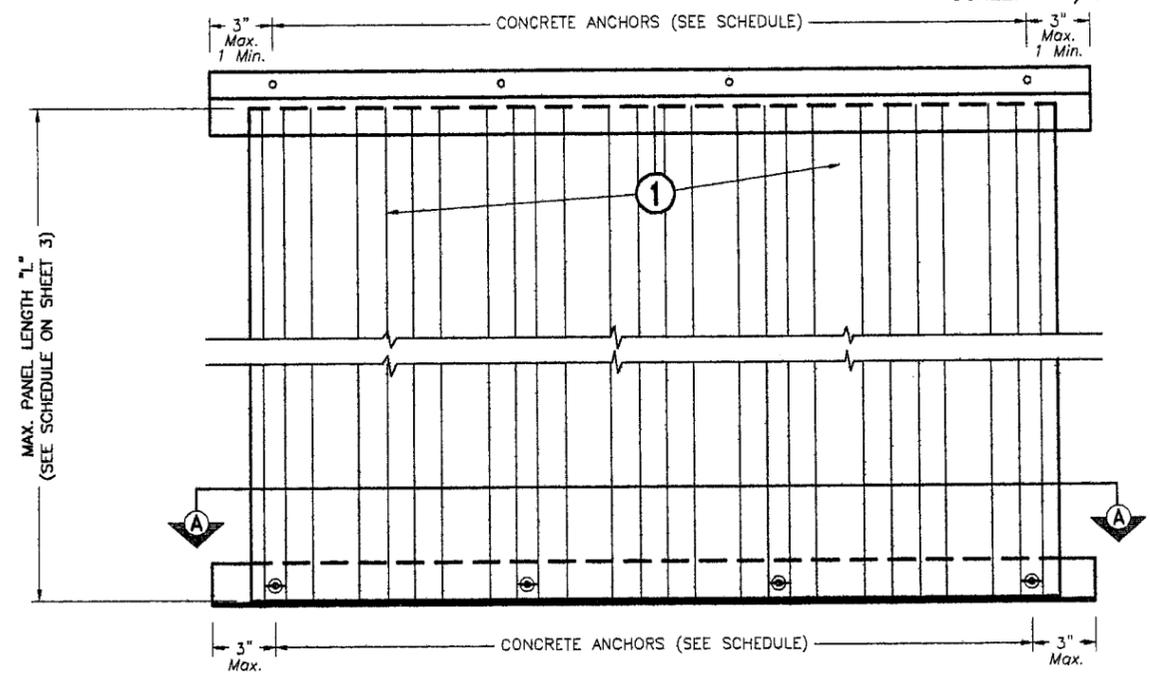

STORM PANEL TYPICAL ELEVATION SCALE 3" = 1'-0"

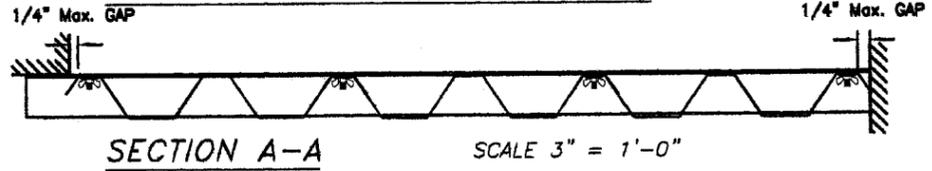

SECTION A-A SCALE 3" = 1'-0"

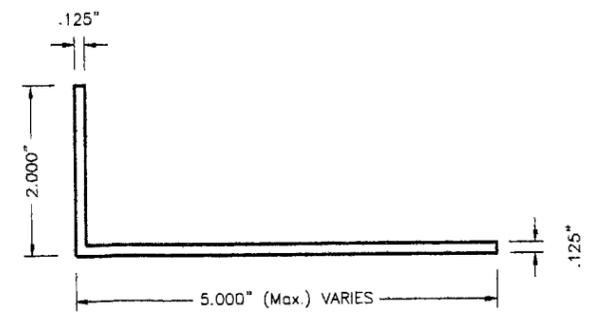

⑦ 2" x 5" (Max.) x .125" ANGLE
SCALE: 1/2" = 1"

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 05-1220-11
Expiration Date 09/03/2006
By *Helmut H. Miller*
Miami Dade Product Control
Division


F.B.C. (High Velocity Hurricane Zone)

COMPONENTS


Handwritten signature and date: 11/5/05

TILECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 309, MIAMI, FL. 33166
Phone: (305)871-1530, Fax: (305)871-1531
EB-0006719
WALTER A. TILLIT Jr., P. E.
FLORIDA Lic. 44167


0.0375" THICK GALVANIZED STORM PANEL						Drawn by: J.J.V.
MIAMI DADE ALUMINUM SUPPLY						9/29/05 DATE
1615 WEST 31st. PLACE HIALEAH, FLORIDA 33012 PH.: (305)823-0099, FAX: (305)823-2782						05-313 DRAWING No
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE	SHEET 1A OF 4
1	OLD 98-56	9/29/05	3			
2			4			

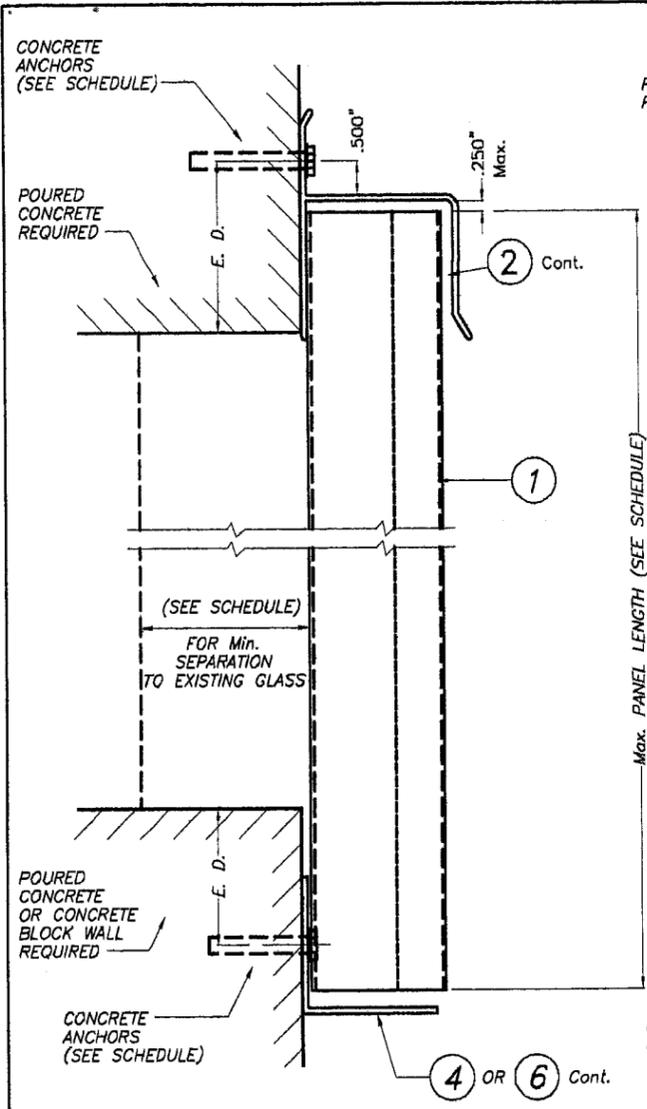


SECTION @ ANCHOR

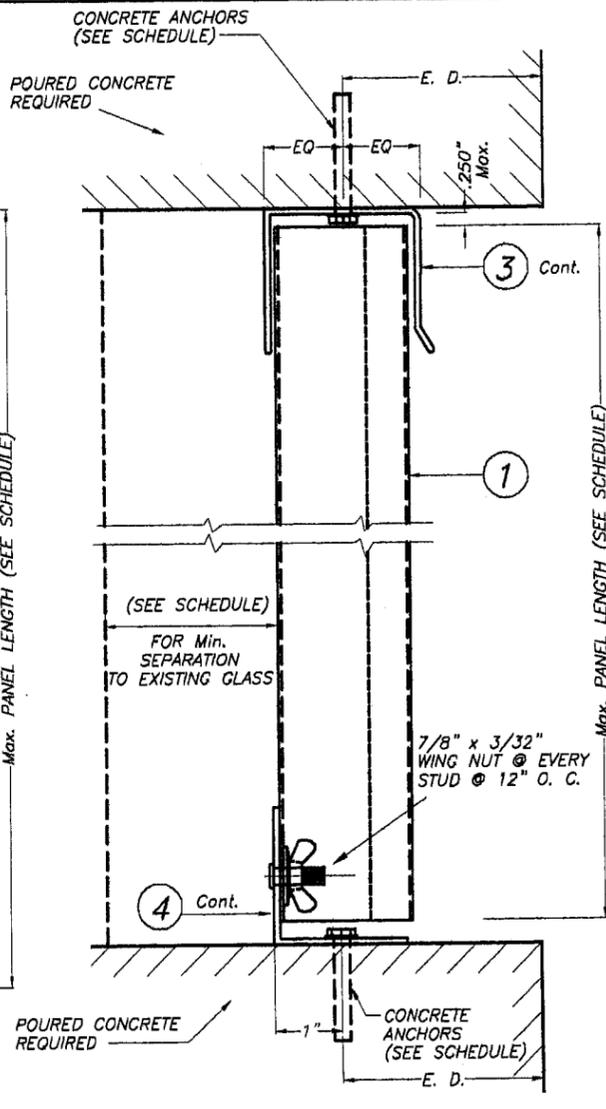


CEILING & FLOOR MOUNT. INSTALL.
- SECTION 2 SCALE: 3/8" = 1"

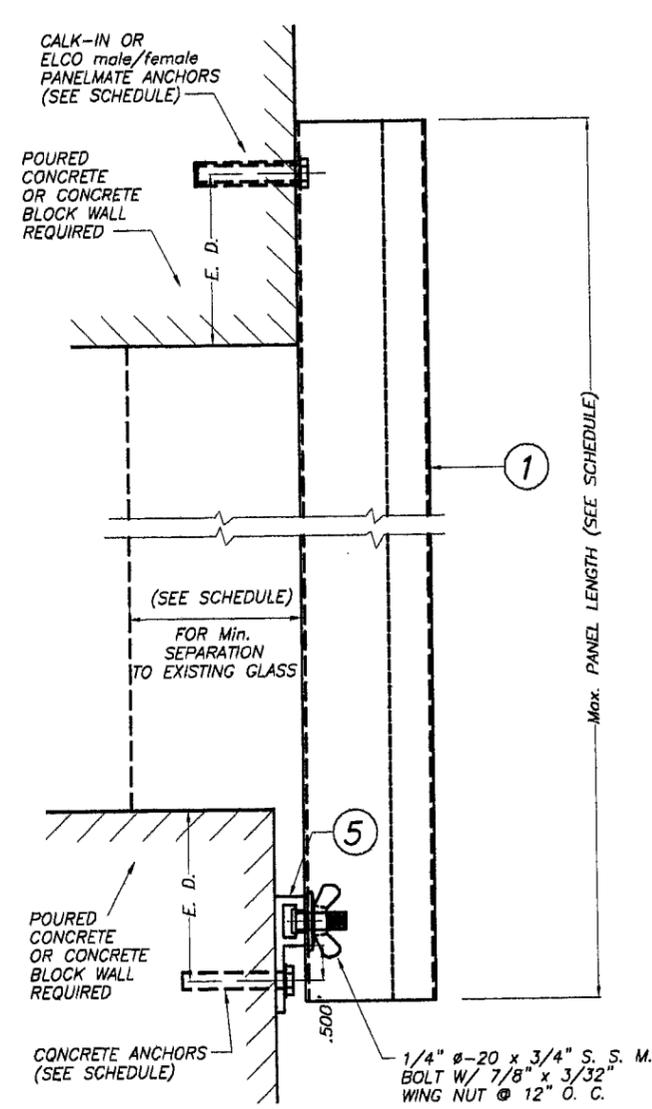

WALL MOUNTING INSTALLATION W/
DIRECT MOUNT - SECTION 3
SCALE: 3/8" = 1"

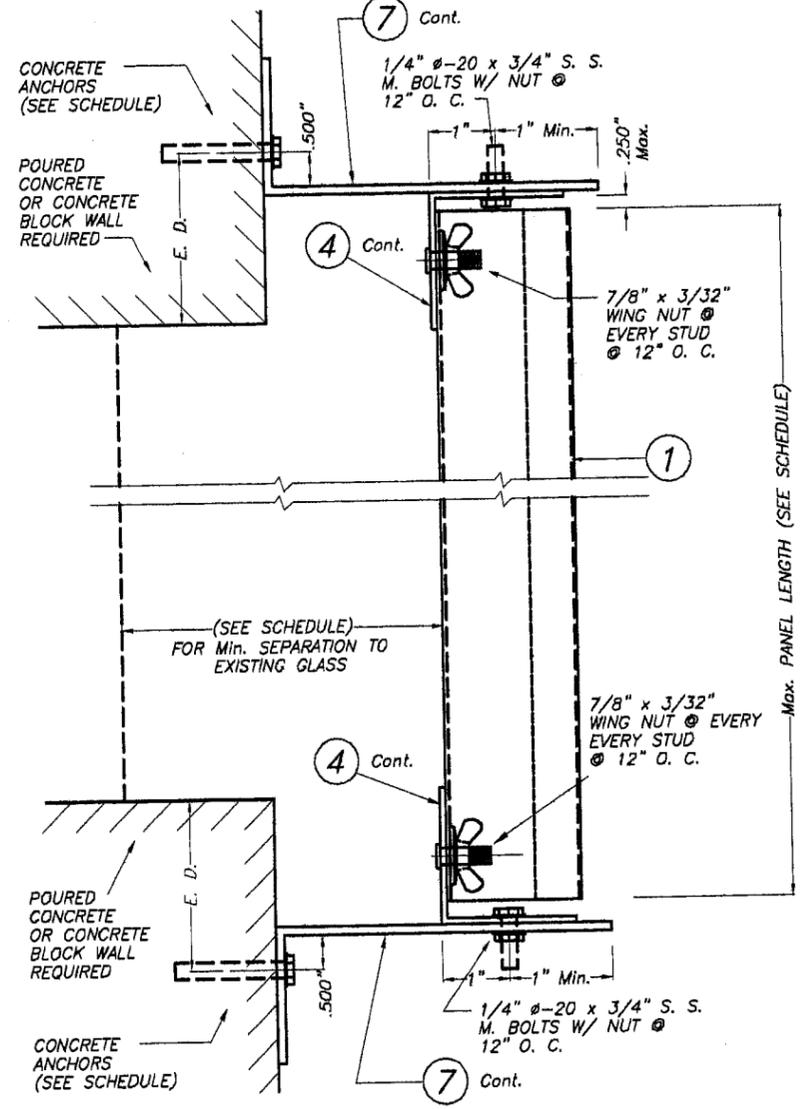

BUILD-OUT WALL MOUNTING INSTALLATION
- SECTION 4 SCALE: 3/8" = 1"

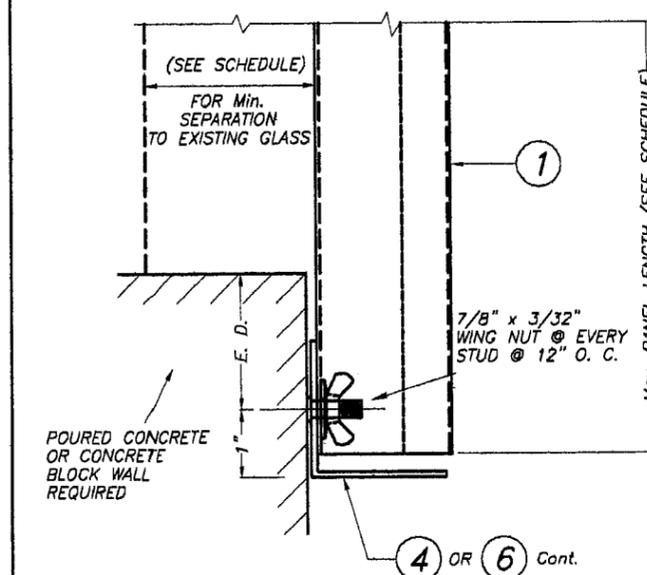

SECTION @ STUD
WALL MOUNTING INSTALLATION
- SECTION 1 SCALE: 3/8" = 1"

NOTE FOR COMBINATION OF SECTIONS :
WALL/FLOOR/CEILING MOUNTING SECTIONS
CAN BE COMBINED IN ANY WAY TO SUIT
ANY INSTALLATION.

E. D. = EDGE DISTANCE
(SEE SCHEDULE
ON SHEET 3 OF 4)


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 05-1220-11
Expiration Date 09/03/2006
By *Helmut H. Mader*
Miami Dade Product Control
Division

F.B.C. (High Velocity Hurricane Zone)


TILECO Inc.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, MIAMI, FL 33166
Phone: (305)871-1530 Fax: (305)871-1531
EB-0006718
WALTER A. TILLIT Jr., P. E.
FLORIDA Lic. 44167

0.0375" THICK GALVANIZED STORM PANEL						Drawn by: J.J.V.
MIAMI DADE ALUMINUM SUPPLY						9/29/05 DATE
1615 WEST 31st. PLACE HIALEAH, FLORIDA 33012 PH.:(305)823-0099, FAX:(305)823-2782						05-313 DRAWING No
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE	SHEET 2 OF 4
1	OLD 98-56	9/29/05	3			
2			4			


11/5705

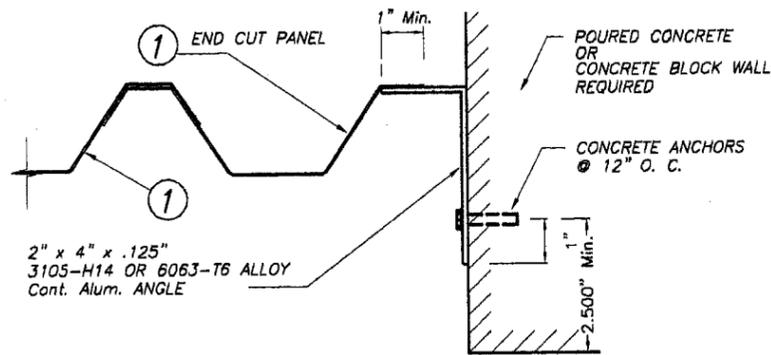

CASE A (Plan)

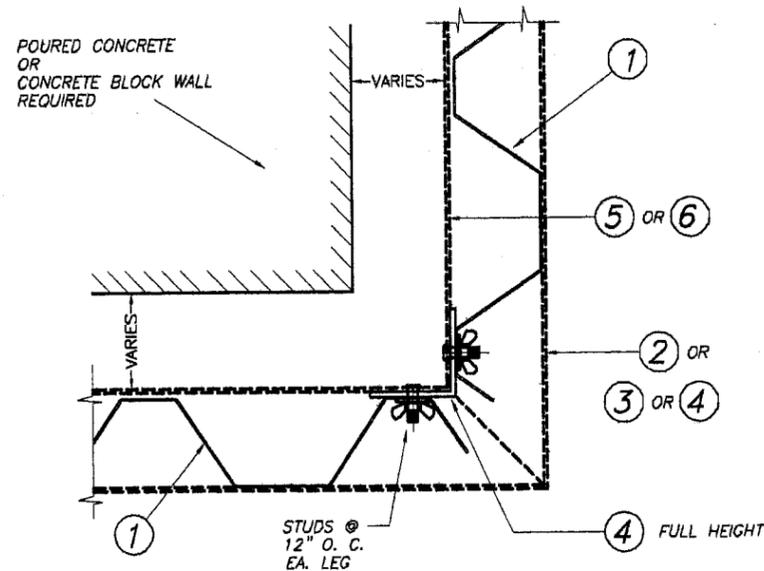

CASE B (Plan)

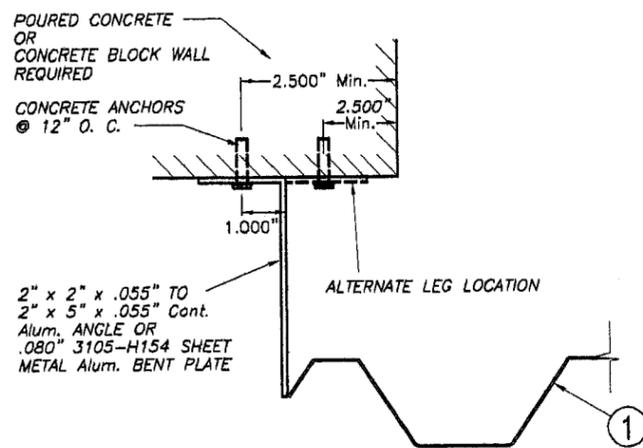

CASE C (Plan)

END CLOSURES DETAILS

SCALE : 3/8" = 1"

MAXIMUM DESIGN PRESSURE RATING "W" (p.s.f.) AND CORRESPONDING MAXIMUM SPAN "L" SCHEDULE

MAXIMUM DESIGN LOAD W (p.s.f.)	Max. PANEL SPAN L (ft.)	MINIMUM SEPARATION TO GLASS	APPLICABLE TO SECTIONS # (SEE SHEET 2 OF 4) OR ANY COMBINATION OF THEM
+60.0, -64.0	10'-0" OR LESS	3 3/8"	1, 2, 3 & 4

MAXIMUM DESIGN PRESSURE RATING "W" (p.s.f.) AND CORRESPONDING MAXIMUM ANCHOR SPACING SCHEDULE FOR INSTALLATIONS INTO CONCRETE AND C.B.S. STRUCTURES *

MAXIMUM DESIGN LOAD W (p.s.f.)	MAXIMUM ANCHORS SPACING **						APPLICABLE TO SECTIONS #	MAXIMUM PANEL SPAN L (ft.)
	TAPCON		CALK-IN		PANELMATE			
	TO CONCRETE	TO MASONRY	TO CONCRETE	TO MASONRY	TO CONCRETE	TO MASONRY		
+60.0, -64.0	5 1/2"	N/A	5 1/2"	N/A	3"	N/A	1 (TOP)	10'-0" OR LESS
	12"	5 1/2"	12"	8"	10"	9 1/2"	1 (BOTTOM)	
	9"	N/A	8 1/2"	N/A	7"	N/A	2 (TOP)	
	8"	N/A	7"	N/A	5 1/2"	N/A	2 (BOTTOM)	
	N/A	N/A	12"	6"	6"	6"	3 (TOP)	
	11 1/2"	5 1/2"	11 1/2"	8"	10"	9 1/2"	3 (BOTTOM)	
	11 1/2"	3 1/2"	11 1/2"	5 1/2"	6 1/2"	6 1/2"	4 (TOP/BOTTOM)	

* SEE SHEET 4 OF 4 FOR ANCHORS TYPE & SPACING FOR INSTALLATION INTO WOOD FRAME BUILDINGS.

** MAXIMUM ANCHOR SPACINGS ARE VALID FOR 3 1/2" EDGE DISTANCE. FOR E. D. LESS THAN 3 1/2", REDUCE ANCHOR SPACING BY MULTIPLYING SPACINGS SHOWN ON SCHEDULE BY THE FOLLOWING FACTORS. (Min. E. D. FOR CALK-IN ANCHORS IS 2 1/2").

ACTUAL E. D.	FACTOR	
	TAPCON / PANELMATE	CALK-IN
3"	.86	.75
2 1/2"	.71	.50
2"	.50	-

THIS EDGE DISTANCE REDUCTION IS NOT ALLOWED FOR DIRECT MOUNT INSTALLATIONS (SEE SECTION 3 (TOP) ON SHEET 2 OF 4)


PRODUCT REVISED as complying with the Florida Building Code Acceptance No 05-1220.11 Expiration Date 09/03/2006
By: *Helmut A. Mohr*
Miami Dade Product Control Division

F.B.C. (High Velocity Hurricane Zone)


 TILTECO Inc. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, MIAMI, FL 33166 Phone: (305)871-1530 Fax: (305)871-1531 EB-0006719 WALTER A. TILLIT Jr., P. E. FLORIDA Lic. 44167	0.0375" THICK GALVANIZED STORM PANEL	Drawn by: J.J.V.
	MIAMI DADE ALUMINUM SUPPLY 1615 WEST 31st. PLACE HIALEAH, FLORIDA 33012 PH.: (305)823-0099, FAX: (305)823-2782	9/29/05 DATE
	REV. NO. DESCRIPTION DATE REV. No. DESCRIPTION DATE 1 OLD 98-56 9/29/05 3 2 - - - 4	05-313 DRAWING No

SHEET 3 OF 4


11/5/05

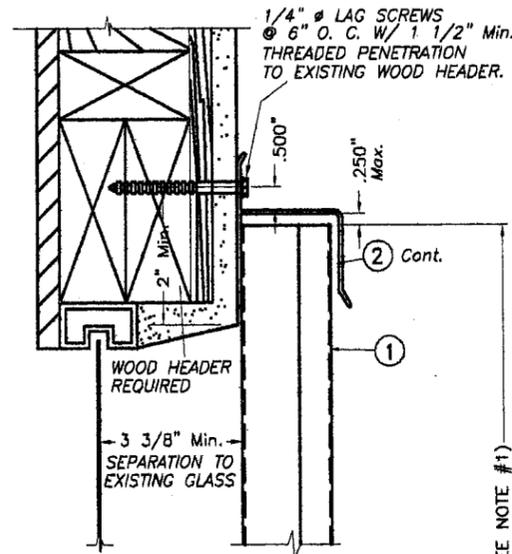


ALTERNATIVE 1

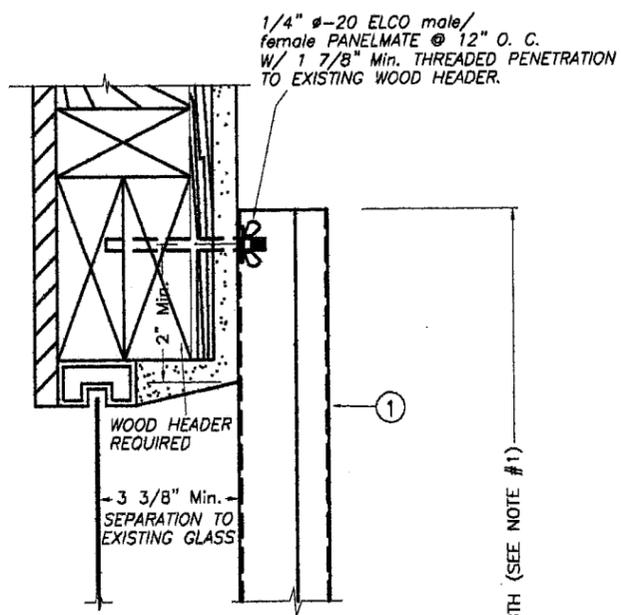


ALTERNATIVE 3

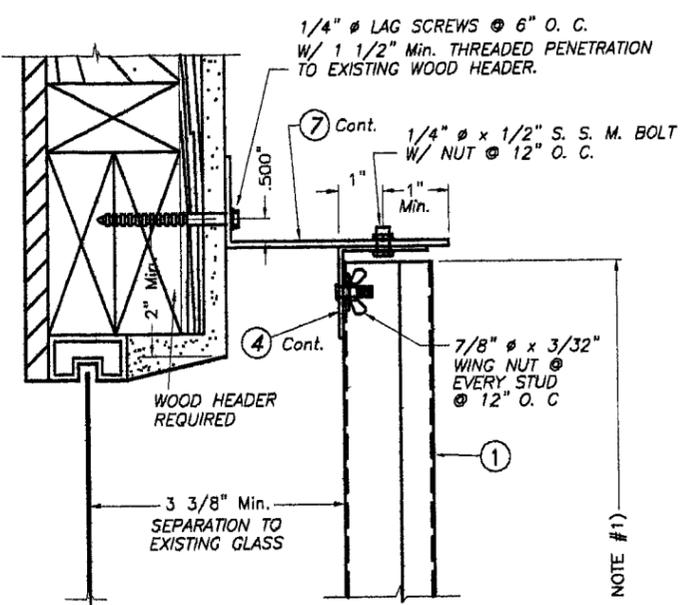


ALTERNATIVE 5

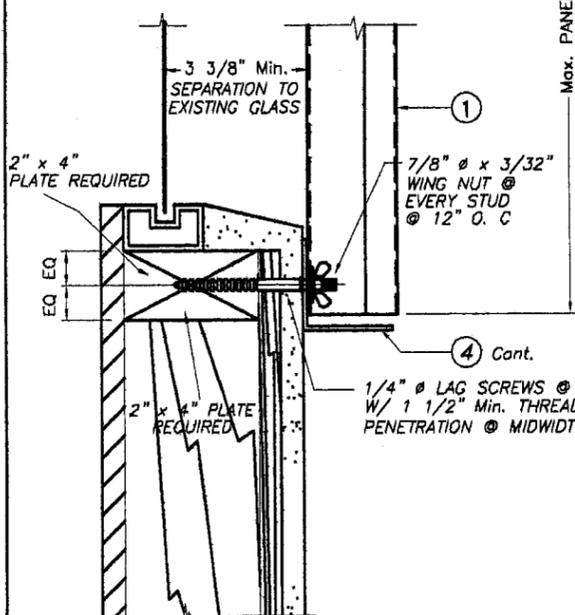


ALTERNATIVE 2

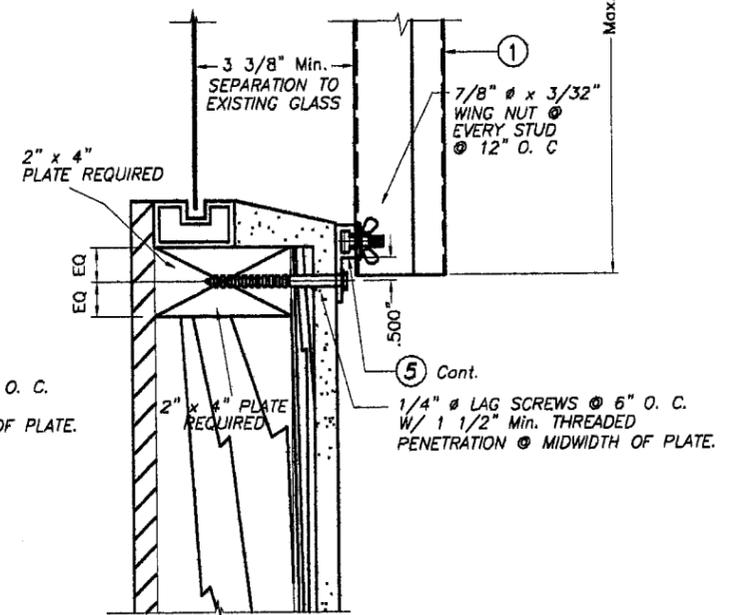

ALTERNATIVE 4

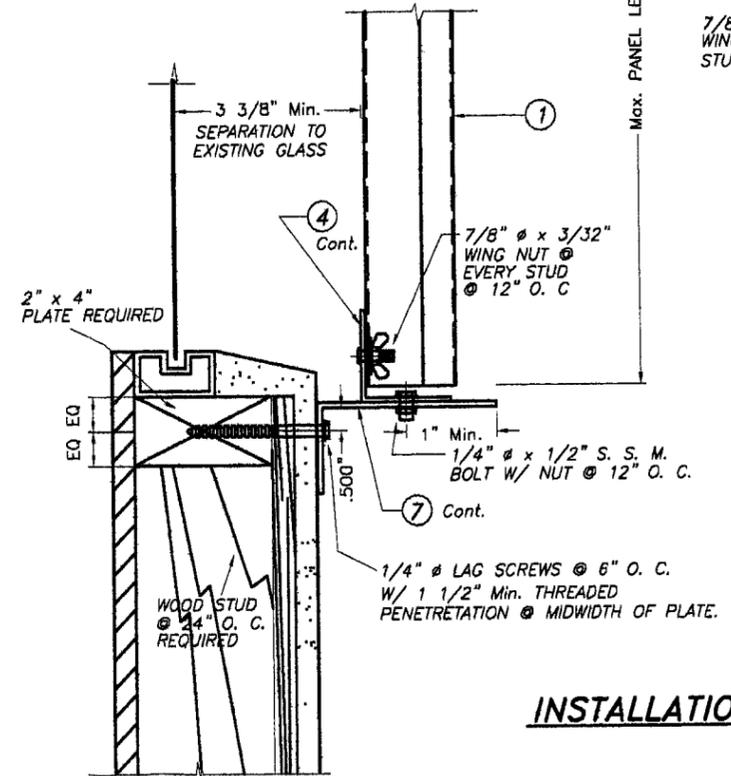

ALTERNATIVE 6

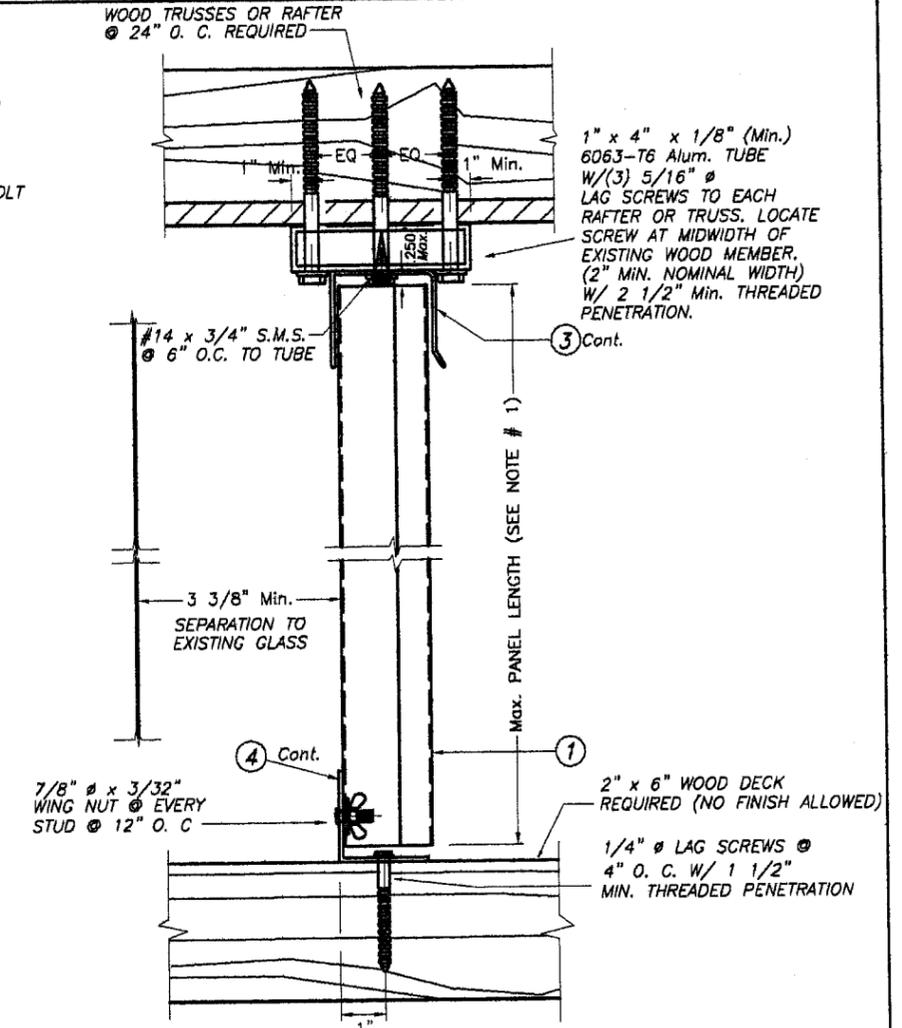

CEILING & FLOOR MOUNTING INSTALLATIONS

- SECTION B

SCALE: 1/4" = 1"

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 05-1220.11 Expiration Date 09/03/2006 By Helmut H. Mohr Miami Dade Product Control Division

INSTALLATION DETAILS ON EXISTING WOOD BUILDINGS

WALL MOUNTING INSTALLATIONS - SECTIONS A

F.B.C. (High Velocity Hurricane Zone)

NOTE FOR COMBINATION OF SECTIONS:
SECTIONS CAN BE COMBINED IN ANY WAY TO SUIT ANY INSTALLATION.

NOTES:
1. INSTALLATIONS ARE ONLY VALID FOR BUILDINGS WITH DESIGN LOADS UP TO +60.0, -64.0 p.s.f. AND PANEL'S LENGTH UP TO 10'-0".
2. FOR NEW WOOD FRAME CONSTRUCTION: WOOD MEMBERS TO BE SOUTHERN PINE No. 2, W/ SPECIFIC DENSITY OF 0.55 OR EQUAL.

11/5/05

TILECO inc.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 303, MIAMI, FL 33166
Phone: (305)871-1530 Fax: (305)871-1531
EB-0008719
WALTER A. TILLIT Jr., P. E.
FLORIDA Lic. 44167

0.0375" THICK GALVANIZED STORM PANEL
MIAMI DADE ALUMINUM SUPPLY
1615 WEST 31st. PLACE
HIALEAH, FLORIDA 33012
PH.: (305)823-0099, FAX: (305)823-2782

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 98-56	9/28/05	3		
2			4		

Drawn by:
J.J.V.
9/29/05
DATE
05-313
DRAWING No
SHEET 4 OF 4