



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

www.buldingcodeonline.com

Bell-View, Inc.
150 Industrial Blvd.
Wrightsville, GA 31096

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series PA-25 Aluminum Horizontal Sliding Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W05-24**, titled "Series PA-25 Alum. Horiz. Sliding Wdw. (L.M.I.)", sheets 1 through 6 of 6, dated 05/24/05, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No 05-1222.06
Expiration Date: July 20, 2011
Approval Date: July 20, 2006
Page 1

Bell-View, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W05-24**, Sheets 1 through 6 of 6, titled "Series PA-25 Alum. Horiz. Sliding Wdw. (L.M.I.)", prepared by Al-Farooq Corporation, dated 05/24/05, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 3603.2 (b) and TAS 202-94
along with marked-up drawings and installation diagram of PA 25 horizontal slider XO, prepared by American Test Lab of South Florida, Test Report No. **ATL-1022.01-01**, dated 05/10/02, signed and sealed by William R. Mehner, P.E. and Harry Hattem, P.E.
2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 3603.2 (b) and TAS 202-94
along with marked-up drawings and installation diagram of PA 25 horizontal slider XO, prepared by American Test Lab of South Florida, Test Report No. **ATL-1022.02-01**, dated 05/10/02, signed and sealed by William R. Mehner, P.E. and Harry Hattem, P.E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by Al-Farooq Corporation, dated September 15, 2005, signed and sealed by Humayoun Farooq, P.E.
Complies with ASTM E1300-98/02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **01-1204.01** issued to E.I. DuPont DeNemours for "Sentry Glass (R) Plus" dated 01/17/02, expiring on 01/14/07.


Manuel Perez, P.E.
Product Control Examiner
NOA No 05-1222.06
Expiration Date: July 20, 2011
Approval Date: July 20, 2006


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED



F. STATEMENTS

1. Statement letter of conformance, dated September 15, 2005, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated September 15, 2005, signed and sealed by Humayoun Farooq, P.E.
3. Laboratory compliance letter for Test Report no. **ATLSF-1022.01-01**, issued by American Test Lab of South Florida, dated 05/10/02, signed and sealed by William R. Mehner, P.E. and Harry Hattem, P.E.
4. Laboratory compliance letter for Test Report no. **ATLSF-1022.02-01**, issued by American Test Lab of South Florida, dated 05/10/02, signed and sealed by William R. Mehner, P.E. and Harry Hattem, P.E.

G. OTHER

1. None.

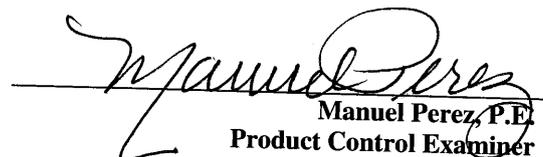
Manuel Perez, P.E.
Product Control Examiner
NOA No 05-1222.06
Expiration Date: July 20, 2011
Approval Date: July 20, 2006

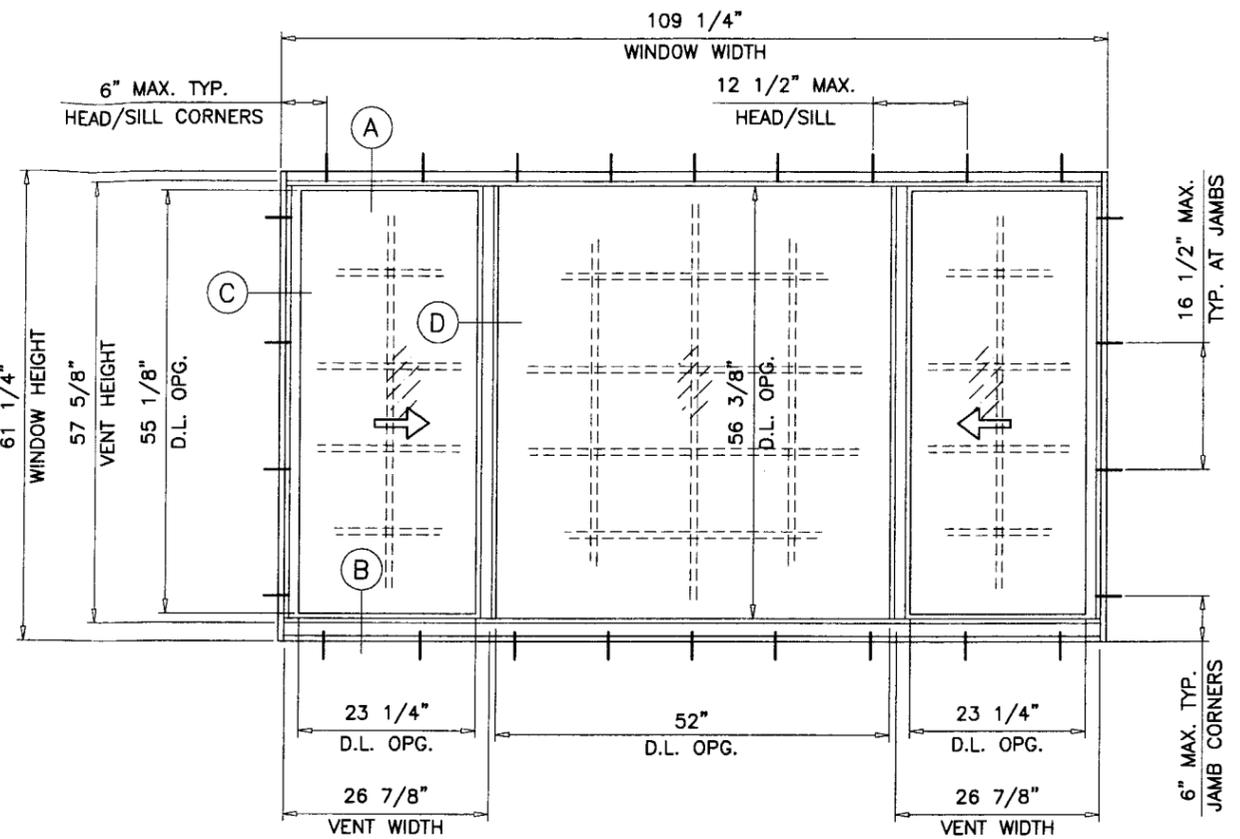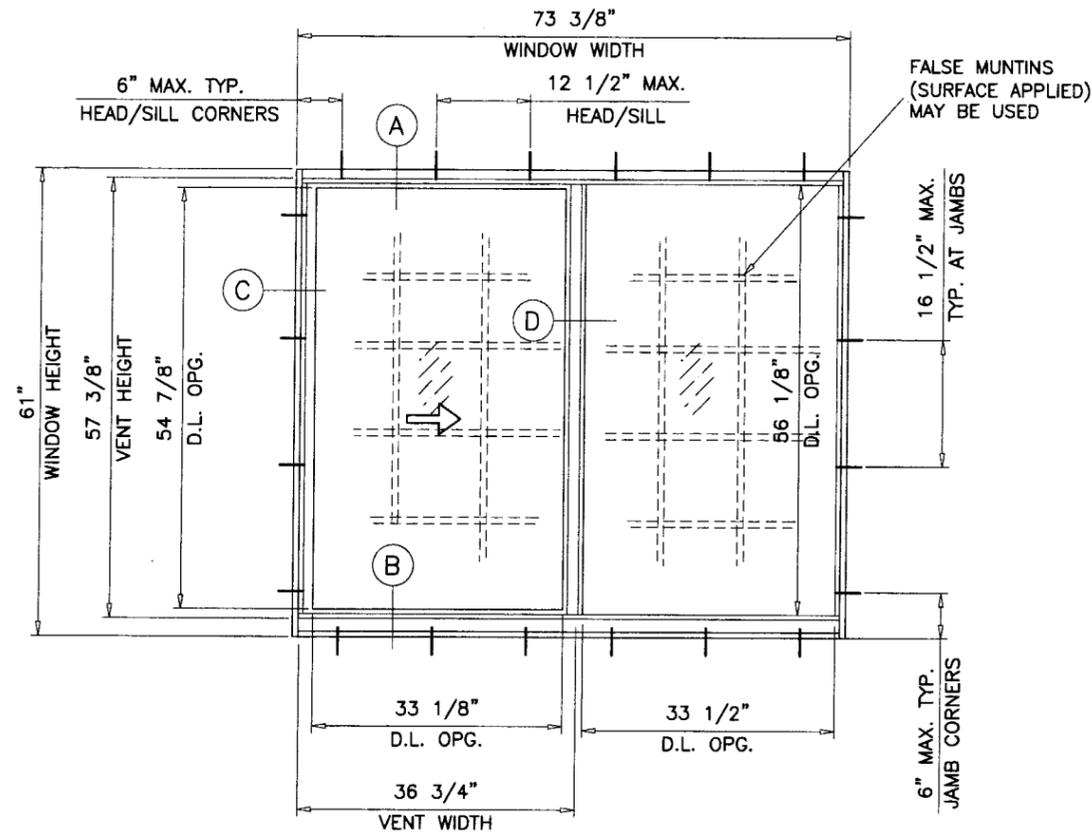

TYPICAL ELEVATION
TESTED UNITS

THESE WINDOWS ARE RATED FOR LARGE MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

SERIES PA-25 ALUM HORIZ. SLIDING WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF H.R./H.R. OR H.R. WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING APPROVED MULLIONS.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE.


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.


ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A 33% INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF WOOD ANCHORS ONLY.

ALL STEEL IN CONTACT WITH ALUMINUM TO BE PAINTED OR PLATED.

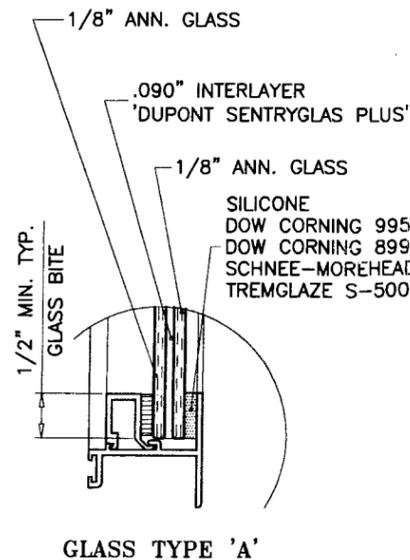

GLASS TYPE 'A'

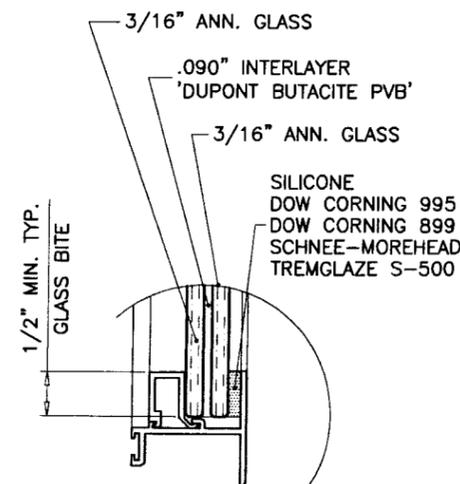

GLASS TYPE 'B'

GLAZING OPTIONS

LAMINATED GLASS
LARGE MISSILE IMPACT

Engr. DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

Approved as complying with the
Florida Building Code
Date JULY 20, 2006
NOA# 05-1222.06
Miami Dade Product Control
Division
By [Signature]

SEP 27 2005

revisions:	
no	date by description

date: 05-24-05
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W05-24

sheet 1 of 6

afc


AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES PA-25 ALUM HORIZ. SLIDING WDW. (L.M.I.)
BELL-VIEW INC.
150 INDUSTRIAL BLVD.
WRIGHTSVILLE, GA. 31096
TEL. (478) 864-2227 FAX. (478) 864-2492

COMP-ANL\W05-24BVI


DESIGN LOAD CAPACITY - PSF (XO OR OX SIZES)						
WINDOW DIMS.		A	GLASS TYPE 'A'		GLASS TYPE 'B'	
WIDTH	HEIGHT		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
26-1/2"	26" (2)	3	50.0	55.0	70.0	75.0
37"		3	50.0	55.0	70.0	75.0
53"		5	50.0	55.0	70.0	75.0
74"		6	50.0	55.0	70.0	75.0
26-1/2"	38-3/8" (3)	3	50.0	55.0	70.0	75.0
37"		3	50.0	55.0	70.0	75.0
53"		5	50.0	55.0	70.0	75.0
74"		6	50.0	55.0	70.0	75.0
26-1/2"	50-5/8" (4)	3	50.0	55.0	70.0	75.0
37"		3	50.0	55.0	70.0	75.0
53"		5	50.0	55.0	70.0	75.0
74"		6	49.6	49.6	70.0	75.0
26-1/2"	63" (4)	3	50.0	55.0	70.0	75.0
37"		3	50.0	55.0	70.0	75.0
53"		5	50.0	55.0	70.0	75.0
74"		6	50.0	55.0	70.0	75.0
25"	25" (2)	3	50.0	55.0	70.0	75.0
37"		3	50.0	55.0	70.0	75.0
45"		4	50.0	55.0	70.0	75.0
49"		4	50.0	55.0	70.0	75.0
61"		5	50.0	55.0	70.0	75.0
73"		6	50.0	55.0	70.0	75.0
25"	37" (3)	3	50.0	55.0	70.0	75.0
37"		3	50.0	55.0	70.0	75.0
45"		4	50.0	55.0	70.0	75.0
49"		4	50.0	55.0	70.0	75.0
61"		5	50.0	55.0	70.0	75.0
73"		6	50.0	55.0	70.0	75.0
25"	45" (4)	3	50.0	55.0	70.0	75.0
37"		3	50.0	55.0	70.0	75.0
45"		4	50.0	55.0	70.0	75.0
49"		4	50.0	55.0	70.0	75.0
61"		5	50.0	55.0	70.0	75.0
73"		6	50.0	55.0	70.0	75.0
25"	49" (4)	3	50.0	55.0	70.0	75.0
37"		3	50.0	55.0	70.0	75.0
45"		4	50.0	55.0	70.0	75.0
49"		4	50.0	55.0	70.0	75.0
61"		5	50.0	55.0	70.0	75.0
73"		6	50.0	51.8	70.0	75.0
25"	61" (5)	3	50.0	55.0	70.0	75.0
37"		3	50.0	55.0	70.0	75.0
45"		4	50.0	55.0	70.0	75.0
49"		4	50.0	55.0	70.0	75.0
61"		5	49.6	49.6	70.0	75.0
73"		6	41.2	41.2	70.0	75.0

A = NO. OF ANCHORS PER HEAD & SILL
() = NO. OF ANCHORS PER JAMB



DESIGN LOAD CAPACITY - PSF (XOX SIZES)						
WINDOW DIMS.		A	GLASS TYPE 'A'		GLASS TYPE 'B'	
WIDTH	HEIGHT		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
74-1/8"	26" (2)	6	45.0	50.0	70.0	70.0
106-3/8"		9	45.0	50.0	70.0	70.0
111-1/4"		9	45.0	50.0	70.0	70.0
74-1/8"	38-3/8" (3)	6	45.0	50.0	70.0	70.0
106-3/8"		9	45.0	50.0	70.0	70.0
111-1/4"		9	45.0	50.0	70.0	70.0
74-1/8"	50-5/8" (4)	6	45.0	50.0	70.0	70.0
106-3/8"		9	45.0	50.0	70.0	70.0
111-1/4"		9	45.0	49.7	70.0	70.0
74-1/8"	63" (4)	6	45.0	50.0	70.0	70.0
106-3/8"		9	37.6	41.2	65.8	65.8
73"	25" (2)	6	45.0	50.0	70.0	70.0
85"		7	45.0	50.0	70.0	70.0
97"		8	45.0	50.0	70.0	70.0
109"		9	45.0	50.0	70.0	70.0
73"	37" (3)	6	45.0	50.0	70.0	70.0
85"		7	45.0	50.0	70.0	70.0
97"		8	45.0	50.0	70.0	70.0
109"		9	45.0	50.0	70.0	70.0
73"	45" (4)	6	45.0	50.0	70.0	70.0
85"		7	45.0	50.0	70.0	70.0
97"		8	45.0	50.0	70.0	70.0
109"		9	45.0	50.0	70.0	70.0
73"	49" (4)	6	45.0	50.0	70.0	70.0
85"		7	45.0	50.0	70.0	70.0
97"		8	45.0	50.0	70.0	70.0
109"		9	45.0	50.0	70.0	70.0
73"	61" (5)	6	45.0	50.0	70.0	70.0
85"		7	45.0	50.0	70.0	70.0
97"		8	43.5	46.6	70.0	70.0
109"		9	40.5	41.5	70.0	70.0


A = NO. OF ANCHORS PER HEAD & SILL
() = NO. OF ANCHORS PER JAMB

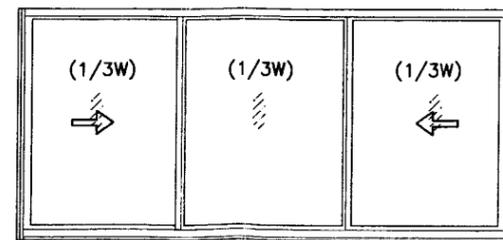

OPERATING VENTS TO BE 1/3 OF THE WINDOW WIDTH

DESIGN LOAD CAPACITY - PSF (XOX SIZES)						
WINDOW DIMS.		A	GLASS TYPE 'A'		GLASS TYPE 'B'	
WIDTH	HEIGHT		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
74-1/8"	26" (2)	6	45.0	50.0	70.0	70.0
106-3/8"		9	45.0	50.0	70.0	70.0
111-1/4"		9	45.0	50.0	70.0	70.0
74-1/8"	38-3/8" (3)	6	45.0	50.0	70.0	70.0
106-3/8"		9	45.0	48.0	70.0	70.0
111-1/4"		9	45.0	45.1	70.0	70.0
74-1/8"	50-5/8" (4)	6	45.0	50.0	70.0	70.0
106-3/8"		9	45.0	46.3	70.0	70.0
111-1/4"		9	44.5	44.5	68.5	68.5
74-1/8"	63" (4)	6	41.3	41.3	70.0	70.0
106-3/8"		9	36.7	38.3	56.1	56.1
73"	25" (2)	6	45.0	50.0	70.0	70.0
85"		7	45.0	50.0	70.0	70.0
97"		8	45.0	50.0	70.0	70.0
109"		9	45.0	50.0	70.0	70.0
73"	37" (3)	6	45.0	50.0	70.0	70.0
85"		7	45.0	50.0	70.0	70.0
97"		8	45.0	50.0	70.0	70.0
109"		9	45.0	47.8	70.0	70.0
73"	45" (4)	6	45.0	50.0	70.0	70.0
85"		7	45.0	50.0	70.0	70.0
97"		8	45.0	50.0	70.0	70.0
109"		9	45.0	49.5	70.0	70.0
73"	49" (4)	6	45.0	50.0	70.0	70.0
85"		7	45.0	47.5	70.0	70.0
97"		8	45.0	50.0	70.0	70.0
109"		9	45.0	46.3	70.0	70.0
73"	61" (5)	6	43.2	43.2	70.0	70.0
85"		7	37.7	37.7	70.0	70.0
97"		8	41.9	41.9	65.0	65.0
109"		9	38.9	38.9	56.5	56.5

A = NO. OF ANCHORS PER HEAD & SILL
() = NO. OF ANCHORS PER JAMB

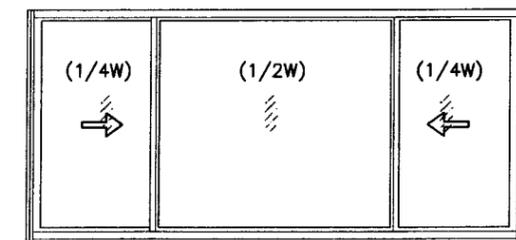

OPERATING VENTS TO BE 1/4 OF THE WINDOW WIDTH

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE BASED ON
A: ASTM E1300-98 (60 SEC. WIND)
B: ASTM E1300-02 (3 SEC. GUSTS) WITH REDUCTIONS FOR FLEXIBLE SUPPORTS TO COMPLY WITH SECTION 2403.2 OF FBC 2004 EDITION.

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

Approved as complying with the
Florida Building Code
Date: July 20, 2006
NOA# 05-1222-06
Miami Dade Product Control
Division
By: *Manuel Pro*

SEP 27 2006

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6878

COMP-ANL\W05-24BVI

SERIES PA-25 ALUM HORIZ. SLIDING WDW. (L.M.I.)

BELL-VIEW INC.

150 INDUSTRIAL BLVD.
WRIGHTSVILLE, GA. 31096


TEL. (478) 864-2227 FAX. (478) 864-2492

revisions:	no	date	by	description



date: 05-24-05
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W05-24

sheet 2 of 6

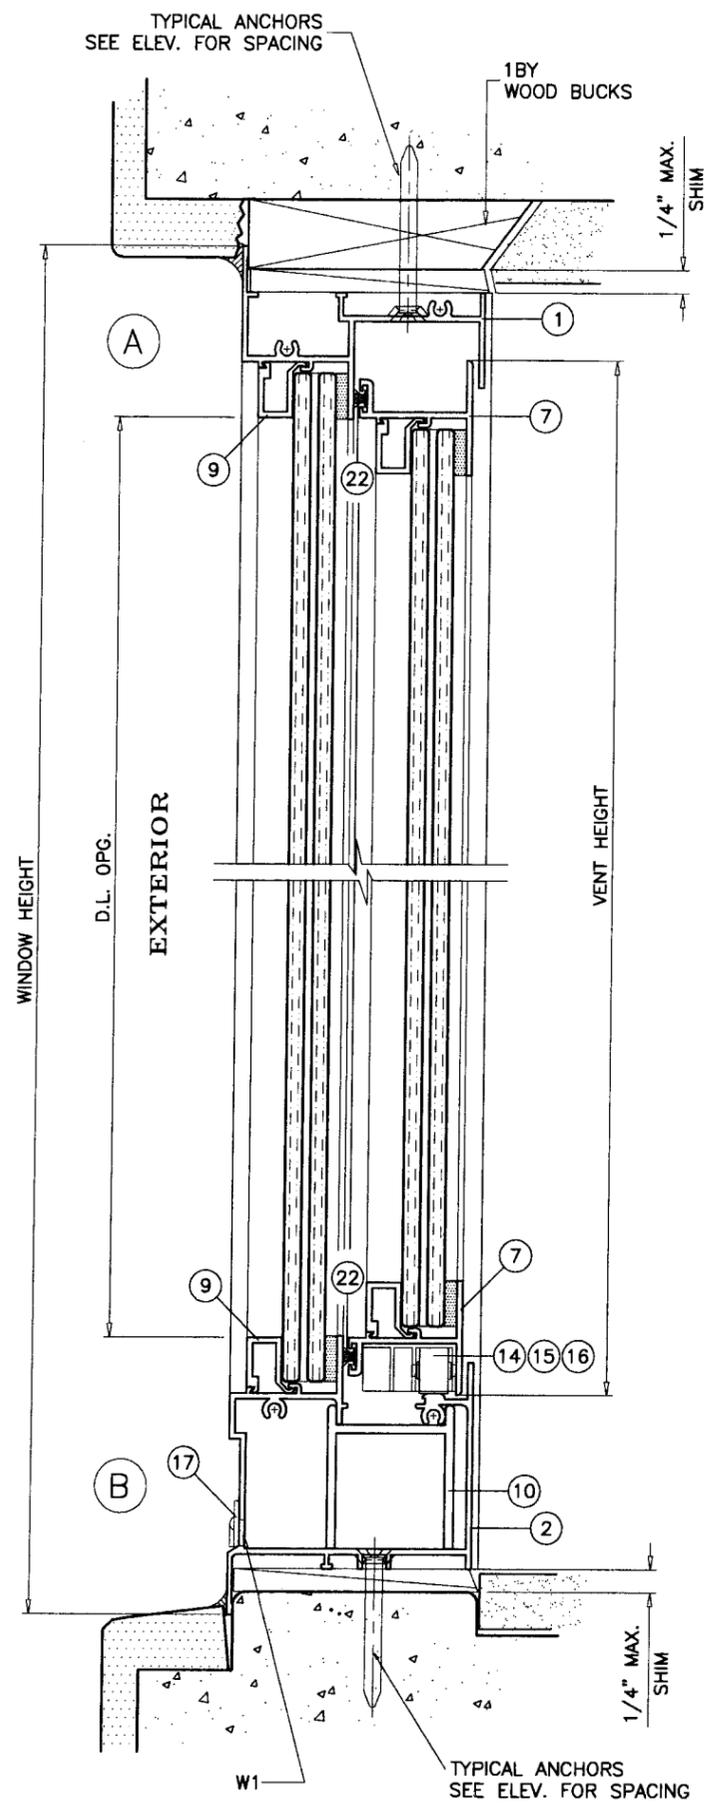

METAL STRUCTURES
(STEEL OR ALUM. 1/8" MIN. THICK)
STEEL : Fy = 36 KSI MIN.
ALUMINUM : 6063-T5 MIN.

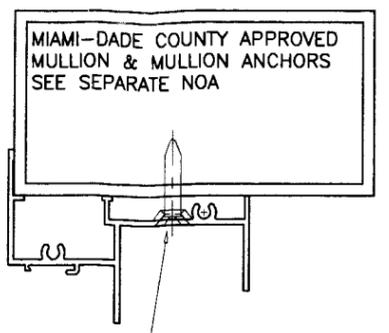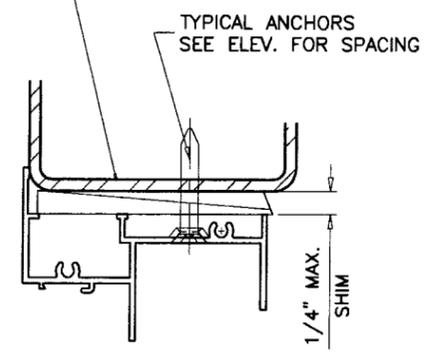

WOOD BUCKS AND METAL STRUCTURES NOT BY BELL-VIEW INC. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A' - 1/4" DIA. TAPCONS
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY WOOD BUCKS INTO
 3000 PSI MIN. CONC. AT HEAD/SILL
 C-90 GROUT FILLED BLOCK AT JAMBS
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

TYPE 'B' - 1/4" DIA. TAPCONS
 DIRECTLY INTO
 3000 PSI MIN. CONC. AT HEAD/SILL
 C-90 GROUT FILLED BLOCK AT JAMBS
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY


TYPE 'C' - #14 SMS OR SELF DRILLING SCREWS
 INTO METAL STRUCTURES (STEEL OR ALUMINUM 1/8" MIN. THICK.)
 STEEL : Fy = 36 KSI MIN.
 ALUMINUM : 6063-T5 MIN.
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPE 'D' - #10 SMS
 INTO DADE COUNTY APPROVED MULLIONS
 (MIN. 1/8" THK. ALUMINUM 6063-T5)
 (NO SHIM SPACE)

EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 1-1/2" MIN.
 INTO WOOD STRUCTURES = 1" MIN.

SEALANT:
 ALL JOINTS AND FRAME CONNECTIONS SEALED WITH SEALANT.

WEEPHOLES:
 W1 = 1-1/2" X 1/4" WEEPHOLES AT 2-1/2" FROM EACH END

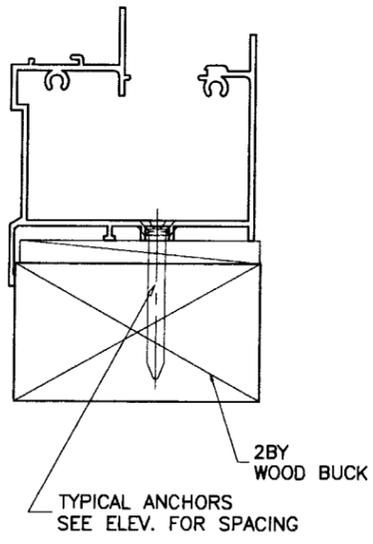

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 18557
 C.A.N. 3538

SEP 27 2006

Approved as complying with the
 Florida Building Code
 Date: JULY 20, 2006
 No. DA# 05-1222.06
 Miami Dade Product Control
 By: *Manuel Perez*




AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W05-24BVI

SERIES PA-25 ALUM. HORIZ. SLIDING WDW. (L.M.I.)
BELL-VIEW INC.
 150 INDUSTRIAL BLVD.
 WRIGHTSVILLE, GA. 31096
 TEL. (478) 864-2227 FAX. (478) 864-2492

revisions:	no	date	by	description

date: 05-24-05
 scale: 1/2" = 1'-0"
 dr. by: HAMID
 chk. by:

drawing no.
W05-24
 sheet 3 of 6

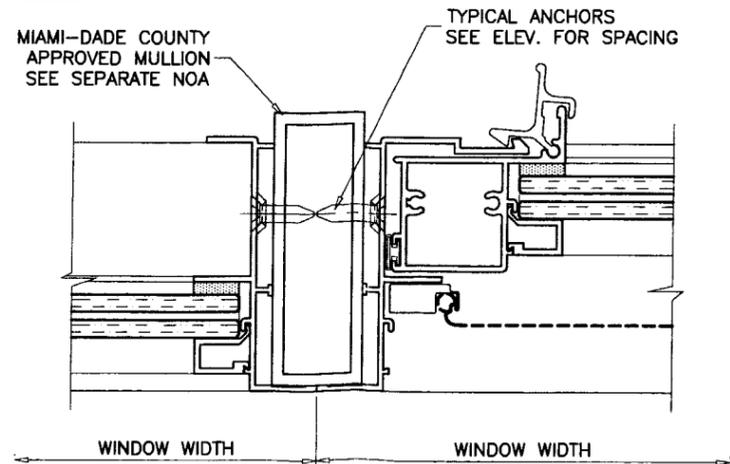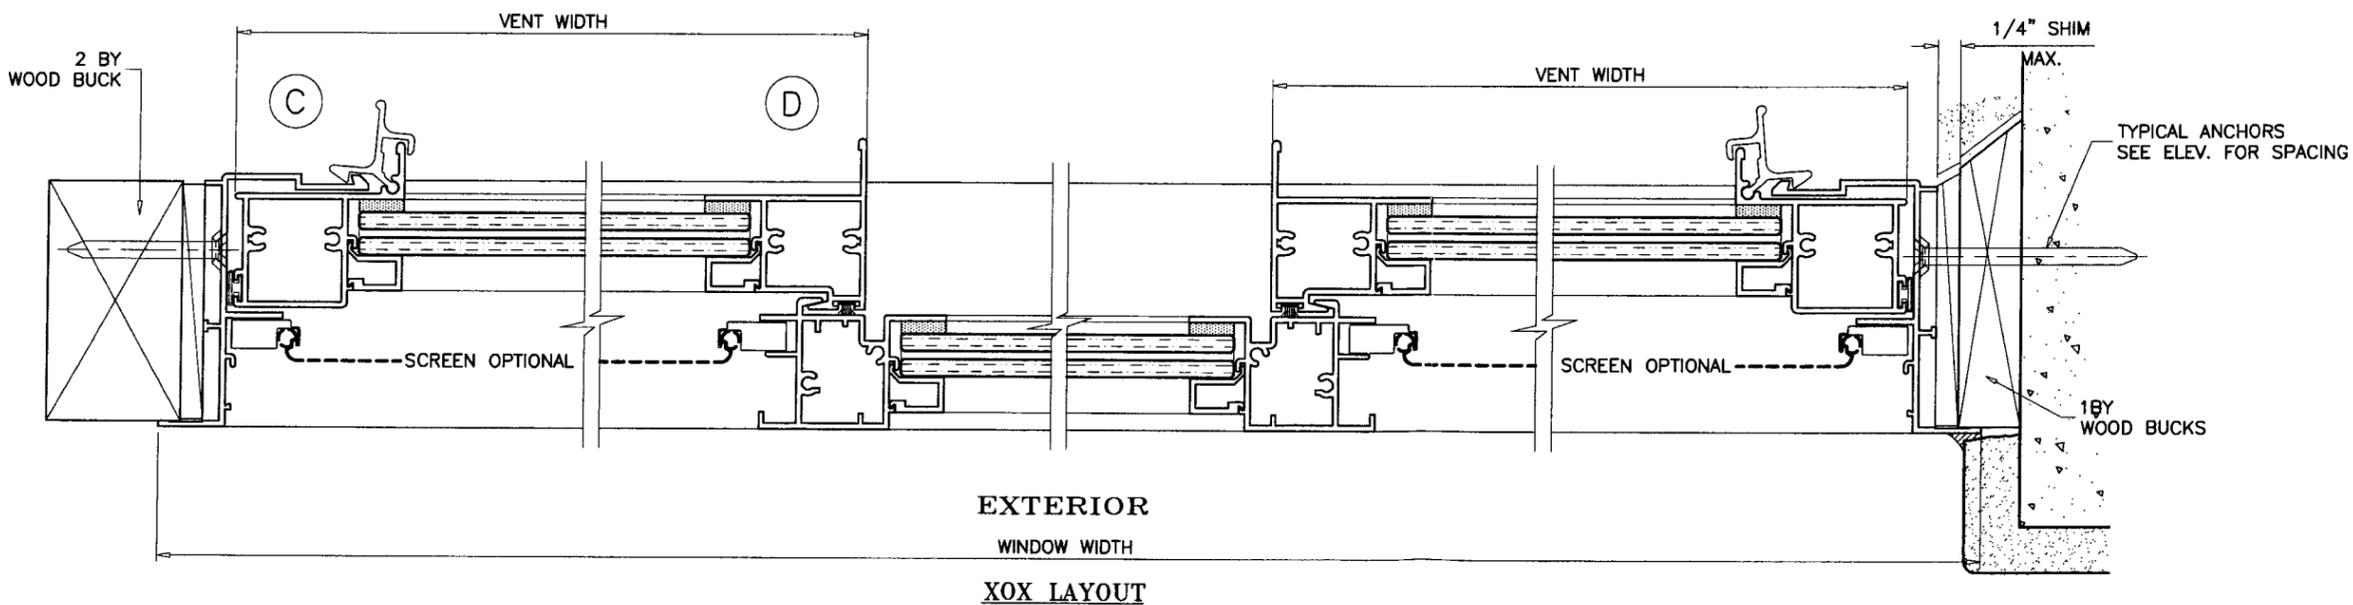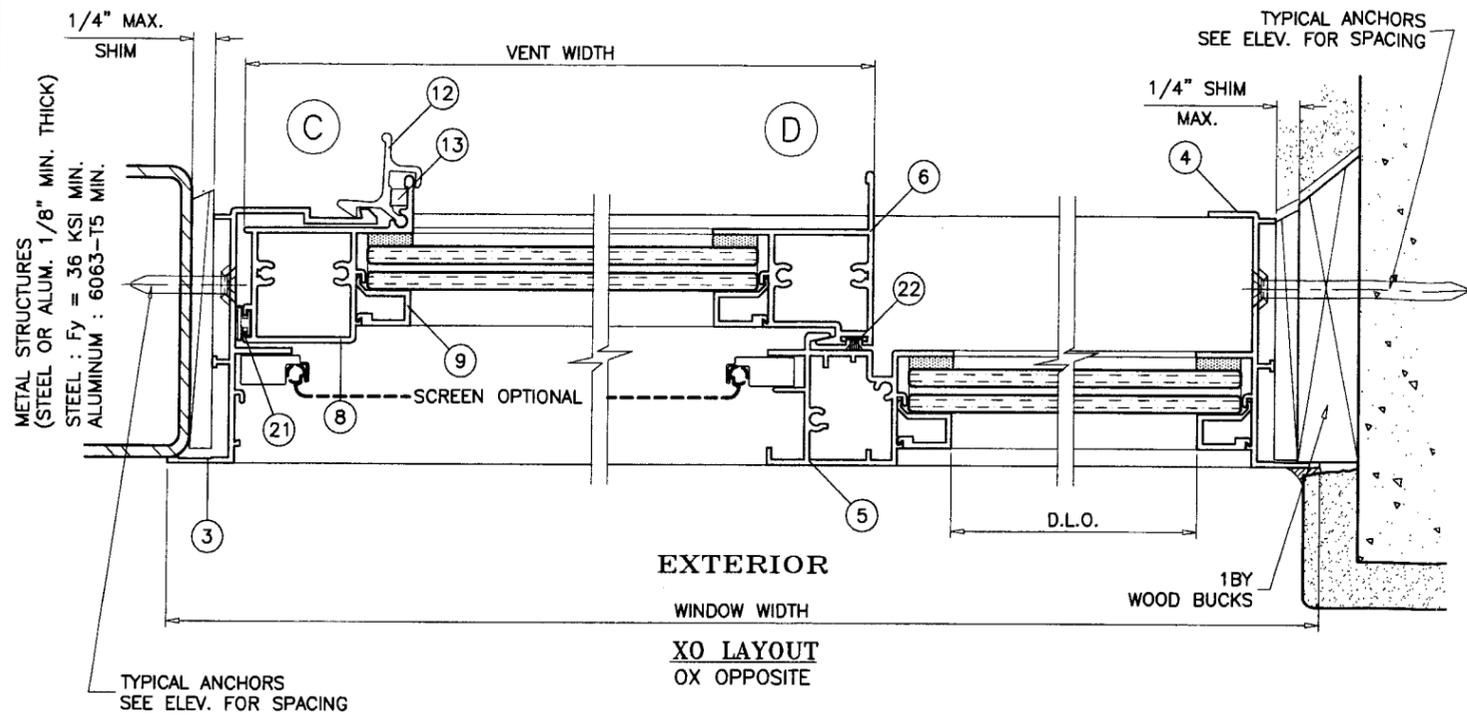

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

SEP 27 2006

Approved as complying with the
Florida Building Code
Date JULY 20, 2006
NOA# 05-1222-06
Miami Dade Product Control
Division
By: *Manuel Perez*

afsc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W05-24BVI


SERIES PA-25 ALUM HORIZ. SLIDING WDW. (L.M.I.)

BELL-VIEW INC.
150 INDUSTRIAL BLVD.
WRIGHTSVILLE, GA. 31096
TEL. (478) 864-2227 FAX. (478) 864-2492


revisions:	
no	date by description

date: 05-24-05
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:


drawing no.
W05-24
sheet 4 of 6

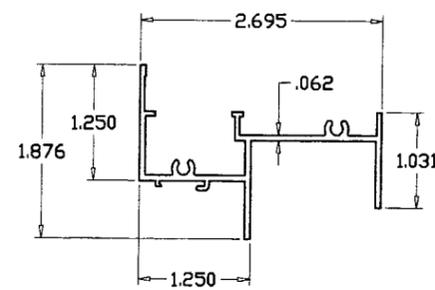


① FRAME HEAD

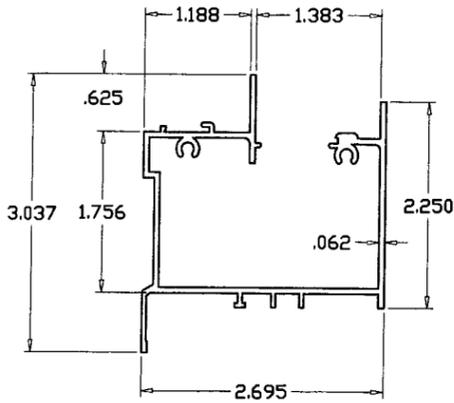


② FRAME SILL

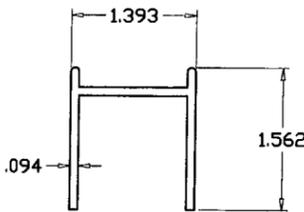


⑩ SILL TRACK




⑫ VENT LATCH




⑨ GLAZING BEAD




⑦ VENT TOP/BOTTOM RAIL

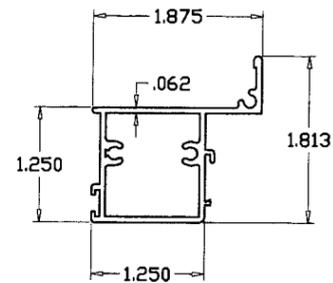


⑧ JAMB STILE

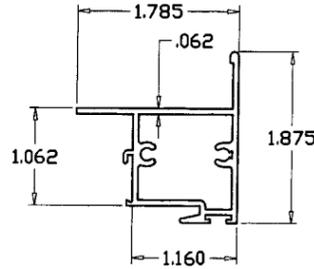


⑥ MEETING RAIL

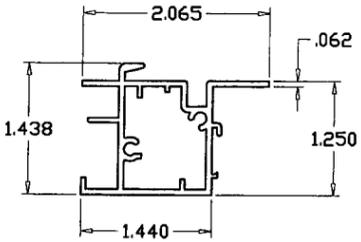

⑤ FIXED MTG. RAIL

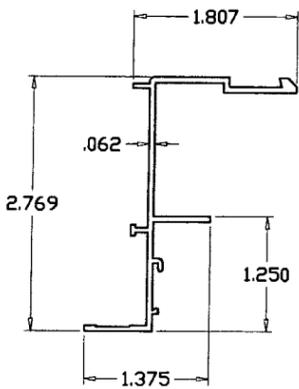

④ FRAME JAMB (FIX)

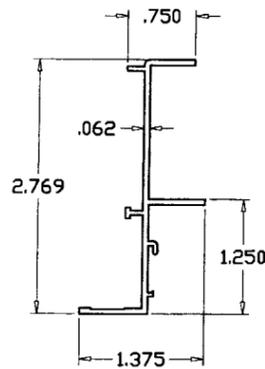

③ FRAME JAMB (VENT)

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	20-04	1	FRAME HEAD	6063-T5	-
2	25-07	1	FRAME SILL	6063-T5	-
3	25-03A	1	FRAME JAMB VENT	6063-T5	-
4	25-03	1	FRAME JAMB FIX.	-	-
5	20-02	1/	VENT FIXED RAIL	6063-T5	-
6	20-05	1/	VENT MEETING RAIL	6063-T5	-
7	20-07	2/	VENT TOP AND BOTTOM RAIL	6063-T5	-
8	20-06	1/	VENT JAMB STILE	6063-T5	-
9	20-22	AS REQD.	VENT GLAZING BEAD	6063-T5	-
10	25-06A	1	VENT SILL TRACK INSERT	6063-T5	-
11	-	-	-	-	-
12	14-89A	2/	VENT LATCH	6063-T5	AT 10-1/2" FROM ENDS
13	14-6010	1/	VENT LATCH SPRING	ST. STEEL	-
14	25-5001	4/	VENT ROLLER HOUSING & GUIDE	PLASTIC	-
15	25-5002	2/	VENT ROLLER	BRASS/ST. ST.	-
16	25-5003	2/	VENT ROLLER PIN	ST. STEEL	-
17	25-5004	AS REQD.	VENT BAFFLE	NYLON	-
18	#8 X 1"	AS REQD.	VENT FRAME/VENT ASSEMBLY SCREWS	CRS	P.H. SMS
19	#8 X 3"	2/	VENT FIX. RAIL SILL SCREWS (SILL END)	CRS	P.H. SMS
20	-	-	-	-	-
21	20-2001	AS REQD.	VENT BULB W'STRIPPING	FLEX PVC	-
22	4802100	AS REQD.	VENT WOOLPILE W'STRIPPING	-	ULTRAFAB OR EQUIV.
23	-	-	-	-	-
24	-	-	-	-	-
25	-	1/	VENT 5/16" BOX SCREEN	-	OPTIONAL
26	-	AS REQD.	VENT REINFORCING	STEEL	5/8" X 7/8"
27	-	AS REQD.	VENT FIX. RAIL REINFORCING	STEEL	13/32" X 1"

Engr: DR. HUMAYOUM FAROOQ
STRUCTURES
FLA. PE # 16537
C.A.N. 3538

SEP 27 2006

Approved as complying with the
Florida Building Code
Date: JULY 20, 2006
NOA# 05-1222-06
Miami Dade Product Control
Division
By: Manuel Perez


AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W05-24BVI

SERIES PA-25 ALUM HORIZ. SLIDING WDW. (L.M.I.)
BELL-VIEW INC.
150 INDUSTRIAL BLVD.
WRIGHTSVILLE, GA. 31096
TEL. (478) 864-2227 FAX. (478) 864-2492


revisions:	no	date	by	description

date: 05-24-05
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


drawing no.
W05-24
sheet 5 of 6

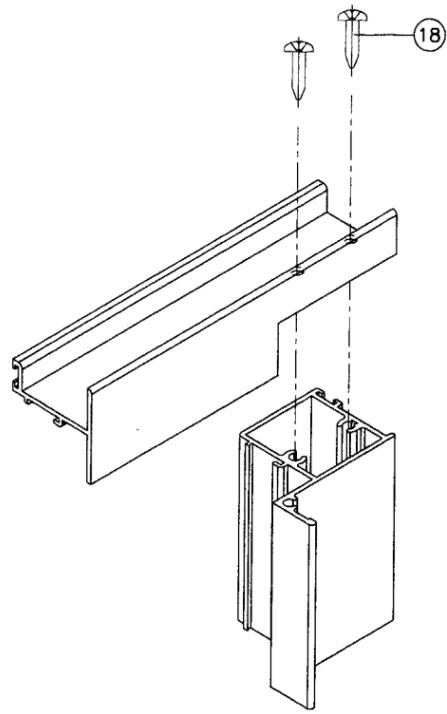


VENT TOP/BOTTOM CORNERS

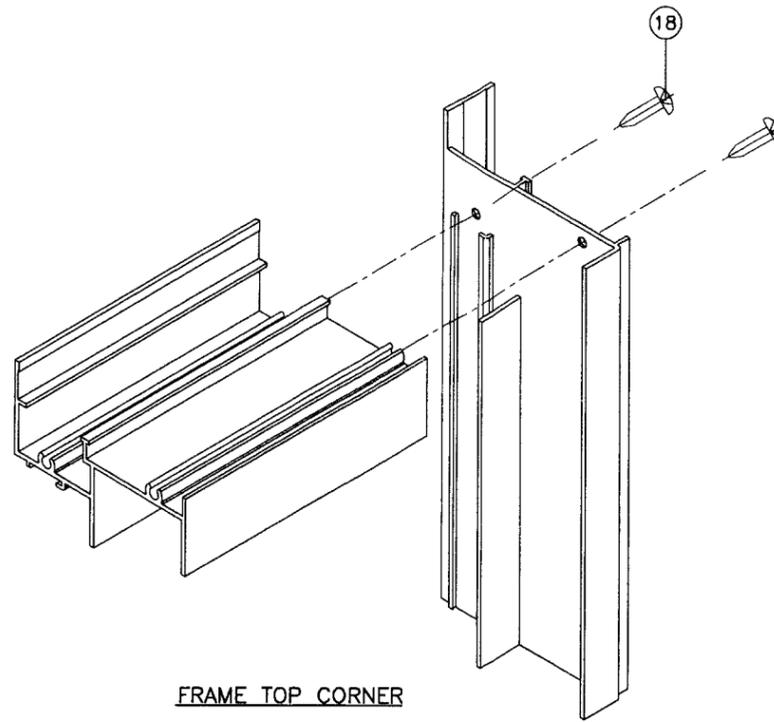

FRAME TOP CORNER

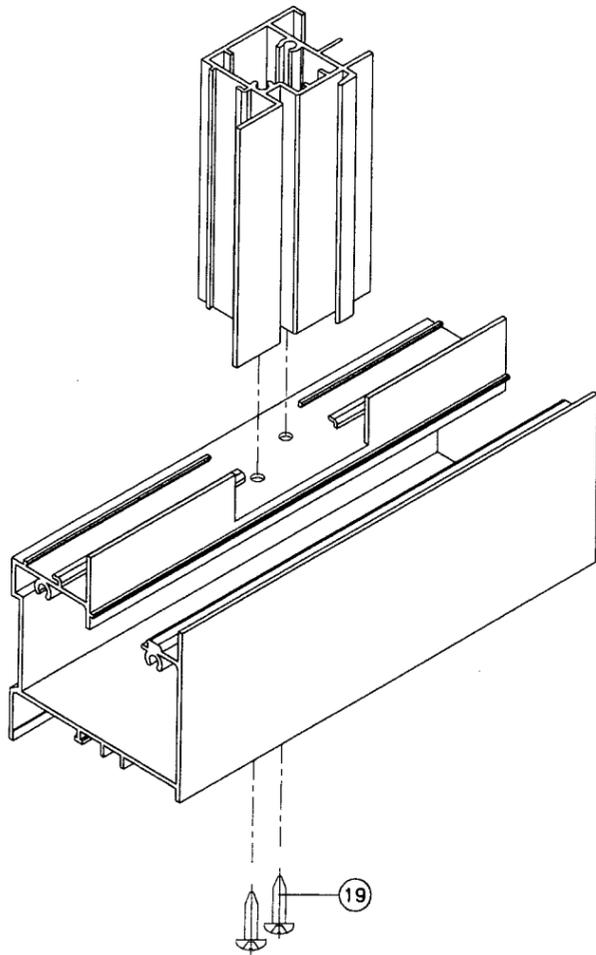

FIXED MTG. RAIL CORNER

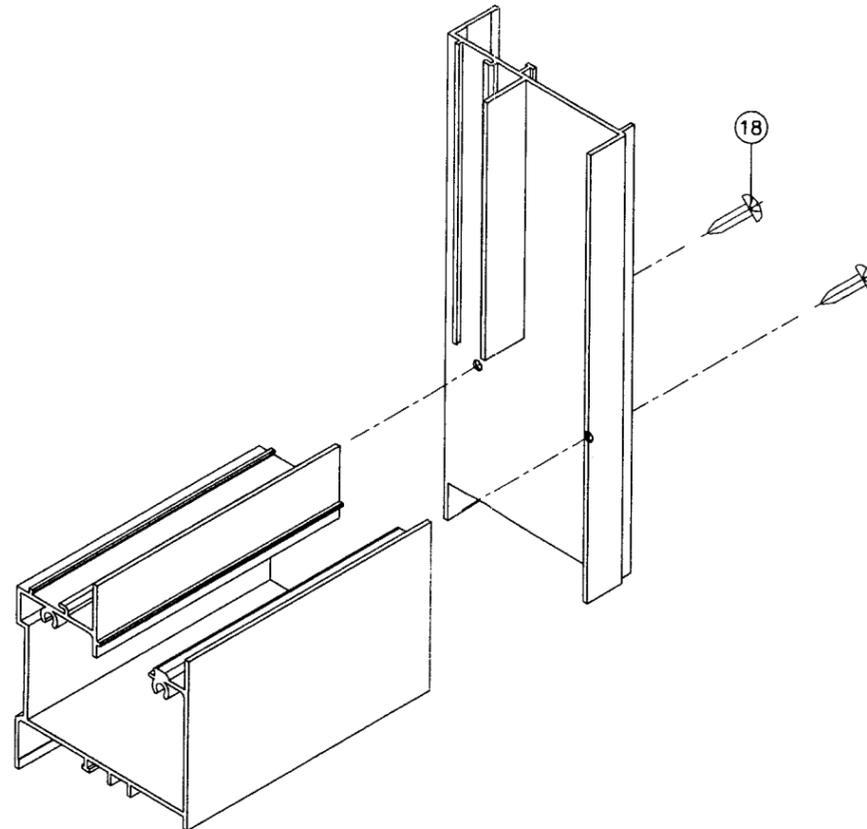

FRAME BOTTOM CORNER

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

J.P. 27 2006

Approved as complying with the
Florida Building Code
Date JULY 20, 2006
NOAH 05-1222.06
Miami Dade Product Control
Division
By: *Manuel Perez*

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W05-24BV

SERIES PA-25 ALUM HORIZ. SLIDING WDW. (L.M.I.)
BELL-VIEW INC.
150 INDUSTRIAL BLVD.
WRIGHTSVILLE, GA. 31096
TEL. (478) 864-2227 FAX. (478) 864-2492

revisions:	
no	date by description

date: 05-24-05
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W05-24

sheet 6 of 6