MIAMI-DADE

BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

RGM Products, Inc.
3441 S. Willow Avenue
Fresno, CA. 93725

SCOPE:
This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Ridglass High Profile Hip and Ridge Shingles

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 4.
The submitted documentation was reviewed by Alex Tigera.

PRODUCT CONTROL ACCEPTED

ROOFING ASSEMBLY APPROVAL

Category:	Roofing
Sub-Category:	Asphalt Shingles
Materials	Asphalt, Fiberglass
Deck Type:	Wood

1. SCOPE

This approves Ridglass High Profile Hip & Ridge Shingle as manufactured by RGM Products, Inc. described in Section 2 of this Notice of Acceptance.

2. PRODUCT DESCRIPTION

Product	Dimensions	Test Specifications	Product Description
Ridglass High Profile Hip & Ridge Shingle – 8" Wide	8" x 23"	TAS 110	Prefabricated hip and ridge fiberglass reinforced asphalt shingle.
Ridglass High Profile Hip & Ridge Shingle – 10" Wide	10" x 23"	TAS 110	Prefabricated hip and ridge fiberglass reinforced asphalt shingle.
Ridglass High Profile Hip & Ridge Shingle – 12" Wide	12" x 23"	TAS 110	Prefabricated hip and ridge fiberglass reinforced asphalt shingle.

3. PRODUCTS MANUFACTURED BY OTHERS

Product	Product Description	Size	Manufacturer
Henry 209 Elastomastic	Mastic adhesive	various	Allied Building Products

4. EVIDENCE SUBMITTED:

Test Agency	Test Identifier	Test Name/Report	Date
PRI Asphalt Technologies, Inc.	RMC-021-02-01	TAS 100	02/06/06
Underwriters Laboratories, Inc.	05NK27924	ASTM D3462	02/10/06
Underwriters Laboratories, Inc.	02NK42802	TAS 107	11/04/02

5. LIMITATIONS

5.1 Fire classification is not part of this acceptance; refer to a current Approved Roofing Materials Directory for fire ratings of this product.

5.2 Shall not be installed on roof mean heights in excess of 33 ft.

6. INSTALLATION

6.1 Hip and Ridge shingles shall be installed in compliance with Roofing Application Standard RAS 115.

6.2 Flashing shall be in accordance with Roofing Application Standard RAS 115

6.3 The manufacturer shall provide clearly written application instructions.

6.4 Henry 209 Mastic Adhesive must be used in the application of this product as specified in Detail A.

6.5 Exposure and course layout shall be in compliance with Detail 'A', attached.

7 LABELING

7.2 Hip and Ridge shingles shall be labeled with the Miami-Dade Logo or the wording "Miami-Dade County Product Control Approved".

8 BUILDING PERMIT REQUIREMENTS

8.2 Application for building permit shall be accompanied by copies of the following:

8.2.1 This Notice of Acceptance.

8.2.2 Any other documents required by the Building Official or the applicable code in order to properly evaluate the installation of this system.

DETAIL A

1. NAILING SCHEDULE:
Nails must be galvanized 11 or 12 guage with heads at least 7/16" in diameter. All fasteners must penetrate at least 3/4" into the wood deck or completely through plywood sheathing.

2. STARTER SHINGLE INSTALLATION:
To create a **starter shingle**, cut off the 8" exposed portion of a full hip and ridge shingle leaving the dimensional fold portion, which will be approximately 8 1/2 inches long. Starting at the eaves for hips and opposite the prevailing wind for ridges, install **starter shingle**. Apply six spots of asphalt roofing cement approximately 1/2" in diameter. Fasten through the dimensional fold with two nails on each side of **starter shingle**.

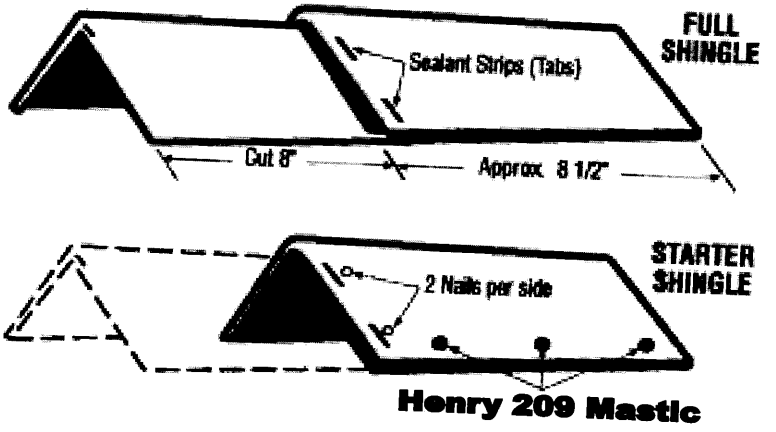

3. HIP AND RIDGE INSTALLATION:
Beginning with a complete **hip and ridge shingle**, cover starter shingle with the 8" exposed portion overlapping the front end of the starter shingle by 1/4" and nail into place. Two nails should be applied on each side of hip and ridge shingle 9" back from exposed end and 1" and 2" in from each side.

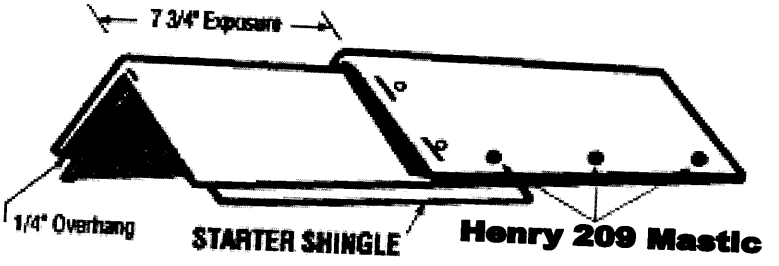

To proceed, overlap the first hip and ridge shingle extending 1/4" past dimensional fold with complete hip and ridge shingle, apply asphalt roofing cement, then nail shingle through dimensional fold. Continue installation in same fashion obtaining a 7 3/4" finished exposure.

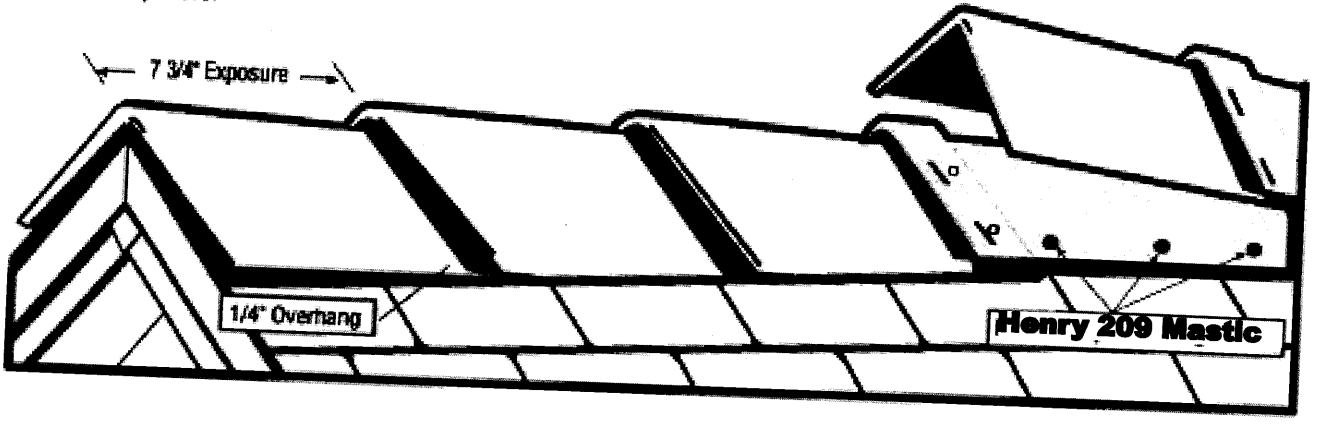

END OF THIS ACCEPTANCE