



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING

140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

www.buildingcodeonline.com

NOTICE OF ACCEPTANCE (NOA)

General Screen Service Corp.
5033 SW 151st Place
Miami, Florida 33185

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Aluminum Framed Screen Enclosure

APPROVAL DOCUMENT: Drawing titled "Screen Enclosure Specs", prepared by Ramms Engineering, Inc., dated 12/31/2001, sheet 1 of 3, dated 03/28/2005, sheet 2 of 3, and dated 06/06/1995, sheet 3 of 3, all sheets signed and sealed by Robert S. Monsour, P.E. on 04/01/2005, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: A permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", shall be attached to the bottom of each chair rail.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 05-0531.02** and consists of this page 1, evidence submitted pages E-1, E-2, and E-3 as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E.**



Helmy A. Makar
 04/27/2006

NOA No 06-0331.08
Expiration Date: 12/16/2010
Approval Date: 04/27/2006
Page 1

General Screen Service Corp.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #97-0804.02

A. DRAWINGS

Drawing Number Sheet Number	Drawing Date Latest Revision Date	Signed and Sealed By Date
3005 Sheet 1 of 3	August 30, 1994 Revised: June 12, 1995	Robert S. Monsour, P.E. June 12, 1995
3005 Sheet 2 of 3	August 30, 1994 Revised: June 12, 1995	Robert S. Monsour, P.E. June 12, 1995
3005 Sheet 3 of 3	June 6, 1995	Robert S. Monsour, P.E. June 12, 1995

B. TESTS

Test Laboratory	Construction Testing Corporation
Test Number	CTC 95-013
Test Results	1,480 lbs positive or negative wind load on 5 in. Aluminum Super Gutter.
Test Signature	Christopher G. Tyson, P.E.
Test Date(s)	May 1, 1995

Test Laboratory	Construction Testing Corporation
Test Number	CTC 95-019
Test Results	1,100 lbs positive or negative wind load on 4 in. Aluminum Super Gutter.
Test Signature	Christopher G. Tyson, P.E.
Test Date(s)	May 1, 1995

Test Laboratory	Construction Testing Corporation
Test Number	CTC 94-011
Test Results	1,015 lbs tension wind load on 1/8 in. steel cable.
Test Signature	Christopher G. Tyson, P.E.
Test Date(s)	November 15, 1994

C. CALCULATIONS

Signature	Date
Robert S. Monsour, P.E.	April 18, 1994
Robert S. Monsour, P.E.	April 21, 1994
Robert S. Monsour, P.E.	October 6, 1994
Robert S. Monsour, P.E.	June 12, 1995



Helmy A. Makar, P. E.
Product Control Examiner
NOA No 06-0331.08
Expiration Date: 12/16/2010
Approval Date: 04/27/2006

General Screen Service Corp.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- 2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #00-1116.03**
- A. DRAWINGS**
1. *None.*
- B. TESTS**
1. *None.*
- C. CALCULATIONS**
1. *None.*
- D. MATERIAL CERTIFICATIONS**
1. *None.*
- E. STATEMENTS**
1. *Letter dated 08/15/2000, requesting renewal of NOA No. 97-0804.02 and stating that the product has not changed, prepared by General Screen Service Company.*
2. *Letter prepared by Ramms Engineering, Inc., dated January 3, 2001, signed and sealed by Robert S. Monsour, P.E., stating that he is still in the engineering business.*
- 3. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 05-0531.02**
- A. DRAWINGS**
1. *Drawing titled "Screen Enclosure Specs", prepared by Ramms Engineering, Inc., dated 12/31/2001, sheet 1 of 3, dated 03/28/2005, sheet 2 of 3, and dated 06/06/1995, sheet 3 of 3, all sheets signed and sealed by Robert S. Monsour, P.E. on 04/01/2005.*
- B. TESTS**
1. *None.*
- C. CALCULATIONS**
1. *Calculation prepared by Ramms Engineering, Inc., dated April 05, 2005, 41 pages, signed and sealed by Robert S. Monsour, P.E.*
- D. QUALITY ASSURANCE**
1. *By Miami-Dade County Building Code Compliance Office.*
- E. MATERIAL CERTIFICATIONS**
1. *None.*



Helmy A. Makar, P. E.
Product Control Examiner
NOA No 06-0331.08
Expiration Date: 12/16/2010
Approval Date: 04/27/2006

General Screen Service Corp.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

4. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. *None.*

B. TESTS

1. *None.*

C. CALCULATIONS


1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *None.*



Helmy A. Makar, P. E.
Product Control Examiner
NOA No 06-0331.08
Expiration Date: 12/16/2010
Approval Date: 04/27/2006

COASTAL & NON-COASTAL ZONE ASCE 7-02 146 MPH EXP. "C"

FLAT SPAN BEAM SCHEDULE BASED ON 10 PSF ROOF LOAD ACTING ALONE

MARK	SIZE	T1	T2	TYPE	MAX. BEAM SPANS AT GIVEN SPACINGS							
					5'-0"	5'-6"	6'-0"	6'-6"	7'-0"	7'-6"	8'-0"	
Box Bm.	2 x 2	.045	.045	HOLLOW	6'-0"	5'-8"	5'-5"	5'-2"	5'-0"	4'-9"	4'-8"	
Box Bm.	2 x 3	.045	.045	HOLLOW	8'-0"	7'-7"	7'-2"	7'-0"	6'-8"	6'-5"	6'-2"	
Box Bm.	2 x 4	.100	.045	LAP	13'-4"	13'-0"	12'-4"	11'-10"	11'-5"	11'-0"	10'-8"	
Box Bm.	2 x 5	.116	.050	LAP	16'-5"	15'-8"	15'-0"	14'-4"	13'-10"	13'-4"	13'-0"	
Box Bm.	2 x 6	.120	.050	LAP	17'-0"	16'-2"	15'-5"	14'-10"	14'-3"	13'-9"	13'-4"	
Box Bm.	2 x 7	.220	.055	LAP	22'-0"	20'-10"	20'-0"	19'-2"	18'-5"	17'-10"	17'-3"	
Box Bm.	2 x 8	.224	.072	LAP	26'-5"	25'-2"	24'-1"	23'-2"	22'-3"	21'-6"	20'-10"	
Box Bm.	2 x 9	.306	.082	LAP	32'-8"	31'-1"	29'-9"	28'-7"	27'-6"	26'-7"	25'-9"	
Box Bm.	2 x 10	.389	.092	LAP	38'-5"	36'-9"	35'-1"	33'-9"	32'-6"	31'-4"	30'-4"	

MANSARD BEAM SCHEDULE COMBINED LOAD OF 7.4 PSF ROOF & 24.42 PSF WALL ACTING SIMULTANEOUSLY

MARK	SIZE	T1	T2	TYPE	MAX. COLUMN HEIGHTS AT GIVEN SPACINGS							
					5'-0"	5'-6"	6'-0"	6'-6"	7'-0"	7'-6"	8'-0"	
Box Bm.	2 x 7	.220	.055	LAP	18'-5"	16'-8"	15'-2"	13'-9"	12'-4"	11'-0"	9'-9"	
Box Bm.	2 x 8	.224	.072	LAP	25'-3"	23'-3"	21'-10"	20'-5"	19'-0"	17'-10"	16'-8"	
Box Bm.	2 x 9	.306	.082	LAP	32'-5"	30'-3"	28'-5"	26'-9"	25'-3"	23'-10"	22'-6"	
Box Bm.	2 x 10	.389	.092	LAP	38'-5"	36'-9"	35'-1"	33'-9"	32'-5"	30'-9"	29'-3"	

NOTE: BEAM SPANS SHOWN ABOVE WERE REDUCED TO COMPENSATE FOR AXIAL COMPRESSION LOADS.

PURLIN TABLE HEAVY LINE INDICATES MAXIMUM SPAN FOR 4" GUTTER "Z" BRACKET. NO LIMIT TO 5" GUTTER MEGA BRACKET.

MARK	SIZE	T1	T2	TYPE	MAXIMUM SPAN
2 x 2	.045	.045	HOLLOW	MAXIMUM SPAN = 7'-0" AS PURLIN AND CHAIRRAIL	
2 x 3	.045	.045	HOLLOW	MAXIMUM SPAN = 8'-0" AS PURLIN AND CHAIRRAIL	

NOTE: MAXIMUM SPACING OF PURLINS = 84". MAXIMUM AREA IN ANY PANEL = 56 SQ. FT. MAXIMUM SPACING OF 2X2 CHAIRRAILS = 66" AVG. SPANS SHOWN ABOVE ARE CLEAR SPANS. 4" MAY BE ADDED TO EACH SPAN SHOWN.

MARK	SIZE	T1	T2	TYPE	MAX. COLUMN HEIGHTS AT GIVEN SPACINGS							
					5'-0"	5'-6"	6'-0"	6'-6"	7'-0"	7'-6"	8'-0"	
Box Col.	2 x 4	.100	.045	LAP	7'-11"	7'-7"	7'-2"	6'-11"	6'-8"	6'-5"	6'-3"	
Box Col.	2 x 5	.116	.050	LAP	9'-2"	8'-8"	8'-4"	8'-0"	7'-8"	7'-5"	7'-3"	
Box Col.	2 x 6	.120	.050	LAP	9'-3"	8'-10"	8'-5"	8'-1"	7'-10"	7'-7"	7'-4"	
Box Col.	2 x 7	.220	.055	LAP	12'-6"	11'-11"	11'-5"	11'-0"	10'-7"	10'-3"	9'-11"	
Box Col.	2 x 8	.224	.082	LAP	15'-9"	15'-0"	14'-4"	13'-9"	13'-3"	12'-10"	12'-5"	

NOTE: MAX SPACING OF CHAIRRAILS IS 66" SPANS SHOWN ABOVE ARE CLEAR SPANS. 4" MAY BE ADDED TO EACH SPAN SHOWN. 2X3 AND 2X4 NON-LOAD BEARING BOX COLUMNS MAY BE INCREASED AN ADDITIONAL 4% TO THE HEIGHTS SHOWN ABOVE. ALL OTHER COLUMNS TO REMAIN THE SAME.

NOTES:

- 1) ROOF AND SIDES SHALL BE COVERED WITH SCREEN CLOTH BEING 60% OPEN OR GREATER ONLY.
- 2) THE EXISTING STRUCTURE MUST BE CAPABLE OF SUPPORTING THE LOADED SCREEN ENCLOSURE.
- 3) METAL STRUCTURES WITHIN 5 FT. OF SWIMMING POOLS SHALL BE GROUNDED PR N.E.C. 680-22
- 4) ANCHORS TO CONCRETE & MASONRY SHALL BE 3/8" X 3" ANCHORS OR APPROVED EQUAL UNLESS OTHERWISE SPECIFIED.
- 5) CONSULT ENGINEER OF RECORD FOR CONDITIONS EXCEEDING THESE SPECS.


DESIGN CRITERIA: FLORIDA BUILDING CODE, 2004

ASCE 7-02 EXPOSURE "C"
 WALLS DESIGN WIND LOAD IN & OUT ----- 24.42 PSF
 TEST LOAD WIND IN & OUT ----- 36.83 PSF
 ROOF LIVE LOAD UP & DOWN ----- 10.0 PSF
 TEST LOAD UP & DOWN ----- 15.0 PSF
 DEFLECTION LIMITATION ----- L/80
 ALUMINUM ALLOY 6063-T6 UNLESS OTHERWISE SPECIFIED.


CARRY BEAM TABLE

CLEAR SPAN OF 2 X 7 CARRY BEAM	MAX SPAN OF SCREEN ENCLOSURE	CLEAR SPAN OF 2 X 8 CARRY BEAM	MAX. SPAN OF SCREEN ENCLOSURE
10'-0"	MAXIMUM	14'-0"	MAXIMUM
12'-0"	26'-5"	16'-0"	34'-5"
14'-0"	17'-4"	18'-0"	25'-6"
16'-0"	10'-9"	20'-0"	16'-9"
18'-0"	5'-2"	22'-0"	10'-7"


MAXIMUM SPAN SHOWN IN BEAM TABLE ABOVE.

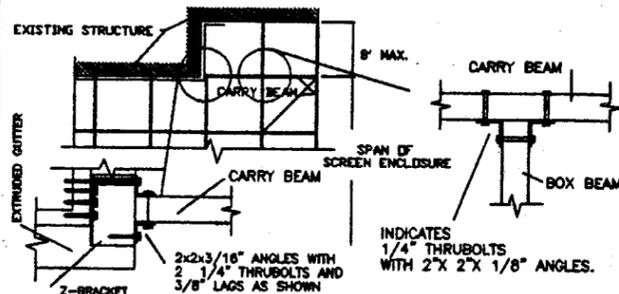


TYP. CROSS SECTIONS




SNAP BEAM





LAP-BEAM




2 X 2 PURLIN




1 X 2 PATIO

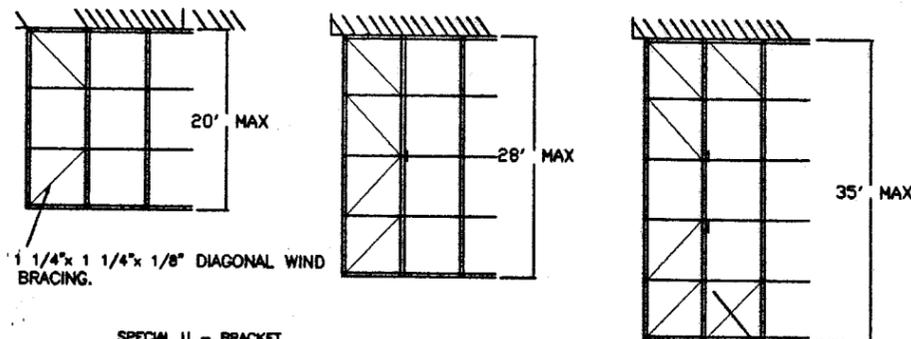

ROOF BRACING LAYOUT

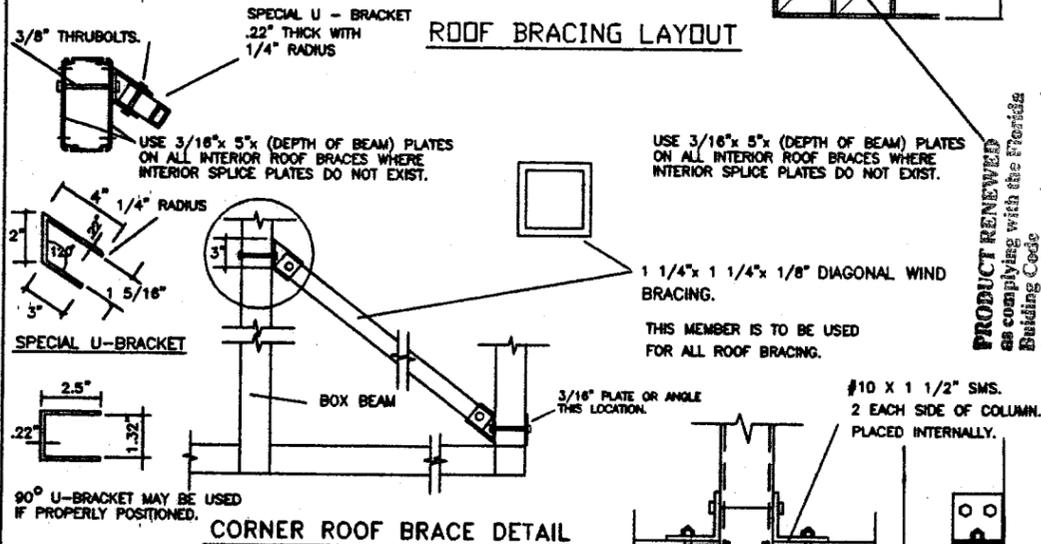

DETAIL OF ANCHORING TO FOOTING

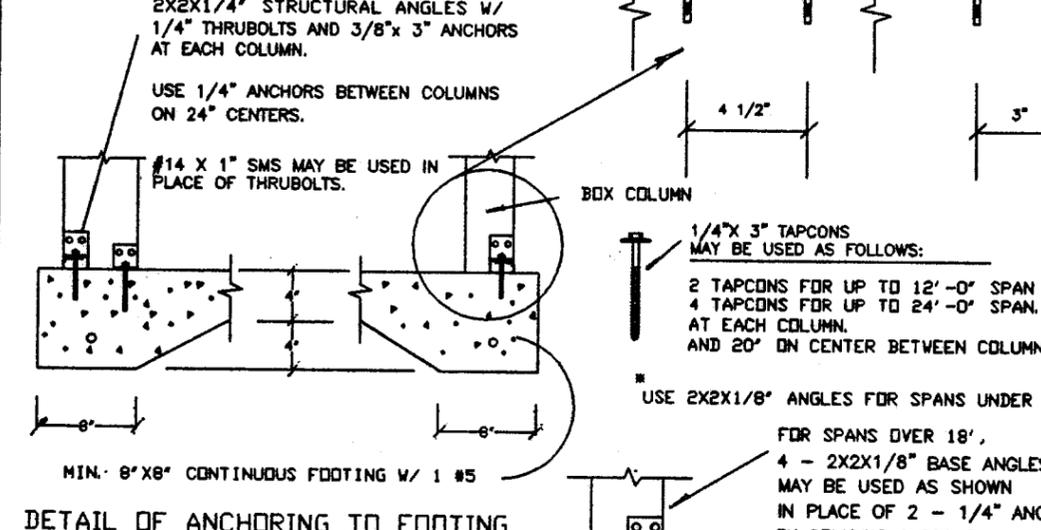

ANCHOR BOLTS TO EXTEND 1 1/4" BEYOND CHATT. OR BRICK PAVEMENT SURFACES

NOTE: COLUMNS ALONG END WALLS REQUIRE ONE PAIR OF 2X2X1/8" ANGLES UNLESS COLUMNS ARE 2X5 OR GREATER. THEN TWO PAIR OF ANGLES ARE REQUIRED

REPRODUCTION AND APPROVAL OF THIS PLAN OR ANY PART THEREOF FOR CONSTRUCTION OR ANY OTHER USE SHALL BE DONE BY RAMMS ENGINEERING, INC.

THIS PLAN IS INVALID UNLESS SIGNED AND SEALED BY ROBERT S. MONSOUR FOR EACH PERMIT SUBMITTAL

PRODUCT RENEWED as complying with the Florida Building Code Acceptance No. 05-0531-08 Expiration Date 12/16/2010 By Helmut A. Mohr Miami Dade Product Control Division

RAMMS ENGINEERING, INC. Structural Design 2100 W. 76th STREET, SUITE 311 MIAMI, FLORIDA 33149 P.E. No. 11955

Screen Enclosure Specs General Screen 5033 SW 151 Place Miami, FL


DESIGNED BY R.S.M. DRAWN BY R.S.M. DATE 12-31-01 SCALE AS SHOWN. AFF2/SPEC

REVISIONS	BY:

RAMMS ENGINEERING, INC.
Structural Design
 2100 W. 79th STREET, SUITE 311
 MIAMI, FLORIDA 33166
 P.E. No. 11955
 EB 0006024

Screen Enclosure Specs
 General Screen
 5033 SW 151 Place
 Miami, FL

DESIGNED BY	R.S.M.
DRAWN BY	R.S.M.
DATE	3-28-05
SCALE	AS SHOWN.
BY	RAMMS 2
2	

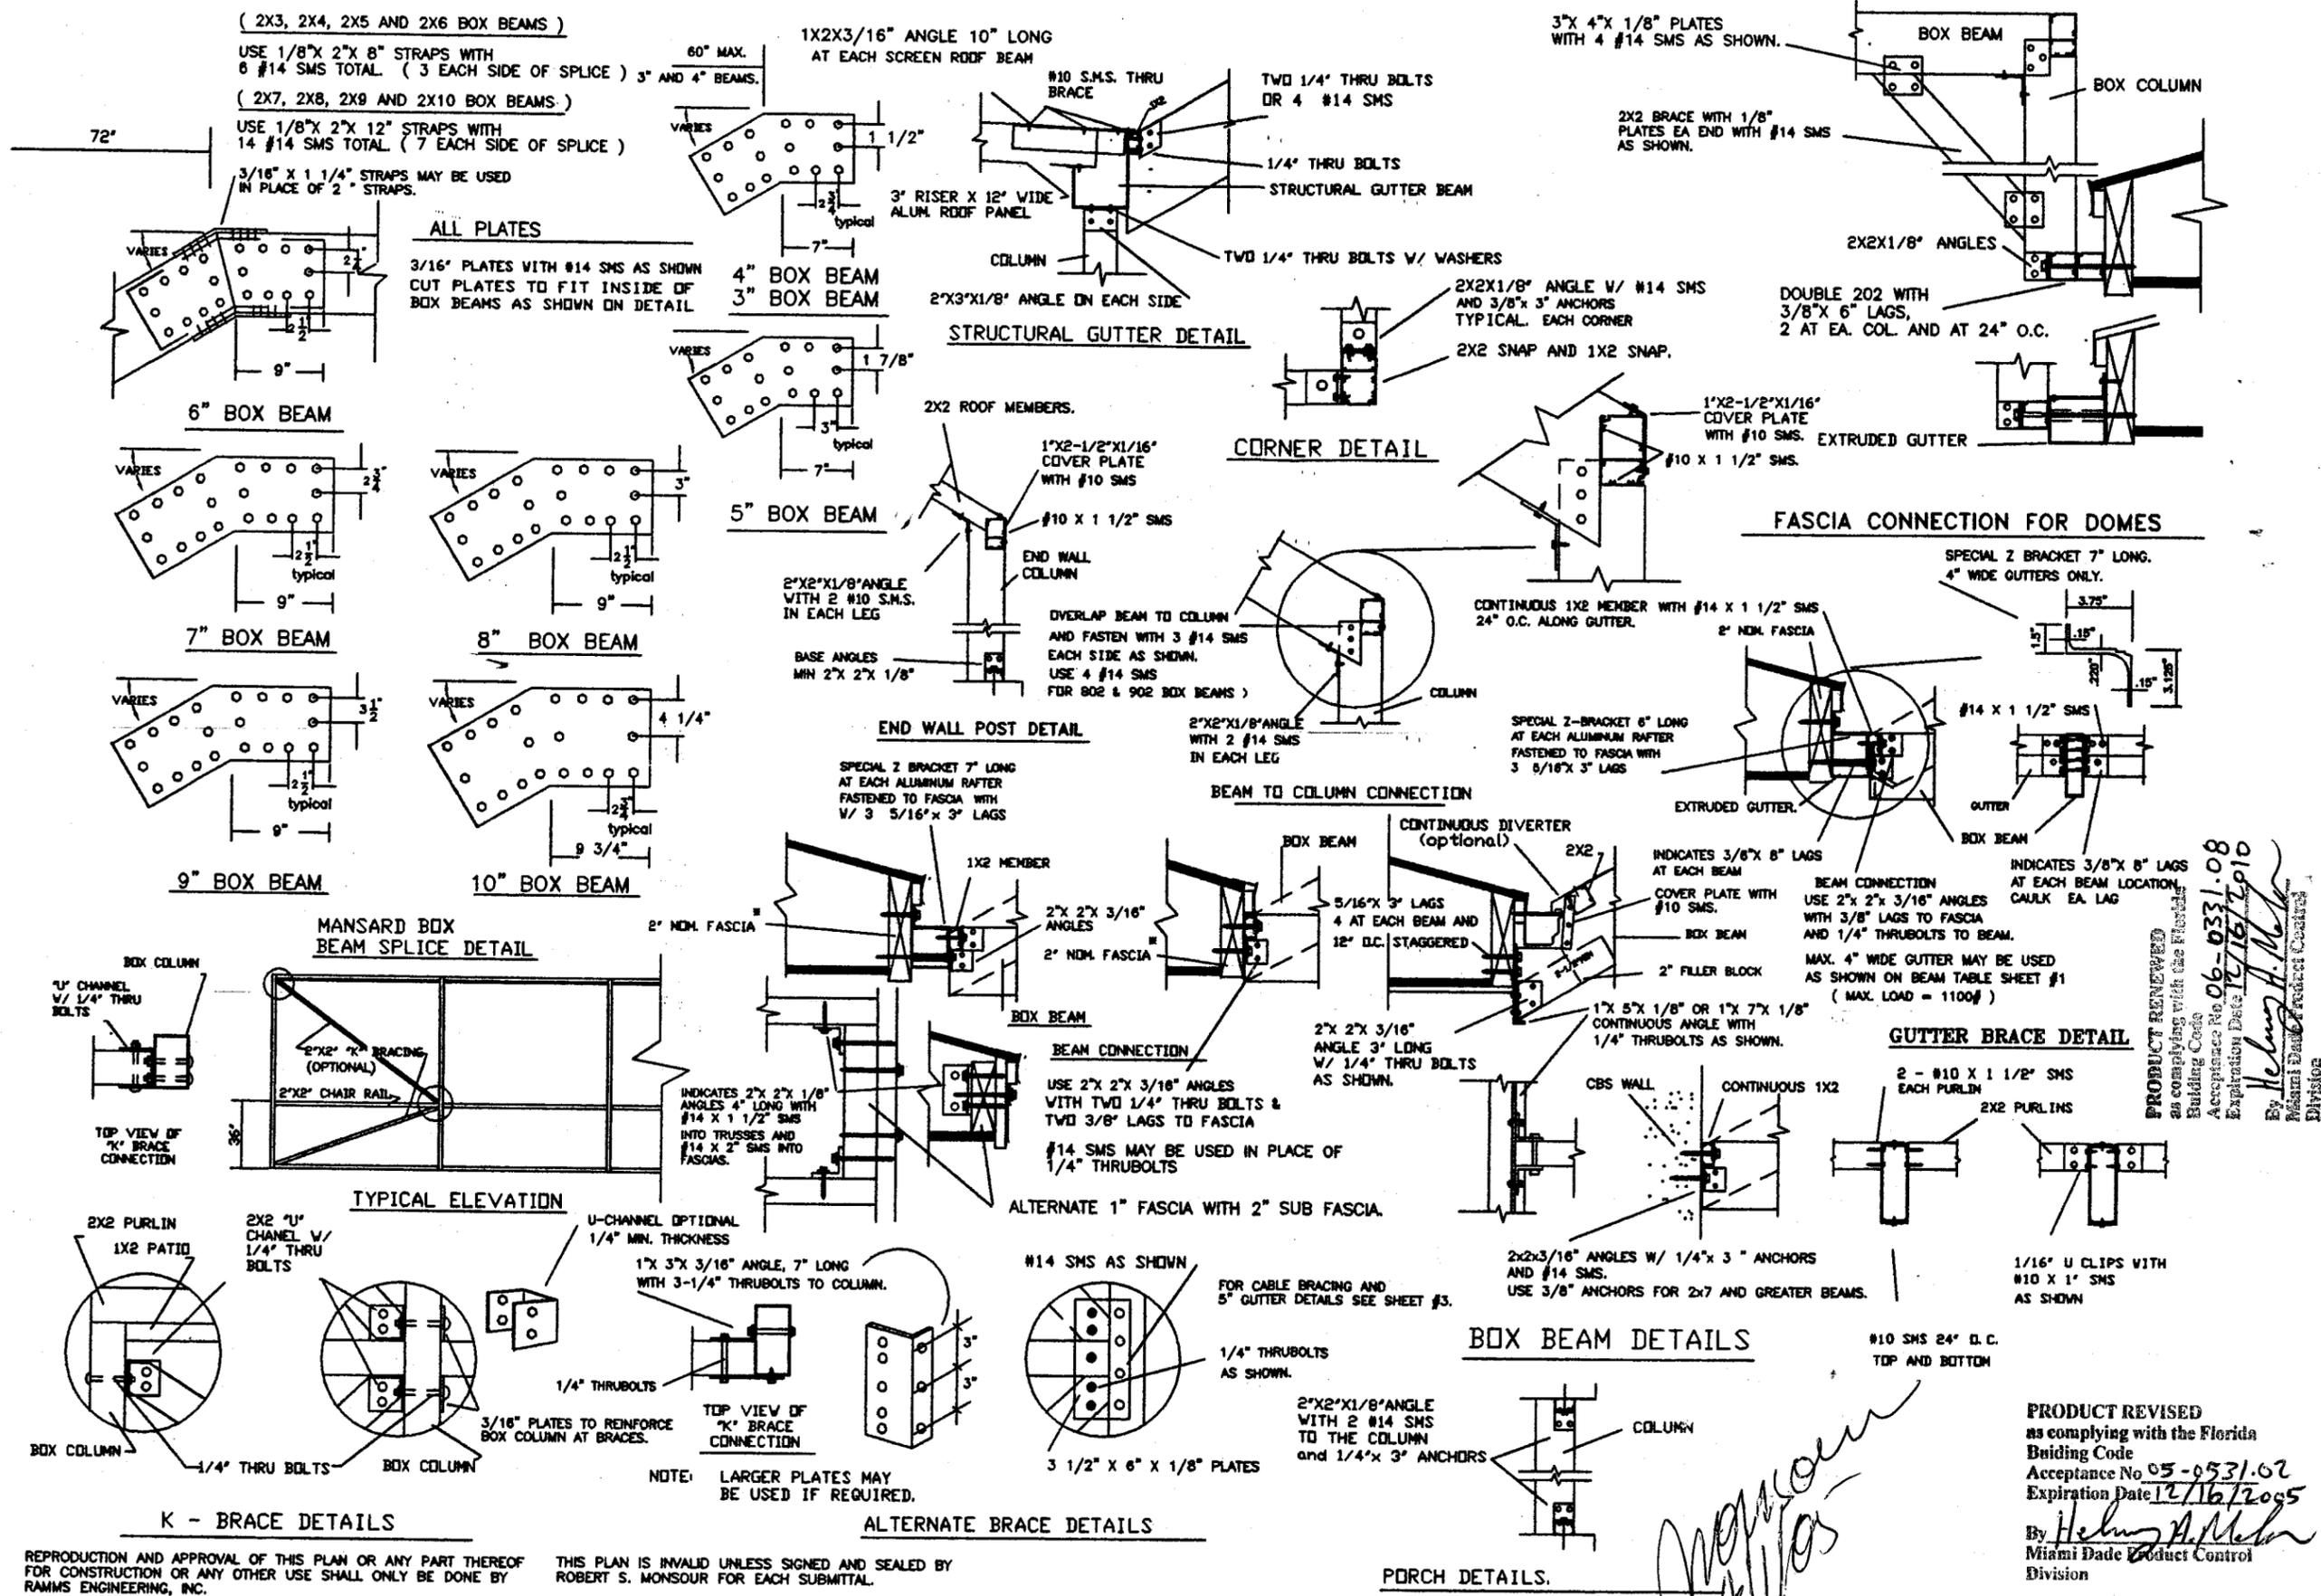


PRODUCT REVIEWED
 as complying with the Florida
 Building Code
 Acceptance No 06-0331-08
 Expiration Date 12/16/2010
 By Helmut A. Mohr
 Miami Dade Product Control
 Division

REPRODUCTION AND APPROVAL OF THIS PLAN OR ANY PART THEREOF FOR CONSTRUCTION OR ANY OTHER USE SHALL ONLY BE DONE BY RAMMS ENGINEERING, INC.

THIS PLAN IS INVALID UNLESS SIGNED AND SEALED BY ROBERT S. MONSOUR FOR EACH SUBMITTAL.



Robert S. Monsour

SPECIAL Z BRACKET 7" LONG.
4" WIDE GUTTERS ONLY.

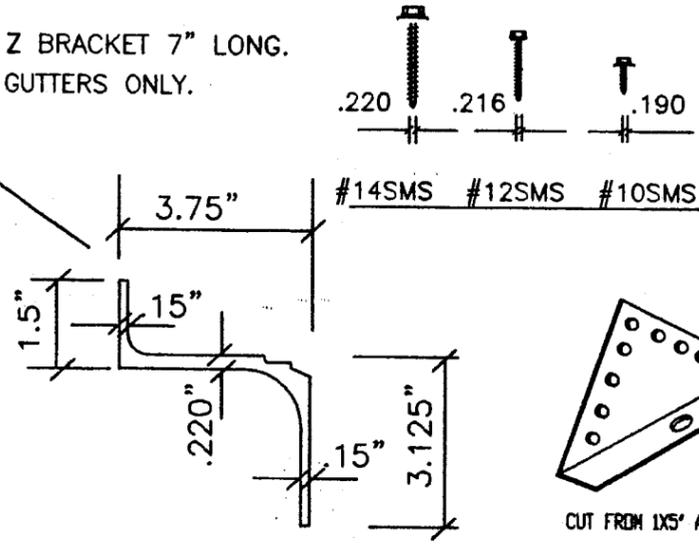


4" Z-BRACKET

6" SUPER BRACKET WITH (4) 3/8" X 2 1/2" LAG BOLTS TO FASCIA

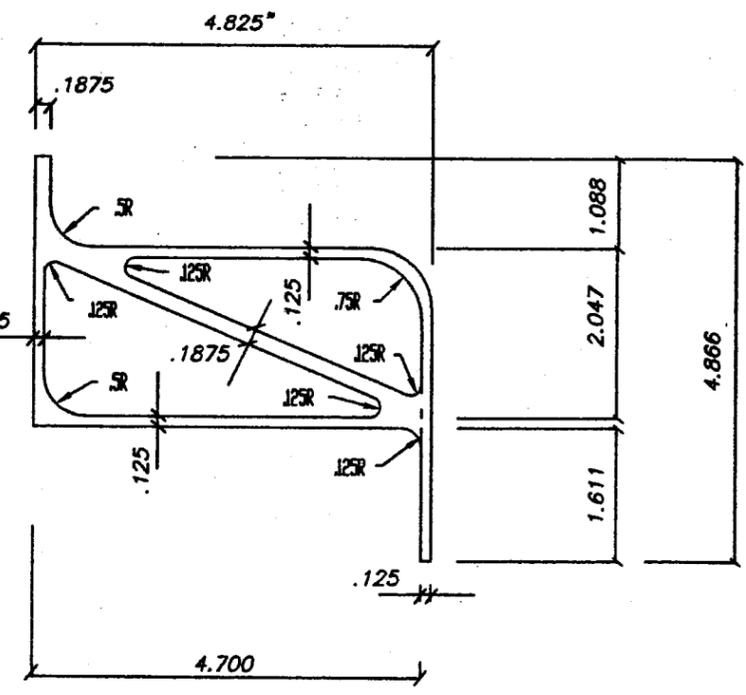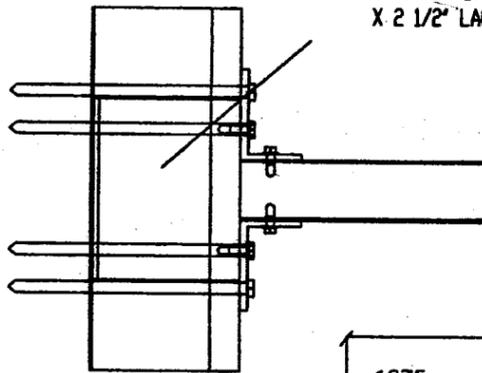


ALTERNATE GUTTER SIZE.

1/8" ANGLE BRACKET WITH (9) #14 X 3/4" SMS TO WALL MEMBERS

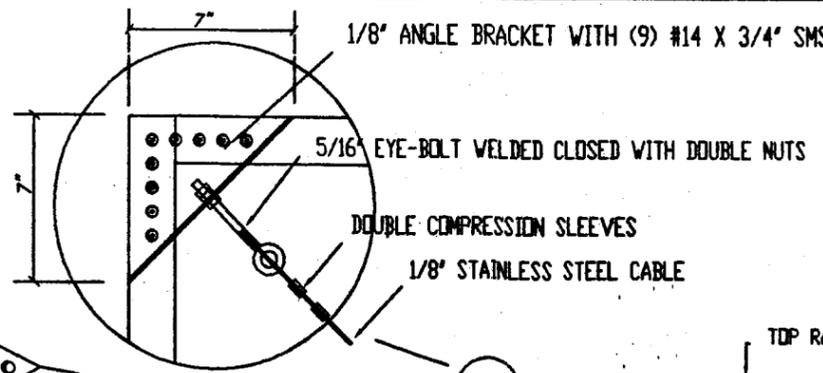

END NON LOAD BEARING WALL SQUARE FOOTAGE				
1-145	146-273	274-363	364-416	417-443
TOTAL NUMBER OF CABLES ON THE FRONT LOAD BEARING WALL				
2	4	6	8	10
1 EA. END	2 EA. END	3 EA. END	4 EA. END	5 EA. END

QUANTITIES ABOVE ARE FOR 3 SIDED ENCLOSURES.
REFER TO ENGINEER'S SITE SPECIFIC PLAN FOR OTHER CONDITIONS.
USE ONE SET OF CABLES ON RETURN WALLS
FOR SPANS OVER 16 FEET.

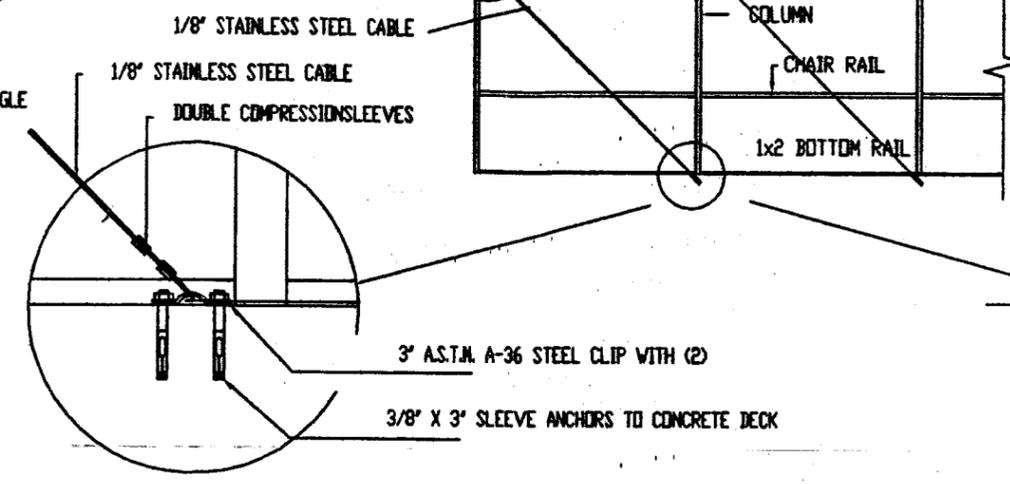

ALTERNATE


CABLE BRACING DETAIL

THIS CLIP MAY ALSO BE USED ON SIDE OF CONCRETE SLAB. MAINTAIN 2" MIN. EDGE DISTANCE.

6" SUPER BRACKET WITH (4) 3/8" X 2 1/2" LAG BOLTS TO FASCIA

FASTEN SUPER GUTTER TO THE HOST STRUCTURE WITH 1/4" X 2 1/2" LAGS 20" DC.

2" X 3" X 1/4" ANGLE @ EACH SIDE OF ROOF BEAM WITH (4) #14 X 3/4" SMS TO ROOF BEAM AND (2) 3/8" X 8" LAG BOLTS & (3) #14 X 1" SMS TO GUTTER

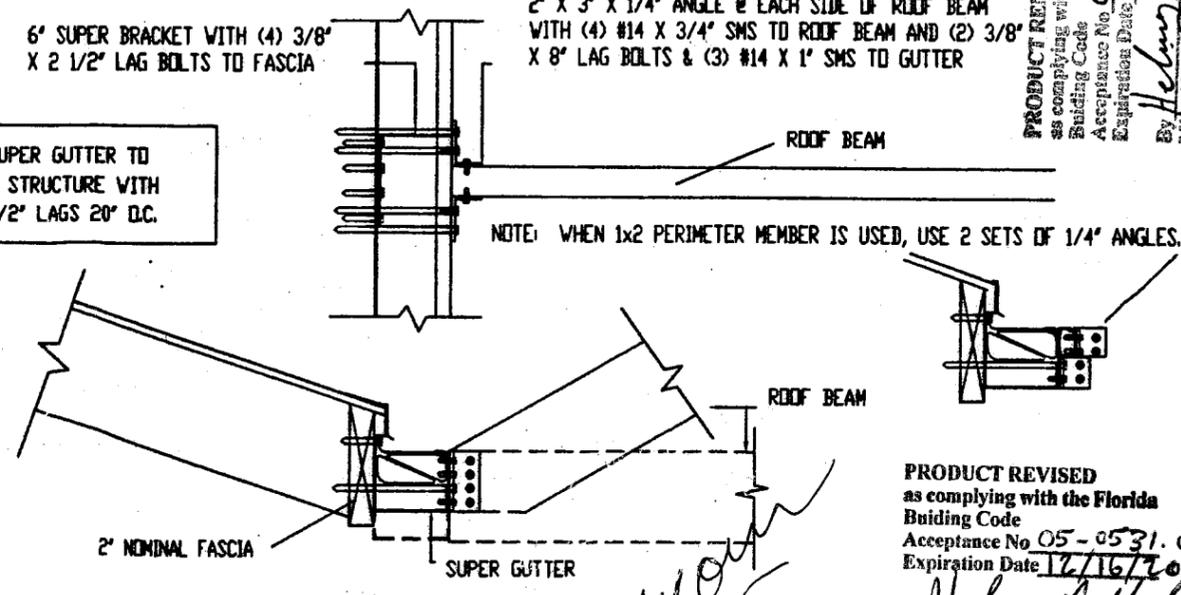

5" GUTTER BRACKET DETAIL

1 1/4" X 5 5/8" X 1/8" FLAT BAR

PRODUCT REVIEWED as complying with the Florida Building Code Acceptance No. 06-0531-08 Expiration Date 12/16/2008 By Helmut A. Mohr Miami Dade Product Control Division

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 05-0531-02 Expiration Date 12/16/2005 By Helmut A. Mohr Miami Dade Product Control Division

REVISIONS	BY

RAMMS-ENGINEERING, INC.
Structural Design
2100 W. 76th STREET, SUITE 311
HALEAH, FLORIDA 33016
EB 0006024

Screen Enclosure Specs
General Screen
5033 SW 151 Place
Miami, FL

MONSOUR
RSM
JUNE 6, 1995
SHOWN
3
3