



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING**

**140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

www.miamidade.gov

NOTICE OF ACCEPTANCE (NOA)

**Aluminum World, Inc.
4401 E. 10th Avenue
Hialeah, Florida 33013**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: "Storm Guard" 0.0384" (min.) Galvanized Steel Storm Panels Shutter

APPROVAL DOCUMENT: Drawing No. **05-109**, titled " 0.0384" Galvanized Steel Storm Panel-Storm Guard", sheets 1 through 7 of 7, prepared by Tilteco, Inc., dated May 06, 2005, last revision #2 dated July 08, 2005, signed and sealed by Walter A. Tillit Jr., P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each panel shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 05-0610.01** and consists of this page 1, evidence submitted pages E-1, E-2, E-3, & E-4 as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**



Helmy A. Makar
03/15/2007

**NOA No 06-0410.03
Expiration Date: 07/09/2011
Approval Date: 03/15/2007
Page 1**

Aluminum World, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #99-0304.05

A. DRAWINGS

1. *Drawing prepared by Tilteco, Inc., titled "20 Gage Storm Panel - Storm Guard", Drawing No. 99-70, dated February 24, 1999, sheets 1 through 7 of 7, signed and sealed by Walter A. Tillit, Jr., P.E.*

B. TESTS

1. *None. (Tests originally in file #98-0303.05)*

C. CALCULATIONS

1. *None. (Calculations originally in file #98-0303.05)*

D. MATERIAL CERTIFICATIONS

1. *None. (Material certifications originally in file #98-0303.05)*

E. OTHER

1. *An official corporate resolution issued by Mr. Scott Shaver, from Florida Metal Industries, Inc., February 19, 1999, rescinding any claim to the Notice of Acceptance #98-0303.05.*
2. *Letter issued by Walter T. Tillit, Jr., P.E., March 26, 1999, stating that all documents are unchanged copies of Florida Metal Industries, Inc. "Storm Panel - Storm Guard" submittals, Acceptance #98-0303.05.*

F. NOTE

1. *This approval, the same as Approval #98-0303.05, is issued to change the name from Florida Metal Industries, Inc. to Dynamic Window Shutters, Inc.*

2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #01-0516.01

A. DRAWINGS

1. *Drawing No. 99-70, prepared by Tilteco, Inc., titled "20 Gage Storm Panel - Storm Guard", dated February 24, 1999, last revision #2 dated July 11, 2001, sheets 1 through 7 of 7, signed and sealed by Walter A. Tillit, Jr., P.E.*

B. TESTS


1. *None. (Tests originally in file #98-0303.05)*

C. CALCULATIONS

1. *None. (Calculations originally in file #98-0303.05)*

D. MATERIAL CERTIFICATIONS

1. *None. (Material certifications originally in file #98-0303.05)*



Helmy A. Makar, P. E., M.S.

Product Control Examiner

NOA No 06-0410.03

Expiration Date: 07/09/2011

Approval Date: 03/15/2007

Aluminum World, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3 EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #01-1029.02

A. DRAWINGS

1. *Drawing No. 01-280, titled "20 Gage Storm Panel - Storm Guard", prepared by Tilteco, Inc., dated October 08, 2001, sheets 1 through 7 of 7, signed and sealed by Walter A. Tillit, Jr., P.E.*

B. TESTS

1. *None. (Tests originally in file #98-0303.05)*

C. CALCULATIONS

1. *None. (Calculations originally in file #98-0303.05)*

D. MATERIAL CERTIFICATIONS

1. *None. (Material certifications originally in file #98-0303.05)*

E. OTHER

1. *An official corporate resolution issued by Mr. Rafael Rosado and Leocadia E. Rosado, from Dynamic Window Shutters, Inc., dated October 01, 2001, rescinding any claim to the Notice of Acceptance #01-0516.01.*
2. *Letter issued, signed, and sealed by Walter T. Tillit, Jr., P.E., dated October 08, 2001, stating that drawing #01-280 prepared for Aluminum World, Inc. is engineering wise completely identical to Dynamic Window Shutters, Inc. drawing #99-70.*
3. *Bill of Sale from Dynamic Window Shutters, Inc. to Aluminum World, Inc., dated October 01, 2001.*

F. NOTE

1. *Approval #01-0516.01, the same as Approval #98-0303.05, is issued to change the name from Florida Metal Industries, Inc. to Dynamic Window Shutters, Inc.*
2. *This approval, the same as Approval #01-0516.01, is issued to change the name from Dynamic Window Shutters, Inc. to Aluminum World, Inc.*


4. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #03-0206.06

A. DRAWINGS

1. *Drawing No. 02-575, titled "20 gage Storm Panel - Storm Guard", sheets 1 through 7 of 7, prepared by Tilteco, Inc., dated December 11, 2002, last revision #1 dated December 11, 2002 signed and sealed Walter A. Tillit, Jr., P.E.*

B. TESTS

1. *None.*



Helmy A. Makar, P. E., M.S.

Product Control Examiner

NOA No 06-0410.03

Expiration Date: 07/09/2011

Approval Date: 03/15/2007

Aluminum World, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. *None.*

D. MATERIAL CERTIFICATIONS

1. *None.*

E. STATEMENTS

1. *Letter issued by Mr. Walter A. Tillit, Jr., P.E., dated December 17, 2002, indicating that the only change is update General Note numbers 1 & 10 to reference the Florida Building Code and ASCE 7-98.*

5. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #05-0610.01

A. DRAWINGS

1. *Drawing No. 05-109, titled " 0.0384" Galvanized Steel Storm Panel – Storm Guard ", sheets 1 through 7 of 7, prepared by Tilteco, Inc., dated May 06, 2005, last revision #2 dated July 08, 2005, signed and sealed Walter A. Tillit, Jr., P.E.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *Anchor analysis titled " 2004 Florida Building Code High Velocity Hurricane Zone Revision of Miami-Dade County Product Approval for 0.0384" Galvanized Steel Storm Panel – Storm Guard ", dated May 26, 2005, sheets 1 through 38 of 38, signed and sealed by Walter A. Tillit Jr., P.E.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *None.*

6. NEW EVIDENCE SUBMITTED

A. DRAWINGS


1. *None.*

B. TESTS


1. *None.*




Henry A. Makar, P. E., M.S.
Product Control Examiner
NOA No 06-0410.03
Expiration Date: 07/09/2011
Approval Date: 03/15/2007

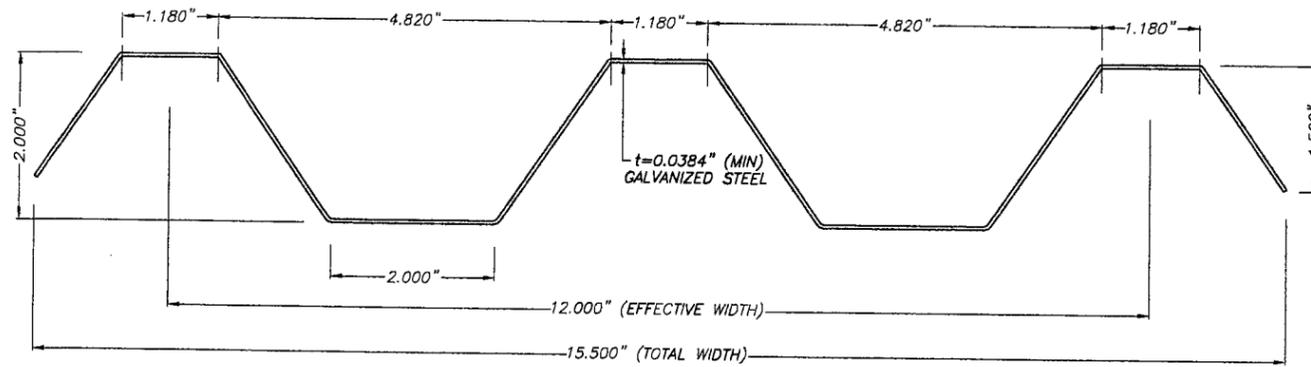


① PANEL

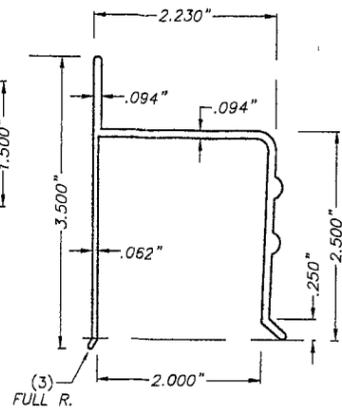


② "h" HEADER

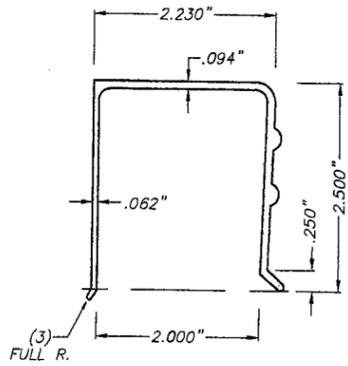

③ "U" HEADER

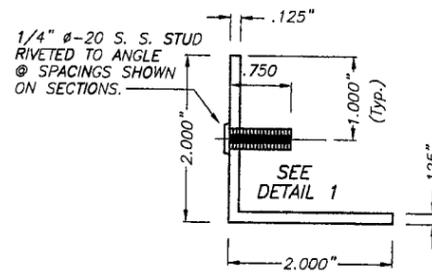


④ STUDDED ANGLE

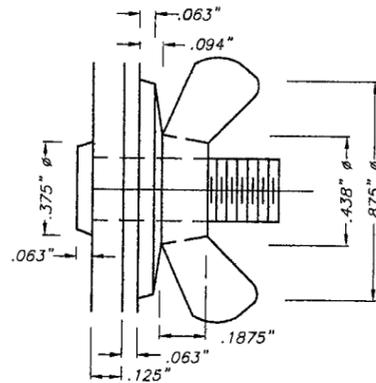


⑤ STEEL TUBE REINFORCEMENT

ASTM A-653 W/
FY = 33 ksi


DETAIL 1: STUD W/ WING NUT

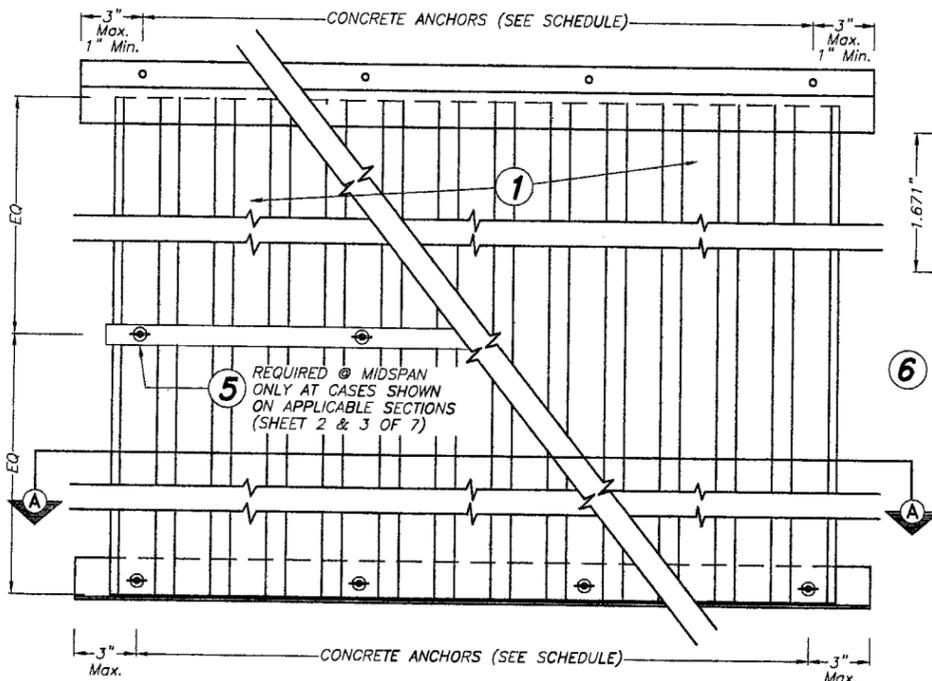


STORM PANEL TYPICAL ELEVATION

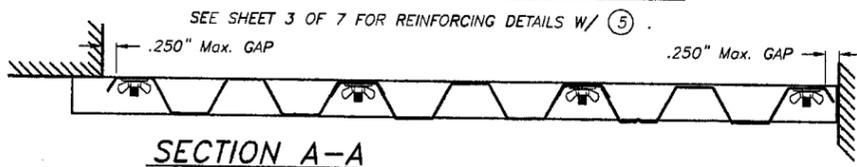

SECTION A-A



⑥ "F" TRACK

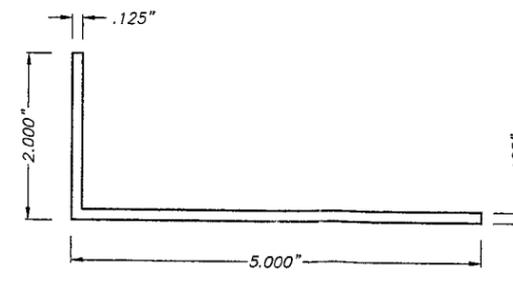

⑦ 2"x5" (Max.)x0.125" ANGLE

6063-T5 Alum. ALLOY

COMPONENTS

GENERAL NOTES:

- STORM PANEL SHOWN ON THIS PRODUCT APPROVAL DOCUMENT (P.A.D.) HAS BEEN VERIFIED FOR CODE COMPLIANCE IN ACCORDANCE WITH THE 2004 EDITION OF THE FLORIDA BUILDING CODE. DESIGN WIND LOADS SHALL BE DETERMINED AS PER SECTION 1620 OF THE ABOVE MENTIONED CODE. IN ORDER TO VERIFY THAT ANCHORS ON THIS P.A.D., AS TESTED, WERE NOT OVER STRESSED, A 33% INCREASE IN ALLOWABLE LOADS FOR WIND LOADS WAS NOT USED IN THEIR ANALYSIS. HOWEVER, FOR LAG SCREWS INTO WOOD, A 1.60 WIND LOAD DURATION FACTOR WAS USED TO CALCULATE SCREWS SPACINGS. STORM PANEL'S ADEQUACY FOR IMPACT AND FATIGUE RESISTANCE HAS BEEN VERIFIED IN ACCORDANCE WITH SECTION 1609.1.4 OF THE ABOVE MENTIONED CODE AS PER HETI REPORT # HETI-99-831 PER TAS-201, TAS-202 & TAS-203 PROTOCOLS.
- ALL STEEL SHEET METAL PANELS SHALL HAVE STRUCTURAL QUALITY ASTM A653, GRADE 50, GALVANIZED STEEL DESIGNATION W/Fy=56.6 ksi (AFTER ROLLED).
- ALL ALUMINUM EXTRUSIONS SHALL BE 6063-T6 ALLOY UNLESS OTHERWISE NOTED.
- ALL SCREWS TO BE STAINLESS STEEL 304 OR 316 SERIES W/50 ksi YIELD POINT AND 90 ksi TENSILE STRENGTH OR CORROSION RESISTANT COATED CARBON STEEL AS PER DIN 50018.
- BOLTS TO BE 2024-T4 ALUMINUM ALLOY, GALVANIZED OR STAINLESS STEEL, WITH 36 ksi MINIMUM YIELD POINT.
- ANCHORS TO WALL SHALL BE AS FOLLOWS: (UNLESS OTHERWISE NOTED)
 - (A) TO EXISTING POURED CONCRETE:
 - 1/4" Ø TAPCON ANCHORS, AS MANUFACTURED BY I.T.W. BUILDEX.
 - 1/4" Ø x 7/8" CALK-IN ANCHORS, AS MANUFACTURED BY POWERS FASTENERS, INC.
 - (B) TO EXISTING CONCRETE BLOCK WALL:
 - 1/4" Ø TAPCON ANCHORS, AS MANUFACTURED BY I.T.W. BUILDEX.
 - 1/4" Ø x 7/8" CALK-IN ANCHORS AS MANUFACTURED BY POWERS FASTENERS, INC.
 - (C) ANCHORS SHALL BE INSTALLED FOLLOWING ALL OF THE RECOMMENDATIONS AND SPECIFICATIONS OF THE ANCHOR'S MANUFACTURER.
- PANELS MAY ALSO BE INSTALLED HORIZONTALLY FOLLOWING INSTALLATION DETAILS SHOWN ON SECTIONS 2, 2A, 3 & 6 (SHEET 2 & 3 OF 7).
- EACH PANEL SHALL HAVE A LEGIBLE AND READILY VISIBLE MARKING INSTRUCTING OWNER OR TENANT TO SECURE PANELS WITH APPLICABLE REINFORCEMENT DURING PERIODS OF HURRICANE WARNING.
- IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY THE SOUNDNESS OF THE STRUCTURE WHERE SHUTTER IS TO BE ATTACHED TO INSURE PROPER ANCHORAGE. THIS PANEL SHALL ONLY BE ATTACHED TO CONCRETE, BLOCK OR WOOD FRAMES BUILDINGS.
- (A) THIS PRODUCT APPROVAL DOCUMENT (P.A.D.) PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT; I.E. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.A.D.
 - (B) CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION INCLUDING LIFE SAFETY OF THIS PRODUCT BASED ON THIS P.A.D. PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT. CONSTRUCTION SAFETY AT SITE IS THE CONTRACTOR'S RESPONSIBILITY.
 - (C) THIS PRODUCT APPROVAL DOCUMENT WILL BE CONSIDERED INVALID IF MODIFIED.
 - (D) SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.A.D. ENGINEER OF RECORD, ACTING AS DELEGATED ENGINEER TO THE P.A.D. ENGINEER, SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
 - (E) THIS P.A.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER THAT PREPARED IT.
- SHUTTER MANUFACTURER'S LABEL SHALL BE PLACED AT BOTTOM OF EACH PANEL. LABEL SHALL READ AS FOLLOWS:
ALUMINUM WORLD, INC.
HIALEAH, FLORIDA
MIAMI-DADE COUNTY PRODUCT CONTROL APPROVED.

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 06-0410.03
Expiration Date 07/09/2011
By Helmut A. Meier
Miami Dade Product Control
Division

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 05-0610.01
Expiration Date 07/09/2006
By Helmut A. Meier
Miami Dade Product Control
Division


F.B.C. (High Velocity Hurricane Zone)

* ATTN. BLDG. OFFICIALS DO NOT ACCEPT THIS DRAWING W/O ALUMINUM WORLD, INC. RAISED CORPORATE SEAL


CORPORATE SEAL *

TILECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 Fax : (305)871-1531
EB-0006719
WALTER A. TILLIT Jr., P. E.
FLORIDA Lic. # 44167

0.0384" GALV. STEEL STORM PANEL-"STORM GUARD"		DRAWN BY: M.C.V.	
ALUMINUM WORLD, INC		05/6/05 DATE	
4401 E. 10 AVENUE HIALEAH, FL 33013.		05-109 DRAWING No	
REV. No	DESCRIPTION	DATE	REV. No
1	OLD 02-575	05/06/05	3
2	NOTE 1	07/08/05	4
			SHEET 1 OF 7

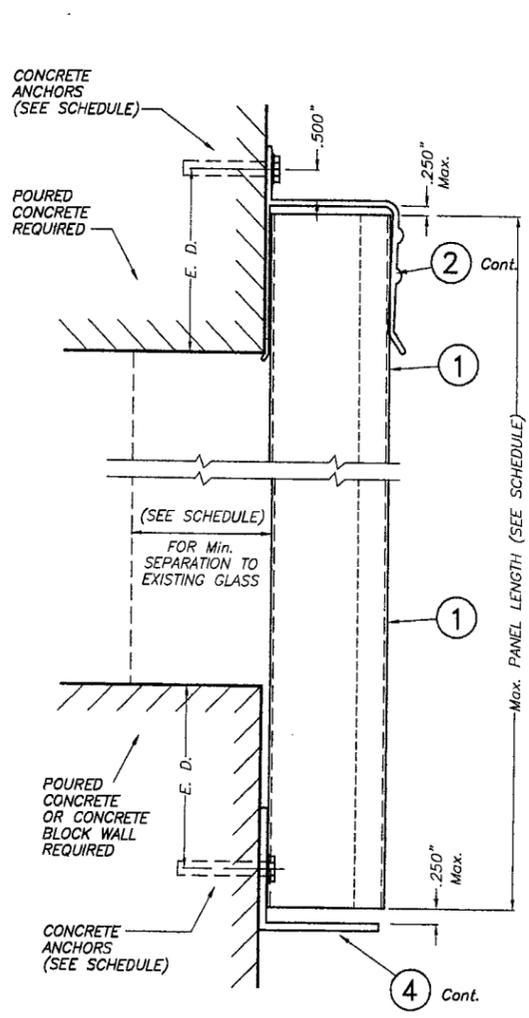


SECTION @ ANCHOR

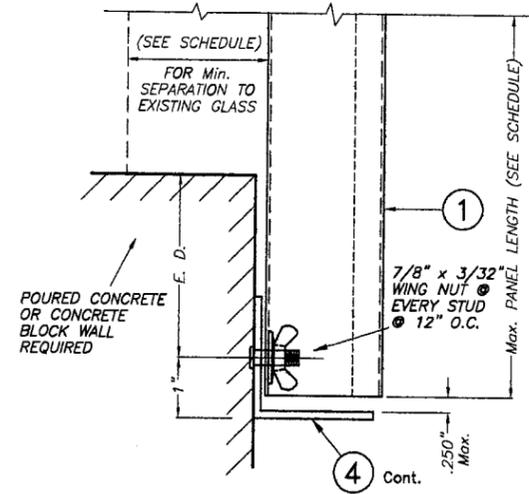


SECTION @ STUD

WALL MOUNTING INSTALLATION
- SECTION 1

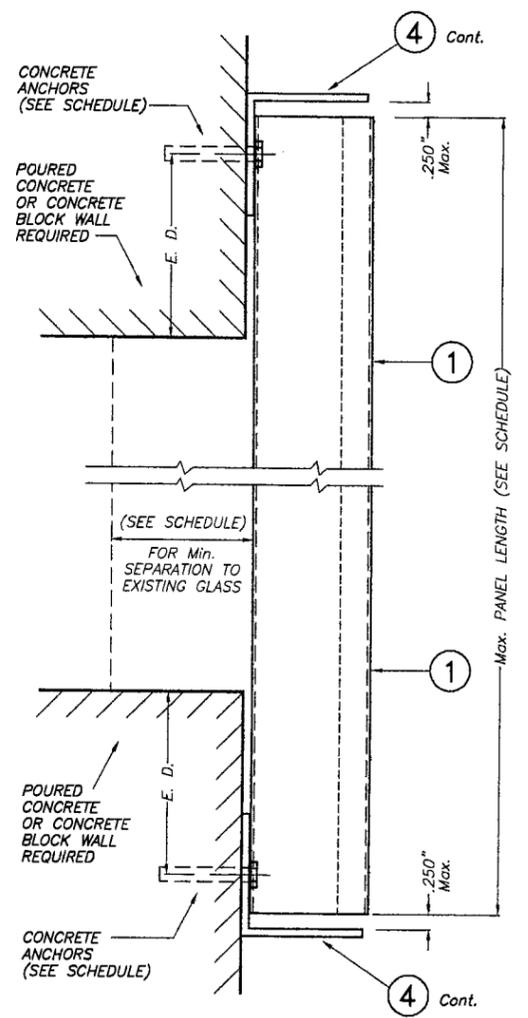


SECTION @ ANCHOR

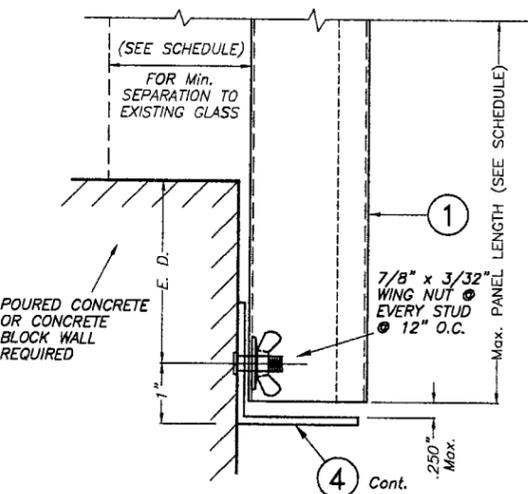


SECTION @ STUD

WALL MOUNTING INSTALLATION
- SECTION 2

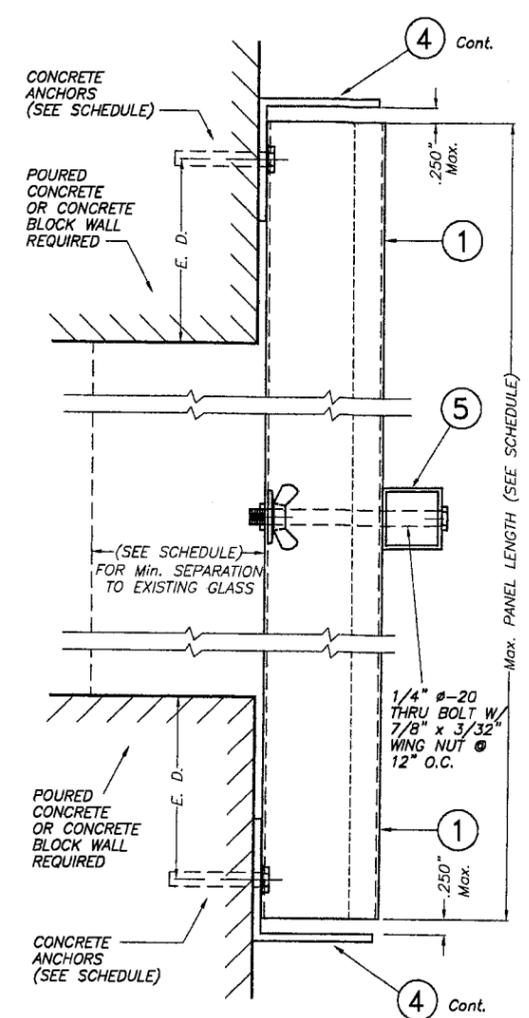


SECTION @ ANCHOR

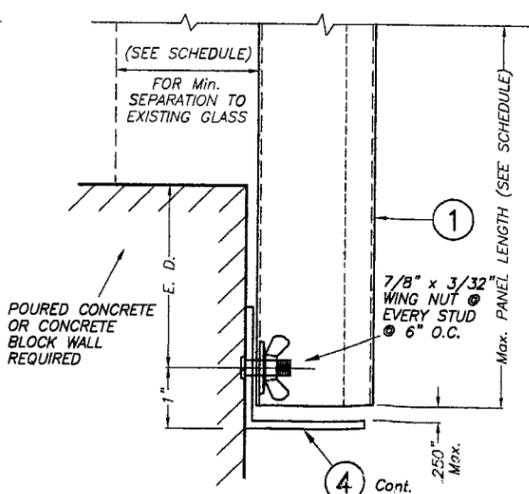


SECTION @ STUD

WALL MOUNTING INSTALLATION
- SECTION 2A

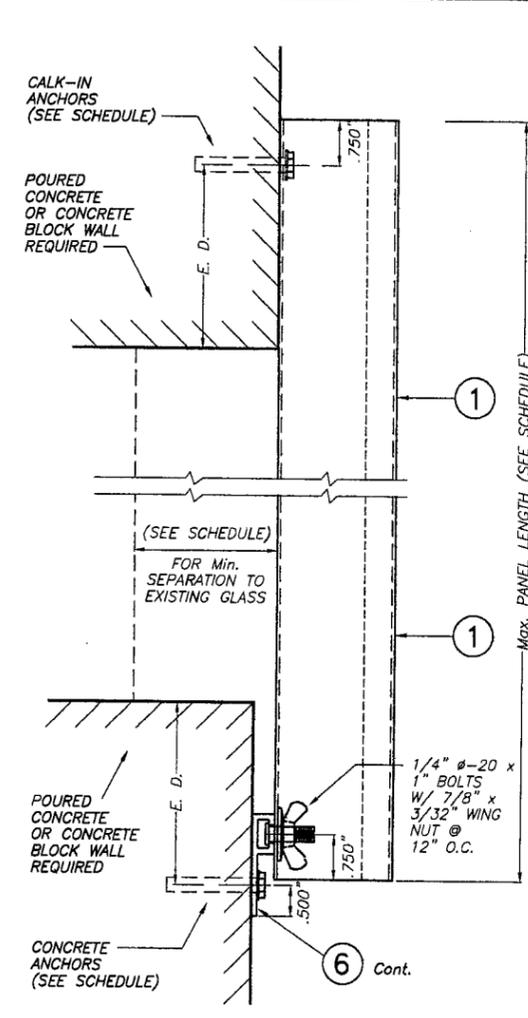

WALL MOUNTING INSTALLATION
- SECTION 3

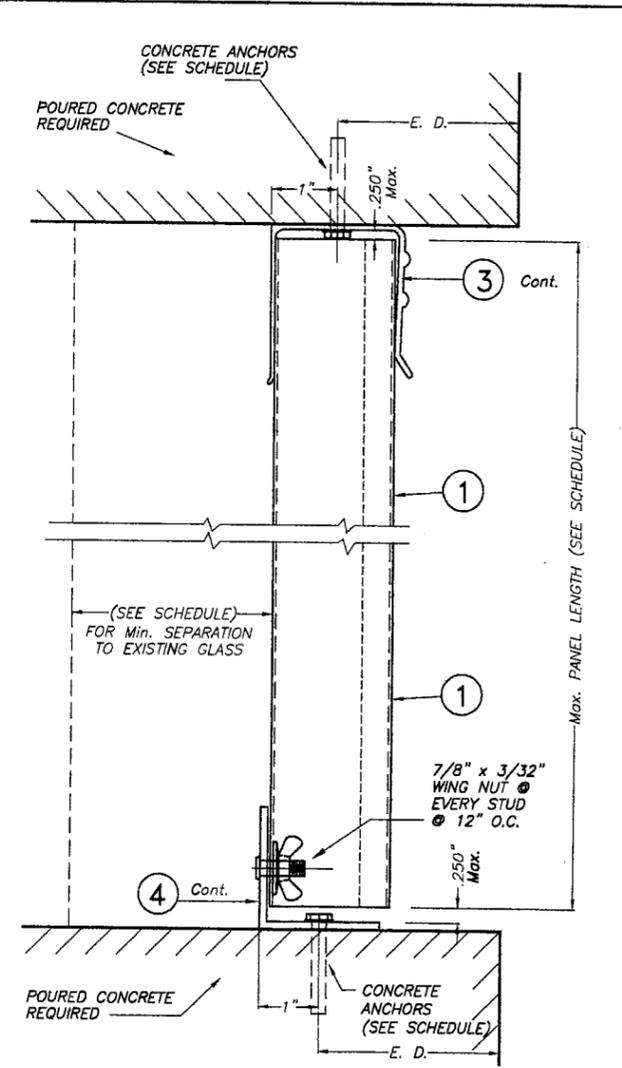

CEILING & FLOOR MOUNT. INSTALL.
- SECTION 4

E. D. = EDGE DISTANCE
(SEE SCHEDULE ON SHEET 5 OF 7)

NOTE FOR COMBINATION OF SECTIONS:
WALL/FLOOR/CEILING MOUNTING SECTIONS CAN BE COMBINED IN ANY WAY TO SUIT ANY INSTALLATION.


PRODUCT RENEWED
as complying with the Florida Building Code
Acceptance No. 06-9410.03
Expiration Date 07/09/2011
By Helmy A. Matar
Miami Dade Product Control Division

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 05-9610.01
Expiration Date 07/09/2006
By Helmy A. Matar
Miami Dade Product Control Division


F.B.C. (High Velocity Hurricane Zone)

		ALUMINUM WORLD, INC 4401 E. 10 AVENUE HIALEAH, FL 33013.		DRAWN BY: M.C.V. 05/6/05 DATE 05-109 DRAWING No	
TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone: (305)871-1530 Fax: (305)871-1531 EB-0006719 WALTER A. TILLIT Jr. P. E. FLORIDA Lic. # 44167		0.0384" GALV. STEEL STORM PANEL-"STORM GUARD" REV. No. DESCRIPTION DATE REV. No. DESCRIPTION DATE 1 OLD 02-575 05/06/05 3 - - 2 GENERAL 07/08/05 4 - -		SHEET 2 OF 7	

Handwritten signature and date: 7/8/05

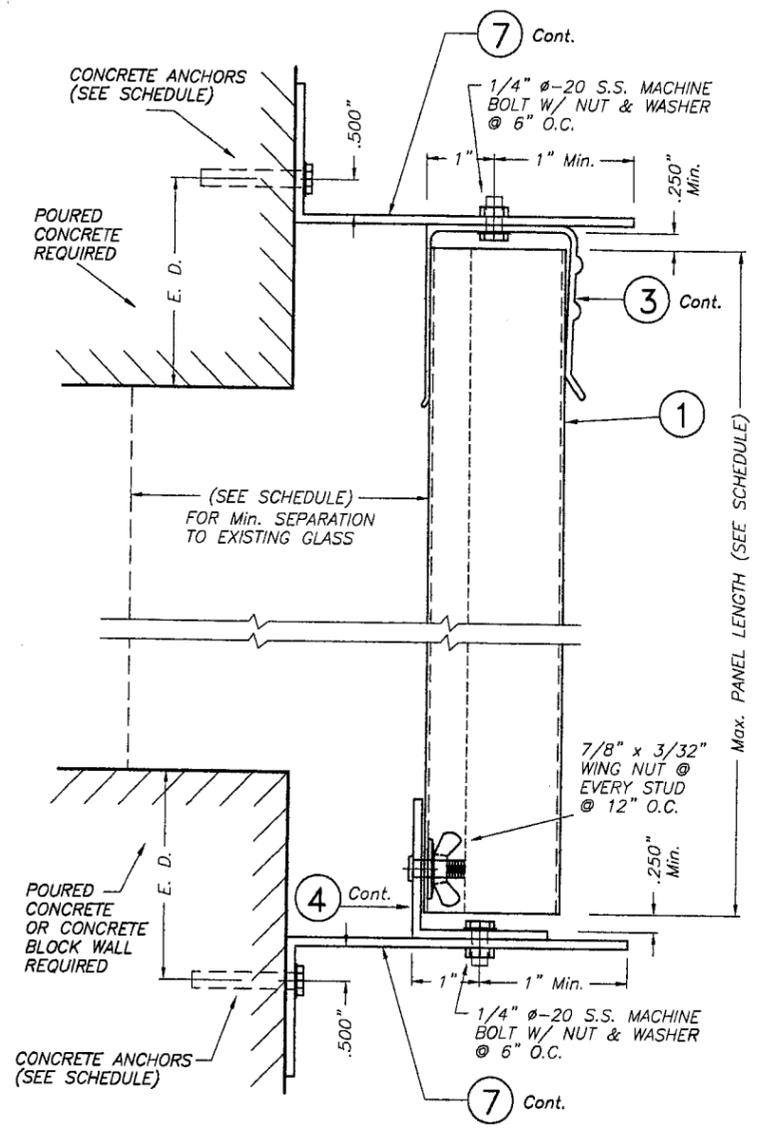


**BUILD-OUT MOUNTING INSTALLATION
- SECTION 5**

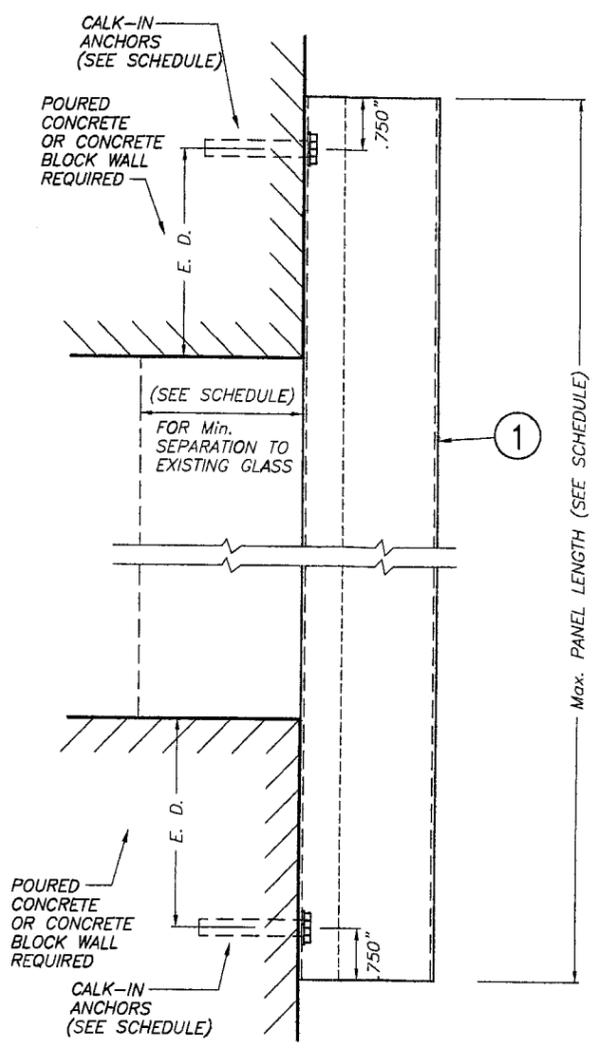

**WALL MOUNTING INSTALLATION
(DIRECT MOUNT) - SECTION 6**

NOTE FOR COMBINATION OF SECTIONS:
WALL/FLOOR/CEILING MOUNTING SECTIONS CAN BE COMBINED IN ANY WAY TO SUIT ANY INSTALLATION.

E. D. = EDGE DISTANCE
(SEE SCHEDULE
ON SHEET 5 OF 7

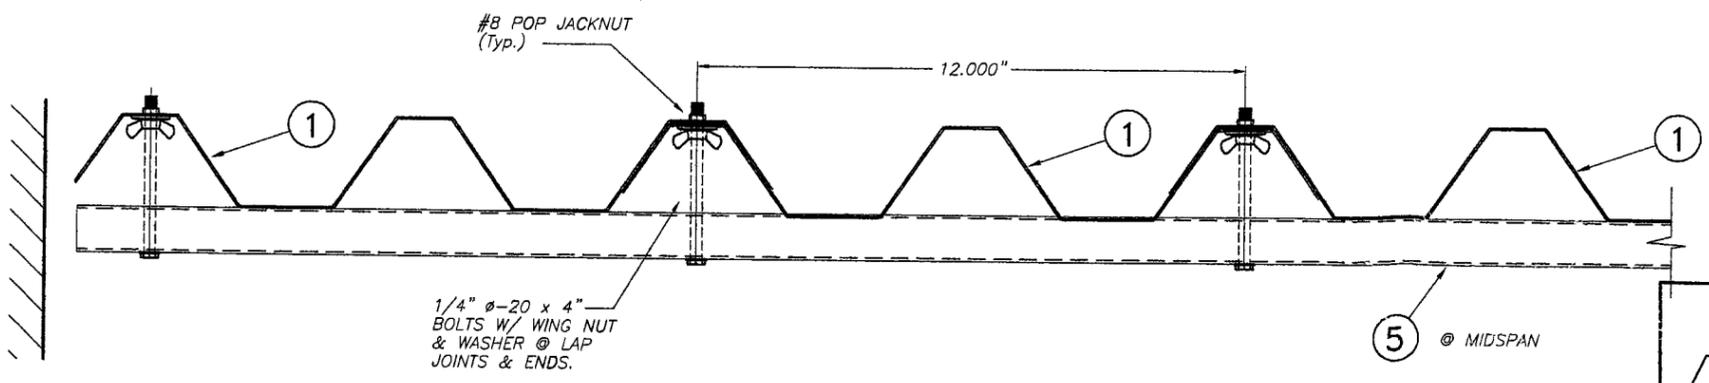


PANEL REINFORCING DETAIL W/ (5)

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 06-0410.03
Expiration Date 07/09/2011
By *Helmut A. Heber*
Miami Dade Product Control
Division

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 05-0610.01
Expiration Date 07/09/2006
By *Helmut A. Heber*
Miami Dade Product Control
Division


F.B.C. (High Velocity Hurricane Zone)

 TILECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 Fax : (305)871-1531 EB-0006719 WALTER A. TILLIT Jr. P. E. FLORIDA Lic. # 44167		0.0384" GALV. STEEL STORM PANEL-"STORM GUARD"	DRAWN BY: M.C.V.		
		ALUMINUM WORLD, INC 4401 E. 10 AVENUE HIALEAH, FL 33013.		05/6/05 DATE	
		05-109 DRAWING No			
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 02-575	05/06/05	3	-	-
2	GENERAL	07/08/05	4	-	-

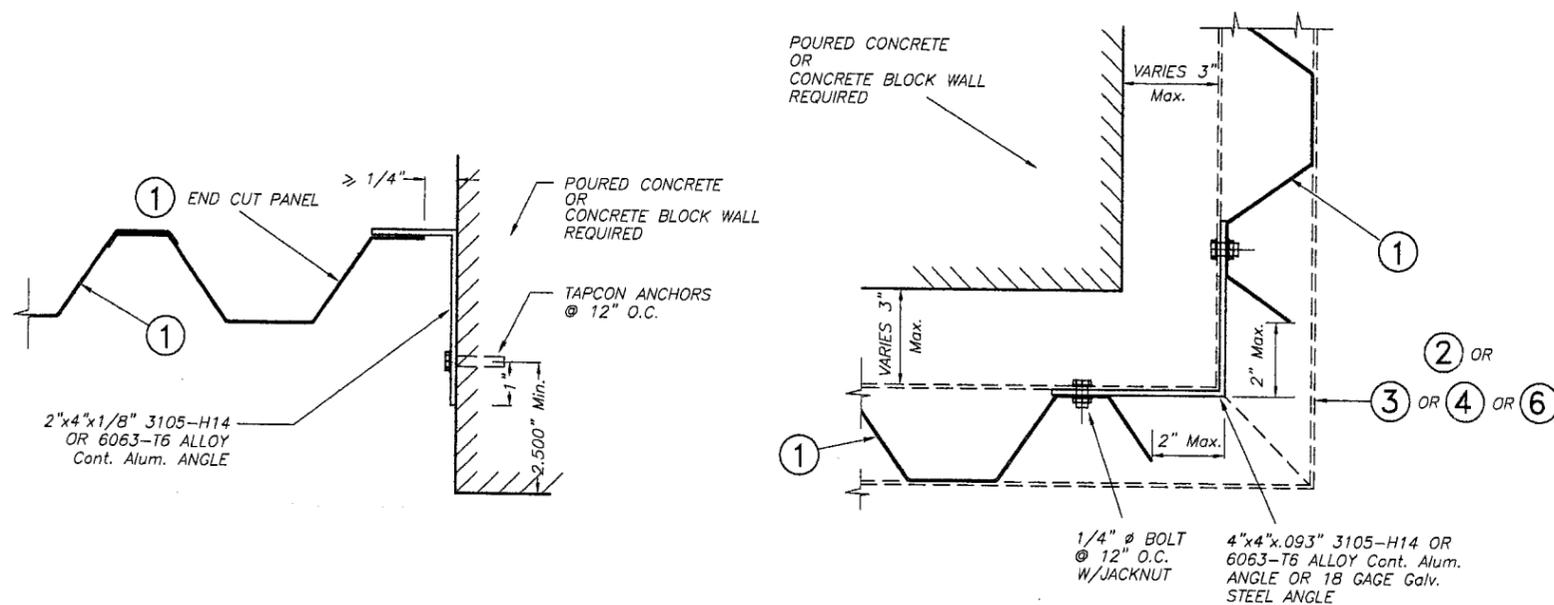

CASE A (Plan)

CASE B (Plan)

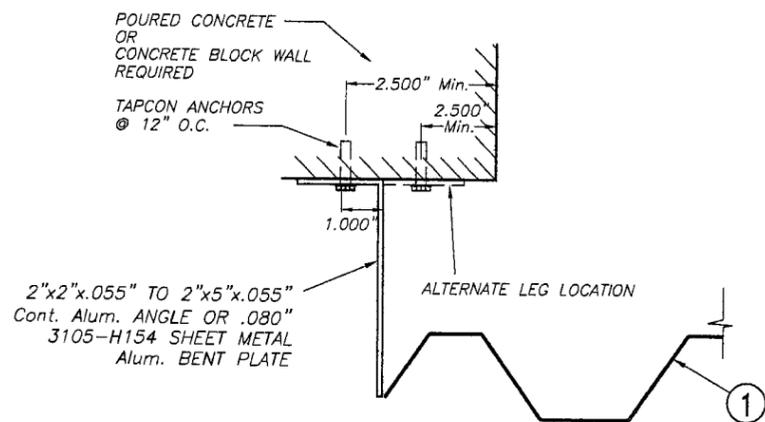

CASE C (Plan)

END CLOSURES DETAILS

MAXIMUM DESIGN PRESSURE RATING "W" (p.s.f.) AND CORRESPONDING MAXIMUM PANEL LENGTH "L" SCHEDULE

MAXIMUM DESIGN LOAD W (p.s.f.)	Max. PANEL LENGTH L (ft.)	MINIMUM SEPARATION TO GLASS	APPLICABLE TO SECTIONS # (SEE SHEET 2 & 3 OF 7)	PANEL REINFORCEMENT CONDITION
+60.0, -76.0	8'-10"	3 1/8"	1, 2, 3, 4 & 5	UNBOLTED
+60.0, -72.0	9'-0"	3"	6	UNBOLTED
+60.0, -76.0	8'-10"	2 3/4"	6	UNBOLTED
+42.7, -53.3	>8'-10" TO 12'-0"	3"	2A	BOLTED W/ BAR *

* BOLTED W/ 1/4" Ø-20 S.S. M.S. & WINGNUT AT OVERLAP & MIDLENGTH OF PANEL.

PRODUCT RENEWED
 as complying with the Florida Building Code
 Acceptance No 06-0410-03
 Expiration Date 07/09/2011
 By Helmy A. Alator
 Miami Dade Product Control Division

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 05-0610-01
 Expiration Date 07/09/2006
 By Helmy A. Alator
 Miami Dade Product Control Division

F.B.C. (High Velocity Hurricane Zone)

[Handwritten Signature]
 7/8/05

 TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 Fax : (305)871-1531 EB-0006719 WALTER A. TILLIT Jr. P. E. FLORIDA Lic. # 44167	0.0384" GALV. STEEL STORM PANEL-"STORM GUARD"	DRAWN BY: M.C.V.
	ALUMINUM WORLD, INC 4401 E. 10 AVENUE HIALEAH, FL 33013.	05/6/05 DATE
		05-109 DRAWING No
		SHEET 4 OF 7

REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 02-575	05/06/05	3	-	-
2	GENERAL	07/08/05	4	-	-

MAXIMUM DESIGN PRESSURE RATING "W" (p.s.f.) AND CORRESPONDING MAXIMUM ANCHOR SPACING SCHEDULE FOR INSTALLATIONS INTO CONCRETE AND C.B.S. STRUCTURES *

E. D. = EDGE DISTANCE

MAXIMUM DESIGN LOAD W (p.s.f.)	MAXIMUM ANCHORS SPACING FOR E. D. = 3 1/2" **				APPLICABLE TO SECTIONS # & ANY COMBINATION OF THEM	MAXIMUM PANEL LENGTH "L" (ft.)
	TAPCONS		CALK-IN			
	TO CONCRETE	TO MASONRY	TO CONCRETE	TO MASONRY		
+60, -71.5	N/A	N/A	12"	12"	6 (TOP/BOTTOM)	6'-1" OR LESS
+60, -71.5	N/A	N/A	12"	6"	6 (TOP/BOTTOM)	>6'-1" TO 8'-2"
+60, -72.0	N/A	N/A	6"	6"	6 (TOP/BOTTOM)	9'-0" OR LESS
+60.0, -76.0	6"	N/A	6"	N/A	1 (TOP)	8'-10" OR LESS
	6"	5 1/2"	6"	6"	1 (BOTTOM)	
	6"	5 1/2"	6"	6"	2 (TOP/BOTTOM)	
	N/A	N/A	6"	6"	3 (TOP)	
	6"	5 1/2"	6"	6"	3 (BOTTOM)	
	8"	N/A	7"	N/A	4 (TOP)	
	7"	N/A	6 1/2"	N/A	4 (BOTTOM)	
	6"	N/A	6"	N/A	5 (TOP)	
	6"	5 1/2"	6"	6"	5 (BOTTOM)	
	N/A	N/A	6"	6"	6 (TOP/BOTTOM)	
+42.7, -53.3	6"	5 1/2"	6"	6"	2A (TOP/BOTTOM)	>8'-10" TO 12'-0"

PRODUCT RENEWED
 as complying with the Florida Building Code
 Acceptance No 06-0410.03
 Expiration Date 07/09/2011
 By *Helmut A. Meiser*
 Miami Dade Product Control Division

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 05-0610.01
 Expiration Date 07/09/2006
 By *Helmut A. Meiser*
 Miami Dade Product Control Division

* SEE SHEET 6 & 7 OF 7 FOR ANCHORS TYPE & SPACING FOR INSTALLATIONS INTO WOOD FRAME BUILDINGS.
 ** MAXIMUM ANCHOR SPACINGS ARE VALID FOR 3 1/2" EDGE DISTANCE. FOR E. D. LESS THAN 3 1/2"; REDUCE ANCHOR SPACING BY MULTIPLYING SPACINGS SHOWN ON SCHEDULE BY THE FOLLOWING FACTORS. (NOTE : Min. E. D. FOR CALK-IN ANCHORS IS 2 1/2"). THIS OPERATION SHALL ONLY BE PERFORMED WHEN REQUIRED SPACING RESULTS INTO A MINIMUM OF 3"


ACTUAL E. D.	FACTOR	
	TAPCON	CALK-IN
3"	.86	.75
2 1/2"	.71	.50
2"	.50	-

W. A. Tillit Jr.
 7/8/05


TILECO INC.
 TILLIT TESTING & ENGINEERING COMPANY
 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
 Phone : (305)871-1530 Fax : (305)871-1531
 EB-0006719
 WALTER A. TILLIT Jr. P. E.
 FLORIDA Lic. # 44167

F.B.C. (High Velocity Hurricane Zone)

0.0384" GALV. STEEL STORM PANEL-"STORM GUARD" DRAWN BY: M.C.V.
ALUMINUM WORLD, INC
 4401 E. 10 AVENUE
 HIALEAH, FL 33013. DATE 05/6/05
 05-109 DRAWING No
 REV. No DESCRIPTION DATE REV. No DESCRIPTION DATE
 1 OLD 02-875 05/06/05 3 - -
 2 GENERAL 07/08/05 4 - - SHEET 5 OF 7

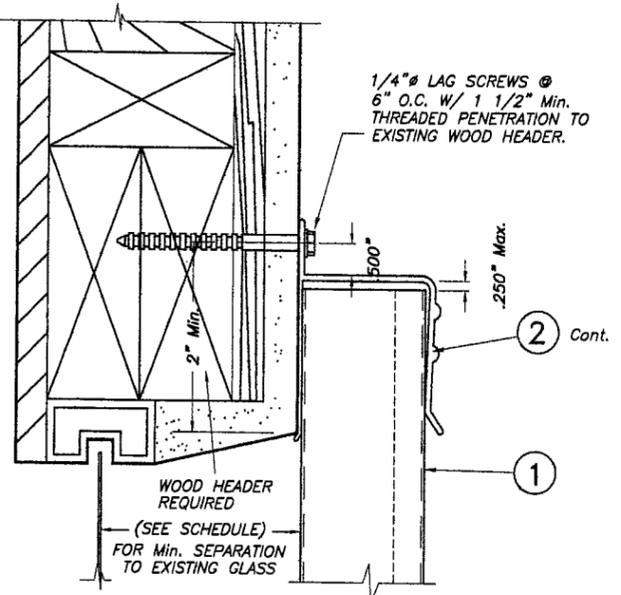


ALTERNATIVE 1

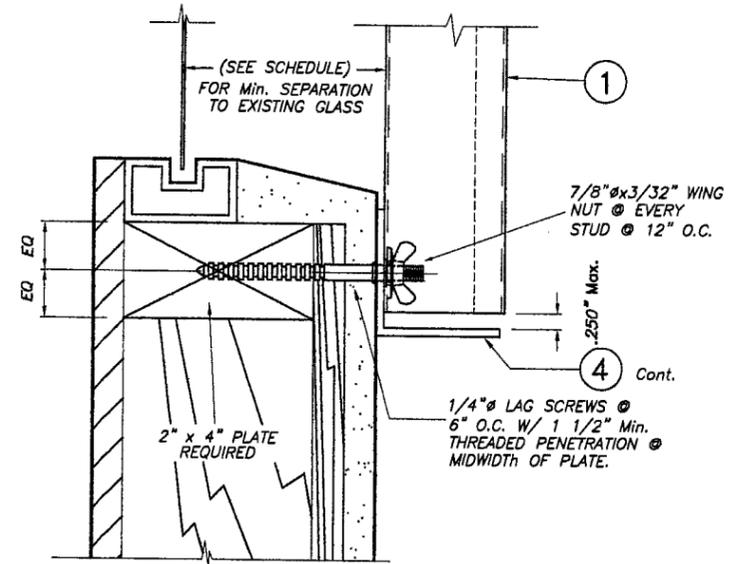


ALTERNATIVE 2

NOTE FOR COMBINATION OF SECTIONS:
WALL MOUNTING SECTIONS CAN BE COMBINED IN ANY WAY TO SUIT ANY INSTALLATION.

NOTES:
1. INSTALLATIONS ARE ONLY VALID FOR DESIGN WIND LOADS UP TO +60.0, -76.0 p.s.f. AND PANEL'S LENGTHS UP TO 8'-10".
2. NEW 2" x 6" P. T. TO BE SOUTHERN PINE No. 2, SURFACED DRY WITH 19 % M. M. C. W/ SPECIFIC DENSITY OF 0.55.
3. FOR NEW WOOD FRAME CONSTRUCTION: WOOD MEMBERS TO BE SOUTHERN PINE No. 2, W/ SPECIFIC DENSITY OF 0.55 OR EQUAL.

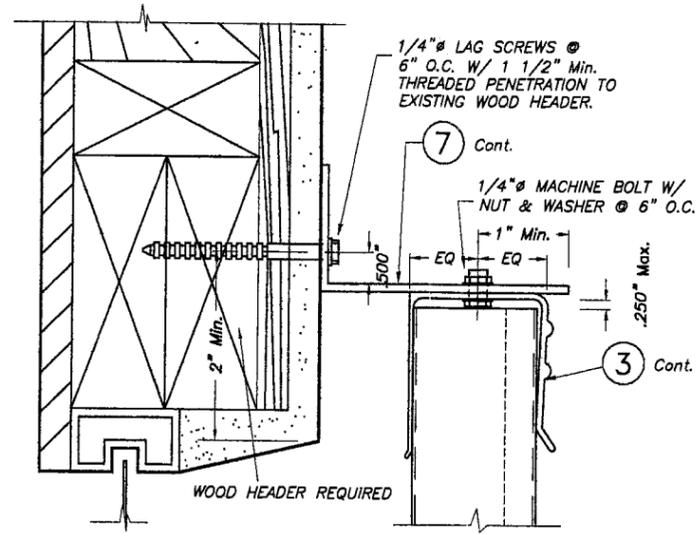

ALTERNATIVE 3

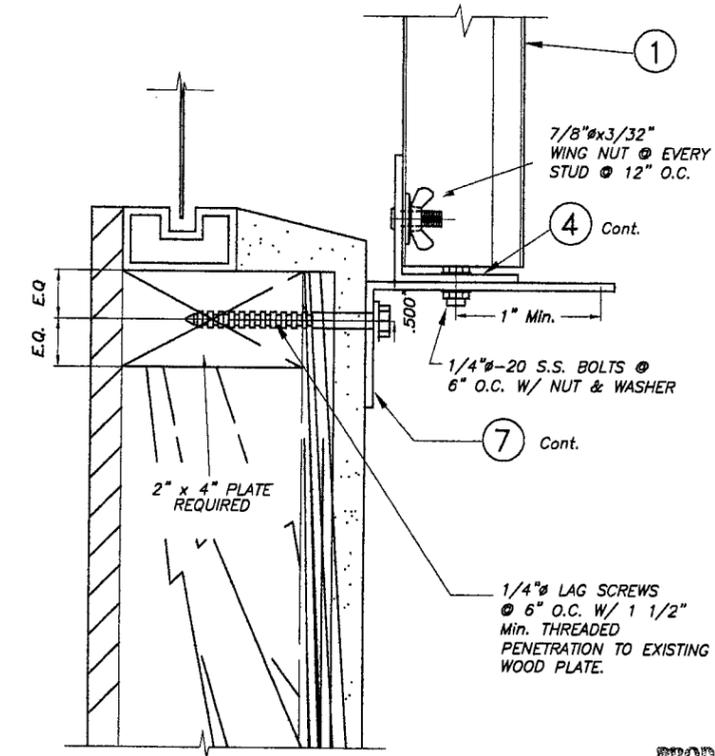

ALTERNATIVE 7

WALL MOUNT. INSTALLAT. (OFFSET)
- SECTION A

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 06-0410.03
Expiration Date 07/09/2011
By Helmut A. Mader
Miami Dade Product Control
Division


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 05-0610.01
Expiration Date 07/09/2006
By Helmut A. Mader
Miami Dade Product Control
Division

F.B.C. (High Velocity Hurricane Zone)


Handwritten signature and date: 7/8/05

<p>TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone: (305)871-1530 Fax: (305)871-1531 EB-0006719 WALTER A. TILLIT Jr. P. E. FLORIDA Lic. # 44167</p>		<p>0.0384" GALV. STEEL STORM PANEL-"STORM GUARD"</p> <p>ALUMINUM WORLD, INC 4401 E. 10 AVENUE HIALEAH, FL 33013.</p>	<p>DRAWN BY: M.C.V.</p> <p>05/6/05 DATE</p> <p>05-109 DRAWING No</p> <p>SHEET 6 OF 7</p>		
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 02-375	05/06/05	3	-	-
2	GENERAL	07/08/05	4	-	-


INSTALLATION DETAILS ON EXISTING WOOD BUILDINGS

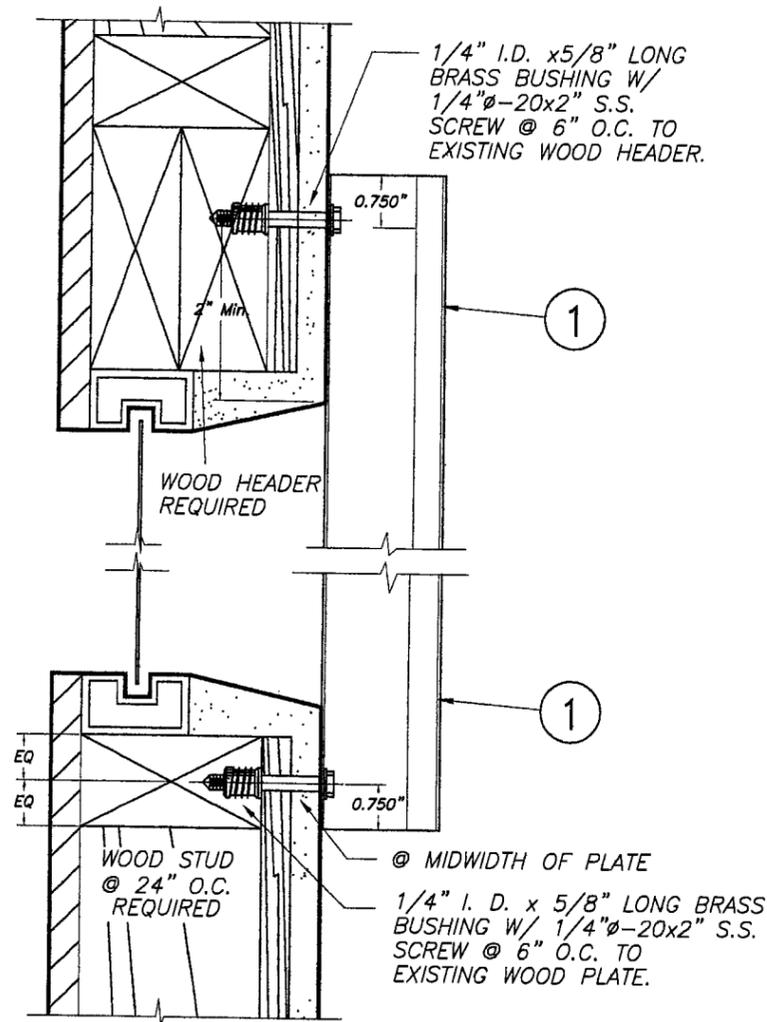

ALTERNATIVE 9

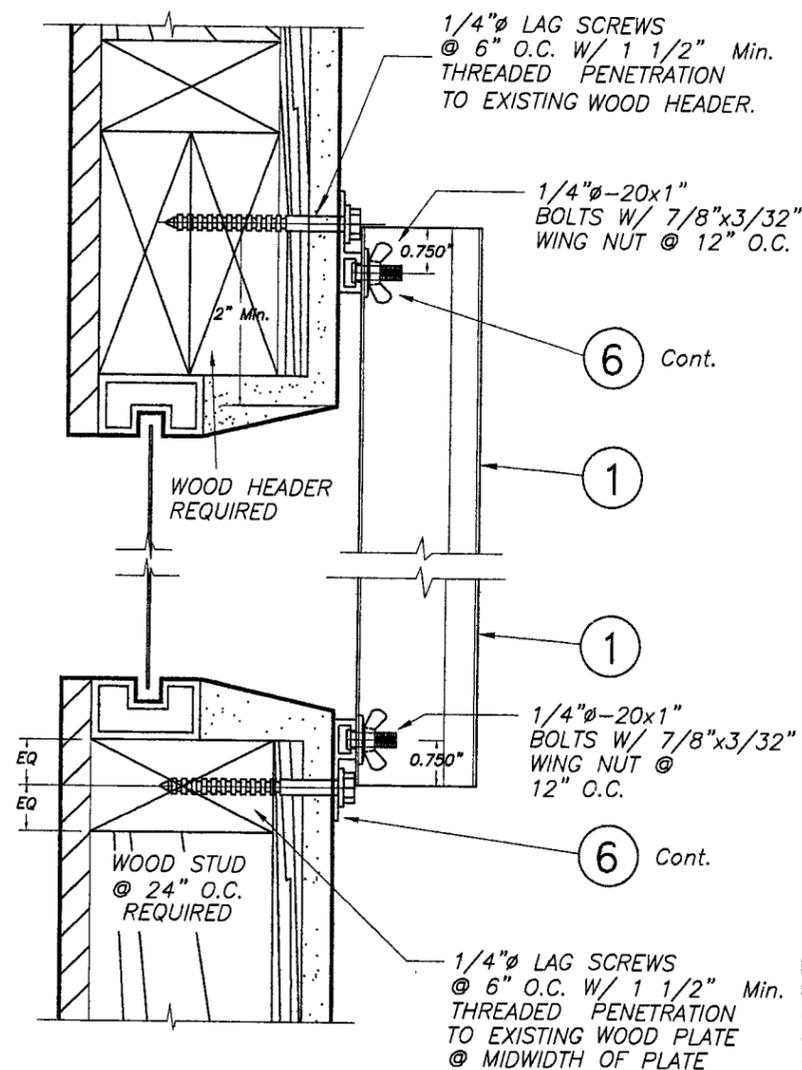

ALTERNATIVE 10

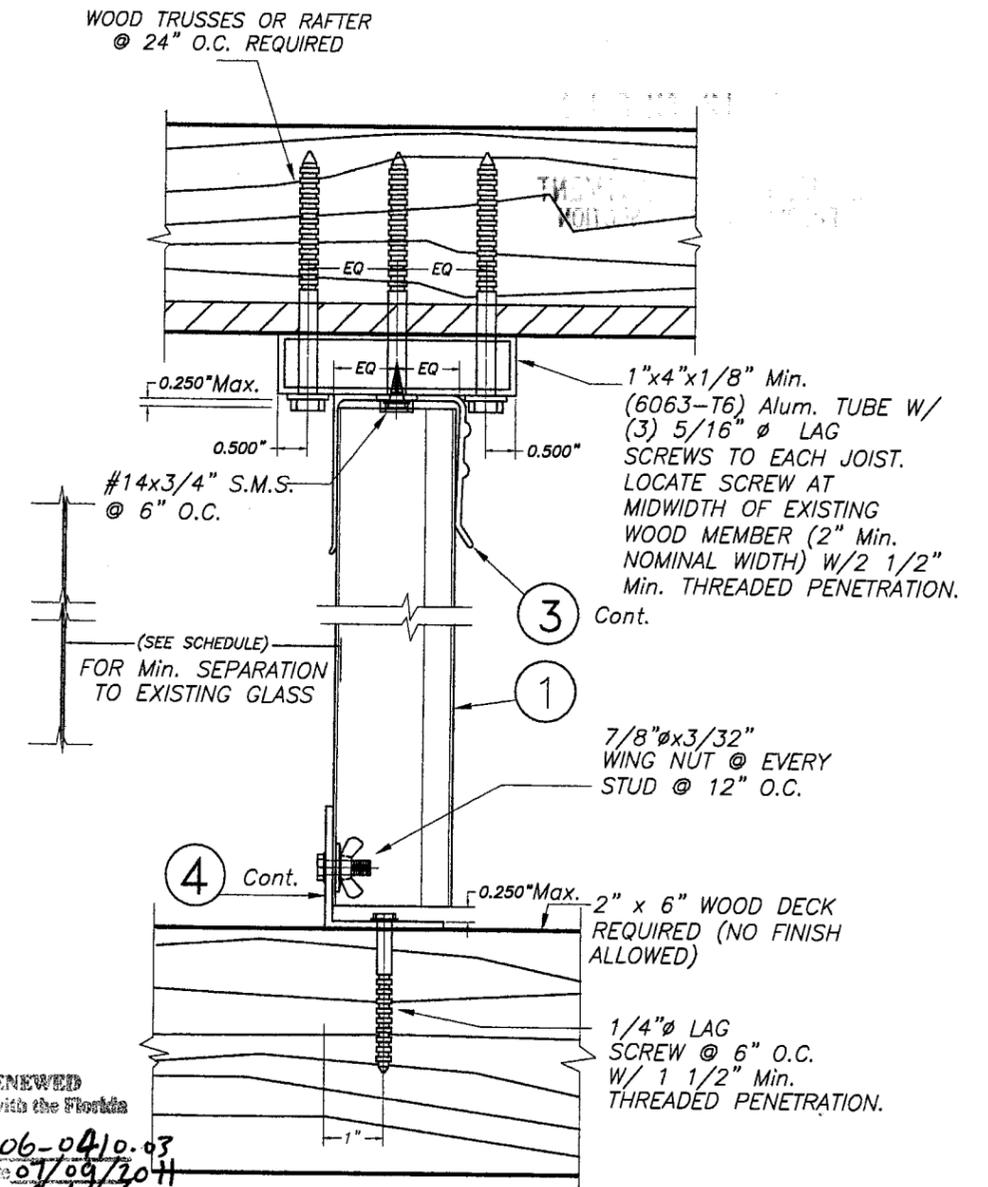

ALTERNATIVE 2

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 06-0410.03
Expiration Date 07/09/2011
By Helmut A. Mahr
Miami Dade Product Control
Division

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 05-0610.01
Expiration Date 07/09/2006
By Helmut A. Mahr
Miami Dade Product Control
Division

CEILING & FLOOR MOUNTING INSTALLATION - SECTION B

NOTES:

- INSTALLATIONS ARE ONLY VALID FOR DESIGN WIND LOADS up to +60.0, -76.0 p.s.f. AND PANEL'S LENGTHS UP TO 8'-10".
- NEW 2" x 6" P. T. TO BE SOUTHERN PINE No. 2, SURFACED DRY WITH 19 % M. C. W/ SPECIFIC DENSITY OF 0.55.
- FOR NEW WOOD FRAME CONSTRUCTION: WOOD MEMBERS TO BE SOUTHERN PINE No. 2, W/ SPECIFIC DENSITY OF 0.55 OR EQUAL.

NOTE FOR COMBINATION OF SECTIONS:
FLOOR/ WALL/ CEILING MOUNTING SECTIONS CAN BE COMBINED IN ANY WAY TO SUIT ANY INSTALLATION.

Handwritten signature
7/8/05

F.B.C. (High Velocity Hurricane Zone)

TILECO INC.		ALUMINUM WORLD, INC		DRAWN BY: M.C.V.
TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 38th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone: (305)871-1530 . Fax: (305)871-1531 EB-0006719 WALTER A. TILLIT Jr. P. E. FLORIDA Lic. # 44167		4401 E. 10 AVENUE HIALEAH, FL 33013.		05/6/05 DATE
				05-109 DRAWING No
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION
1	OLD 02-375	05/06/05	3	-
2	GENERAL	07/08/05	4	-
				SHEET 7 OF 7