



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**NOTICE OF ACCEPTANCE (NOA)**

[www.miamidade.gov](http://www.miamidade.gov)

Jeld - Wen, Inc.(OR)  
3737 Lakeport Blvd.  
Klamath Falls, OR 97601

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "6'-8" F/E Outswing Opaque Premium Fiberglass Door"**

**APPROVAL DOCUMENT:** Drawing No. **JW062006**, titled "6'-8" O/S Opaque Premium Fiberglass Door (N.I.)", sheets 1 through 10 of 10, dated 04/18/06 with revision A dated 11/06/06, prepared by PTC, LLC, signed and sealed by Eric S. Nielsen, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: NONE**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**APPROVAL** of this NOA shall be considered after an approval application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P.E.**



*J. Gascon*  
*3/30/07*

NOA No 06-0613.11  
Expiration Date: April 19, 2012  
Approval Date: April 19, 2007  
Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No. **JW062006**, titled "6'-8" O/S Opaque Premium Fiberglass Door (N.I.)", sheets 1 through 10 of 10, dated 04/18/06 with revision A dated 11/06/06, prepared by PTC, LLC, signed and sealed by Eric S. Nielsen, P.E.,

**B. TESTS**

1. Test reports on: : 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Forced Entry Test, per FBC 3603.2 (b) and 2411.3.2.1, TAS 202-94  
along with marked-up drawings and installation diagram, prepared by Architectural Testing, Inc., Test Report No. **63496.01-301-18**, dated 03 /31/06, signed and sealed by Joseph A. Reed, P.E.
2. Test reports on:  
1) Surface Burning Characteristics of Building Materials ASTM E 84-05, along with marked-up drawings and installation diagram, prepared by Intertek ETL Semko, Test Report No. **3081208**, dated 07 /28/05, signed and sealed by Stephen J. Emerman, P.E.
3. Test reports on:  
1) Self-Ignition Temperature ASTM D 1929-96,  
2) Rate of Burning ASTM D 635-03,  
along with marked-up drawings and installation diagram, prepared by ETC Laboratories, Test Report No. **ETC-05-056-16240.0**, dated 04 /27/05, signed and sealed by Joseph Labora Doldan, P.E.
4. Test reports on:  
1) Mechanical Property Tests of Plastic Materials ASTM D 638, along with marked-up drawings and installation diagram, prepared by ETC Laboratories, Test Report No. **ETC-05-056-17003.0**, dated 12 /05/05, signed and sealed by Joseph Labora Doldan, P.E.

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC-2004 (Supplement 2006), prepared by PTC, LLC, dated 03/05/07, signed and sealed by Eric S. Nielsen, P.E.  
**Complies with ASTM E1300-98/02.**

  
Jaime D. Gascon, P.E.

Chief, Product Control Division  
NOA No 06-0613.11  
Expiration Date: April 19, 2012  
Approval Date: April 19, 2007

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**


1. Notice of Acceptance No. **06-0411.01** issued to Jeld-Wen., Inc. for their “**Premium Fiberglass Door Skin with PURfiber – Component Approval**” dated 08/17/06, expiring on 08/17/11.

**F. STATEMENTS**

1. Laboratory compliance letter for Test Report no. ATI- 63496.01-301-18, issued by Architectural Testing, dated March 31, 2006, signed and sealed by Joseph A. Reed, P.E.
2. Statement letter of no financial interest, dated February 14, 2006, signed by Steve Saffell of Jeld-Wen, Inc.

**G. OTHER**

1. N/A

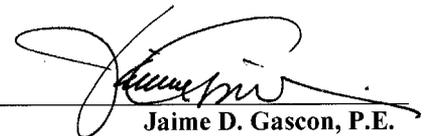

**Jaime D. Gascon, P.E.**  
**Chief, Product Control Division**  
**NOA No 06-0613.11**  
**Expiration Date: April 19, 2012**  
**Approval Date: April 19, 2007**

# JELD-WEN®

PREMIUM FIBERGLASS DOOR  
OUT-SWING 6-8 OPAQUE

**GENERAL NOTES**

1. THIS PRODUCT IS DESIGNED TO MEET THE 2004 FLORIDA BUILDING CODE AND HVHZ REQUIREMENTS.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. IMPACT RESISTANT SHUTTERS ARE REQUIRED
5. DESIGNED PRESSURE RATING SEE TABLE 1, PAGE 1.
6. SIDELITES ARE AN OPTION AND CAN BE IN A SINGLE OR DOUBLE CONFIGURATION.
7. THIS PRODUCT DOES NOT MEET THE WATER REQUIREMENTS FOR HIGH WIND ZONE VELOCITY AREA WHEN USING THE LOW PROFILE BUMPER THRESHOLD.

**RESIDENTIAL FIBERGLASS DOOR**  
(Common to all frame conditions)

**Door Leaf Construction:**

Face sheets: Fiberglass avg. min. yield strength

Fy(min.)=6,600 psi

Skin - 0.065" nominal

Core design: Expanded Polystyrene foam core, with 1.0 to 1.25 lbs/cf density.

Panel Construction: The panel skin is constructed from a 0.065" nominal fiberglass skin.

The panel face sheets are glued to a wood bottom rail and LVL top rail & stiles. In the double door application the inactive door is fitted with an extruded aluminum astragal (Endura) of 6063-T5 alloy.


Sidelite Construction: Panels are sandwich glazed using a two piece ODG (Thermofil-P6-30FM0391) lite frame. Glazing consists of two 0.125" tempered panes separated by a 0.25" air space. The lite frames are wet glazed on the interior and exterior side with Dow Corning 1199 sealant.

Frame Construction: The frames are constructed of finger-jointed pine jambs measuring 4-9/16" x 1-1/4". The head jambs are mortised and butt joined to the side jambs, and attached with three (3) 16GA, 7/16" crown x 2" long staples on each side. The threshold is attached to the side jambs with three (3) 16GA 7/16" crown x 2" long staples on each side.

TABLE 1

DOUBLE DOOR DESIGN PRESSURE RATING AND SINGLE DOOR WITH 15.5" O.A. MAX WIDTH SIDELITES		SINGLE DOOR DESIGN PRESSURE RATING WITHOUT SIDELITES	
POSITIVE	+60	POSITIVE	+65
NEGATIVE	-60	NEGATIVE	-65

\* CAN BE UTILIZED WHERE OVERHEAD REQUIREMENTS MEET THE 2004 FBC SECTION R 4410.2.3.2.1

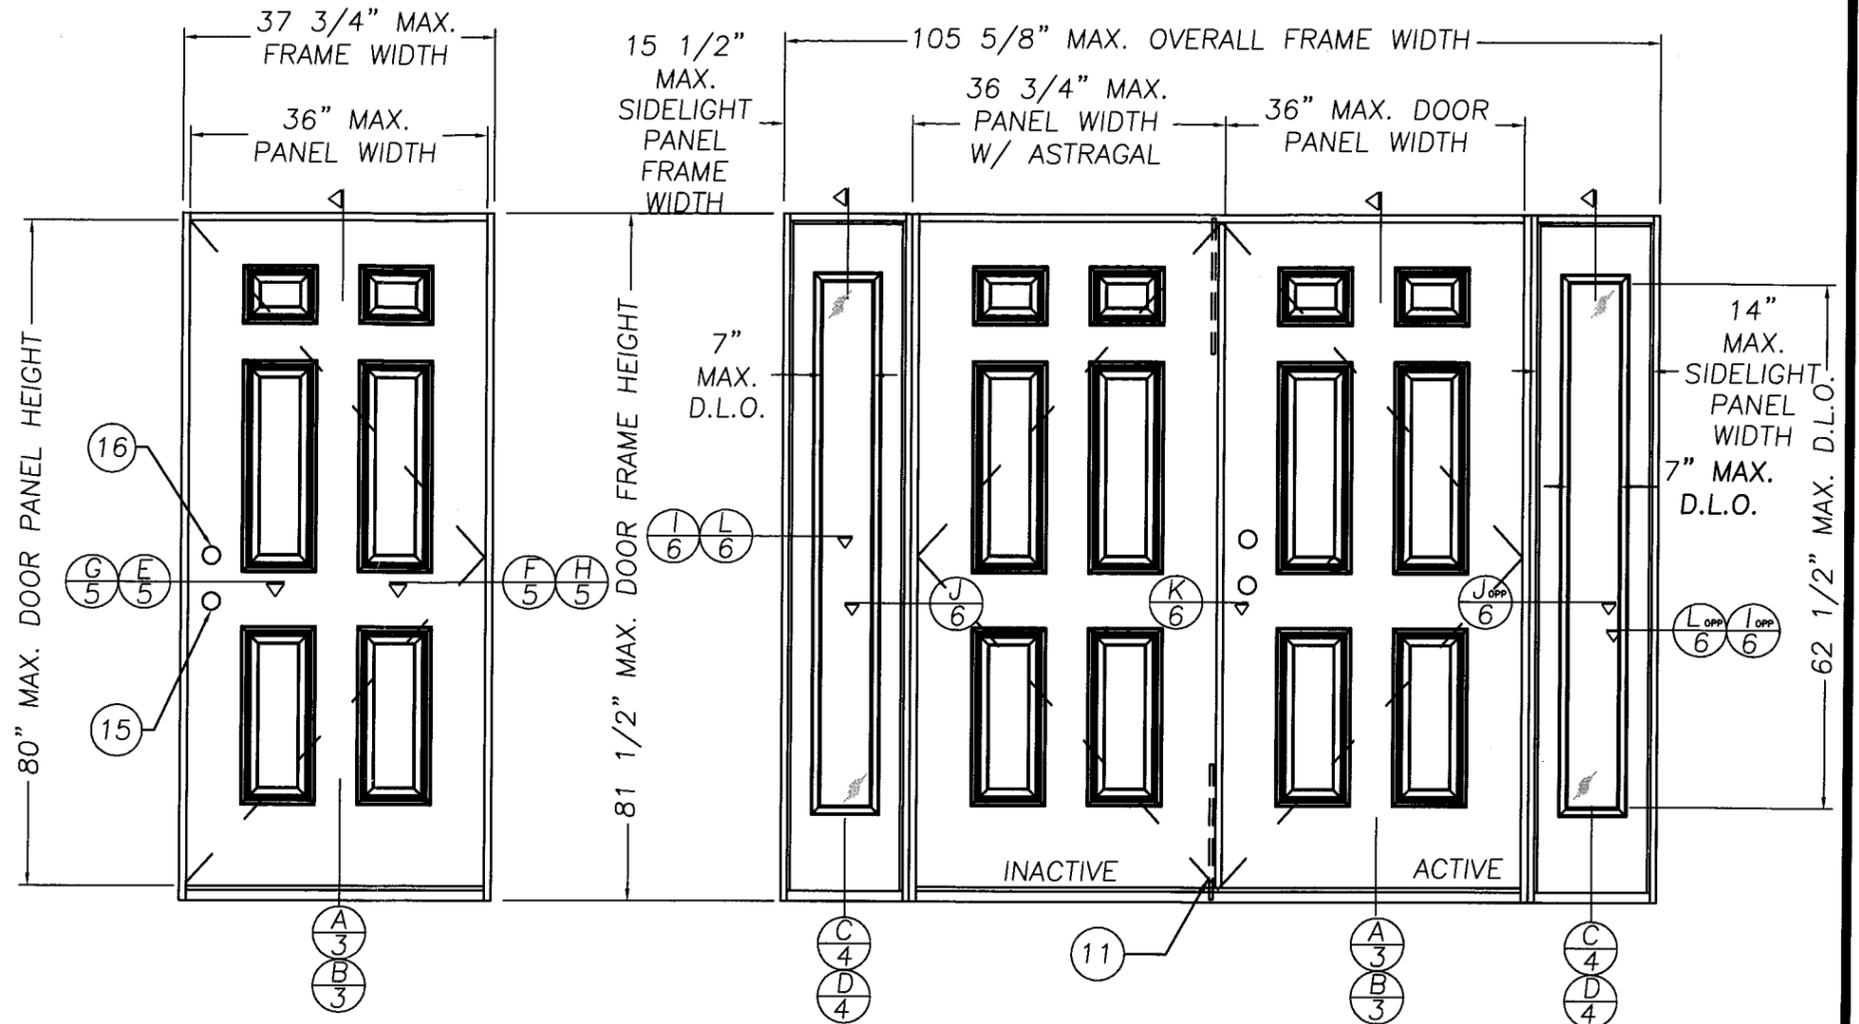

**SINGLE OUT-SWING UNIT**

**DOUBLE OUT-SWING UNIT W/SIDELITES**

**TABLE OF CONTENTS**

SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS & NOTES
2	TYPICAL ELEVATIONS & NOTES
3	VERTICAL CROSS SECTIONS
4	VERTICAL CROSS SECTIONS
5	HORIZONTAL CROSS SECTIONS
6	HORIZONTAL CROSS SECTIONS
7	ANCHORING LOCATIONS & DETAILS
8	ANCHORING LOCATIONS & DETAILS
9	COMPONENTS
10	BILL OF MATERIALS

ALL DOOR MODELS ARE VIEWED FROM THE INTERIOR SIDE

Approved as complying with the Florida Building Code  
Date 04/19/2007  
NOA# 06-0613.13  
Miami Dade Product Control Division  
By *[Signature]*

JELD-WEN, INC.

PHONE (541)-882-3451

3737 LAKEPORT BLVD. - KLAMATH FALLS, OR. 97601

TITLE: 6'-8" O/S OPAQUE PREMIUM FIBERGLASS DOOR

ELEVATIONS & NOTES

PREPARED BY:

**PTC**  
PTC, LLC

DRN:

S. SAFFELL

DATE: 4/18/06

SCALE:

N.T.S.

DWG. NO: JW062006

REV:


A

SHEET: 1 of 10

*[Signature]*  
11/16/06  
Eric S. Nielsen  
Florida P. E. No. 41323  
PTC, LLC  
1535 Cogswell Street, Suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935

SYM	REVISION	DATE	BY
A	CHANGES AS REQUESTED BY CLIENT	11/06/06	SAM

Phone 321.690.1788 Fax 321.690.1789

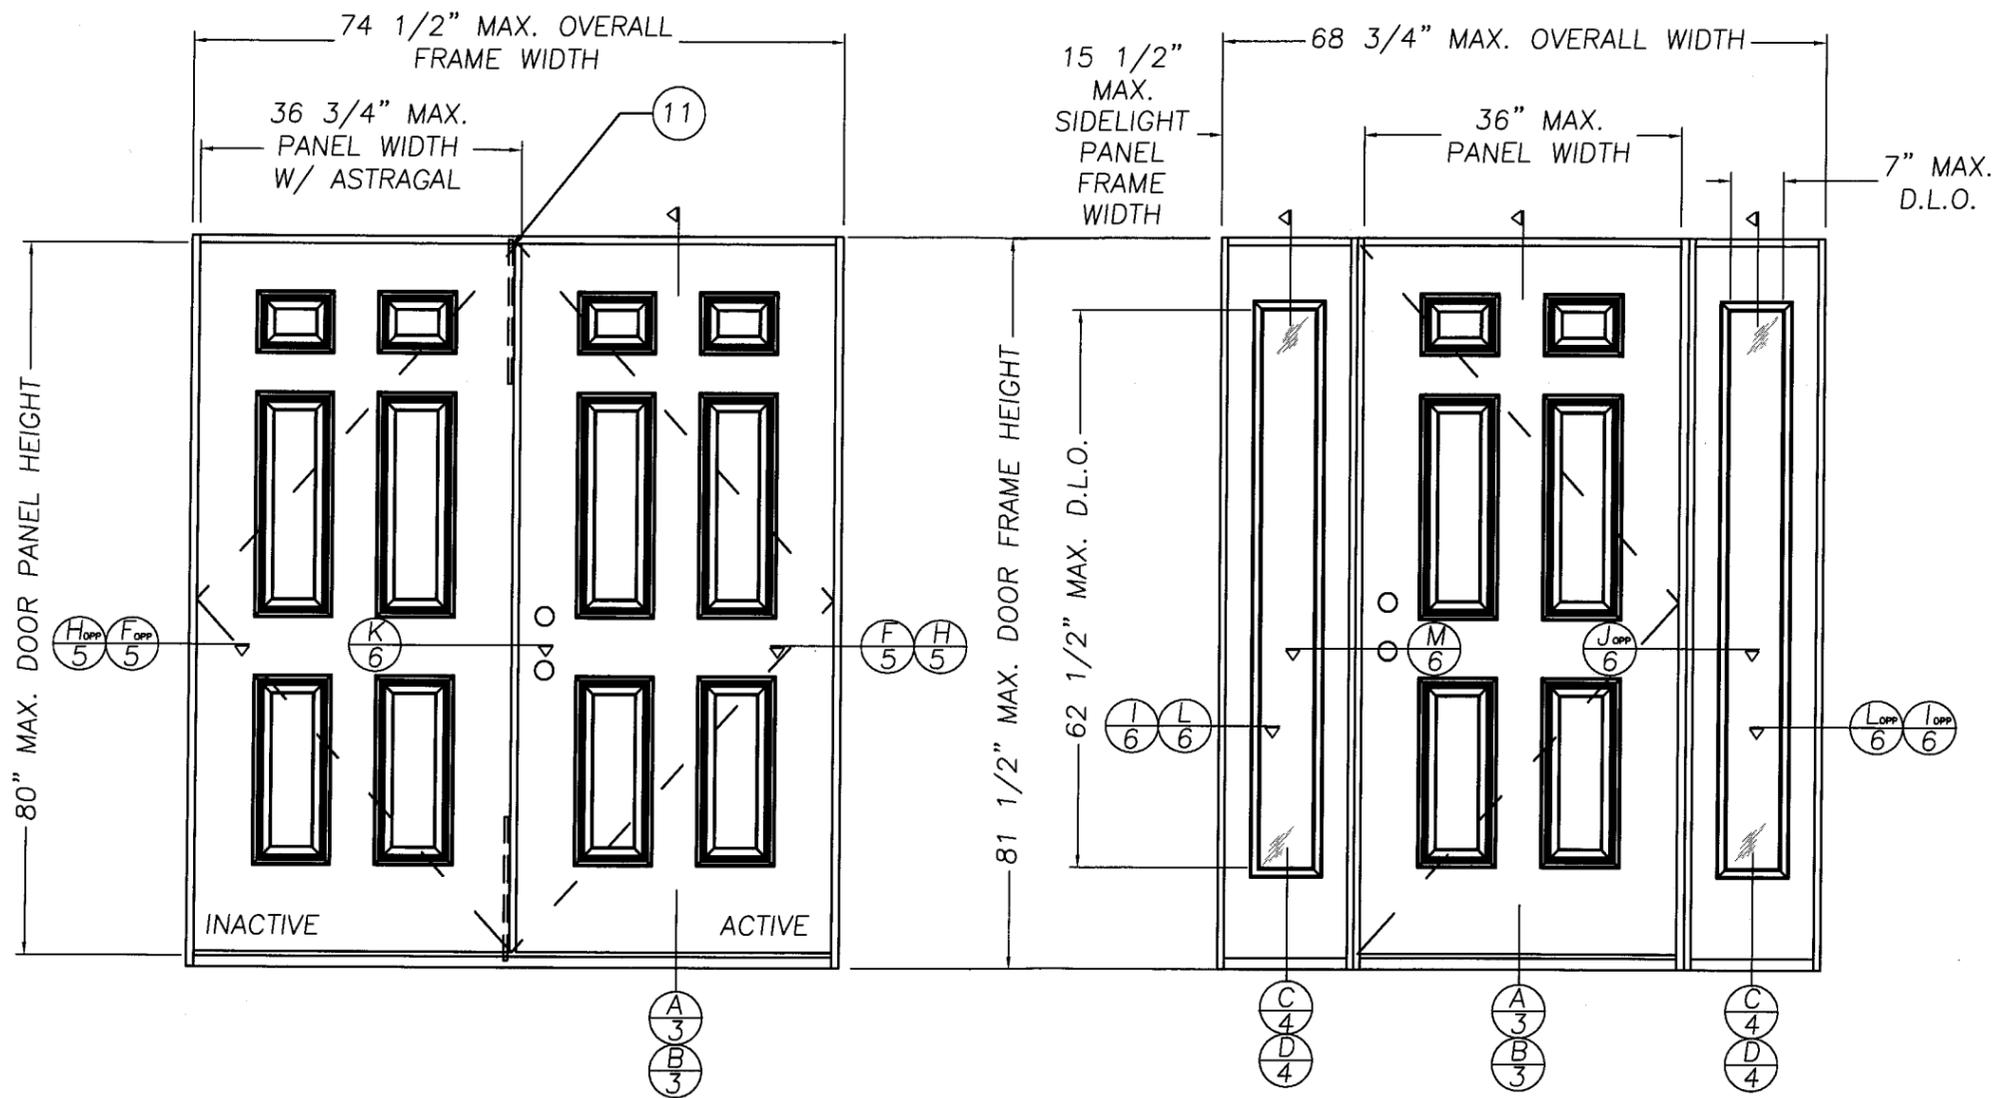

DOUBLE OUT-SWING UNIT

SINGLE OUT-SWING UNIT W/SIDELITES

Approved as complying with the  
 Florida Building Code  
 Date 04/19/2007  
 NOA# 06-0613.13  
 Miami Dade Product Control  
 Division  
 By [Signature]

ALL DOOR MODELS ARE VIEWED  
 FROM THE INTERIOR SIDE


SYM	REVISION	DATE	BY
A	CHANGES AS REQUESTED BY CLIENT	11/06/06	SAM

[Signature]  
 11/16/06  
 Eric S. Nielsen  
 Florida P. E. No. 41323  
 PTC, LLC  
 1535 Cogswell Street, Suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935


JELD-WEN, INC.  
 PHONE (541)-882-3451  
 3737 LAKEPORT BLVD. - KLAMATH FALLS, OR. 97601  
 TITLE: 6'-8" O/S OPAQUE PREMIUM FIBERGLASS DOOR  
 ELEVATIONS & NOTES

PREPARED BY: <b>PTC</b> PTC, LLC	DRN: S. SAFFELL	DATE: 4/18/06
SCALE: N.T.S.	DWG. NO: JW062006	
REV: A	SHEET: 2 of 10	


Phone 321.690.1788 Fax 321.690.1789

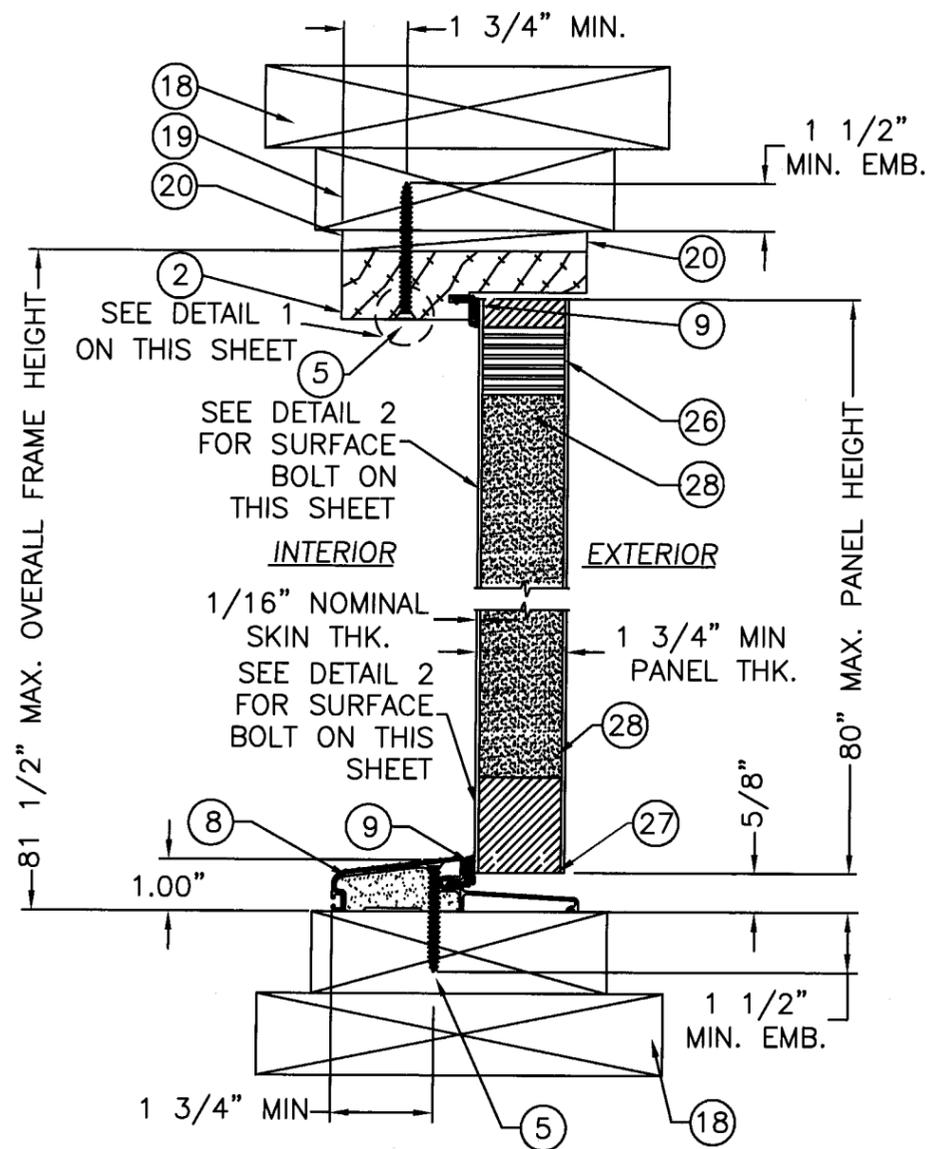


**A**  
3  
VERTICAL CROSS-SECTION  
DOOR PANEL

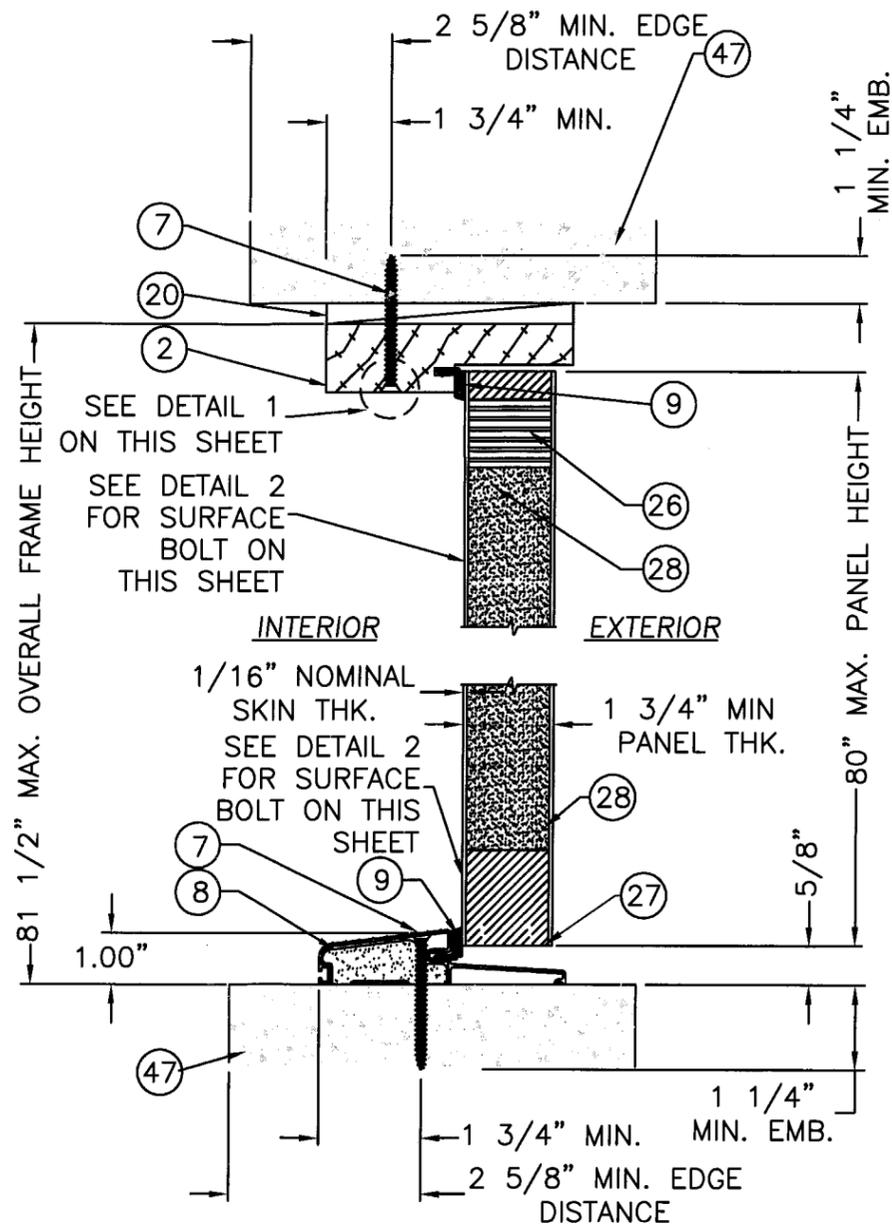

**B**  
3  
VERTICAL CROSS-SECTION  
DOOR PANEL

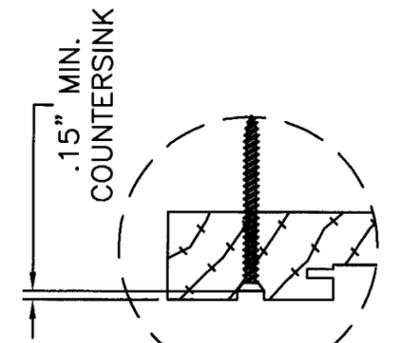

DETAIL 1  
COUNTERSINK IN HEAD

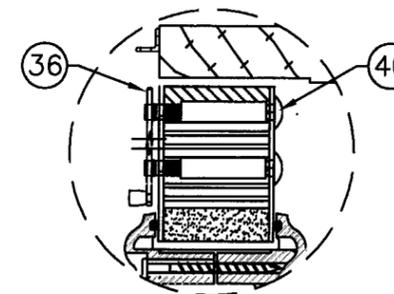

DETAIL 2  
SURFACE BOLT

Approved as complying with the  
Florida Building Code  
Date 04/19/2007  
NOA# 06-0613.13  
Miami Dade Product Control  
Division  
By [Signature]


SYM	REVISION	DATE	BY
A	CHANGES AS REQUESTED BY CLIENT	11/06/06	SAM

*EPNL*  
11/16/06  
Eric S. Nielsen  
Florida P. E. No. 41323  
PTC, LLC  
1535 Cogswell Street, Suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935


JELD-WEN, INC.  
PHONE (541)-882-3451  
3737 LAKEPORT BLVD. - KLAMATH FALLS, OR. 97601  
TITLE: 6'-8" O/S OPAQUE PREMIUM FIBERGLASS DOOR  
VERTICAL CROSS SECTIONS

PREPARED BY: <b>PTC</b> PTC, LLC	DRN: S. SAFFELL	DATE: 4/18/06
SCALE: N.T.S.	DWG. NO.:	JW062006
REV:	SHEET:	A 3 of 10

Phone 321.690.1788 Fax 321.690.1789

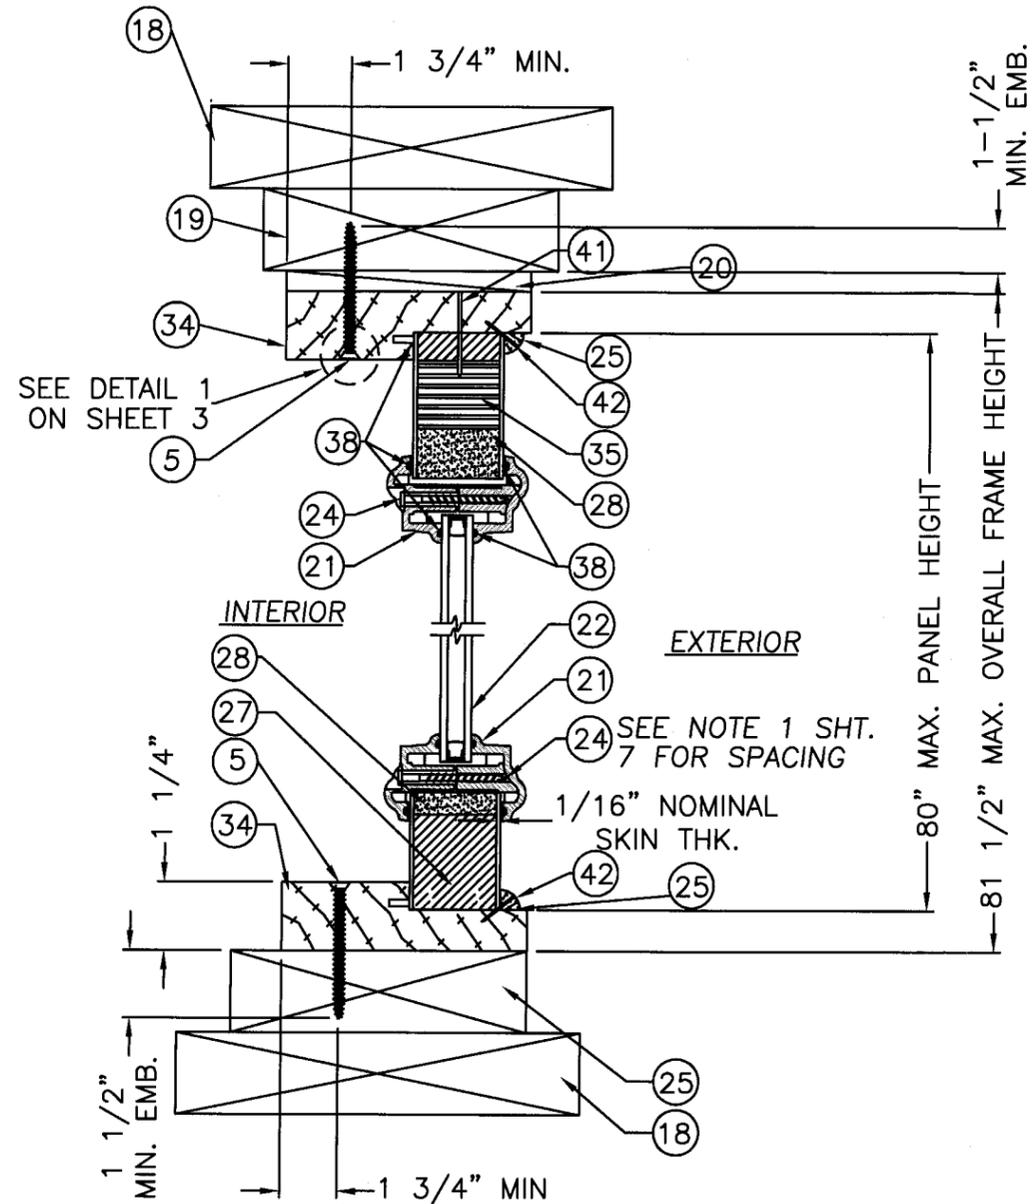

**C**  
4 VERTICAL CROSS-SECTION  
SIDE LITE PANEL

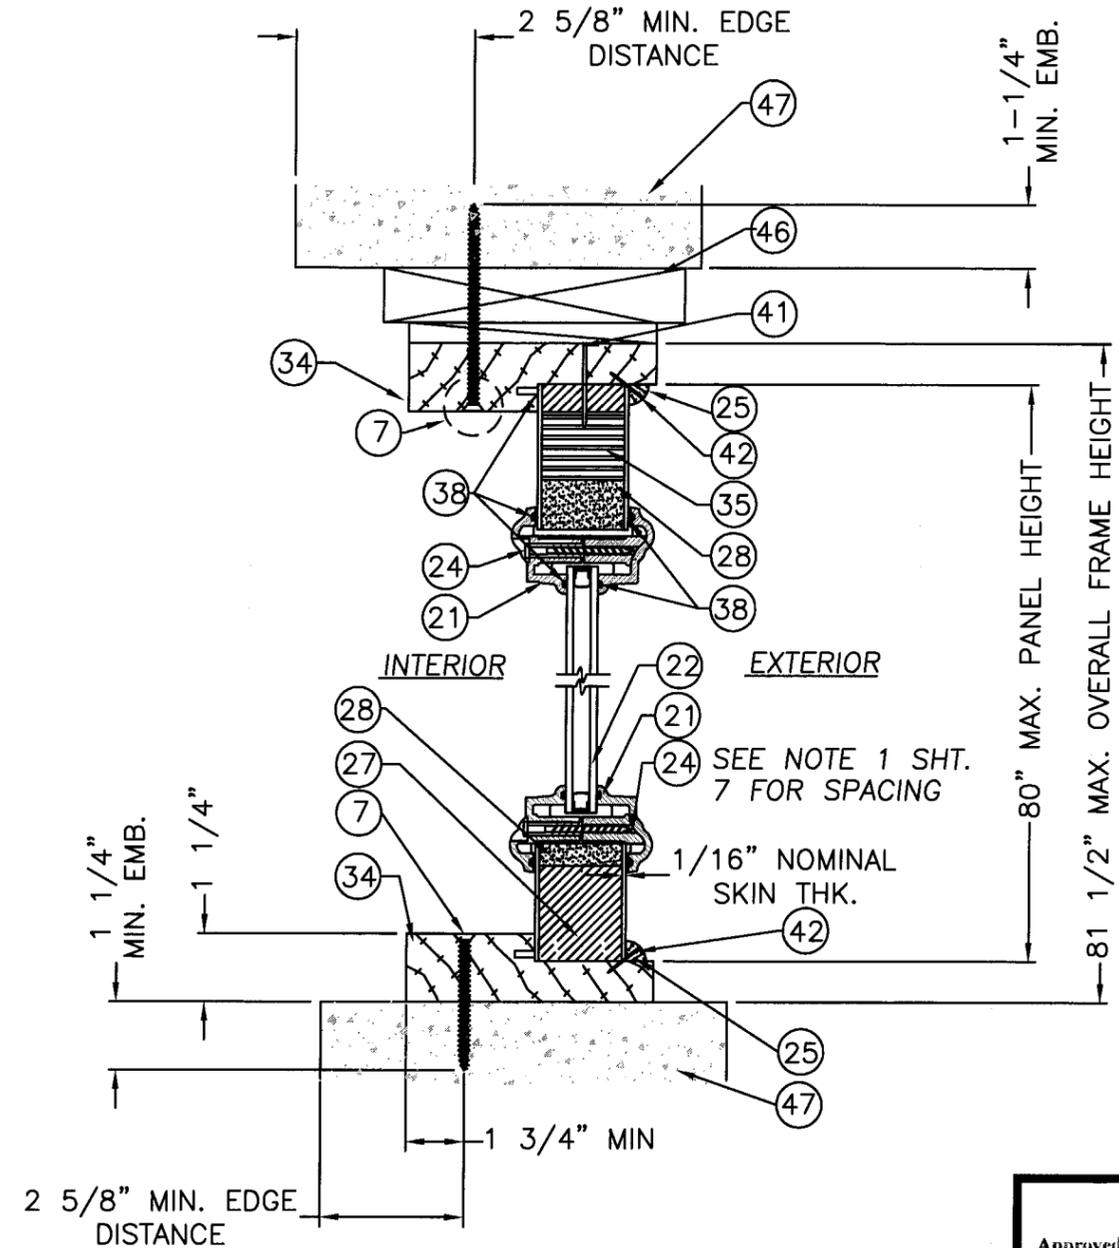

**D**  
4 VERTICAL CROSS-SECTION  
SIDE LITE PANEL

Approved as complying with the  
Florida Building Code  
Date 04/19/2007  
NOA# 06-0613.13  
Miami Dade Product Control  
Division  
By [Signature]

SYM	REVISION	DATE	BY
A	CHANGES AS REQUESTED BY CLIENT	11/06/06	SAM


*ESN*  
11/16/06  
Eric S. Nielsen  
Florida P. E. No. 41323  
PTC, LLC  
1535 Cogswell Street, Suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935

JELD-WEN, INC.  
PHONE (541)-882-3451  
3737 LAKEPORT BLVD. - KLAMATH FALLS, OR. 97601  
TITLE: 6'-8" O/S OPAQUE PREMIUM FIBERGLASS DOOR  
VERTICAL CROSS SECTIONS




PREPARED BY: <b>PTC</b> PTC, LLC	DRN: S. SAFFELL	DATE: 4/18/06
SCALE: N.T.S.	DWG. NO.: JW062006	
REV: A	SHEET: 4 of 10	

Phone 321.690.1788 Fax 321.690.1789

**E** HORIZONTAL CROSS SECTION  
5 AT LATCH JAMB TO BUCK, TYP.

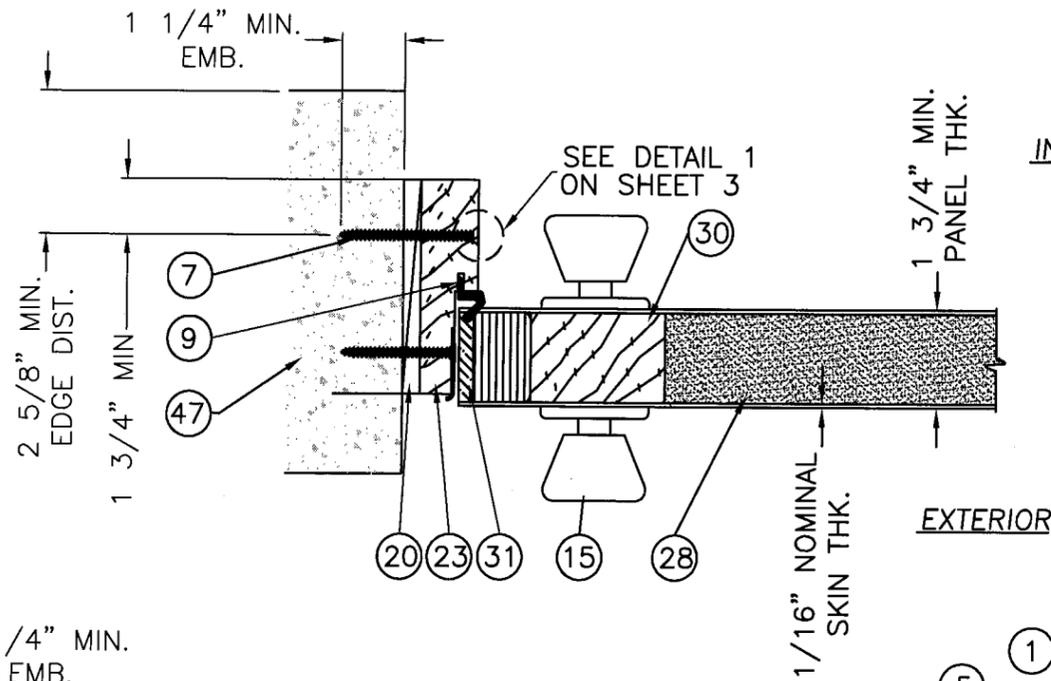

**F** HORIZONTAL CROSS SECTION  
5 AT HINGE JAMB TO BUCK, TYP.

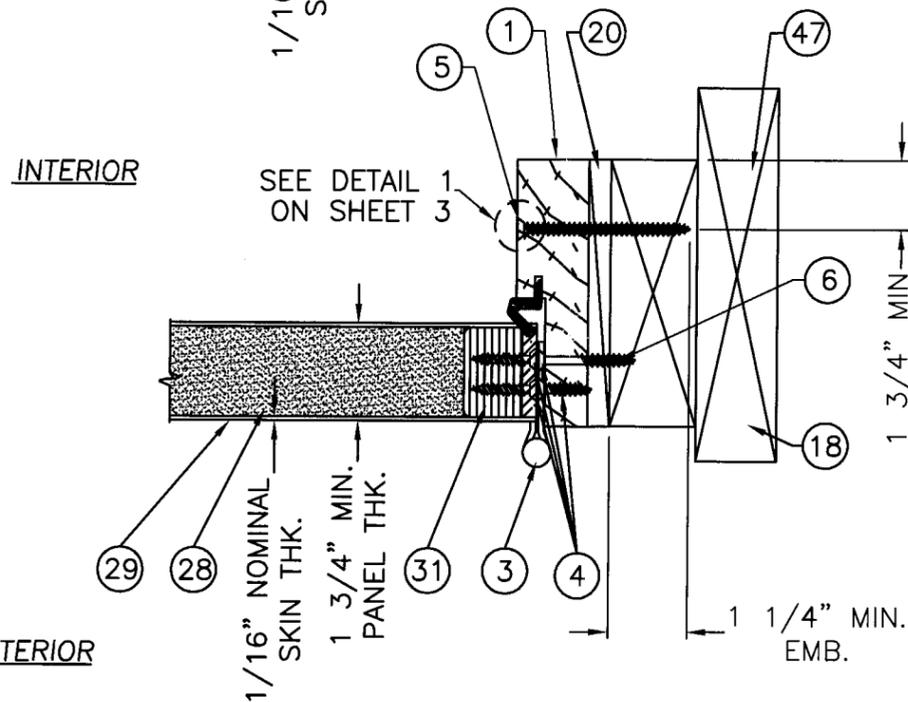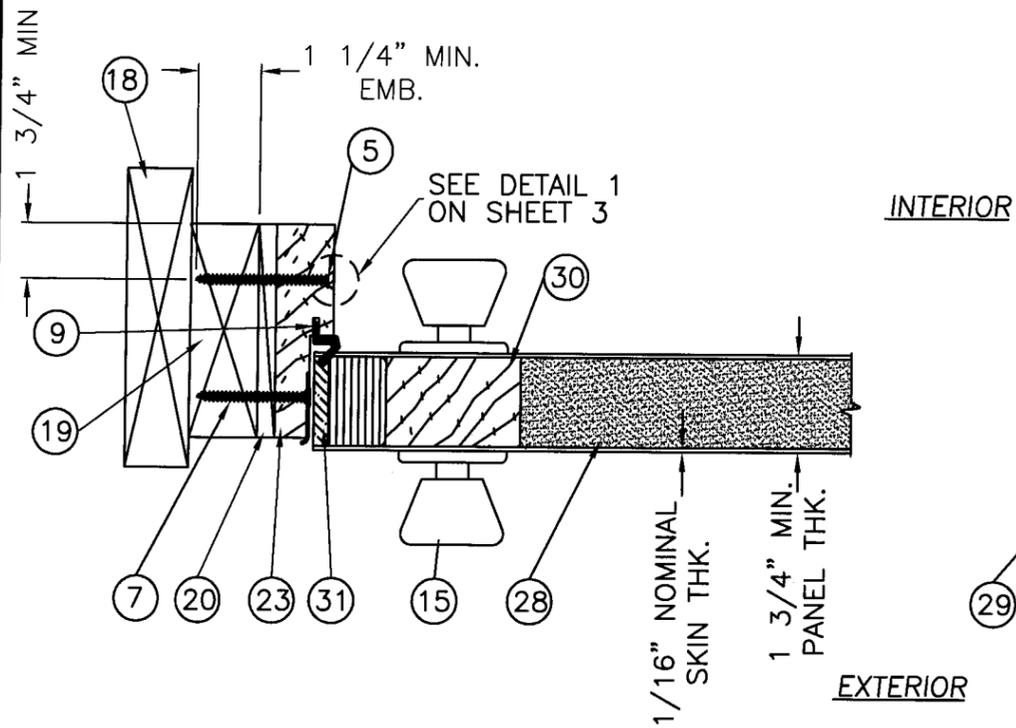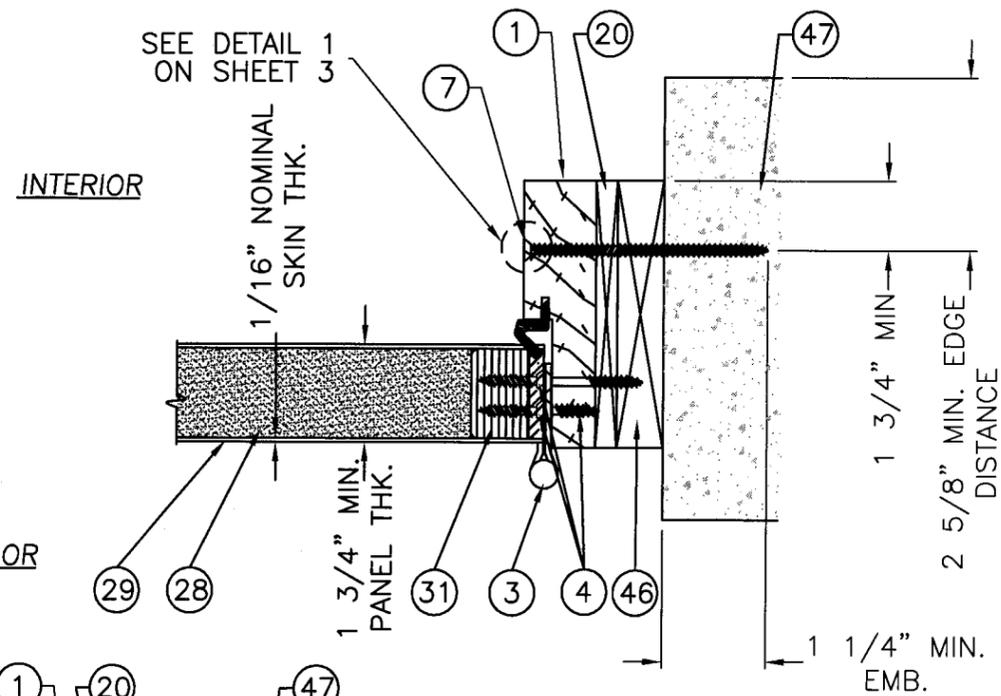

**G** HORIZONTAL CROSS SECTION  
5 AT LATCH JAMB TO BUCK, TYP.

**H** HORIZONTAL CROSS SECTION  
5 AT HINGE JAMB TO BUCK, TYP.

Approved as complying with the  
Florida Building Code  
Date 04/19/2007  
NOAH 06-0613.13  
Miami Dade Product Control  
Division  
By [Signature]


SYM	REVISION	DATE	BY
A	CHANGES AS REQUESTED BY CLIENT	11/06/06	SAM

*[Signature]*  
11/16/06  
Eric S. Nielsen  
Florida P. E. No. 41323  
PTC, LLC  
1535 Cogswell Street, Suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935

JELD-WEN, INC.  
PHONE (541)-882-3451  
3737 LAKEPORT BLVD. - KLAMATH FALLS, OR. 97601  
TITLE: 6'-8" O/S OPAQUE PREMIUM FIBERGLASS DOOR  
HORIZONTAL CROSS SECTIONS

PREPARED BY: <b>PTC</b> PTC, LLC	DRN: S. SAFFELL	DATE: 4/18/06
SCALE: N.T.S.	DWG. NO: JW062006	
REV: A	SHEET: 5 of 10	

Phone 321.690.1788 Fax 321.690.1789

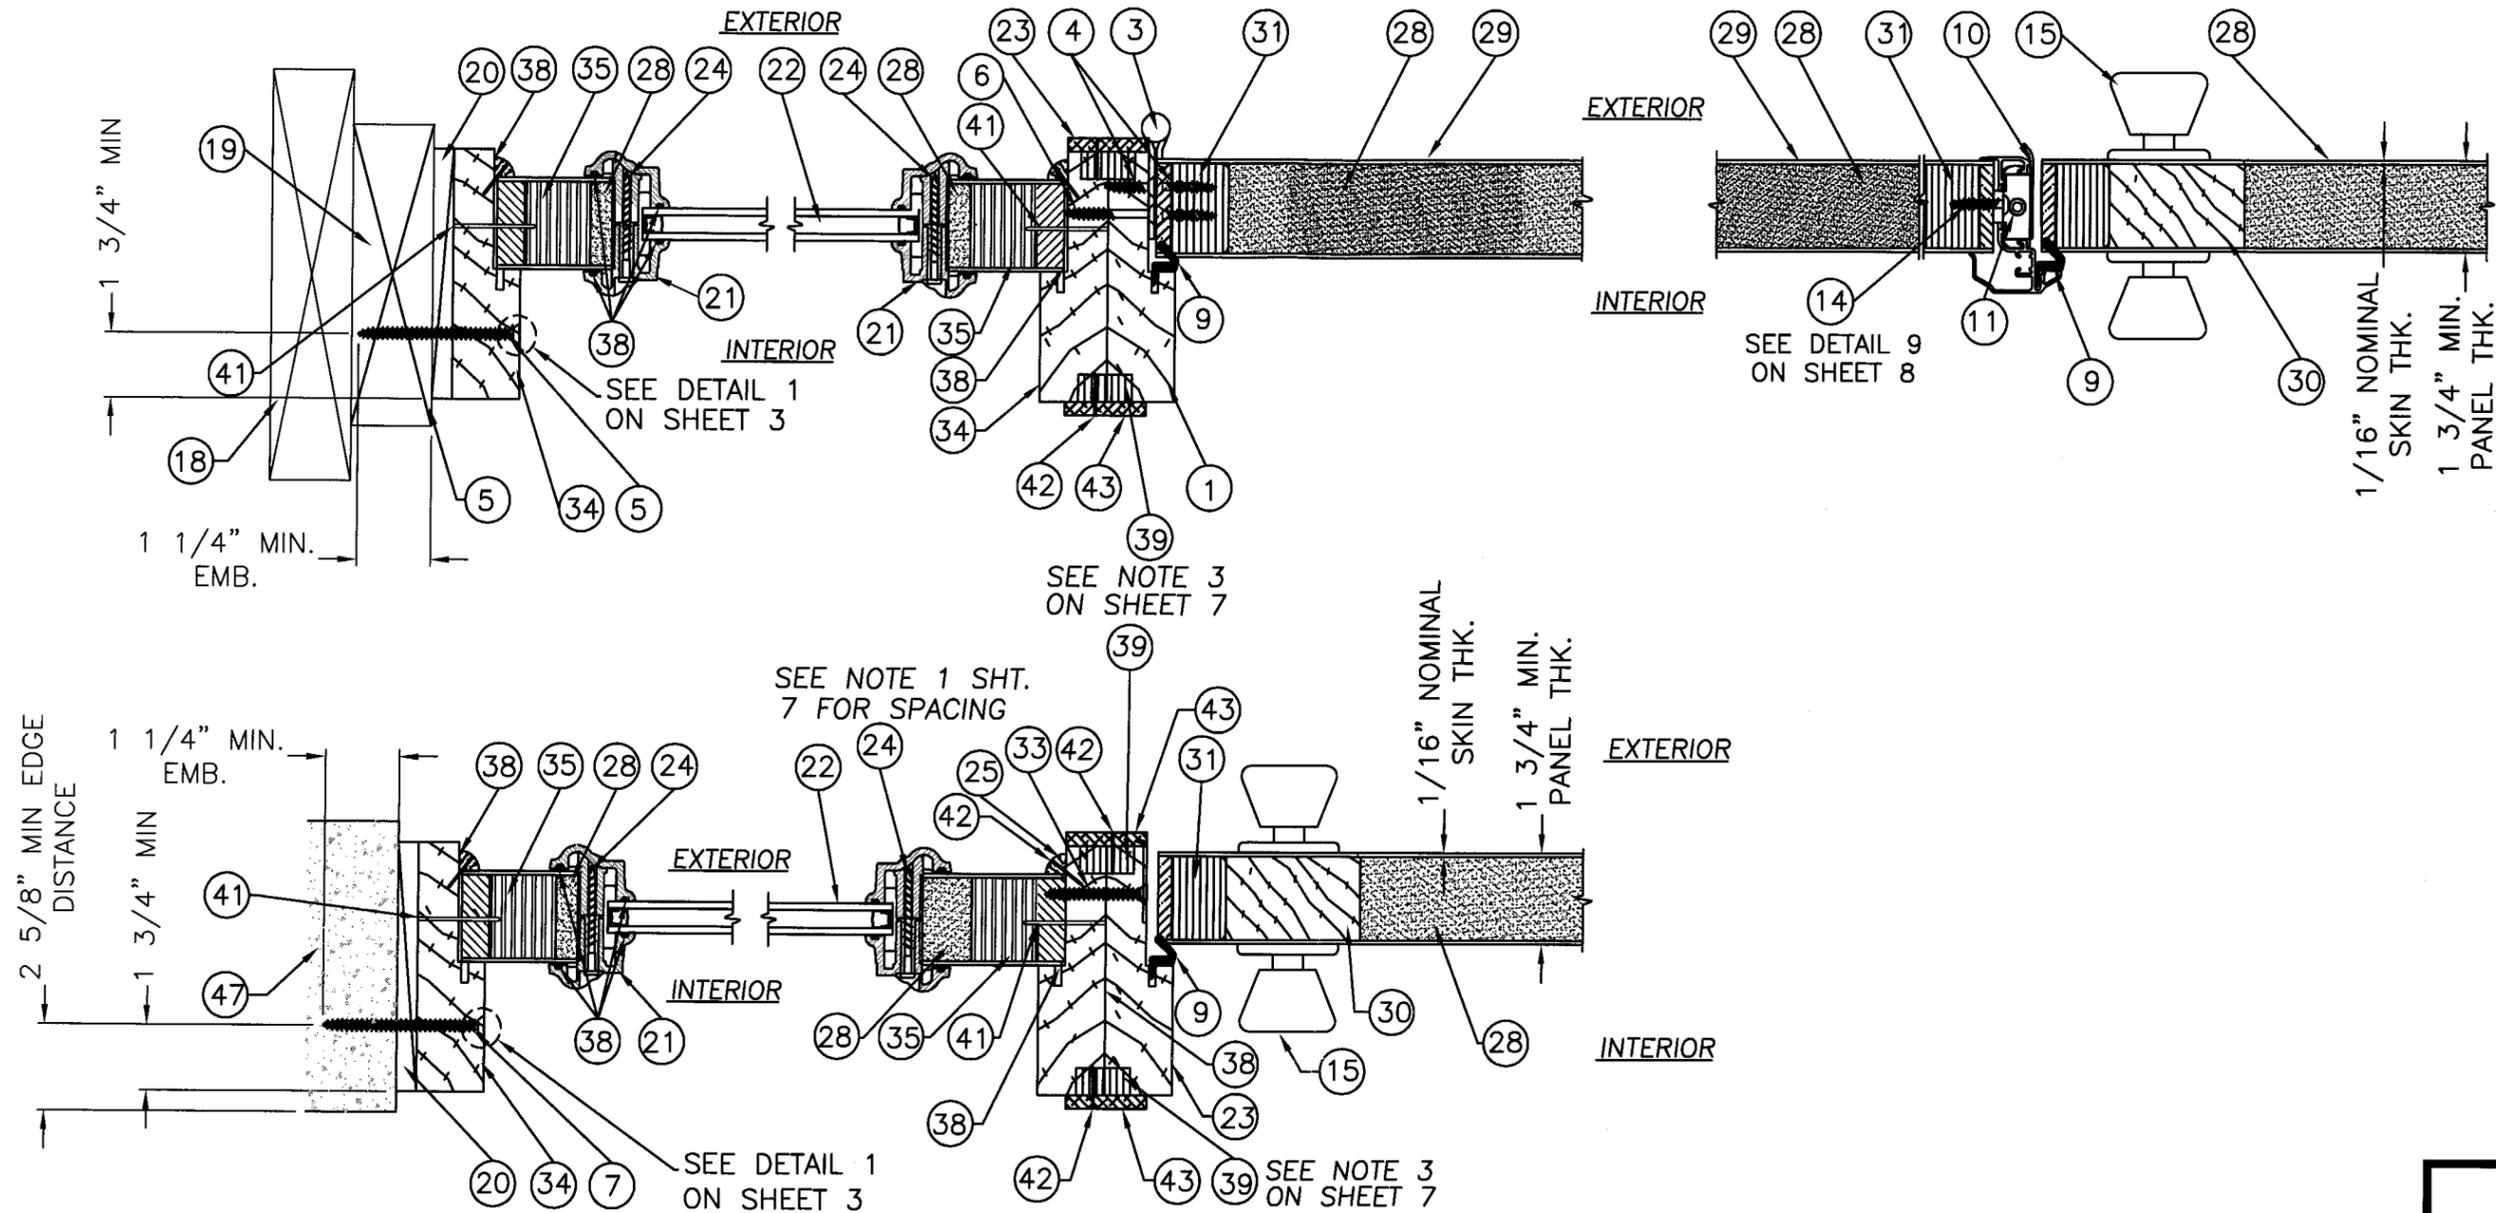

**L** HORIZONTAL CROSS SECTION  
6 AT SIDELITE

**M** HORIZONTAL CROSS SECTION  
6 AT SIDELITE TO LATCH JAMB

Approved as complying with the  
Florida Building Code  
Date 04/19/2007  
NOA# 06-061313  
Miami Dade Product Control  
Division  
By [Signature]


SYM	REVISION	DATE	BY
A	CHANGES AS REQUESTED BY CLIENT	11/06/06	SAM

*[Signature]*  
11/16/06  
Eric S. Nielsen  
Florida P. E. No. 41323  
PTC, LLC  
1535 Cogswell Street, Suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935

JELD-WEN, INC.  
PHONE (541)-882-3451  
3737 LAKEPORT BLVD. - KLAMATH FALLS, OR. 97601  
TITLE: 6'-8" O/S OPAQUE PREMIUM FIBERGLASS DOOR  
HORIZONTAL CROSS SECTIONS



PREPARED BY: <b>PTC</b> PTC, LLC	DRN: S. SAFFELL	DATE: 4/18/06
SCALE: N.T.S.	DWG. NO: JW062006	
REV: A	SHEET: 6 of 10	

Phone 321.690.1788 Fax 321.690.1789

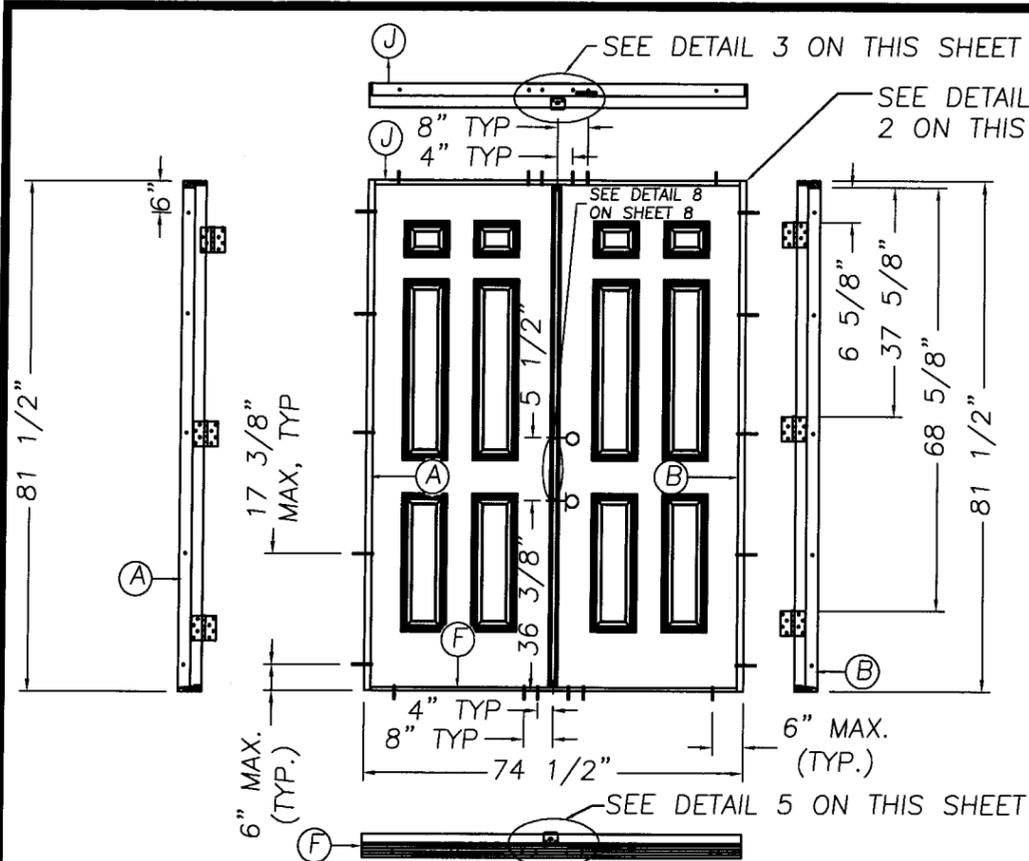

**DOUBLE DOOR ANCHORING LOCATIONS**

**DETAIL 4**

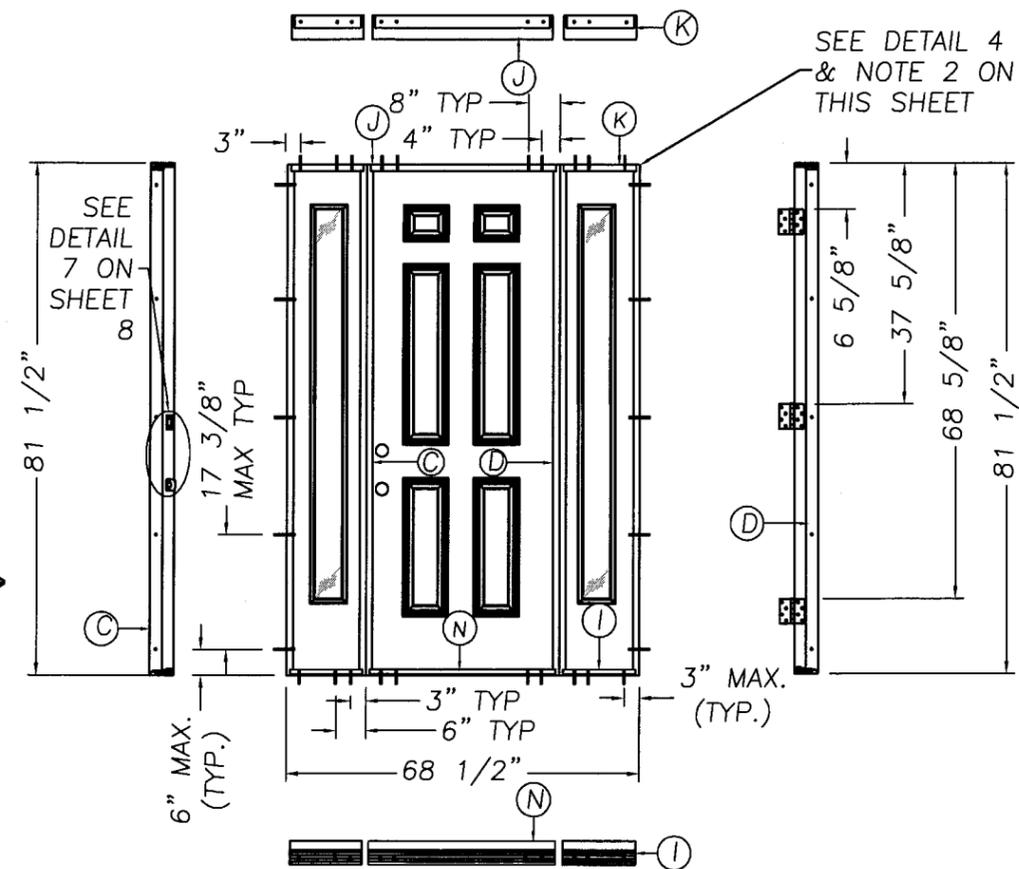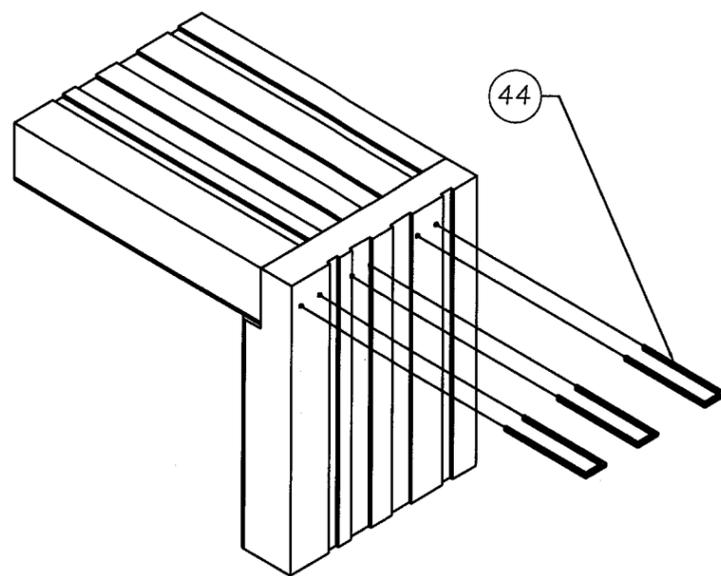


**SINGLE DOOR W/SIDELITES ANCHORING LOCATIONS**


**NOTES:**

1. SPACING FOR ITEM #24 (#8 x 1 1/2" TEK SCREW) IS AS FOLLOWS: TOP & BOTTOM; SIDELITE (2) SCREWS 3" IN FROM EACH CORNER. DOOR PANEL (2) SCREWS 3" IN FROM EACH CORNER, & (2) IN THE CENTER SPACED 5.75" O.C. SIDES FOR BOTH; (8) SCREWS 6.5", 16.375", 26.25", 36.125", 46", 55.875", 65.75" AND 75.625" FROM THE BOTTOM OF THE LITE FRAME.
2. THE HEAD JAMBS ARE JOINED TO THE SIDE JAMBS USING (3) 7/16" CROWN x 2" LONG WIRE STAPLES.
3. CORRUGATED NAILS (QTY 10) ARE EQUALLY SPACED ALONG BOTH FACES OF THE MULLION.

**DETAIL 5**

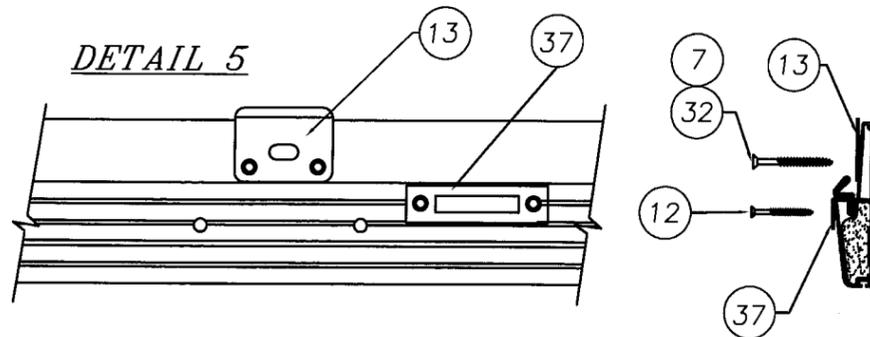


DRILL 3/8" ASTRAGAL RETAINER BOLT HOLE THRU THRESHOLD/MASONRY x 1-3/8" DEEP

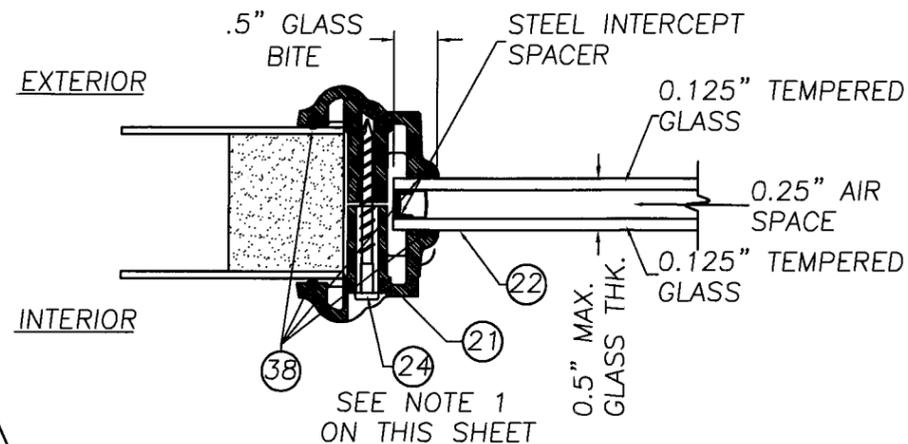

**GLAZING DETAIL INSULATED GLASS UNIT**

**DETAIL 3**

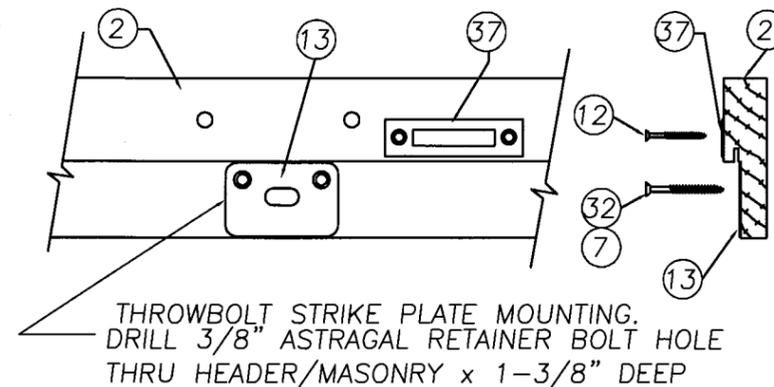

Approved as complying with the Florida Building Code  
 Date 04/19/2007  
 NOA# 06-0613.13  
 Miami Dade Product Control Division  
 By *[Signature]*


SYM	REVISION	DATE	BY
A	CHANGES AS REQUESTED BY CLIENT	11/06/06	SAM

*[Signature]*  
 11/16/06  
 Eric S. Nielsen  
 Florida P. E. No. 41323  
 PTC, LLC  
 1535 Cogswell Street, Suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935


**JELD-WEN, INC.**  
 PHONE (541)-882-3451  
 3737 LAKEPORT BLVD. - KLAMATH FALLS, OR. 97601  
 TITLE: 6'-8" O/S OPAQUE PREMIUM FIBERGLASS DOOR ANCHORING LOCATIONS & DETAILS

PREPARED BY: <b>PTC</b> PTC, LLC	DRN: S. SAFFELL	DATE: 4/18/06
	SCALE: N.T.S.	DWG. NO: JW062006
REV: A		SHEET: 7 of 10


Phone 321.690.1788 Fax 321.690.1789

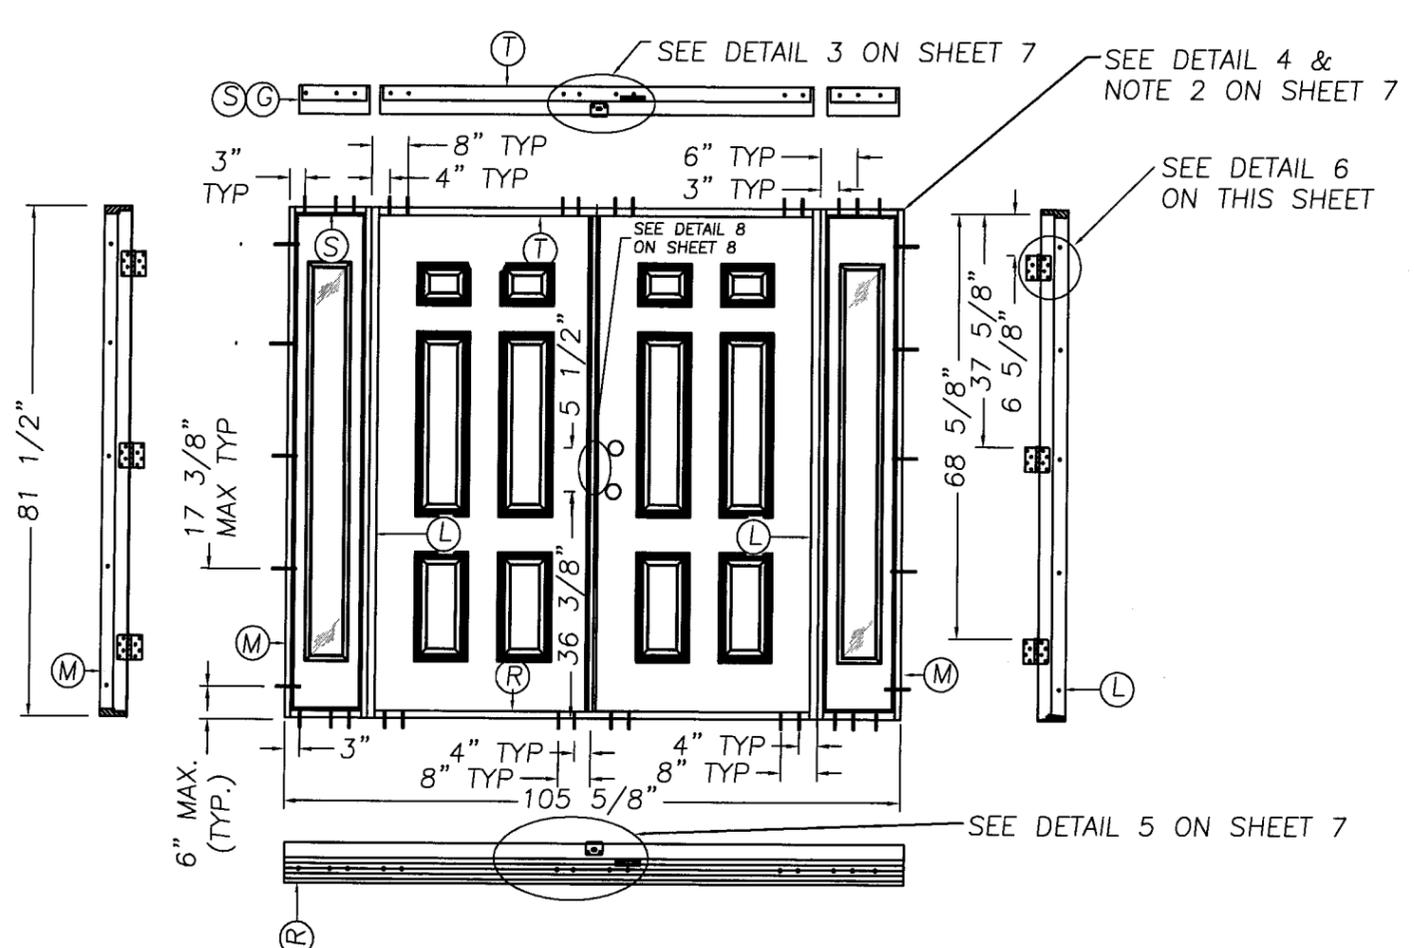


**DOUBLE DOOR W/SIDELITES ANCHORING LOCATIONS**

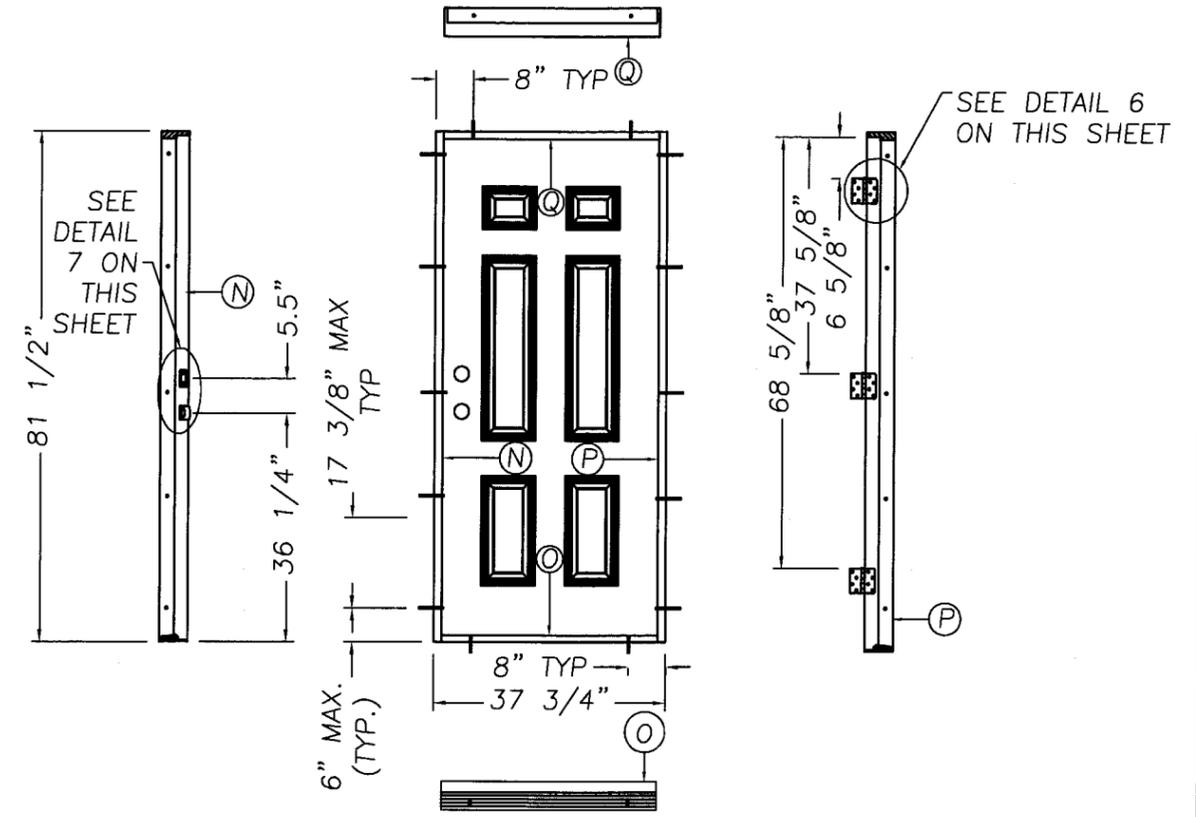


**SINGLE DOOR ANCHORING LOCATIONS**

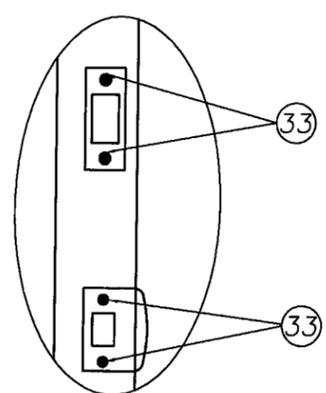


**DETAIL 8**  
STRIKE PLATE TO  
IMPERIAL ASTRAGAL

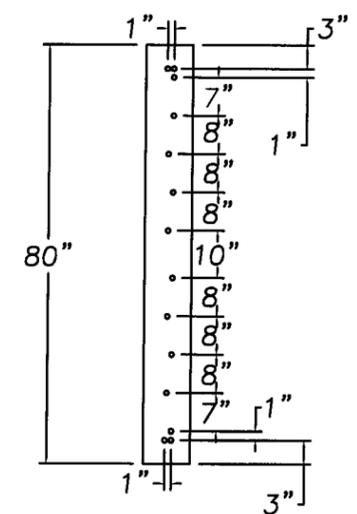

**DETAIL 9**  
FASTENER SPACING  
ENDURA ASTRAGAL

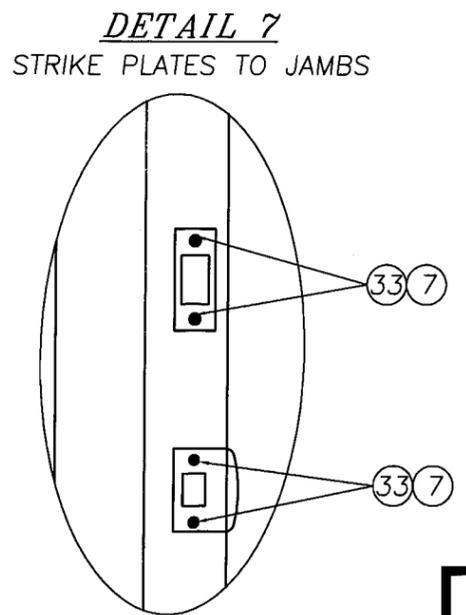

**DETAIL 7**  
STRIKE PLATES TO JAMBS

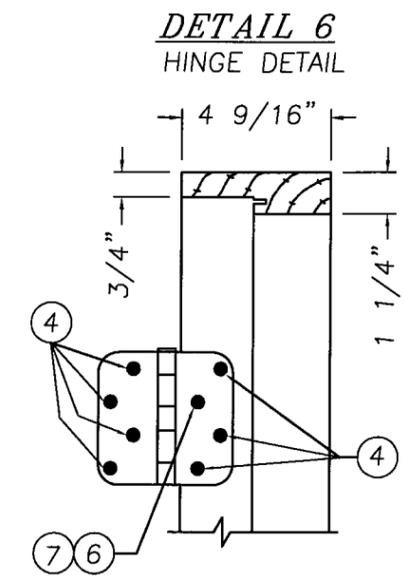

**DETAIL 6**  
HINGE DETAIL

Approved as complying with the  
Florida Building Code  
Date 04/19/2007  
NOA# 06-0613-13  
Miami Dade Product Control  
Division  
By [Signature]


SYM	REVISION	DATE	BY
A	CHANGES AS REQUESTED BY CLIENT	11/06/06	SAM

*ESN*  
11/16/06  
Eric S. Nielsen  
Florida P. E. No. 41323  
PTC, LLC  
1535 Cogswell Street, Suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935

**JELD-WEN, INC.**  
PHONE (541)-882-3451  
3737 LAKEPORT BLVD. - KLAMATH FALLS, OR. 97601  
TITLE: 6'-8" O/S OPAQUE PREMIUM FIBERGLASS DOOR  
ANCHORING LOCATIONS & DETAILS


PREPARED BY: <b>PTC</b> PTC, LLC	DRN: S. SAFFELL	DATE: 4/18/06
SCALE: N.T.S.	DWG. NO: JW062006	
REV: A	SHEET: 8 of 10	

Phone 321.690.1788 Fax 321.690.1789

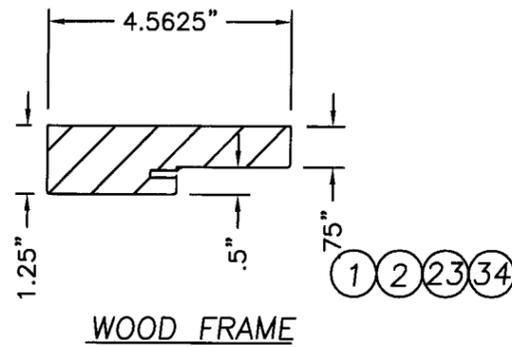


WOOD FRAME

① ② ③ ④

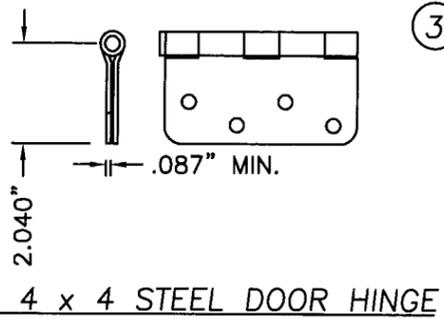

4 x 4 STEEL DOOR HINGE

③

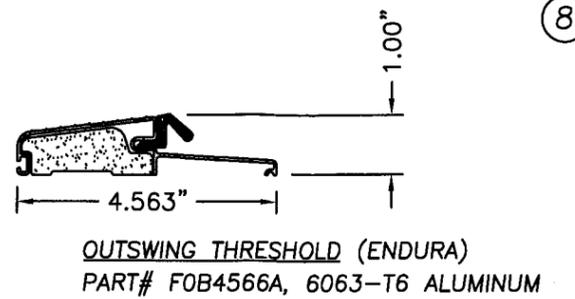


OUTSWING THRESHOLD (ENDURA)  
PART# FOB4566A, 6063-T6 ALUMINUM

⑧




COMPRESSION WEATHERSTRIP  
Q-LON QDS 650

⑨

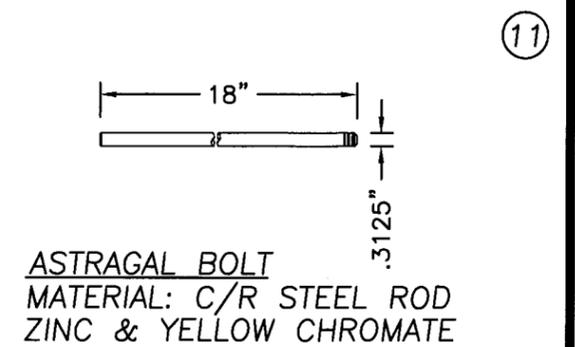

ASTRAGAL BOLT  
MATERIAL: C/R STEEL ROD  
ZINC & YELLOW CHROMATE


⑪

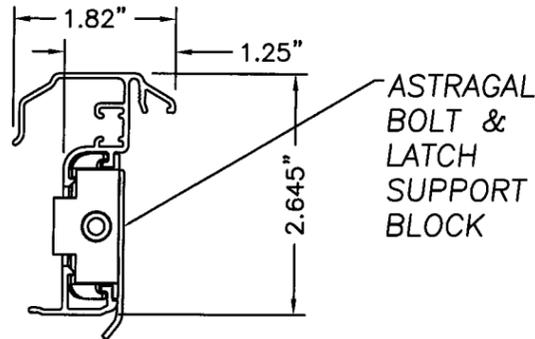

ASTRAGAL BOLT & LATCH SUPPORT BLOCK


ASTRAGAL (ENDURA)  
6063-T6 ALUMINUM

⑩

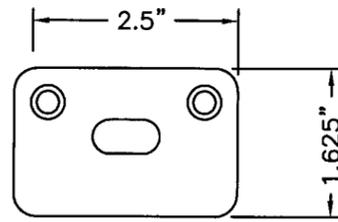


ASTRAGAL BOLT STRIKE PLATE (.050\"/>

⑬

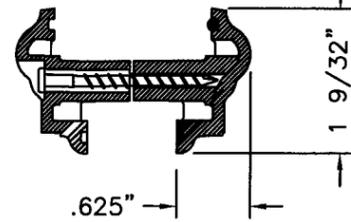


PLASTIC LIP LITE FRAME

⑳

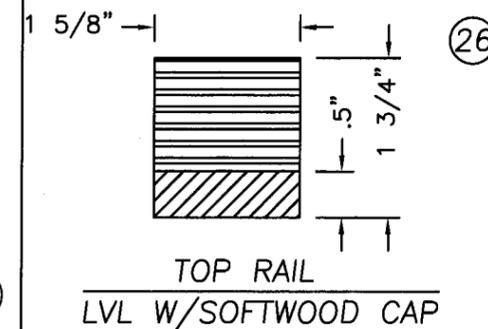


TOP RAIL  
LVL W/SOFTWOOD CAP

㉔

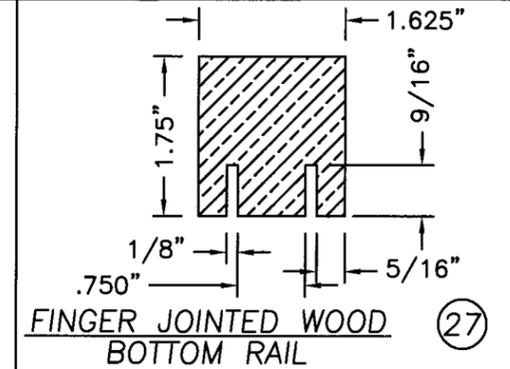


FINGER JOINTED WOOD  
BOTTOM RAIL

㉗

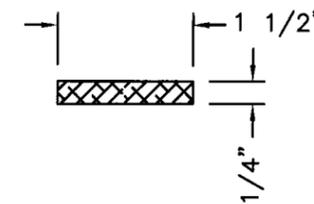


WOOD MULLION CAP

㉛

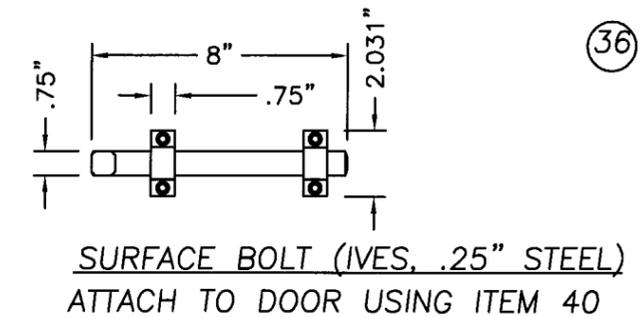


SURFACE BOLT (IVES, .25\"/>

㉞

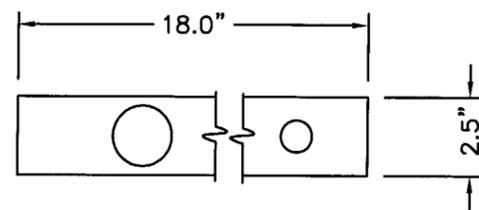


LOCK BLOCK, (PINE)

㉟

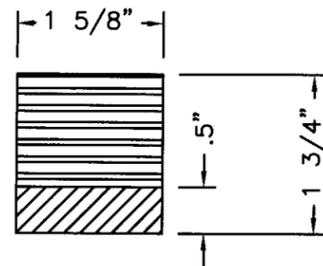


HINGE & LATCH STILE  
LVL W/SOFTWOOD CAP

㉡

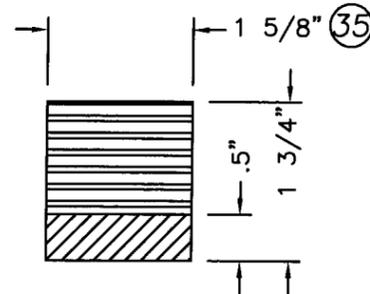

SIDELITE STILE & RAIL  
LVL W/SOFTWOOD CAP

㉤



SURFACE BOLT STRIKE (.125\"/>

㉟

SYM	REVISION	DATE	BY
A	CHANGES AS REQUESTED BY CLIENT	11/06/06	SAM

*Eric S. Nielsen*  
11/16/06  
Eric S. Nielsen  
Florida P. E. No. 41323  
PTC, LLC  
1535 Cogswell Street, Suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935

JELD-WEN, INC.  
PHONE (541)-882-3451  
3737 LAKEPORT BLVD. - KLAMATH FALLS, OR. 97601  
TITLE: 6'-8" O/S OPAQUE PREMIUM FIBERGLASS DOOR  
COMPONENTS & BILL OF MATERIALS

PREPARED BY: <b>PTC</b> PTC, LLC	DRN: D. MONTOYA	DATE: 4/18/06
SCALE: N.T.S.	DWG. NO: JW062006	
REV: A	SHEET: 9 of 10	

Phone 321.690.1788 Fax 321.690.1789

Approved as complying with the  
Florida Building Code  
Date 04/19/2007  
NOA# 06-0613.13  
Miami Dade Product Control  
Division  
By: *[Signature]*

Item	DESCRIPTION	Material	Item	DESCRIPTION	Material
1	HINGE JAMB (1 1/4" x 4 9/16" PONDEROSA PINE)	PINE	35	SIDELITE RAIL & STILE	LVL/PINE
2	HEAD FRAME (1 1/4" x 4 9/16" PONDEROSA PINE)	PINE	36	IVES SURFACE BOLT #454 8.0" L. X .25" THK.	STEEL
3	4" x 4" BUTT HINGE 12GA. (.087" MIN)	STEEL	37	SURFACE BOLT STRIKE (0.125" THK.)	STEEL
4	#9 x 3/4" PHILLIPS FLATHEAD WOOD SCREW	STEEL	38	DOW CORNING 1199 SILICONE SEALANT	
5	#8 PHILLIPS FLATHEAD WOOD SCREW W/ 1-1/2" MIN EMBED	STEEL	39	1" X 1/2" CORRUGATED NAIL	STEEL
6	#10 X 1 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL	40	1/4-20 SEX BOLT W/1/4-20 FEMALE END x 1" L	STEEL
7	3/16" TAPCON W/ 1 1/2" MIN. EMBED. (ITW OR EQUIV.)	STEEL	41	16-GA, 7/16" CROWN BY 1-1/2" LONG STAPLE	STEEL
8	OUT-SWING THRESHOLD (ENDURA)	ALUMINUM	42	16 GA. BRAD TRIM NAIL 3/4" L.	STEEL
9	COMPRESSION WEATHERSTRIP (Q-LON QDS-650)		43	1/4" X 1 1/2" WOOD MULLION CAP	WOOD
10	EXTRUDED ASTRAGAL (ENDURA)	ALUMINUM	44	16 Ga. 7/16" CROWN x 2" LONG STAPLES	STEEL
11	ASTRAGAL THROW BOLT 0.3125" X 18.0" LONG		45	NOT USED	-
12	#10 x 1 1/4" F.H. SHEET METAL SCREW	STEEL	46	1x WOOD BUCK	WOOD
13	ASTRAGAL BOLT STRIKE PLATE LOCATED AT HEAD (ENDURA)	STEEL	47	CONCRETE	CONCRETE
14	#10 X 1" PHILLIPS PAN HEAD SHEET METAL SCREW	STEEL			
15	KWIKSET TITAN LOCK SERIES 400				
16	KWIKSET TITAN DEADBOLT SERIES 780				
17	LATCH SCREWS (SEE LOCK INSTRUCTIONS)				
18	2X WOOD BUCK	WOOD			
19	2x WOOD BUCK	WOOD			
20	1/4" MAX. SHIMS	PLASTIC/METAL			
21	LITE FRAME (ODL HP POLYPROPYLENE)	PLASTIC			
22	ODL 1/2" IG GLAZING UNIT	GLASS			
23	LATCH JAMB (1-1/4" X 4-9/16" PONDEROSA PINE)	PINE			
24	#8 x 1 1/2" TEK SCREW (LITE FRAME)	STEEL			
25	3/8" RADIUS QUARTER ROUND STOP	SOFTWOOD			
26	TOP RAIL LVL/ PINE CAPPED	LVL W/PINE			
27	BOTTOM RAIL (FINGER JOINTED PINE)	PINE			
28	EXPANDED POLYSTYRENE (1.0 TO 1.25lbs DENSITY BY JELD-WEN)	FOAM			
29	FIBERGLASS DOOR PANEL SKIN (0.065" NOMINAL THICKNESS)	FIBERGLASS SKIN			
30	LOCK BLOCK (2.5" x 18")	PINE			
31	HINGE & LATCH SIDE STILE (LVL/ PINE CAPPED)	LVL / PINE			
32	-	-			
33	#8 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL			
34	SIDELITE HEAD, SILL & JAMB FRAME (1 1/4" x 4 9/16" PONDEROSA PINE)	PINE			

**NOTES:**

1. SHIM AS REQUIRED AT EACH SET OF INSTALLATION ANCHORS.
2. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4", SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS.
3. ALL INSTALLATION ANCHORS MUST BE MADE OF CORROSION RESISTANT MATERIALS.
4. WOOD FRAMING SUBSTRATE MUST HAVE A SPECIFIC GRAVITY OF 0.55 OR GREATER.

Approved as complying with the Florida Building Code  
 Date 04/19/2007  
 NOAH 06-0613.13  
 Miami Dade Product Control  
 Division  
 By *[Signature]*

SYM	REVISION	DATE	BY
A	CHANGES AS REQUESTED BY CLIENT	11/06/06	SAM

*[Signature]*  
 11/16/06  
 Eric S. Nielsen  
 Florida P. E. No. 41323  
 PTC, LLC  
 1535 Cogswell Street, Suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935

JELD-WEN, INC.  
 PHONE (541)-882-3451  
 3737 LAKEPORT BLVD. - KLAMATH FALLS, OR. 97601  
 TITLE: 6'-8" O/S OPAQUE PREMIUM FIBERGLASS DOOR  
 COMPONENTS & BILL OF MATERIALS

PREPARED BY: <b>PTC</b> PTC, LLC	DRN: D. MONTOYA	DATE: 4/18/06
SCALE: N.T.S.	DWG. NO: JW062006	
REV: A	SHEET: 10 of 10	

Phone 321.690.1788 Fax 321.690.1789