



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

www.buildingcodeonline.com

**Yale Ogron Windows and Doors, Inc.
8130 NW 74th Avenue
Medley, FL 33166**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 4000 Aluminum Sliding Glass Door.

APPROVAL DOCUMENT: Drawing No. W97-12, titled "Series 4000-Riviera Alum. Sld. Glass Door (N.I.)", sheets 1 through 9 of 9, dated 07/07/97 with revision B dated 07/20/06, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises and renews NOA # 01-0607.03 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Manuel Perez, P.E.



**NOA No 06-0628.01
Expiration Date: July 22, 2007
Approval Date: August 17, 2006
Page 1**

Yale Ogron Windows and Doors, Inc.


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W97-12**, Sheets 1 through 10 of 10, titled "Series 4000-Riviera Alum. Sld. Glass Door (N.I.)", prepared by Al-Farooq Corporation, dated 07/07/97 with revision B dated 07/20/06, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 3603.2 (b) and TAS 202-94
along with marked-up drawings and installation diagram of an aluminum sliding glass door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. FTL 99009, dated 2/15/99, signed and sealed by Joseph Chan, P.E.
(Submitted under NOA #02-0927.12)
2. Test reports on 1) Air Infiltration Test, per SFBC, PA 202-94
2) Uniform Static Air Pressure Test, Loading per SFBC, PA 202-94
3) Water Resistance Test, per SFBC, PA 202-94
4) Forced Entry Test, per SFBC and PA 202-94
Along with installation diagram of an aluminum sliding glass door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-1393 (report#7)**, specimen #A1, A2 & A3, dated 04/19/1996, signed and sealed by late Gilbert Diamond, P.E.
(Submitted under NOA #02-0927.06) (Transferred from file # **02-0507.07**). Note: test conducted under SFBC, PA 202-94, now known as FBC, TAS-202-94
3. Test reports on 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94
along with marked-up drawings and installation diagram of an aluminum sliding glass door, prepared by Construction Research Laboratory, Inc., Test Report No. **CRL-6392**, dated April 17, 1997, signed and sealed by Nariman S. Balsara, P.E.
(Submitted under NOA #01-0607.03)

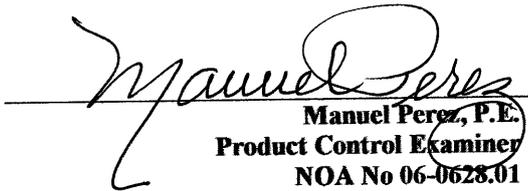
Manuel Perez, P.E.
Product Control Examiner
NOA No 06-0628.01
Expiration Date: July 22, 2007
Approval Date: August 17, 2006

Yale Ogron Windows and Doors, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Anchor Calculations and structural analysis consolidating all three NOA's, complying with FBC-2004, prepared by Al-Farooq Corporation, dated _____, signed and sealed by Humayoun Farooq, P.E.
Complies with ASTM E1300-98/02
2. Anchor Calculations and structural analysis, prepared by Al Farooq Corporation, dated 8/14/02, signed and sealed by Humayoun Farooq, P.E.
(Submitted under NOA #02-0927.12)
3. Comparative analysis & anchor verification calculations dated 08-07-02, prepared by Al-Farooq Corporation, signed and sealed by Dr. Humayoun Farooq, P.E.
(Transferred from file # 02-0507.07) (Submitted under NOA #02-0927.06)
4. Comparative Analysis and Anchor Calculations prepared by Al-Farooq Corporation, P.E dated June 30, 1997, signed and sealed by Humayoun Farooq, P.E.
(Submitted under NOA #01-0607.03)

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. None.

F. STATEMENTS

1. Statement letter of conformance, dated June 30, 2006, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated July 20, 2006, signed and sealed by Humayoun Farooq, P.E.


G. OTHER

1. Notice of Acceptance No. **02-0927.12**, issued to Yale Ogron Manufacturing Co., Inc. for their Series "Riviera 4000" Aluminum Sliding Glass Door with Steel Reinforcement, approved on 12/05/02 and expiring on 12/05/07.
2. Notice of Acceptance No. **02-0927.06**, issued to Yale Ogron Manufacturing Co., Inc. for their Series "4000" Aluminum Sliding Glass Door, approved on 07/29/04 and expiring on 07/11/07.
3. Notice of Acceptance No. **01-1120.03**, issued to Yale Ogron Manufacturing Co., Inc. for their Series "Riviera 4000" Aluminum Sliding Glass Door, approved on 08/09/01 and expiring on 07/22/06.

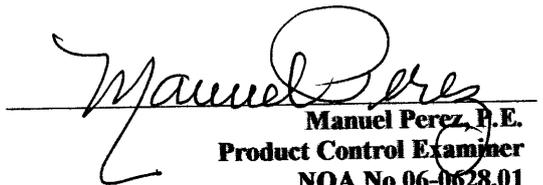
Manuel Perez, P.E.
Product Control Examiner
NOA No 06-0628.01
Expiration Date: July 22, 2007
Approval Date: August 17, 2006

DESIGN LOAD CAPACITY - PSF					
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	WITHOUT REINFORCING		WITH REINFORCING	
		EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
24	80-1/2	50.7	93.1	55.3	111.6
30		50.7	78.5	55.3	93.4
36		50.7	68.6	55.3	81.5
42		50.7	61.7	55.3	73.4
48		50.7	56.9	55.3	67.6
54		50.7	53.4	55.3	63.5
24	95-1/2	50.7	55.4	55.3	66.3
30		50.7	51.8	55.3	62.4
36		47.4	47.4	55.3	56.5
42		46.0	46.0	54.3	54.3
48		46.0	46.0	53.5	53.5

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE BASED ON
ASTM E1300-02 (3 SEC. GUSTS) WITH REDUCTIONS
FOR FLEXIBLE SUPPORTS TO COMPLY WITH SECTION
2403.2 OF FBC 2004 EDITION.

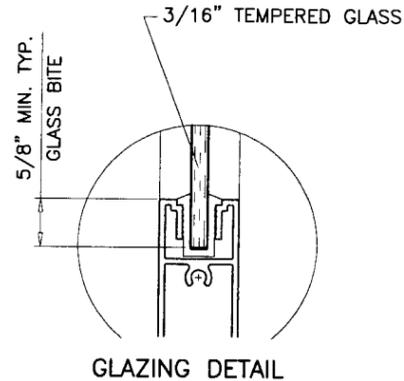

DOORS NOT RATED FOR IMPACT.
INSTALLATION OF THIS PRODUCT IN THE HVHZ AREA REQUIRES THE
USE OF APPROVED SHUTTERS OR EXTERNAL PROTECTION DEVICES
COMPLYING WITH HVHZ REQUIREMENTS.
INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA SHALL MEET
THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

SERIES 4000 ALUMINUM SLIDING GLASS DOOR

DESIGN LOAD CAPACITY FOR DOORS TO BE AS PER CHARTS
SHOWN ABOVE.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION (REV. 2005)
INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).



WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER
LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS
EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS
ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF
ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO
CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS
OF 2004 FLORIDA BLDG. CODE SECTION 2003.8.4 (SUPPLEMENT 2005).

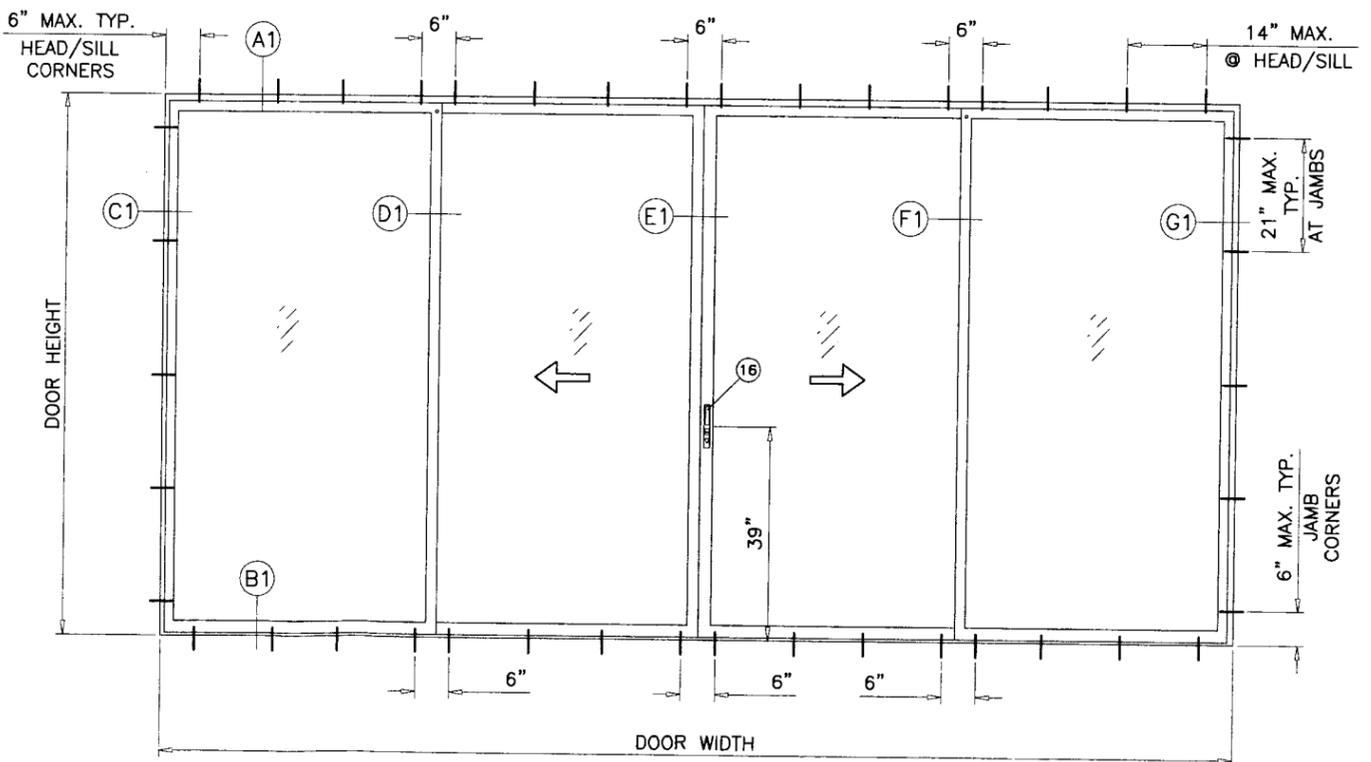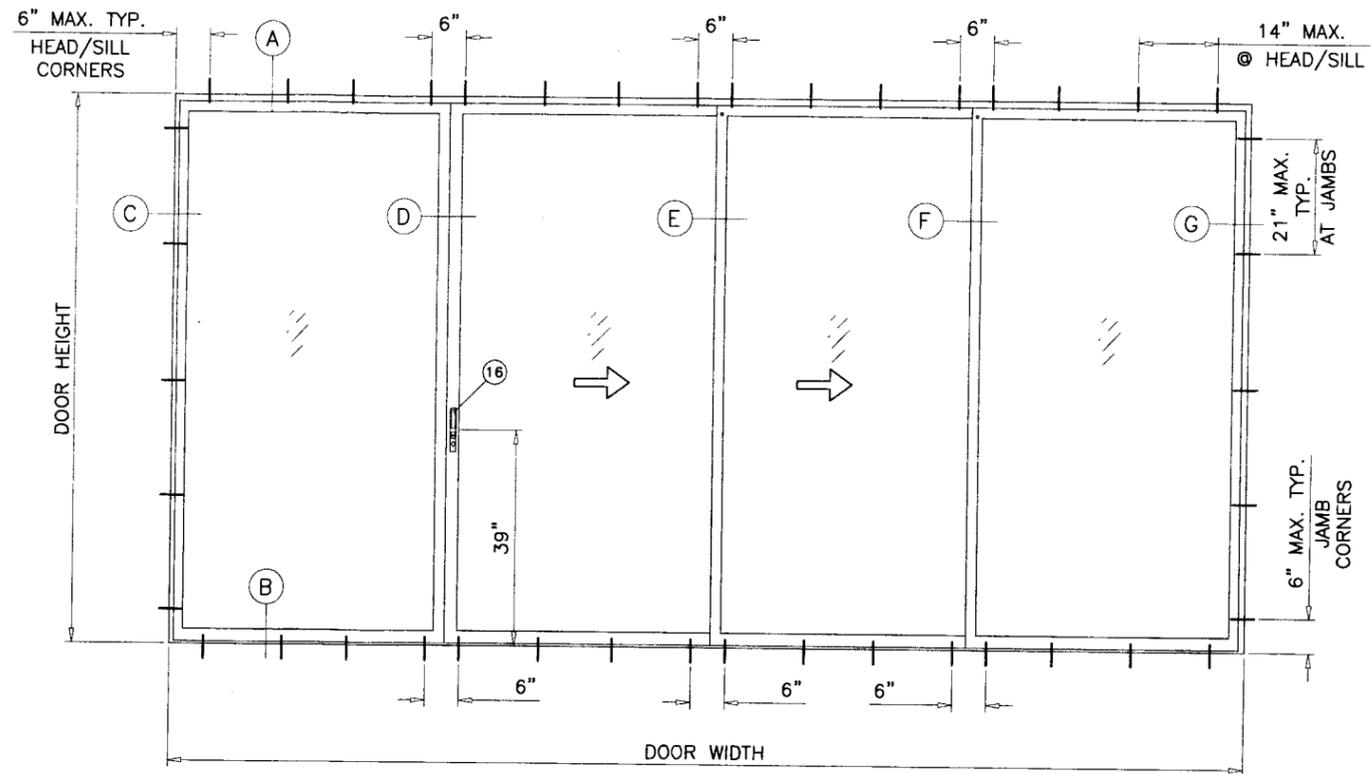

TYPICAL ELEVATION

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 06-0628.01
Expiration Date JULY 22, 2007

By: *Manuel Jerez*
Miami Dade Product Control
Division

JUL 27 2006


AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX (305) 262-6978
COMP-ANL\W97-12YO-NEW

SERIES 4000 ALUM SLD. GLASS DOOR (N.I.)
YALE OGRON WINDOWS AND DOORS INC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309


no	date	description
A	5.19.98	GENERAL REVISION
B	07.20.06	UPDATED FOR 2004 FBC

date:	07-07-97
scale:	3/8"=1'-0"
dr. by:	HAMID
chk. by:	


drawing no.
W97-12

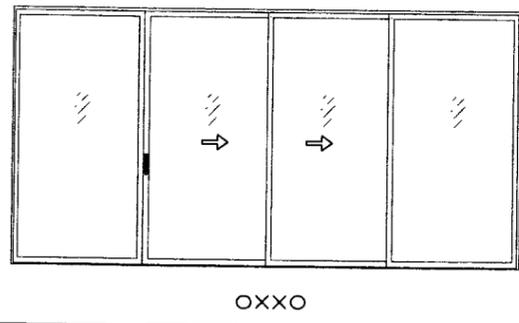


OXXO

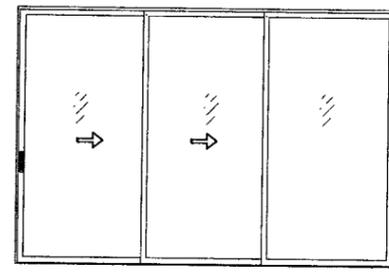


XXO (SHOWN)
OXX

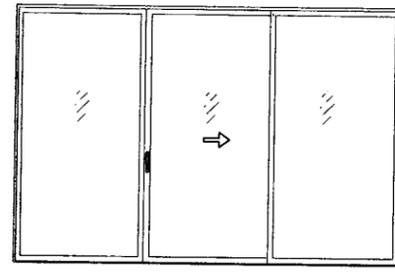


OXO




XO (SHOWN)
OX




XX

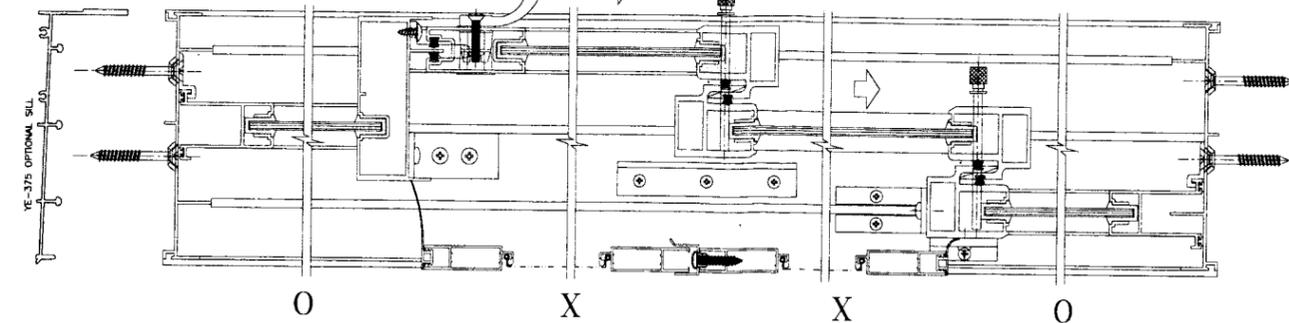


O X X O

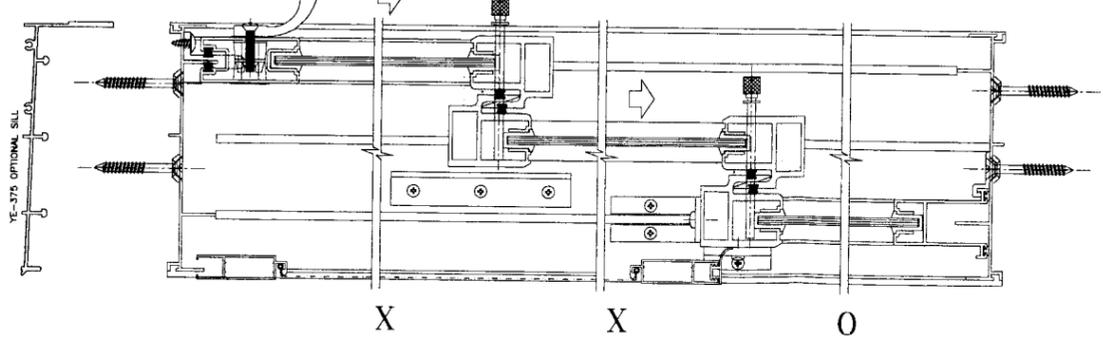


O X O

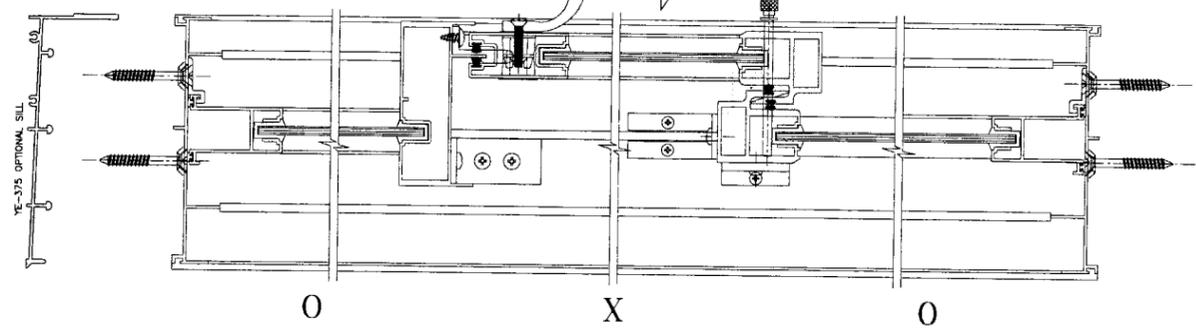

O X O

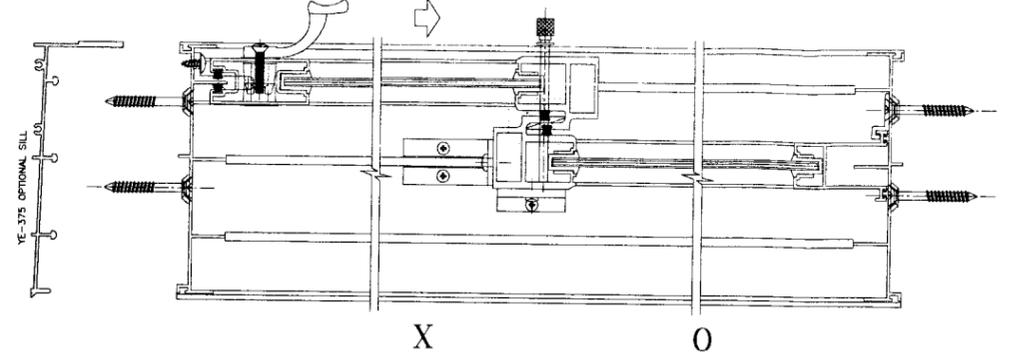

X O

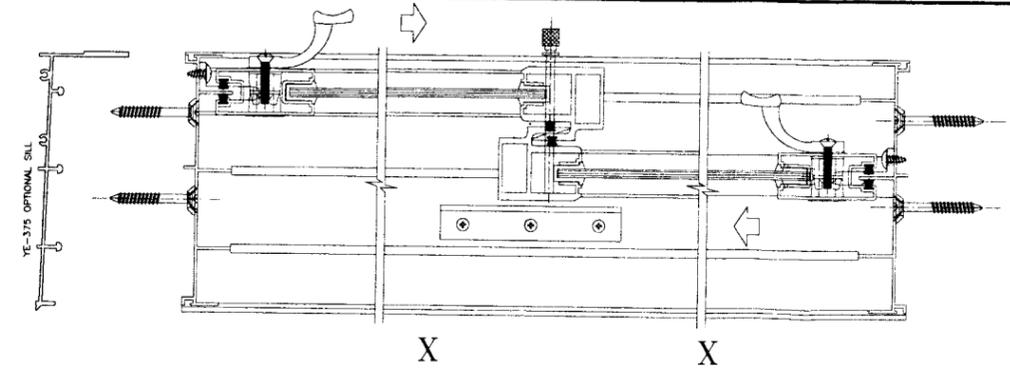


X X

APPROVED CONFIGURATIONS
3 TRACKS

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 06-0628.01
Expiration Date: JULY 22, 2007
By: *Manuel Perez*
Retired Date Product Control
Division

JUL 27 2006



AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL: (305) 264-8100 FAX: (305) 262-6978
COMP-ANL\W97-12YO-NEW

SERIES 4000 ALUM SLD. GLASS DOOR (N.I.)

YALE OGRON WINDOWS AND DOORS INC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309


no	date	description
B	07.20.06	UPDATED FOR 2004 FBC

revisions:


date: 07-07-97
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W97-12


sheet 2 of 9




XX




OX (SHOWN)
XO

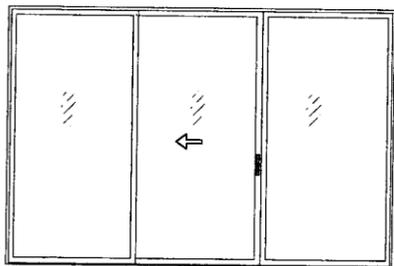






OXO

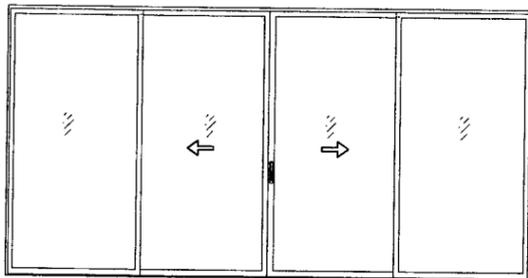

OXXO



XO (SHOWN)
OX

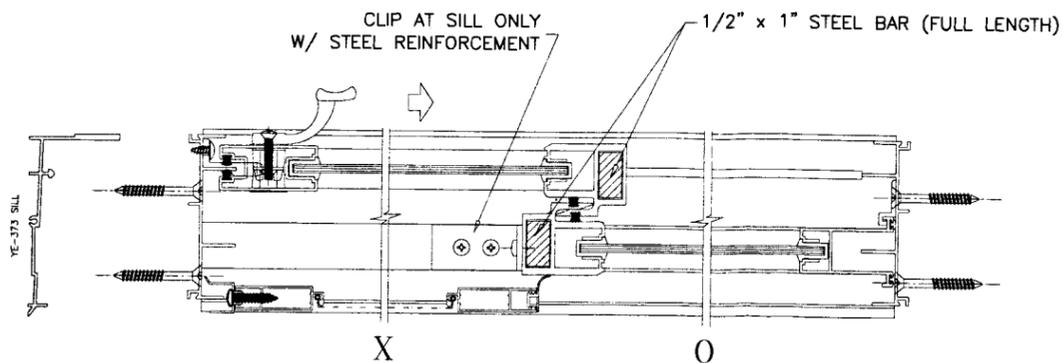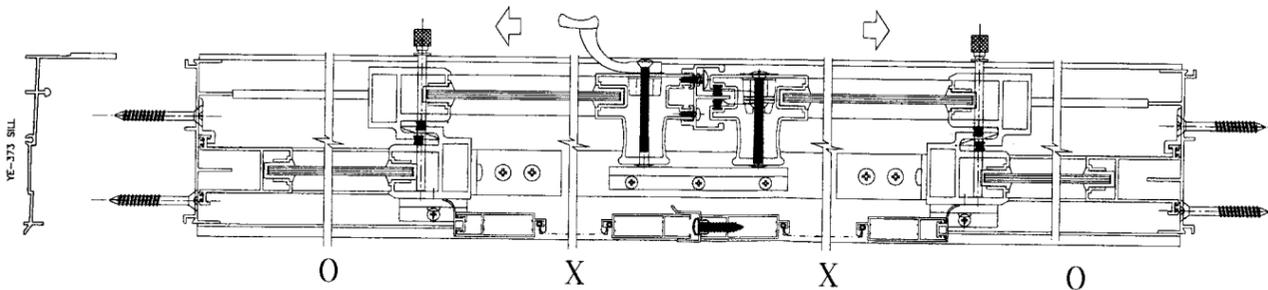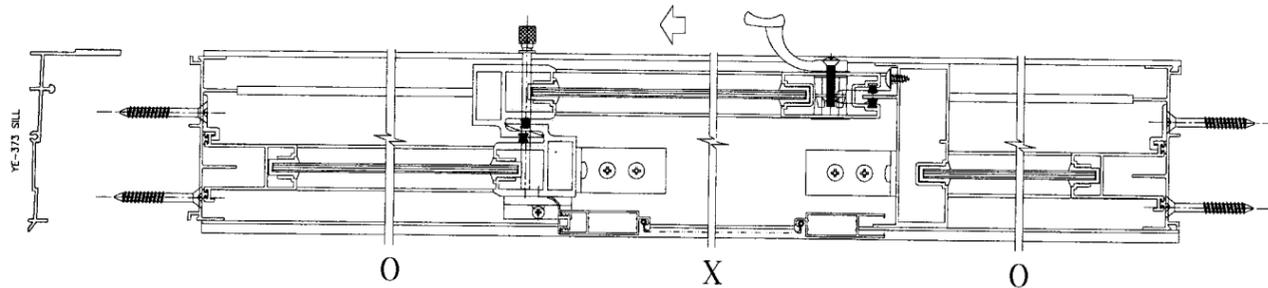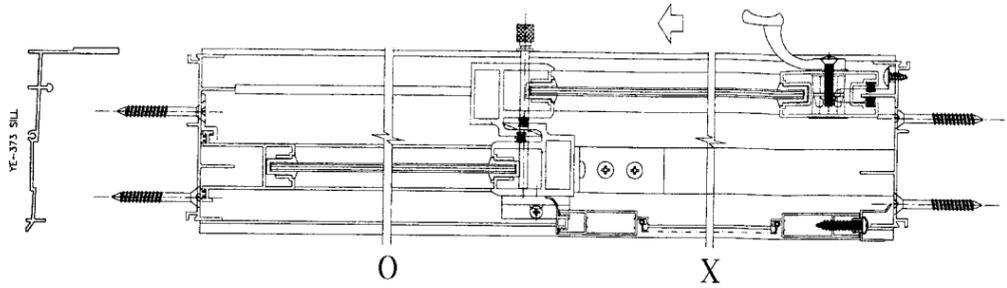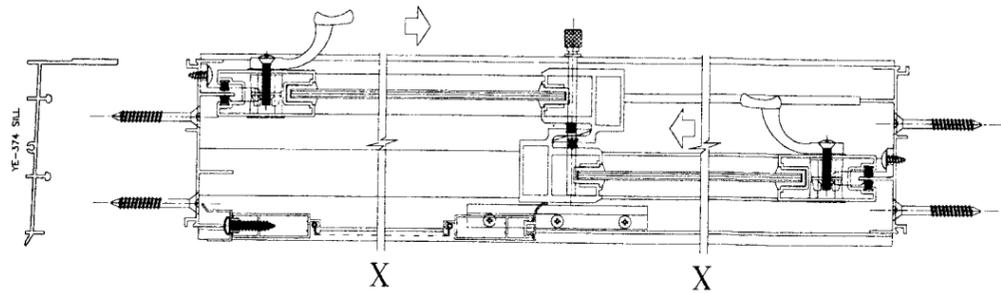

APPROVED CONFIGURATIONS
2 TRACKS
WITHOUT STEEL REINFORCING

APPROVED CONFIGURATIONS
2 TRACKS
WITH STEEL REINFORCING

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 06-0622-01
Expiration Date JULY 22, 2007
Manuel Perez
Related Code Product Catalog
Edition

JUL 27 2006

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W97-12YO-NEW







SERIES 4000 ALUM SLD. GLASS DOOR (N.I.)
YALE OGRON WINDOWS AND DOORS INC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	by	description
B	07.20.06		UPDATED FOR 2004 FBC

date:	07-07-97
scale:	1/2"=1'-0"
dr. by:	HAMID
chk. by:	

drawing no.
W97-12

sheet 3 of 9

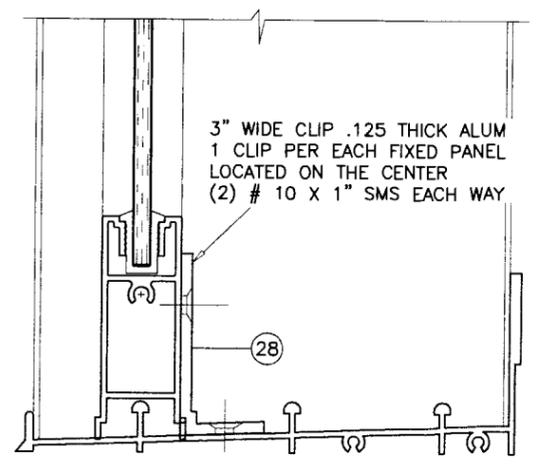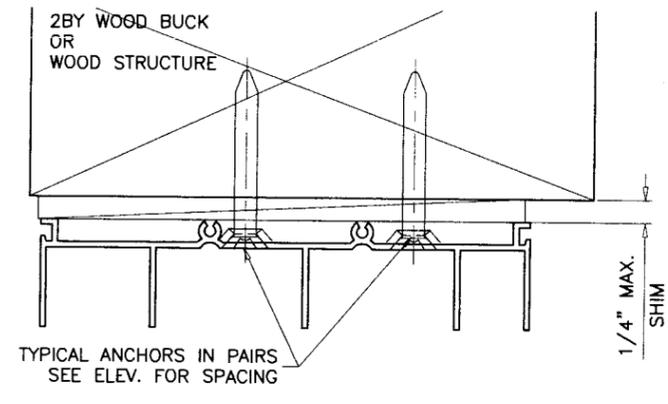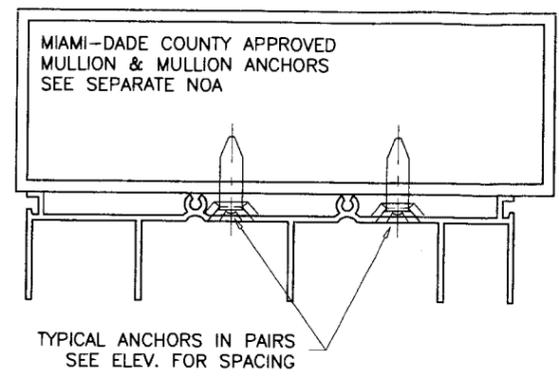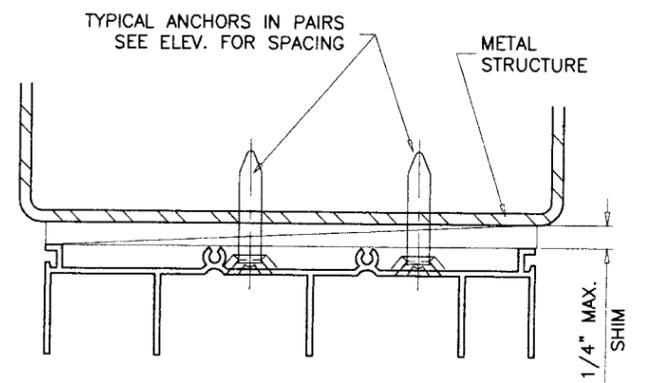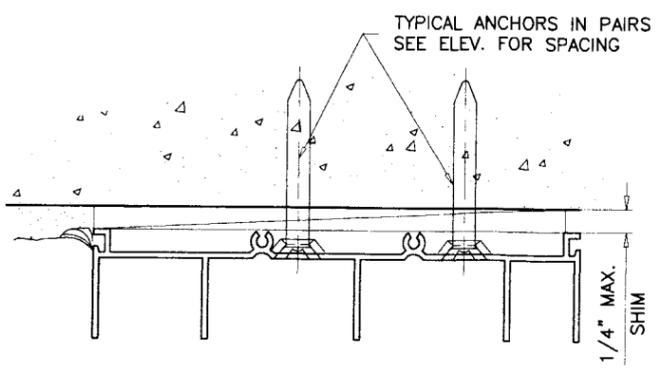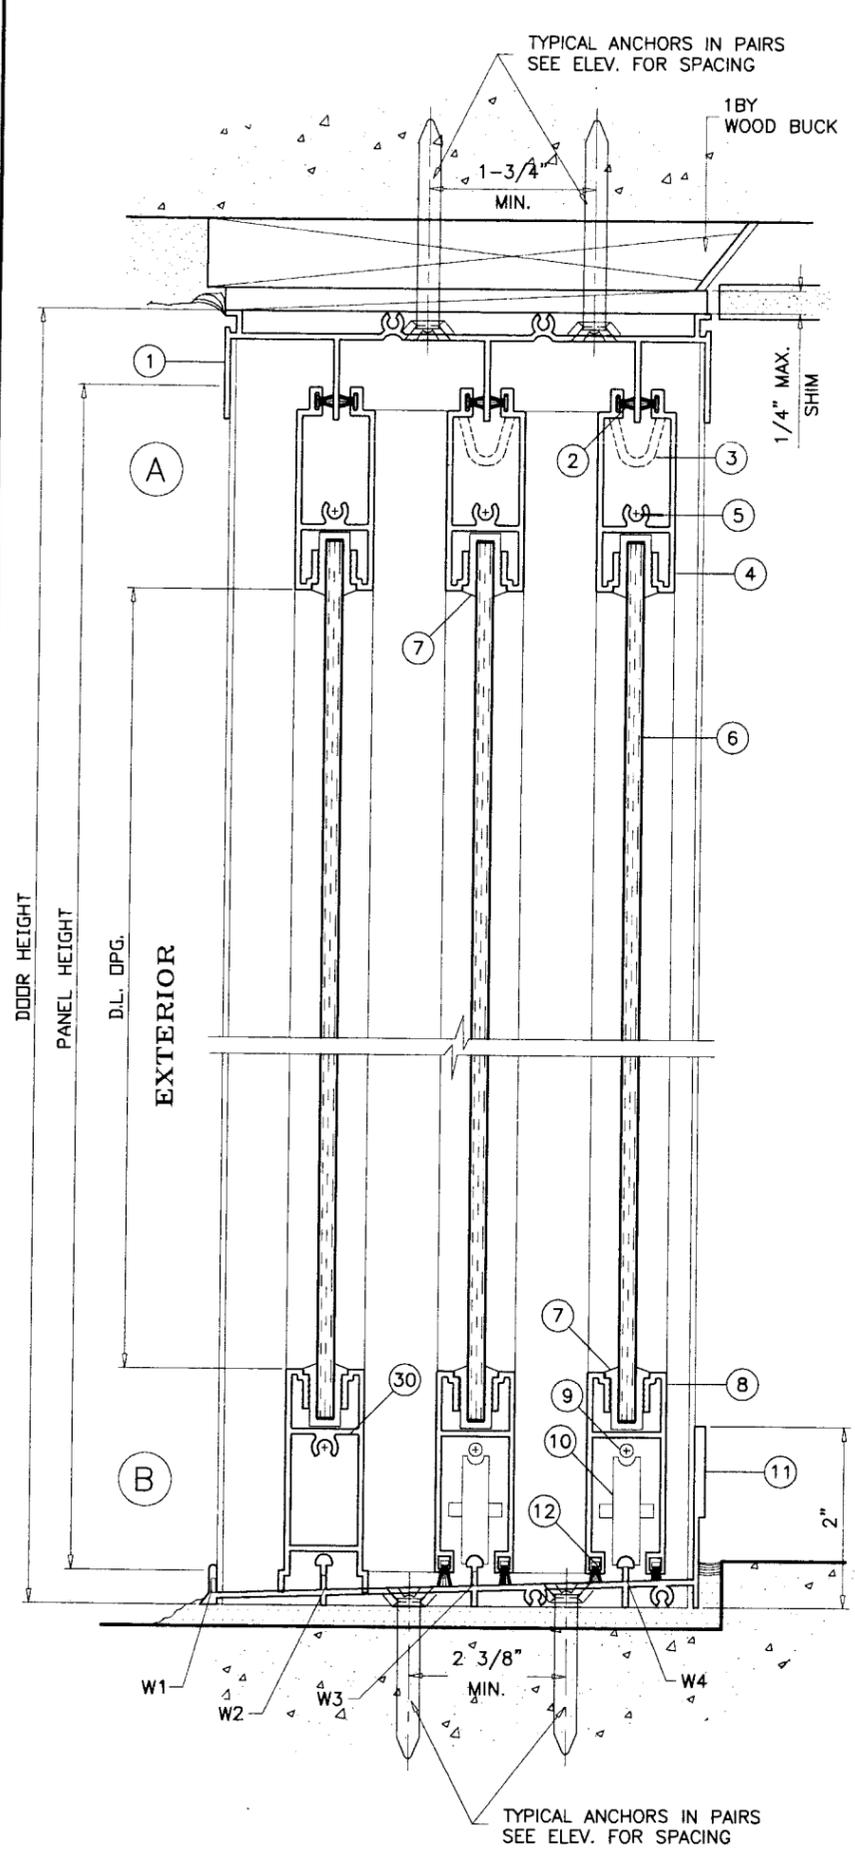

WOOD BUCKS AND METAL STRUCTURE NOT BY YALE OGRON MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

- 1/4" TAPCONS**
- INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
- 1-3/8" MIN. PENETRATION INTO WOOD
- THRU 1BY BUCKS INTO CONC. OR MASONRY
- 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
- DIRECTLY INTO CONC. OR MASONRY
- 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

- #14 SMS OR SELF DRILLING SCREWS**
- INTO METAL STRUCTURES
- STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
- ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
- (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

- #12 SMS OR SELF DRILLING SCREWS**
- INTO MIAMI-DADE APPROVED MULLIONS (MIN. THK. = .090")
- (NO SHIM SPACE)

- TYPICAL EDGE DISTANCE**
- INTO CONCRETE AND MASONRY = 2" MIN.
- INTO WOOD STRUCTURE = 1" MIN.
- INTO METAL STRUCTURE = 1/2" MIN.

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 06-0628-01
Expiration Date: JULY 22, 2007

Manuel Sere
Miami Dade Product Control
Division

JUL 27 2006

3 TRACK DOOR DETAILS

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W97-12YO-NEW

SERIES 4000 ALUM SLD. GLASS DOOR (N.I.)



YALE OGRON WINDOWS AND DOORS INC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	description
B	07.20.06	UPDATED FOR 2004 FBC

revisions:
no date by description

date: 07-07-97
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no. **W97-12**
sheet 4 of 9

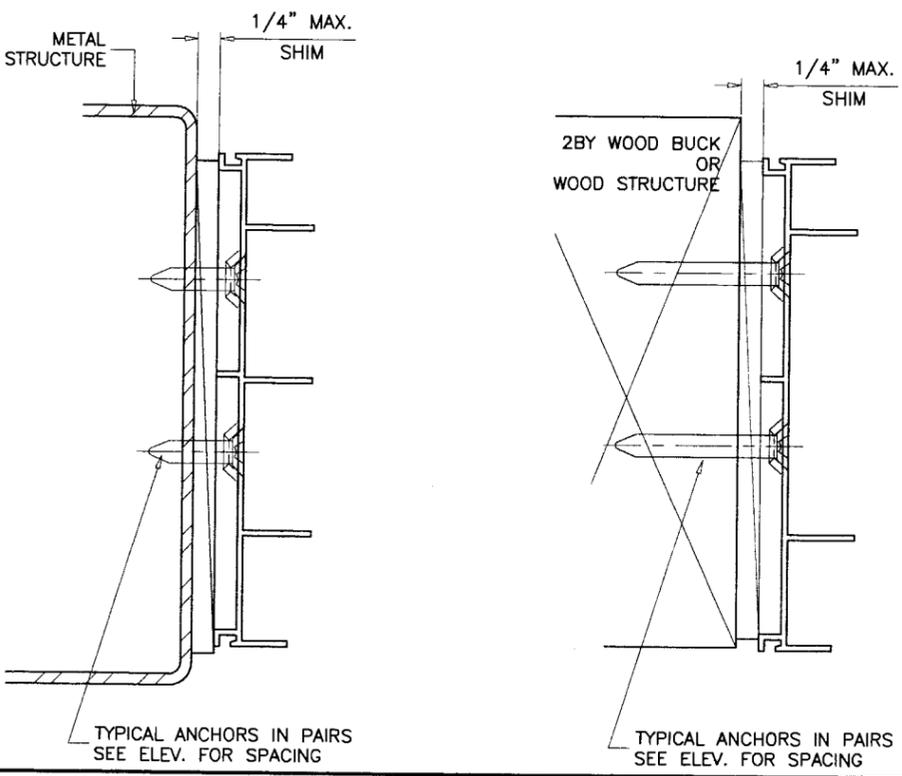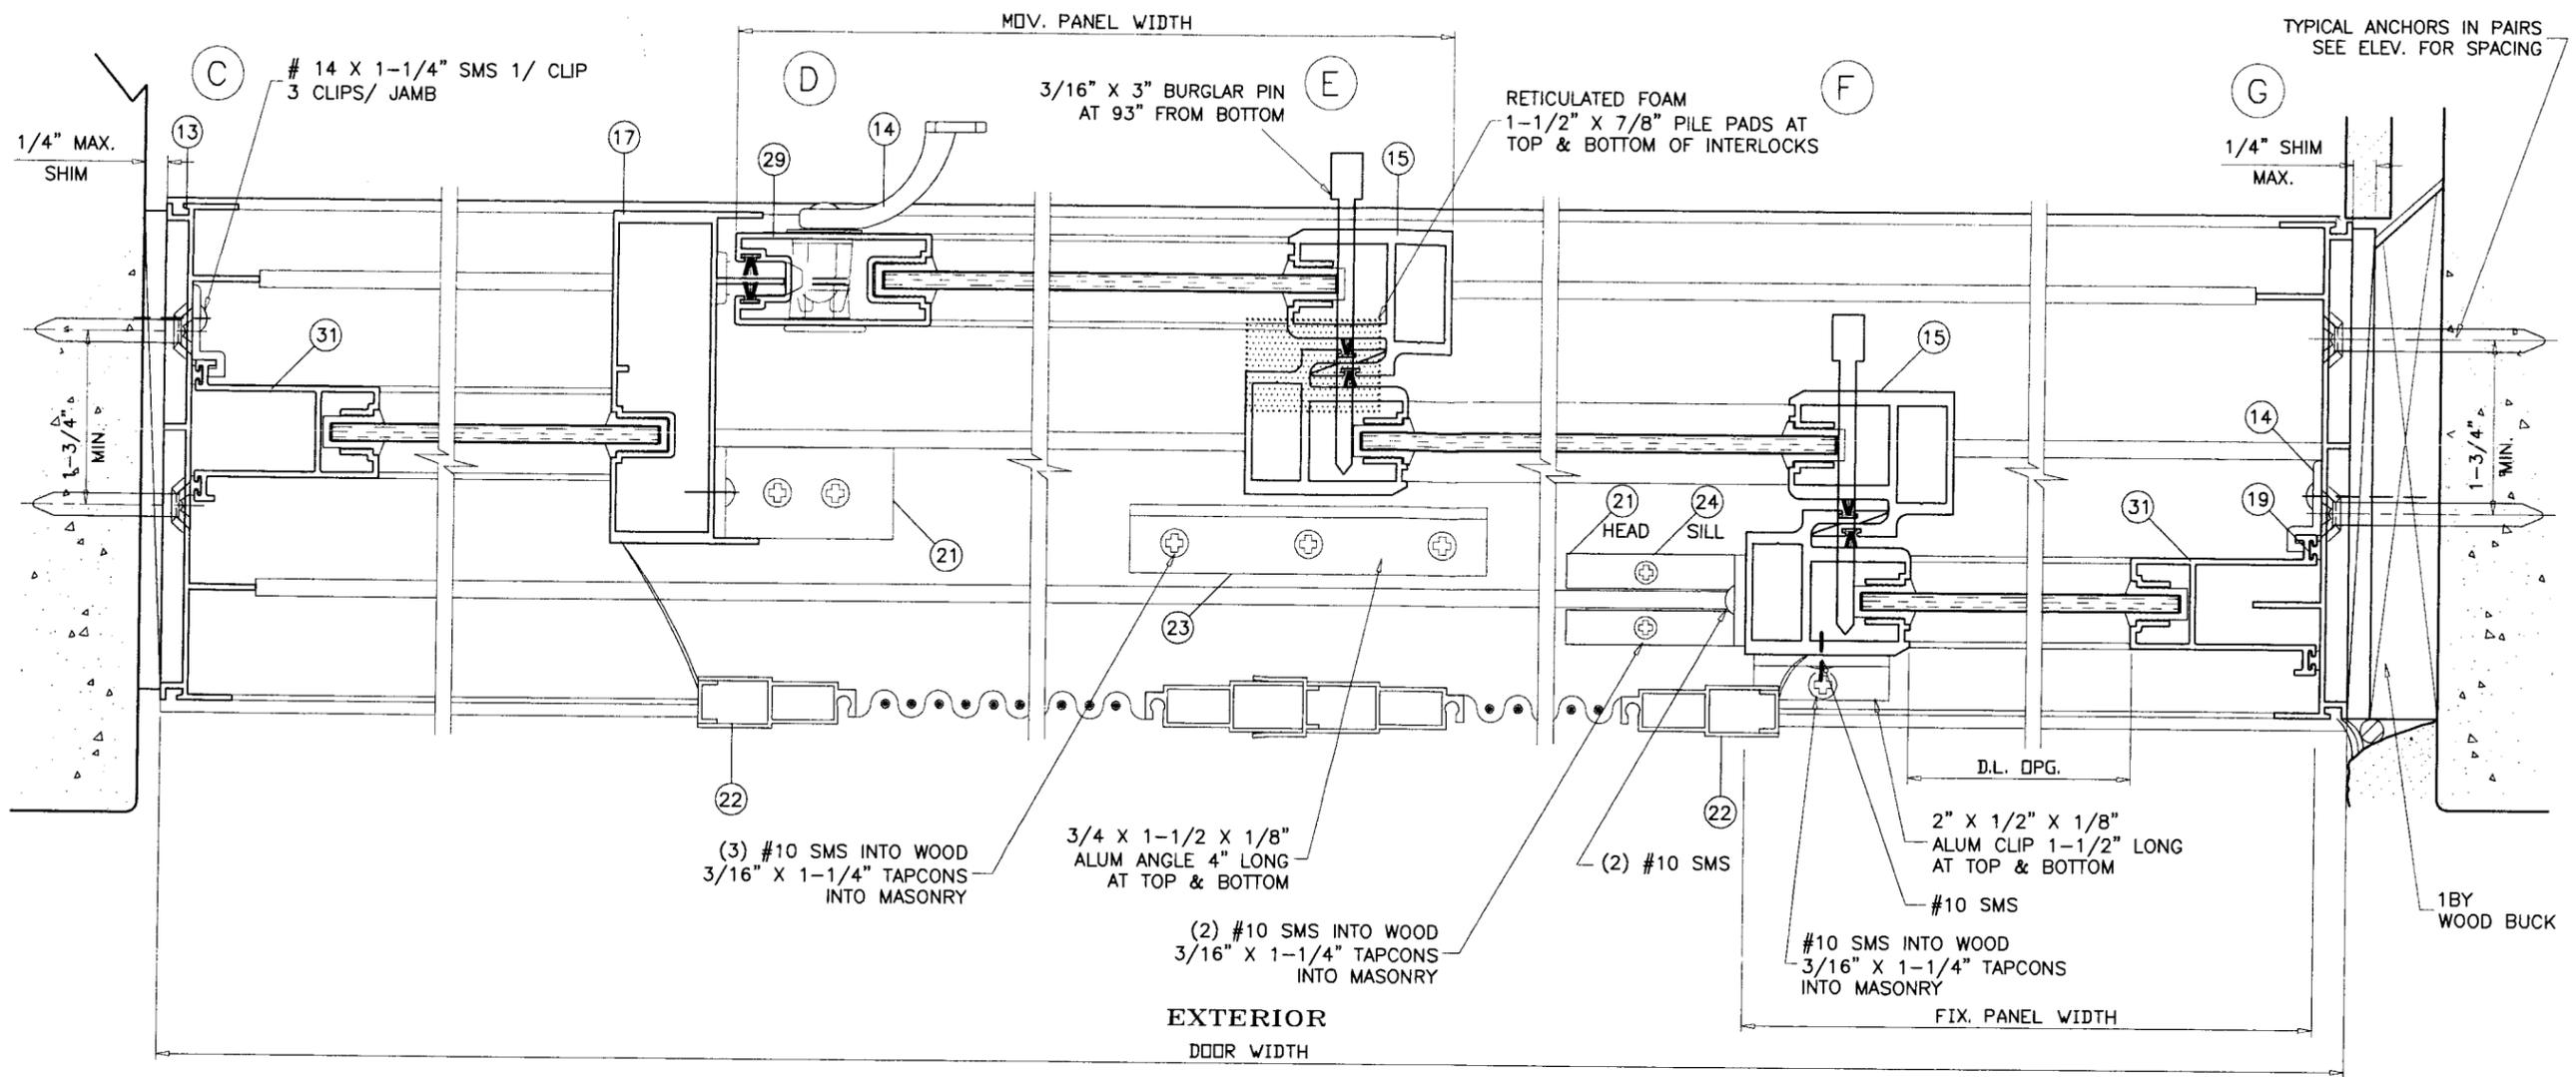

3 TRACK DOOR DETAILS

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

JUL 27 2006

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 06-0628.01
 Expiration Date JULY 22, 2007

By: *Manuel Perez*
 Miami Made Product Control
 Division









afc

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W97-12YO-NEW

SERIES 4000 ALUM SLD. GLASS DOOR (N.I.)
YALE OGRON WINDOWS AND DOORS INC.
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

revisions:		by description	
no	date		
B	07.20.06	UPDATED FOR 2004 FBC	

date: 07-07-97	scale: 1/2" = 1"	dr. by: HAMID	chk. by:
drawing no.		W97-12	
sheet 5 of 9			

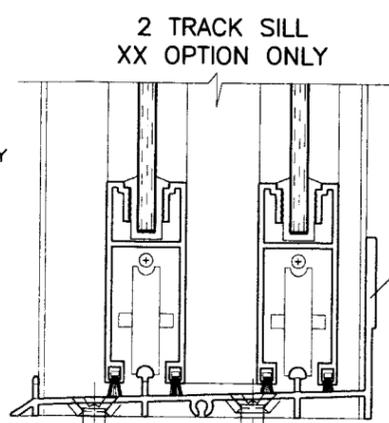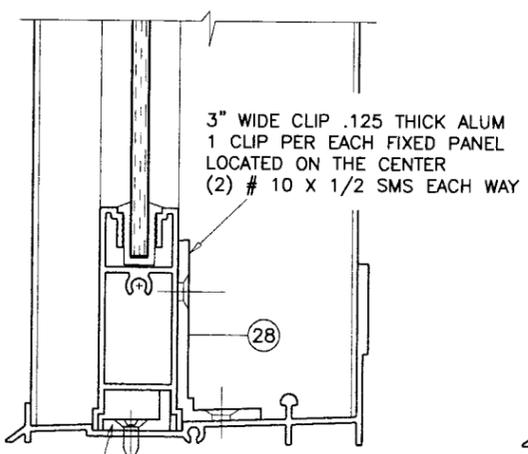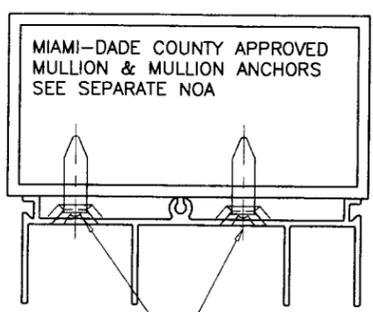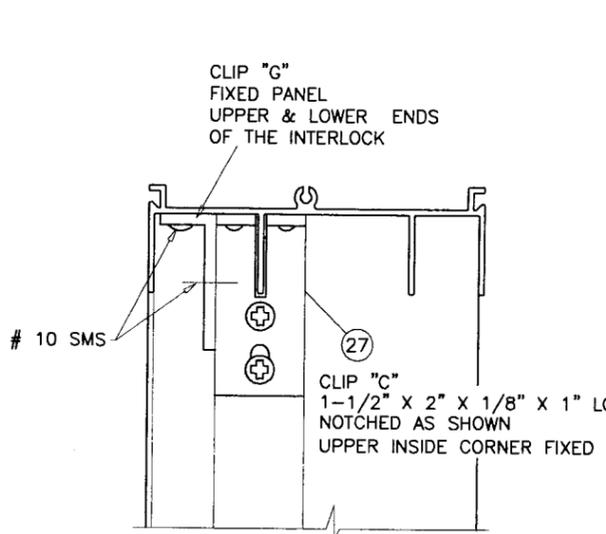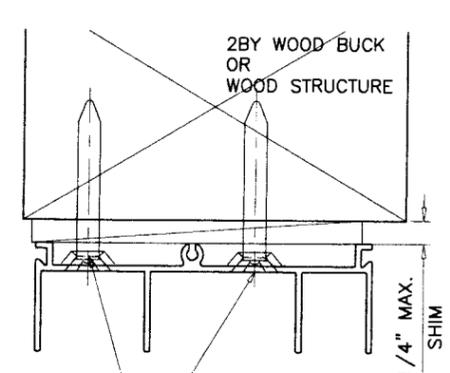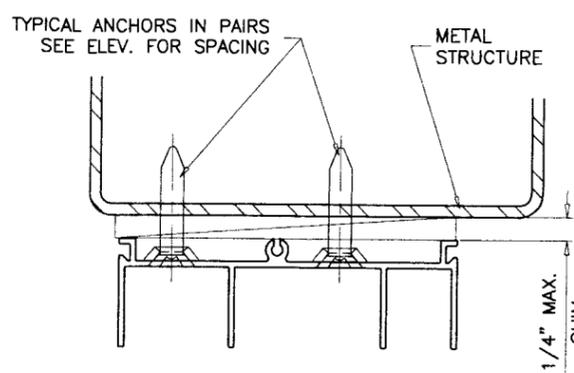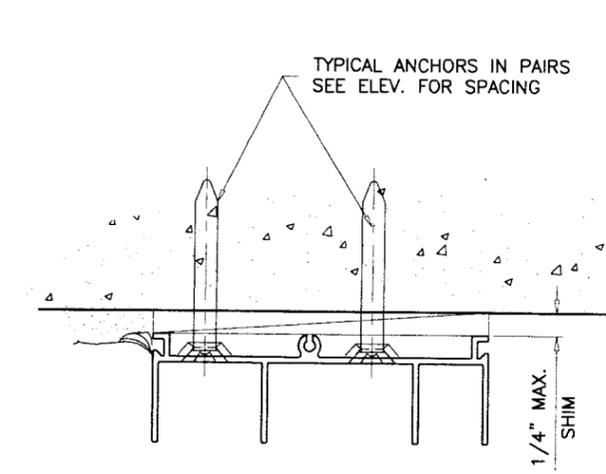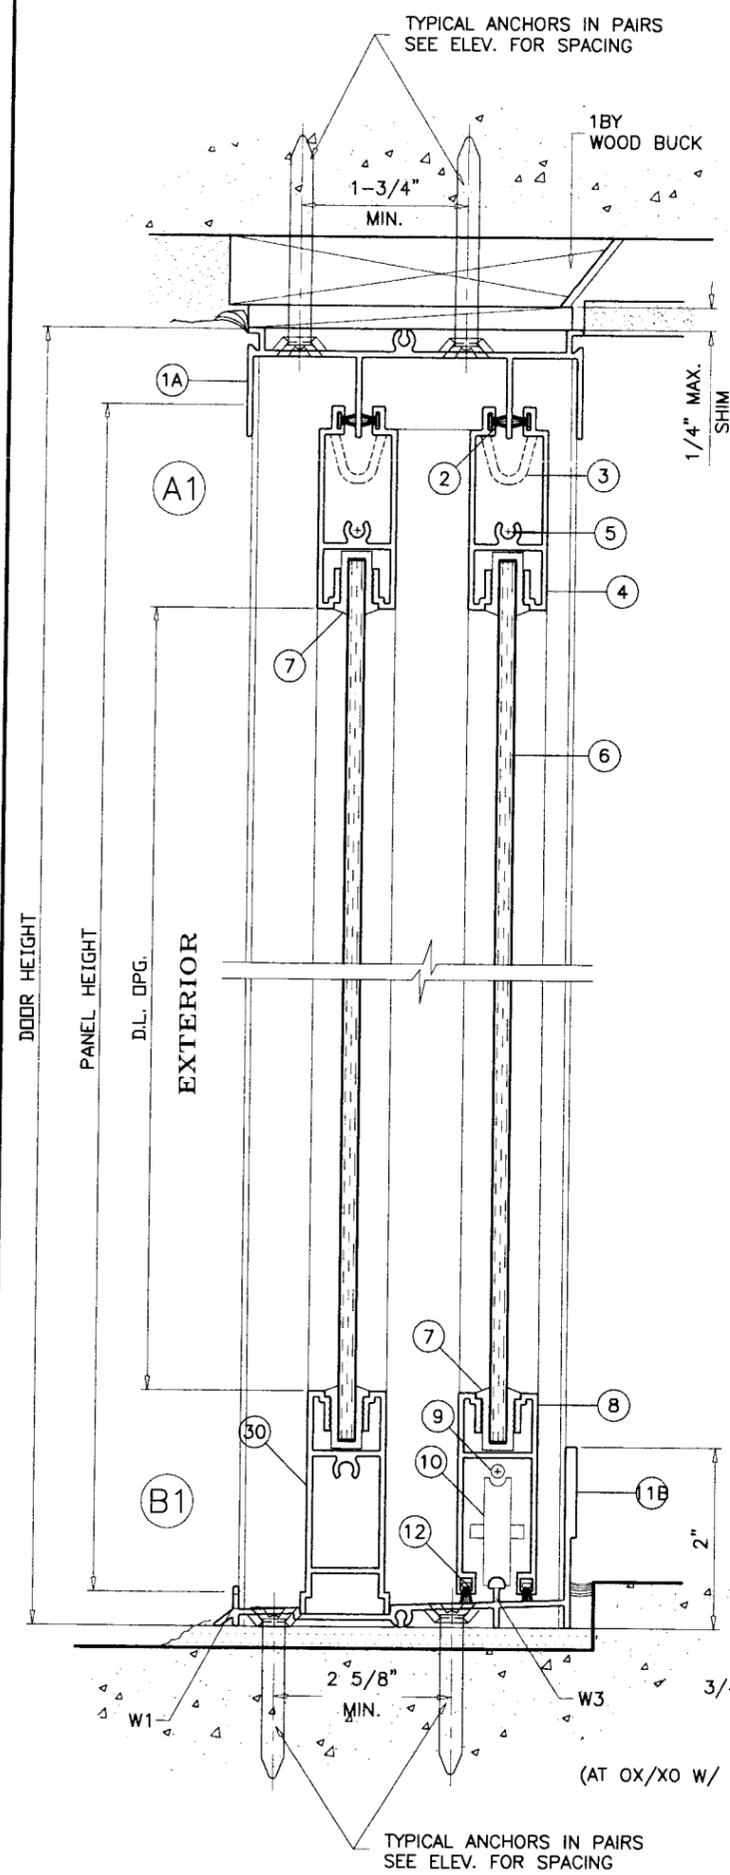

WOOD BUCKS AND METAL STRUCTURE NOT BY YALE OGRON
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" TAPCONS

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-3/8" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SMS OR SELF DRILLING SCREWS

INTO METAL STRUCTURES
STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#12 SMS OR SELF DRILLING SCREWS

INTO MIAMI-DADE APPROVED MULLIONS (MIN. THK. = .090")
(NO SHIM SPACE)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 1/2" MIN.

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 06-0628.01
Expiration Date JULY 22, 2007
Miami-Dade Product Control
Division

Manuel Perez
JUL 27 2006

2 TRACK DOOR DETAILS

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W97-12YO-NEW

SERIES 4000 ALUM SLD. GLASS DOOR (N.I.)
YALE OGRON WINDOWS AND DOORS INC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309



no	date	by	description
B	07.20.06		UPDATED FOR 2004 FBC

revisions:

date: 07-07-97
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W97-12

sheet 6 of 9

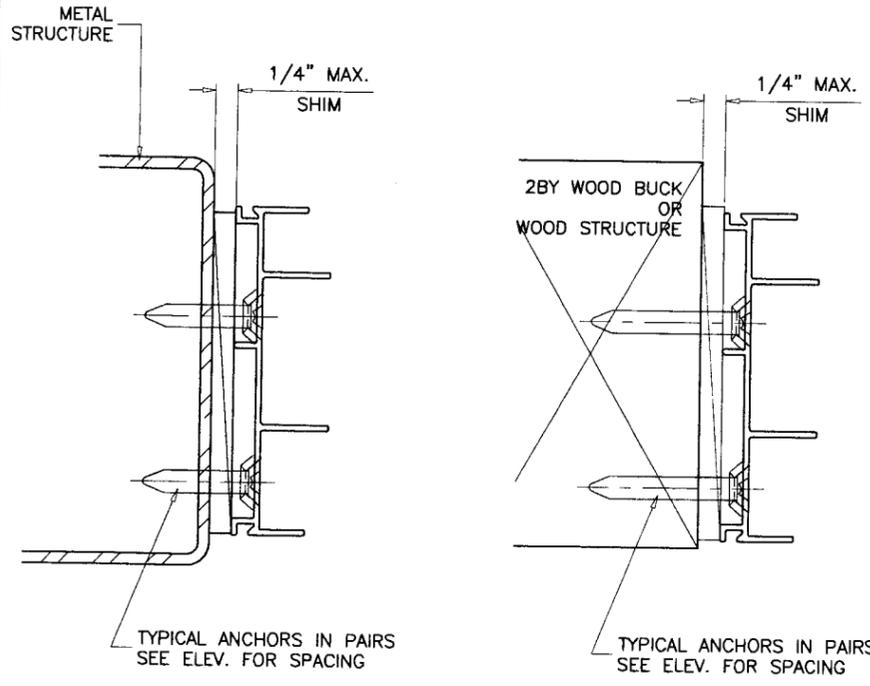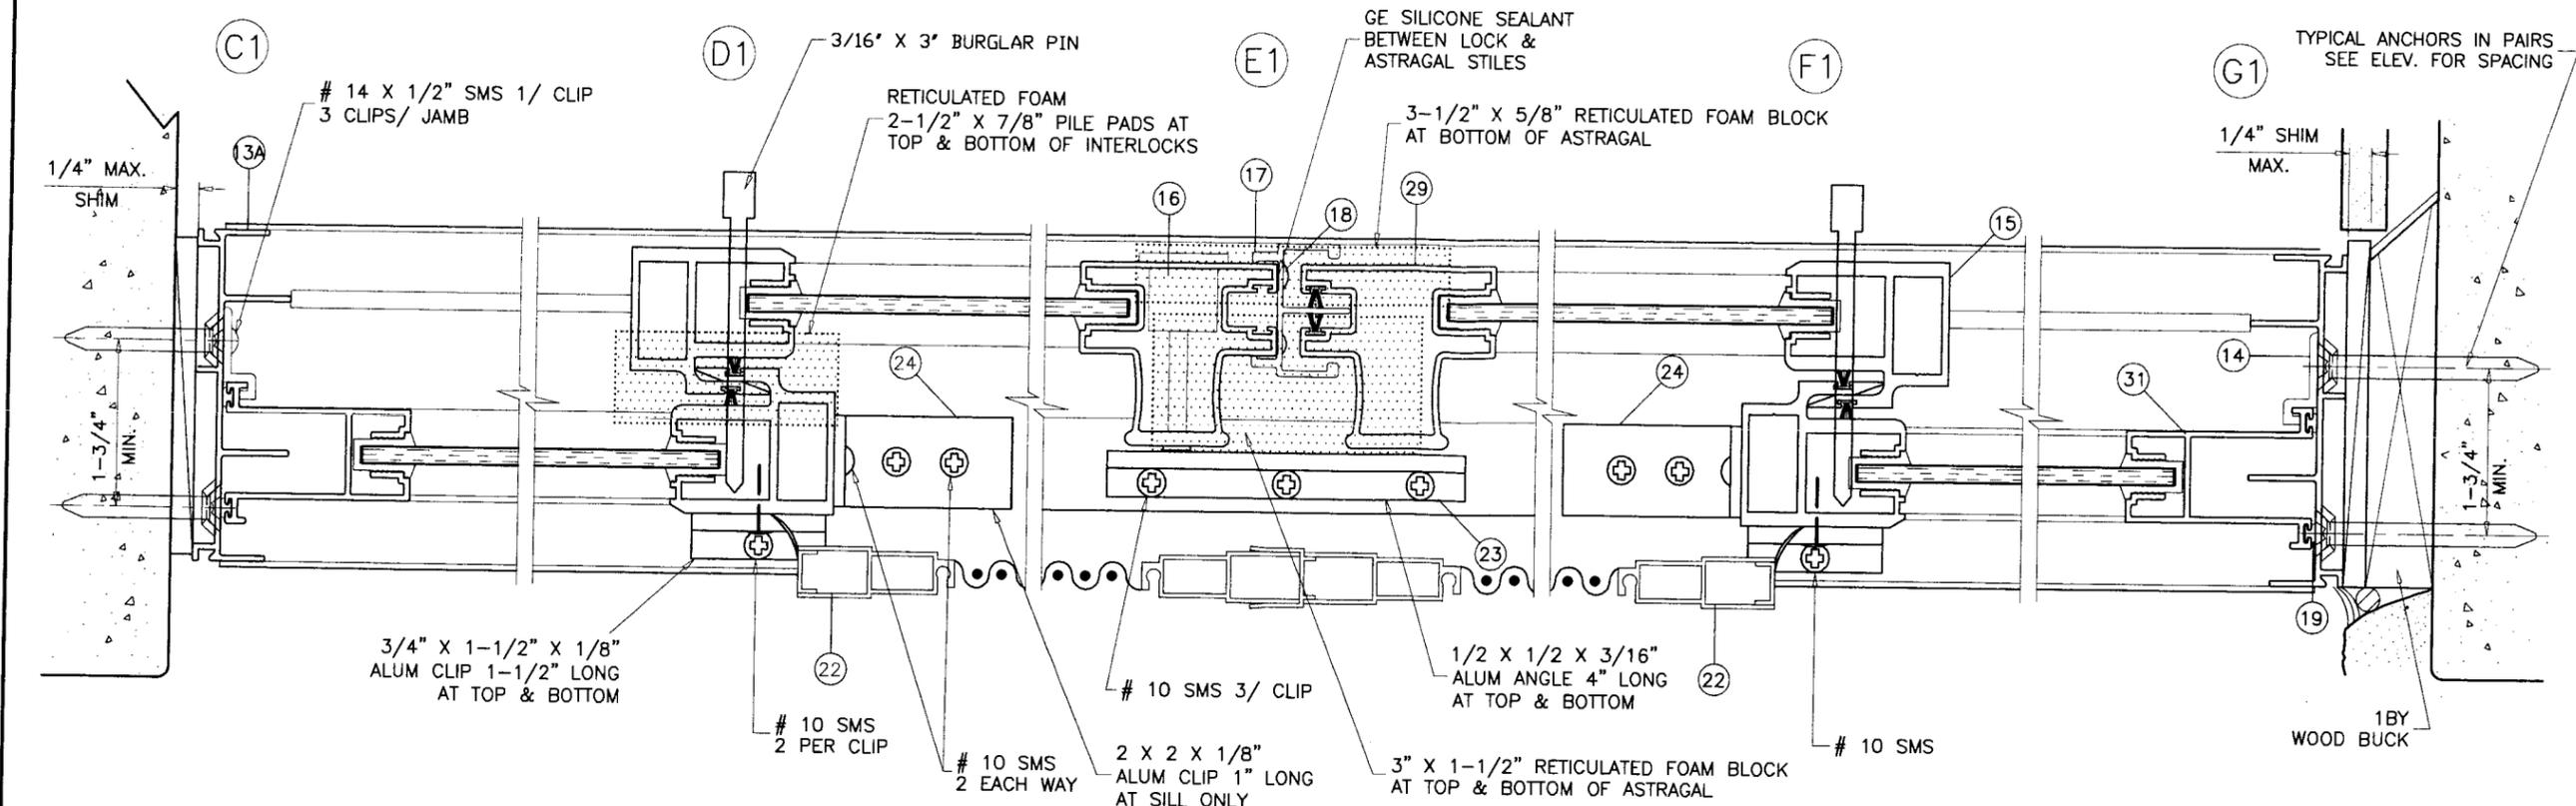

afc
AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W97-12YO-NEW

SERIES 4000 ALUM SLD. GLASS DOOR (N.I.)
YALE OGRON WINDOWS AND DOORS INC.
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

no	date	by	description
B	07.20.06		UPDATED FOR 2004 FCC

Engr: DR. HUMAYOON FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Approval No. **06-0628.01**
 Expiration Date **JULY 22, 2007**
Manuel Perez
 National Trade Product Council
 Member


JUL 27 2006

2 TRACK DOOR DETAILS


date: 07-07-97
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W97-12


sheet 7 of 9

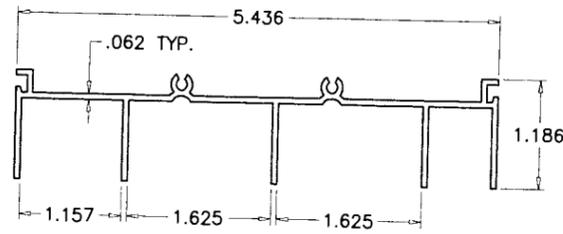


① **FRAME HEAD (3 TRACK)**
YE-320
6063-T5

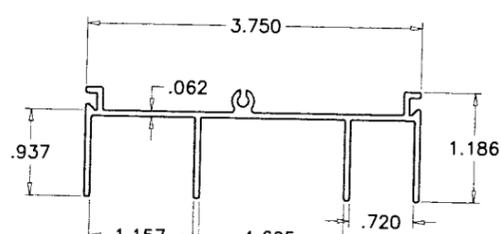


①A **FRAME HEAD (2 TRACK)**
YE-304
6063-T5

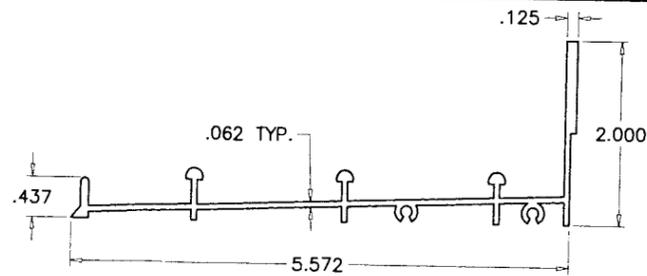


①① **FRAME SILL (3 TRACK)**
YE-375
6063-T5

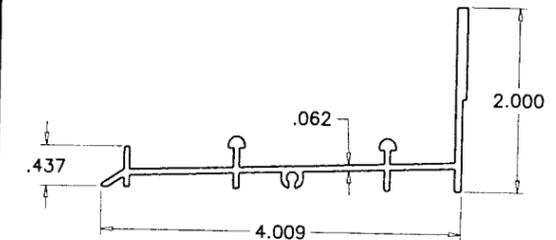


①①A **FRAME SILL (2 TRACK)**
YE-374
6063-T5




④ **PANEL TOP RAIL**
YE-307
6063-T5




⑭ **FIXED PANEL CLIP**
YE-377
6063-T5

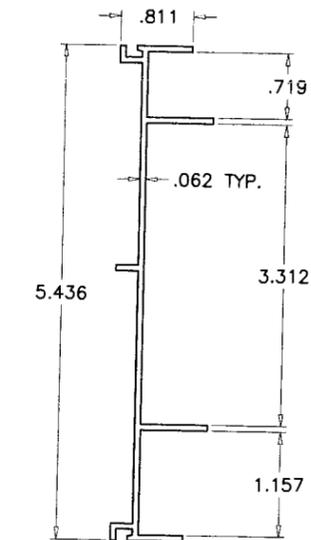


⑬ **FRAME JAMB (3 TRACK)**
YE-321
6063-T5

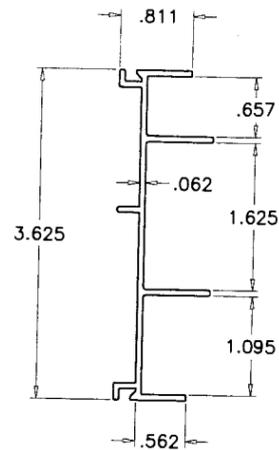


⑬A **FRAME JAMB (2 TRACK)**
YE-304
6063-T5

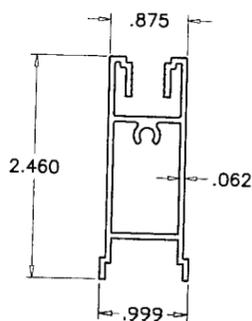


③① **FIXED PANEL BOTTOM RAIL**
YE-379
6063-T5

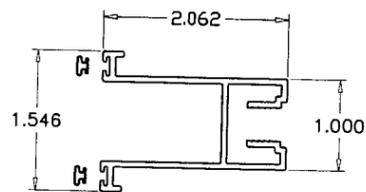


③① **FIXED PANEL STILE**
YE-302
6063-T5

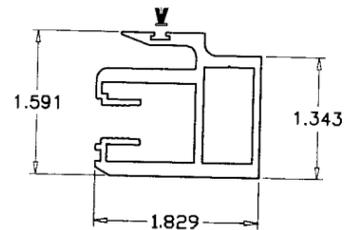


⑮ **PANEL HEAVY INTERLOCK STILE**
YE-325
6063-T5




③② **ASTRAGAL**
YE-355
6063-T5




⑧ **MOVING PANEL BOTTOM RAIL**
YE-306
6063-T5

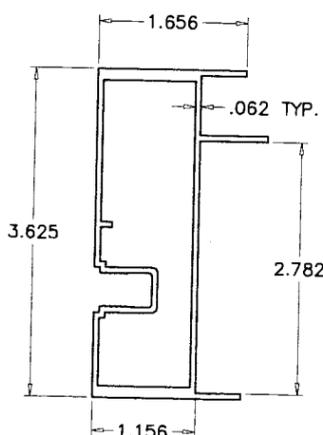


⑮ **PANEL ASTRAGAL STILE**
YE-344
6063-T5



③③ **PANEL HEAVY LOCKING STILE**
YE-380
6063-T5

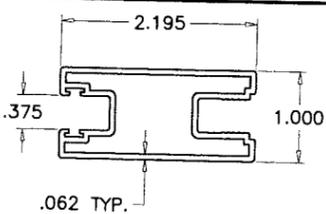

⑲ **MOVING PANEL STILE**
YE-301
6063-T5

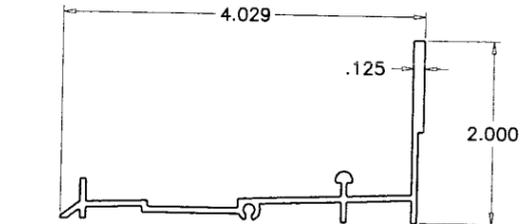

①①B **FRAME SILL**
YE-373
6063-T5

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

JUL 27 2006

PRODUCT REVIEWED
or complying with the Florida
Building Code
Approval No. 06-0628.01
Expiration Date: JULY 22, 2007
By: *Manuel*
Miami State Product Control
Division

af

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN

1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W97-12YO-NEW

SERIES 4000 ALUM SLD. GLASS DOOR (N.I.)

YALE OGRON WINDOWS AND DOORS INC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309



no	date	by	description
B	07.20.06		UPDATED FOR 2004 FBC

date: 07-07-97
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W97-12

sheet 8 of 9

ITEM NO.	PART NUMBER	DESCRIPTION	MATERIAL/REMARKS
1	YE-320	FRAME HEAD (3 TRACK)	ALUMINUM (6063-T5)
1A	YE-304	FRAME HEAD (2 TRACK)	ALUMINUM (6063-T5)
2	YH-4004	WEATHERSTRIPPING	SCHLEGEL PB8322-187 OR EQUIV.
3	YH-4001	TOP SLIDE GUIDE	NYLON 6/6 SECURITY PLASTICS INC.
4	YE-307	PANEL TOP RAIL	ALUMINUM (6063-T5)
5	YF-31	TOP RAIL ASSY. SCREW	# 10 X 1" PH SMS
6	-	PANEL GLASS	3/16" TEMPERED
7	YE-4007	VINYL GASKET FOR 3/16" GLASS	CUSTOM PLASTICS 026-8 OR EQUIV.
8	YE-306	MOVING PANEL BOTTOM RAIL	ALUMINUM (6063-T5)
9	YF-27A	BOTTOM RAIL ASSY. SCREW	# 10-32 X 7/8" PH. MACH. SCREW
10	YH-4031	ROLLER ASSEMBLY	ALUM HOUSING WITH STEEL WHEEL
11	YE-375	FRAME SILL (3 TRACK)	ALUMINUM (6063-T5)
11A	YE-374	FRAME SILL (2 TRACK)	ALUMINUM (6063-T5)
11B	YE-373	FRAME SILL (2 TRACK)	ALUMINUM (6063-T5)
12	YH-4005	ROLLING PANEL SILL W'STRIPPING	SCHLEGEL SK1004-510 OR EQUIV.
13	YE-321	FRAME JAMB (3 TRACK)	ALUMINUM (6063-T5)
13A	YE-304	FRAME JAMB (2 TRACK)	ALUMINUM (6063-T5)
14	YE-377	FIXED PANEL CLIP (TYPE A)	ALUMINUM 2" LONG, 3/ JAMB
15	YE-325	PANEL HEAVY INTERLOCK STILE	ALUMINUM (6063-T5)
16	YH-4017	LOCK ASSY. WITH LATCH MECHANISM	PLATED/PAINTED ZAMAK WITH STEEL CAM
17	YE-344	PANEL HEAVY ASTRAGAL STILE	ALUMINUM (6063-T5)
18	YH-25A	SCREW	#8 X 1/2" P.H. SMS
19	YH-4010	FIXED END STILE WEATHERSTRIPPING	CUSTOM PLASTICS 042-1 (VINYL)
21	YH-4056	UPPER & LOWER FACE ANGLE CLIP (TYPE G)	ALUMINUM (3/4"x2"x1/8"x1" LONG)
22	-	SCREEN	OPTIONAL
23	YH-4053	MOVING PANEL SILL & TRACK CLIP (TYPE B)	ALUMINUM TOP & BOTTOM
24	YH-4034	BRACKET TYPE 'B'	ALUMINUM (1-1/2"x2"x1/8"x1" LONG)
26	YF-28	FRAME ASSY. SCREW	# 8 X 1" SMS
27	YH-4055	FIXED PANEL UPPER CLIP (TYPE C)	ALUMINUM
28	YH-4054	CENTRAL FIXED PANEL CLIP (TYPE D)	ALUMINUM (1-1/2"x2"x1/8"x1" LONG)
29	YE-301	PANEL LOCKING STILE	ALUMINUM (6063-T5)
30	YE-379	FIXED PANEL BOTTOM RAIL	ALUMINUM (6063-T5)
31	YE-302	FIXED END STILE	ALUMINUM (6063-T5)
33	YE-355	ASTRAGAL STILE	ALUMINUM (6063-T5)
34	YE-380	PANEL HEAVY LOCKING STILE	ALUMINUM (6063-T5)

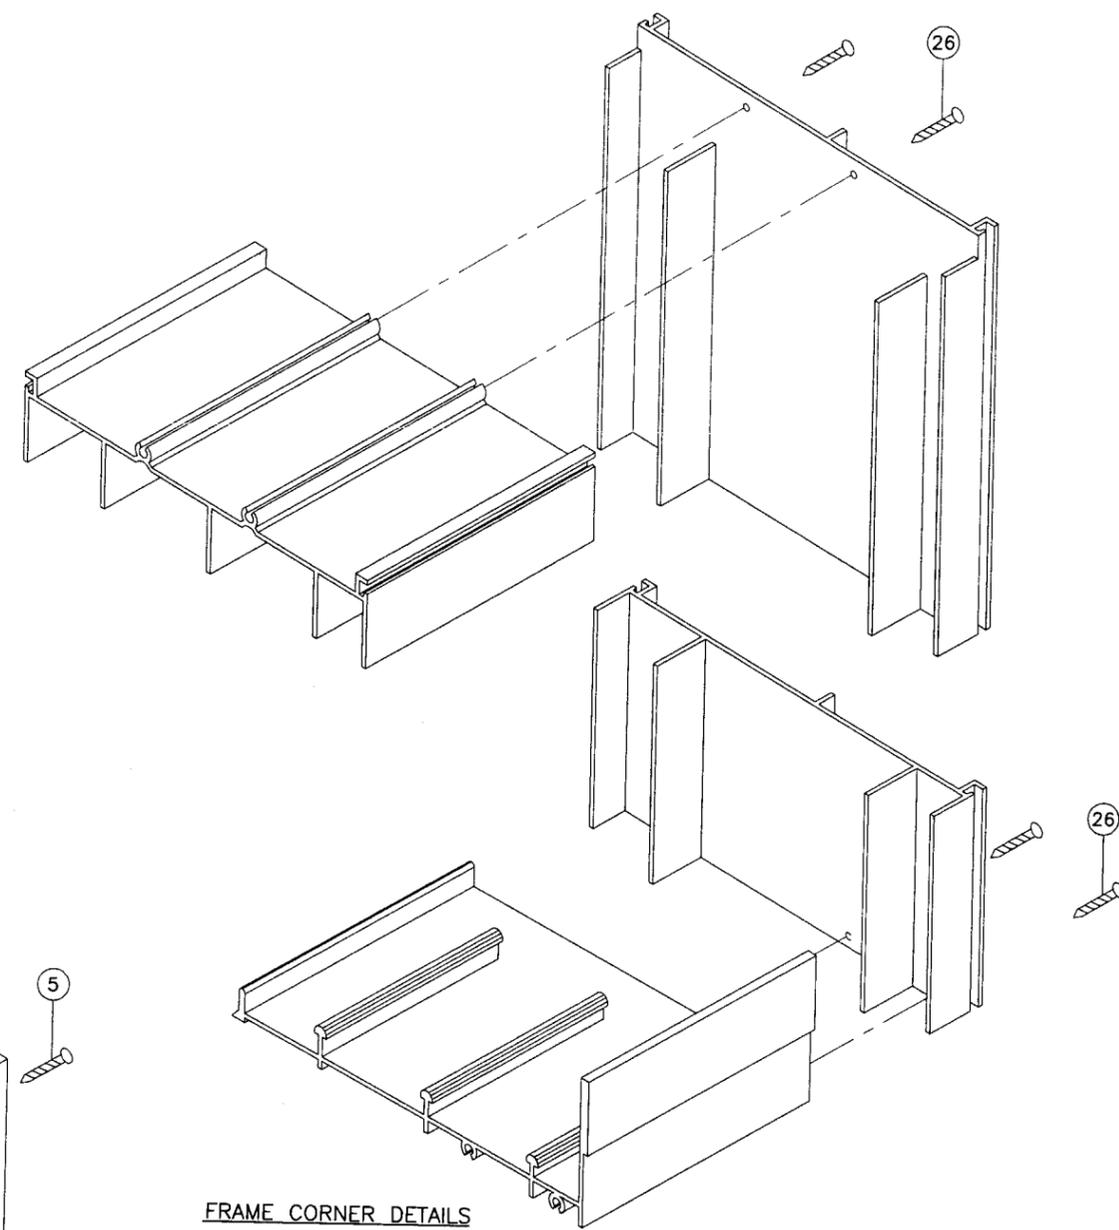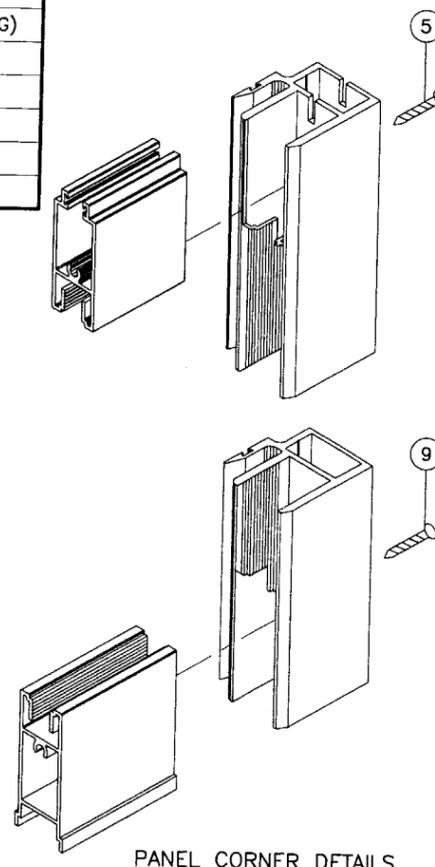

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

JUL 27 2006

PRODUCT REVISED
as compliance with the Florida
Building Code
Approved by 06-0628.01
Architect's Date JULY 22, 2007

By: *Manuel Perez*
Quality Control

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W97-12YO-NEW

SERIES 4000 ALUM SLD. GLASS DOOR (N.I.)
YALE OGRON WINDOWS AND DOORS INC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

revisions:	no	date	by	description
	B	07.20.06		UPDATED FOR 2004 FBC

date: 07-07-97
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W97-12

sheet 9 of 9