



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

www.buildingcodeonline.com

NOTICE OF ACCEPTANCE (NOA)

**Yale Ogron Windows & Doors, Inc.
8130 NW 74th Avenue
Medley, FL 33166**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 9500 White PVC Single Hung Window

APPROVAL DOCUMENT: Drawing No. **W00-52**, dated 12/11/00, with revision A dated 06/07/06, titled "Series-9500 Vinyl Single Hung Window", sheets 1 through 4 of 4, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises & renews NOA# 00-1227.05 and consists of this page 1 and evidence pages E-1 & E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 06-0705.02
Expiration Date: July 12, 2011
Approval Date: August 24, 2006
Page 1**

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **W00-52** titled "Series-9500 Vinyl Single Hung Window", sheets 1 through 4 of 4, dated 12/11/00, with revision A dated 06/07/06, prepared by Al Farooq Corporations, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per TAS 202-94 & AAMA 1302.5
along with marked-up drawings and installation diagram of one specimen of a vinyl single hung window using insulating glass consisting of one lite of 1/8" annealed glass and one lite of 3/16" annealed glass with air space in between, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-2814**, dated November 2, 2000, signed and sealed by Antonio Acevedo, P.E.
"Submitted Under NOA# 00-1227.05"
2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 1302.5 (b) and TAS 202-94
along with marked-up drawings and installation diagram of three specimens of a vinyl single hung window using 3/16" annealed glass, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-2815**, dated October 13, 2000, signed and sealed by Antonio Acevedo, P.E.
"Submitted Under NOA# 00-1227.05"

C. CALCULATIONS


1. Revised Anchor Calculations and structural analysis, prepared by Al-Farooq Corporation, dated 06/06/06, signed and sealed by Dr. Humayoun Farooq P.E
Complies with ASTM E1300-02 (with Flexible Support Analysis)

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **01-0821.12** issued to Spectus Systems – A Mikron Company for "White PVC Rigid" approved on 12/26/01, expiring on 12/26/06.

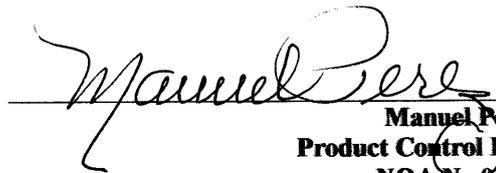

Manuel Perez, P.E.
Product Control Examiner
NOA No 06-0705.02

Expiration Date: July 12, 2011
Approval Date: August 24, 2006

Yale Ogron Windows & Doors, Inc.


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS


1. Statement letter of conformance, dated June 6, 2006, signed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated July 18, 1997, signed by Humayoun Farooq, P.E.
3. Letter from Al-Farooq Corporation, dated 5/31/01, stating that the engineer who performed the review of the product is still in the engineering business.
4. Letter from Yale Ogron, dated 2/27/01, stating that the product has not changed since it was originally approved.

G. OTHER

1. Notice of Acceptance No. **00-1227.05**, issued to Yale Ogron Manufacturing Co., Inc., Series 9500 White PVC Single Hung Window, approved on 07/12/01 and expiring on 07/12/06.

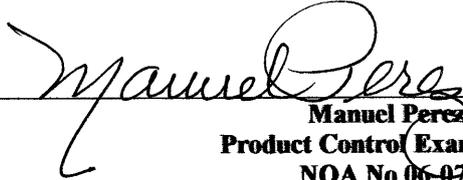

Manuel Perez, P.E.
Product Control Examiner
NOA No 06-0705.02
Expiration Date: July 12, 2011
Approval Date: August 24, 2006

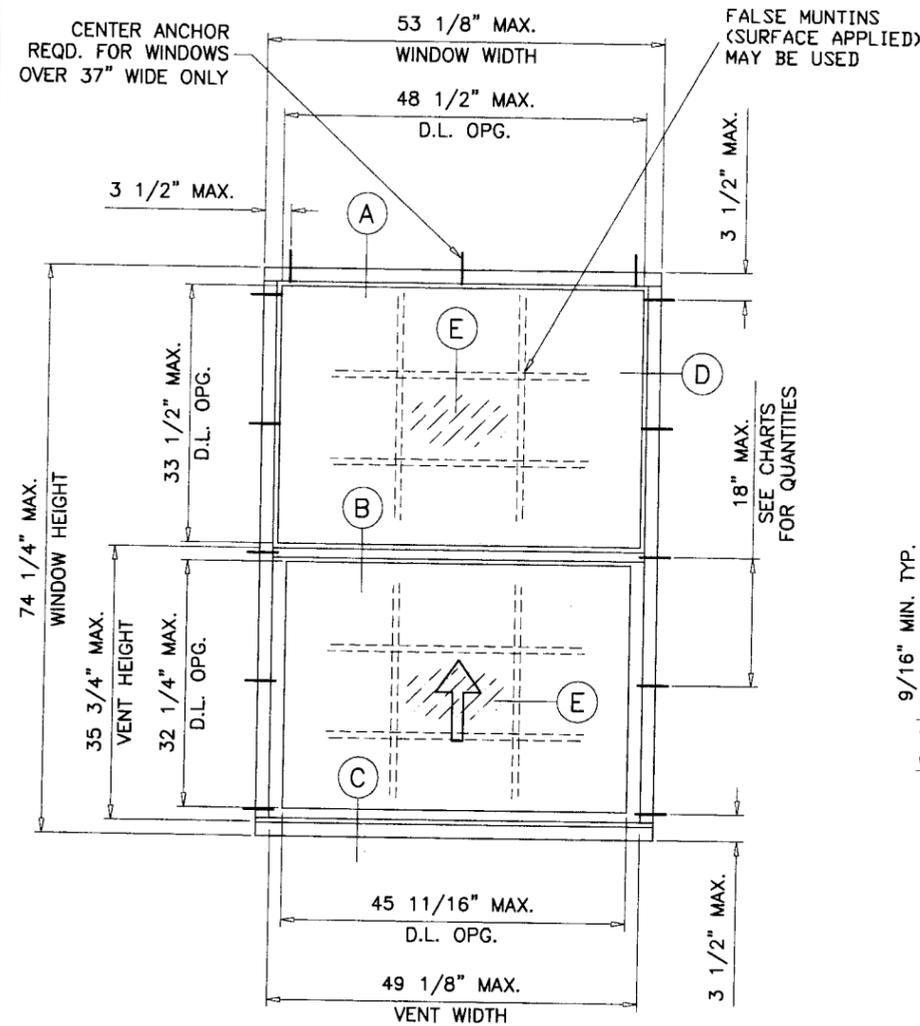

TYPICAL ELEVATION

SERIES-9500 VINYL SINGLE HUNG WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ABOVE.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF S.H./S.H. OR SINGLE HUNG WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION (REV. 2005) FOR THE HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.


ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.


MATERIALS INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004 FLORIDA BLDG. CODE SECTION 2003.8.4 (SUPPLEMENT 2005).

FALSE MUNTINS (SURFACE APPLIED) MAY BE USED

18" MAX. SEE CHARTS FOR QUANTITIES

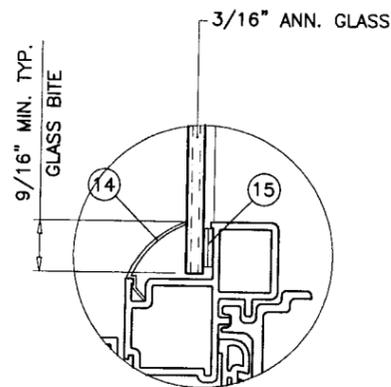

3/16" ANN. GLASS

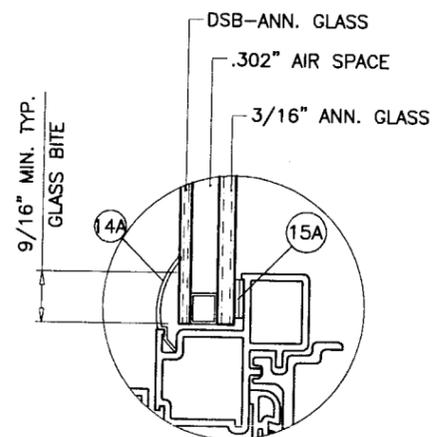

9/16" INSUL. ANN. GLASS

GLAZING OPTIONS

DESIGN LOAD CAPACITY - PSF STANDARD JAMB ANCHOR SPACING					
WINDOW DIMS.		3/16" GLASS		9/16" INSUL. GLASS	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	26" (3)	53.3	125.0	53.3	125.0
26-1/2"		53.3	125.0	53.3	125.0
32"		53.3	125.0	53.3	125.0
37"		53.3	125.0	53.3	125.0
42"		53.3	110.8	53.3	110.8
48"		53.3	96.9	53.3	96.9
53-1/8"		53.3	87.1	53.3	87.6
19-1/8"	38-3/8" (3)	53.3	125.0	53.3	125.0
26-1/2"		53.3	118.9	53.3	118.9
32"		53.3	98.5	53.3	98.5
37"		53.3	85.2	53.3	85.2
42"		53.3	75.0	53.3	75.0
48"		53.3	65.7	53.3	65.7
53-1/8"		53.3	59.3	53.3	59.3
19-1/8"	50-5/8" (4)	53.3	125.0	53.3	125.0
26-1/2"		53.3	120.2	53.3	120.2
32"		53.3	99.6	53.3	99.6
37"		53.3	86.1	53.3	86.1
42"		53.3	75.9	53.3	75.9
48"		53.3	65.4	53.3	66.4
53-1/8"		51.7	51.7	53.3	58.7
19-1/8"	58" (5)	53.3	125.0	53.3	125.0
26-1/2"		53.3	125.0	53.3	104.9
32"		53.3	108.6	53.3	86.9
37"		53.3	93.9	53.3	75.2
42"		53.3	81.6	53.3	66.2
48"		53.3	62.2	53.3	57.9
53-1/8"		48.9	48.9	52.3	52.3
19-1/8"	63" (5)	53.3	125.0	53.3	125.0
26-1/2"		53.3	120.8	53.3	120.8
32"		53.3	100.0	53.3	100.0
37"		53.3	86.5	53.3	86.5
42"		53.3	76.2	53.3	76.2
48"		53.3	61.1	53.3	63.2
53-1/8"		48.3	48.3	53.3	54.5
19-1/8"	74-1/4" (5)	53.3	125.0	53.3	125.0
26-1/2"		53.3	102.5	53.3	102.5
32"		53.3	84.8	53.3	84.8
37"		53.3	73.4	53.3	73.4
42"		53.3	64.6	53.3	64.6
48"		53.3	56.6	53.3	56.6
53-1/8"		48.3	48.3	50.0	50.0

* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.

NOTE: GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-02 (3 SEC. GUSTS) WITH REDUCTIONS FOR FLEXIBLE SUPPORTS TO COMPLY WITH SECTION 2403.2 OF FBC 2004 EDITION.

INSTALLATION OF THIS PRODUCT IN THE HVHZ AREA REQUIRES THE USE OF APPROVED SHUTTERS OR EXTERNAL PROTECTION DEVICES COMPLYING WITH HVHZ REQUIREMENTS. INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA SHALL MEET THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

DESIGN LOAD CAPACITY - PSF EXTRA JAMB ANCHORS					
WINDOW DIMS.		3/16" GLASS		9/16" INSUL. GLASS	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	26" (4)	53.3	125.0	53.3	125.0
26-1/2"		53.3	125.0	53.3	125.0
32"		53.3	125.0	53.3	125.0
37"		53.3	125.0	53.3	125.0
42"		53.3	125.0	53.3	125.0
48"		53.3	121.7	53.3	118.9
53-1/8"		53.3	87.1	53.3	98.9
19-1/8"	38-3/8" (4)	53.3	125.0	53.3	125.0
26-1/2"		53.3	125.0	53.3	125.0
32"		53.3	125.0	53.3	125.0
37"		53.3	113.6	53.3	113.6
42"		53.3	100.1	53.3	100.1
48"		53.3	83.7	53.3	87.1
53-1/8"		53.3	65.8	53.3	74.6
19-1/8"	50-5/8" (6)	53.3	125.0	53.3	125.0
26-1/2"		53.3	125.0	53.3	125.0
32"		53.3	125.0	53.3	125.0
37"		53.3	111.3	53.3	104.1
42"		53.3	86.9	53.3	86.4
48"		53.3	65.4	53.3	71.7
53-1/8"		51.7	51.7	53.3	58.7
19-1/8"	58" (6)	53.3	125.0	53.3	125.0
26-1/2"		53.3	125.0	53.3	125.0
32"		53.3	124.3	53.3	125.0
37"		53.3	101.9	53.3	98.3
42"		53.3	81.6	53.3	80.4
48"		53.3	62.2	53.3	66.0
53-1/8"		48.9	48.9	53.3	55.5
19-1/8"	63" (6)	53.3	125.0	53.3	125.0
26-1/2"		53.3	125.0	53.3	125.0
32"		53.3	113.9	53.3	120.0
37"		53.3	96.0	53.3	95.8
42"		53.3	78.9	53.3	77.6
48"		53.3	61.1	53.3	63.2
53-1/8"		48.3	48.3	53.3	54.5
19-1/8"	74-1/4" (6)	53.3	125.0	53.3	125.0
26-1/2"		53.3	117.9	53.3	123.0
32"		53.3	98.9	53.3	101.8
37"		53.3	81.6	53.3	88.1
42"		53.3	72.0	53.3	73.7
48"		53.3	59.0	53.3	58.7
53-1/8"		48.3	48.3	50.0	50.0

* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538






PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 06-0705.02
Expiration Date JULY 12, 2011
Miami Dade Product Control
Division

JUN 09 2006

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W00-52YO

SERIES-9500 VINYL SINGLE HUNG WINDOW
YALE OGRON WINDOWS AND DOORS INC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no.	date	by	description
A	06.07.06		UPDATED FOR 2004 FBC
date:	12-11-00	scale:	1/2" = 1"
dr. by:	HAMID	chk. by:	
drawing no.	W00-52		
sheet 1 of 4			

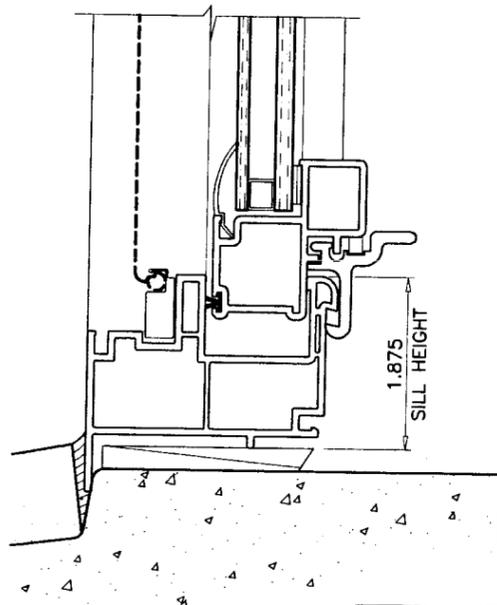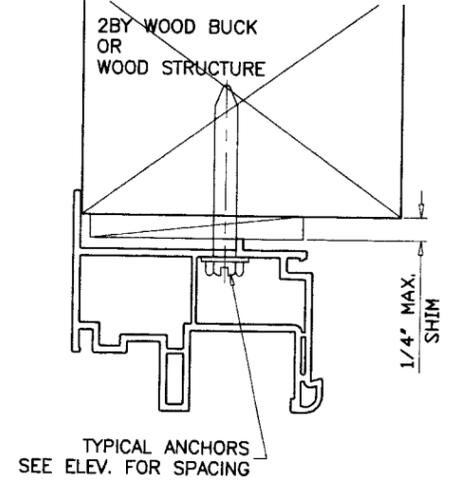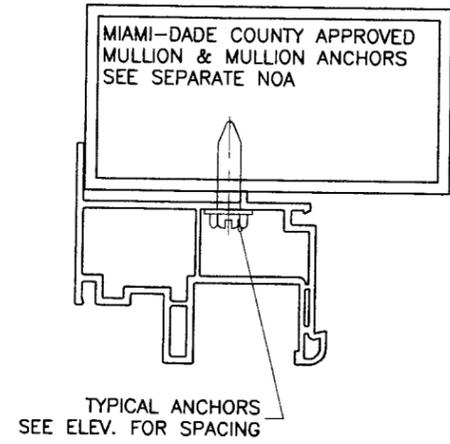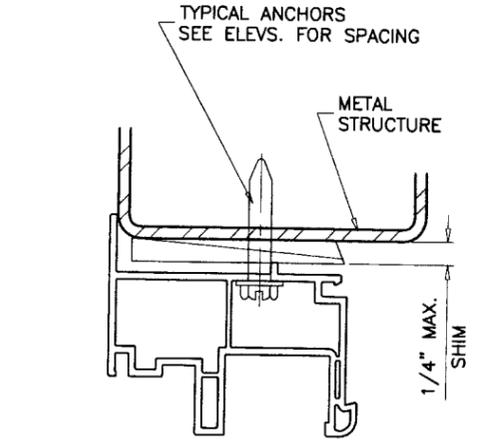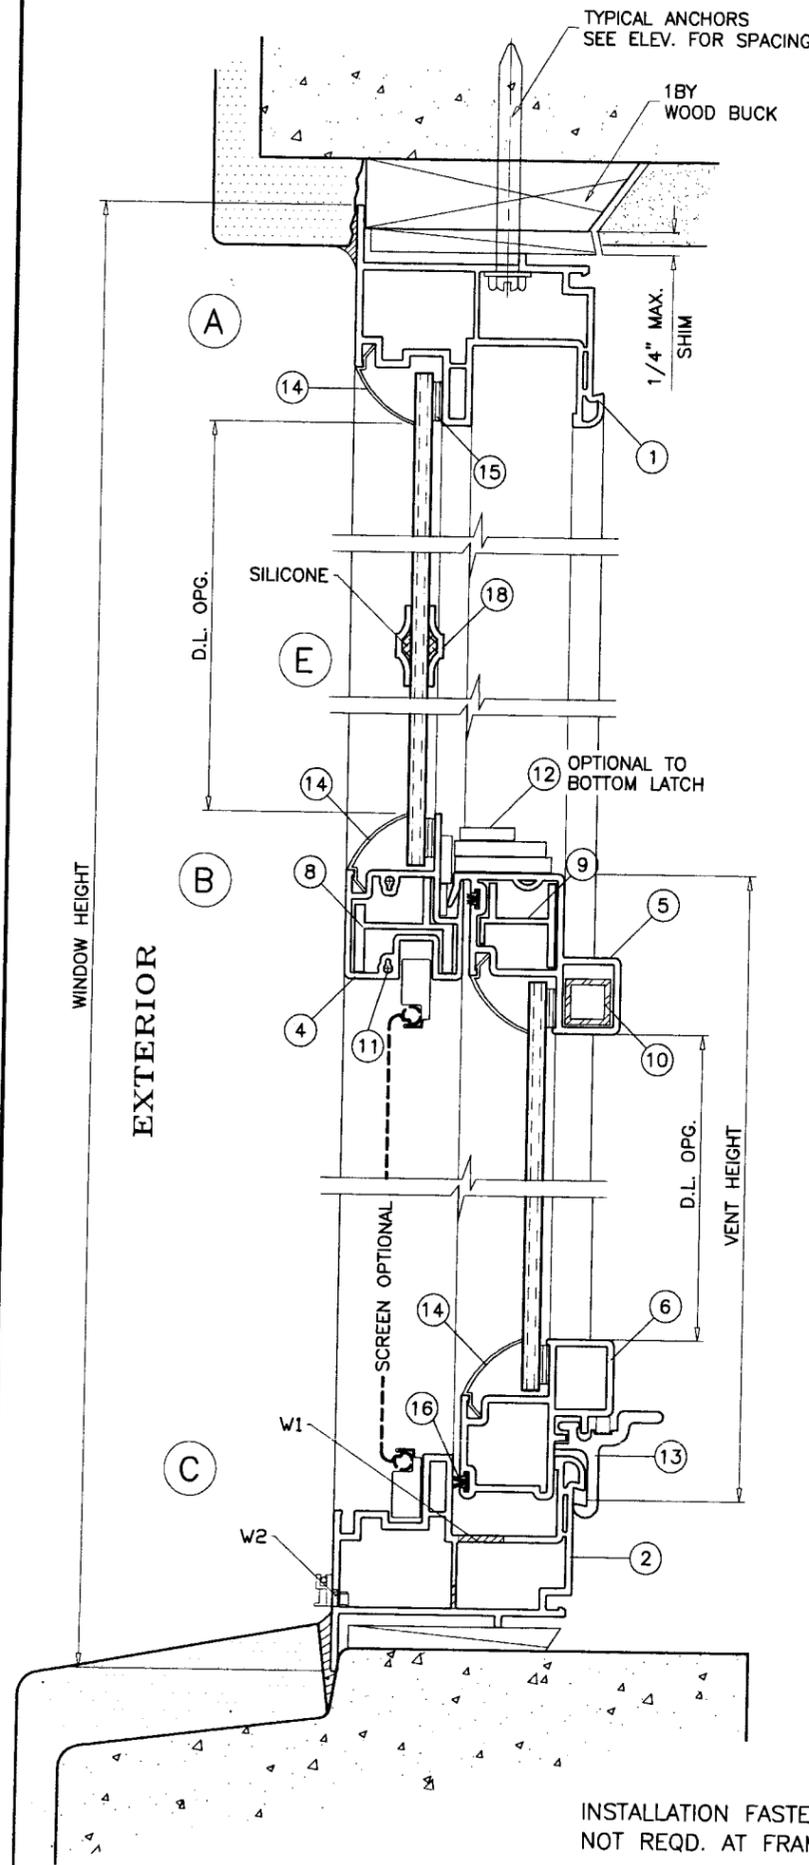

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

#14 SMS

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-3/8" MIN. PENETRATION INTO WOOD

1/4" TAPCONS

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-3/8" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SMS OR SELF DRILLING SCREWS

INTO METAL STRUCTURES

STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)

ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)

(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#12 SMS OR SELF DRILLING SCREWS

INTO DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
(NO SHIM SPACE)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2" MIN.

INTO WOOD STRUCTURE = 1" MIN.

INTO METAL STRUCTURE = 1/2" MIN.

WEEPHOLES:

W1 = 5/8" X 3/16" DRAIN HOLES
AT 3" FROM EACH END

W2 = 1-1/4" X 1/4" WEEP HOLE WITH PLASTIC BAFFLE
AT 3" FROM EACH END

INSTALLATION FASTENERS
NOT REQD. AT FRAME SILL

WOOD BUCKS AND METAL STRUCTURE NOT BY YALE OGRON
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 06-0705.02
Expiration Date JULY 12, 2011

Handwritten signature
JUN 09 2006

By *Manuel Perez*
Miami Dade Product Control
Division

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W00-52YO




SERIES-9500 VINYL SINGLE HUNG WINDOW
YALE OGRON WINDOWS AND DOORS INC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

revisions:	no	date	by	description
	A	06.07.06		UPDATED FOR 2004 FBC

date: 12-11-00
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W00-52

sheet 2 of 4

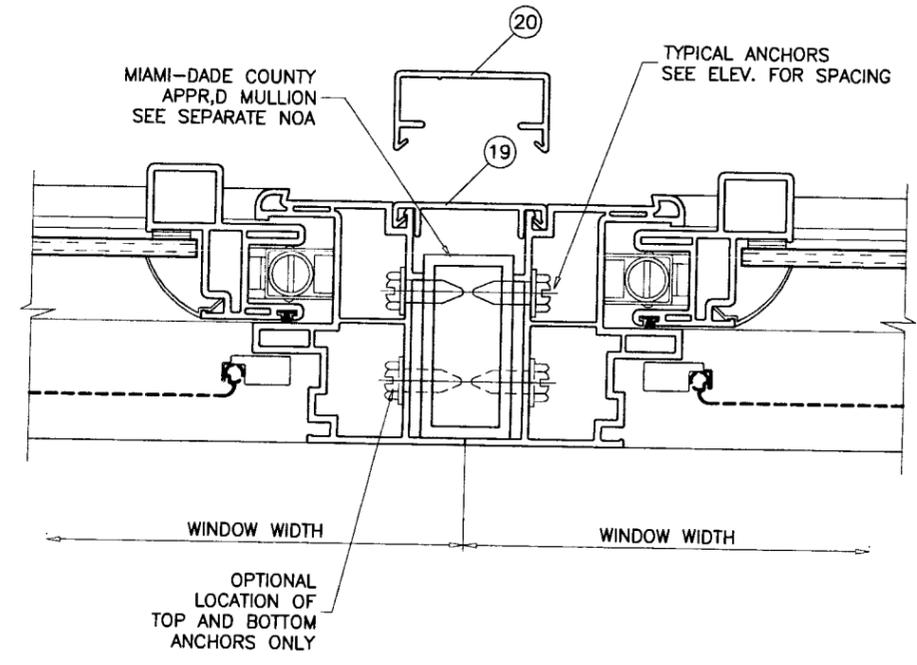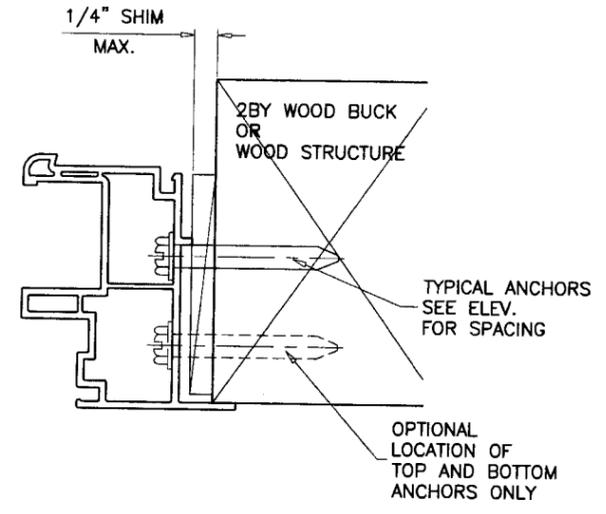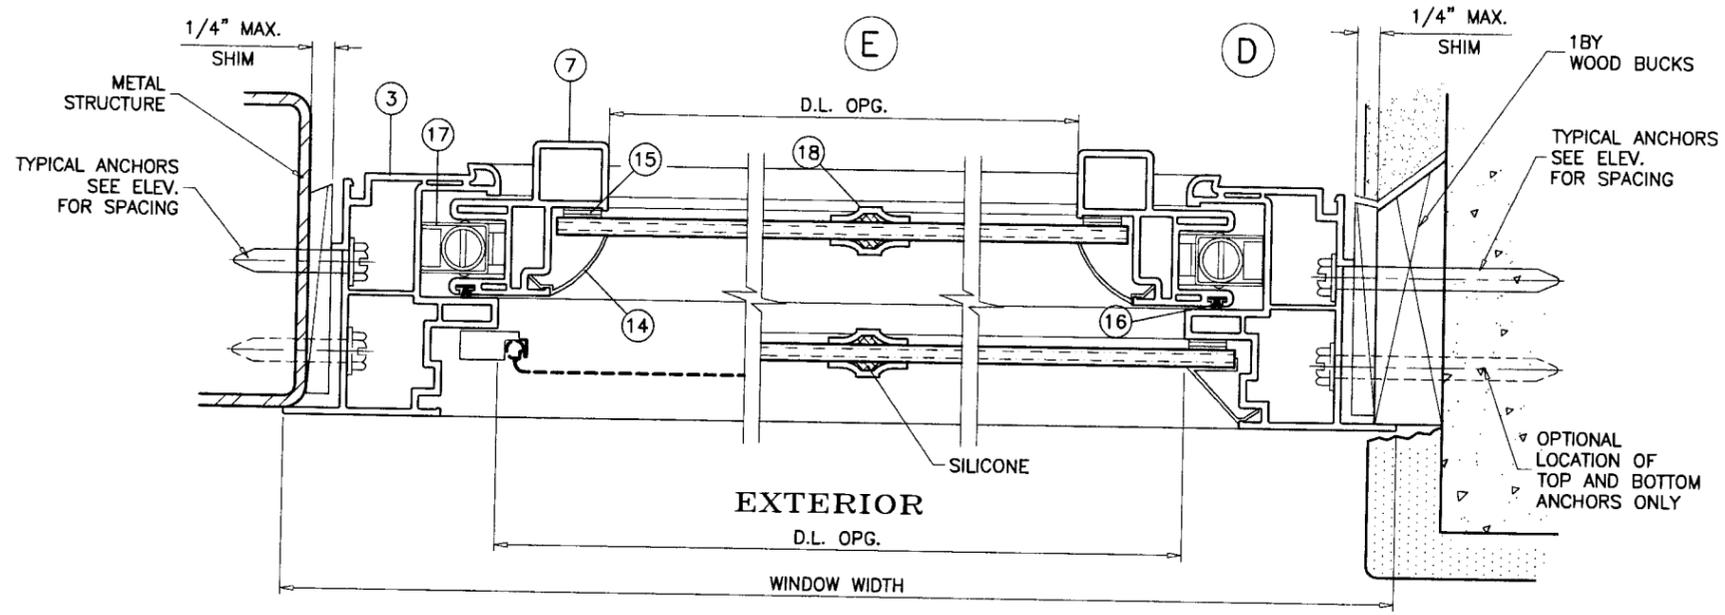

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

JUN 09 2006

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 06-0705.02
 Expiration Date JULY 12, 2011

By *Manuel Perez*
 Miami Dade Product Control
 Division


AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W00-52YO

SERIES-9500 VINYL SINGLE HUNG WINDOW
YALE OGRON WINDOWS AND DOORS INC.
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309


no	date	by	description
A	06.07.06		UPDATED FOR 2004 FBC

date: 12-11-00
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
W00-52
 sheet 3 of 4

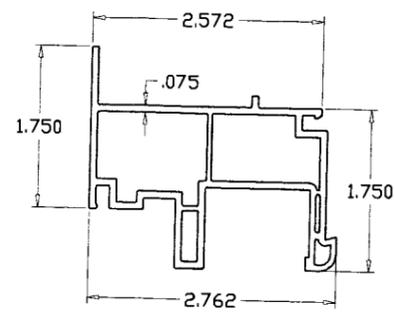


FRAME HEAD/SILL/JAMB

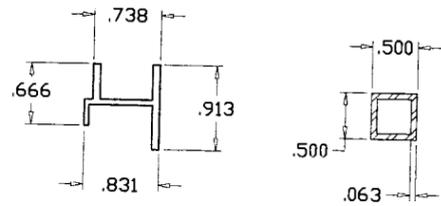


VENT TOP RAIL STIFFENERS

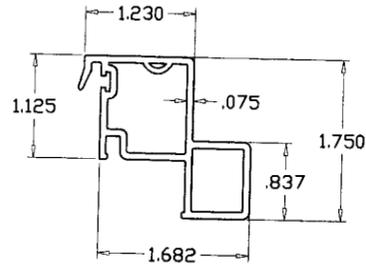


VENT TOP RAIL




FIXED RAIL STIFFENER




FIXED RAIL




VENT LATCH

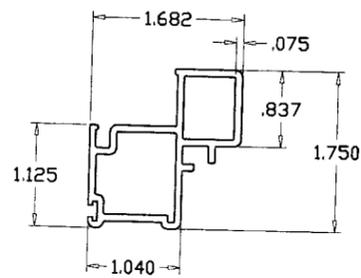


VENT BOTTOM RAIL




FALSE MUNTIN

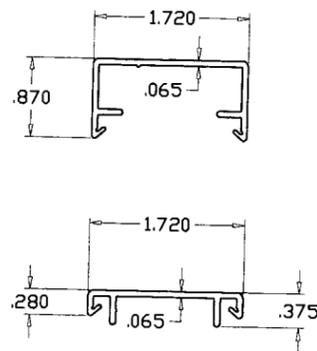


MULLION COVERS

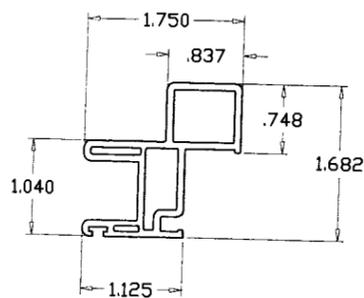

VENT SIDE RAIL



3/16" GLASS




9/16" GLASS


GLAZING BEADS
SCALE 1:1

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	YV-938	1	FRAME HEAD	PVC	-
2	YV-938	1	FRAME SILL	PVC	-
3	YV-938	2	FRAME JAMB	PVC	-
4	YV-930	1	FIXED MTG. RAIL	PVC	-
5	YV-935	1	VENT TOP RAIL	PVC	-
6	YV-937	1	VENT BOTTOM RAIL	PVC	-
7	YV-936	2	VENT JAMB	PVC	-
8	YE-1101	1	FIXED RAIL STIFFENER	6063-T5	-
9	YE-1102	1	VENT MTG. RAIL STIFFENER	6063-T5	-
10	YH-961	1	VENT MTG. RAIL STIFFENER	STEEL	1/2" X 1/2" X 1/16" THK.
11	#BX1-3/4"	4	FIXED RAIL FASTENERS	-	PAN HEAD SMS
12	YH-960	1	CAM LOCK & KEEPER @ MIDSPAN	ZAMAK	ALLEN STEVENS
13	YV-939	2/ VENT	VENT BOTTOM LATCH	PLASTIC	AT 6" FROM EACH END
14	YB-901	AS REQD.	GLAZING BEAD 3/16" GLASS	PVC	-
14A	YB-902	AS REQD.	GLAZING BEAD 9/16" GLASS	PVC	-
15	-	AS REQD.	GLAZING COMPOUND	SILICONE	-
15A	YGT-1/8	AS REQD.	GLAZING TAPE 1/8" X 1/2"	POLYOLEFIN	VENTURE TAPE
16	YH-970	AS REQD.	FIN SEAL PILE WEATHERSTRIP	-	ULTRAFAB .190 X .187
17	-	2/ VENT	BALANCES	-	5/8" SPRING & PULLEY
18	YV-915	AS REQD.	APPLIED MUNTIN (OPTIONAL)	PVC	-
19	YH-950	AS REQD.	MULLION COVER (OPTIONAL)	PVC	FOR 1X2 TUBE
20	YH-951	AS REQD.	MULLION COVER (OPTIONAL)	PVC	FOR 1X3 TUBE

NOTE:
RIGID PVC EXTRUSIONS
SPECTUS SYSTEMS-A BY MIKRON CO.
MAY BE SUBSTITUTED BY ANOTHER SUPPLIER
THAT IS A MEMBER OF AAMA AND HOLDS A
MIAMI-DADE COUNTY NOA.

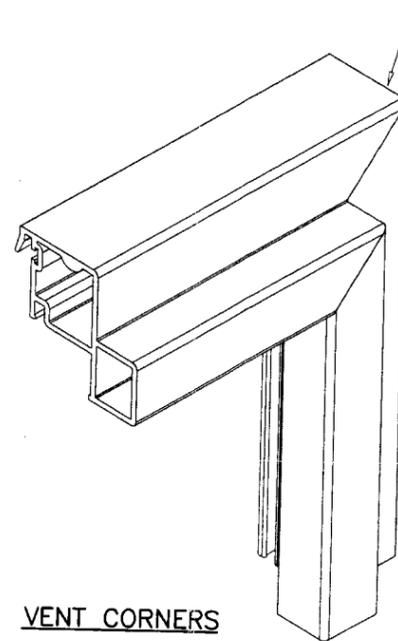

VENT CORNERS

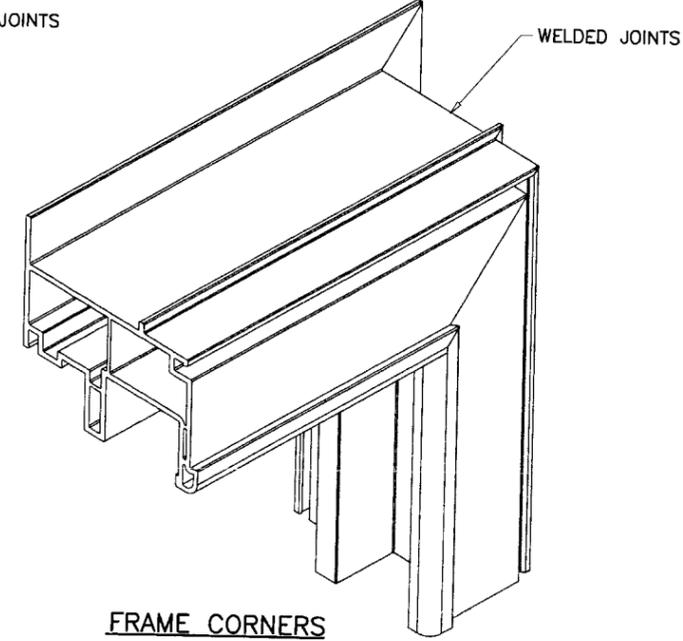

FRAME CORNERS

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 06-0705.02
Expiration Date JULY 12, 2011

By *Manuel Perez*
Miami Back Product Control
Division

JUN 09 2006

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W00-52YO

SERIES-9500 VINYL SINGLE HUNG WINDOW
YALE OGRON WINDOWS AND DOORS INC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no.	date	by	description
A	06.07.06		UPDATED FOR 2004 FBC

revisions:

date: 12-11-00
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W00-52

sheet 4 of 4