



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908  
www.buildingcodeonline.com

**NOTICE OF ACCEPTANCE (NOA)**

**Traco Security Windows & Doors, Inc.**  
**71 Progress Avenue**  
**Cranberry Township, PA 16066**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series 8000 Aluminum Sliding Glass Door -LMI**

**APPROVAL DOCUMENT:** Drawing No. **W02-08**, titled "Series 8000 Alum. SLD. Glass Door (L.M.)", sheets 1 through 6 of 6, prepared by Al-Farooq Corporation, dated 08/25/00 and last revised on 09/07/06, signed and sealed by Dr. Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistance**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews NOA # 02-0226.10** consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



*J. Gascon*  
*10/20/06*

**NOA No 06-0706.19**  
**Expiration Date: May 09, 2012**  
**Approval Date: November 08, 2006**  
**Page 1**


**Traco Security Windows & Doors, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

- A. DRAWINGS**
1. Manufacturer's die drawings and sections.
  2. Drawing No. W02-08, titled "Series 8000 Alum. SLD. Glass Door (L.M.)", sheets 1 through 6 of 6, prepared by Al-Farooq Corporation, dated 08/25/00 and last revised on 09/07/06, signed and sealed by Dr. Humayoun Farooq, P.E.
- B. TESTS (transferred from file # 02-0706.10)**
1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TASA 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of an aluminum sliding glass door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL 3260**, dated 1/18/02, signed and sealed by Luis Figueredo, P.E.
- C. CALCULATIONS**
1. Revised Anchor verification calculation dated 09/07/06, complying w/ FBC 2004, prepared by Al-Farooq Corporation, signed and sealed by Dr. Humayoun Farooq, P.E.
  2. Glazing complies with ASTM E-1300-98.
- D. QUALITY ASSURANCE**
1. Miami Dade Building Code Compliance Office (BCCO).
- E. MATERIAL CERTIFICATIONS**
1. Notice of Acceptance No. **02-1205.03**, issued to Security Impact Glass Holdings L.L.C. for "SAF-GLAS" dated 01/02/03, expiring on 12/16/07.
- F. STATEMENTS**
1. Statement letter of compliance w/FBC-2004, signed by Dr. Humayoun Farooq, P.E.
  2. Statement letter of compliance and of no financial interest, dated 08/01/06, signed and sealed by Dr. Humayoun Farooq, P.E.
- G. OTHER**
1. Letter from the consultant stating that the product is in compliance with the Florida Building Code.



**Jaime D. Gascon, P. E.**  
**Chief, Product Control Division**  
NOA No 06-0706.19  
Expiration Date: May 09, 2012  
Approval Date: November 08, 2006

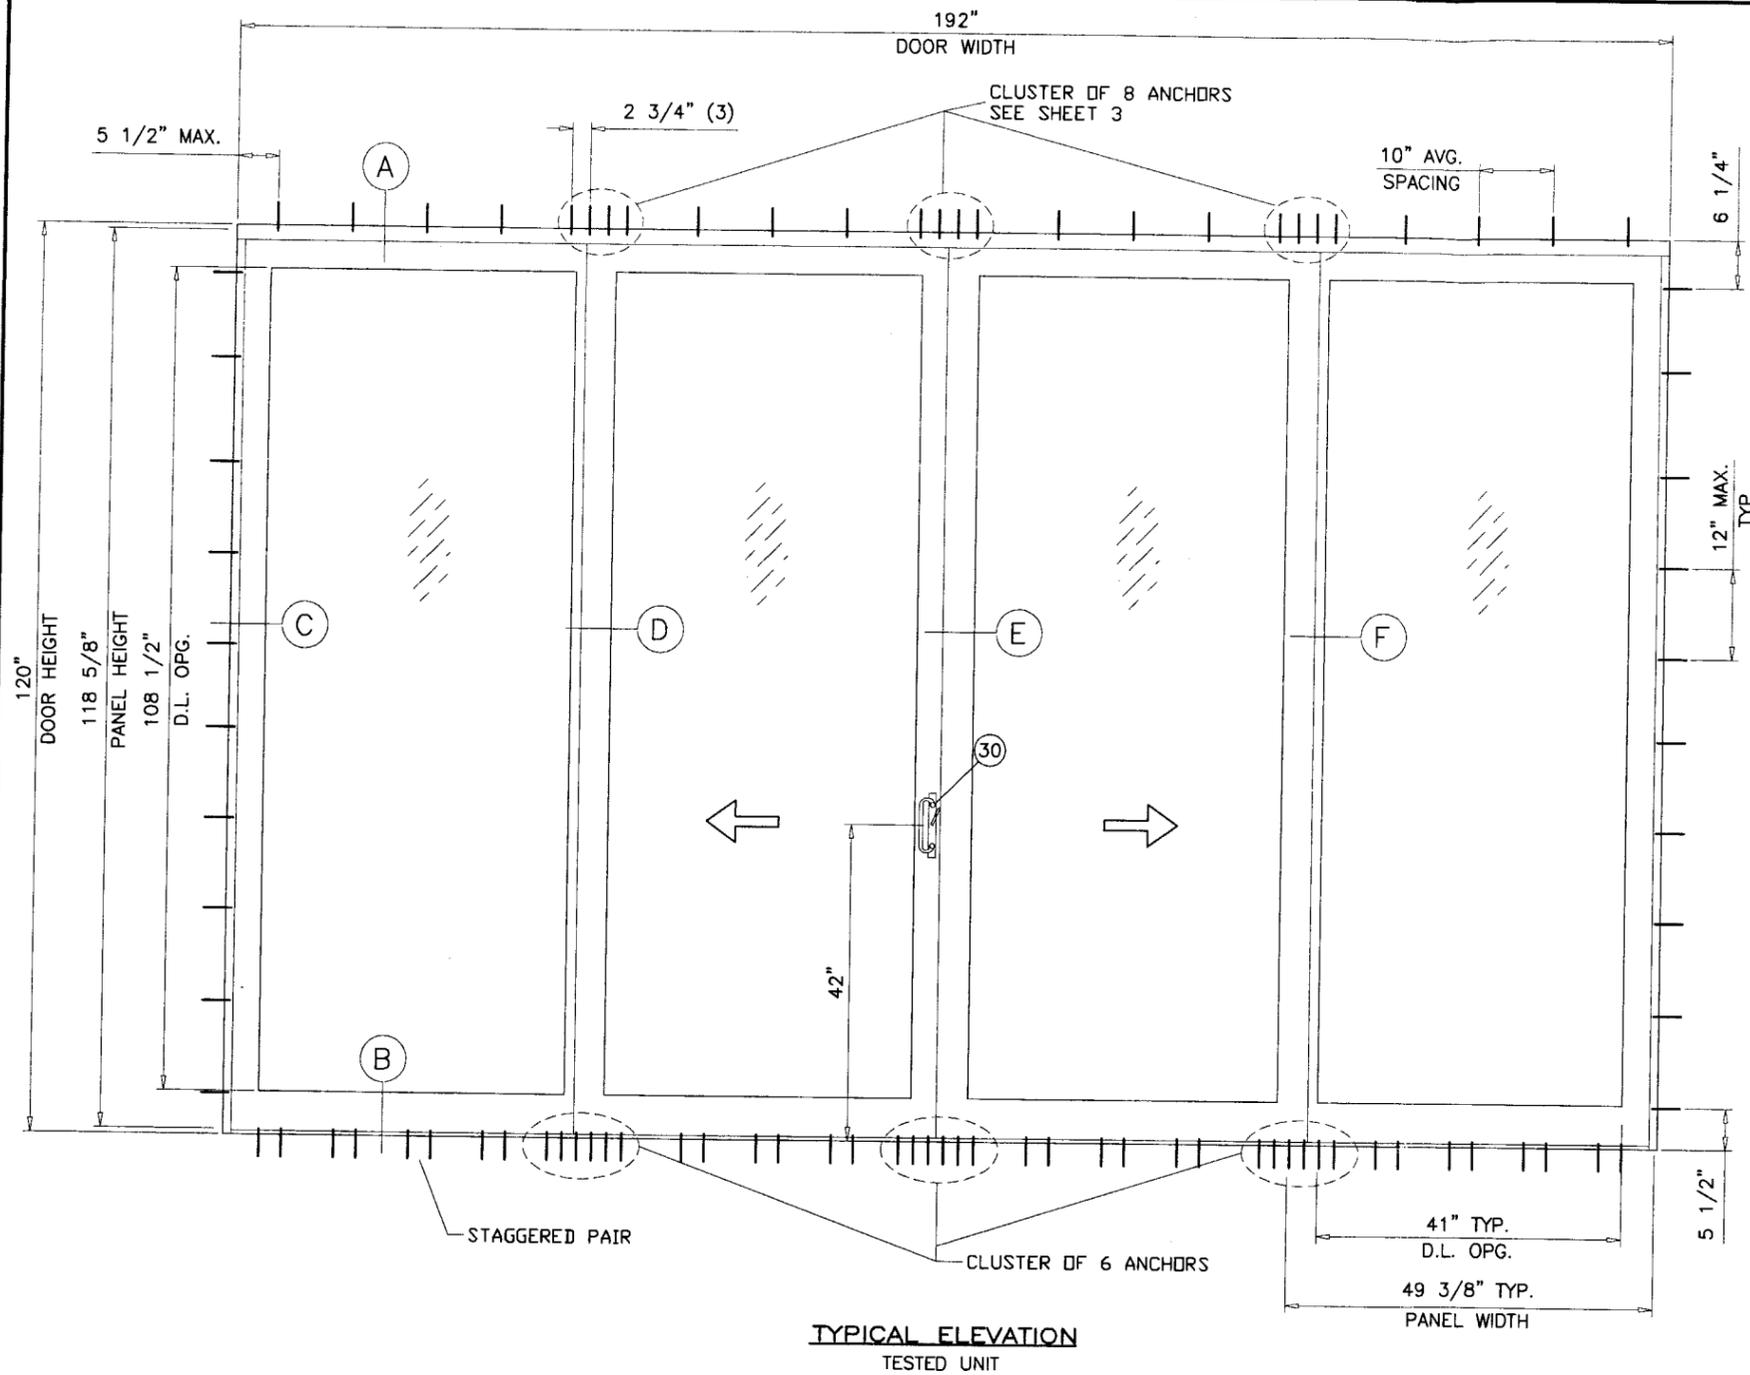

**PRODUCT RENEWED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 06-0700-19  
 Expiration Date 05/09/12  
 By *[Signature]*  
 Miami Code Product Control  
 Division

DOORS GLAZED WITH LAMINATED GLASS RATED FOR  
 LARGE MISSILE IMPACT AND REQUIRE NO SHUTTERS.

**SERIES 8000 ALUMINUM SLIDING GLASS DOOR**

DESIGN LOAD RATING FOR DOORS TO BE AS PER CHARTS  
 SHOWN ON SHEET 2.


THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE  
 REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION (REV. 2005)  
 INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER  
 LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS  
 EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.  
 ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS  
 ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF  
 ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO  
 CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS  
 OF 2004 FLORIDA BLDG. CODE SECTION 2003.8.4 (SUPPLEMENT 2005).

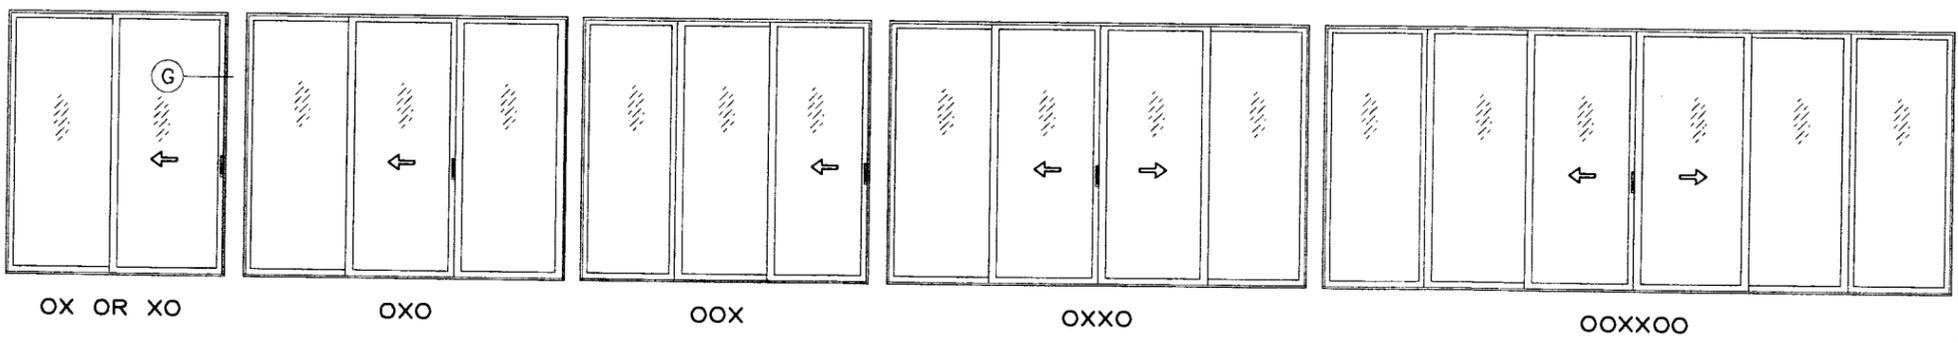

**APPROVED CONFIGURATIONS**

DOORS MAY HAVE ANY NUMBER OF PANELS USING STILE CONFIGURATIONS AS SHOWN ON SHEET 3.  
 I.E. OX, XO, OXO, OXXO, O0XX00 ETC.

Engr: DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 C.A. No. 3538  
*[Signature]*  
 SEP 08 2008

*afc*

**AL-FAROOQ CORPORATION**  
 ENGINEERS, PLANNERS & PRODUCT DESIGN  
 1235 SW 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W02-08TS

---

SERIES 8000 ALUM. SLD. GLASS DOOR (L.M.)  
**TRACO SECURITY WINDOWS & DOORS INC.**  
 5100 N.W. 72 AVE.  
 MIAMI, FL. 33166  
 TEL. (305) 591-8990

no	date	by	description
A	07.27.05		UPDATED FOR 2004 FBC
B	09.07.06		NO CHANGE THIS SHEET

revisions:


date: 08-25-00  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W02-08**

sheet 1 of 6

DESIGN LOAD CAPACITY - PSF						
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		
		EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	
36	96	100.0	120.0	100.0	120.0	
39		100.0	120.0	100.0	120.0	
42		100.0	120.0	100.0	120.0	
45		100.0	120.0	100.0	120.0	
48		100.0	120.0	100.0	120.0	
51		100.0	119.2	100.0	120.0	
54		100.0	115.0	100.0	120.0	
57		100.0	111.4	100.0	120.0	
60	100.0	108.2	100.0	120.0		
36	102	100.0	120.0	100.0	120.0	
39		100.0	120.0	100.0	120.0	
42		100.0	120.0	100.0	120.0	
45		100.0	119.8	100.0	120.0	
48		100.0	114.5	100.0	120.0	
51		100.0	109.8	100.0	120.0	
54		100.0	105.8	100.0	120.0	
36		108	100.0	120.0	100.0	120.0
39	100.0		120.0	100.0	120.0	
42	100.0		117.3	100.0	120.0	
45	100.0		111.4	100.0	120.0	
48	100.0		106.3	100.0	120.0	
51	100.0		101.9	100.0	120.0	
36	114		100.0	120.0	100.0	120.0
39			100.0	116.3	100.0	120.0
42		100.0	109.7	100.0	120.0	
45		100.0	104.1	100.0	120.0	
48		99.2	99.2	100.0	120.0	
36	120	100.0	116.7	100.0	120.0	
39		100.0	109.3	100.0	120.0	
42		100.0	103.1	100.0	120.0	
45		97.7	97.7	100.0	120.0	
48		93.0	93.0	100.0	120.0	

NOTE:  
GLASS CAPACITIES ON THIS SHEET ARE  
BASED ON ASTM E1300-98 (60 SEC. WIND)

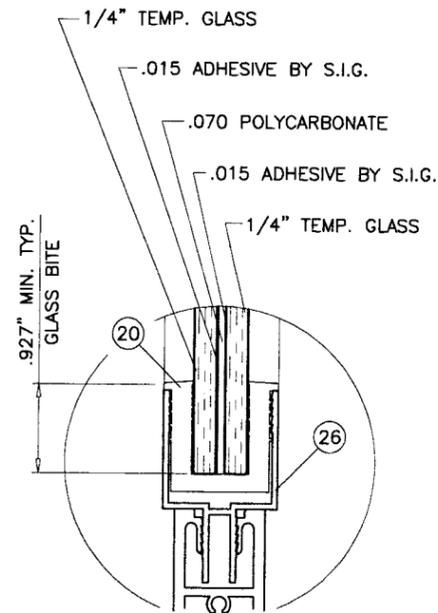

LARGE MISSILE IMPACT RESISTANT  
LAMINATED BY 'SECURITY IMPACT GLASS'  
GLAZING DETAIL

**PRODUCT RENEWED**  
as complying with the Florida  
Building Code  
Acceptance No. 06-0706.19  
Expiration Date 05/09/12  
By [Signature]  
Miami Code Product Control  
Division

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

11 SEP 08 2008

*afc*

**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 8000 ALUM. SLD. GLASS DOOR (L.M.)  
**TRACO SECURITY WINDOWS & DOORS INC.**  
5100 N.W. 72 AVE.  
MIAMI, FL. 33166  
TEL. (305) 591-8990



no	date	description
A	07.27.05	CHART REV.
B	09.07.06	NO CHANGE THIS SHEET

date: 08-25-00  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W02-08**

sheet 2 of 6

COMP-ANL W02-08TS

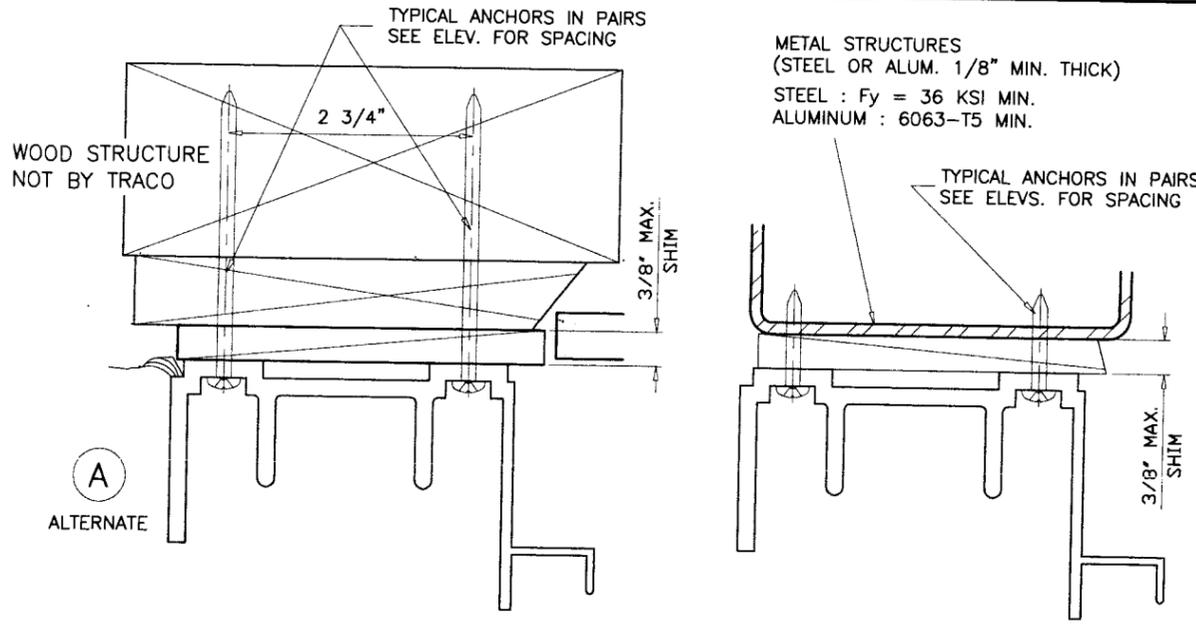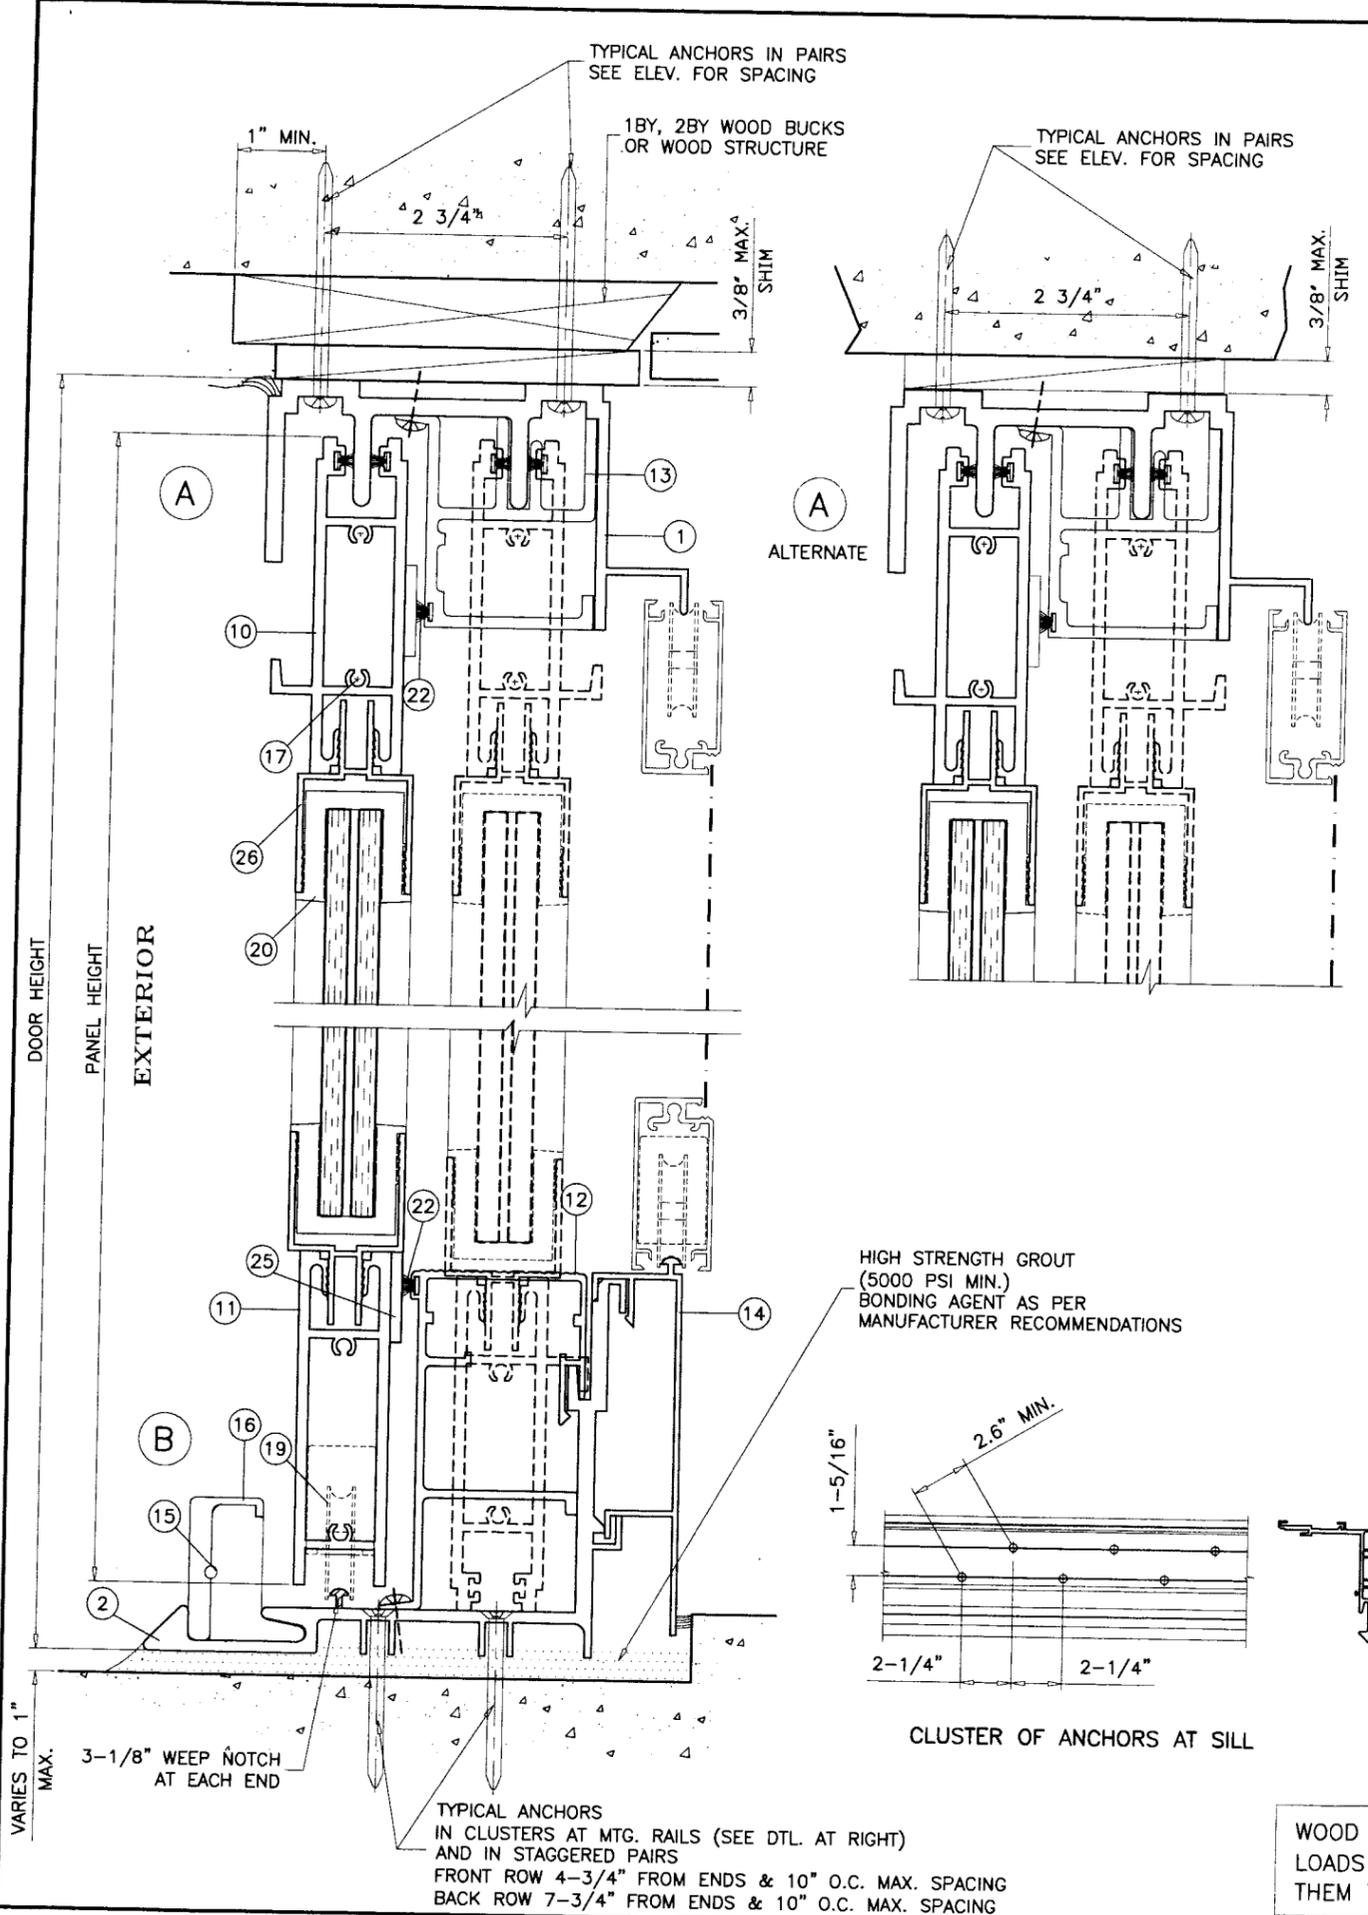

**AL-FAROOQ CORPORATION**  
 ENGINEERS, PLANNERS & PRODUCT DESIGN  
 1235 SW 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978

**TYPICAL ANCHORS:** SEE ELEV. FOR SPACING

**TYPE 'A'**  
**1/4" TAPCONS** (AT HEAD, SILL AND JAMBS)  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE  
 1-1/2" MIN. PENETRATION INTO WOOD  
 THRU 1BY BUCKS INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
 DIRECTLY INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

**#14 SMS OR SELF DRILLING SCREWS**  
 INTO METAL STRUCTURES (1/8" MIN. THICKNESS)  
 (1/4" MAX. SHIM SPACE)


**PRODUCT RENEWED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 06-0706.19  
 Expiration Date 05/09/12  
 By: [Signature]  
 Miami Base Product Control  
 Division

**TYPE 'B'**  
**5/16" TAPCONS** (AT HEAD ONLY)  
 INTO WOOD STRUCTURE  
 1-3/4" MIN. PENETRATION INTO WOOD  
 THRU WOOD BUCKS INTO CONC.  
 1-3/4" MIN. EMBED INTO CONC.  
 DIRECTLY INTO CONC.  
 1-3/4" MIN. EMBED INTO CONC.

**1/4" TAPCONS** (AT SILL AND JAMBS)  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE  
 1-1/2" MIN. PENETRATION INTO WOOD  
 THRU 1BY BUCKS INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
 DIRECTLY INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
**1/4" SELF DRILLING SCREWS (DRILLFLEX OR EQUIV.)**  
 INTO METAL STRUCTURES (1/8" MIN. THICKNESS)  
 (1/4" MAX. SHIM SPACE)

**EDGE DISTANCES**  
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.  
 INTO WOOD STRUCTURE = 1" MIN.  
 INTO METAL STRUCTURE = 5/8" MIN.  
 MIN. CONC. STRENGTH =  $f_c' = 3000$  PSI  
 MIN. MASONRY =  $f_m' = 1500$  PSI

**SEALANTS:**  
 FRAME AND PANEL CORNERS AND INSTALLATION SCREWS AT SILL  
 SEALED WITH SEALANT.

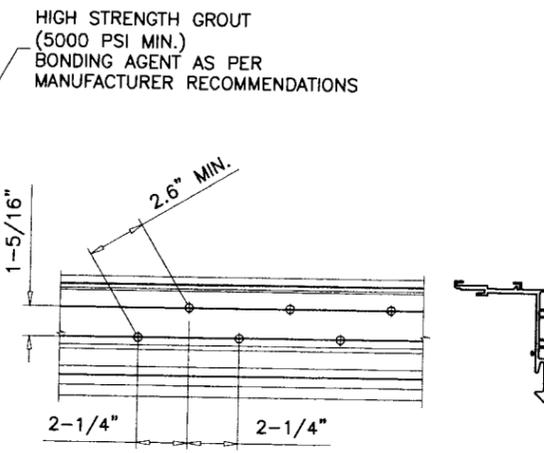

WOOD BUCKS NOT BY TRACO SECURITY, MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

Engr: DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 C.A.N. 3538  
 SEP 08 2006

SERIES 8000 ALUM. SLD. GLASS DOOR (L.M.)  
**TRACO SECURITY WINDOWS & DOORS INC.**  
 5100 N.W. 72 AVE.  
 MIAMI, FL. 33166  
 TEL. (305) 591-8990

no	date	description
A	07.27.05	ANCHORS REV.
B	09.07.06	REV. PER BCCO COMMENTS


date: 08-25-00	scale: 1/2" = 1"
dr. by: HAMID	chk. by:

drawing no.	W02-08
sheet	3 of 6

COMP-ANL W02-0BTS

3/16" X 2" DRIVE PIN  
2 PER FIX. PANEL

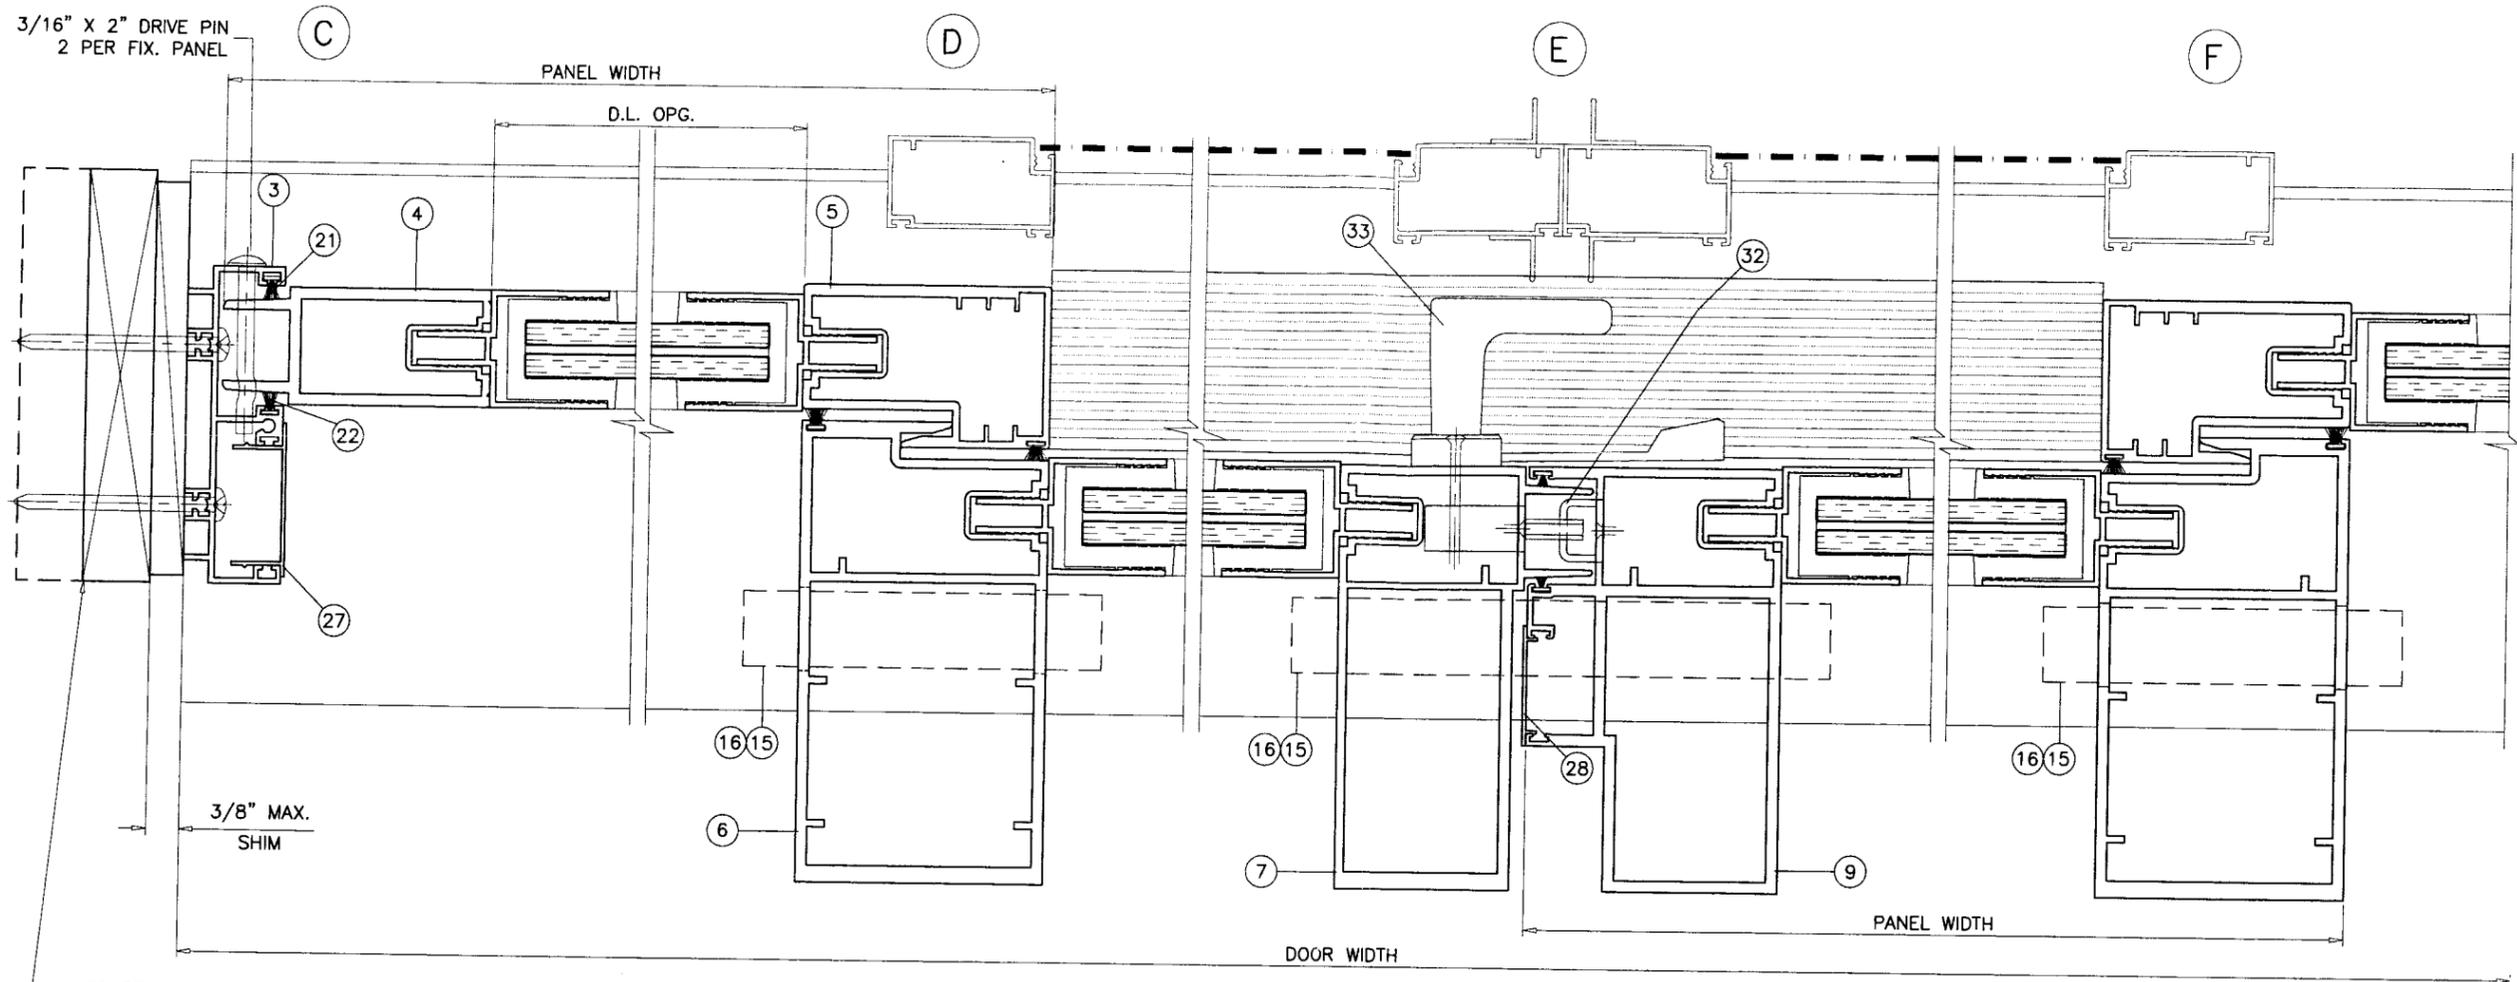


EXTERIOR


1BY, 2BY WOOD BUCKS  
OR WOOD STRUCTURE

3/8" MAX.  
SHIM

TYPICAL ANCHORS IN PAIRS  
SEE ELEV. FOR SPACING

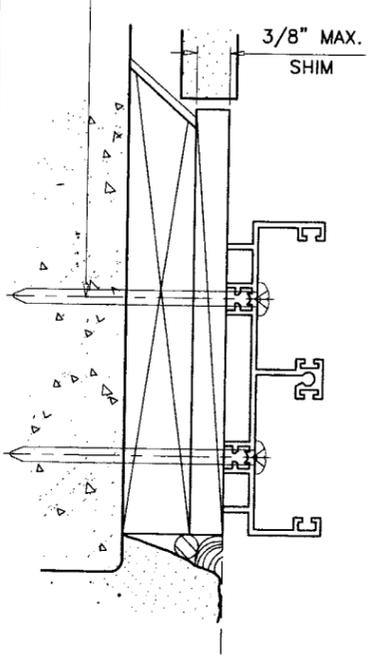


METAL STRUCTURES  
(STEEL OR ALUM. 1/8" MIN. THICK)  
STEEL : F<sub>y</sub> = 36 KSI MIN.  
ALUMINUM : 6063-T5 MIN.

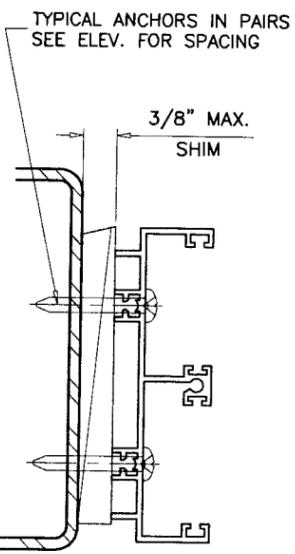

TYPICAL ANCHORS IN PAIRS  
SEE ELEV. FOR SPACING

3/8" MAX.  
SHIM

TYPICAL ANCHORS IN PAIRS  
SEE ELEV. FOR SPACING

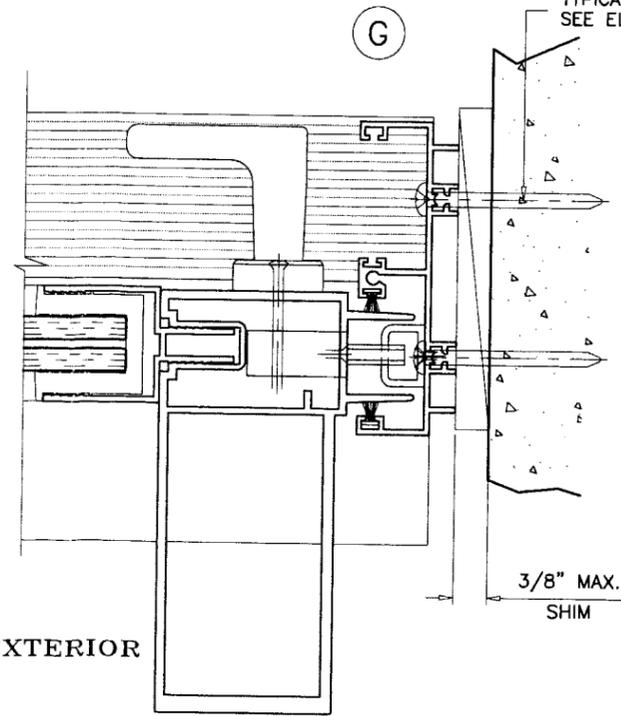

EXTERIOR

3/8" MAX.  
SHIM

**PRODUCT RENEWED**  
in compliance with the Florida  
Building Code  
Acceptance No. 06-0706-19  
Expiration Date: 05/09/12  
By: [Signature]  
Miami State Product Control  
Division

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538  
SEP 08 2008

**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978


SERIES 8000 ALUM. SLID. GLASS DOOR (L.M.)  
**TRACO SECURITY WINDOWS & DOORS INC.**  
5100 N.W. 72 AVE.  
MIAMI, FL. 33166  
TEL. (305) 591-8990

revisions:	
no	description
A	07.27.05 NO CHANGE THIS SHEET
B	09.07.06 NO CHANGE THIS SHEET


  

date: 08-25-00	scale: 1/2" = 1"	dr. by: HAMID	chk. by:
drawing no. W02-08			
sheet 4 of 6			


COMP-ANL\W02-08TS

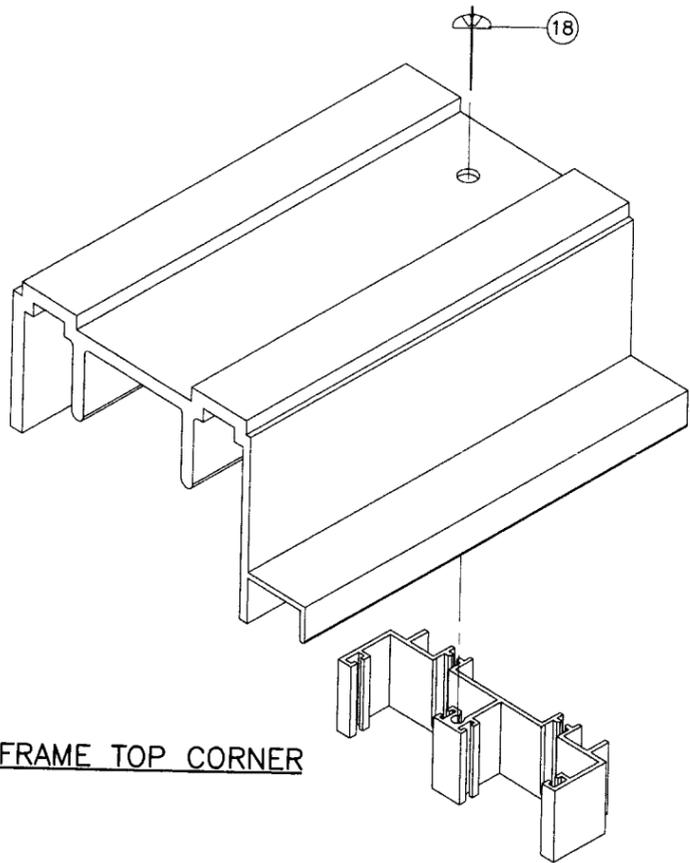


FRAME TOP CORNER



FRAME BOTTOM CORNER

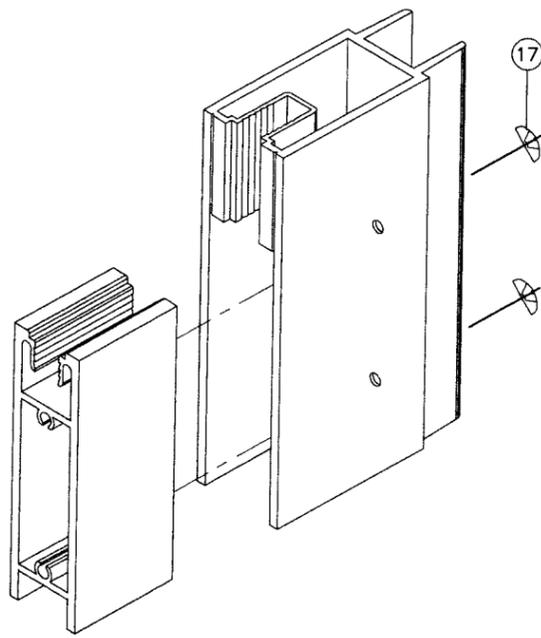

PANEL BOTTOM CORNER

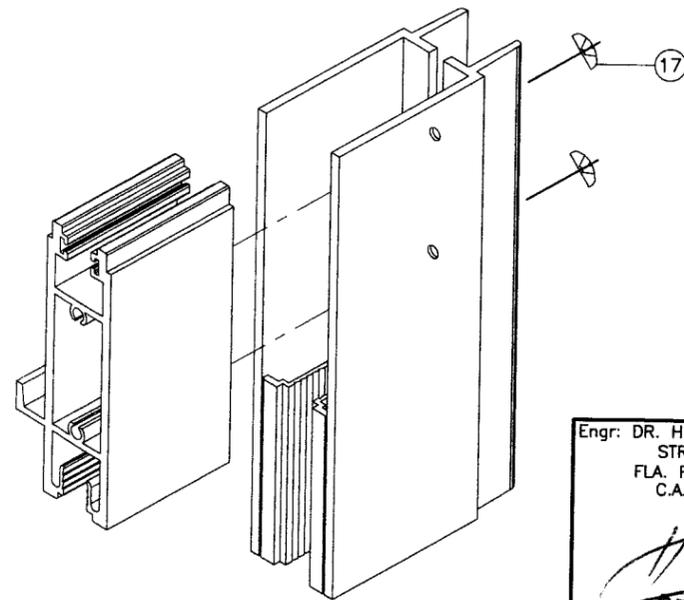

PANEL TOP CORNER

ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	050-633	1	FRAME HEAD	6005-T5	-
2	050-630	1	FRAME SILL	6063-T6	-
3	050-608	2	FRAME JAMB	6063-T6	-
4	051-643	AS REQD.	JAMB STILE	6063-T6	-
5	052-647	AS REQD.	INT. INTERLOCK	6063-T6	-
6	052-646	AS REQD.	EXT. INTERLOCK	6063-T6	-
7	052-644	AS REQD.	MALE LOCK STILE	6063-T6	-
8	-	-	-	-	-
9	052-654	AS REQD.	FEMALE ASTRAGAL STILE	6063-T6	-
10	051-632	1/ PANEL	TOP RAIL	6005-T5	-
11	051-631	1/ PANEL	BOTTOM RAIL	6005-T5	-
12	050-635	1	THRESHOLD	6005-T5	-
13	050-636	1	HEAD COVER	6005-T5	-
14	050-611	1	SCREEN TRACK ADAPTER	6063-T6	-
15	050-648	AS REQD.	PRESSURE CLIP	6063-T6	8" LONG
16	050-649	AS REQD.	PRESSURE CLIP COVER	6063-T6	8" LONG
17	012-130	1/CORNER	PANEL ASSEMBLY SCREW	CRS	#10 X 1" PPH SMS
18	012-131	-	FRAME ASSEMBLY SCREWS	CRS	#8 X 1" PH SMS
19	037-003	2/ MOV. PANEL	TANDEM WHEEL ASSEMBLY @ 6-1/4" FROM EACH END	ST. STEEL	TRUTH OR EQUIV.
20	046-101	AS REQD.	GLAZING CHANNEL	SOFT VINYL	WIBORG
21	-	-	-	-	-
22	047-014	AS REQD.	PILE W'STRIPPING WITH PLASTIC FIN	-	BY AMESBURY OR EQUIV.
23	-	-	-	-	-
24	-	-	-	-	-
25	050-004	1/ MOV. PANEL	FLAT BAR 1" X 1/16" X 43-3/4" LONG	6063-T6	SILICONED TO BOTTOM RAIL
26	SEG-491	AS REQD.	GLAZING ADAPTER	6063-T5	-
27	050-529	AS REQD.	JAMB COVER	6063-T5	OPTIONAL
28	050-660	AS REQD.	SNAP COVER	6063-T6	OPTIONAL
29	-	-	-	-	-
30	007-084	-	DEAD LOCK & LATCH	ST. STEEL	ADAMS RITE
31	013-033	-	3/16" X 2" DRIVE PIN	ST. STEEL	RAWL
32	007-115	-	KEEPER	ST. STEEL	TRUTH
33	007-10-114	-	HANDLE	-	TRUTH

**PRODUCT RENEWED**  
 as complying with the Florida  
 Building Code  
 Acceptance No 06-0706.19  
 Expiration Date 05/09/17  
 By *[Signature]*  
 Miami (Bade) Product Control  
 Division

Engr: DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 C.A.N. 3538  
 SEP 08 2006

**afc**

**AL-FAROOQ CORPORATION**  
 ENGINEERS, PLANNERS & PRODUCT DESIGN  
 1235 SW 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W02-08TS

---

SERIES 8000 ALUM. SLD. GLASS DOOR (L.M.)

**TRACO SECURITY WINDOWS & DOORS INC.**  
 5100 N.W. 72 AVE.  
 MIAMI, FL. 33166  
 TEL. (305) 591-8990

---

revisions:	no	date	description	no	change	no	change
	A	07.27.05					
	B	09.07.06					

---


date: 08-25-00  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:

---


drawing no.  
**W02-08**

---


sheet 5 of 6

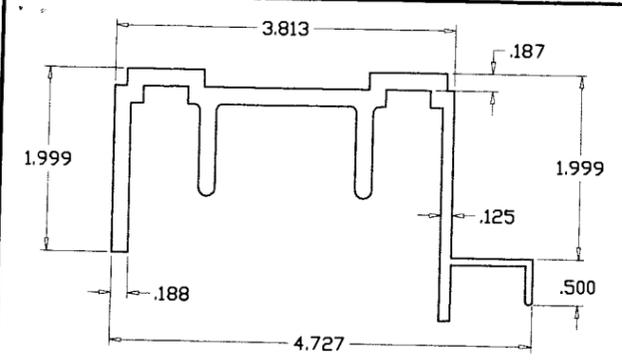


① FRAME HEAD

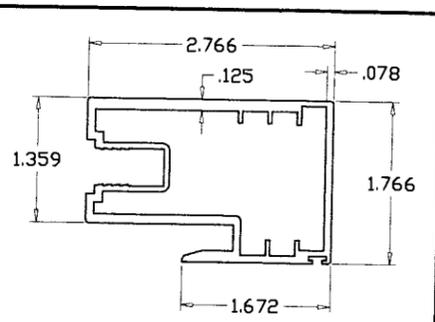


⑤ INT. INTERLOCK

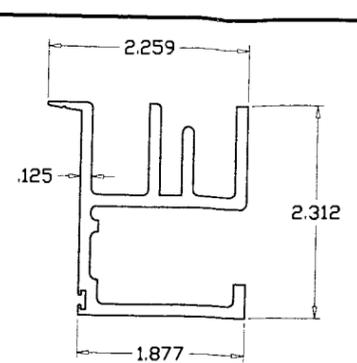

⑬ HEAD FILLER

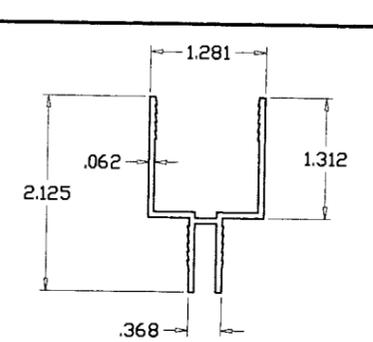


⑳ GLAZING ADAPTER

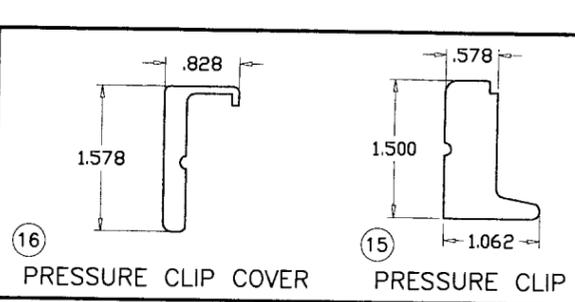


⑯ PRESSURE CLIP COVER


⑮ PRESSURE CLIP

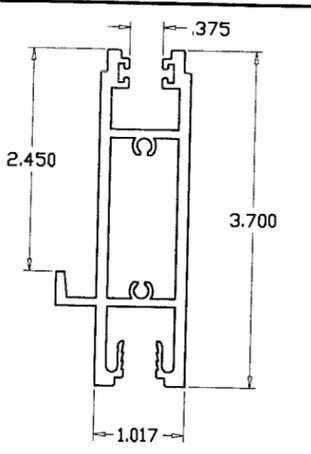


⑩ TOP RAIL

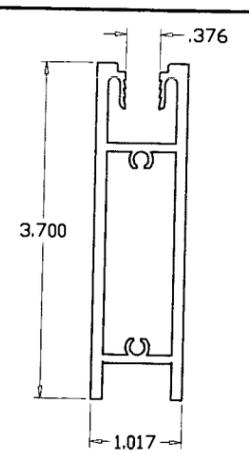


⑪ BOTTOM RAIL

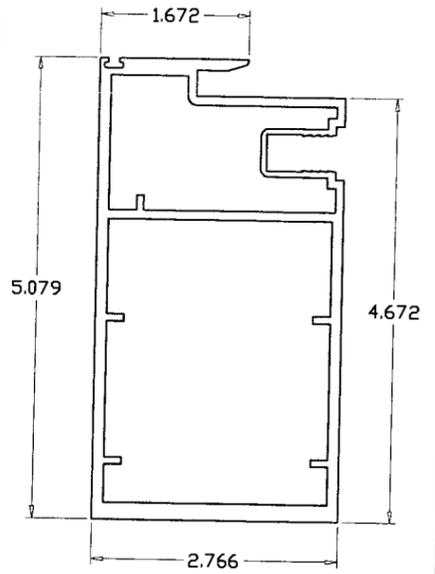


⑥ EXT. INTERLOCK

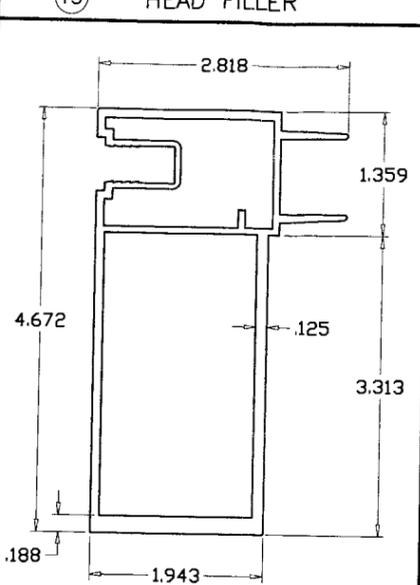


⑦ MALE LOCK STILE

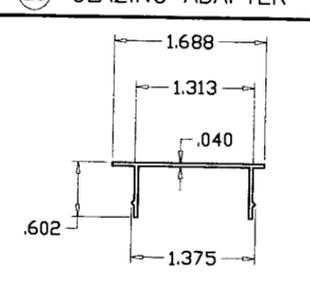


⑳ JAMB COVER

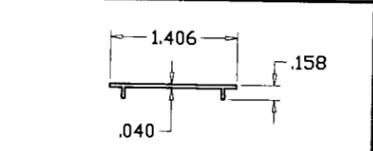


⑳ SNAP COVER

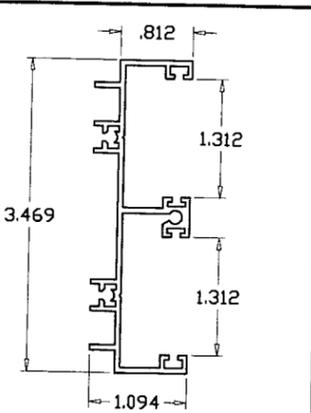


③ FRAME JAMB

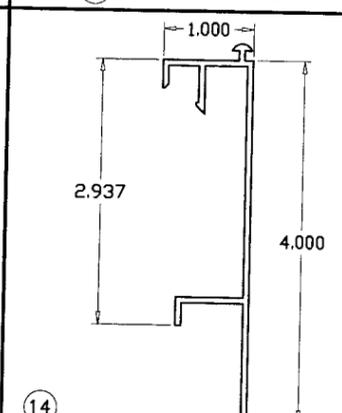


⑭ SCREEN TRACK ADAPTER

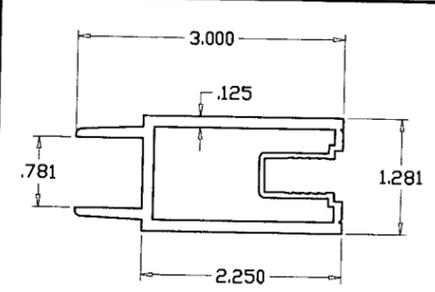


④ JAMB STILE

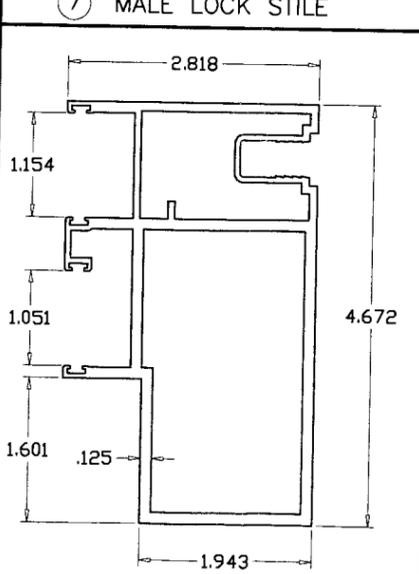

⑨ FEMALE ASTRAGAL STILE

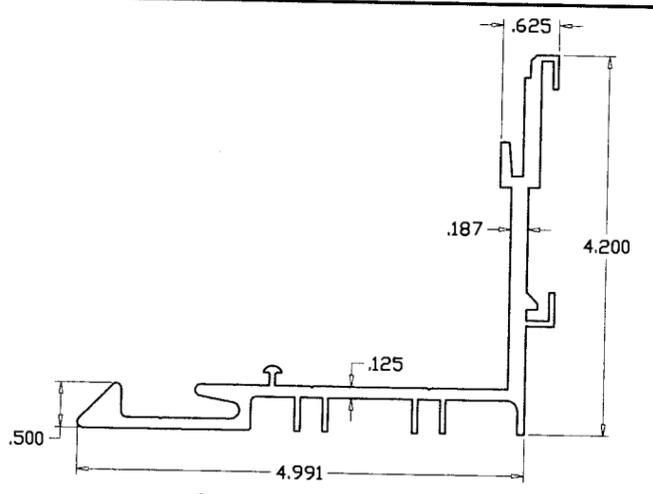

② FRAME SILL

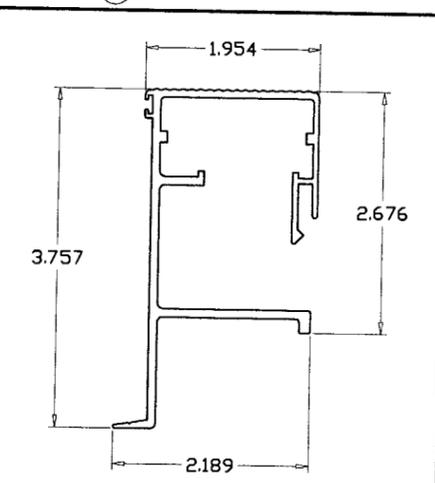

⑫ THRESHOLD

**PRODUCT RENEWED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 06-0706-19  
 Expiration Date 05/09/12  
 By: *[Signature]*  
 Miami Code Product Control  
 Division

Engr. DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 C.A.N. 3538

*[Signature]*  
 SEP 08 2005

**afc**

**AL-FAROOQ CORPORATION**  
 ENGINEERS, PLANNERS & PRODUCT DESIGN  
 1235 SW 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W02-08TS

---

SERIES 8000 ALUM. SLD. GLASS DOOR (L.M.)  
**TRACO SECURITY WINDOWS & DOORS INC.**  
 5100 N.W. 72 AVE.  
 MIAMI, FL. 33166  
 TEL. (305) 591-8990

no	date	description	by
A	07.27.05	NO CHANGE THIS SHEET	
B	09.07.06	NO CHANGE THIS SHEET	

revisions:

date: 08-25-00  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no. **W02-08**  
 sheet 6 of 6