



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

**[www.buildingcodeonline.com](http://www.buildingcodeonline.com)**

**Jeld-Wen, Inc. (OR)  
3737 Lakeport Blvd.  
Klamath Falls, OR 97601**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION:** Series "Direct Set" Aluminum Clad Wood Fixed Window – L.M.I.

**APPROVAL DOCUMENT:** Drawing No. JELD0029, titled "Direct Set Fixed Aluminum Clad Wood Windows", sheets 1 through 6 of 6, dated 05/25/06, with revision B dated 6/23/06, prepared by PTC, LLC, signed and sealed by Luis R. Lomas, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING:** Large and Small Missile Impact Resistant

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name: **JELD-WEN – BEND WINDOW DIVISION, 62845 Boyd Acres Rd., Bend, OR 97708** and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises and renews NOA # 03-0210.06 and consists of this page 1 and evidence pages E-1, E-2, E-3 and E-4, as well as approval document mentioned above.

The submitted documentation was reviewed by Manuel Perez, P.E.



**NOA No. 06-0713.01  
Expiration Date: February 26, 2011  
Approval Date: September 28, 2006  
Page 1**


**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **JELD0027**, Sheets 1 through 6 of 6, titled "Direct Set Fixed Aluminum Clad Wood Windows", dated 05/25/06, with revision B dated 6/23/06, prepared by PTC-LLC, signed and sealed by Luis R. Lomas, P.E.


**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **ATI-61973.01-301-18**, dated 04/26/06, signed and sealed by Joseph A. Reed, P.E.
2. Test reports on 1) Large Missile Impact Test per FBC, TAS 201-94  
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **ATI-62248.01-301-18**, dated 04/26/06, signed and sealed by Joseph A. Reed, P.E.
3. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **03-31488.02**, dated 8/26/02, signed and sealed by Steven Urich, P.E.  
**(Submitted under NOA#03-0210.06)**
4. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **03-31488.04**, dated 8/27/02, signed and sealed by Steven Urich, P.E.  
**(Submitted under NOA#03-0210.06)**

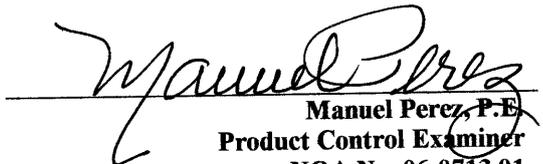  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 06-0713.01  
Expiration Date: February 26, 2011  
Approval Date: September 28, 2006


**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

5. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **03-31488.06**, dated 8/28/02, signed and sealed by Steven Urich, P.E.  
**(Submitted under NOA#03-0210.06)**
6. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **03-31488.08**, dated 8/27/02, signed and sealed by Steven Urich, P.E.  
**(Submitted under NOA#03-0210.06)**
7. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **03-31488.10**, dated 8/26/02, signed and sealed by Steven Urich, P.E.  
**(Submitted under NOA#03-0210.06)**
8. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **03-31488.11**, dated 8/27/02, signed and sealed by Steven Urich, P.E.  
**(Submitted under NOA#03-0210.06)**

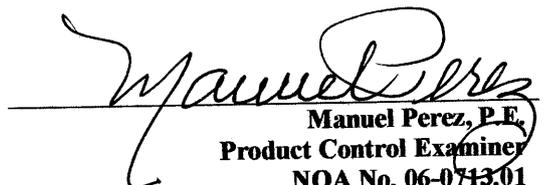  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 06-0713.01  
Expiration Date: February 26, 2011  
Approval Date: September 28, 2006

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

9. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **03-31488.12**, dated 8/27/02, signed and sealed by Steven Urich, P.E.  
**(Submitted under NOA#03-0210.06)**
10. Test report on: 1) Large Missile Impact Test per FBC, TAS 201-94  
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with installation diagram of an aluminum clad wood fixed window, overall size 48" wide by 96" high, prepared by Hurricane Test Laboratory, Inc., report No. **HTL-0112-0412-00**, dated 04/19/00, signed and sealed by Vinu J. Abraham, P.E.  
**(Submitted under NOA#00-1003.0)**
11. Test report on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with installation diagram of aluminum clad wood fixed windows, overall sizes: 42" wide x 84" high & 48" wide by 96" high, prepared by Hurricane Test Laboratory, Inc., report No. **HTL-0112-0803-99**, dated 8/16/99, signed and sealed by Vinu J. Abraham, P.E. **(Submitted under NOA#00-1003.0)**
12. Test report on: 1) Large Missile Impact Test per FBC, TAS 201-94  
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with installation diagram of an aluminum clad wood fixed window, overall size 60" wide x 120" high, prepared by Hurricane Test Laboratory, Inc., report No. **HTL-0112-0724-98**, dated 07/30/98, signed and sealed by Vinu J. Abraham, P.E.  
**(Submitted under NOA#00-1003.0)**
13. Test report on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with installation diagram of an aluminum clad wood fixed window, overall size 48" wide by 96" high, prepared by Hurricane Test Laboratory, Inc., report No. **HTL-0112-1007-96**, dated October 08, 1996 signed and sealed by Timothy S. Marshall, P.E. **(Submitted under original file No. 97-0421.0)**

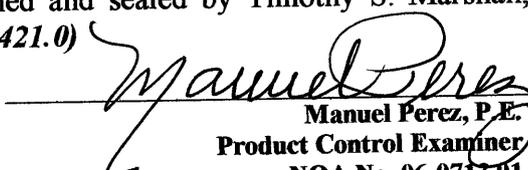  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 06-0713.01  
Expiration Date: February 26, 2011  
Approval Date: September 28, 2006

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**C. CALCULATIONS**

1. Anchor calculations complying with FBC-2004, prepared by PTC, LLC, dated 8/24/06, signed and sealed by Luis R. Lomas, P.E.  
**Complies with ASTM E1300-02**
2. Anchor Calculations, dated 1/13/03, prepared by R.W. building Consultants, Inc., signed and sealed by Lyndon Schmidt, P.E.  
*(Submitted under NOA#00-1003.02)*

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**


1. Notice of Acceptance No. **03-1223.04** issued to Surface Specialties, Inc. for their "Uvekol, a Laminate Glass Component" dated 02/05/04, expiring on 02/08/09.
2. Notice of Acceptance No. **03-0417.01** issued to Cardinal LG. for their "Laminated Glass Cardinal Sea-Storm Type B" dated 05/15/03, expiring on 12/30/07.
3. Notice of Acceptance No. **01-1204.01** issued to E.I. DuPont DeNemours for "Sentry Glass ® Plus" dated 01/17/02, expiring on 01/14/07.


**F. STATEMENTS**

1. Statement letter of conformance and of no financial interest, dated July 13, 2006, signed and sealed by Luis R. Lomas, P.E.
2. Laboratory compliance letter for Test Report No. ATI-61973.01-301-18, issued by Architectural Testing, Inc., dated April 26, 2006, signed and sealed by Joseph A. Reed, P.E.
3. Letter stating that Pozzi Window Company of Bend, OR was purchased by Jeld-Wen, Inc. on Sept. 22, 1992, signed by David G. Stork.


**G. OTHER**

1. Notice of Acceptance No. **03-0210.06**, issued to Pozzi Window Company for their Series "Direct Set" Aluminum Clad Wood Window, approved on 04/24/03 and expiring on 02/26/06.

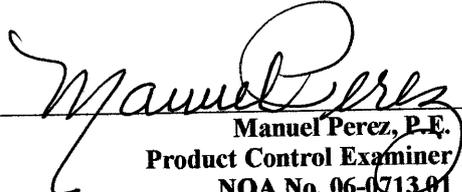  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 06-0713.01  
Expiration Date: February 26, 2011  
Approval Date: September 28, 2006

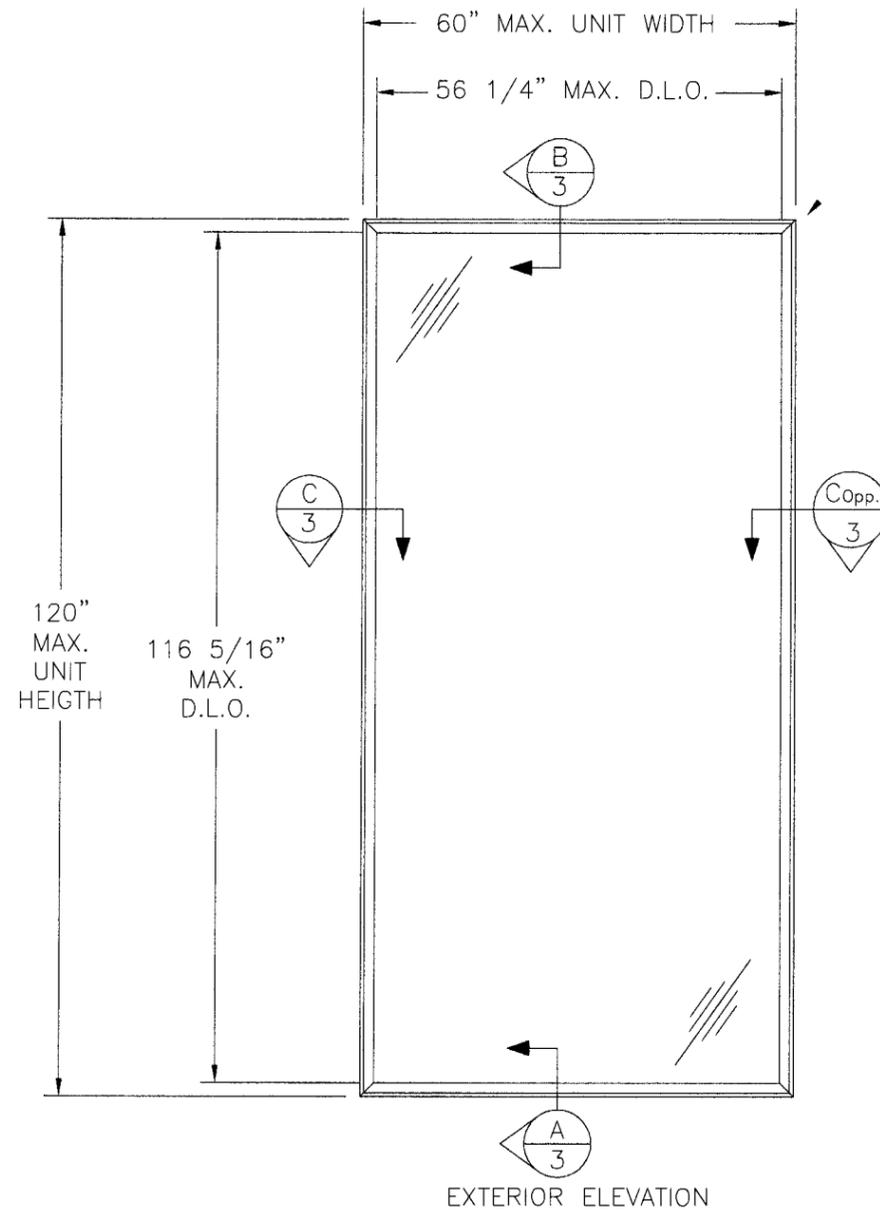

EXTERIOR ELEVATION

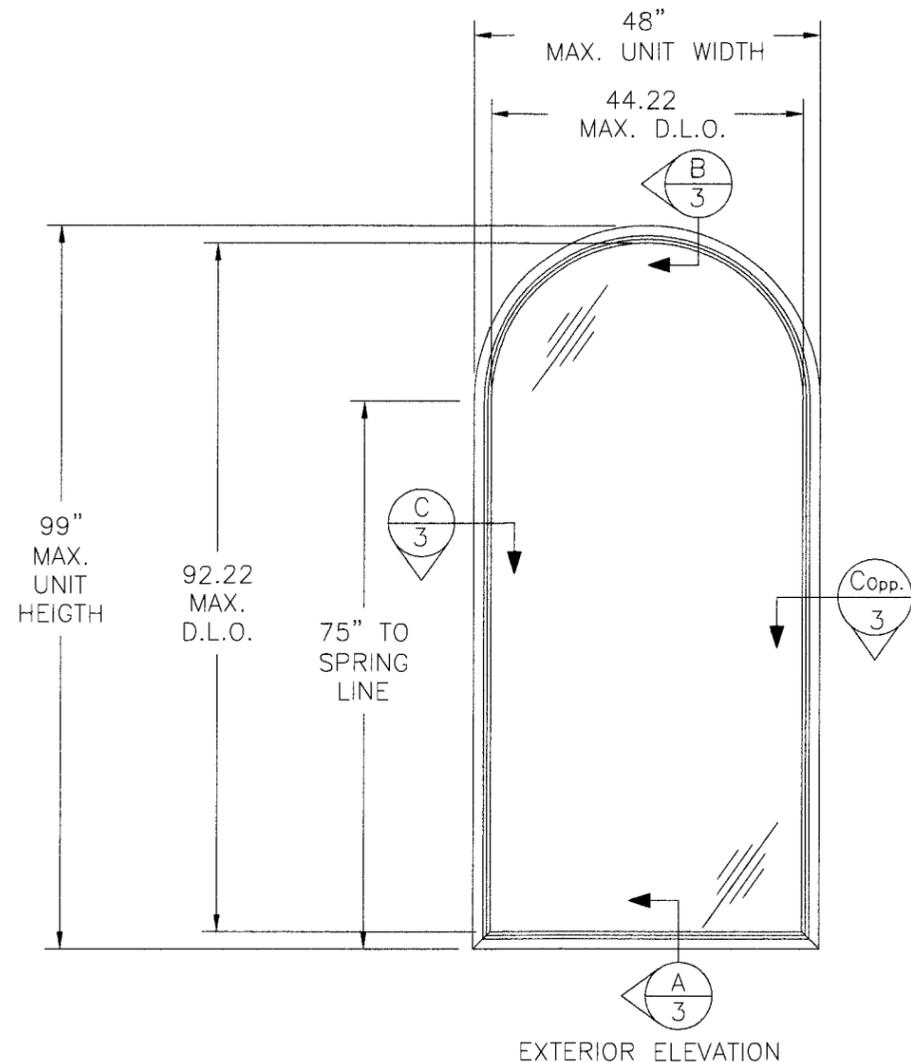

EXTERIOR ELEVATION

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2004 FLORIDA BUILDING CODE.
2. WOOD BUCK OR STUD FRAMING BY OTHERS MUST BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE, BUCK OR FRAMING IS RESPONSIBILITY OF ARCHITECT OF RECORD.
3. PRODUCTS ARE APPROVED FOR USE WHERE LARGE MISSILE IMPACT RESISTANCE IS REQUIRED. IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED.
4. SEE CHART IN THIS PAGE FOR DESIGN PRESSURE RATINGS.

DESIGN PRESSURE RATING

GLASS TYPE	OVERALL SIZE (IN)	MAX AREA (SQ FT)	DESIGN PRESSURE (PSF)
1/4" HS -.090 SGP - 1/4" HS	UP TO 60" x 120"	50.0	±50.0
1/4" ANN -.090 SGP - 1/4" ANN	UP TO 48" x 96"	32.0	±65.0
1/4" ANN -.090 SGP - 1/4" ANN	UP TO 48" x 60"	20.0	±75.0
3/16" ANN -.090 SGP - 3/16" ANN	UP TO 36" x 60"	15.0	±75.0

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 06-0713.01  
 Expiration Date FEB. 26, 2011  
 By *Manuel Perez*  
 Miami Dade Product Control  
 Division


SYM	REVISION	DATE	BY
B	CHANGES WERE MADE TO O.A. DIM. OF RADIUS TOP	6/23/06	DO
A	Changed customers address	07/11/06	DRL

L. Roberto Lomas  
 P.E. No. 62514  
*L. Roberto Lomas*  
 8/24/06  
 PTC, LLC  
 1535 Cogswell Street, suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935


JELD-WEN WINDOWS AND DOORS  
 BEND WINDOW DIVISION; 62845 BOYD ACRES RD.; BEND, OR 97708  
 TITLE: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS  
 ELEVATIONS AND GENERAL NOTES

PREPARED BY: <b>PTC</b> PTC, LLC	DRN: DRL	DATE: 05/25/06
SCALE: N.T.S.	DWG. NO: JELD0029	
REV: B	SHEET: 1 OF 6	

Phone 321.690.1788 Fax 321.690.1789

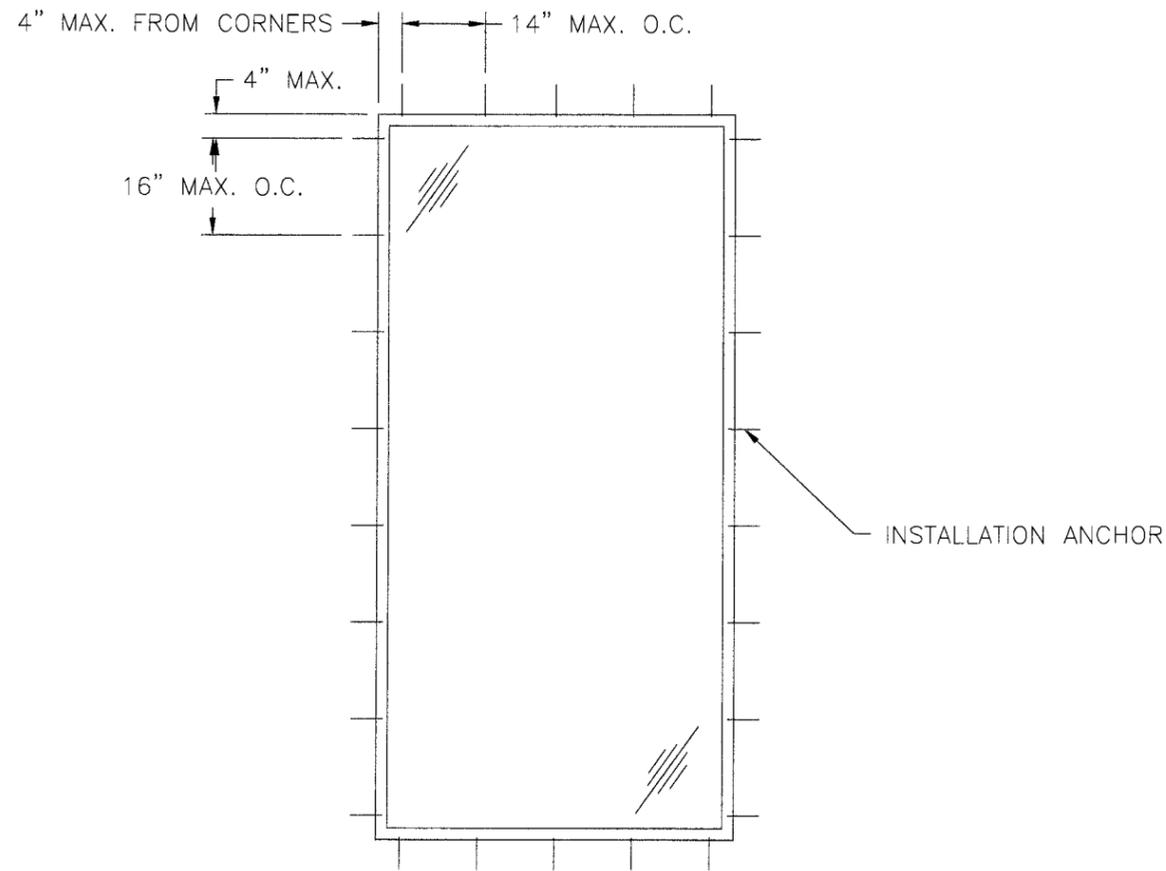

EXTERIOR ELEVATION  
RECTANGULAR DIRECT SET  
FIXED ALUMINUM CLAD  
WOOD WINDOW WITH NAILING FIN

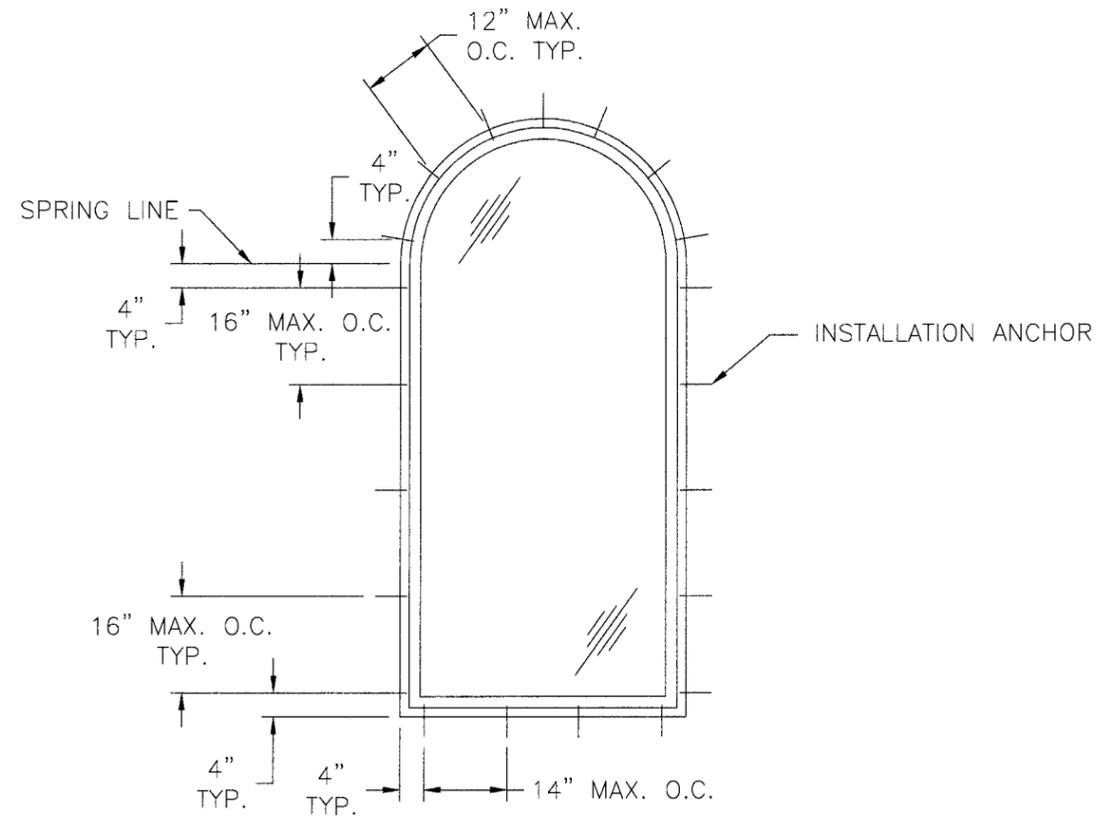

EXTERIOR ELEVATION  
RADIUS TOP DIRECT SET  
FIXED ALUMINUM CLAD  
WOOD WINDOW WITH NAILING FIN

**ANCHORING NOTES:**


- 1) FOR RECTANGULAR UNITS LOCATE ANCHORS AT SHORT SIDE 4" MAX. FROM EACH CORNER AND 14" MAX. O.C. THEREAFTER. AT LONG SIDE 4" MAX. FROM EACH CORNER AND 16" MAX. O.C. THEREAFTER.
- 2) FOR GEOMETRIC UNITS LOCATE ANCHORS 4" MAX. FROM EACH CORNER AND 12" MAX. O.C. THEREAFTER.
- 3) FOR RADIUS UNITS LOCATE ANCHORS AT SILL 4" MAX. FROM EACH CORNER AND 14" MAX. O.C. THEREAFTER. AT LONG SIDE 4" MAX. FROM EACH CORNER AND 16" MAX. O.C. THEREAFTER. AT RADIUS 4" MAX. FROM EACH CORNER AND 12" MAX. O.C.
- 5) FOR OVAL AND CIRCULAR UNITS LOCATE ANCHORS AT 12" MAX. O.C.
- 6) FOR NAILING FLANGES 4" MAX FROM EACH CORNER AND 16" MAX. O.C. THEREAFTER. ANCHORS THRU JAMBS ARE REQUIRED AND MUST BE INSTALLED REGARDLESS OF NAILING FLANGES.
- 6) SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
- 7) FOR ANCHORING INTO WOOD FRAMING USE #10 WOOD SCREWS, OF SUFFICIENT LENGTH TO ACHIEVE A 1 1/2" MINIMUM EMBEDMENT INTO WOOD FRAMING.

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 06-0713.01  
Expiration Date FEB. 26, 2011  
By *Manuel Perez*  
Miami/Dade Product Control  
Division

SYM	REVISION	DATE	BY
B	CHANGES WERE MADE TO O.A. DIM. OF RADIUS TOP	8/23/06	DO
A	Changed customers address	07/11/06	DRL

L. Roberto Lomas  
P.E. No. 62514  
*L. Roberto Lomas*  
8/24/06  
PTC, LLC  
1535 Cogswell Street, suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935


JELD-WEN WINDOWS AND DOORS  
BEND WINDOW DIVISION; 62845 BOYD ACRES, RD.; BEND, OR 97708  
TITLE: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS  
ANCHORING LAYOUT AND NOTES  
PREPARED BY: **PTC**  
PTC, LLC  
Phone 321.690.1788 Fax 321.690.1789  
DRN: DRL DATE: 05/25/06  
SCALE: N.T.S. DWG. NO: JELD0029  
REV: B SHEET: 2 OF 6

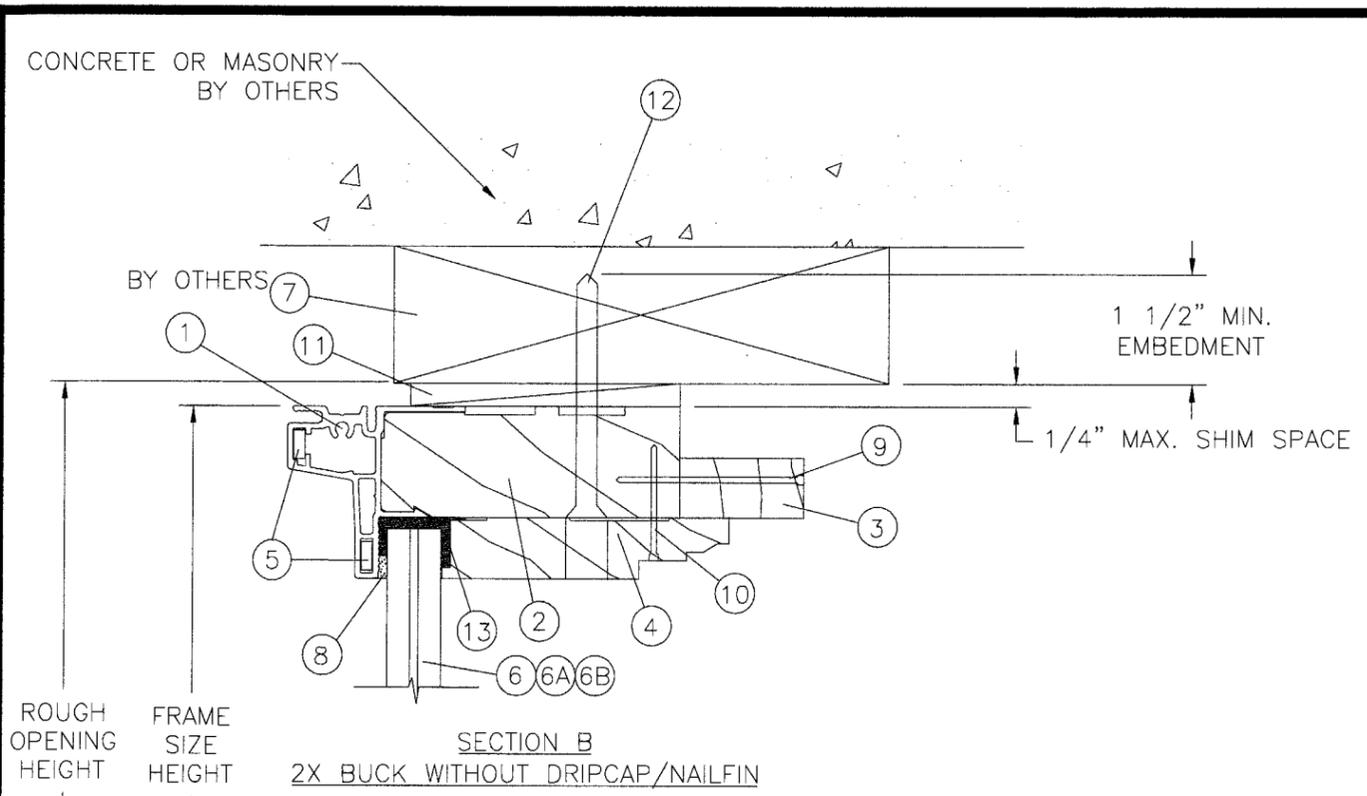


ROUGH  
OPENING  
HEIGHT

FRAME  
SIZE  
HEIGHT

SECTION B  
2X BUCK WITHOUT DRIPCAP/NAILFIN

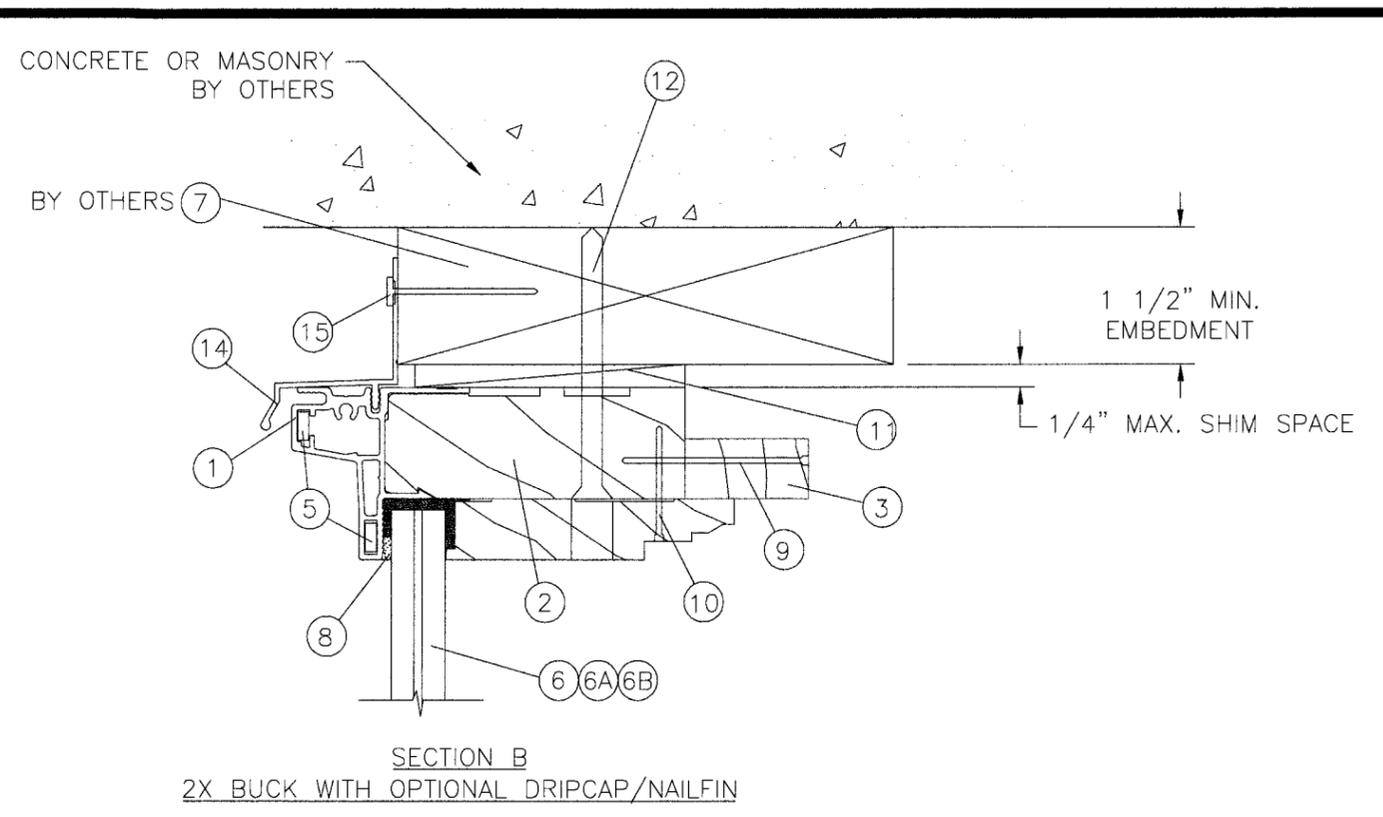


SECTION B  
2X BUCK WITH OPTIONAL DRIPCAP/NAILFIN

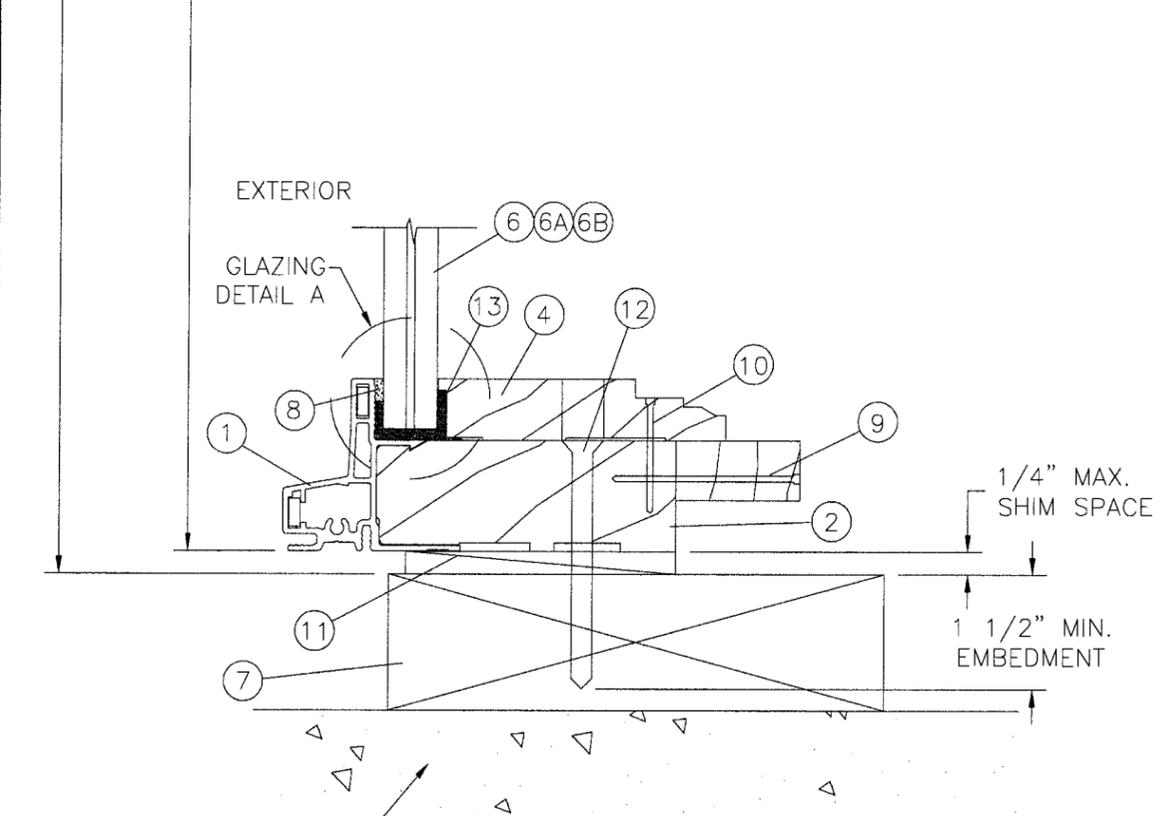

CONCRETE OR MASONRY  
BY OTHERS

SECTION A  
2X BUCK WITHOUT DRIPCAP/NAILFIN

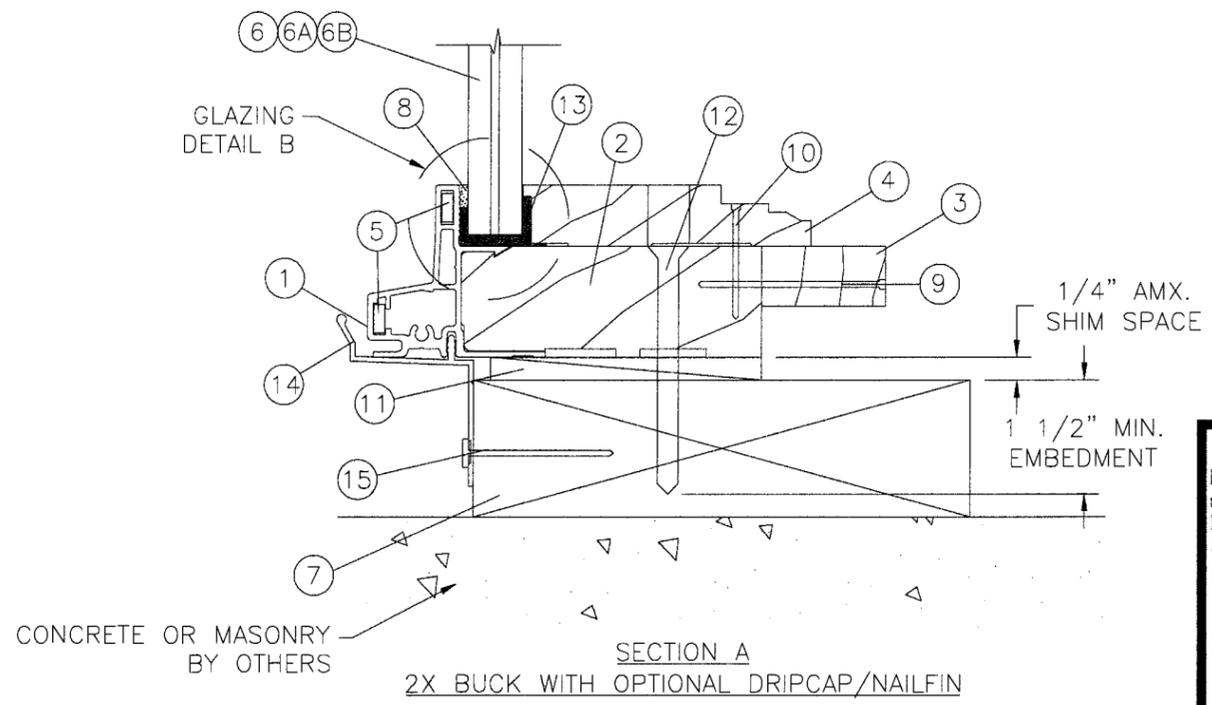

CONCRETE OR MASONRY  
BY OTHERS

SECTION A  
2X BUCK WITH OPTIONAL DRIPCAP/NAILFIN

PRODUCT REVISED  
to comply with the Florida  
Building Code  
Acceptance No. 06-0713.01  
Expiration Date FEB. 26, 2011  
By *Manuel Perez*  
Milena Bode Product Control  
Division

SYM	REVISION	DATE	BY
B	CHANGES WERE MADE TO O.A. DIM. OF RADIUS TOP	6/23/06	DO
A	Changed customers address	07/11/06	DRL


L. Roberto Lomas  
P.E. No. 62514  
*L. Roberto Lomas*  
8/24/06  
PTC, LLC  
1535 Cogswell Street, suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935

JELD-WEN WINDOWS AND DOORS  
BEND WINDOW DIVISION; 62845 BOYD ACRES DIVISION; BEND, OR 97708  
TITLE: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOW  
VERTICAL CROSS SECTIONS

PREPARED BY: **PTC**  
PTC, LLC  
Phone 321.690.1788 Fax 321.690.1789


DRN:	DRL	DATE:	05/25/06
SCALE:	N.T.S.	DWG. NO.:	JELD0029
REV:	B	SHEET:	3 OF 6

0.600 OA LAMINATED GLASS CONSISTING OF:  
 1/4" HEAT STRENGTHENED;  
 .090 SGP INNERLAYER;  
 1/4" HEAT STRENGTHENED

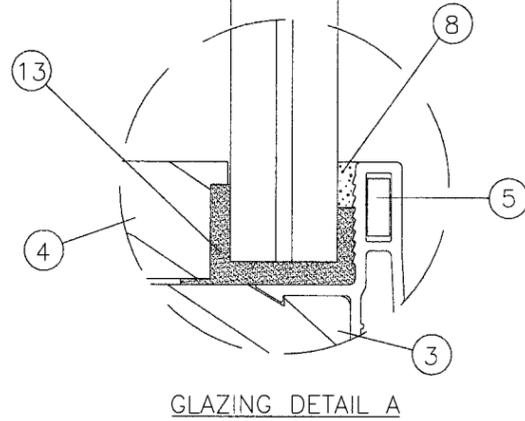


GLAZING DETAIL A

0.600 OA LAMINATED GLASS CONSISTING OF:  
 1/4" ANNEALED;  
 .090 SGP INNERLAYER;  
 1/4" ANNEALED

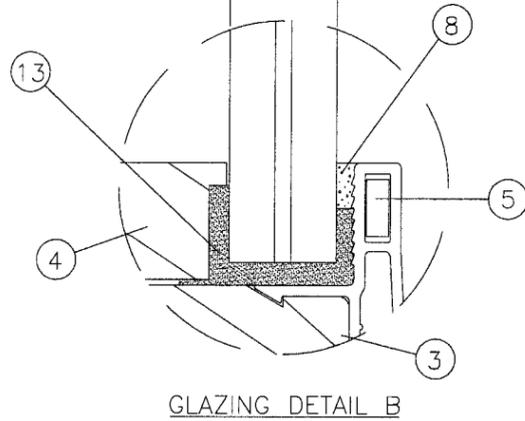


GLAZING DETAIL B

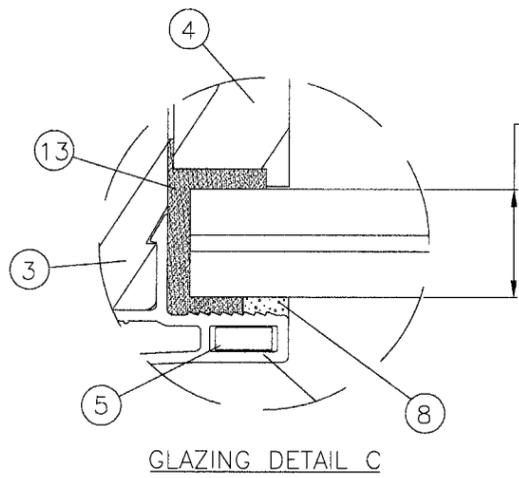


GLAZING DETAIL C

0.475 OA LAMINATED GLASS CONSISTING OF:  
 3/16" ANNEALED;  
 .090 SGP INNERLAYER;  
 3/16" ANNEALED

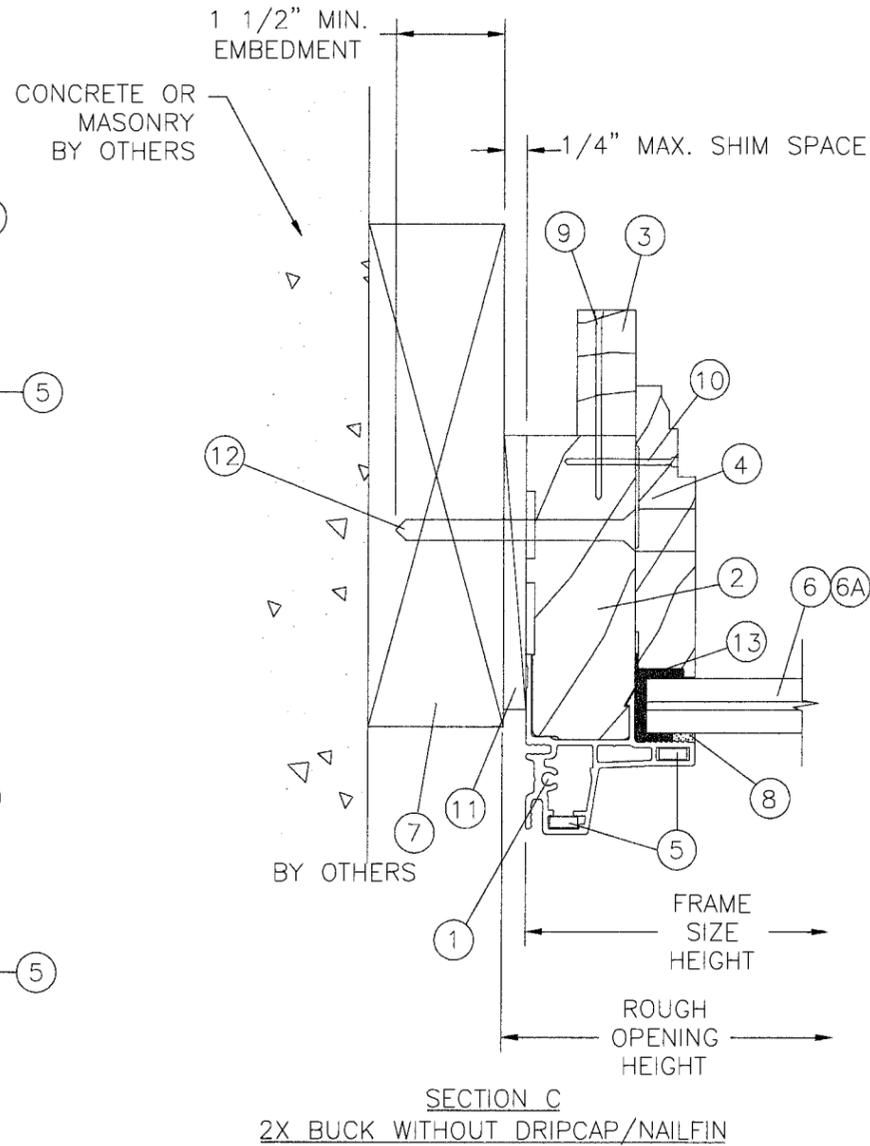

SECTION C  
 2X BUCK WITHOUT DRIPCAP/NAILFIN

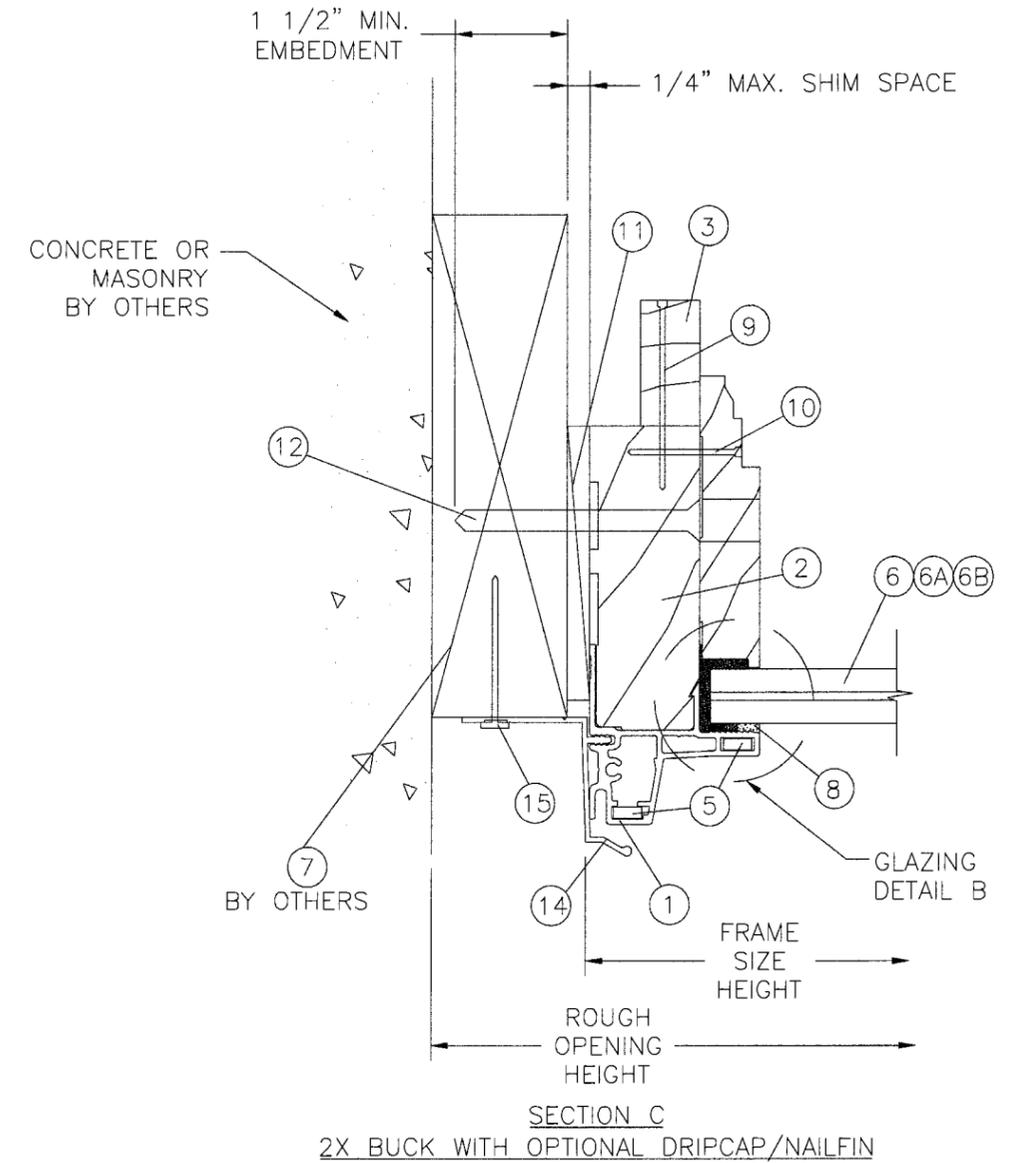

SECTION C  
 2X BUCK WITH OPTIONAL DRIPCAP/NAILFIN


**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. **06-0713.01**  
 Expiration Date **FEB. 26, 2011**  
 By: *Manuel Serrano*  
 Product Center  
 Jeld-Wen

SYM	REVISION	DATE	BY
B	CHANGES WERE MADE TO O.A. DIM. OF RADIUS TOP	6/23/06	DO
A	Changed customers address	07/11/06	DRL


L. Roberto Lomas  
 P.E. No. 62514  
*L. Roberto Lomas*  
 6/24/06  
 PTC, LLC  
 1535 Cogswell Street, suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935

**JELD-WEN WINDOWS AND DOORS**  
 BEND WINDOW DIVISION; 62845 BOYD ACRES RD.; BEND, OR 97708  
 TITLE: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS  
 HORIZONTAL CROSS SECTIONS AND GLAZING DETAILS  
 PREPARED BY: **PTC**  
 DRN: DRL DATE: 05/25/06  
 SCALE: N.T.S. DWG. NO: JELD0029  
 REV: B SHEET: 4 OF 6  
 Phone 321.690.1788 Fax 321.690.1789


① FRAME CLADDING

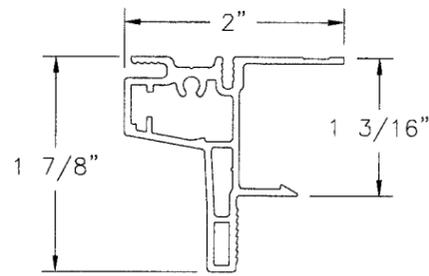


② WOOD JAMB

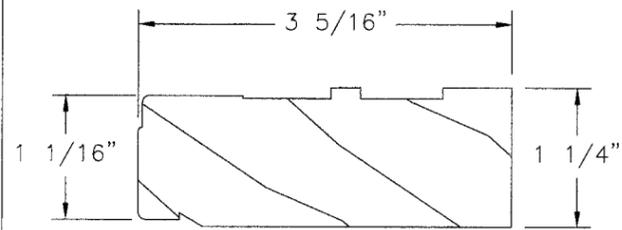


③ JAMB EXTENDER




④ GLASS STOP

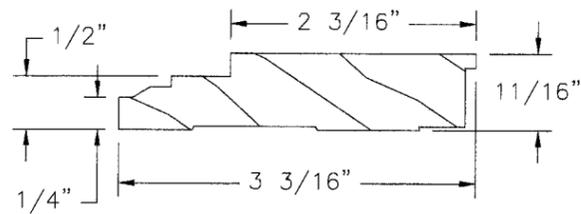

⑤ CORNER KEY

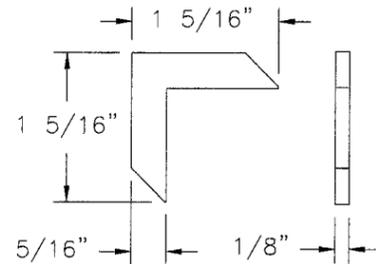

⑭ OPTIONAL DRIPCAP



MATERIALS LIST




ITEM	PART #	DESCRIPTION	MATERIAL
1	AC-90R1	ALUMINUM FRAME CLADDING - .060 WALL	6063-T5 ALUM.
2	AC-151	WOOD JAMB F/J LINEAL - (BMC)	PONDEROSA PINE
3	AC-11	WOOD 4 9/16" JAMB EXTENDER - (BMC)	CLEAR PINE
4	AC-173	WOOD GLASS STOP (BMC)	CLEAR PINE
5	AC-74	FRAME CORNER KEY - 2 EA. (MITCHELL METAL)	6061-T6511 ALUM.
6	N/A	IMPACT RESISTANT LAMINATED GLASS - (CARDINAL CORP.)	SEE SHEET 4
7	N/A	PRESSURE TREATED 2X BUCK	P.T. WOOD
8	N/A	1/4" x 1/8" GLAZING TAPE (3M)	
9	N/A	2" x 16 GA. FINISH NAIL	STEEL
10	N/A	1 1/4" x 16 GA. FINISH NAIL	STEEL
11	N/A	1/4" FRAME SHIM	
12	N/A	#10 x 3" F.H. WOOD SCREW	STEEL
13	N/A	#995 SEALANT (DOW CORNING)	SEALANT
14	AC-172	DRIPCAP	6061-T6511 AL
15	N/A	11GA 1 5/8" ROOFING NAIL	STEEL

PRODUCT REVISED  
 to comply with the Florida  
 Building Code  
 Acceptance No. 06-0713.01  
 Expiration Date FEB 26, 2011  
 By Manuel Pina  
 Aluminum Product Control  
 Division

SYM	REVISION	DATE	BY
B	CHANGES WERE MADE TO O.A. DIM. OF RADIUS TOP	6/23/06	DO
A	Changed customers address	07/11/06	DRL

L. Roberto Lomas  
 P.E. No. 62514  
*L. Roberto Lomas*  
 8/24/06  
 PTC, LLC  
 1535 Cogswell Street, suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935

JELD-WEN WINDOWS AND DOORS  
 BEND WINDOW DIVISION; 62845 BOYD ACRES RD.; BEND, OR 97708  
 TITLE: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS  
 COMPONENTS AND BILL OF MATERIALS  
 PREPARED BY: **PTC** PTC, LLC  
 DRN: DRL DATE: 05/25/06  
 SCALE: N.T.S. DWG. NO: JELD0029  
 REV: B SHEET: 5 OF 6  
 Phone 321.690.1788 Fax 321.690.1789

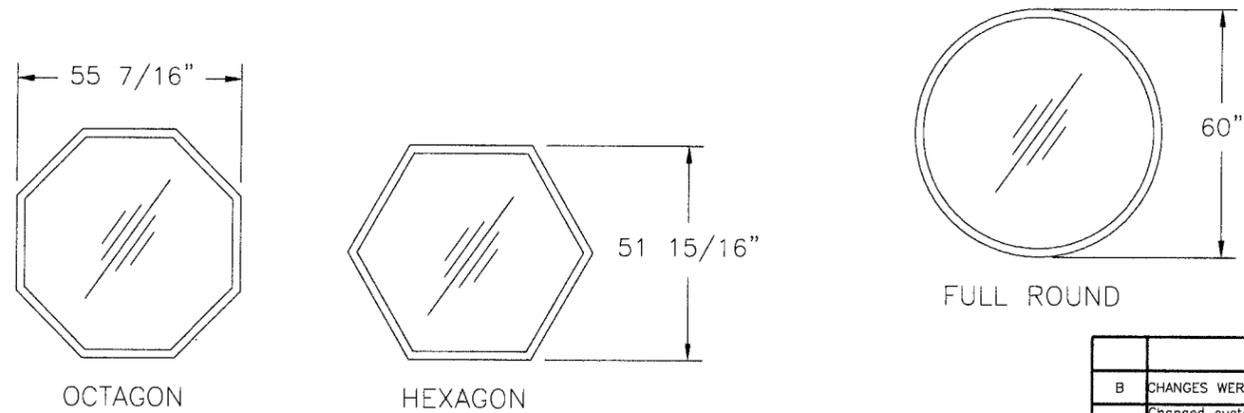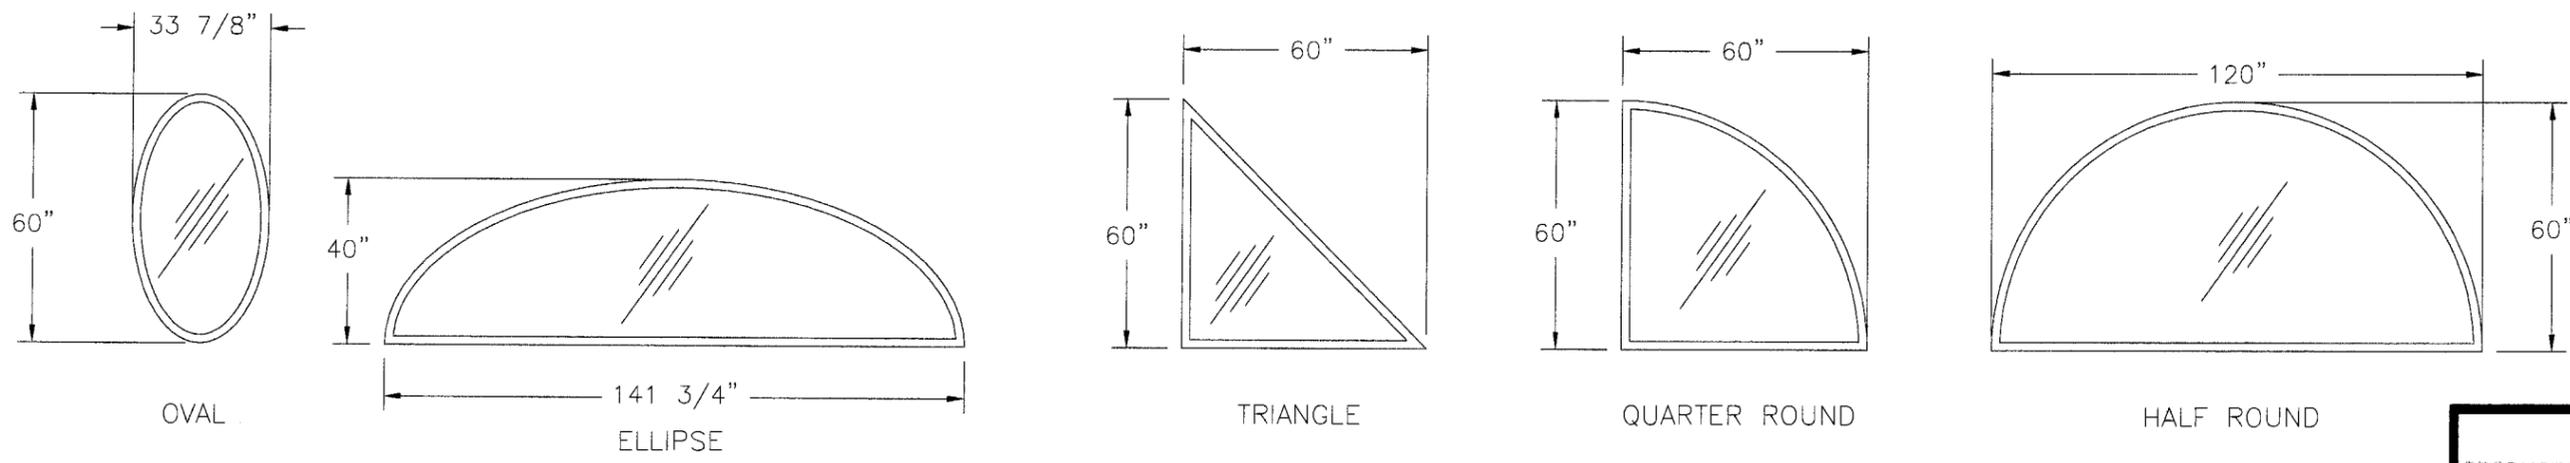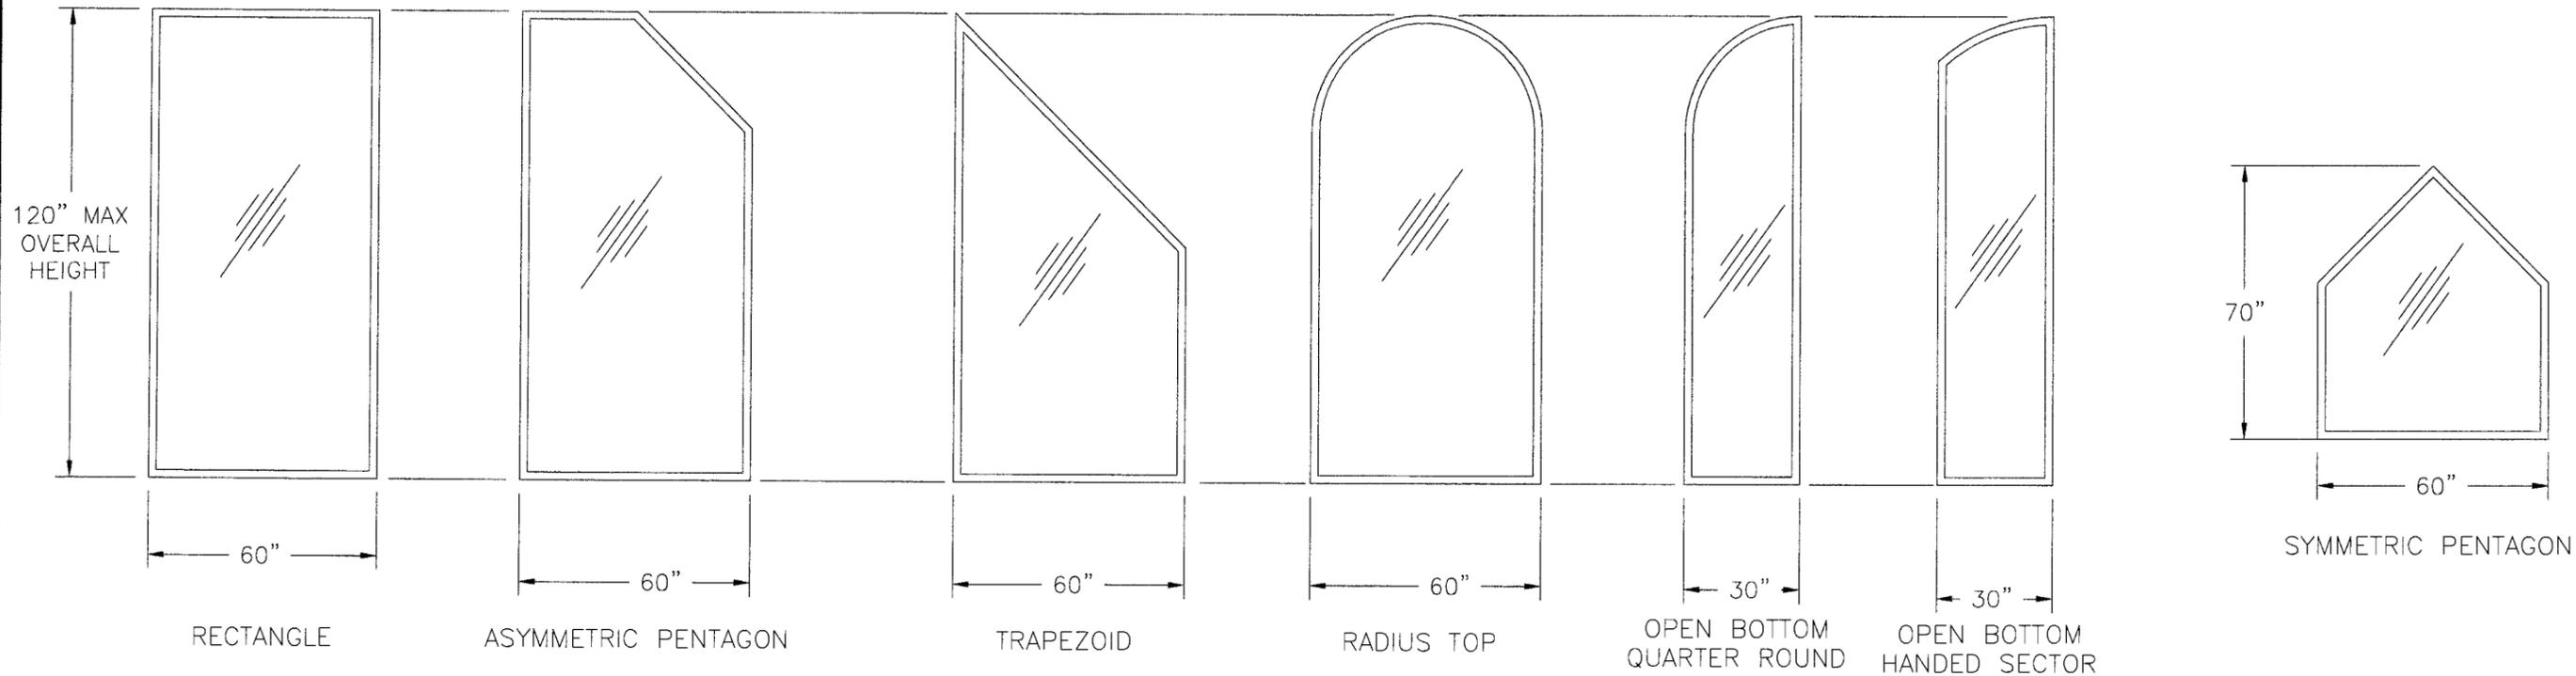

PRODUCT REVIEWED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 06-0713.01  
 Expiration Date FEB. 26, 2011  
 By *Manuel Pro*  
 Release/Trade Product Control  
 Division

SYM	REVISION	DATE	BY
B	CHANGES WERE MADE TO O.A. DIM. OF RADIUS TOP	6/23/06	DO
A	Changed customers address	07/11/06	DRL

L. Roberto Lomas  
 P.E. No. 62514  
*L. Roberto Lomas*  
 8/24/06  
 PTC, LLC  
 1535 Cogswell Street, suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935

JELD-WEN WINDOWS AND DOORS  
 BEND WINDOW DIVISION; 62845 BOYD ACRES RD.; BEND, OR 97708  
 TITLE: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS  
 ALTERNATE WINDOW CONFIGURATIONS

PREPARED BY: **PTC** PTC, LLC  
 Phone 321.690.1788 Fax 321.690.1789

DRN: DRL	DATE: 05/25/06
SCALE: N.T.S.	DWG. NO: JELD0029
REV: B	SHEET: 6 OF 6