



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908  
www.buildingcodeonline.com

**NOTICE OF ACCEPTANCE (NOA)**

Jeld-Wen, Inc.  
31725 Highway 97 North  
Chiloquin, OR 97624

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION:** The Jeld-Wen Series "Alum Clad" – Outswing Wood French Doors

**APPROVAL DOCUMENT:** Drawing No. JWC0032, titled "Aluminum Clad Wood Outswing French Door" Sheets 1 through 6 of 6, prepared by manufacture dated 06/21/06 and last revised on 09-20-2006, signed and sealed by L. Roberto Lomas, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING:** Large and Small Missile Impact Resistant

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 03-0224.06 and, consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P. E.**

NOA No 06-0719.06  
Expiration Date: February 11, 2007  
Approval Date: October 12, 2006  
Page 1



**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS (transferred from files # 03-0224.06)**

1. Manufacturer's die drawings and sections.
2. Drawing No. **JWC0032**, titled "Aluminum Clad Wood Outswing French Door" Sheets 1 through 6 of 6, prepared by manufacture dated 06/21/06 and last revised on 09-20-2006, signed and sealed by L. Roberto Lomas, P.E.

**B. TESTS (transferred from files # 03-0224.06)**

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
6) Forced Entry Test, per FBC 2411 3.2.1 (b) and TAS 202-94

Along with marked-up drawings and installation diagram of outswing wood French doors, prepared by Architectural Testing Lab, Test Report No. **61976.01-301-18** dated 03-24-06, signed and sealed by Joseph A. Reed, P.E and **03-31369.01** dated 03-15-02 & **03-31369.02** dated July 22,2000, signed and sealed by Steven M. Urich, P.E

**C. CALCULATIONS (transferred from files # 03-0224.06)**

1. Anchor verification calculations complying w/ FBC 2004, dated 9/12/06 and last revised on 09-14-06, prepared, signed & sealed by L. Roberto Lomas, P.E.
2. Anchor Calculations, dated 4/1/03, prepared by R.W. Building Consultants, Inc., signed and sealed by Lyndon Schmidt, P.E. (transferred from files # **03-0224.06**)

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **01-1204.01** issued to E. I. DuPont De Nemours for their "Sentry Glas Plus" expiring on 01/14/2007

**F. STATEMENTS (transferred from files # 03-0224.06)**

1. Statement letter of conformance & no financial interest, dated 07/13/06, signed by L. Roberto Lomas, P.E.
2. Statement letter of conformance & no financial interest, dated 1/30/03, signed by Lyndon Schmidt P.E. (transferred from files # **03-0224.06**)


**G. OTHER**

1. Notice of Acceptance No. **03-0224.06** (# 01-1224.06), issued to Pozzi Window Company for Aluminum Clad Wood Outswing Door, expiring on 2/11/07.
2. Letter of acquisition of Pozzi Window by Jeld-Wen Inc., dated July 06, 2006, signed by David G. Stork (Jeld-Wen Inc.)


*Ishaq I. Chanda*

Ishaq I. Chanda, P. E.  
Product Control Examiner  
NOA No 05-0830.19

Expiration Date: February 11, 2007  
Approval Date: October 12, 2006

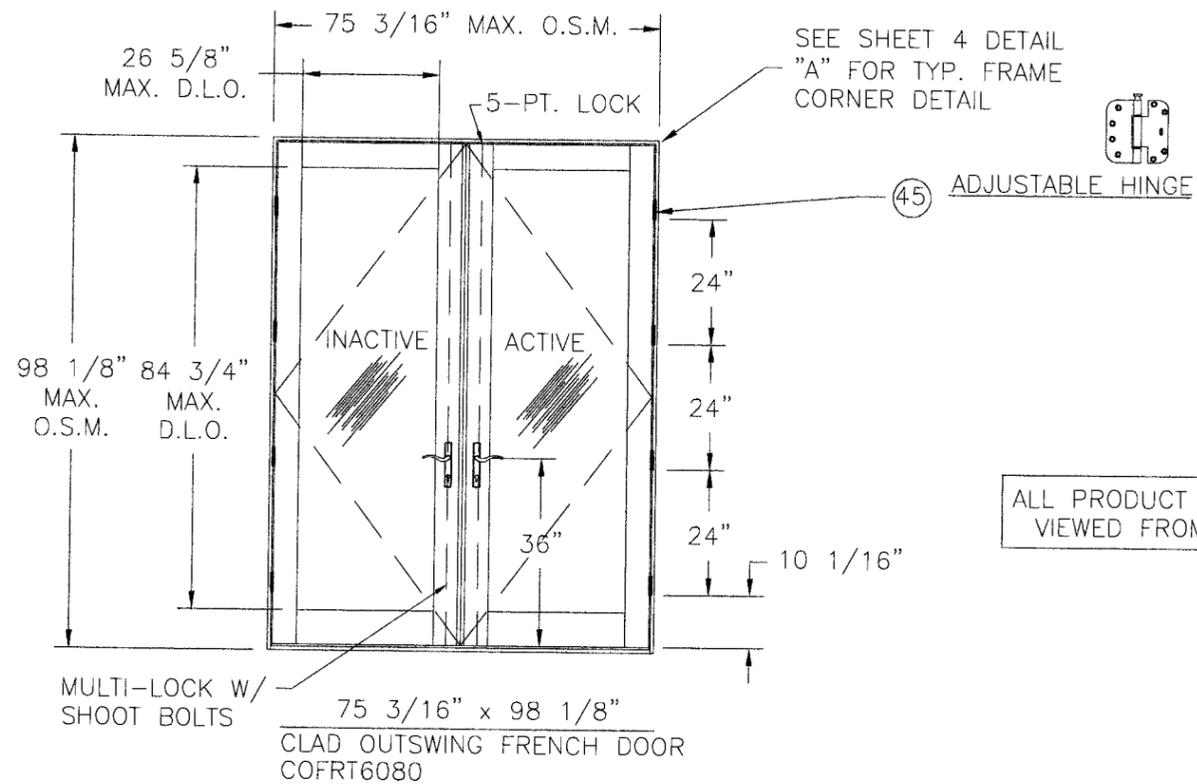

ALL PRODUCT ELEVATIONS ARE VIEWED FROM THE EXTERIOR.

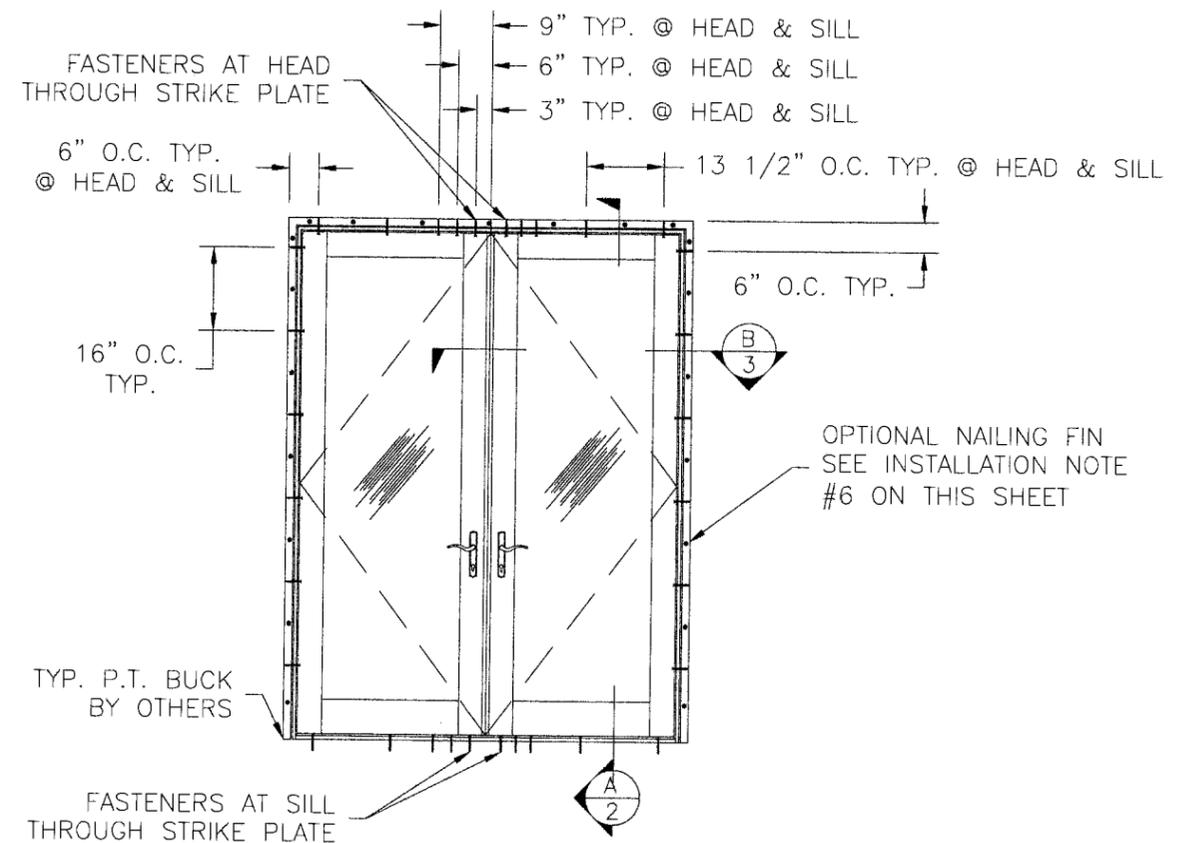

75 3/16" x 98 1/8"  
CLAD OUTSWING FRENCH DOOR  
COFRT6080

DESIGN LOAD INFORMATION				
FRAME SIZE	GLAZING DESCRIPTION	GLASS SIZE	DP POS.	DP NEG.
75 3/16" x 98 1/8"	3/16" ANN. GLASS + .095 SEA STORM CARDINAL SGP + 3/16" ANN. GLASS	26 5/8" x 84 3/4"	60	62

**GENERAL NOTES**

- THIS PRODUCT IS DESIGNED TO MEET THE 2004 FLORIDA BUILDING CODE INCLUDING HVHZ. INSTALLATION OF THIS PRODUCT OUTSIDE THE "HVHZ" SHALL MEET THE APPLICABLE CODE REQUIREMENTS FOR WINDBORNE DEBRIS REQUIREMENTS.
- THIS PRODUCT IS RATED FOR LARGE MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.
- PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS PER DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT A PART OF THIS APPROVAL.
- WOOD BUCKS BY OTHERS MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
- THESE DOOR SYSTEMS HAVE BEEN TESTED AND APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE IN THE DESIGN LOAD INFORMATION CHART SHOWN ON SHEET 3 OF THESE DRAWINGS.

**INSTALLATION NOTES**

- SHIM AS REQUIRED AT EACH SET OF INSTALLATION ANCHORS. MAXIMUM ALLOWABLE SHIM SPACE TO BE 1/4". SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS.
- FOR ANCHORING INTO CONCRETE OR MASONRY USE 1/4" DIAMETER ELCO TAPCON WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT WITH A 2 1/4" MINIMUM EDGE DISTANCE.
- FOR ANCHORING INTO WOOD FRAMING USE #10 WOOD SCREW WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/2" MINIMUM EMBEDMENT.
- LOCATE ANCHORS AT HEAD & SILL 6" FROM EACH CORNER, 13 1/2" O.C. & (6) ANCHORS 3" APART AT ASTRAGAL.
- LOCATE ANCHORS AT JAMBS 6" FROM EACH CORNER AND 16" MAXIMUM ON CENTER THEREAFTER.
- #8 X 1 5/8" ROOFING NAILS USED W/ OPT. NAIL FINES & DRIP CAP ARE NOT REQ'D. FOR USE AS AN INSTALLATION ANCHOR. IT IS SOLELY USED AS A LOCATOR.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	ELEVATION, GENERAL NOTES & ANCHORING LOCATIONS
2	VERTICAL SECTIONS
3	HORIZONTAL SECTION & GLASS DETAILS
4	FRAME CORNER FASTENER DETAILS
5	COMPONENT DETAILS AND BOM
6	HARDWARE FASTENING DETAILS

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No. 06-0719.06  
Expiration Date FEB 11, 2007  
By Iskay I. Chanda  
Miami Dade Product Control  
Division

NOTE:  
ELEVATIONS SHOWN ON THIS PAGE WITH 2X BUCKING AND WITHOUT LOCATING FLANGES. FOR OPTIONAL LOCATING FLANGES, W/ DIRECT MOUNT SCREWS, SEE SHEETS 2 & 3.


SYMBOL	REVISION	DATE	BY
B	CHANGES PER M-D LETTER ON 08/27/2006	09/04/06	HFN
A	Changed customers address	07/11/06	DRL

L. Roberto Lomas  
P.E. No. 62514  
*L. Roberto Lomas*  
9/20/06  
PTC, LLC  
1535 Cogswell Street, suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935

JELD-WEN WINDOWS AND DOORS  
BEND WINDOW DIVISION; 62845 BOYD RD.; BEND, OR 97708  
TITLE: ALUMINUM CLAD WOOD OUTSWING FRENCH DOOR  
ELEVATION, ANCHORING DETAILS AND NOTES

PREPARED BY: **PTC**  
PTC, LLC  
Phone 321.690.1788 Fax 321.690.1789

DRN: DRL DATE: 06/21/06  
SCALE: N.T.S. DWG. NO: JWC0032  
REV: B SHEET: 1 OF 6

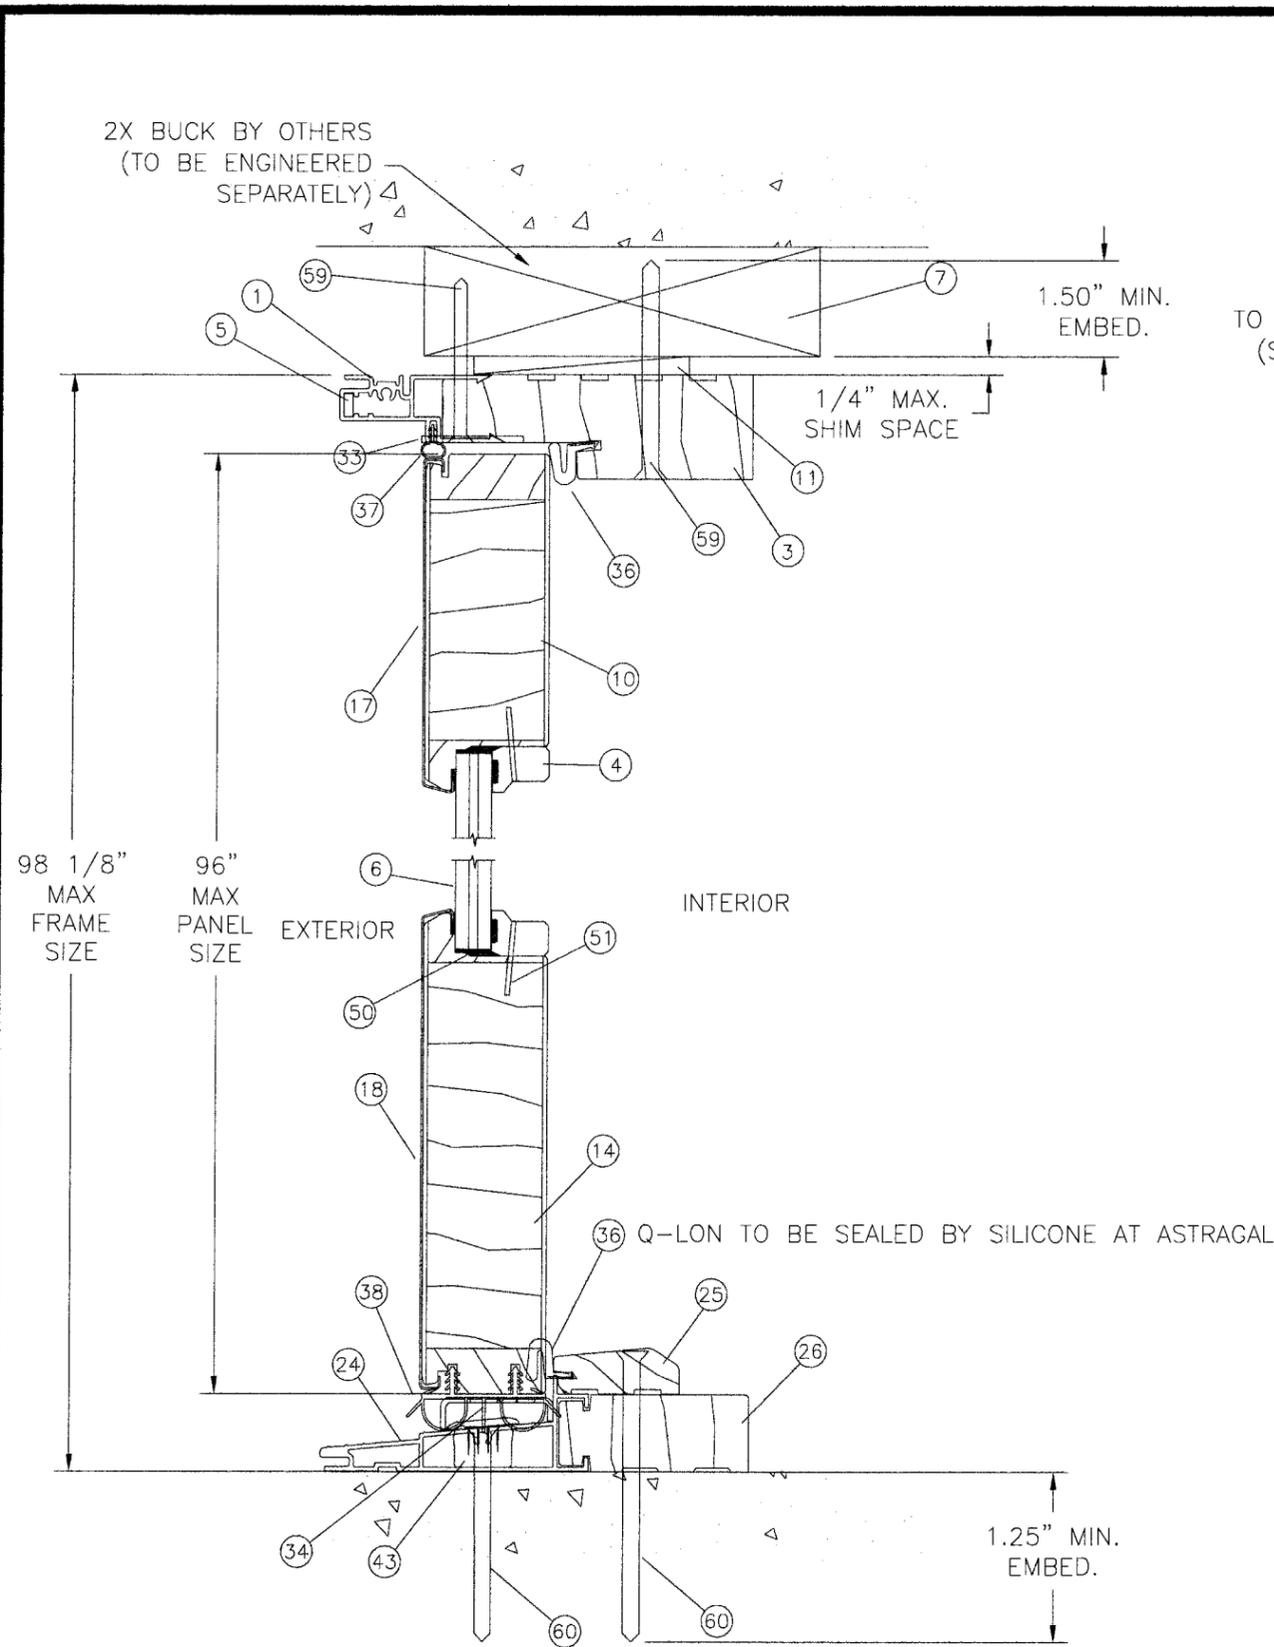


98 1/8" MAX FRAME SIZE  
96" MAX PANEL SIZE

EXTERIOR INTERIOR

Q-LON TO BE SEALED BY SILICONE AT ASTRAGAL

1.25" MIN. EMBED.

1 A VERTICAL SECTION TYP. (2X BUCK)  
2

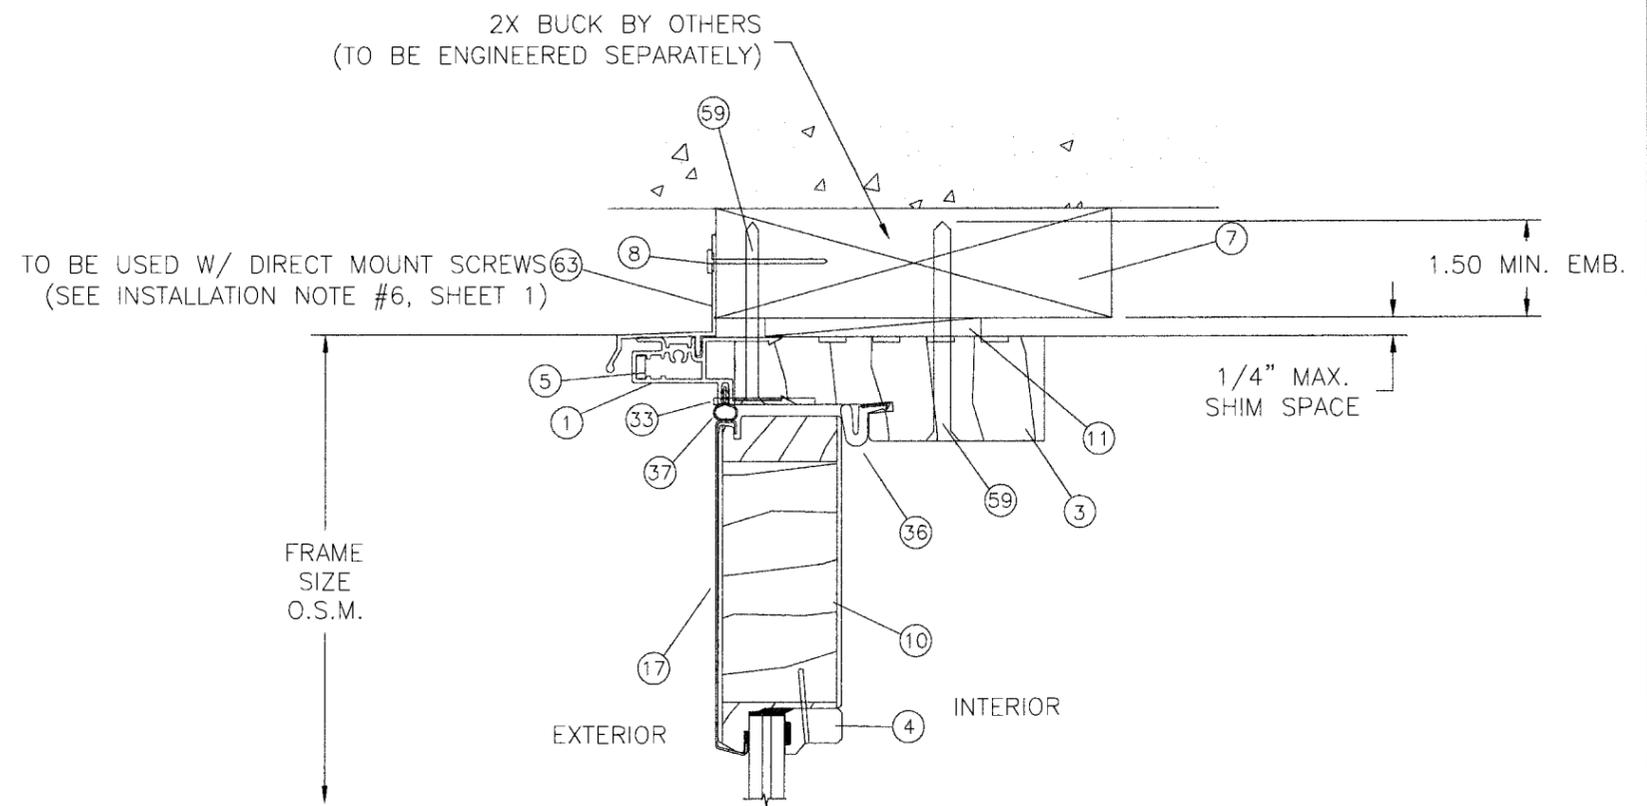

FRAME SIZE O.S.M.

EXTERIOR INTERIOR

1 A VERTICAL SECTION TYP. (2X BUCK)  
2 OPTIONAL DRIPCAP

NOTE:  
TOP RAIL AND BOTTOM RAIL ARE COMPOSED OF SOLID WESTERN PINE VENEER LAMINATED TO A KILN DRIED EDGE-AND-END GLUED CORE. LOCK AND HINGE STILES SHALL BE SOLID WESTERN PINE VENEER LAMINATED TO A TIMBERSTRAND® CORE. STILES AND RAILS ARE 1.71875" THICK. TOP RAILS AND STILES ARE 4.625" WIDE. BOTTOM RAILS ARE 6.625" (168MM) WIDE. THE OPTIONAL BOTTOM RAIL IS 10.25" (260MM) WIDE. CLAD ALUMINUM ROLLFORM SURFACE IS .024" WALL THICKNESS.

**PRODUCT REVISED**  
as complying with the Florida Building Code  
Acceptance No. 06-0719-06  
Expiration Date 06/30/2007  
By Isaac L. Chaudh  
Miami Dade Product Control Division


SYM	REVISION	DATE	BY
B	CHANGES PER M-D LETTER ON 08/27/2006	09/04/06	HFN
A	CHANGED CUSTOMER ADDRESS	07/11/06	DRL

L. Roberto Lomas  
P.E. No. 62514  
*L. Roberto Lomas*  
9/20/06  
PTC, LLC  
1535 Cogswell Street, suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935

JELD-WEN WINDOWS AND DOORS  
BEND WINDOW DIVISION; 62845 BOYD RD.; BEND, OR 97708  
TITLE: ALUMINUM CLAD WOOD OUTSWING FRENCH DOOR  
VERTICAL CROSS SECTIONS


PREPARED BY: <b>PTC</b> PTC, LLC	DRN: DRL	DATE: 06/21/06
SCALE: N.T.S.	DWG. NO: JWC0032	
REV: B	SHEET: 2 OF 6	

Phone 321.690.1788 Fax 321.690.1789

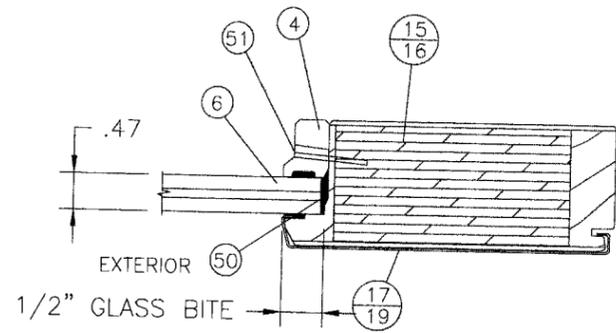

**IMPACT RESISTANT GLAZING DETAIL**

OVERALL 0.47" CARDINAL<sup>®</sup> LAMINATED GLASS CONSIST OF 3/16" ANN + .095 CARDINAL SEA STORM + 3/16" ANN GLASS

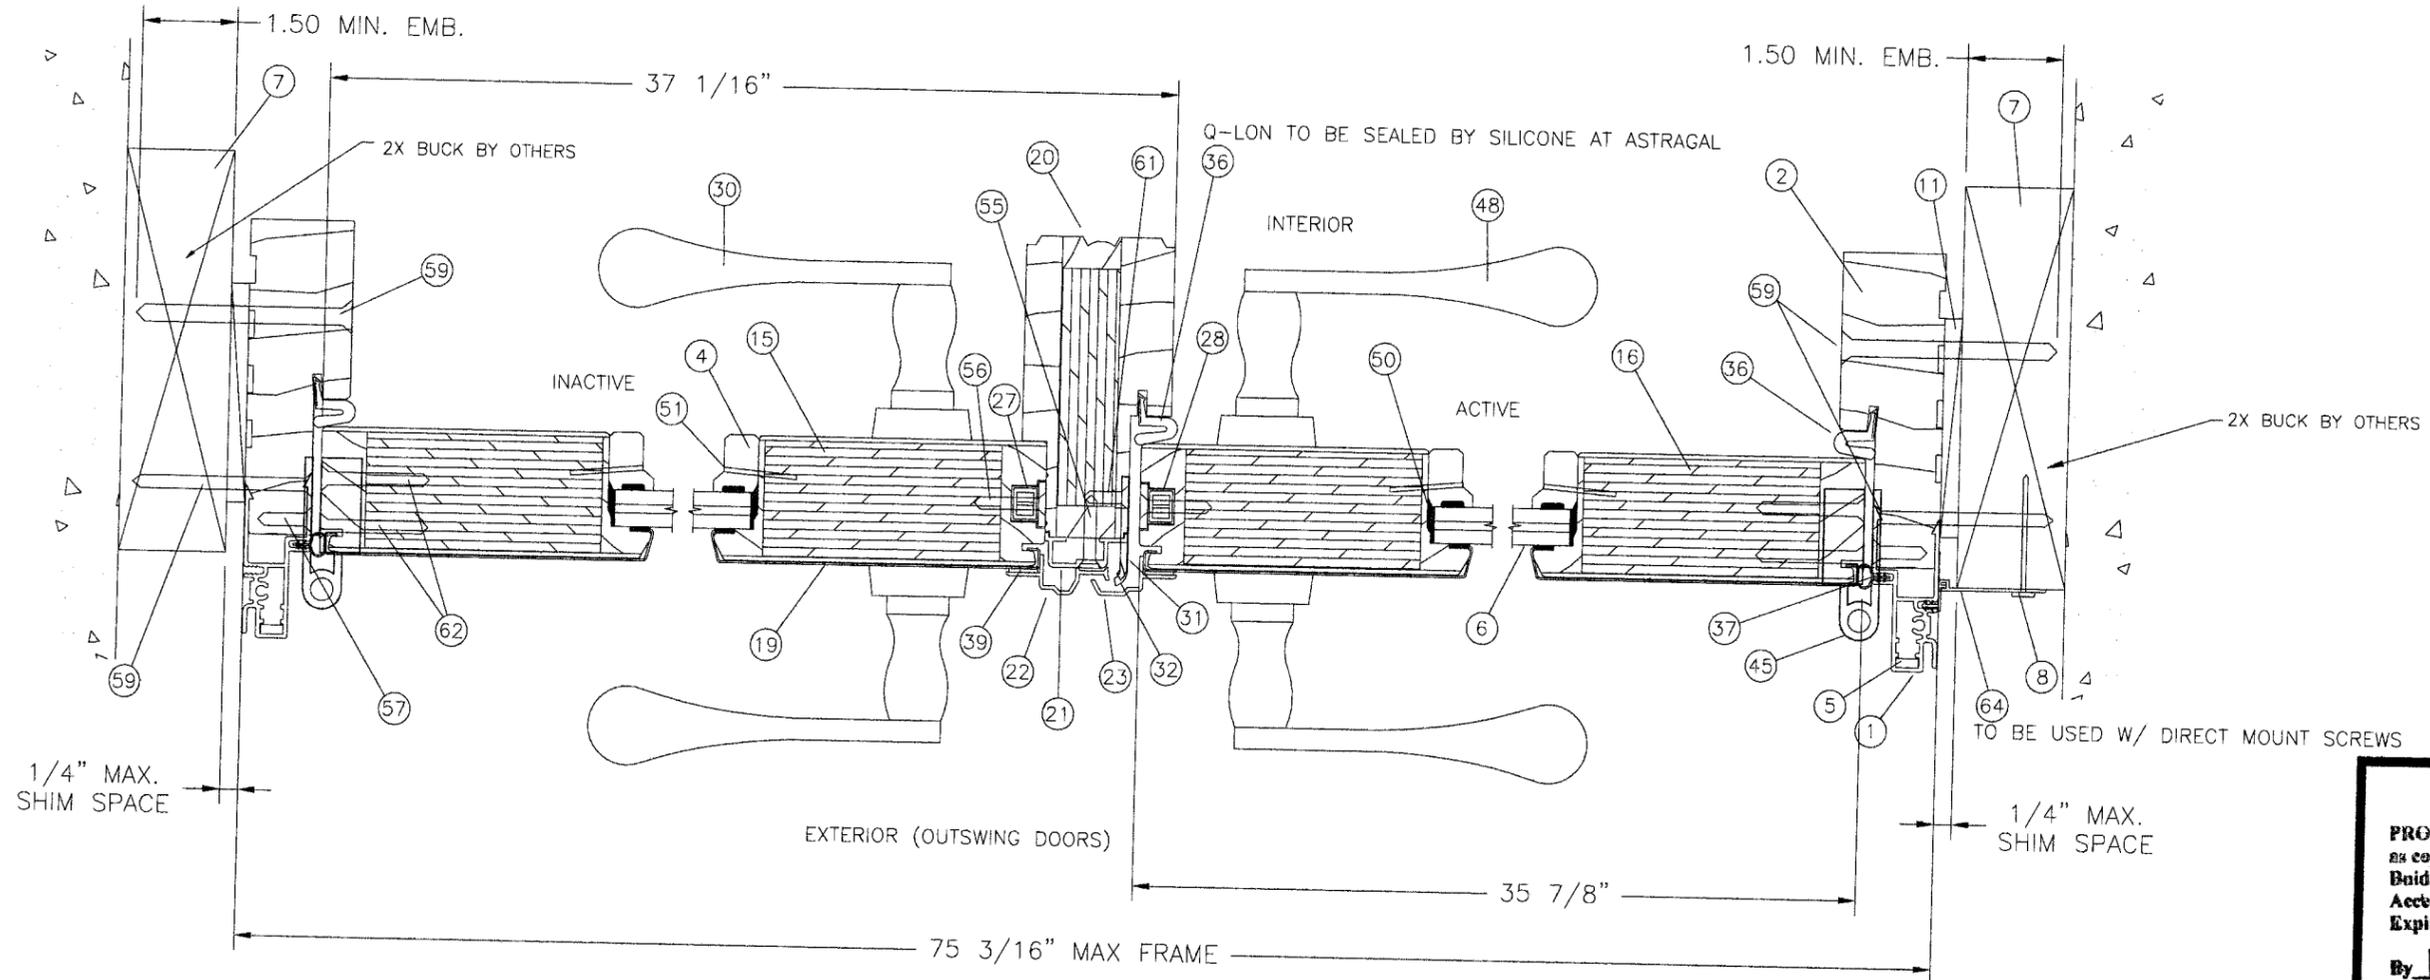

**B**  
**3** HORIZONTAL SECTION TYP.

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No. 06-0719-06  
Expiration Date FEB 11, 2007  
By Ishag I. Chaudh  
Miami Dade Product Control  
Division

SYM	REVISION	DATE	BY
B	CHANGES PER M-D LETTER ON 06/27/2006	09/04/06	HFN
A	CHANGED CUSTOMERS ADDRESS	07/11/06	DRL

L. Roberto Lomas  
P.E. No. 62514  
*L. Roberto Lomas*  
9/20/06  
PTC, LLC  
1535 Cogswell Street, suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935


**JELD-WEN WINDOWS AND DOORS**  
BEND WINDOW DIVISION; 62845 BOYD RD.; BEND, OR 97708  
TITLE: ALUMINUM CLAD WOOD OUTSWING FRENCH DOOR  
HORIZONTAL CROSS SECTIONS

PREPARED BY: **PTC** PTC, LLC  
DRN: DRL DATE: 06/21/06  
SCALE: N.T.S. DWG. NO: JWC0032  
REV: B SHEET: 3 OF 6  
Phone 321.690.1788 Fax 321.690.1789

## OUTSWING DOOR CONSTRUCTION

### FRAME CONSTRUCTION:

THE WOOD FRAME IS 4.3125" x 1.4375" PONDEROSA PINE. THE FRAME METAL IS 2.26091" x .921875" x .060" WALL EXTRUDED ALUMINUM. THE FRAME METAL IS SNAPPED ONTO THE WOOD JAMB WITH A LAP JOINT AT THE HEAD CORNERS AND SEALED WITH SILICONE (1199 DOW CORNING). EACH HEAD CORNER IS FASTENED WITH (3) #8 x 2" FLT. HD. PHL. SCREWS. AN ADDITIONAL #8 x 1" FLT. HD. PHL. SCREW IS APPLIED INTO THE SCREW BOSS OF THE ALUMINUM EXTRUSION AND A CORNER KEY .125" x 11/32" INTO THE SLOT OF THE ALUMINUM EXTRUSION TO COMPLETE THE CORNER. THE SILL IS ATTACHED THROUGH THE SIDE JAMB INTO THE SILL BASE WITH (3) #8 x 2" FLT. HD. PHL. SCREWS. AN ADDITIONAL #8 x 1" FLT. HD. PHL. SCREW IS APPLIED UP THROUGH THE SILL METAL INTO THE SCREW BOSE OF THE ALUMINUM SIDE JAMB EXTRUSION TO COMPLETE THE INSTALLATION.

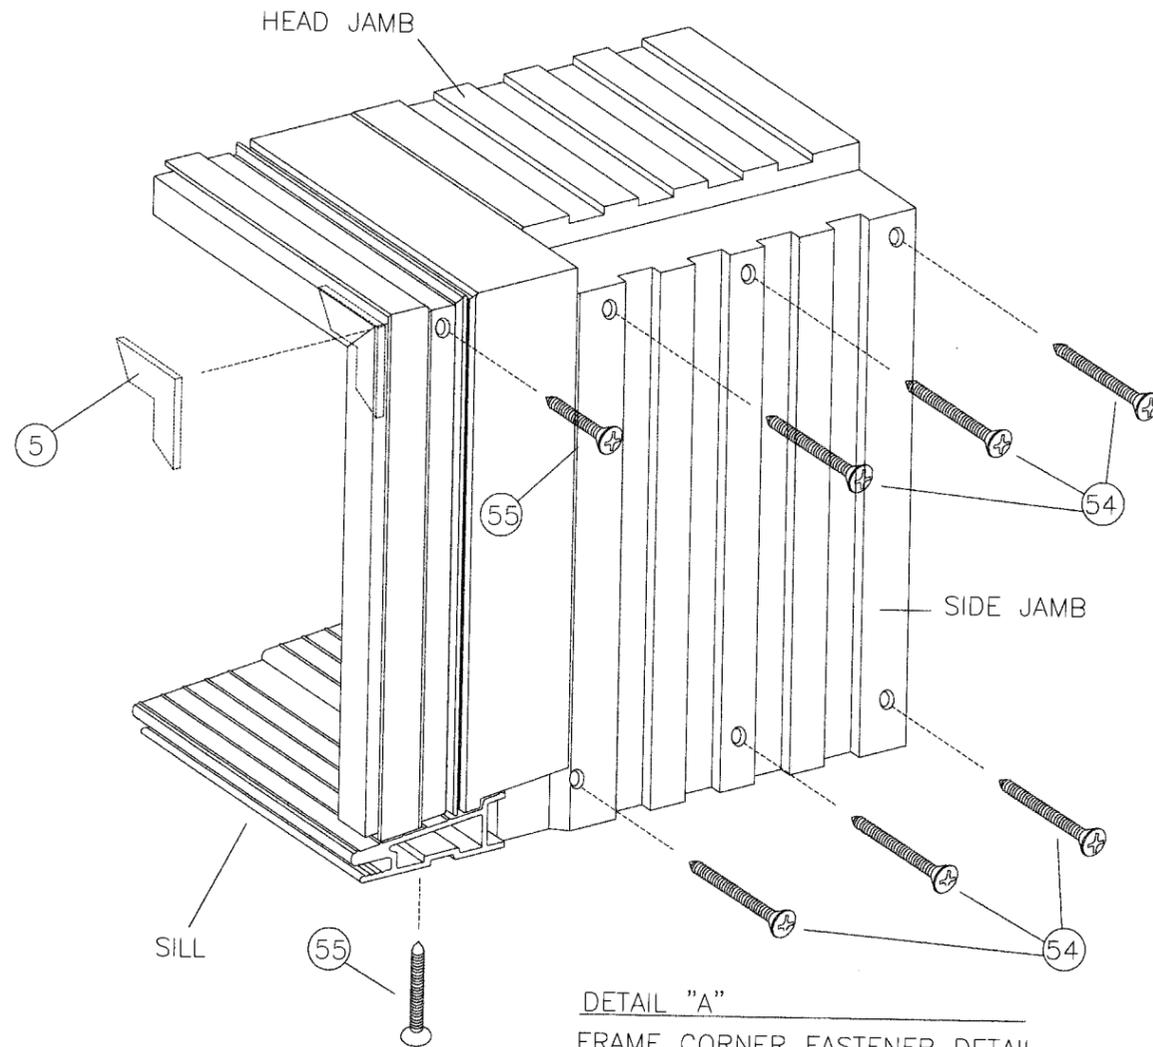

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No. 06-0719.06  
Expiration Date FEB 11, 2007  
By Ichha L. Chandra  
Miami Dade Product Control  
Division

SYM	REVISION	DATE	BY
B	CHANGES PER M-D LETTER ON 08/27/2006	09/04/06	HFN
A	CHANGED CUSTOMERS ADDRESS	07/11/06	DRL

L. Roberto Lomas  
P.E. No. 62514  
*L. Roberto Lomas*  
9/20/06  
PTC, LLC  
1535 Cogswell Street, suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935


**JELD-WEN WINDOWS AND DOORS**

BEND WINDOW DIVISION; 62845 BOYD RD.; BEND, OR 97708  
TITLE: ALUMINUM CLAD WOOD OUTSWING FRENCH DOOR  
DOOR CONSTRUCTION DETAIL

PREPARED BY: <b>PTC</b> PTC, LLC	DRN: DRL	DATE: 06/21/06
SCALE: N.T.S.	DWG. NO.: JWC0032	
REV: B	SHEET: 4 OF 6	

Phone 321.690.1788 Fax 321.690.1789

MATERIAL LIST			
ITEM	PART #	DESCRIPTION	MATERIAL
1	SPD-161	ALUMINUM FRAME CLADDING - .060 WALL	6063-T5 ALUM.
2	SPD-159	WOOD SIDE JAMB - (BMC)	WESTERN PINE
3	SPD-164	WOOD HEAD JAMB - (BMC)	WESTERN PINE
4	SPD-329	WOOD GLASS STOP - (BMC)	WESTERN PINE
5	AC-74	FRAME CORNER KEY - 2 EA. (MITCHELL METALS)	WESTERN PINE
6	N/A	IMPACT RESISTANT LAMINATED GLASS - (CARDINAL CORP.)	SEE SHEET 3
7	N/A	PRESSURE TREATED 2X BUCK	P.T. WOOD
8	N/A	NOT USED	
9	N/A	NOT USED	
10	SPD-224	WOOD TOP RAIL - (BMC)	WESTERN PINE
11	N/A	1/4" FRAME SHIM	WOOD
12	SPD-226	WOOD 10 1/4" BOTTOM RAIL - (BMC) (OPTIONAL)	WESTERN PINE
13	SPD-302	10 1/4" BOTTOM RAIL CLADDING - (HOMESHIELD) (OPTIONAL)	ALUMINUM
14	SPD-225	WOOD BOTTOM RAIL - (BMC)	WESTERN PINE
15	SPD-228	WOOD LOCK STILE - (BMC)	WESTERN PINE
16	SPD-228	WOOD HINGE STILE - (BMC)	WESTERN PINE
17	SPD-300	TOP RAIL CLADDING - (HOMESHIELD)	ALUMINUM
18	SPD-301	BOTTOM RAIL CLADDING - (HOMESHIELD)	ALUMINUM
19	SPD-304	STILE CLADDING - (HOMESHIELD)	ALUMINUM
20	SPD-232	WOOD ASTRAGAL - (JELD-WEN MILLWORK)	WESTERN PINE
21	SPD-162	ASTRAGAL MULLION CAP - (SAPA)	ALUMINUM
22	SPD-321	INACTIVE ASTRAGAL COVER - (SAPA)	ALUMINUM
23	SPD-320	ACTIVE ASTRAGAL COVER - (SAPA)	ALUMINUM
24	SPD-306	OUTSWING SILL METAL - (SAPA)	ALUMINUM
25	SPD-212	SILL CAP - (CONNOLLY)	OAK
26	SPD-213	SILL BASE - (CONNOLLY)	OAK
27	HLS-9000	INACTIVE MULTI-POINT HARDWARE - (HOPPE)	STAINLESS STEEL
28	HLS-9000	ACTIVE MULTI-POINT HARDWARE - (HOPPE)	STAINLESS STEEL
29	N/A	NOT USED	
30	N/A	INACTIVE HANDLE SET & ESCUTCHEON PLATE - (HOPPE)	COATED STEEL
31	N/A	ROUNDBOLT STRIKE PLATE - (HOPPE)	COATED STEEL
32	N/A	DUAL STRIKE AND DEADBOLT PLATE - (HOPPE)	COATED STEEL
33	N/A	HEAD JAMB SHOOTBOLT STRIKE PLATE - (HOPPE)	STAINLESS STEEL
34	N/A	SILL SHOOTBOLT STRIKE PLATE - (HOPPE)	STAINLESS STEEL
35	N/A	NOT USED	
36	N/A	Q-LON 650 WEATHERSTRIP SEALED W/ SILICONE - (SCHLEGEL)	POLY
37	N/A	ARLOC WEATHERSTRIP BULB - (INTEK)	POLY
38	N/A	DOOR SWEEP - (ENDURA)	POLY
39	N/A	3/8" x 1/8" VHB TAPE	3M
40	N/A	NOT USED	
41	N/A	ITEM USED BUT NOT SHOWN	BRASS
42	N/A	ITEM USED BUT NOT SHOWN	STEEL
43	N/A	SILL SHOOTBOLT GROMMET - (BRANDT)	POLY
44	N/A	1/2" x 4" DOWEL (CHICAGO DOWEL)	WOOD
45	N/A	4" ADJUSTABLE HINGE (SIMONSWERK)	COATED STEEL
46	N/A	ITEM USED BUT NOT SHOWN	STEEL
47	N/A	ITEM USED BUT NOT SHOWN	
48	N/A	ACTIVE HANDLE SET & ESCUTCHEON PLATE (HOPPE)	COATED STEEL
49	N/A	THUMBTURN (HOPPE)	COATED STEEL
50	N/A	#1199 SEALANT (DOW CORNING)	SEALANT
51	N/A	1" x 7/32" CROWN 18 GA. STAPLE, 6" O.C.	STEEL
52	N/A	#8 x 3" P.H.F.H. MTL. S/STL. SCREW	STEEL
53	N/A	#8 x 2" P.H.F.H. MTL. SCREW (HOPPE)	COATED STEEL

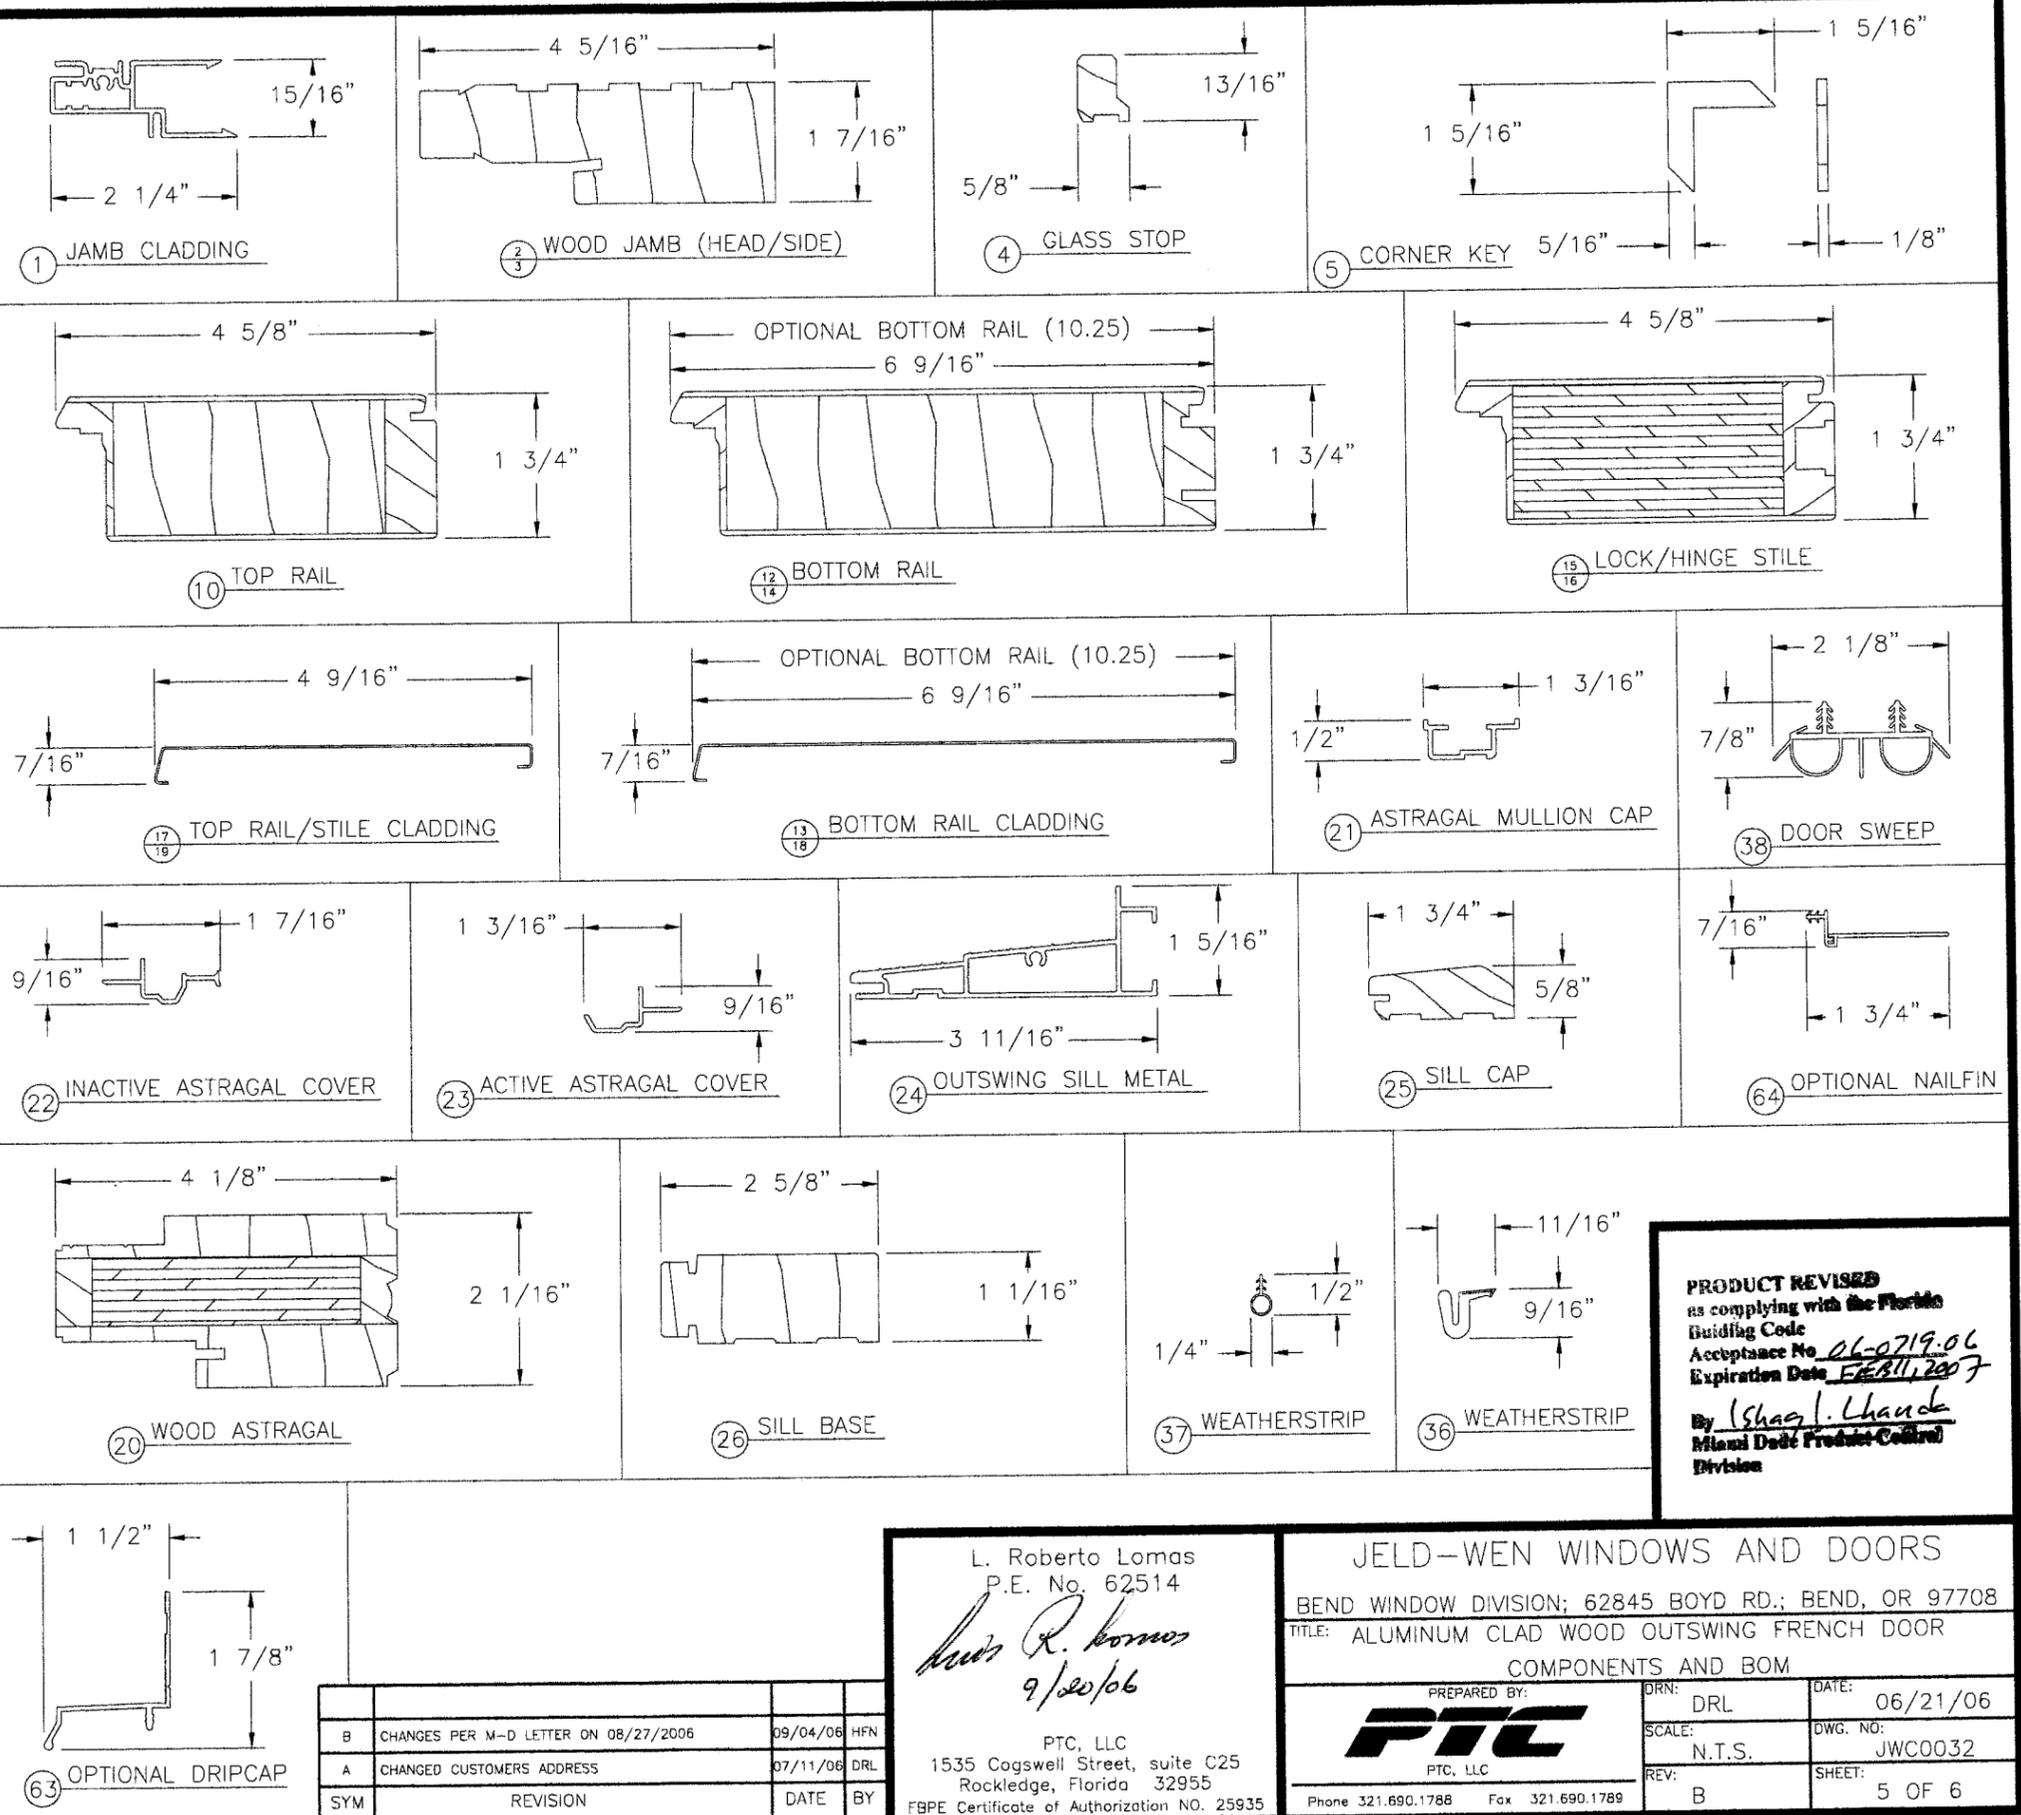

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No. 06-0719-06  
Expiration Date FEB 11, 2007  
By (Shag L. Lhanda  
Miami Dade Product Control  
Division


L. Roberto Lomas  
P.E. No. 62514  
*L. Roberto Lomas*  
9/20/06  
PTC, LLC  
1535 Cogswell Street, suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935

JELD-WEN WINDOWS AND DOORS  
BEND WINDOW DIVISION; 62845 BOYD RD.; BEND, OR 97708  
TITLE: ALUMINUM CLAD WOOD OUTSWING FRENCH DOOR  
COMPONENTS AND BOM

PREPARED BY: **PTC**  
ORIN: DRL DATE: 06/21/06  
SCALE: N.T.S. DWG. NO: JWC0032  
REV: B SHEET: 5 OF 6

SYM	REVISION	DATE	BY
B	CHANGES PER M-D LETTER ON 08/27/2006	09/04/06	HFN
A	CHANGED CUSTOMERS ADDRESS	07/11/06	DRL


NOTE:  
 PANELS ARE CONSTRUCTED OF HINGE STILES (4.625 x 1.71875), LOCK STILES (4.625 x 1.71875), TOP RAIL (4.625 x 1.71875), AND STANDARD BOTTOM RAIL (6.625 x 1.71875), OPTIONAL BOTTOM RAIL (10.25 x 1.71875). DOWELS ARE COATED WITH A WATER ACTIVATED ADHESIVE AND WATER IS APPLIED TO THE DOWELS PRIOR TO INSERTION INTO THE DOWEL HOLES. (SEE DETAIL "C") THE ASTRAGAL IS APPLIED TO THE INACTIVE STILE AFTER THE INACTIVE HARDWARE IS INSTALLED INTO THE INACTIVE STILE.

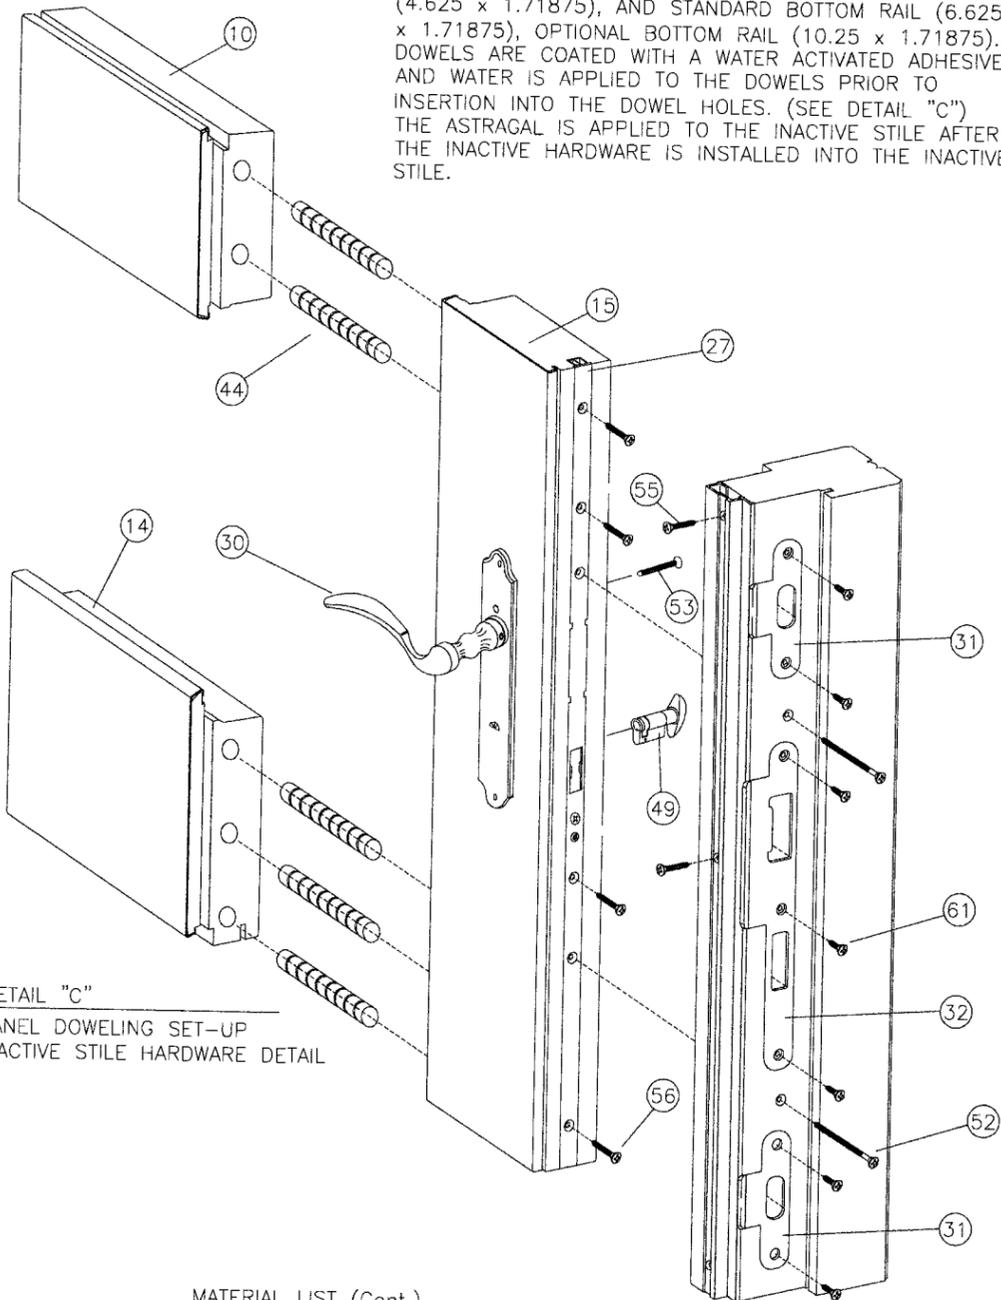

DETAIL "C"  
 PANEL DOWELING SET-UP  
 INACTIVE STILE HARDWARE DETAIL


MATERIAL LIST (Cont.)

ITEM	PART #	DESCRIPTION	MATERIAL
54	N/A	#8 x 2" P.H.F.H. WOOD SCREW	STEEL
55	N/A	#8 x 1" P.H.F.H. WOOD SCREW	COLOR MATCH STL.
56	N/A	#8 x 1" P.H.F.H. S/STL (ITEM USED BUT NOT SHOWN)	STEEL
57	N/A	#8 x 3/4" P.H.F.H. WOOD SCREW	COATED STEEL
58	N/A	#8 x 2 1/4" P.H.F.H. WOOD SCREW (ITEM USED BUT NOT SHOWN)	COATED STEEL
59	N/A	#10 x 3" P.H.F.H. WOOD SCREW	STEEL
60	N/A	1/4" ELCO TAPCON ANCHOR W/ 1 1/4" EMBED.	STEEL
61	N/A	#8 x 5/8" P.H.F.H. WOOD SCREW	COATED STEEL
62	N/A	#8 x 1 1/2" P.H.F.H. WOOD SCREW	COATED STEEL
63	AC-172	DRIPCAP	6063-T5 ALUM.
64	N/A	FOLDING NAILING FLANGE - (AMESBURY) (OPTIONAL)	POLY
65	N/A	ITEM USED BUT NOT SHOWN	WOOD
66	N/A	ITEM USED BUT NOT SHOWN	STEEL

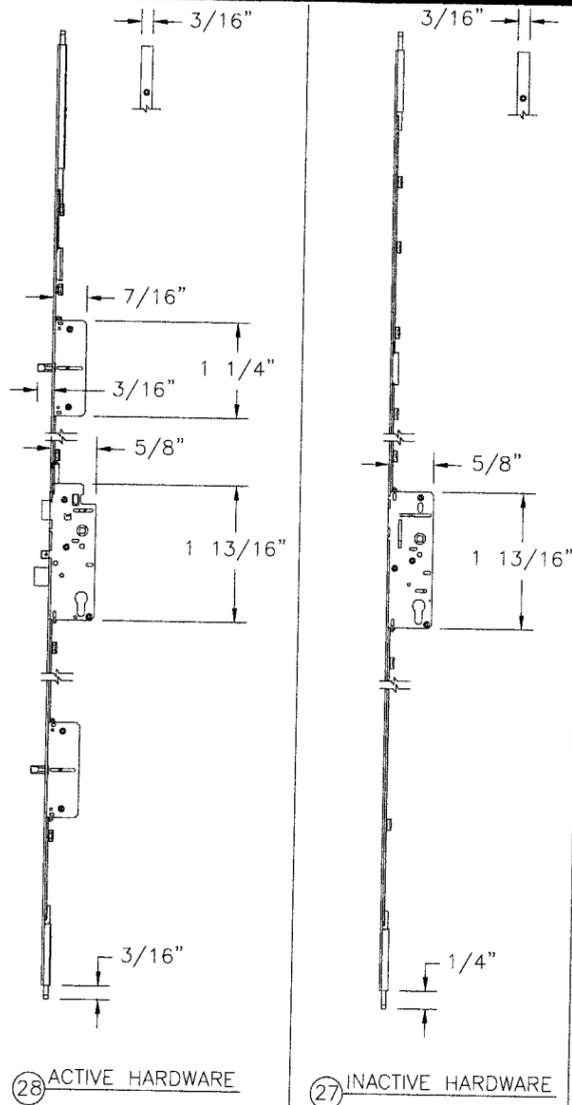


28 ACTIVE HARDWARE

27 INACTIVE HARDWARE

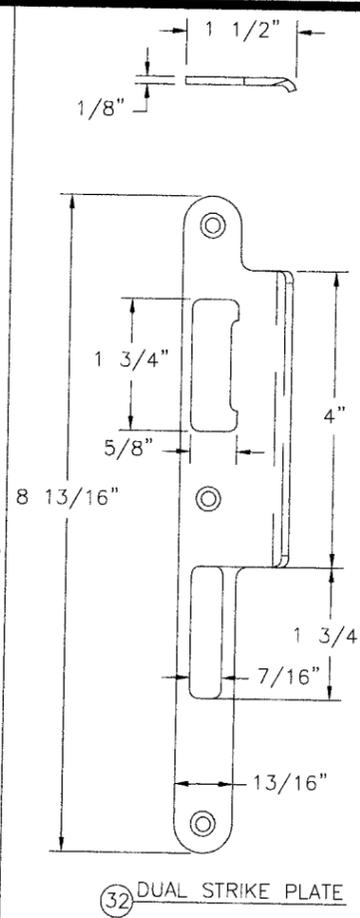


32 DUAL STRIKE PLATE

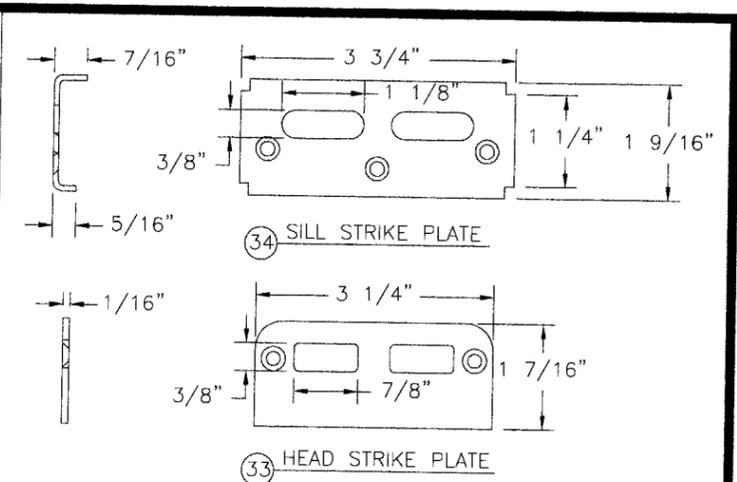


34 SILL STRIKE PLATE


33 HEAD STRIKE PLATE

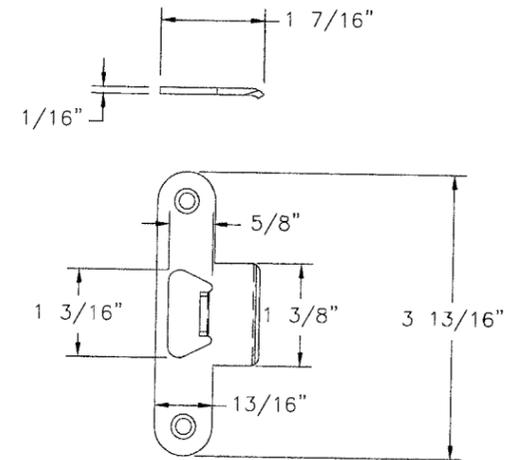

31 ROUND BOLT STRIKE



43 SILL GROMMET

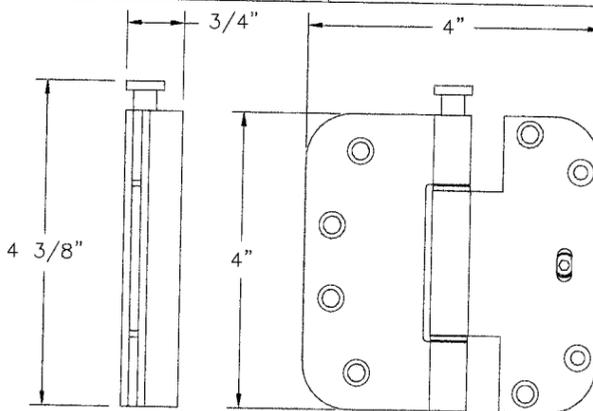

45 ADJUSTABLE HINGE

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 06-0719.06  
 Expiration Date FEB 14, 2007  
 By Ishaq I. Chaudhry  
 Miami Dade Product Control  
 Division

L. Roberto Lomas  
 P.E. No. 62514  
*L. Roberto Lomas*  
 4/20/06  
 PTC, LLC  
 1535 Cogswell Street, suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935

JELD-WEN WINDOWS AND DOORS  
 BEND WINDOW DIVISION; 62845 BOYD RD.; BEND, OR 97708  
 TITLE: ALUMINUM CLAD WOOD OUTSWING DOOR  
 HARDWARE

PREPARED BY: <b>PTC</b> PTC, LLC	DRN: DRL	DATE: 06/21/06
Phone 321.690.1788 Fax 321.690.1789	SCALE: N.T.S.	DWG. NO: JW0032
	REV: B	SHEET: 6 OF 6

SYMBOL	REVISION	DATE	BY
B	CHANGES PER M-D LETTER ON 08/27/2006	08/04/06	HFN
A	CHANGED CUSTOMERS ADDRESS	07/11/06	DRL