



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908
www.buildingcodeonline.com

NOTICE OF ACCEPTANCE (NOA)

Zeluck, Inc.
 5300 Kings Highway
 Brooklyn, NY 11234

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "H-7025" Mahogany Wood Sliding Glass Doors

APPROVAL DOCUMENT: Drawing No. **W97-33** titled "H-7025 Mahogany Wood Sliding Glass Door", sheets 1 through 7 of 7, prepared by Al-Farooq Corporation., dated 10/27/97 and last revised on Aug 31, 2006, signed and sealed by Dr. Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises & renews NOA # 01-0821.01** & consists of this page 1 and evidence page E-1 as well as, approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



9/24/06

NOA No 06-0919.06
Expiration Date: September 28, 2007
Approval Date October 20, 2006
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS (transferred from file # **01-0821.01**)

1. Manufacturer's die drawings and sections
2. Drawing No. **W97-33** titled "H-7025 Mahogany Wood Sliding Glass Door", sheets 1 through 7 of 7, prepared by Al-Farooq Corporation., dated 10/27/97 and last revised on Aug 31, 2006, signed and sealed by Dr. Humayoun Farooq, P.E.

B. TESTS (transferred from file **01-0821.01**) Note: Original test conducted per SFBC, PA 201, 202 & 203-94, now known as FBC, TAS 210, 202 & 203-94

1. Test reports on
 - 1) Air Infiltration Test, per FBC TAS 202-94
 - 2) Uniform Static Pressure Test, Loading per FBC PA 202-94
 - 3) Water Infiltration Test per FBC, TAS 202-94 (Not Performed)
 - 4) Forced Entry Test, per FBC, TAS 202-944.
 - 5) Large Missile Impact Test per FBC, TAS 203-94
 - 6) Cyclic Wind Pressure Test per FBC, TAS 204-94

Along with installation diagram of Mahogany Wood sliding glass doors, prepared by Architectural Testing Inc Test Report No. **ATI-01-30935** and **ATI-01-19714**, dated Nov.02, 19998 and June 19, 1997 respectively, both signed and sealed by Allen M. Reeves, P.E.

C. CALCULATIONS

1. Anchor verification calculations, complying w/ FBC 2004, prepared by Al-Farooq Corporation, dated 08/31/06, signed and sealed by Dr. Humayoun Farooq, P.E.
2. Glazing complies w/ ASTM E-1300-98 & ASTM E-1300-02

D. QUALITY ASSURANCE BY:

1. Miami Dade Building Code Compliance Office (BCCO)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No.**03-0827.08** for" PVB interlayer" issued to Solution Inc., expiring 03-04-2009.

F. STATEMENTS (transferred from file # **01-0821.01**)

1. Letter issued by Architectural Testing Lab, dated Aug. 08, 2006 in reference to scheduled test for re-verification.
2. Statement letter of conformance and "No financial interest", dated 08/31/06, signed & sealed Dr. Humayoun Farooq, P. E.
3. Statement letters of compliance, issued as part of test reports.

G. OTHER

1. This NOA **revises & renews** NOA # **01-0821.01 (97-1222.04)**, expiring 09/28/07.
2. One year conditional approval subjected to submittal of re-verification test.

Ishaq I. Chanda


Ishaq I. Chanda, P.E.

Product Control Examiner


NOA No 06-0919.06

Expiration Date: September 28, 2007

Approval Date: October 20, 2006

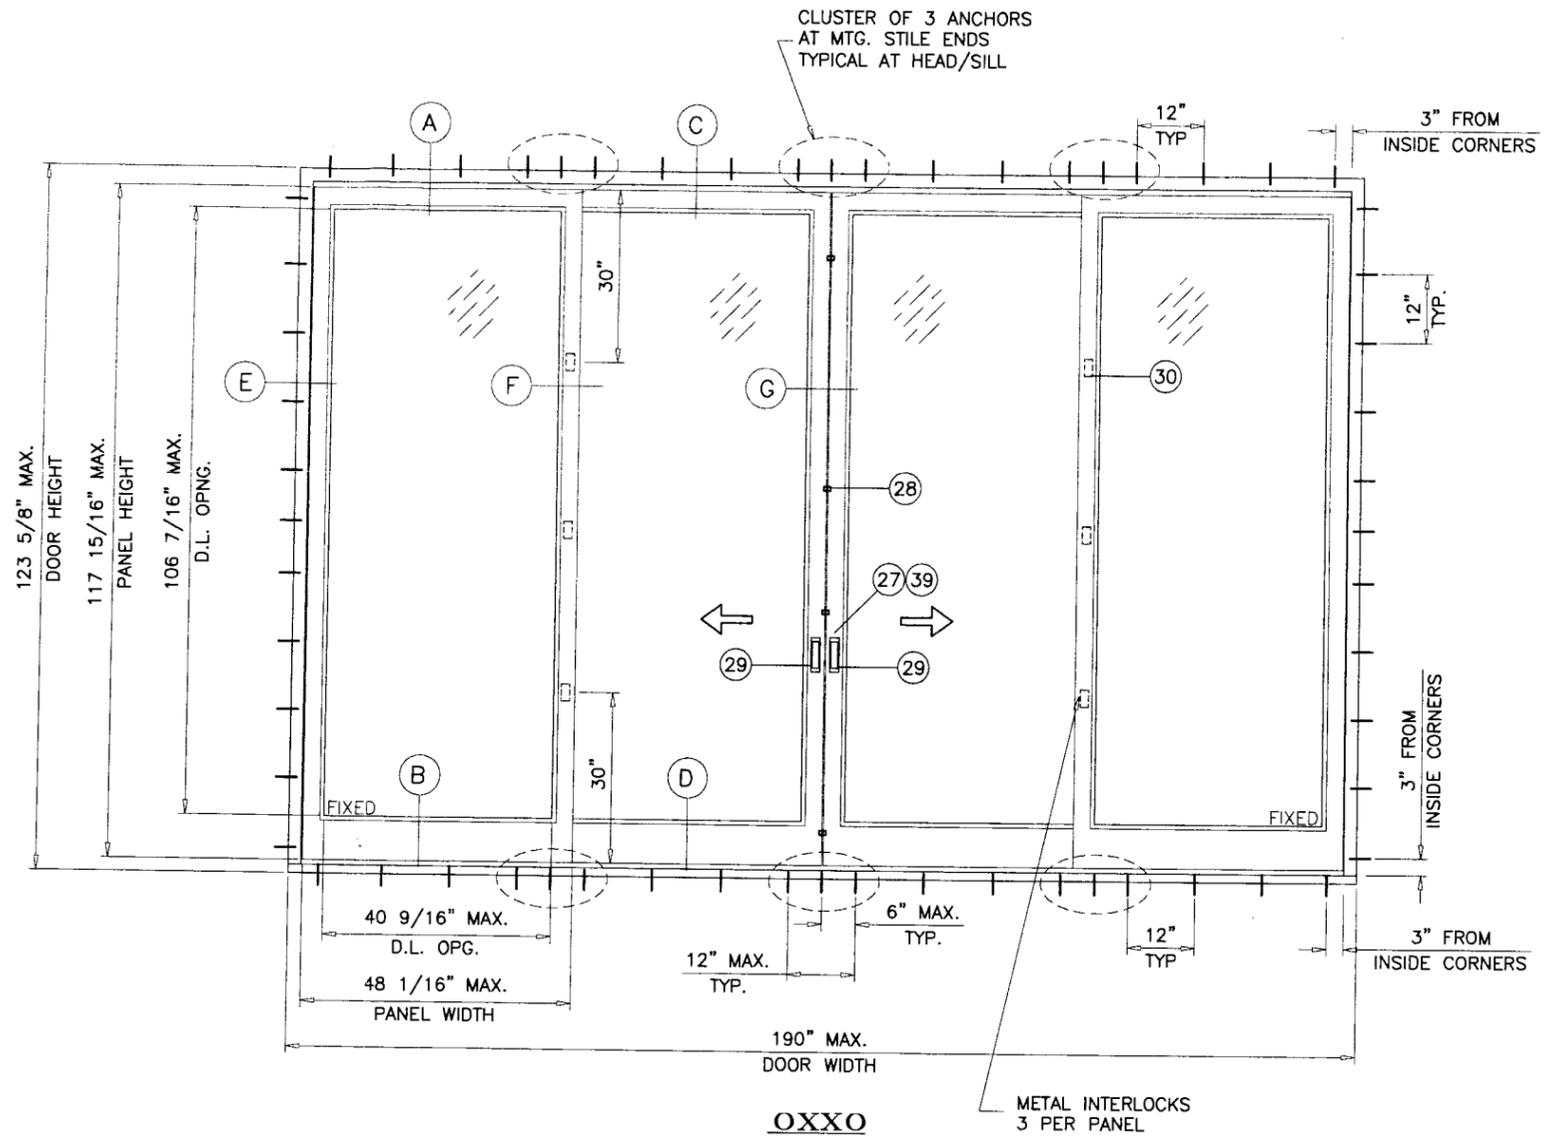

**TYPICAL ELEVATION
TESTED UNIT**

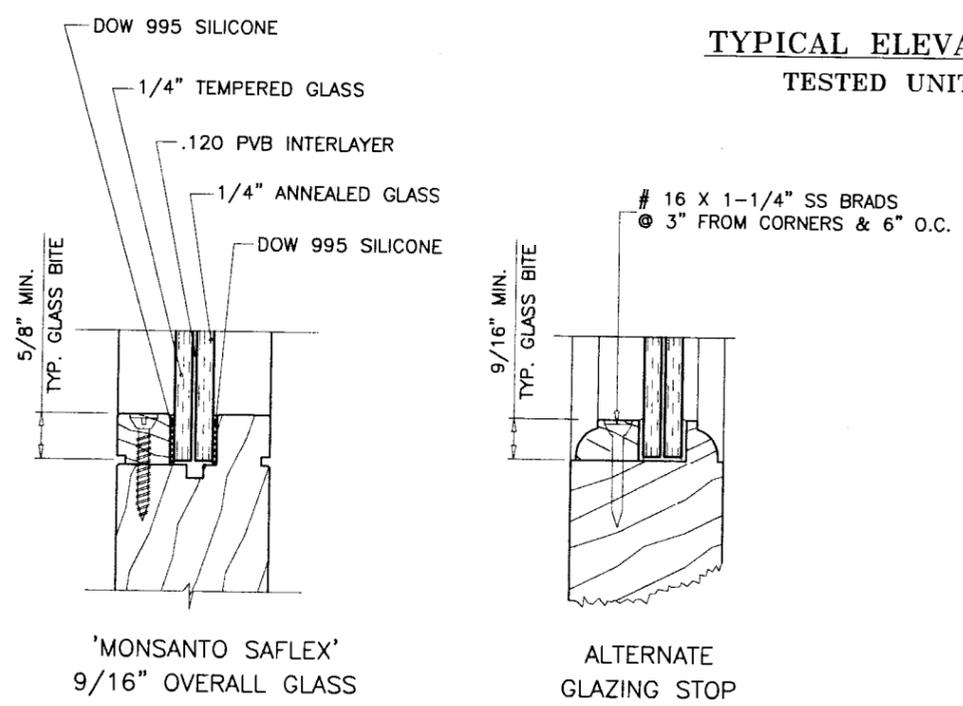

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

AUG 31 2006

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 06-0919-06
Expiration Date SEP 28, 2007
By Isaac I. Chande
Miami Code Product Control
Division

DOORS GLAZED WITH LAMINATED GLASS RATED FOR
LARGE MISSILE IMPACT AND REQUIRE NO SHUTTERS.

H7025 MAHOGANY WOOD SLIDING GLASS DOOR

SEE SHEET 2 FOR DESIGN LOAD CAPACITY OF DESIRED GLASS
SIZE BASED ON APPLICABLE WIND DURATION.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION (REV. 2005)
INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER
LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS
EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS
ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF
ANCHORS INTO WOOD ONLY.

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W97-33ZI-NEW

H7025 MAHOGANY WOOD SLIDING GLASS DOOR (L.M.I.)


ZELUCK INCORPORATED
5300 KINGS HIGHWAY
BROOKLYN, N.Y. 11234-9011
TEL. (718) 251-8060 FAX. (718) 531-2564

no.	date	by	description
A	7.21.98		GENERAL REVISION
B	3.25.99		SHEETS 3, 4 & 5 ADDED
C	12.14.99		GENERAL REVISION
D	1.06.00		HEIGHTS REDUCED SHEETS 3, 4, 5
E	08.07.06		UPDATED FOR 2004 FBC

date: 10-27-97
scale: 3/8"=1'-0"
dr. by: HAMID
chk. by:


drawing no.
W97-33

sheet 1 of 7

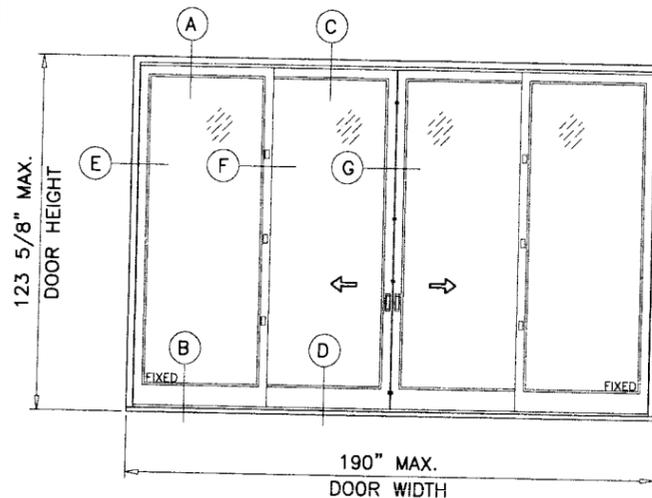


190" MAX. DOOR WIDTH

OXXO

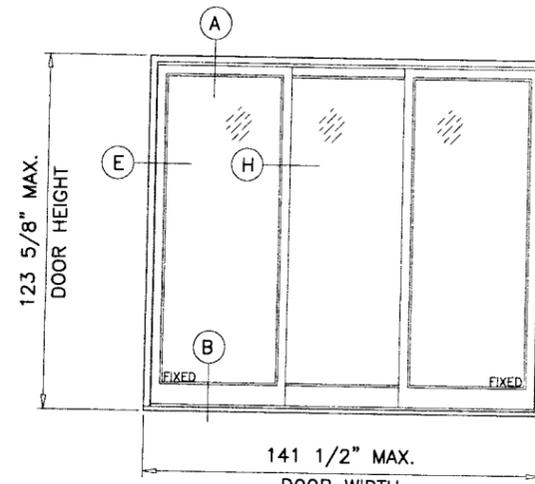


141 1/2" MAX. DOOR WIDTH

OOO

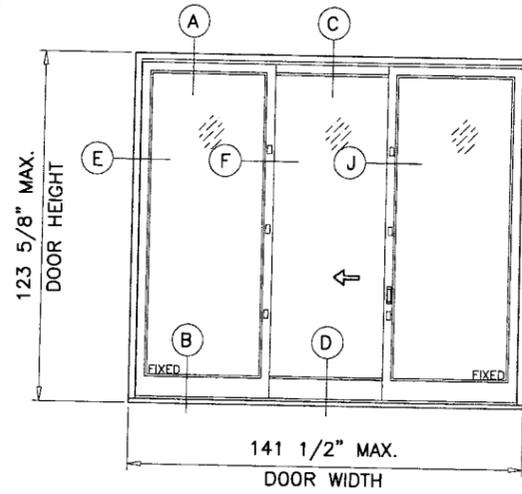


141 1/2" MAX. DOOR WIDTH

OXO

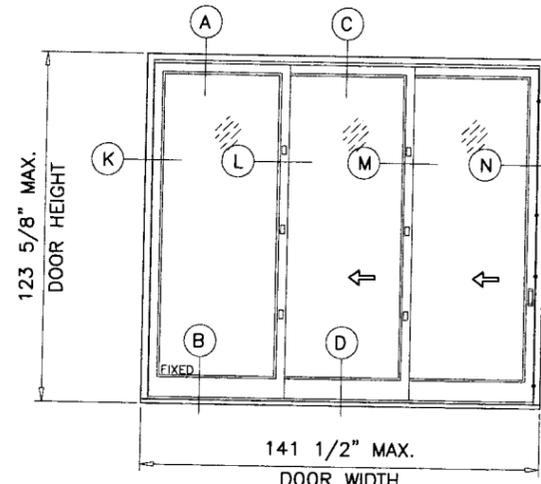


141 1/2" MAX. DOOR WIDTH

OXX

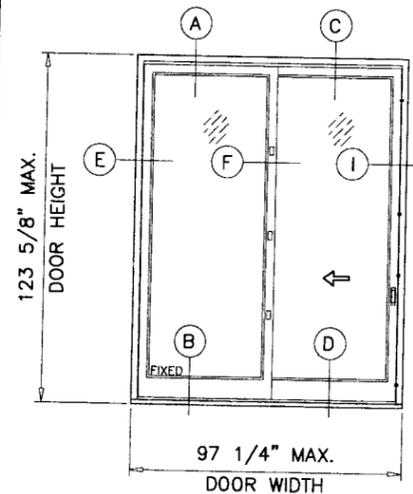

97 1/4" MAX. DOOR WIDTH

OX OR XO

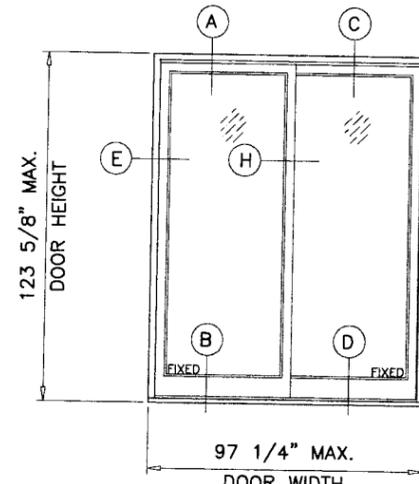

97 1/4" MAX. DOOR WIDTH

OO

APPROVED CONFIGURATIONS

DESIGN LOAD CAPACITY - PSF		
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	9/16" GLASS
		EXT.(+)/INT.(-)
24	84	60.0
30		60.0
36		60.0
42		60.0
47-1/2		50.0
24	90	60.0
30		60.0
36		60.0
42		60.0
47-1/2		50.0
24	96	60.0
30		60.0
36		60.0
42		50.0
47-1/2		50.0
24	102	60.0
30		60.0
36		60.0
42		50.0
47-1/2		50.0
24	108	60.0
30		60.0
36		60.0
42		50.0
47-1/2		50.0
24	114	50.0
30		50.0
36		50.0
42		50.0
47-1/2		50.0
24	120	50.0
30		50.0
36		50.0
42		50.0
47-1/2		50.0
24	123-5/8"	50.0
30		50.0
36		50.0
42		50.0
47-1/2		50.0

GLASS CAPACITIES ON THIS CHART ARE BASED ON ASTM E1300-98 (60 SEC. WIND)

DESIGN LOAD CAPACITY - PSF		
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	9/16" GLASS
		EXT.(+)/INT.(-)
24	84	60.0
30		60.0
36		60.0
42		60.0
47-1/2		50.0
24	90	60.0
30		60.0
36		60.0
42		60.0
47-1/2		50.0
24	96	60.0
30		60.0
36		57.0
42		50.0
47-1/2		48.7
24	102	60.0
30		54.6
36		48.3
42		45.2
47-1/2		42.0
24	108	56.4
30		43.0
36		41.0
42		39.1
47-1/2		36.4
24	114	49.3
30		38.4
36		37.5
42		33.9
47-1/2		31.9
24	120	43.1
30		33.6
36		33.6
42		29.3
47-1/2		28.0
24	123-5/8"	40.0
30		32.5
36		32.1
42		27.0
47-1/2		25.9

GLASS CAPACITIES ON THIS CHART ARE BASED ON ASTM E1300-02 (3 SEC. GUSTS) WITH REDUCTIONS FOR FLEXIBLE SUPPORTS TO COMPLY WITH SECTION 2403.2 OF FBC 2004 EDITION.

PRODUCT RENEWED as complying with the Florida Building Code
 Acceptance No. 06-0919-06
 Expiration Date SEP 28, 2007
 By [Signature] L. Lhanda
 Miami Dade Product Control Division



Engr: DR. HUMAYOON FAROOQ
 STRUCTURES
 FLA. PE # 10557
 C.A.N. 3538
 AUG 31 2006

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W97-33ZI-NEW

H7025 MAHOGANY WOOD SLIDING GLASS DOOR (L.M.I.)
ZELUCK INCORPORATED
 5300 KINGS HIGHWAY
 BROOKLYN, N.Y. 11234-9011
 TEL. (718) 251-8060 FAX. (718) 531-2564

revisions:	no	date	by	description

date: 10-27-97
 scale: 3/8"=1'-0"
 dr. by: HAMID
 chk. by:
 drawing no. W97-33
 sheet 2 of 7

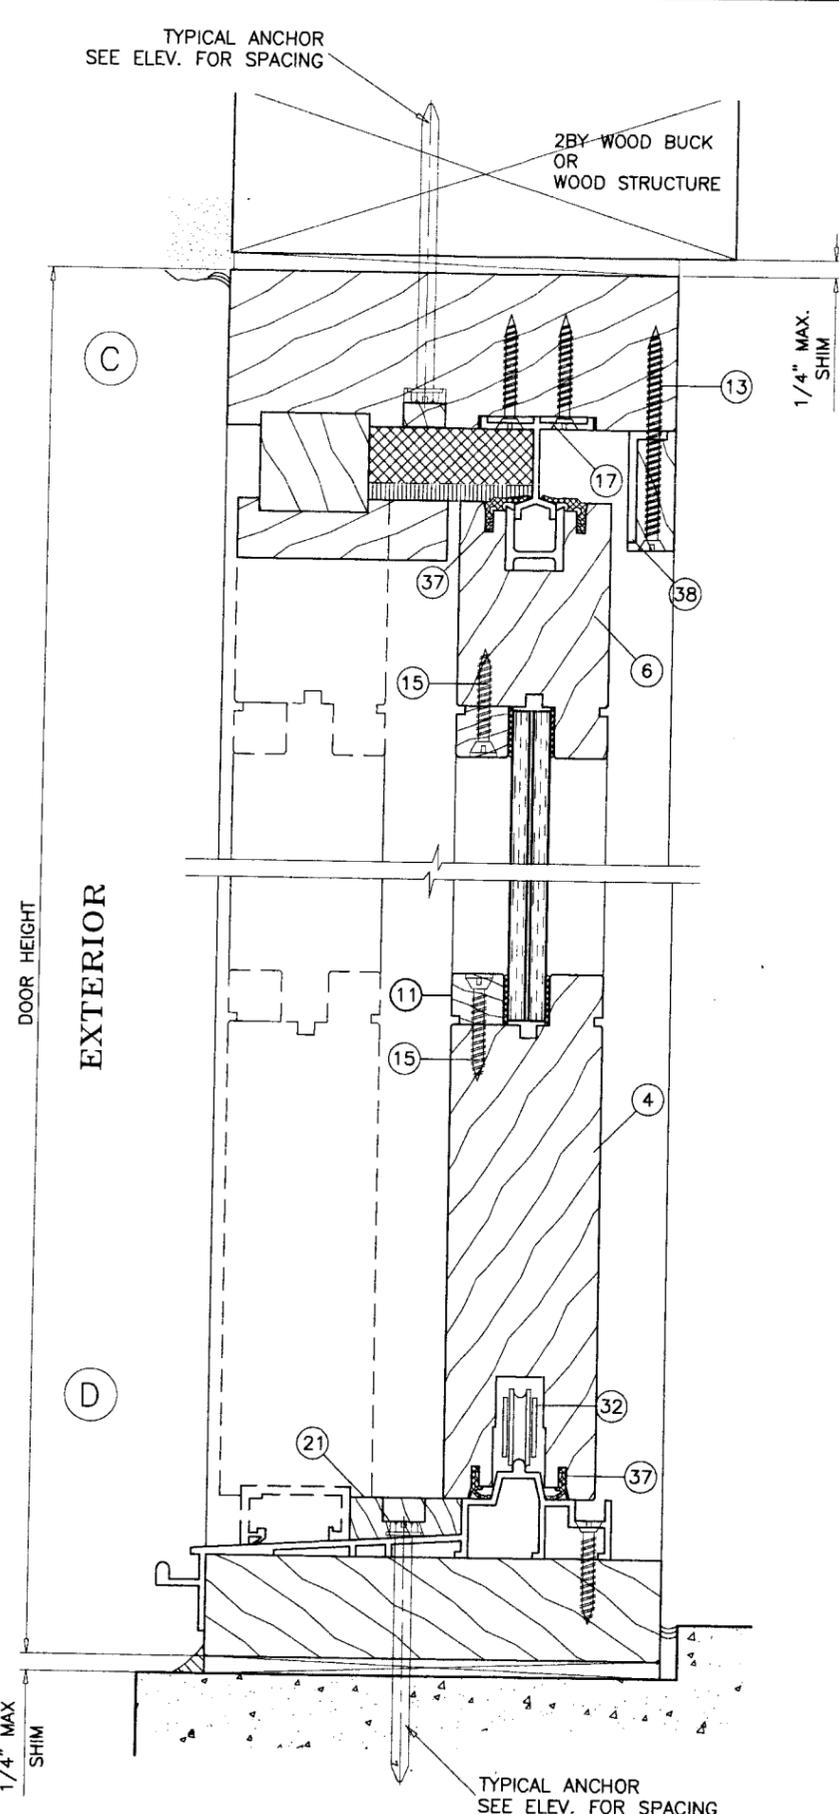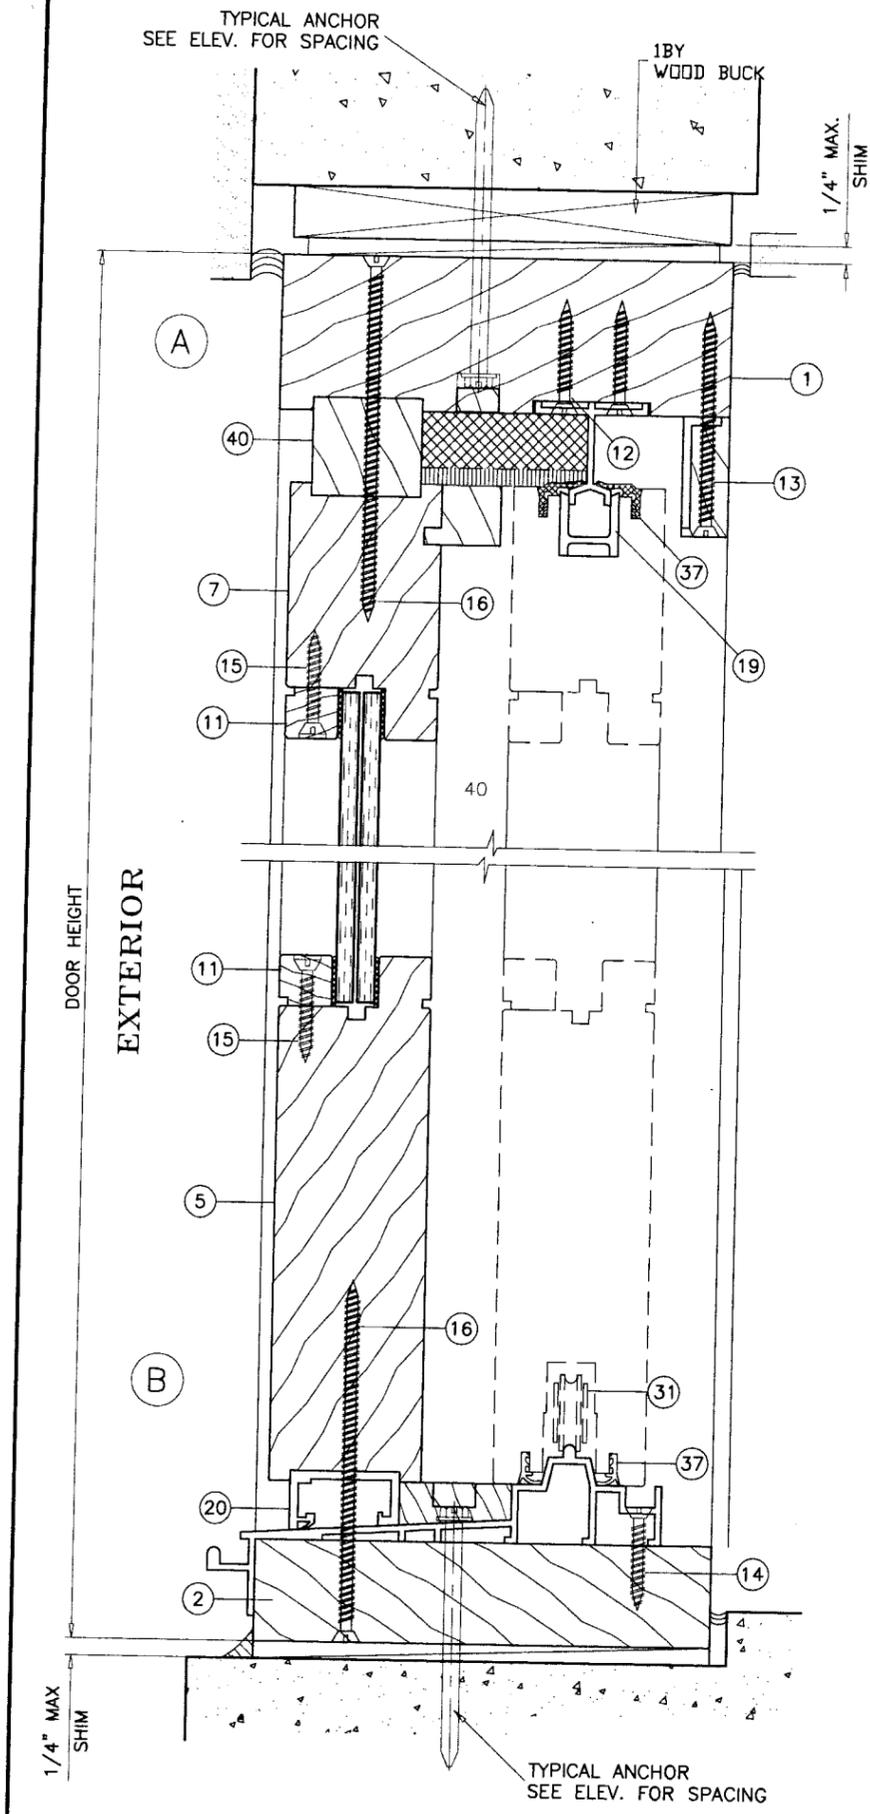

WOOD BUCKS NOT BY ZELUCK INC.
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

3/8" LAG SCREWS

INTO WOOD STRUCTURES
2" MIN. PENETRATION INTO WOOD

1/4" TAPCONS

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/2" MIN. EMBED INTO CONC. OR MASONRY

DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2" MIN.
INTO WOOD STRUCTURE = 1-1/2" MIN.

SEALANT:

FRAME CORNERS, TOP AND BOTTOM RAILS OF FIXED PANELS
INTERIOR & EXTERIOR THRESHOLD, SILL SPACER UNDER FIXED
PANELS AND INTERIOR AND EXTERIOR OF GLAZING TO BE SEALED
WITH SILICONE SEALANT.

4 POINT LOCKING SYSTEM @ 9/0 DOORS

METAL KEEPERS AND SLIDE LOCKS AT
(8", 47", 65-1/2" AND 94" FROM BOTTOM)

4 POINT LOCKING SYSTEM @ 10/4 DOORS

METAL KEEPERS AND SLIDE LOCKS AT
(8", 47", 71-1/2" AND 111-1/4" FROM BOTTOM)

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No *06-0919.06*
Expiration Date *SEP 28, 2007*
By *Shag I. Chande*
Miami Dade Product Control
Division

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

[Signature]

AUG 31 2006

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W97-33ZI-NEW

H7025 MAHOGANY WOOD SLIDING GLASS DOOR (L.M.I.)

ZELUCK INCORPORATED
5300 KINGS HIGHWAY
BROOKLYN, N.Y. 11234-9011
TEL. (718) 251-8060 FAX. (718) 531-2564


no.	date	by	description

revisions: E 08.07.06 UPDATED FOR 2004 FBC


date: 10-27-97	scale: 3/8" = 1"	dr. by: HAMID	chk. by:
----------------	------------------	---------------	----------

drawing no. **W97-33**


sheet 3 of 7

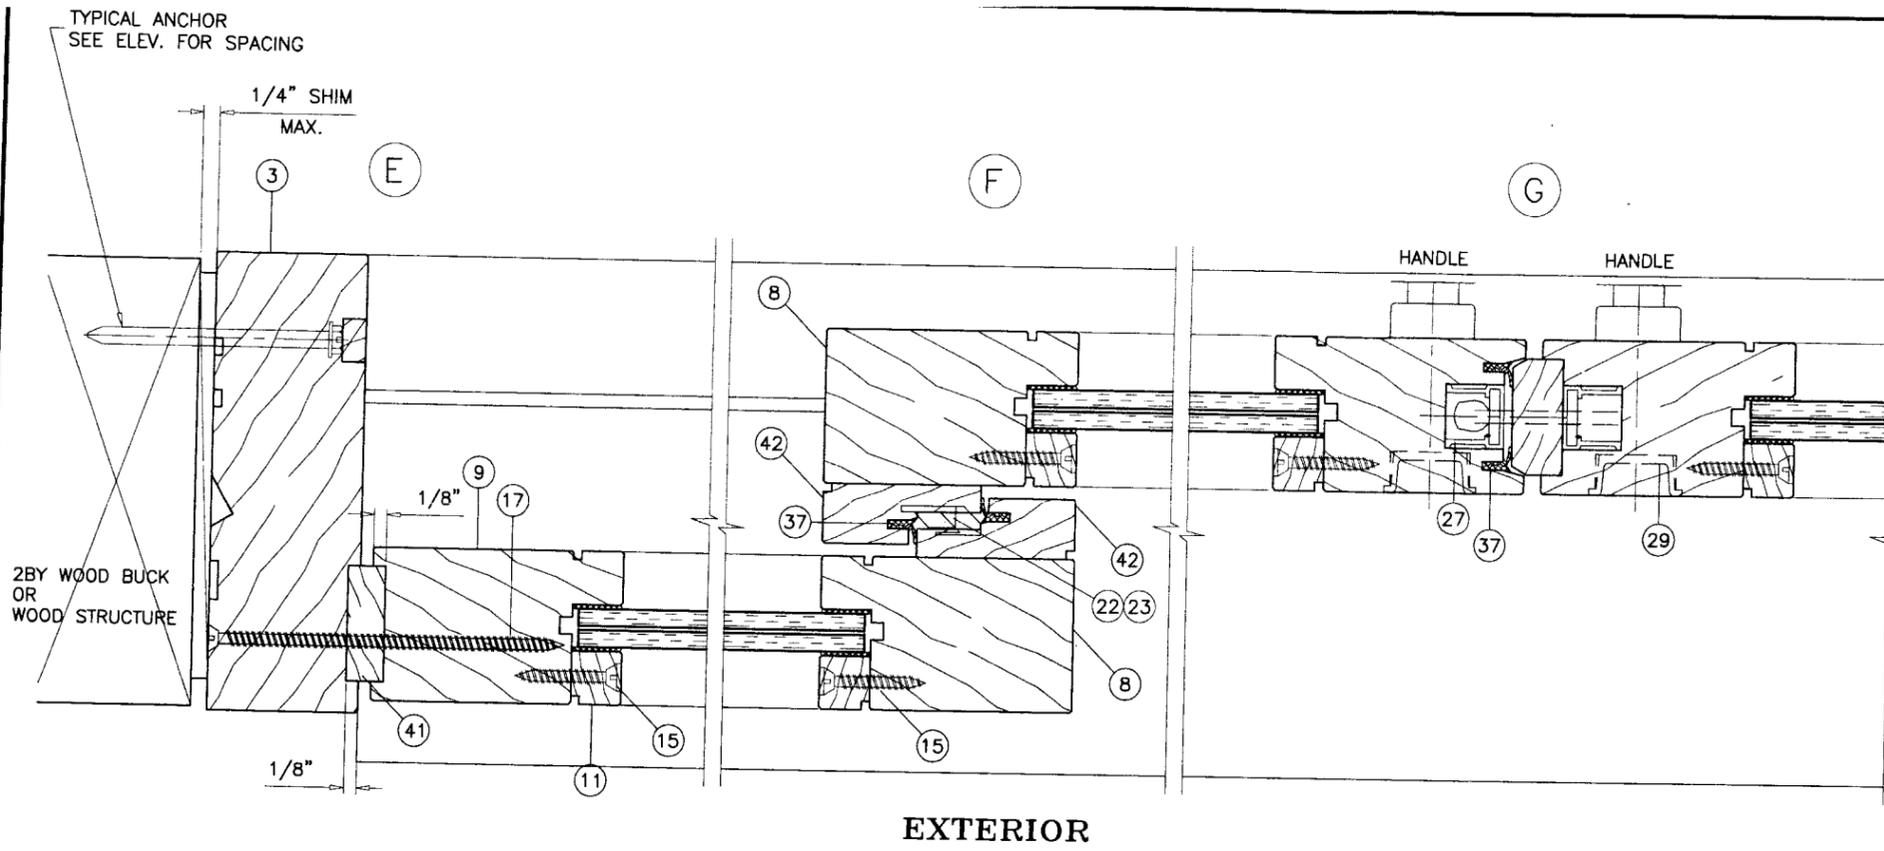

EXTERIOR

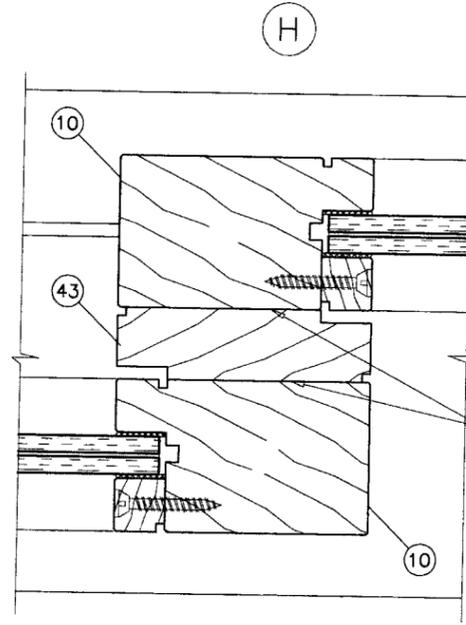

PHENYL RESORCINOL WATER PROOF ADHESIVE

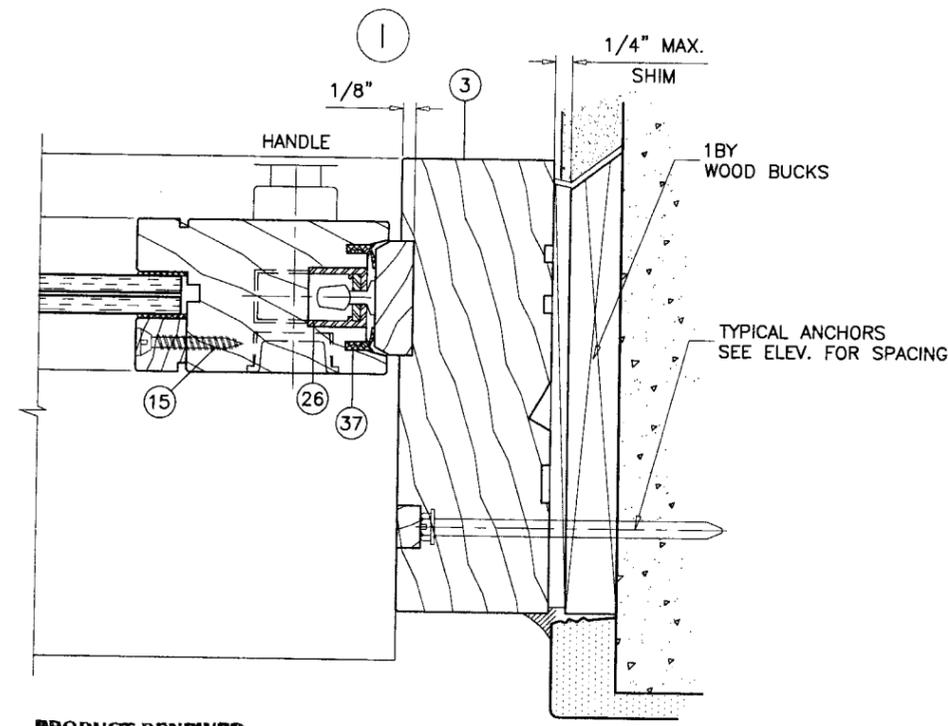

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No 06-0919.06
 Expiration Date SEP 28, 2007
 By Iskay I. Chaudhry
 Release Date Product Control
 Division

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538
 AUG 31 2006

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978

H7025 MAHOGANY WOOD SLIDING GLASS DOOR (L.M.I.)
ZELUCK INCORPORATED
 5300 KINGS HIGHWAY
 BROOKLYN, N.Y. 11234-9011
 TEL. (718) 251-8060 FAX. (718) 531-2564

revisions:	
no.	date by description
E	08.07.06

date: 10-27-97
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W97-33

sheet 4 of 7

COMP-ANL\W97-33ZI-NEW

afc

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W97-33ZI-NEW


H7025 MAHOGANY WOOD SLIDING GLASS DOOR (L.M.I.)
ZELUCK INCORPORATED
 5300 KINGS HIGHWAY
 BROOKLYN, N.Y. 11234-9011
 TEL. (718) 251-8060 FAX. (718) 531-2564

revisions:	
no.	date by description

date: 10-27-97	scale: 3/8" = 1"	dr. by: HAMID	chk. by:
----------------	------------------	---------------	----------

drawing no.
W97-33


sheet 5 of 7

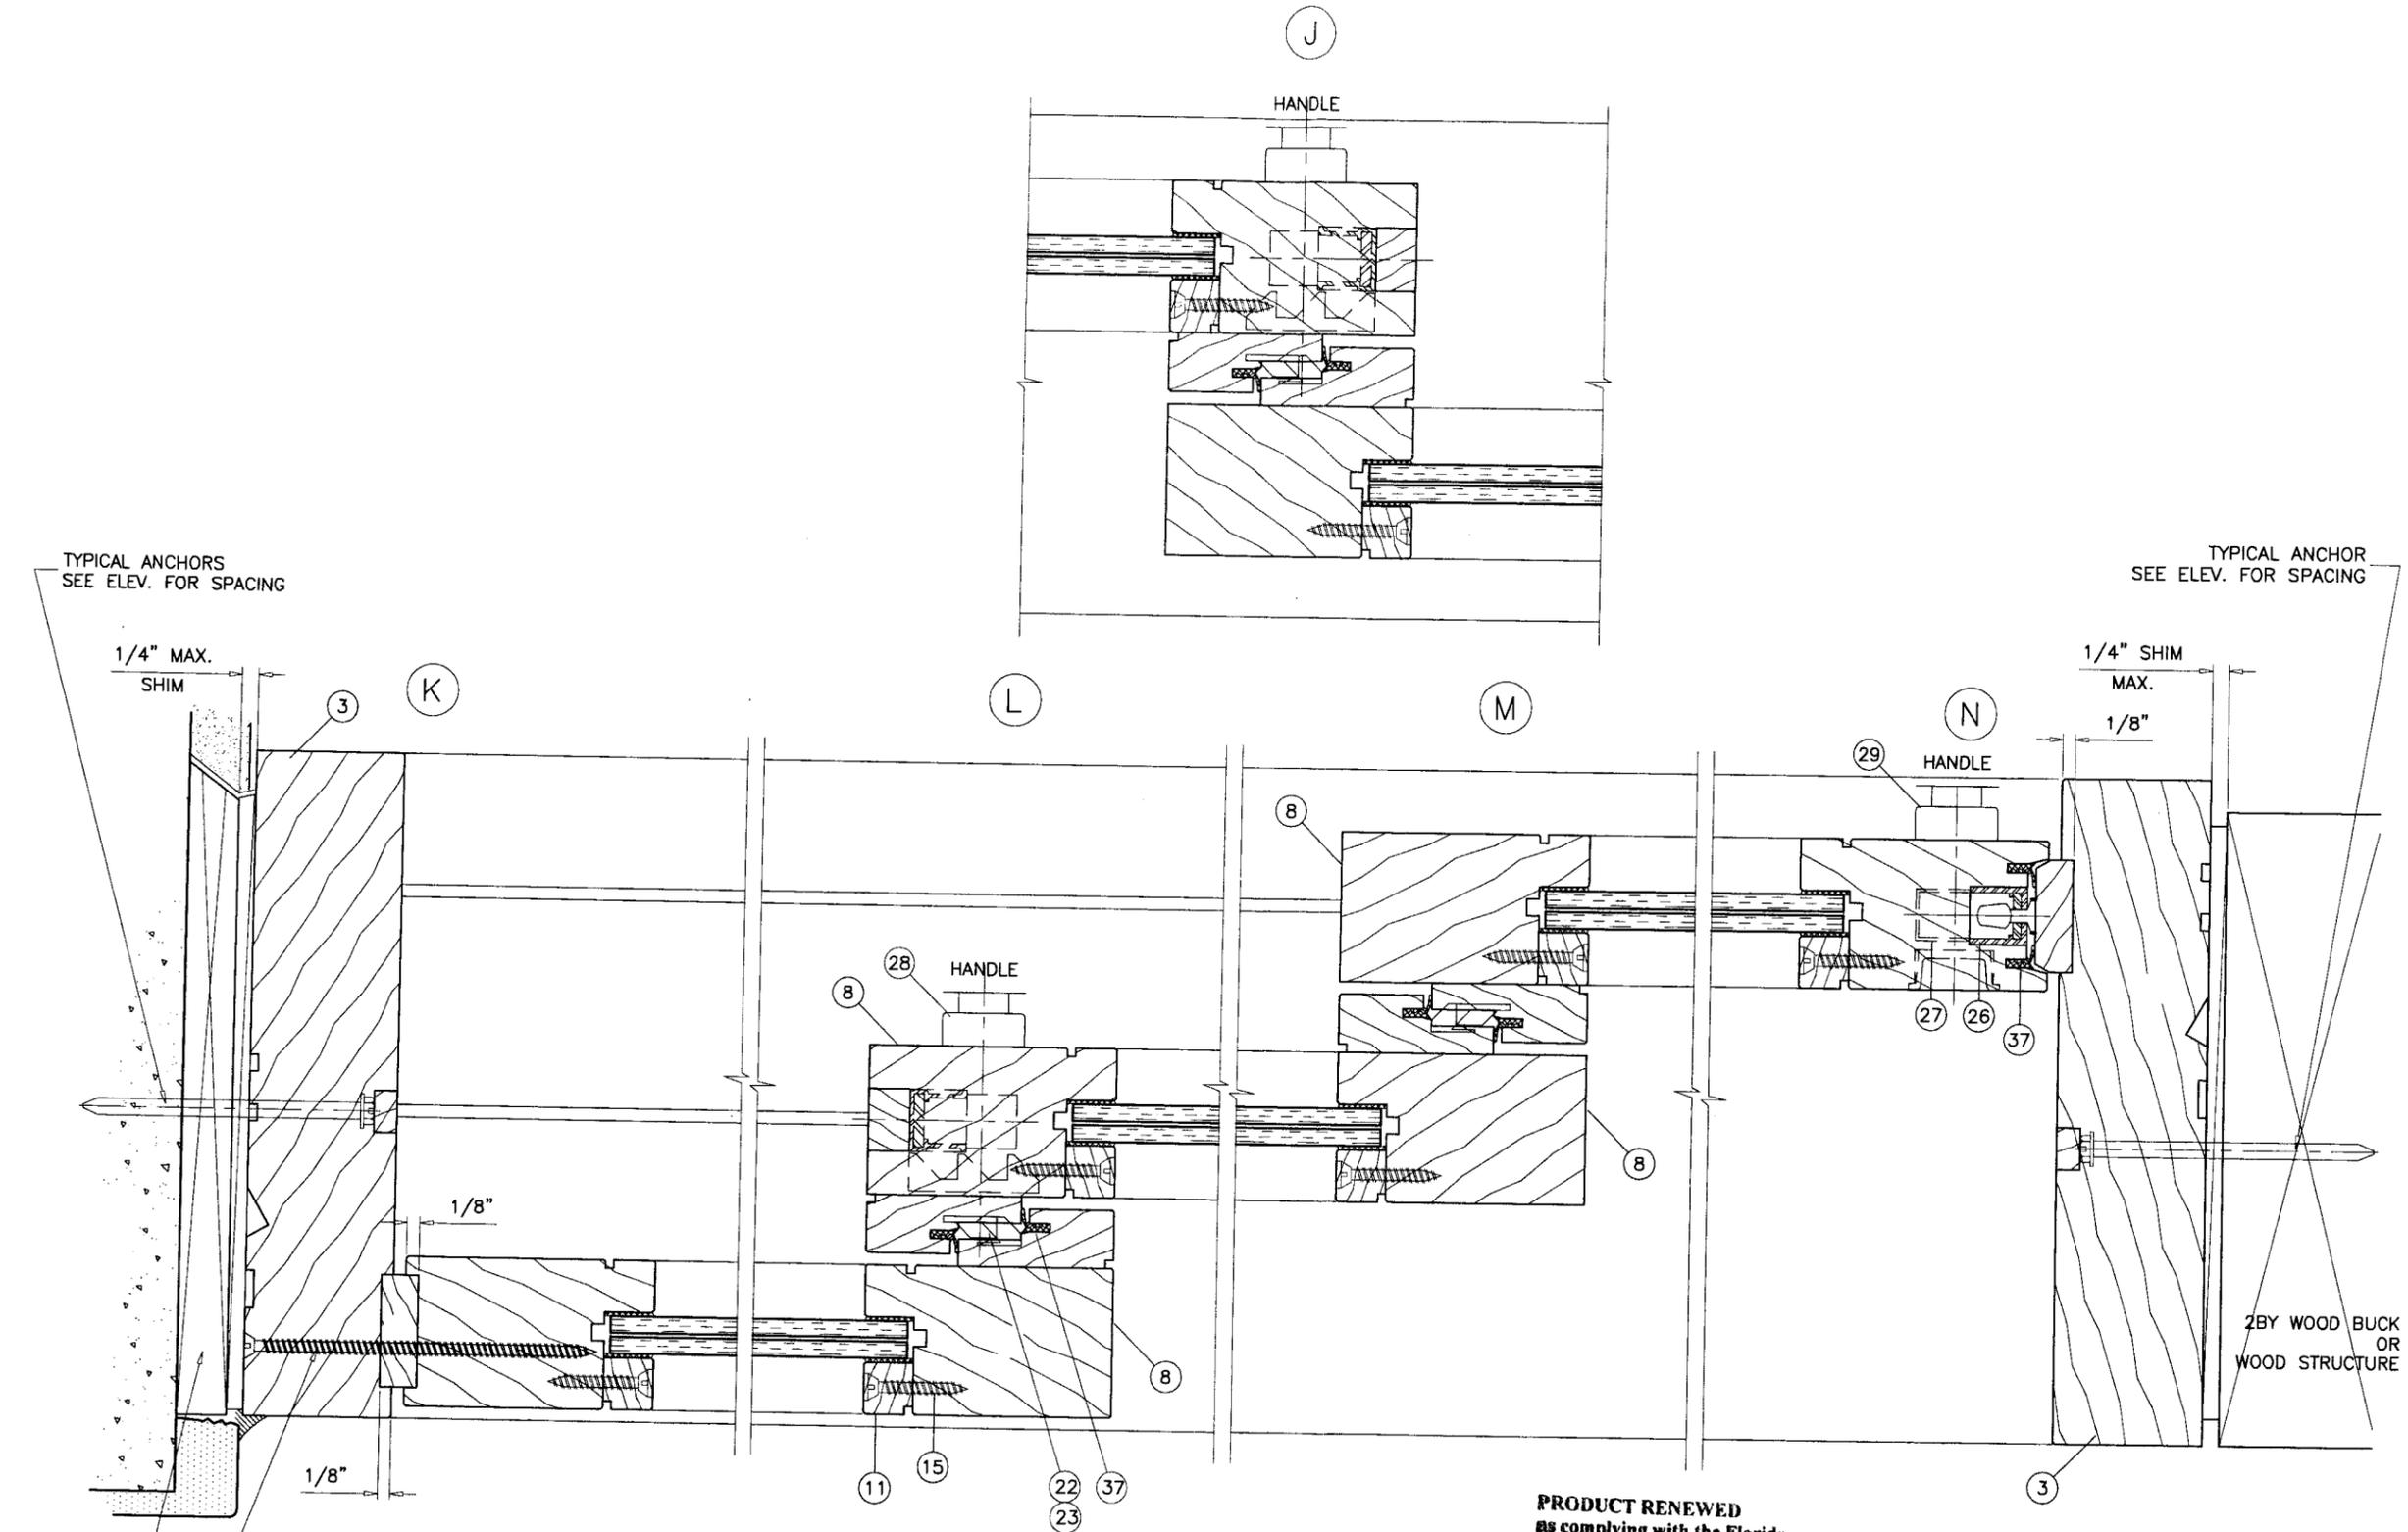


EXTERIOR

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 06-0919-06
 Expiration Date SEP 28, 2007
 By V. S. Chanda
 District Code Product Control
 Division


Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538
 AUG 31 2006

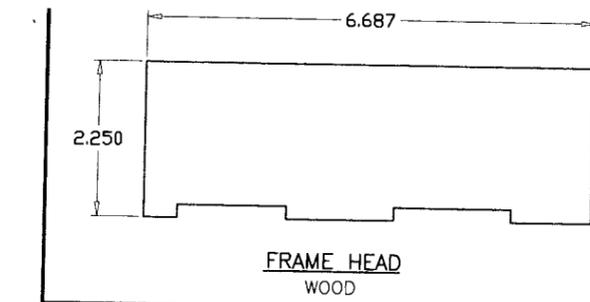


FRAME HEAD
WOOD

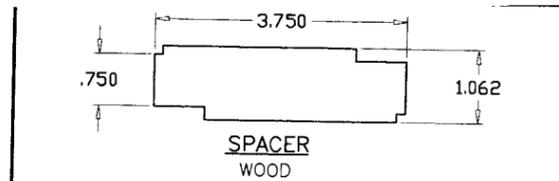


SPACER
WOOD

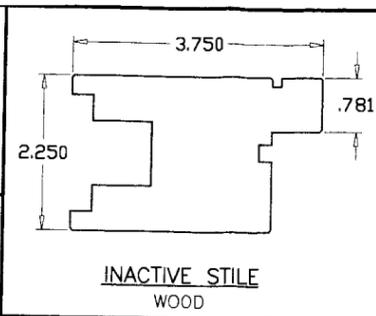


INACTIVE STILE
WOOD

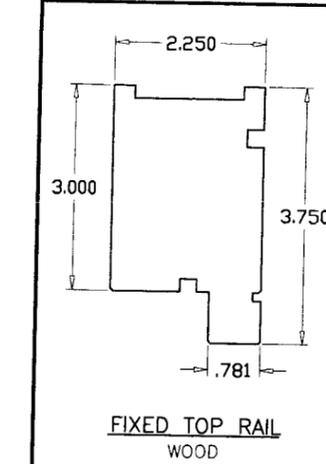


FIXED TOP RAIL
WOOD

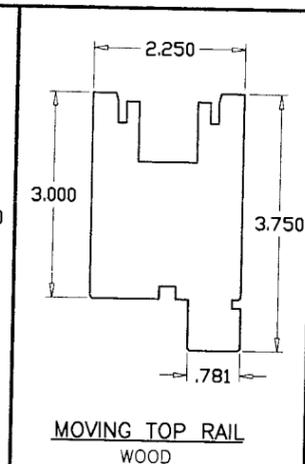


MOVING TOP RAIL
WOOD

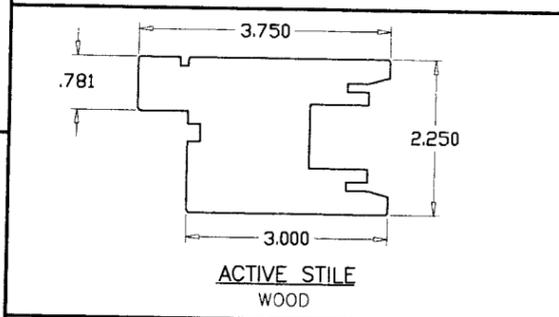


ACTIVE STILE
WOOD

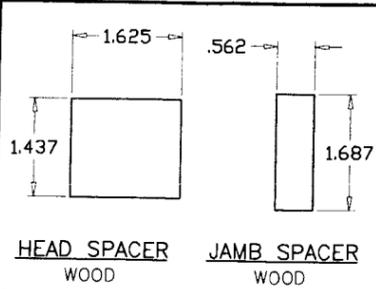


HEAD SPACER WOOD JAMB SPACER WOOD

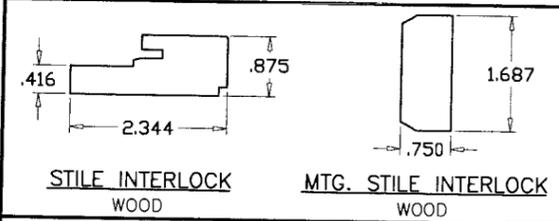


STILE INTERLOCK WOOD MTG. STILE INTERLOCK WOOD

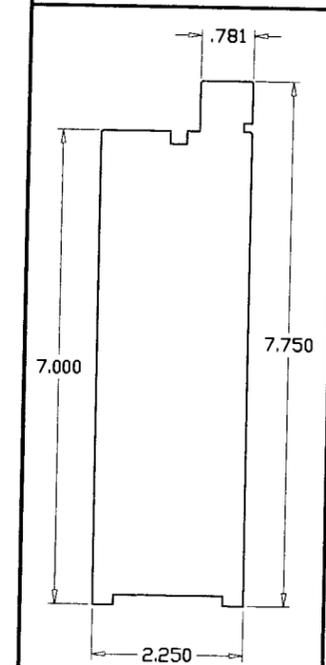


FIXED BOTTOM RAIL
WOOD

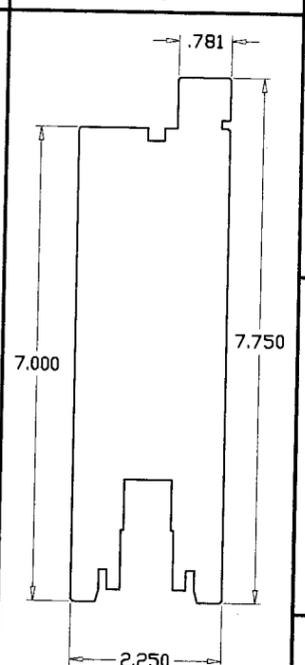


MOVING BOTTOM RAIL
WOOD

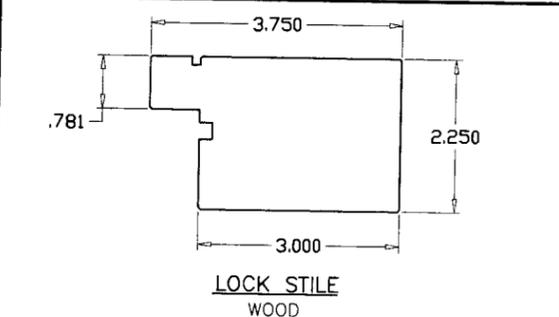


LOCK STILE
WOOD

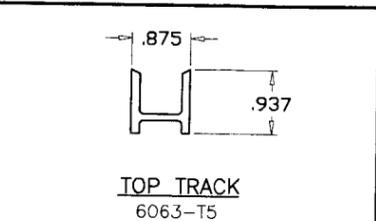


TOP TRACK
6063-T5

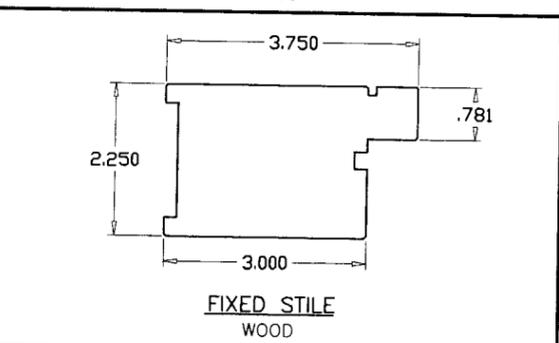


FIXED STILE
WOOD

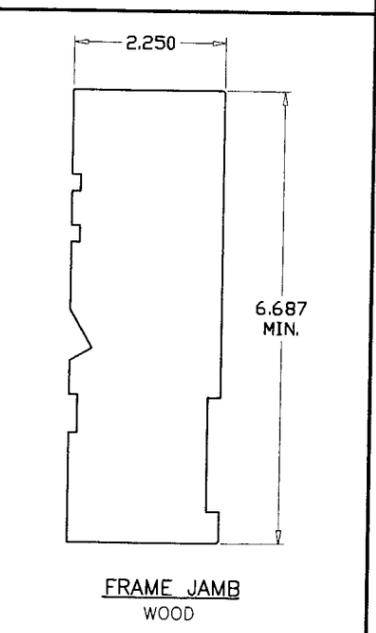


FRAME JAMB
WOOD

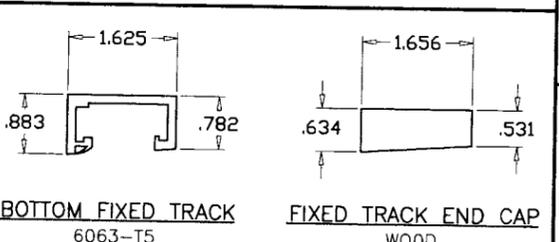


BOTTOM FIXED TRACK 6063-T5 FIXED TRACK END CAP WOOD

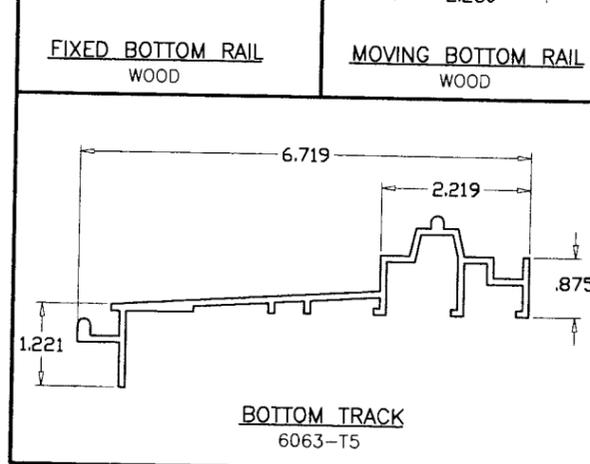

BOTTOM TRACK
6063-T5

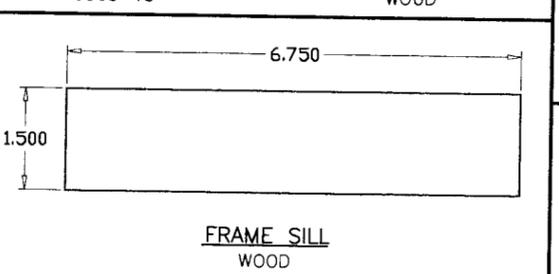

FRAME SILL
WOOD

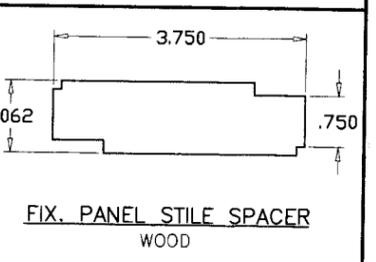

FIX. PANEL STILE SPACER
WOOD

MATERIALS LIST			
ITEM NO.	QTY.	DESCRIPTION	REMARKS
1	1	WOOD FRAME HEAD	
2	1	WOOD FRAME SILL	
3	2	WOOD FRAME JAMB	
4	-	WOOD MOVING HORIZ. BOTT. RAIL	(1) @ BOTT. OF EA. MOVING PANEL
5	-	WOOD FIXED HORIZ. BOTT. RAIL	(1) @ BOTT. OF EA. FIXED PANEL
6	-	WOOD TOP MOVING RAIL	(1) @ TOP OF EA. MOVING PANEL
7	-	WOOD TOP FIXED RAIL	(1) @ TOP OF EA. FIXED PANEL
8	-	WOOD LOCK STILE	(1) @ EA. MOVING PANEL
9	-	WOOD FIXED STILE	(1) @ EA. FIXED PANEL
10	-	WOOD FIXED INTERLOCK	(1) @ EA. FIXED PANEL
11	AS REQ'D	WOOD GLAZING BEAD	2 @ EA. VERT & HOR. STILE
12	-	# 8 X 1-1/4" SST. SCREWS	@ 8" O.C.
13	-	# 8 X 2-1/2" DRYWALL SCREWS	@ 18" O.C.
14	-	# 8 X 1-1/2" SST. SCREWS	@ 12" O.C.
15	-	# 8 X 1-1/2" WOOD SCREWS	@ 10" O.C.
16	-	# 8 X 4" DRYWALL SCREWS	@ 6" O.C.
17	-	# 8 X 4" DRYWALL SCREWS	@ 12" O.C.
18	1	ALUMINUM BOTTOM TRACK	6063-T5, AGB #727.173.602
19	1	ALUMINUM TOP TRACK	6063-T5, AGB #727.270.601
20	2	BOTTOM FIXED TRACK	6063-T5, AGB #727.370.300
21	2	BOTTOM FIXED TRACK END CAP	NEOPRENE, AGB #727.120.31
22	2	BOOTOM INTERLOCK SEAL	NEOPRENE, AGB #727.120.22.56
23	2	TOP INTEERLOCK SEAL	NEOPRENE, AGB #727.120.30.56
24	AS REQ'D	BOTTOM FRAME FASRENERS, ST'L	ZINC CHRMT'D, AGB #727.120.027
25	AS REQ'D	TOP FRAME FASTENERS, ST'L	ZINC CHRMT'D, AGB #727.120.023
26	2	DOOR STOP	NEOPRENE, AGB #727.120.13
27	2	DOOR LOCKING GEAR, ST'L	ZINC CHRMT'D, AGB #727.120.02
28	4	SECONDARY DOOR LCK'G BOLTS	ZINC CHRMT'D, AGB #727.120.13
29	2	ALUM. DOOR HANDLE & PULL	AGB #744.02.02
30	AS REQ'D	MIDDLE LOCK, ST'L	ZINC CHRMT'D, AGB #727.120.014
31	2	FRONT ROLLER, ST'L/DELTRIN	ZINC CHRMT'D, AGB #727.250
32	2	REAR ROLLER, ST'L/DELTRIN	ZINC CHRMT'D, AGB #727.251
33	2	CONNECTING BAR, ST'L/DELTRIN	ZINC CHRMT'D, AGB #727.120.150
34	2	REAR BOTTOM DOOR COVER	NEOPRENE, AGB #727.120.32
35	2	REAR TOP DOOR COVER	NEOPRENE, AGB #727.120.09
36	2	FRONT TOP DOOR COVER	NEOPRENE, AGB #727.120.04
37	16	DOOR WEATHERSTRIPPING	NEOPRENE, AGB #727.2.200
38	2	ALUMINUM ANGLE @ FRAME HEAD	6063-T5, HADCO #12x125
39	2	DOOR GEAR EXTENSION	ZINC CHRMT'D, AGB #727.500.02
40	AS REQD.	WOOD SPACER AT FIXED PANEL HEAD	-
41	AS REQD.	WOOD SPACER AT FIXED PANEL JAMB	-
42	AS REQD.	WOOD STILE INTERLOCK	-
43	AS REQD.	WOOD SPACER FIX. PANEL STILE	-

TYPICAL WOOD-HONDURES MAHOGANY LUMBER

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 06-0919-06
Expiration Date SEP 28, 2007
By: *Shah J. Chugh*
Honduras Product Control
Division

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

AUG 31 2006

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W97-33ZI-NEW

H7025 MAHOGANY WOOD SLIDING GLASS DOOR (L.M.I.)
ZELUCK INCORPORATED
5300 KINGS HIGHWAY
BROOKLYN, N.Y. 11234-9011
TEL. (718) 251-8060 FAX. (718) 531-2564


revisions:
no date by description

date: 10-27-97
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W97-33



sheet 6 of 7

E 08.07.06 UPDATED FOR 2004 FBC

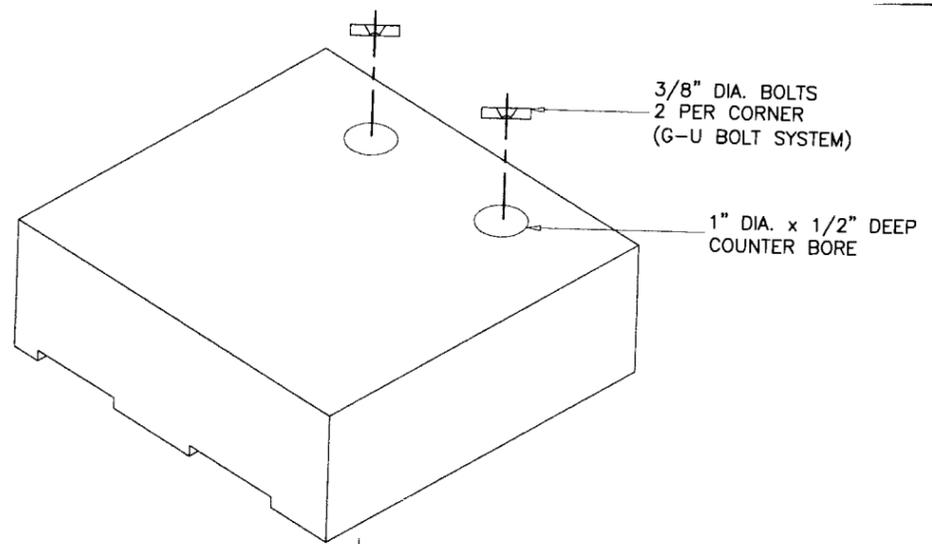


FRAME TOP CORNER

FRAME CORNERS SEALED
WITH 'SIKAFLEX 1A' SEALANT

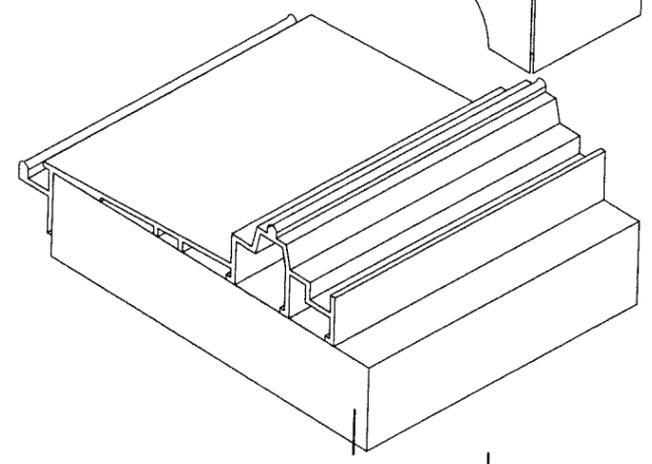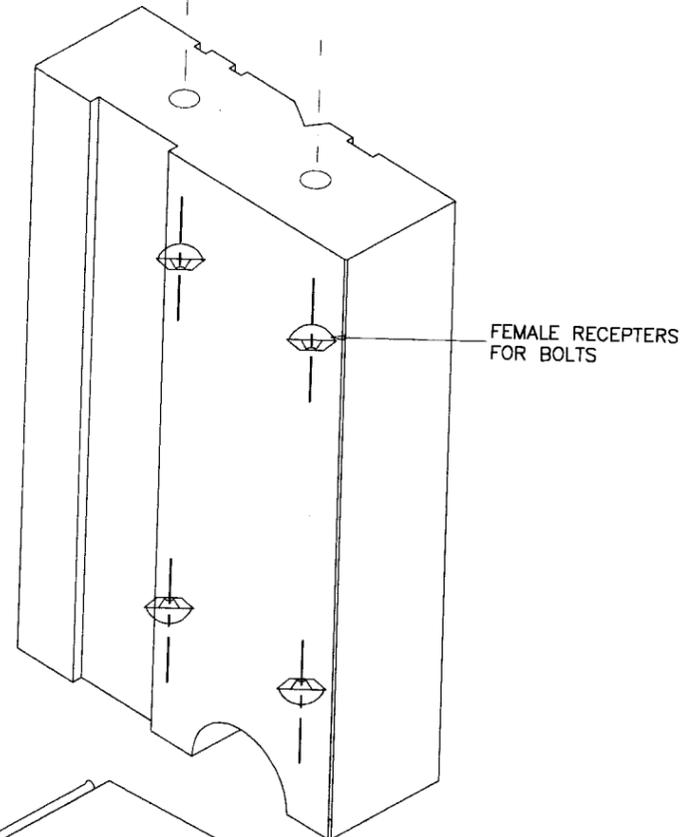


FRAME BOTTOM CORNER

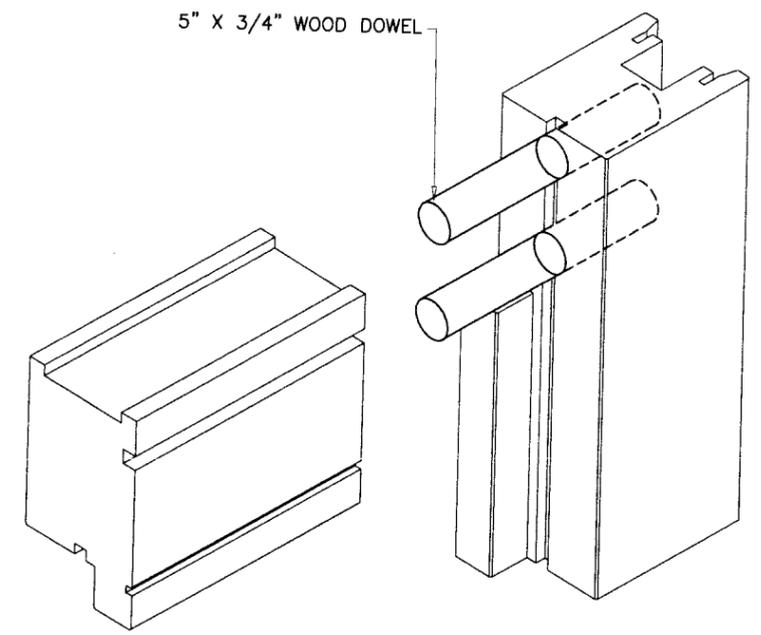

PANEL TOP CORNER

PANEL CORNERS & DOWELS SEALED/GLUED WITH
'PHENYL RESORCINOL' WATER PROOF ADHESIVE

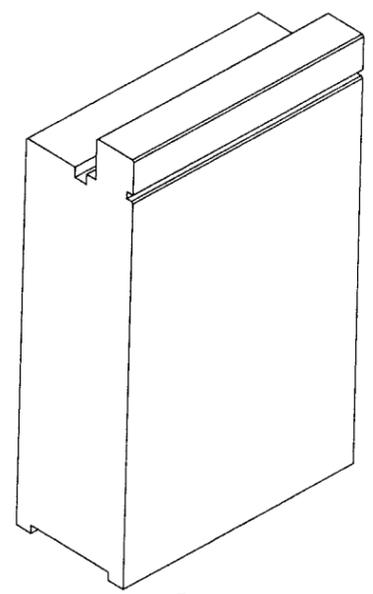

PANEL BOTTOM CORNER

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 06-0919-06
Expiration Date SEP 28, 2007
By Iskay I. Chanda
Miami Code Product Control
Division

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

[Signature]

AUG 31 2006

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

H7025 MAHOGANY WOOD SLIDING GLASS DOOR (L.M.I.)
ZELUCK INCORPORATED
5300 KINGS HIGHWAY
BROOKLYN, N.Y. 11234-9011
TEL. (718) 251-8060 FAX. (718) 531-2564

no.	date	description

revisions:

DATE: 08.07.06
E 08.07.06
UPDATED FOR 2004 FEC

date: 10-27-97
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W97-33
sheet 7 of 7

COMP-ANL\W97-33ZI-NEW