



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**NOTICE OF ACCEPTANCE (NOA)**

Tischler Und Sohn (USA) Ltd.  
Six Suburban Avenue  
Stamford, Ct. 06901

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "Bi-Part" Mahogany Wood Sliding Glass Pocket Doors**

**APPROVAL DOCUMENT:** Drawing No **TS-16**, titled "Bi-Part Mahogany Lift & Rolling Pocket Door " Sheets 1 through 8 of 8, dated 08-01-2000 and revised on 11-24-2006, prepared by manufacturer, signed and sealed by Vipin N. Tolat, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews # 01-0105.01** consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**

**NOA No 06-1004.05**  
**Expiration Date: January 17, 2012**  
**Approval Date: December 21, 2006**  
**Page 1**



11/29/06

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

- A. DRAWINGS** (Transferred from file # **01-0105.01**)
1. Manufacturer's die drawings and sections.
  2. Drawing No **TS-16**, titled "Bi-Part Mahogany Lift & Rolling Pocket Door" Sheets 1 through 8 of 8, dated 08-01-2000 and revised on 11-24-2006, prepared by manufacturer, signed and sealed by Vipin N. Tolat, P.E.
- B. TESTS** (Transferred from file # **01-0105.01**) Note: original test conducted per SFBC, PA 201, 202 & 203-94, now known as TAS 201, 202 and 203-94
1. Test reports on
    - 1) Air Infiltration Test, per PA 202-94
    - 2) Uniform Load Static Air Pressure Test, per PA 202-94
    - 3) Water Resistance Test, per PA 202-94
    - 4) Large Missile Impact Test, SFBC PA 201-94
    - 5) Cyclic Loading Test, per SFBC PA 203-94
    - 6) Forced Entry Resistance Test, per SFBC3603.2 (b) 5.Along with installation diagram of sliding glass wood door marked-up by Construction Research Laboratory, Inc., Test Report No. **6633**, dated 11/30/00, signed and sealed by Nariman S. Balsara, P. E.
  2. Revised test report No. **6633** along w/ revised marked-up drawings, issued by Construction Research Laboratory, dated October 10, 2001, signed & sealed by Nariman S. Balsara, P. E.
- C. CALCULATIONS**
1. Anchor verification calculations complying w/ FBC 2004, dated 11-24-06, signed and sealed by Vipin N. Tolat, P.E.
  2. Anchor verification calculations and structural performance, prepared by Vipin N. Tolat, P. E. Consulting Engineer, dated 01-02-2001 and revised on 07-21-01, signed and sealed by Vipin N. Tolat, P.E. (# **01-0105.01**).
  3. **Glazing complies with ASTM E-1300-98 & 2002**
- D. QUALITY ASSURANCE**
1. Miami Dade Building Code Compliance Office (BCCO).
- E. MATERIAL CERTIFICATIONS**
1. Notice of Acceptance No. 06-0216.06, issued to Solutia Inc, for "Saflex IIIIG interlayer", expiring 05-21-11.
  2. Test report No. 00-010FST dated 06 March, 2000, issued by Construction testing Corp. for "BTI-Masonry" anchor, signed and sealed by Yamil Kuri, P. E.
- F. STATEMENTS** (Transferred from file # **01-0105.01**)
1. Statement letter "Product has not changed & Engineer still in business" dated 11-24-06, signed & sealed by Vipin N. Tolat, P.E.
  2. Statement letter of conformance & "No financial interest, both dated 11-24-06, signed & sealed by Vipin N. Tolat, P.E.
  3. Statement compliance letter as part of for test report CRL 6633 dated 11-30-2000, issued by Construction Research Laboratory, Inc., signed and sealed by Nariman S. Balsara, P.E.
  4. Notarized statement dated September 21, 2001 for the certification by Tischler Und Sohn, for identifying the glazing used with the tested unit, signed by Steve Albert.
- G. OTHER** None

*Ishaq I. Chanda*

Ishaq I. Chanda, P.E.

Product Control Examiner

NOA No 06-1004.05

Expiration Date: January 17, 2012

Approval Date: December 21, 2006

DESIGN PRESSURE POSITIVE	+ 54 PSF
DESIGN PRESSURE NEGATIVE	- 69 PSF


Glazing: Standard Bent Glass: 5/8" overall laminated glass  
 1/4" Heat Strengthened Glass  
 0.120 Saflex III PVB Interlayer By Solutia  
 1/4" Heat Strengthened Glass

**TISCHLER INC SOHN**  
 Tischler und Sohn (U.S.A.) Ltd.  
 Six Suburban Avenue  
 Stamford, CT 06901 USA  
 Tel.: 203/674-0600  
 Fax: 203/674-0601  
 E-mail: dtweid-tischler@worldnet.att.net

DADE COUNTY - FLORIDA  
 TESTING OF WOOD WINDOWS & DOORS  
 ELEVATION OF  
 BI-PART MAHOGANY LIFT AND ROLLING POCKET DOOR  
 Date: August 1, 2000 REV. 11/24/04 Sheet 1 of 8 Scale: 1/2" = 1'-0" (1:24)

Drawn by: K.M.  
 Division

Drawing No. TS-16

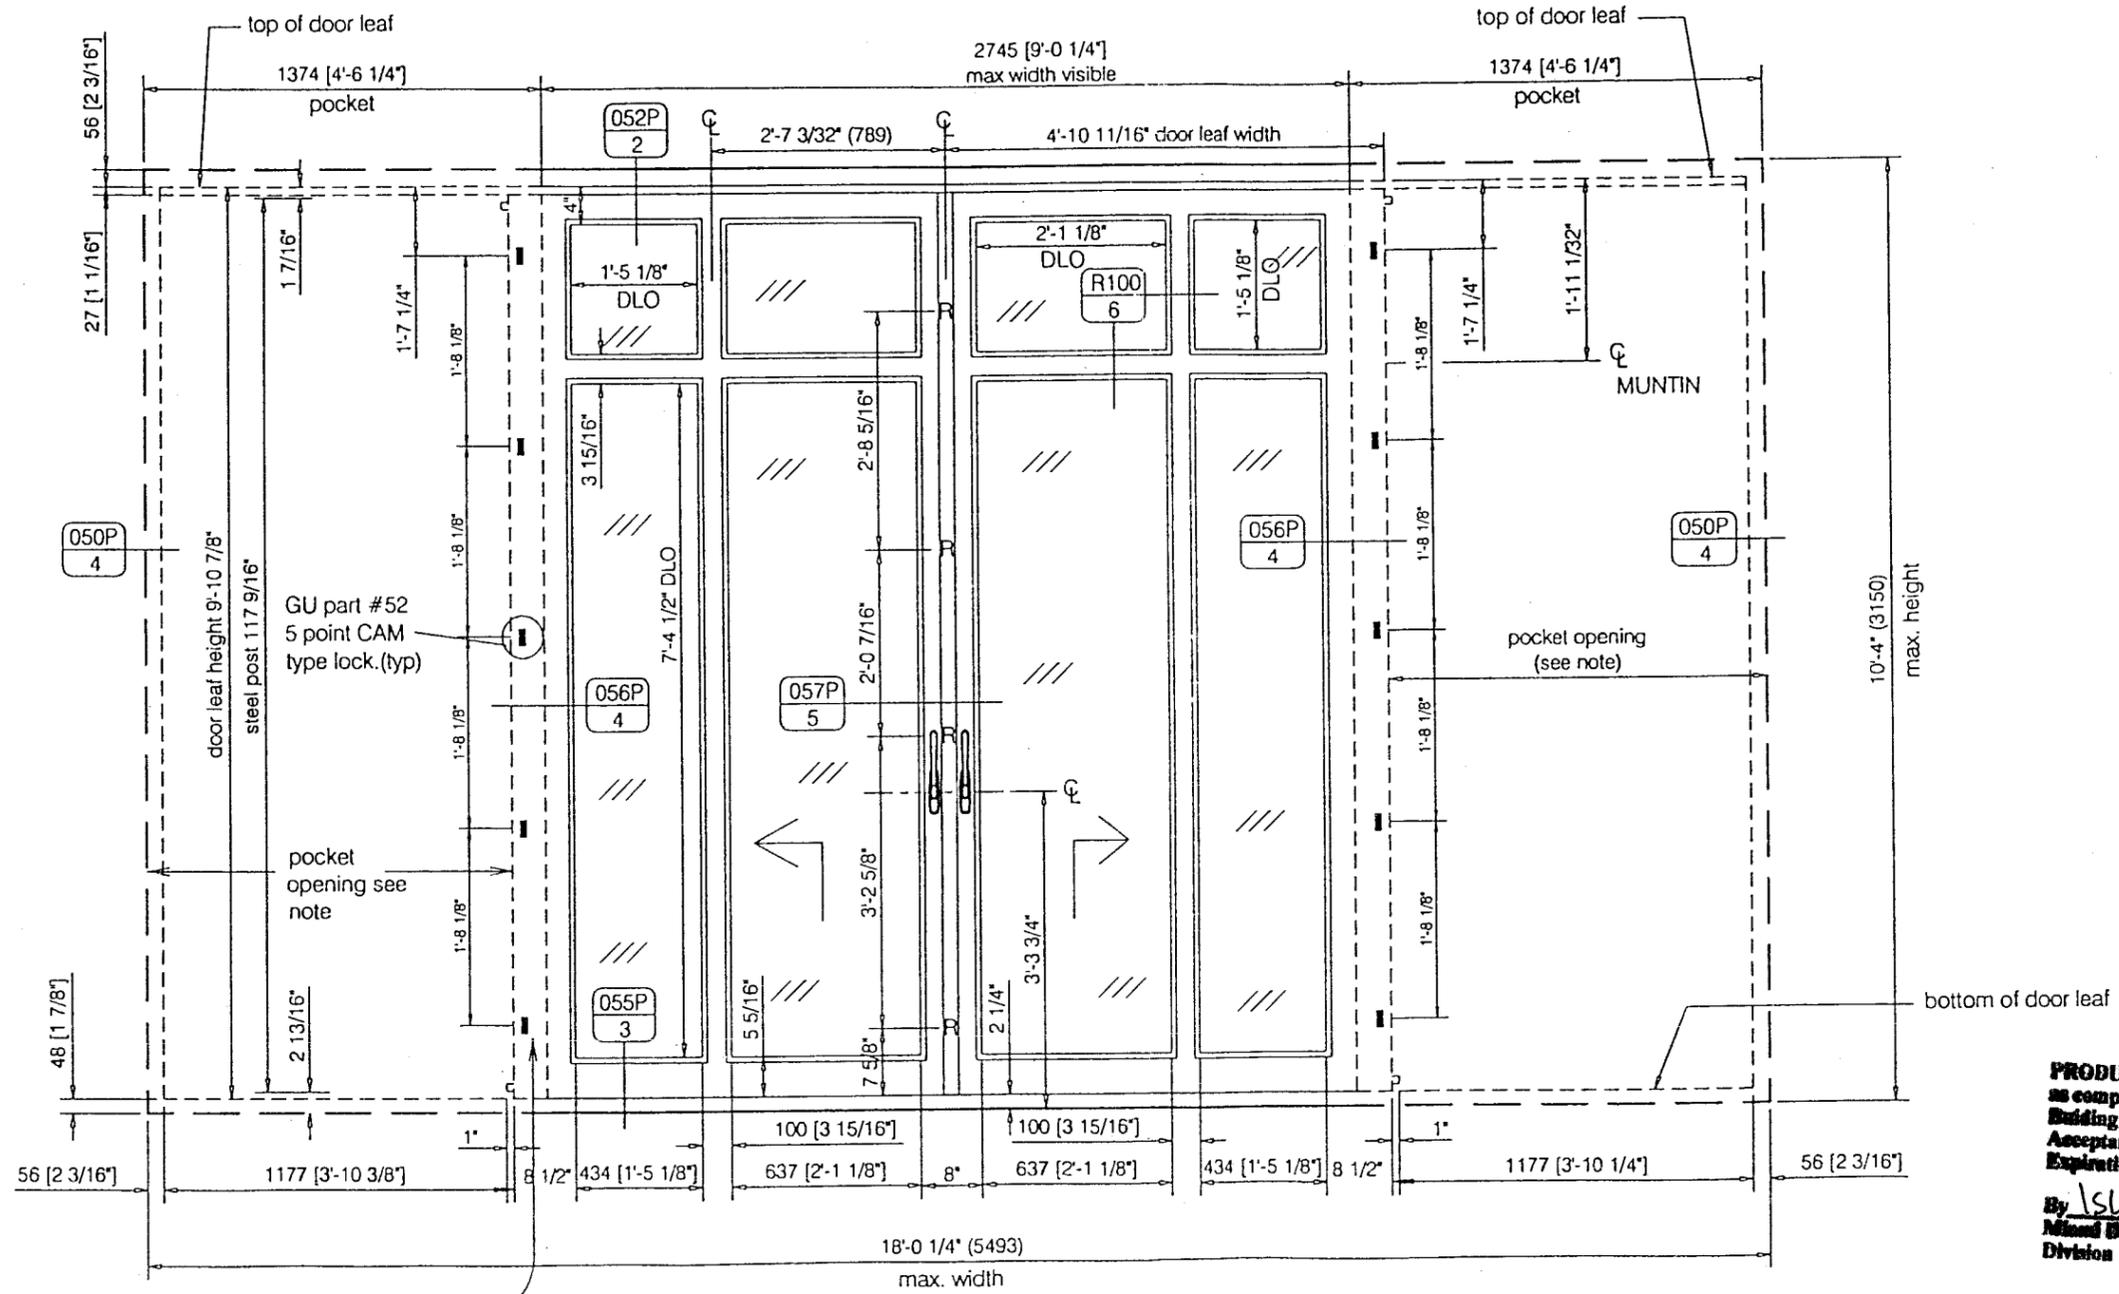

Steel post (2.36" x 2.36" x 0.157" x 117 9/16" long) for top & bottom of steel post see sheets 2 and 3.

INTERIOR ELEVATIONS  
 BI-PART MAHOGANY LIFT AND ROLLING POCKET DOOR

DLO=Day Light Opening

NOTE: Pocket Openings Shall Be Protected by Miami Dade County Approved Impact Resistant Wall Systems And Are Not Part Of This Framing And Are Not Part Of This Approval.

**PRODUCT RENEWED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. DC-1004-05  
 Expiration Date JAN 17, 2012  
 By Shag I. Chavira  
 Miami Dade Product Control  
 Division





Tischler und Sohn (U.S.A.) Ltd.  
 Six Suburban Avenue  
 Stamford, CT 06901 USA  
 Tel.: 203/674-0600  
 Fax: 203/674-0601  
 E-mail: dtw@tdt-tischler.com  
 @wordnet.attnet

DADE COUNTY - FLORIDA  
 TESTING OF WOOD WINDOWS & DOORS  
 SILL SECTION OF  
 BI-PART LIFT & ROLLING MAHOGANY POCKET DOOR

VIPIN N. TOLAT, P.E.  
 FL. REG. # 12847

*John Freese*  
 11/11/06


Date: August 1, 2000 revised: ~~11/24/05~~ Sheet 3 of 8 Scale: Full (1:1)

Drawn by: K.M

Drawing No. TS - 16

Nordsil silicone sealant

brass-nickel wood screws - 3.5 x 45mm  
 (lenticular head), located 50 mm [1 15/16"]  
 from each corner and 150 - 200 mm (6" - 8")  
 distance between screws.

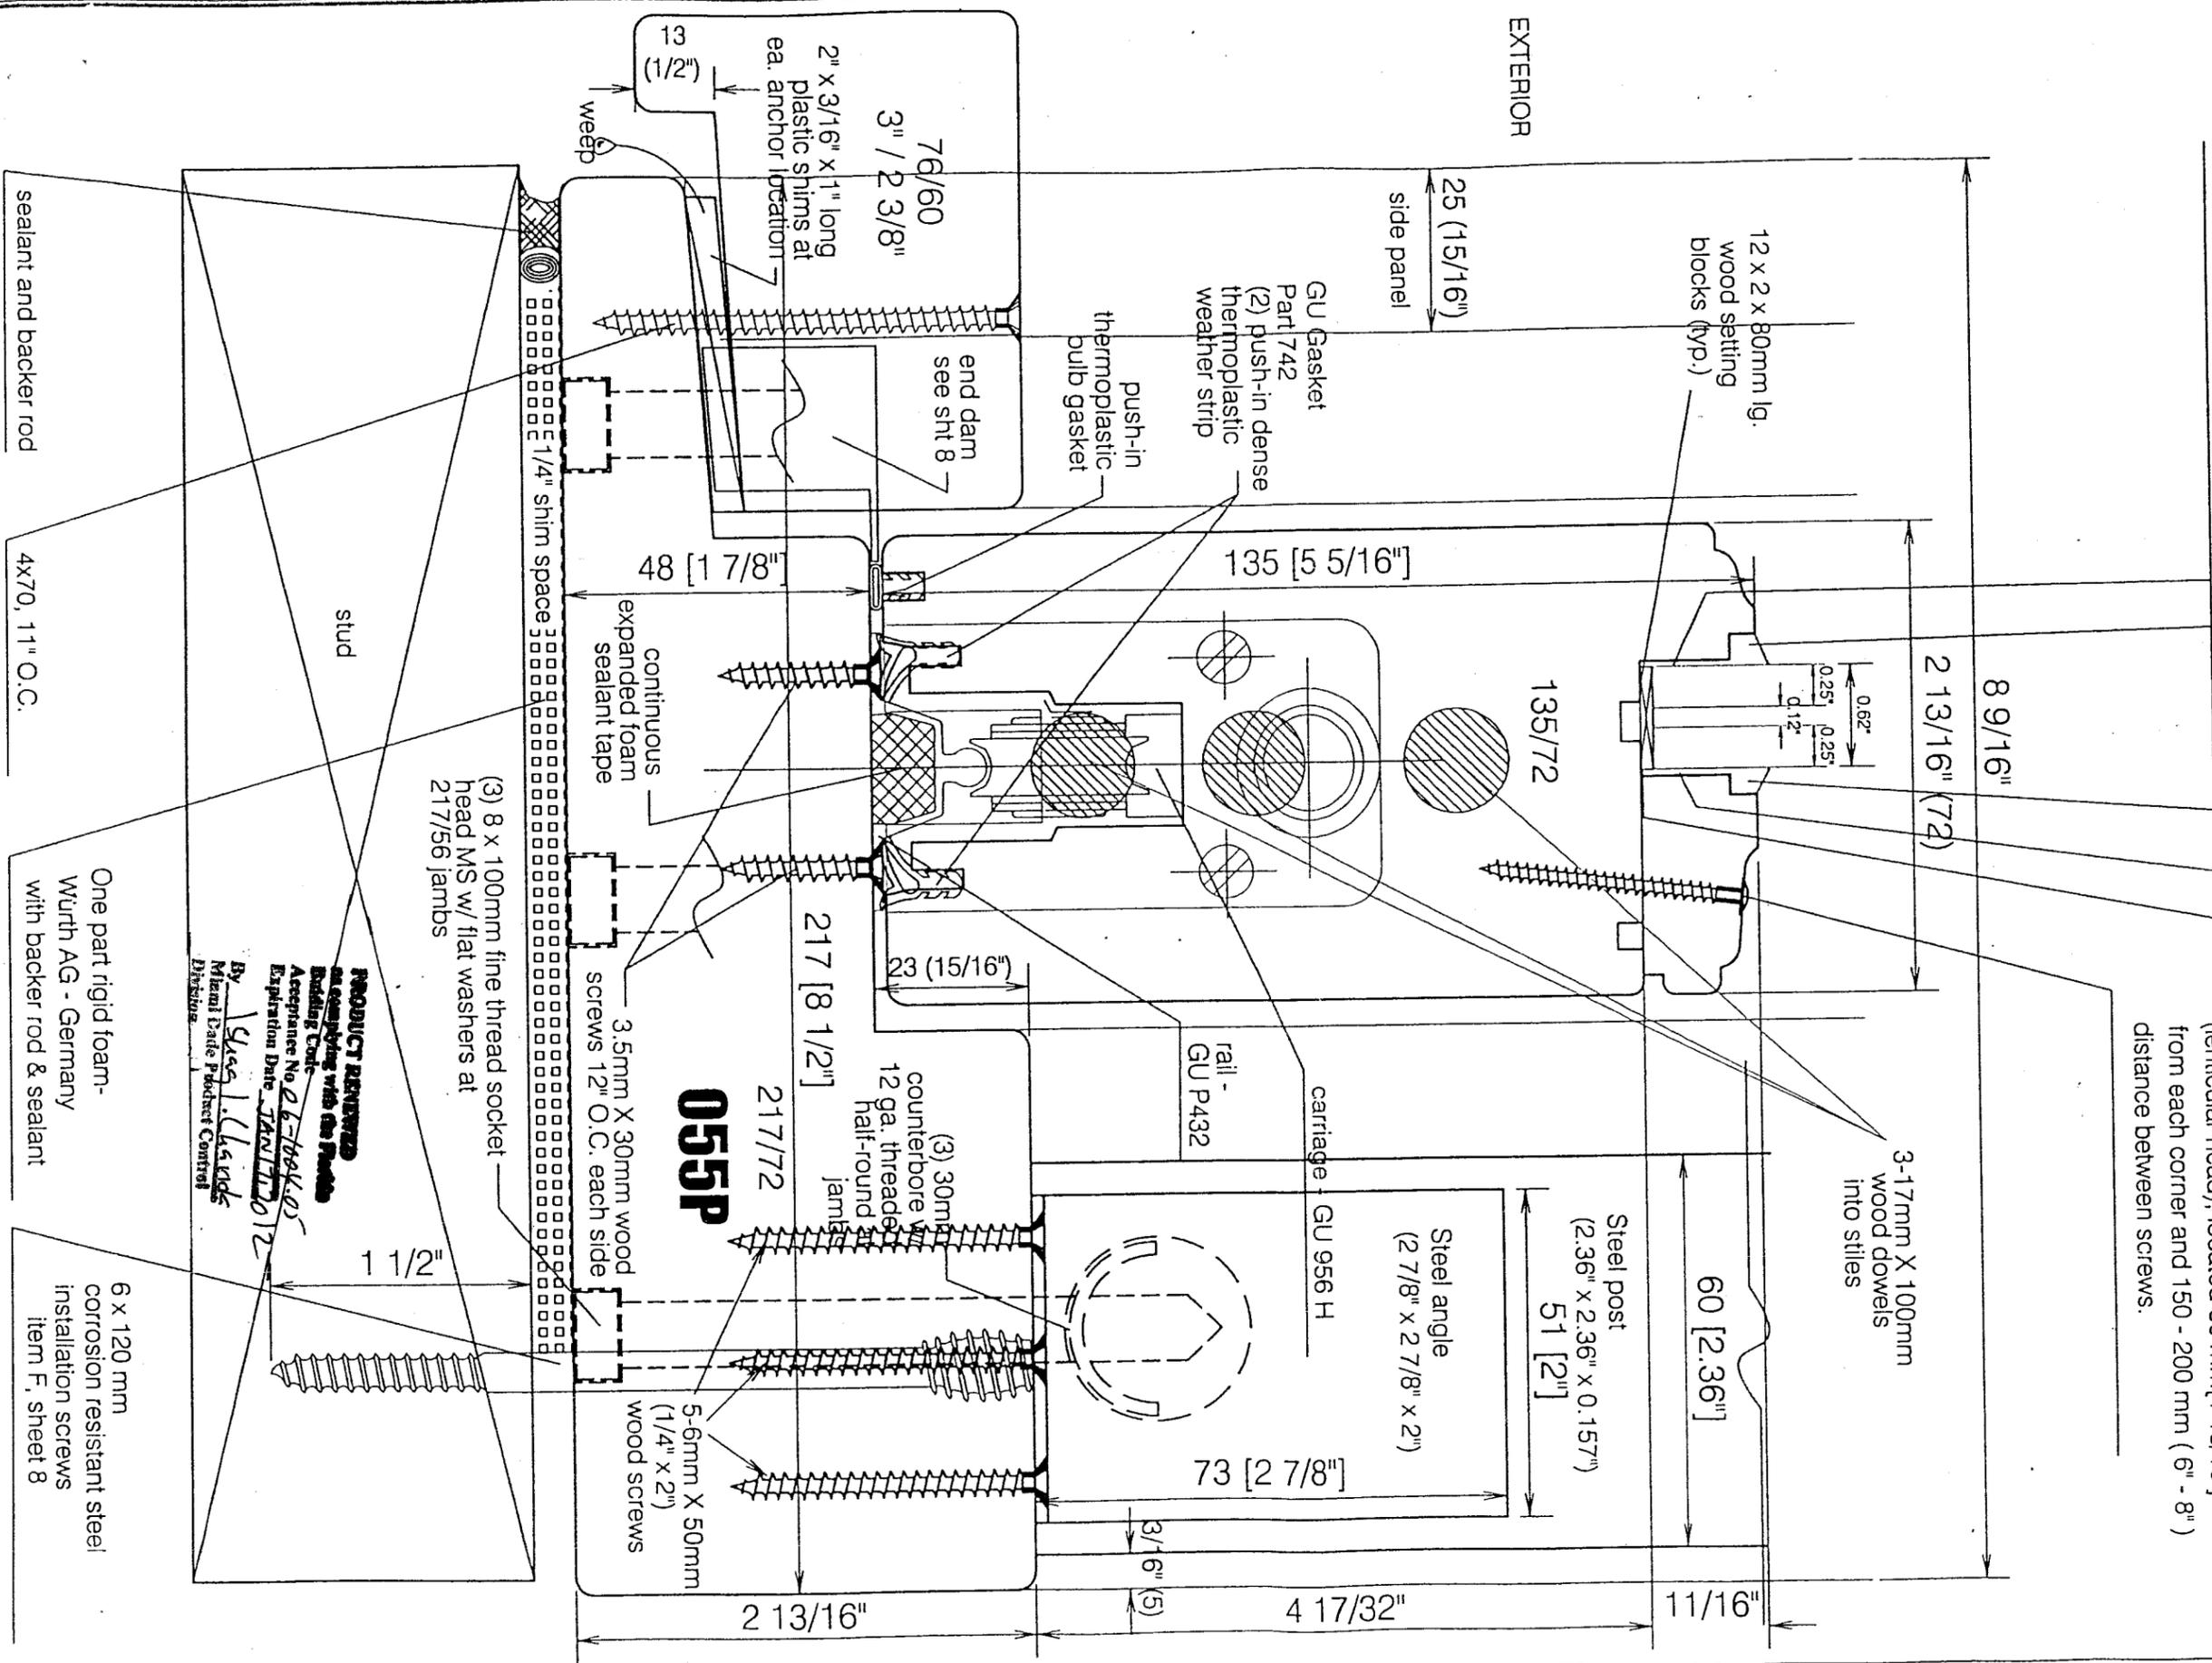


**PRODUCT REVIEW**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 26-1884-05  
 Expiration Date: JAN 17, 2012  
 By: *S. L. L. L.*  
 Miami Dade Product Control  
 Division

sealant and backer rod

4x70, 11" O.C.

One part rigid foam-  
 Wurth AG - Germany  
 with backer rod & sealant

6 x 120 mm  
 corrosion resistant steel  
 installation screws  
 item F, sheet 8

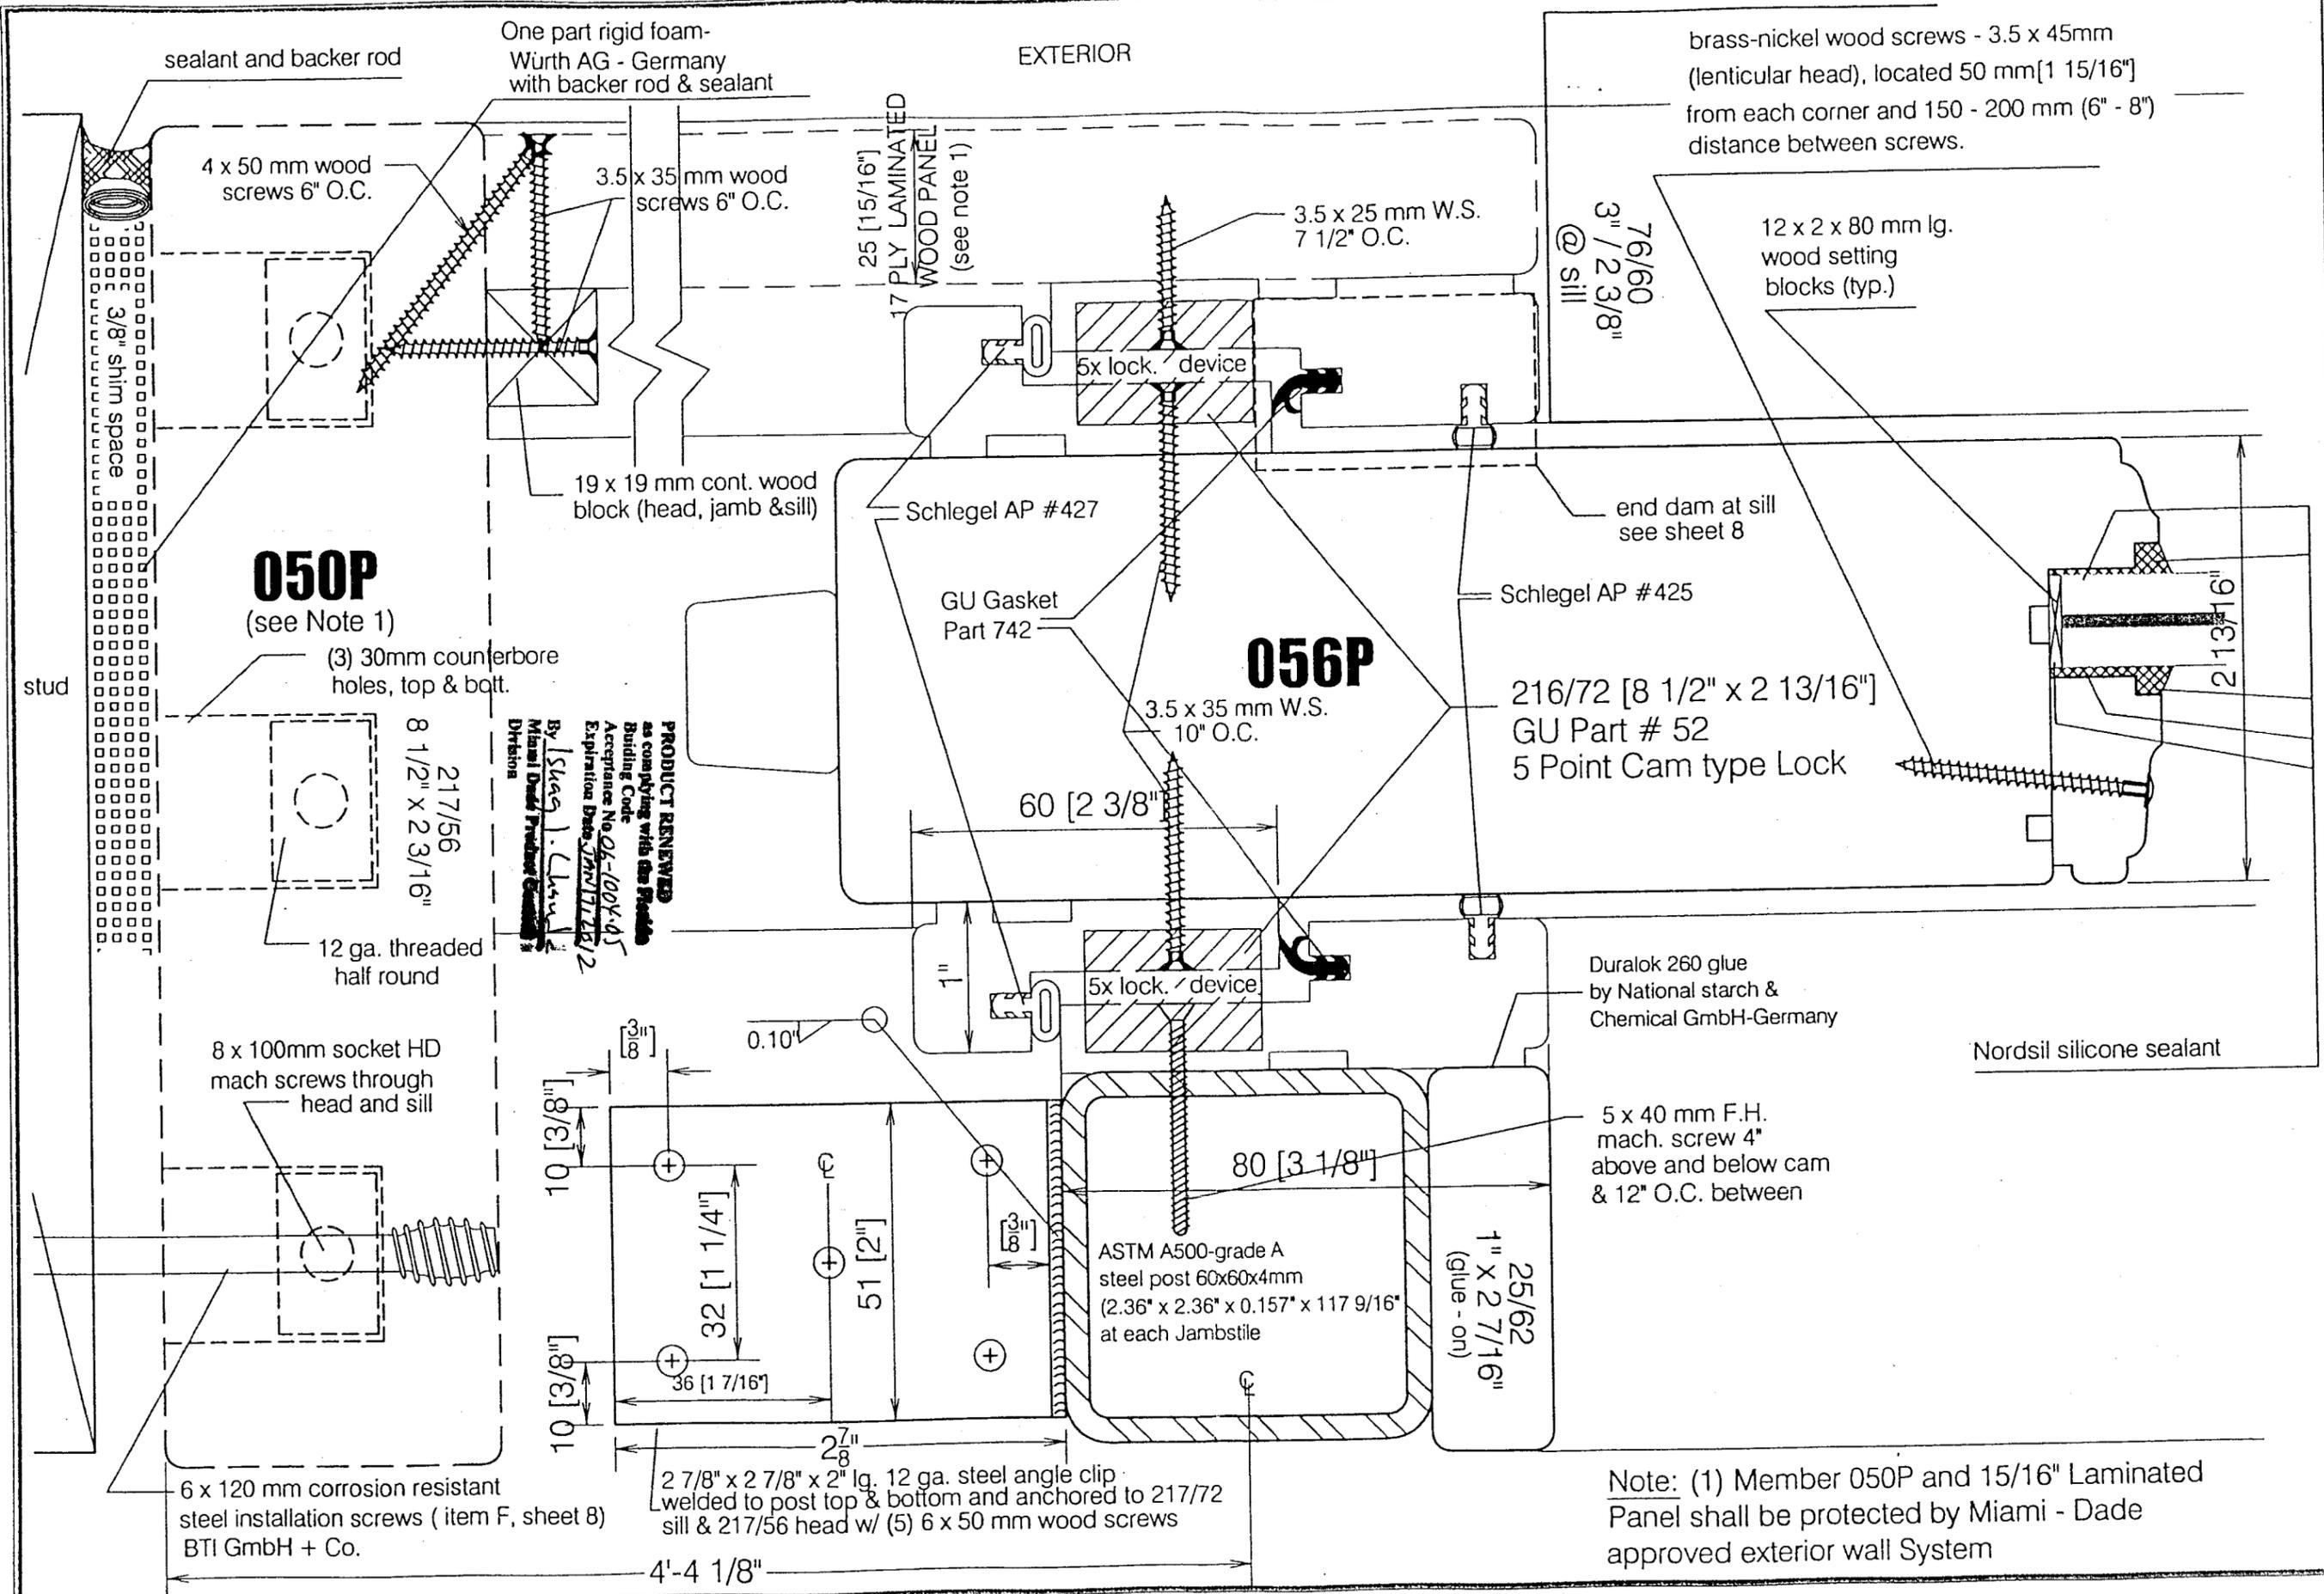

**PRODUCT REVIEWED**  
 as complying with the Florida Building Code  
 Acceptance No. 06-100X-45  
 Expiration Date: 2/21/12/12  
 By: [Signature] J. Chandy  
 Miami Dade Product Control Division

Note: (1) Member 050P and 15/16" Laminated Panel shall be protected by Miami - Dade approved exterior wall System



Tischler und Sohn (U.S.A.) Ltd.  
 Six Suburban Avenue  
 Stamford, CT 06901 USA  
 Tel.: 203/674-0600  
 Fax: 203/674-0601  
 E-mail: dtweid-tischler@wordnet.at.tn.net

DADE COUNTY - FLORIDA  
 TESTING OF WOOD WINDOWS & DOORS

MEETING STILE SECTION OF  
 BI-PART LIFT & ROLLING MAHOGANY POCKET DOOR

VIPIN N. TOLAT, P.E.  
 FL. REG. # 12847

*John Tolat*  
 Date: 11/24/04

Date: August 1, 2000 revised: 11/24/04

Sheet 5 of 8

Scale: Full (1:1)

Drawn by: K.M.


Drawing No. TS - 16

EXTERIOR

ASTM - A 36  
 8 mm x 40 mm [5/16" x 1 9/16"] steel  
 thru the full length of sash  
 (milled to 5 mm x 110 mm long  
 at handle location)

astragal glued to frame  
 w/ DURO-LOK 260 glue  
 by National Starch &  
 Chemical GmbH - Germany

GU Gasket  
 Part 742  
 (2) push-in dense  
 thermoplastic  
 weather strip  
 wood screws [4 mm x 45 mm] 2" Fee, 14 1/2" oc

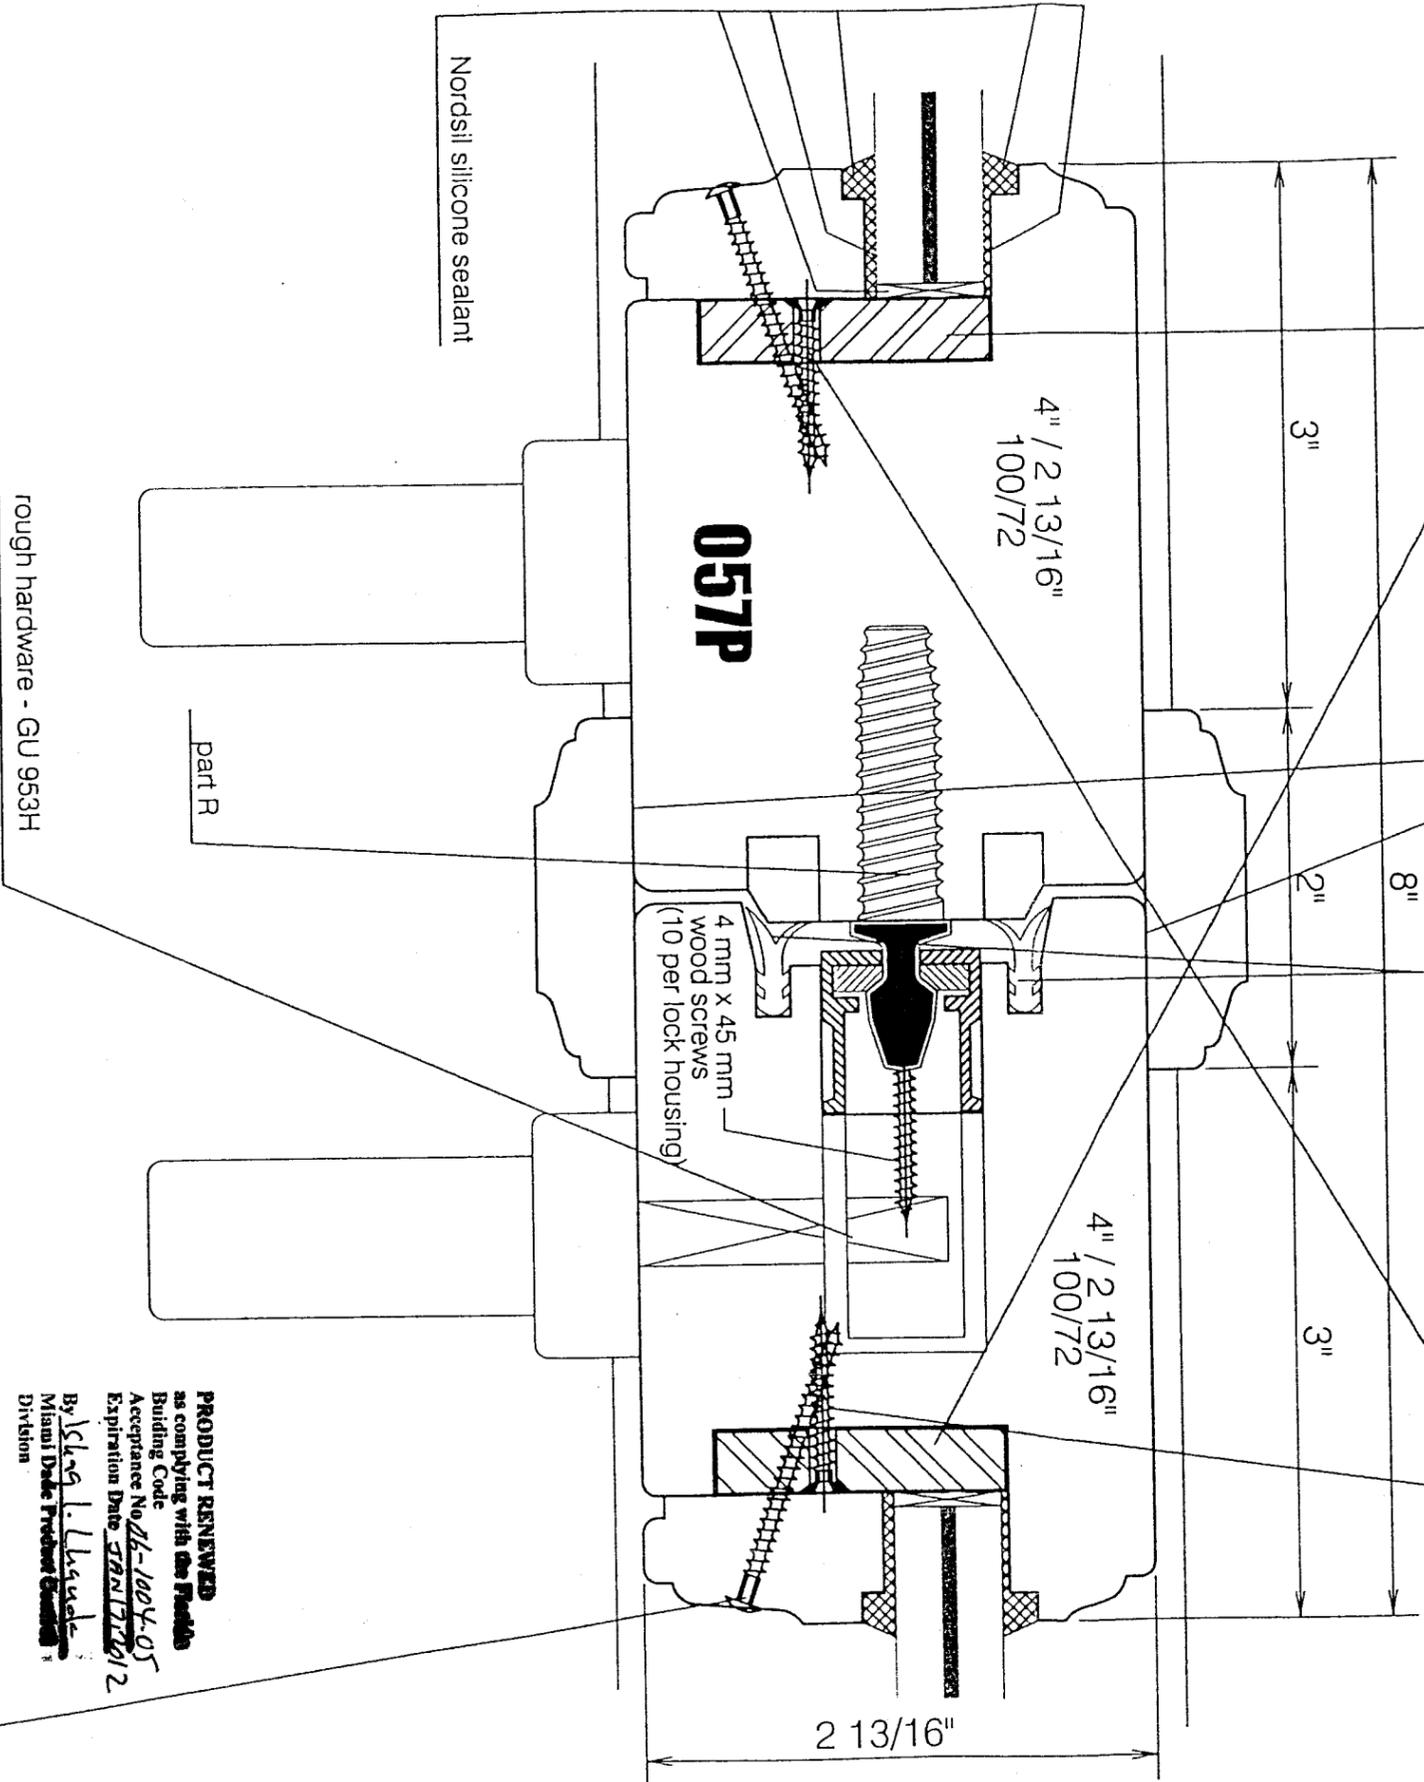

INTERIOR

brass-nickel wood screws - 3.5 x 45mm  
 (lenticular head), located 50 mm [1 15/16"]  
 from each corner and 150 - 200 mm (6" - 8")  
 distance between screws.

**PRODUCT RENEWED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 26-1004-05  
 Expiration Date 2/17/2012  
 By Slung L. Luque  
 Miami Dade Product Council  
 Division



**TISCHLER und SOHN**

Tischler und Sohn (U.S.A.) Ltd.  
Six Suburban Avenue  
Stamford, CT 06901 USA  
Tel.: 203/674-0600  
Fax: 203/674-0601  
E-mail: dtwedt-tischler@wordnet.attnet

DADE COUNTY - FLORIDA  
TESTING OF WOOD WINDOWS & DOORS

REAL MUNTIN FOR  
BI-PART LIFT & ROLLING MAHOGANY POCKET DOOR

VIPIN N. TOLAT, P.E.  
FL. REG. # 12847


*VPIN N. TOLAT*  
1/12/06

Date: August 1, 2000 revised: ~~11/24/06~~ Sheet 6 of 8 Scale: Full (1:1)

Drawn by: K.M

Drawing No. TS - 16

EXTERIOR

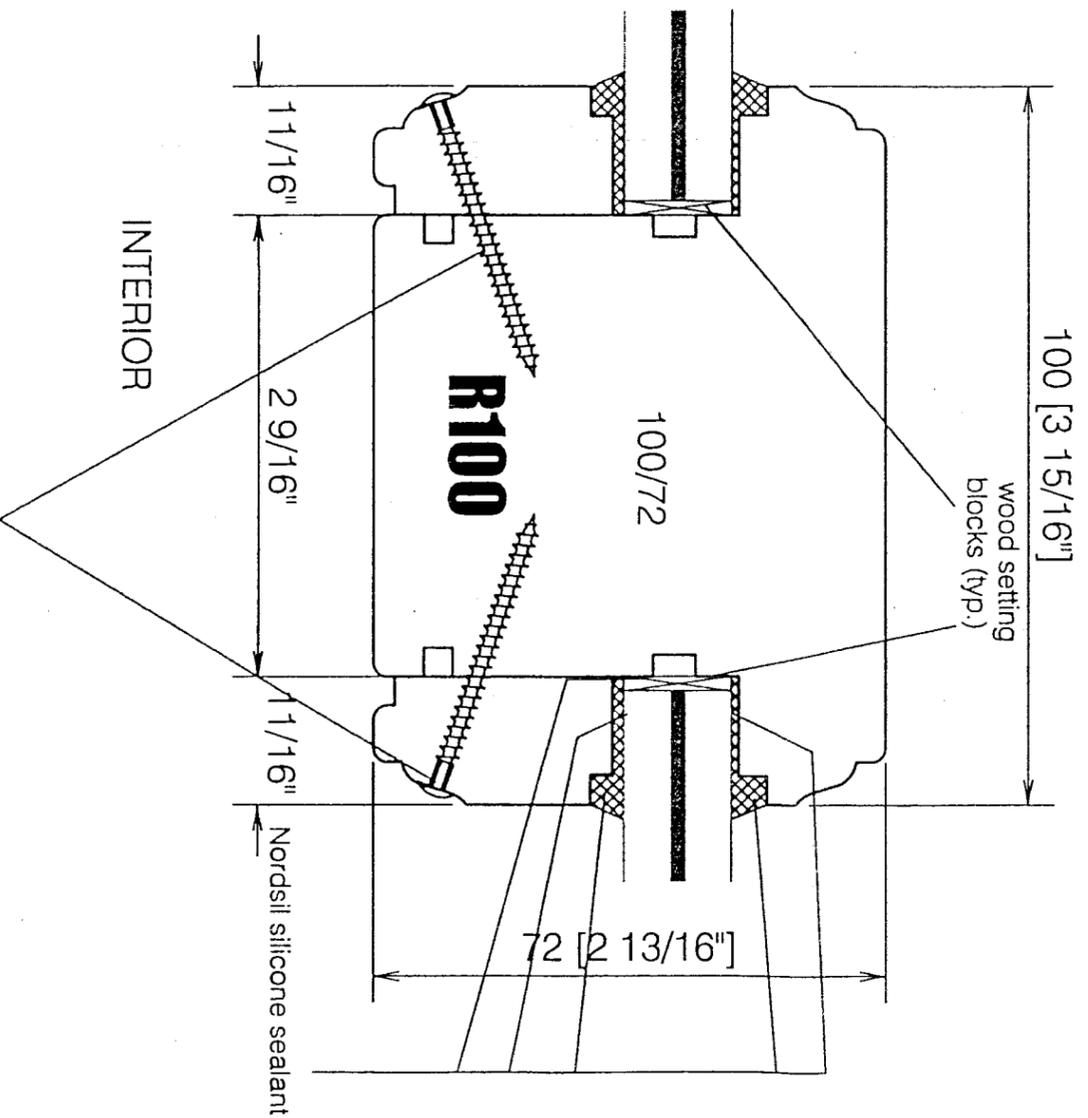

INTERIOR

brass-nickel wood screws - 3.5 x 45mm  
(lenticular head), located 50 mm [1 15/16"]  
from each corner and 150 - 200 mm (6" - 8")  
distance between screws.

**PRODUCT REVIEWED**  
as complying with the Florida  
Building Code  
Acceptance No. 06-1004-05  
Expiration Date JAN 17, 2012  
By Shay L. Chavala  
Miami Dade Product Control  
Division




Tischler und Sohn (U.S.A.) Ltd.  
 Six Suburban Avenue  
 Stamford, CT 06901 USA  
 Tel.: 203/674-0600  
 Fax: 203/674-0601  
 E-mail: dtweid-tischler@worldnet.att.net

DADE COUNTY - FLORIDA  
 TESTING OF WOOD WINDOWS & DOORS  
 ELEVATION OF  
 BI-PART MAHOGANY LIFT AND ROLLING POCKET DOOR  
 Date: August 1, 2000 revised: 11/24/06 Sheet 7 of 8 Scale: 1/2"=1'-0" (1:24)

Drawn by: K.M.  
 Drawing No. TS-16  
 VIPIN N. TOLAT, P.E.  
 FL. REG. # 12847

6mm DIAMETER x 120mm INSTALLATION SCREWS - ITEM F, SHEET 8 - SPACED AS SHOWN ALL AROUND

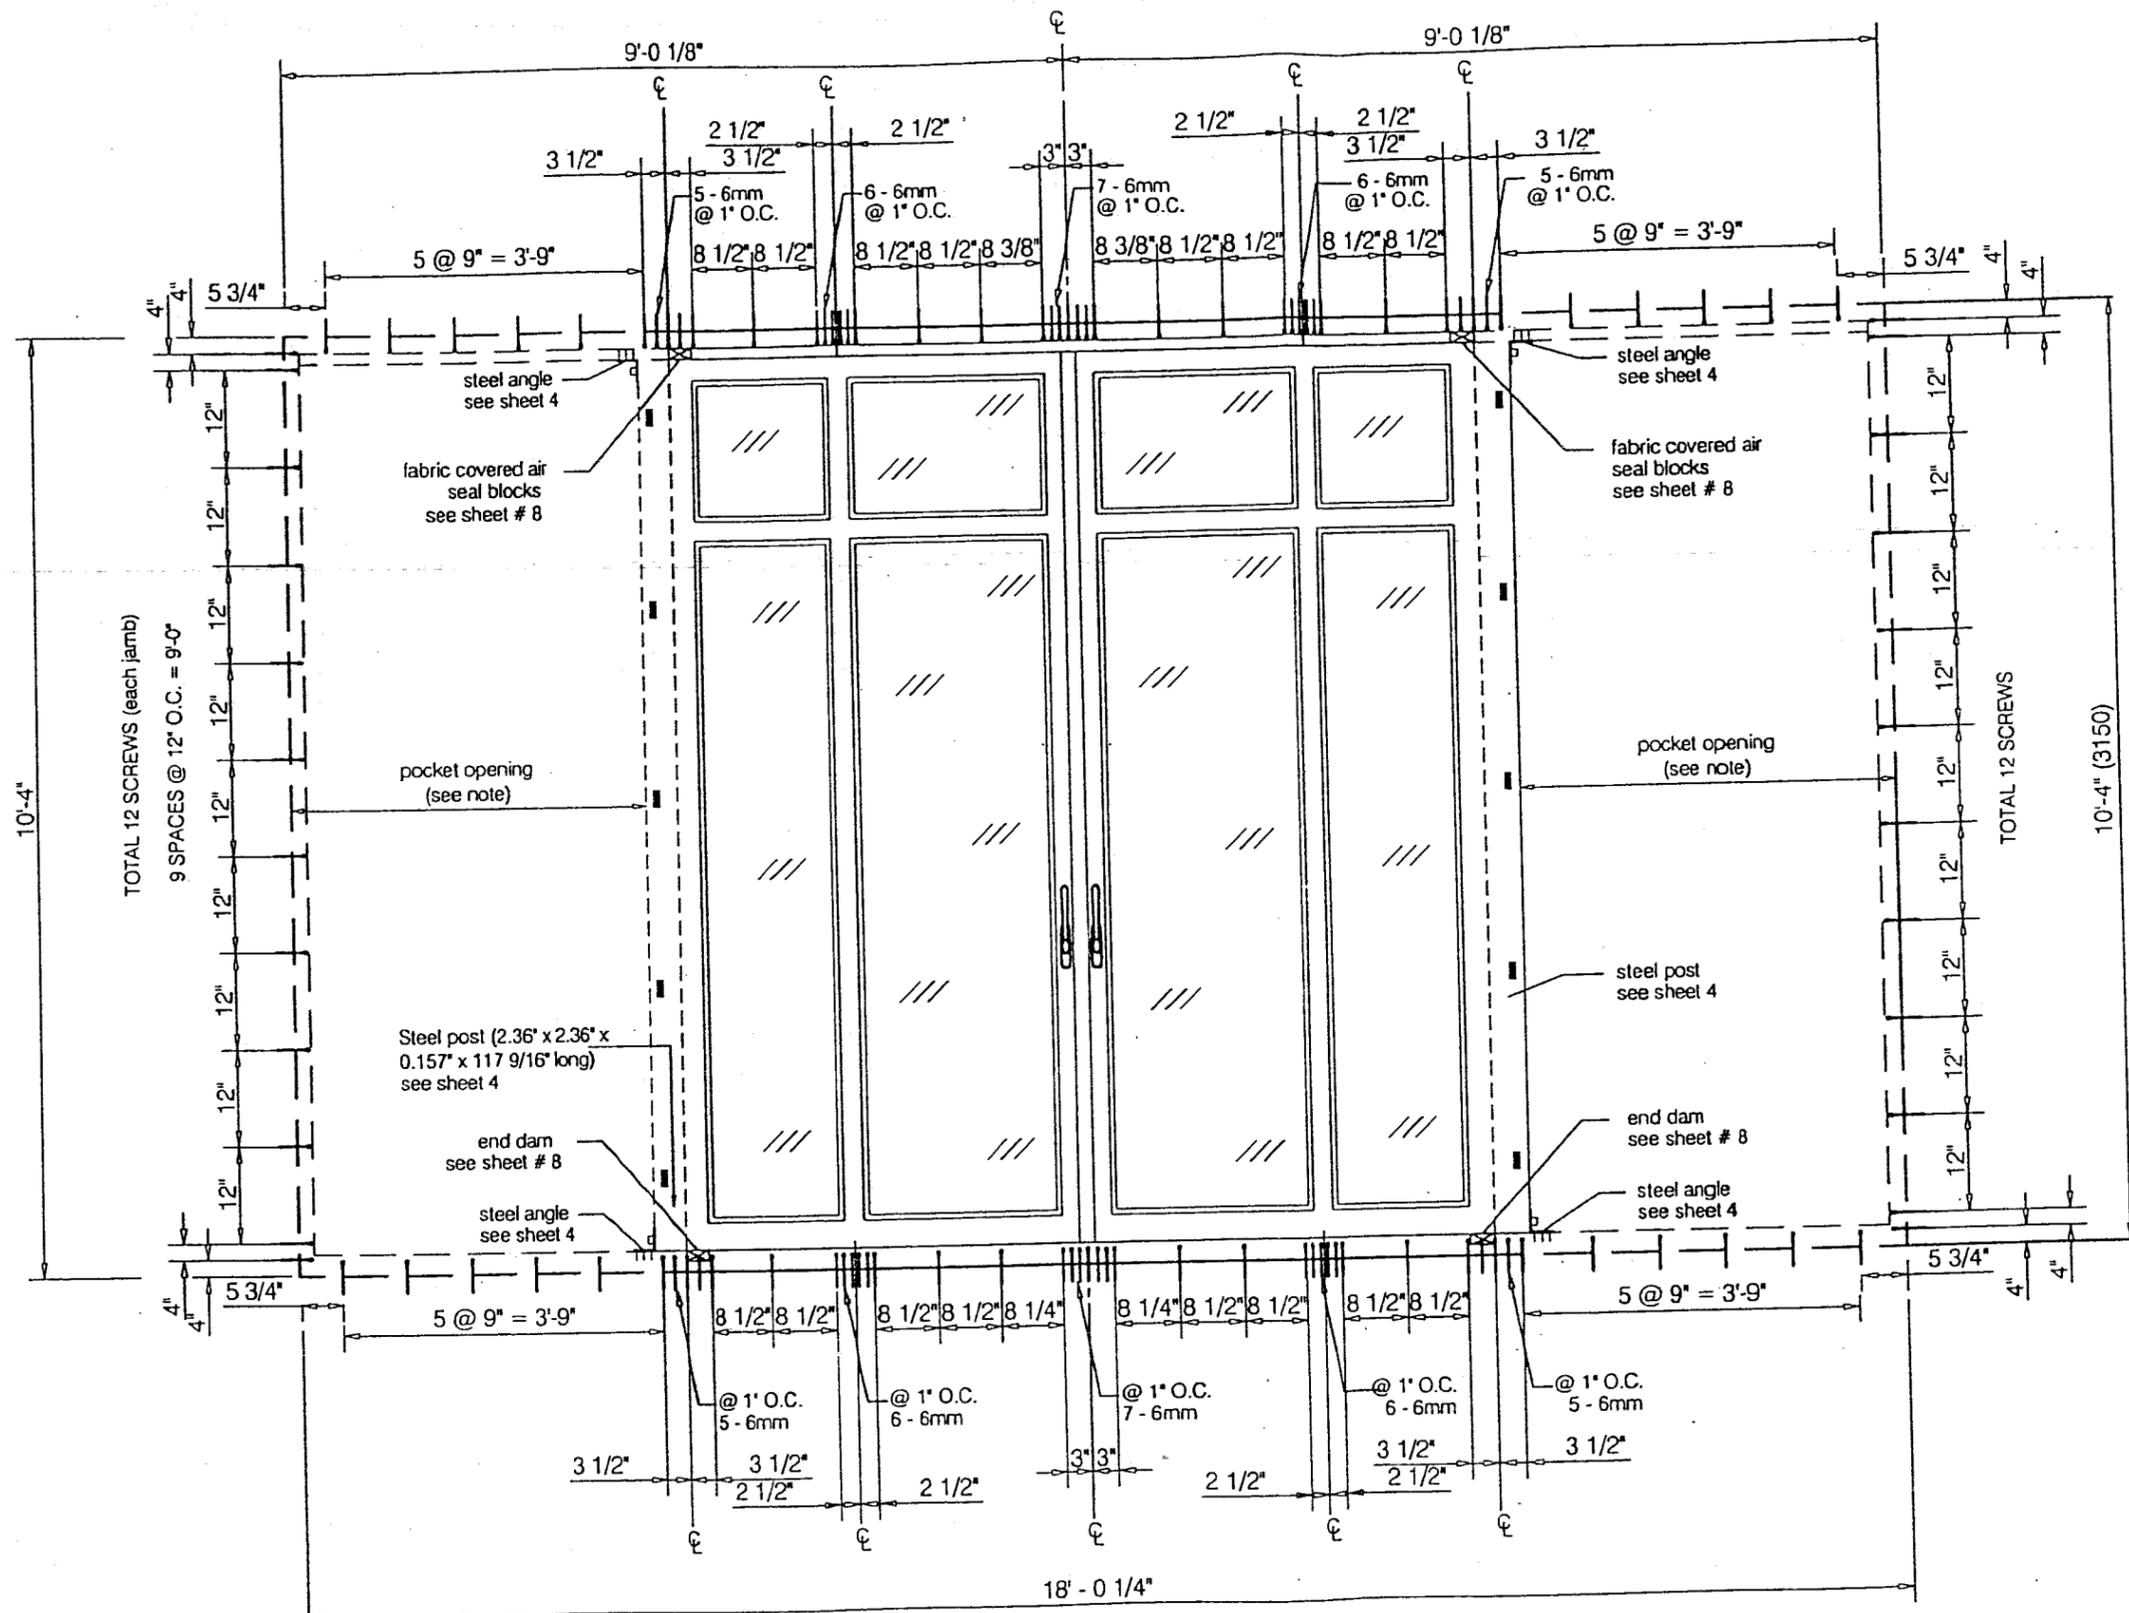

ANCHOR LOCATIONS

INTERIOR ELEVATIONS  
 BI-PART MAHOGANY LIFT AND ROLLING POCKET DOOR

NOTE: Pocket Opening Shall Be Protected by Miami Dade County Approved Impact Resistant Wall System

**PRODUCT RENEWED**  
 so complying with the Florida  
 Building Code  
 Acceptance No. 06-1004-05  
 Expiration Date JAN 17, 2012  
 By: Charles L. Chanda  
 Miami Dade Product Control  
 Division

*Handwritten signature and date: 11/24/06*



Tischler und Sohn (U.S.A.) Ltd.  
 Six Suburban Avenue  
 Stamford, CT 06901 USA  
 Tel.: 203/674-0600  
 Fax: 203/674-0601  
 E-mail: dtm@tischler.com  
 @worldnet.att.net

DADE COUNTY - FLORIDA  
 TESTING OF WOOD WINDOWS & DOORS  
 Installations  
 screws


VIPIN N. TOLAT, P.E.  
 FL. REG. # 12847

*John F. Wells*


Date: August 1, 2000 revised: 11/24/06 Sheet 8 of 8 Scale: Full (1:1)

Drawn by: K.M.

Drawing No. TS-16

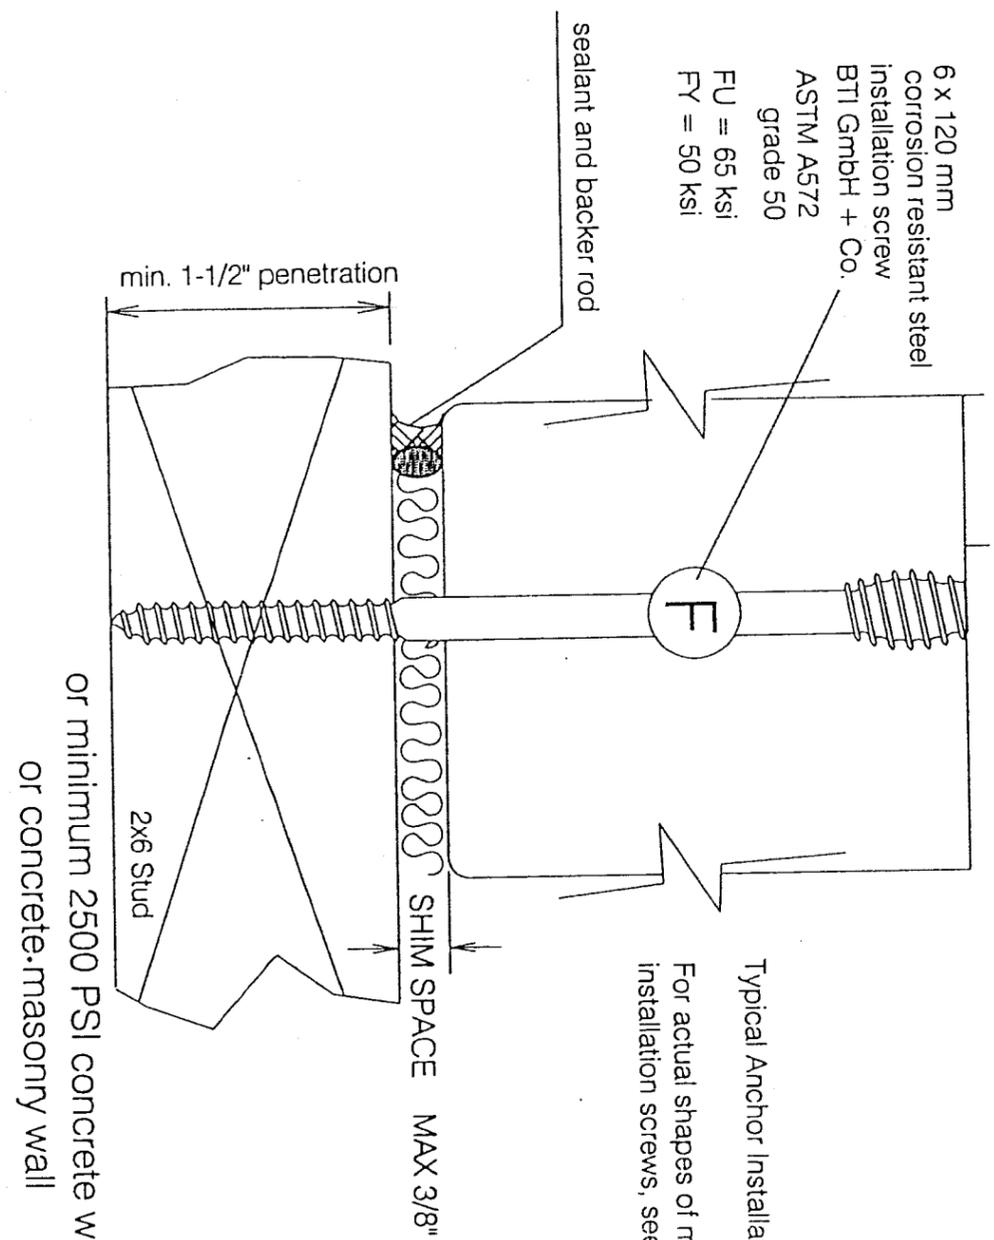


Typical Anchor Installation  
 For actual shapes of members containing installation screws, see appropriate sections.

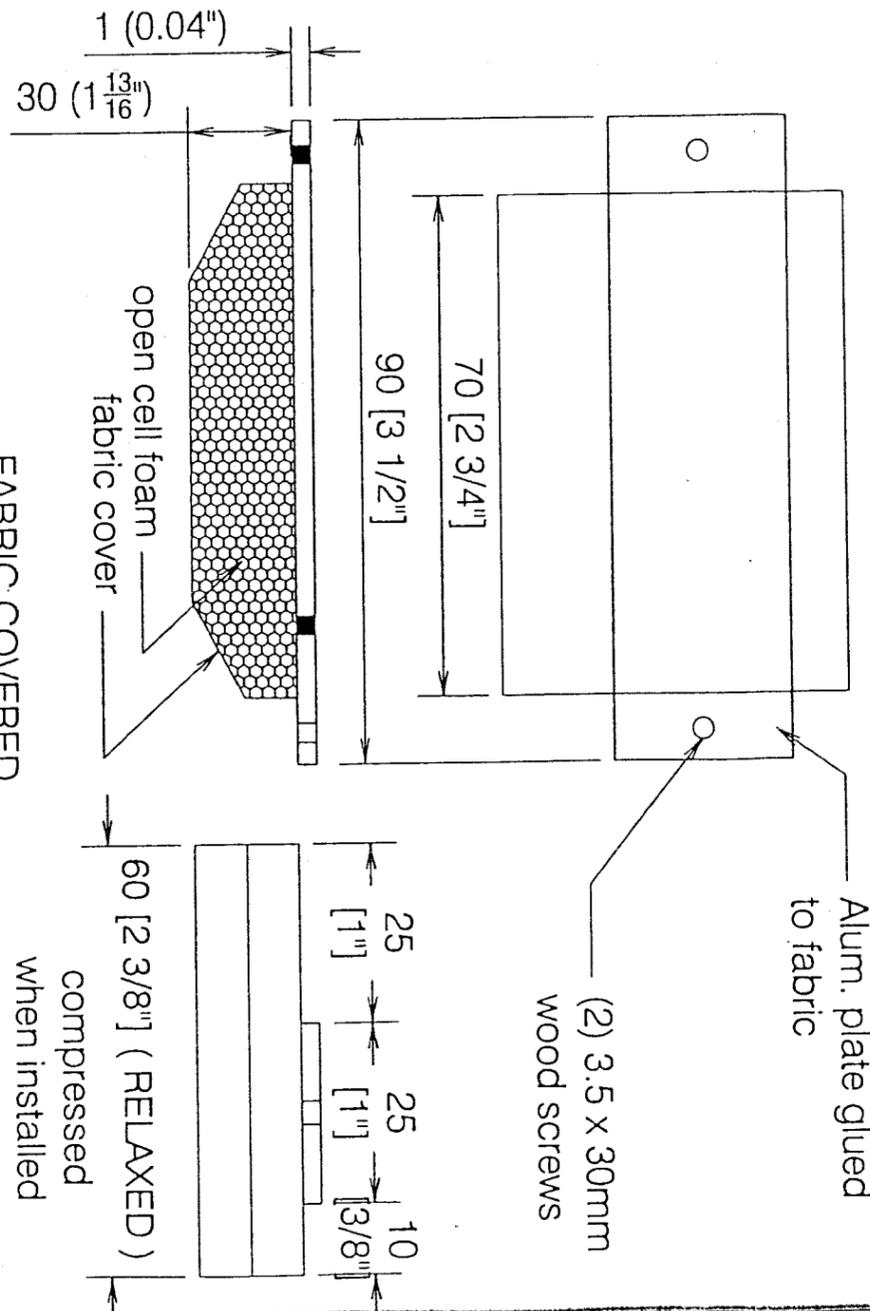

FABRIC COVERED  
 AIR-SEAL BLOCKS AT HEAD  
 (2 REQ'D)

END DAM AT SILL  
 (2 REQ'D)

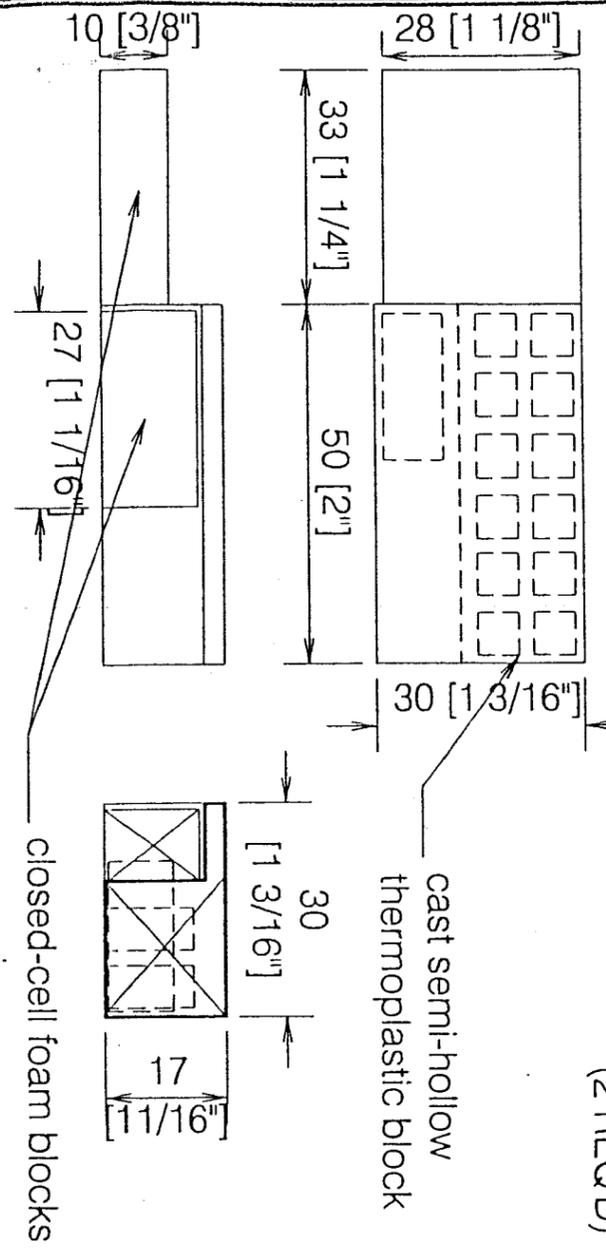

**PRODUCT REVIEWED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 06-1004-05  
 Expiration Date 12/31/12  
 By *Nelag I. Llanos*  
 Material Tests Product Control  
 Division