



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Dryvit Systems, Inc.
One Energy Way
West Warwick, RI 02893**

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone.

DESCRIPTION: Dryvit Infinity EIFS

APPROVAL DOCUMENT: Drawing No. "Large Scale Missile Impact Test For Infinity System", sheets 1 through 2 of 2, prepared by Dryvit System Inc, dated 02/26/01 with no revisions signed and sealed by R. E. Kroll P.E., bearing the Miami-Dade County Product Control renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each component shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved or MDCPCA", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA # **01-0614.14** and consists of this page, evidence page as well as approval document mentioned above.

The submitted documentation was reviewed by **Candido F. Font, P.E.**

[Handwritten signature and date: 11/09/06]



**NOA No 06-1004.07
Expiration Date: December 20, 2011
Approval Date: November 09, 2006**

Druvit Systems Inc.

NOTICE OF ACCEPTANCE: EVIDENCE PAGE

A DRAWING

1. Drawing prepared by Dryvit Sytems, Inc., drawing titled and number "Large Scale Missile Impact Test for Infinity System", Sheets 1 through 2 of 2, dated 02/26/2001, with no revisions, signed and sealed by R. E. Kroll, PE.

B TEST

1. Test report on Large Missile Impact Test per PA 201, Cyclic Pressure Test per PA 203, Uniform Static Air Test, Air Infiltration Test, Water Leakage Test per PA 202 of "4 x 8 Dryvit Infinity System", prepared by Twin City Testing Corporation, report No. TCTCWI01001, test units 1, 2, 3 & 4, dated 03/03/2001, signed and sealed by D. J. Swanson, PE.
2. Test report on tensile bond strength of insulation board test in accordance with ASTM C297, prepared by United States Testing Company Inc on 08/26/94 pages 1 through 6 of 6 and signed by F. Pepe.
3. Test report on tensile bond strength of dryshield barrier/adhesive mixture Dens-Glass gold in accordance to ASTM C297, prepared by United States Testing Company Inc on 05/31/94 pages 1 through 6 of 6 and signed by F. Pepe.

C QUALITY ASSURANCE

1. Building Code Compliance Office


D MATERIAL CERTIFICATION

1. Product Control Notice of Acceptance No. 98-0904.04 issued to Apache Products Company on 11/26/98 and expiring on 01/11/02.


E STATEMENTS.

1. No interest letter prepared by R. J. Kenney Associates, Inc. dated 11/07/01, signed and sealed by R. E. Kroll, PE.
2. No change affidavit prepared by William M. Preston and notarized by Nikki Perkins on 09/26/06.



11/09/06
Candido F. Font, P.E.
Senior Product Control Examiner
NOA No 06-1004.07
Expiration Date: December 20, 2011
Approval Date: November 09, 2006

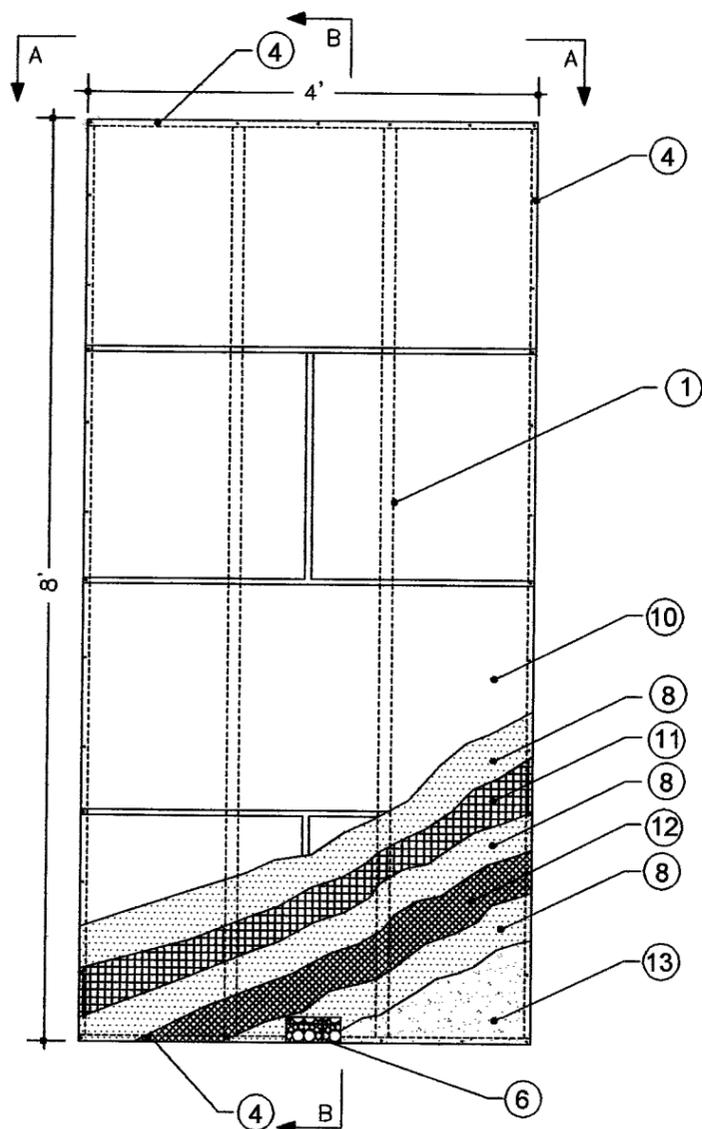

SECTION B-B

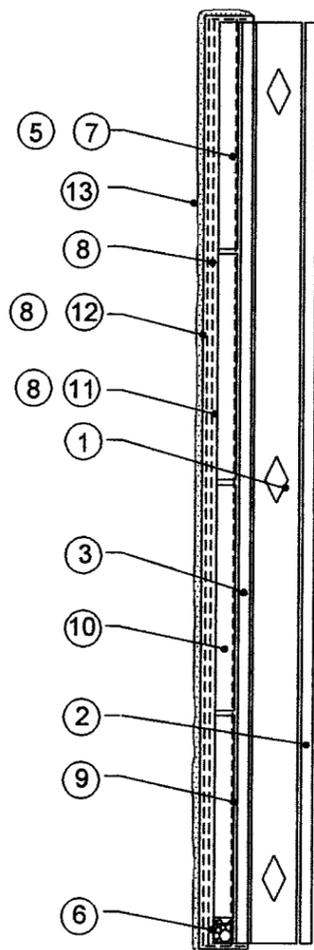

SECTION A-A

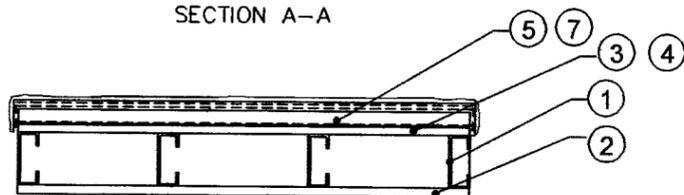

*Revised
11/15/01*

MATERIAL LIST

- ① 3 5/8" X 1 5/8" X 18 GAUGE STEEL STUDS AT 16" O.C.
- ② 1/2" GYPSUM SHEATHING
- ③ 1/2" DENS-GLASS GOLD
- ④ NO. 6 X 1 1/4" SELF TAPPING SCREWS SPACED 6" O.C.
- ⑤ DRYVIT DRYSHIELD ABA MIXED 1:1 BY WEIGHT WITH PORTLAND CEMENT AND WATER. DRYSHIELD ABA IS A HIGH PERFORMANCE POLYMER BASED MATERIAL USED AS A WEATHER RESISTIVE BARRIER.
- ⑥ DRYVIT I.S. VENT ASSEMBLY FOR WATER INTRUSION RELEASE.
- ⑦ DRYVIT'S STANDARD PLUS REINFORCING MESH: 6.0 OZ/SQ. YD FIBERGLASS REINFORCING MESH EMBEDDED IN THE DRYVIT DRYSHIELD ABA. THE STANDARD PLUS REINFORCING MESH SHALL BE LAPPED A MINIMUM OF 2 1/2" AT ALL EDGES.
- ⑧ DRYVIT BASE COAT: I.S. BASE MIXED 2:1 BY WEIGHT WITH PORTLAND CEMENT AND WATER. DRYVIT I.S. BASE IS 100% ACRYLIC BASED PRODUCT.
- ⑨ ADHERE THE EXPANDED POLYSTYRENE INSULATION BOARD BY APACHE (NOA # 98 - 0904.04) WITH DRYVIT'S DRYSHIELD ABA MIXTURE. DRYSHIELD ABA IS A 100 PERCENT POLYMER BASED PRODUCT. IT IS MIXED 1:1 BY WEIGHT WITH PORTLAND CEMENT AND WATER. THE ADHESIVE IS APPLIED WITH A 3/8" WIDE X 1/2" DEEP NOTCH TROWEL WITH NOTCHES SPACED A MAXIMUM OF 1 1/2" O.C. THE ADHESIVE SHALL BE APPLIED TO THE BACK OF THE INSULATION BOARD VERTICALLY.
- ⑩ APACHE PRODUCTS INSULATION BOARD. MINIMUM 2" THICK EPS (1 PCF). AFTER APPLYING ADHESIVE TO INSULATION BOARD, SLIDE BOARD INTO PLACE AND APPLY PRESSURE TO ENSURE CONTACT WITH THE SUBSTRATE. INSULATION SHALL BE APPLIED HORIZONTALLY AND VERTICAL JOINTS SHALL BE STAGGERED.
- ⑪ DRYVIT PANZER 20 REINFORCING MESH: 20.5 OZ/SQ. YD FIBERGLASS REINFORCING MESH EMBEDDED IN DRYVIT I.S. BASE COAT. PANZER 20 MESH EDGES SHALL BE ABUTTED TIGHTLY. DO NOT OVERLAP.
- ⑫ DRYVIT'S I.S. REINFORCING MESH: 5.0 OZ/SQ. YD FIBERGLASS REINFORCING MESH EMBEDDED IN THE DRYVIT I.S. BASE COAT. THE I.S. REINFORCING MESH SHALL BE LAPPED A MINIMUM OF 2 1/2" AT ALL EDGES.
- ⑬ DRYVIT INFINITEX FINISH: A 100 PERCENT ACRYLIC BASED ELASTOMERIC MATERIAL AVAILABLE IN VARIOUS TEXTURES.

GENERAL NOTES


- 1. THE SYSTEM HAS BEEN DESIGNED IN ACCORDANCE WITH THE SOUTH FLORIDA BUILDING CODE 1994 EDITION AND ITS LATEST SUPPLEMENTS.
- 2. THIS SYSTEM HAS BEEN TESTED IN ACCORDANCE WITH DADE COUNTY PROTOCOLS PA-201, PA-202, AND PA-203 FOR LARGE MISSILE IMPACT, STRUCTURAL AND CYCLIC TESTING.
- 3. THIS SYSTEM SHALL BE APPLIED BY A LICENSED PLASTERING CONTRACTOR FOLLOWING THIS NOTICE OF ACCEPTANCE THE RECOMMENDATION OF DRYVIT SYSTEMS, INC. AND THE APPLICABLE SECTIONS OF THE SOUTH FLORIDA BUILDING CODE.
- 4. THE ENGINEER AND/OR ARCHITECT OF RECORD FOR EACH PROJECT USING THIS SYSTEM SHALL SIZE ALL STUD FRAMING TO ENSURE CONFORMANCE WITH STUD DEFLECTION AND STRESS LIMITATIONS AS REQUIRED BY ALL GOVERNING CODES AND THIS DOCUMENT.
- 5. INSULATION BOARDS SHALL BE POSITIONED IN A RUNNING BOND PATTERN.
- 6. ALL STUDS USED WITH THIS SYSTEM SHALL BE COMPLETELY SHEATHED AT THE INTERIOR FLANGE OR BRIDGED AT A MAXIMUM OF EVERY 5' OF STUD LENGTH OR AS SPECIFIED BY THE STUD MANUFACTURER.
- 7. ALL STEEL STUDS SHALL BE STRUCTURAL WITH 1 5/8" MINIMUM FLANGE WIDTH AND HAVE A MINIMUM YIELD STRENGTH OF 33000 PSI.
- 8. DETAILS ON SHEET 2 OF 2 ARE TYPICAL AND SHOW INTENT TO PREVENT WATER INFILTRATION INTO AND BEHIND THIS SYSTEM. ALTERNATE DETAILS AND SPECIFIC CONDITIONS NOT COVERED BY THE TYPICAL DETAILS ARE THE RESPONSIBILITY OF THE LICENSED DESIGN PROFESSIONALS IN CONSULTATION WITH DRYVIT SYSTEMS, INC.

PRODUCT CONTROL DIVISION
 not complying with the Florida Building Code.
 Approval No. 06-1004.07
 Approval Date: 12/20/11
 By: [Signature]
 Miami Dade Product Control Division


DESIGNED IN ACCORDANCE WITH THE SOUTH FLORIDA BUILDING CODE
 DATE DEC 20 2001
 BY: [Signature]
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0619.14

Design Pressure +/- 66.7 PSF		
DRYVIT SYSTEMS, INC. One Energy Way West Warwick, Rhode Island		
DWG. NO.: LARGE SCALE MISSILE IMPACT TEST FOR INFINITY® SYSTEM		
SHEET NO: 1 OF 2	ISSUE DATE: 2/26/01	REV / DATE:
Florida P.E. R.E. Kroll - PE (Structural) : Registration No. PE-0038477		

HEAD

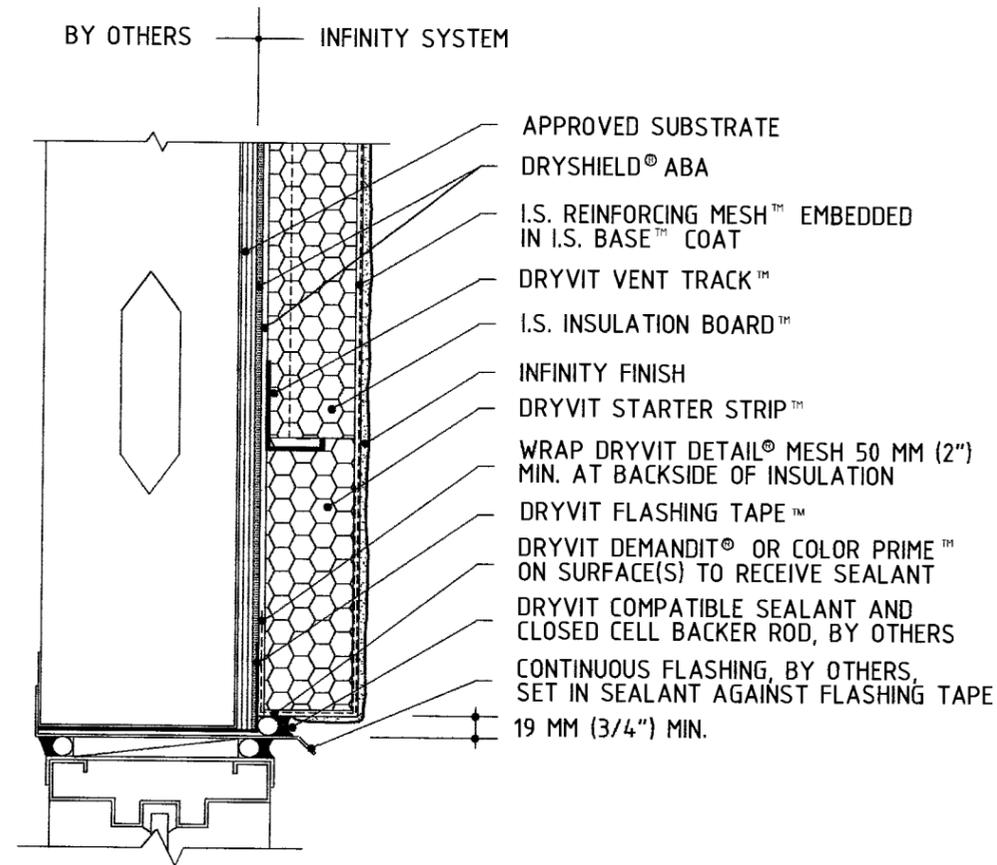


JAMB


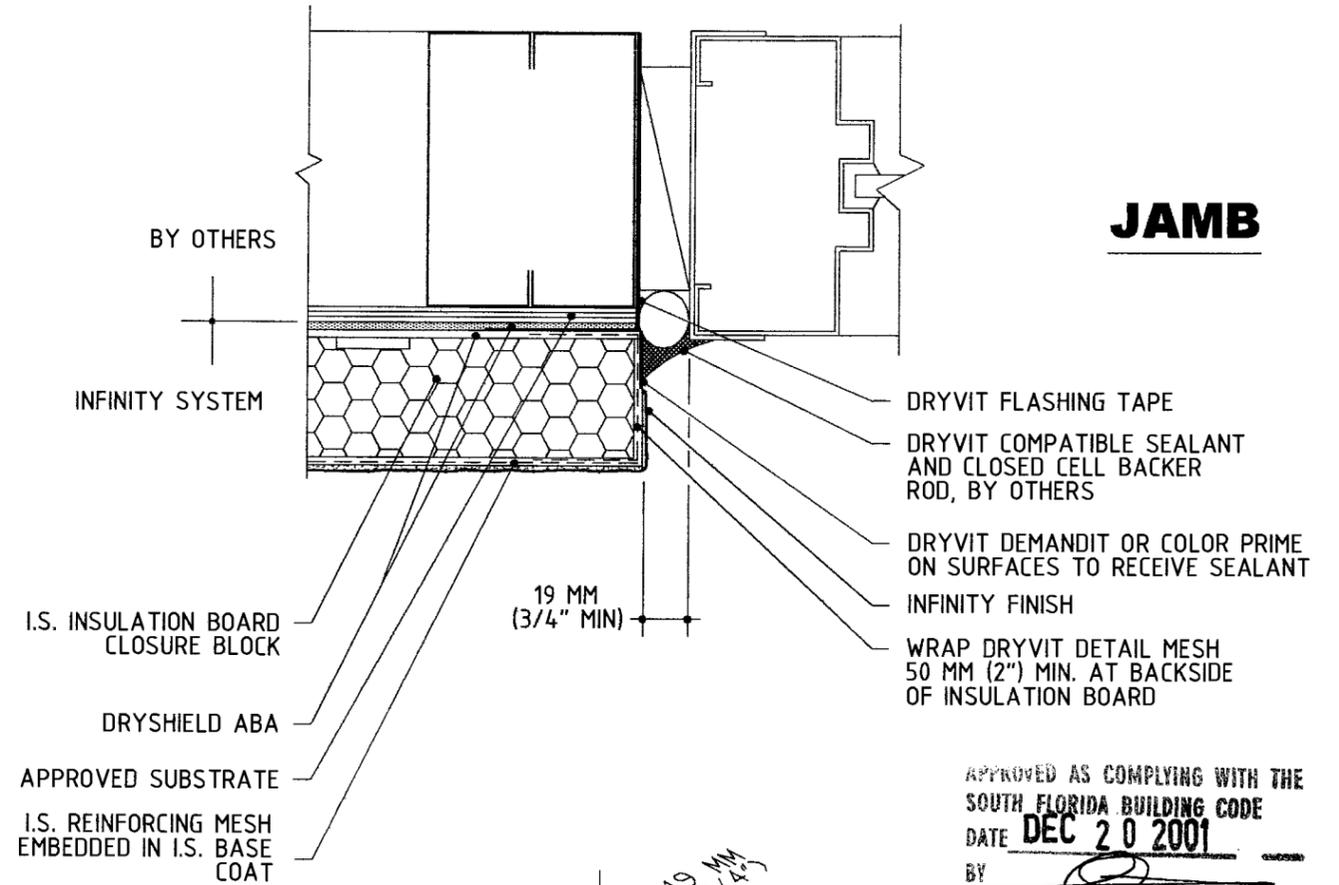


APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE **DEC 20 2001**
 BY
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. **01-0614.14**

SILL

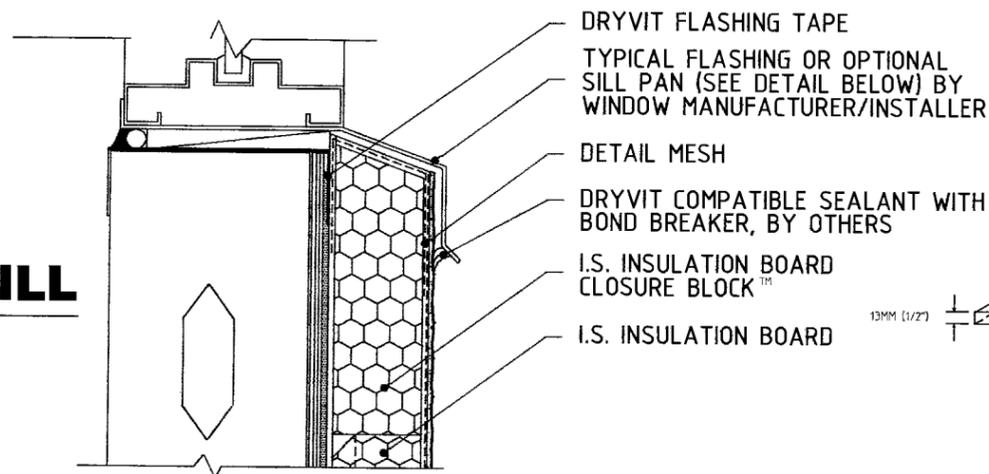

OPTIONAL SILL PAN FLASHING

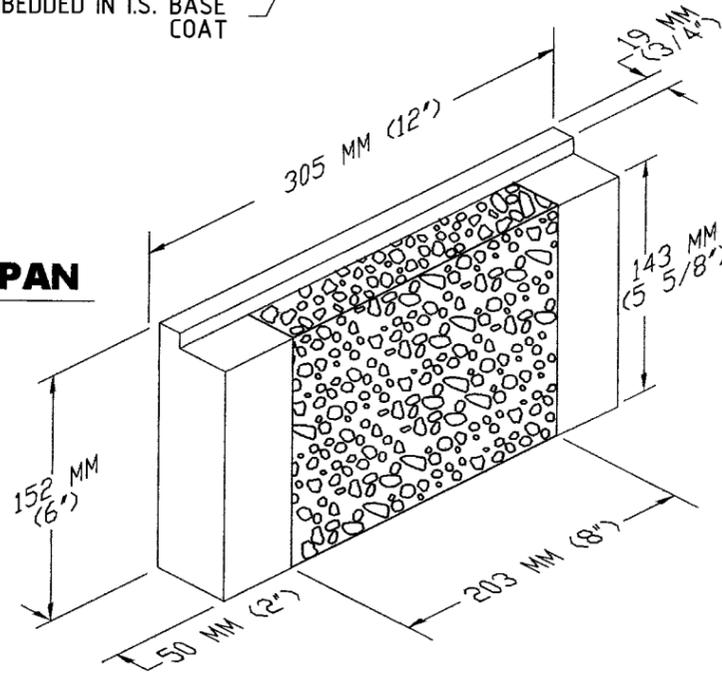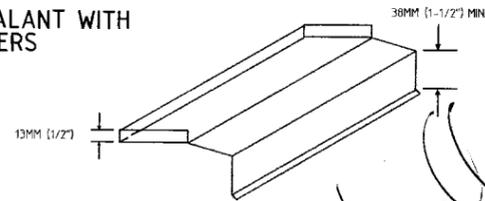

DRYVIT I.S. VENT ASSEMBLY™

PRODUCT APPROVED
 BY
 06-1004.07
 12/20/11
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

Design Pressure +/- 66.7 PSF

DRYVIT SYSTEMS, INC. One Energy Way West Warwick, Rhode Island			
DWG. NO.: LARGE SCALE MISSILE IMPACT TEST FOR INFINITY®SYSTEM			
SHEET NO: 2 OF 2	ISSUE DATE: 2/26/01	REV / DATE:	
Florida P.E. R.E. Krall - PE (Structural) : Registration No. PE-0038477			