



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

www.buildingcodeonline.com

YKK AP America, Inc.
332 Firetower Road
Dublin, GA 31021

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series YOW 225H Non-Thermal Aluminum Project-Out Window – S.M.I.

APPROVAL DOCUMENT: Drawing No. **W06-57**, titled "YOW 225H Non Thermal Alum. Project Out Wdw. (S.M.I.)", sheets 1 through 6 of 6, dated 09/23/06, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 06-1016.04
Expiration Date: December 7, 2011
Approval Date: December 7, 2006
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W06-57**, Sheets 1 through 6 of 6, titled "YOW 225H Non Thermal Alum. Project Out Wdw. (S.M.I.)", dated 09/23/06, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Small Missile Impact Test per FBC, TAS 201-94
 - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 7) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94


along with marked-up drawings and installation diagram of an aluminum outswing casement window, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0231-1019-05**, Elev. A & B dated 10/28/05, Elev. C dated 11/03/05-11/09/05 and Elev. D dated 11/04/05-01/18/06, signed and sealed by Vinu J. Abraham, P. E.

2. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an aluminum project-out window, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0231-1019-05**, Elev. E dated 10/28/05-11/04/05 and Elev. O dated 11/08/05-01/18/06, signed and sealed by Vinu J. Abraham, P. E.


3. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Small Missile Impact Test per FBC, TAS 201-94
 - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of aluminum fixed window, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0231-1019-05**, Elev. F dated 10/28/05-01/23/06, Elev. G dated 10/28/05-01/24/06, Elev. H dated 11/07/05, Elev. I dated 01/23/06-01/26/06, Elev. J dated 10/28/05-01/25/06, Elev. J1 dated 11/07/05-01/24/06, Elev. K dated 11/01/05, Elev. L & M dated 10/31/05-01/20/06, and Elev. N dated 11/07/05-01/18/06, signed and sealed by Vinu J. Abraham, P. E.

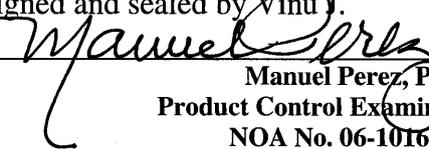

Manuel Perez, P.E.
Product Control Examiner
NOA No. 06-1016.04
Expiration Date: December 7, 2011
Approval Date: December 7, 2006

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED


4. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum fixed window, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0231-0316-06**, Elev. H dated 03/27/06-03/28/06, signed and sealed by Vinu J. Abraham, P.E.
- C. CALCULATIONS**
1. Anchor Calculations and structural analysis, complying with FBC-2004, prepared by Al-Farooq Corporation, dated 09/14/06, signed and sealed by Humayoun Farooq, P.E. **Complies with ASTM E1300-98/02**
- D. QUALITY ASSURANCE**
1. Miami Dade Building Code Compliance Office (BCCO).
- E. MATERIAL CERTIFICATIONS**
1. Notice of Acceptance No. **04-0816.02** issued to E.I. DuPont DeNemours for “**DuPont Butacite “ST” PVB Material**” dated 02/04/05, expiring on 02/04/10.
 2. Notice of Acceptance No. **01-0205.02** issued to Solutia Inc. for their “**Saflex / Keepsafe Maximum**” dated 05/17/01, expiring on 05/21/06.
- F. STATEMENTS**
1. Statement letter of conformance, dated September 14, 2006, signed and sealed by Humayoun Farooq, P.E.
 2. Statement letter of no financial interest, dated September 14, 2006, signed and sealed by Humayoun Farooq, P.E.
 3. Laboratory compliance letter for Test Reports No. HTL-0231-1019-05 and HTL-0231-0316-06, issued by Hurricane Test Laboratory, LLC, dated April 18, 2006, signed and sealed by Vinu J. Abraham, P.E.
- G. OTHER**
1. None.

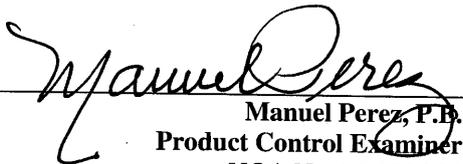
Manuel Perez, P.E.
Product Control Examiner


NOA No. 06-1016.04
Expiration Date: December 7, 2011
Approval Date: December 7, 2006

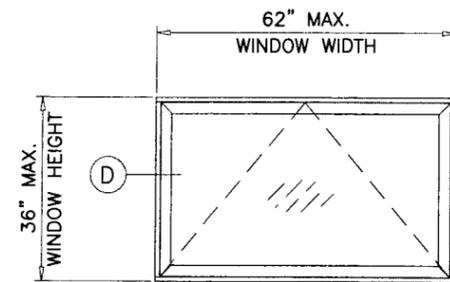


X
SINGLE PROJECT OUT WDW.

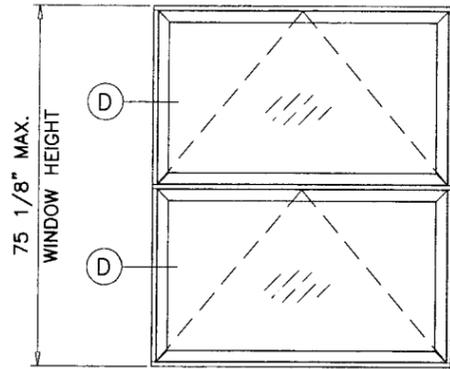

X/X
DOUBLE PROJECT OUT WDW.

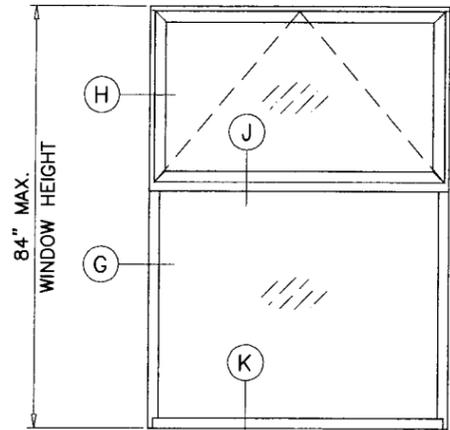


X/O
PROJECT OUT/FIXED WDW.

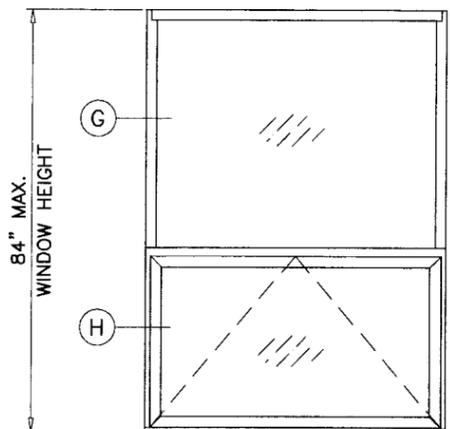


O/X
FIXED/PROJECT OUT WDW.

APPROVED CONFIGURATIONS

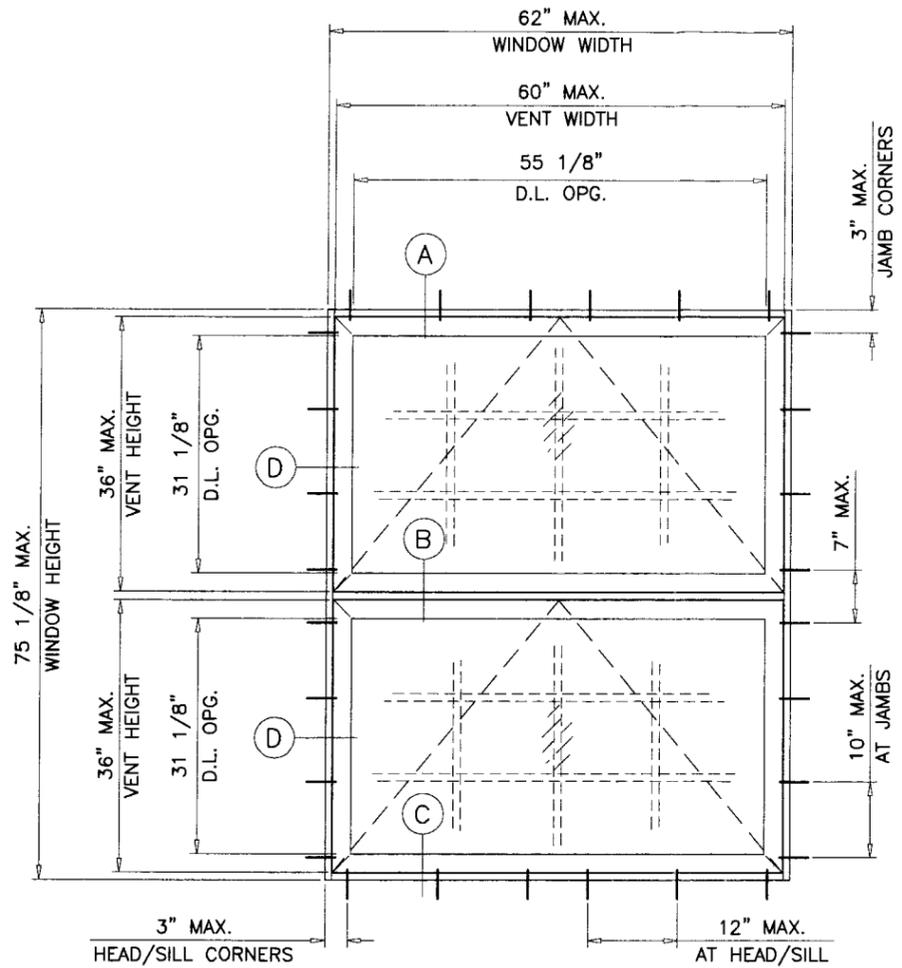

TYPICAL ELEVATION
TESTED UNITS

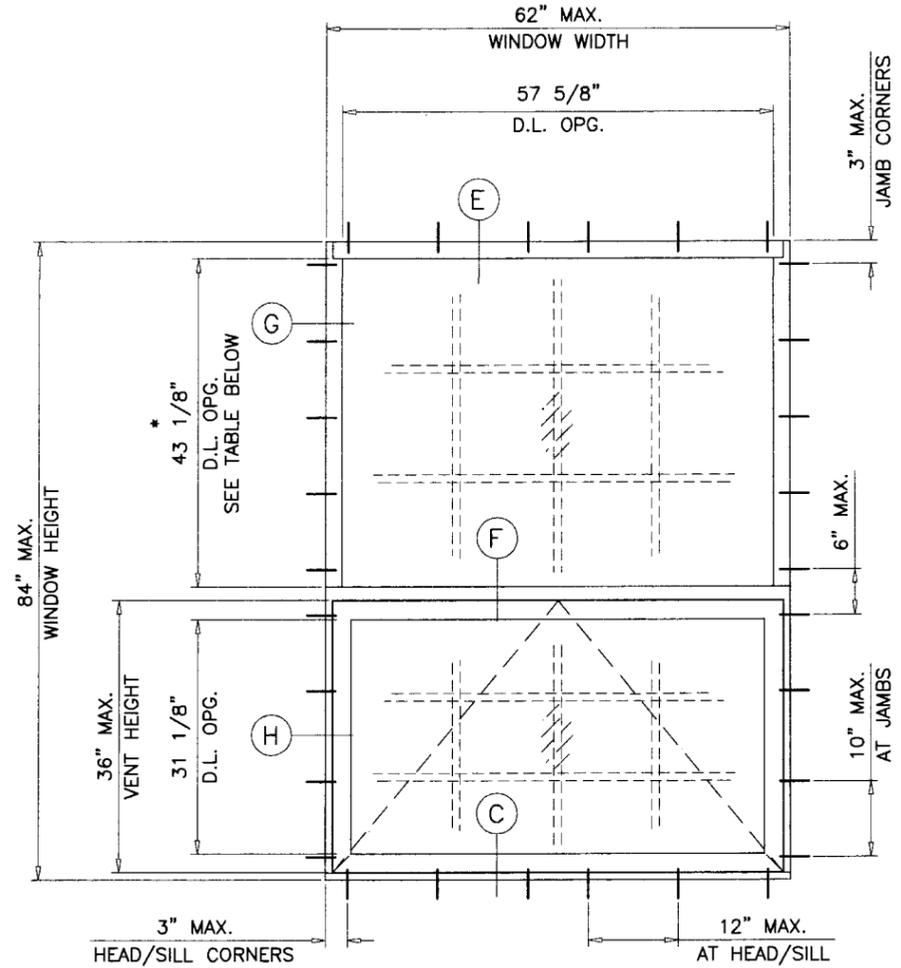

THESE WINDOWS ARE RATED FOR SMALL MISSILE IMPACT. MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS ARE REQUIRED FOR INSTALLATIONS UP TO 30 FT. OF GRADE. SHUTTERS NOT REQD. FOR INSTALLATIONS ABOVE 30 FT. OF GRADE.

**YOW 225H
NON THERMAL ALUMINUM PROJECT OUT WINDOWS**

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF PROJECTED/PROJECTED OR PROJECTED WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION (REV. 2005) INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004 FLORIDA BLDG. CODE SECTION 2003.8.4 (SUPPLEMENT 2005).

MAXIMUM DESIGN LOAD RATING = + 65.0 PSF
(FOR SIZES SHOWN OR SMALLER) - 65.0 PSF

**LAMINATED GLASS
SMALL MISSILE IMPACT**

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538
SEP 29 2006

Approved as complying with the Florida Building Code
Date: DEC 7 2006
NOA# 06-1016-04
Miami Dade Product Control
Division
By: *Manuel Perez*

afc
AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W06-57YKK


YKK AP AMERICA INC.
332 FIRETOWER ROAD
DUBLIN, GEORGIA 31021
TEL.(478) 277-1955 FAX(478) 277-1978

YOW 225H NON THERMAL ALUM PROJECT OUT WDW. (S.M.I.)


no	date	description

date: 09-23-06
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:
drawing no. **W06-57**
sheet 1 of 6

RECEIVED
 06 OCT 10 AM 11:45
 BUILDING CODE
 COMPLIANCE DEPARTMENT
 PRODUCT CONTROL SECTION

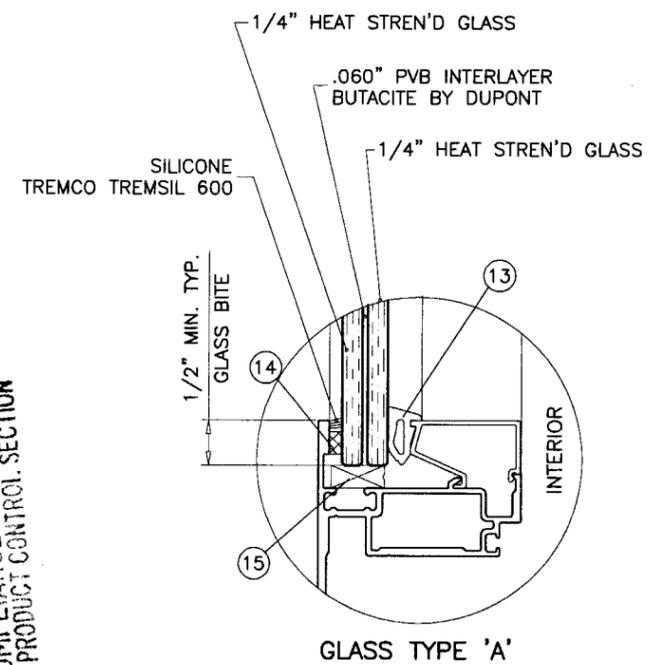

GLASS TYPE 'A'

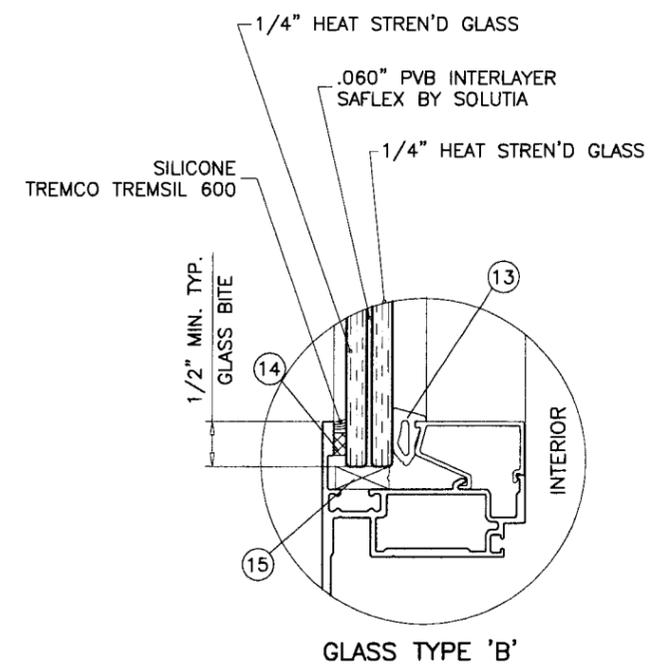

GLASS TYPE 'B'

GLAZING OPTIONS

NOTE:
 GLASS CAPACITIES ARE BASED ON
 ASTM E1300-02 (3 SEC. GUSTS)

SEALANTS:

FRAME CORNERS JOINTS SEALED WITH BUTYL RUBBER
 CORNER GASKET (#E2-0644).
 TREMCO SPECTRUM 2 SILICONE SEALANT AT PERIMETER.

WEEP HOLES:

W1 = 1/4" X 1-1/16" WEEP SLOT AT CENTERLINE.
 W2 = 9/32" DIA. WEEP HOLES AT 4" FROM EACH CORNER

LOCK OPTIONS:

BRONZECRAFT CAM HANDLES (E1-1541/1542)
 AT LOCK STILE OF VENT, 8" FROM EACH END
 SECURED WITH (2) #10 X 1/2" FH SMS.
 BRONZECRAFT KEEPERS (E1-1519)
 AT FRAME SILL/HORIZ. IMPOST FACING LOCKS
 SECURED WITH (2) #10 X 1/2" FH SMS.

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

Approved as complying with the
 Florida Building Code
 Date: DEC 7, 2006
 Drawn: 06-1016-04
 Miami-Dade Product Control
 Division
 SEP 29 2006
 [Signature]

afc

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W06-57YKK

YOW 225H NON THERMAL ALUM PROJECT OUT WDW. (S.M.I.)


YKK AP AMERICA INC.
 332 FIRETOWER ROAD
 DUBLIN, GEORGIA 31021
 TEL(478) 277-1955 FAX(478) 277-1978

no.	date	by	description

date: 09-23-06
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W06-57

sheet 2 of 6

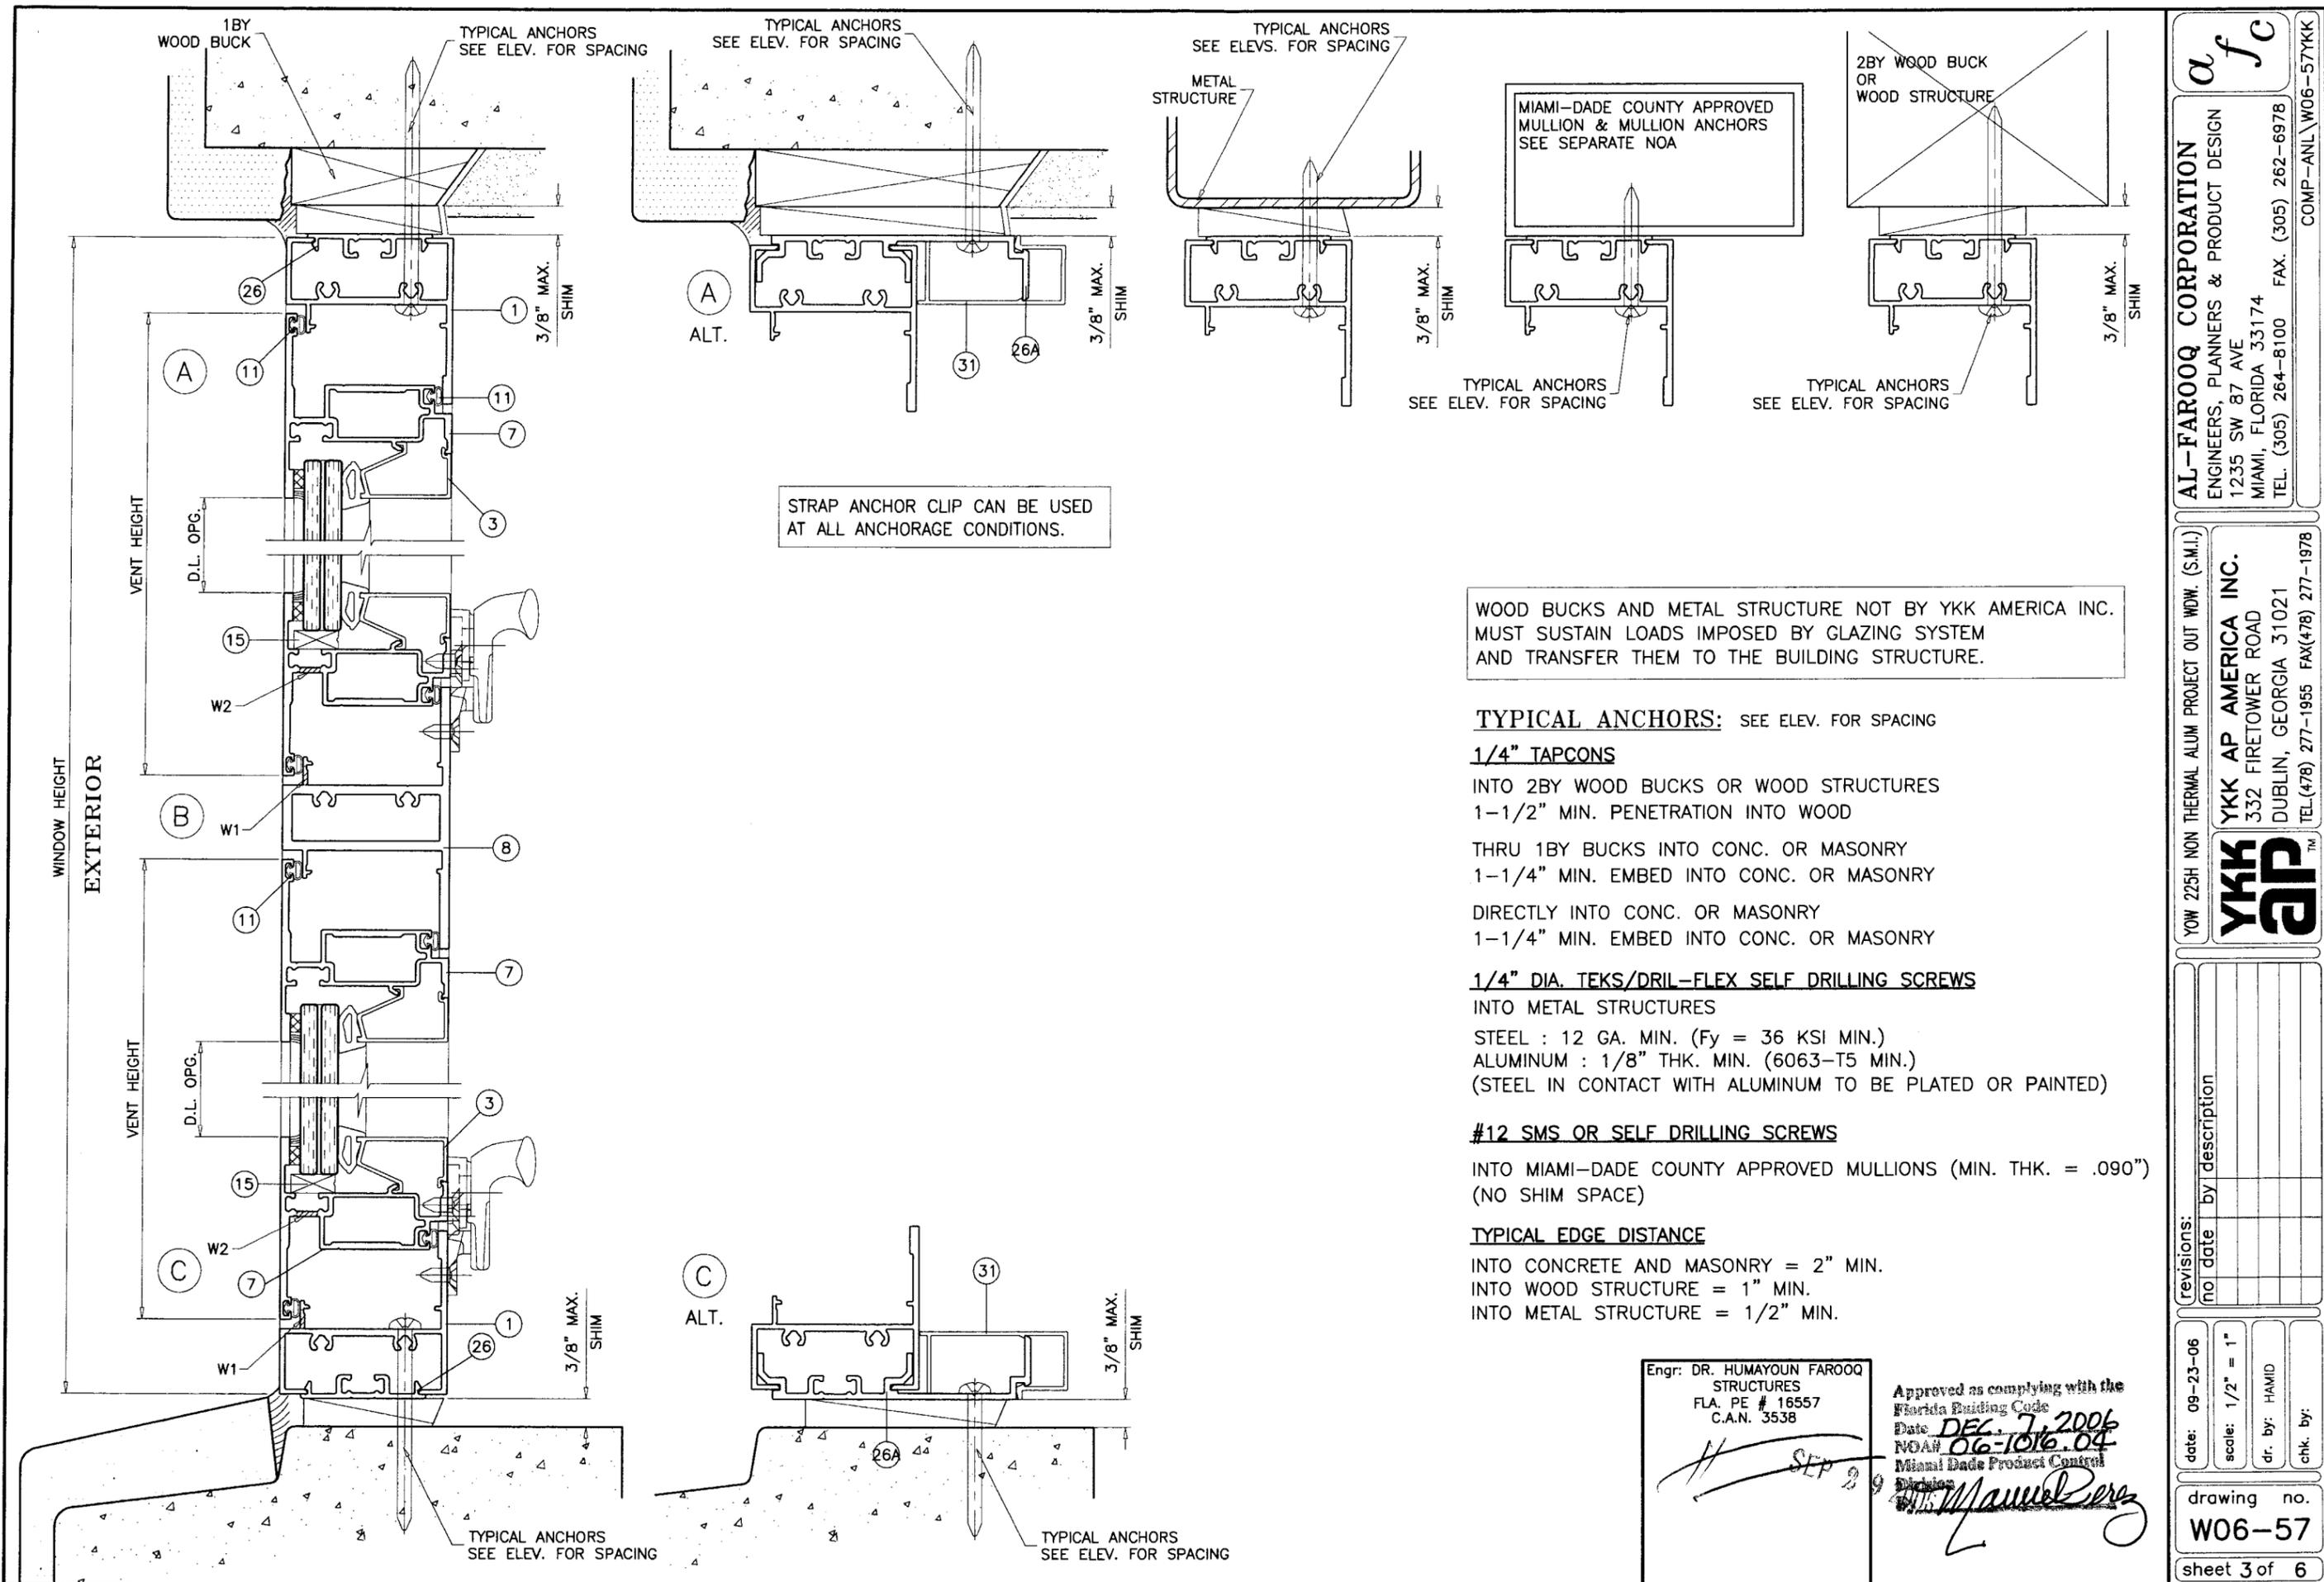

STRAP ANCHOR CLIP CAN BE USED AT ALL ANCHORAGE CONDITIONS.

WOOD BUCKS AND METAL STRUCTURE NOT BY YKK AMERICA INC. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

- 1/4" TAPCONS**
- INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD
- THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY
- DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

1/4" DIA. TEKS/DRIL-FLEX SELF DRILLING SCREWS

- INTO METAL STRUCTURES
- STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
- ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
- (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#12 SMS OR SELF DRILLING SCREWS

- INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
- (NO SHIM SPACE)

TYPICAL EDGE DISTANCE

- INTO CONCRETE AND MASONRY = 2" MIN.
- INTO WOOD STRUCTURE = 1" MIN.
- INTO METAL STRUCTURE = 1/2" MIN.

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

[Signature] SEP 29

Approved as complying with the
Florida Building Code
Date DEC 7 2006
NOAH 06-1016.04
Miami Dade Product Control
[Signature]

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W06-57YKK

YKK AP AMERICA INC.
332 FIRETOWER ROAD
DUBLIN, GEORGIA 31021
TEL.(478) 277-1955 FAX(478) 277-1978





YOW 25H NON THERMAL ALUM PROJECT OUT WDW. (S.M.I.)

no	date	by	description

date: 09-23-06
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W06-57

sheet 3 of 6

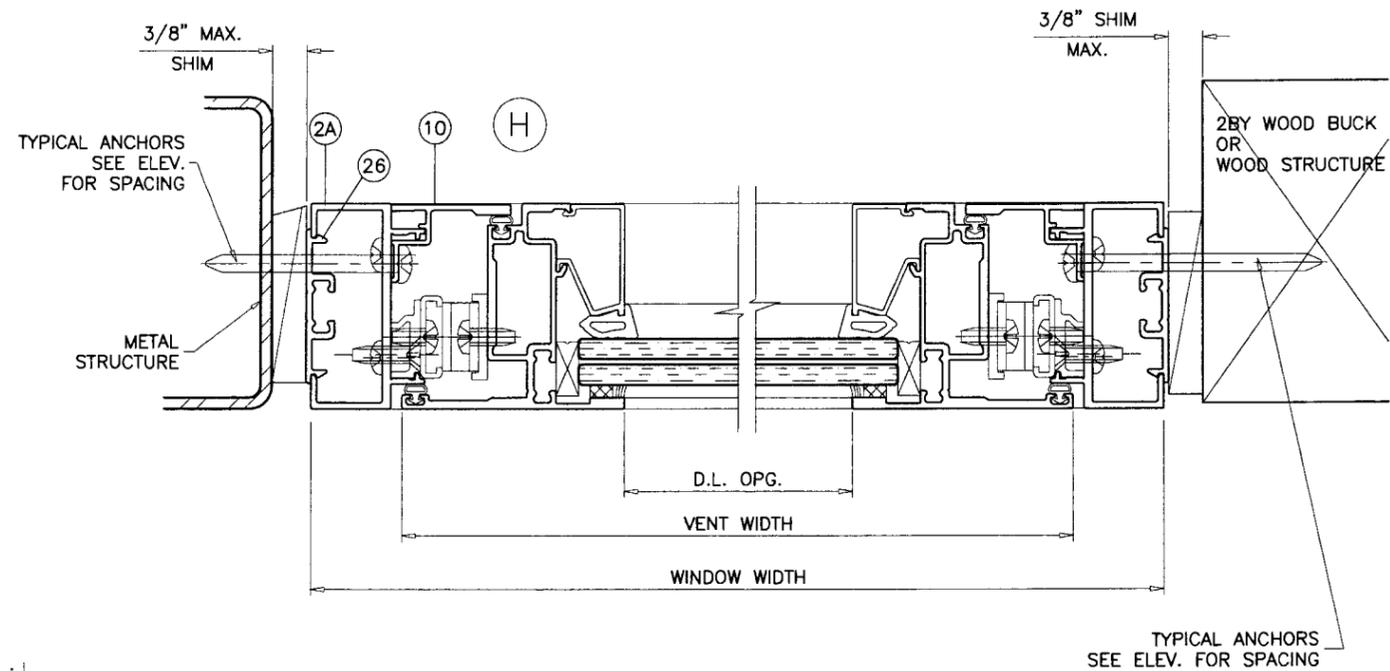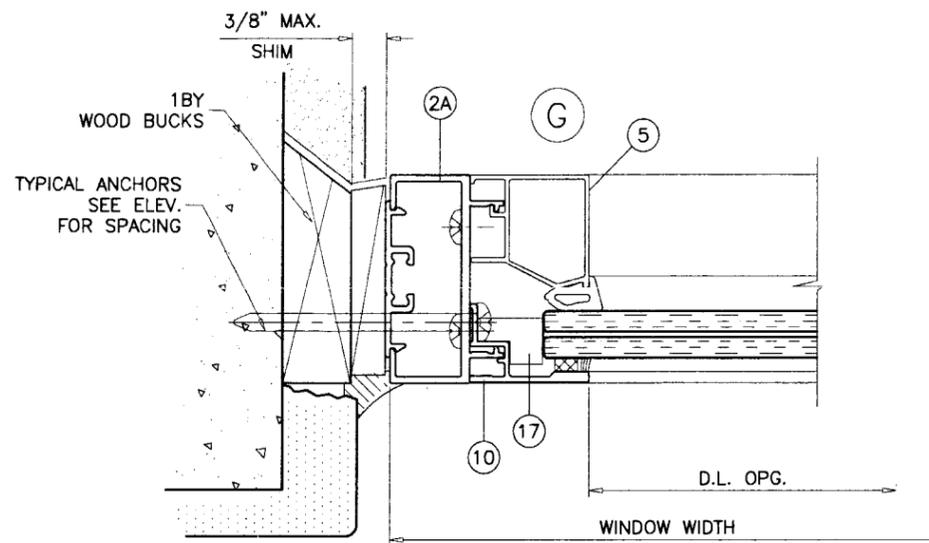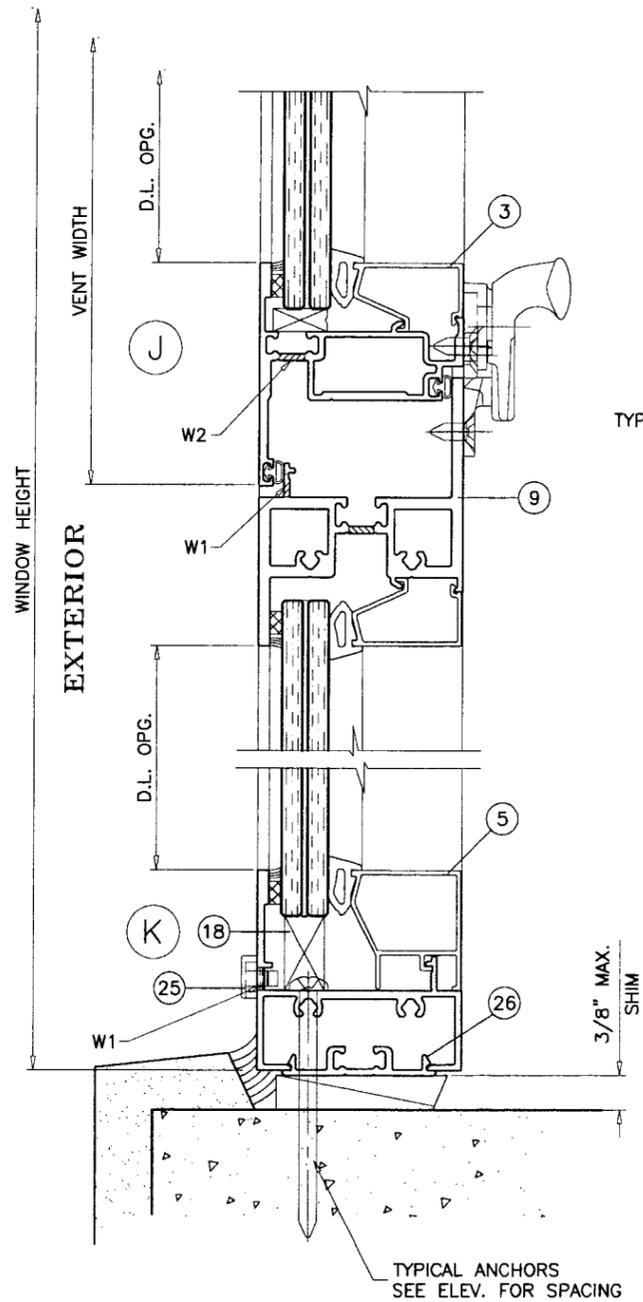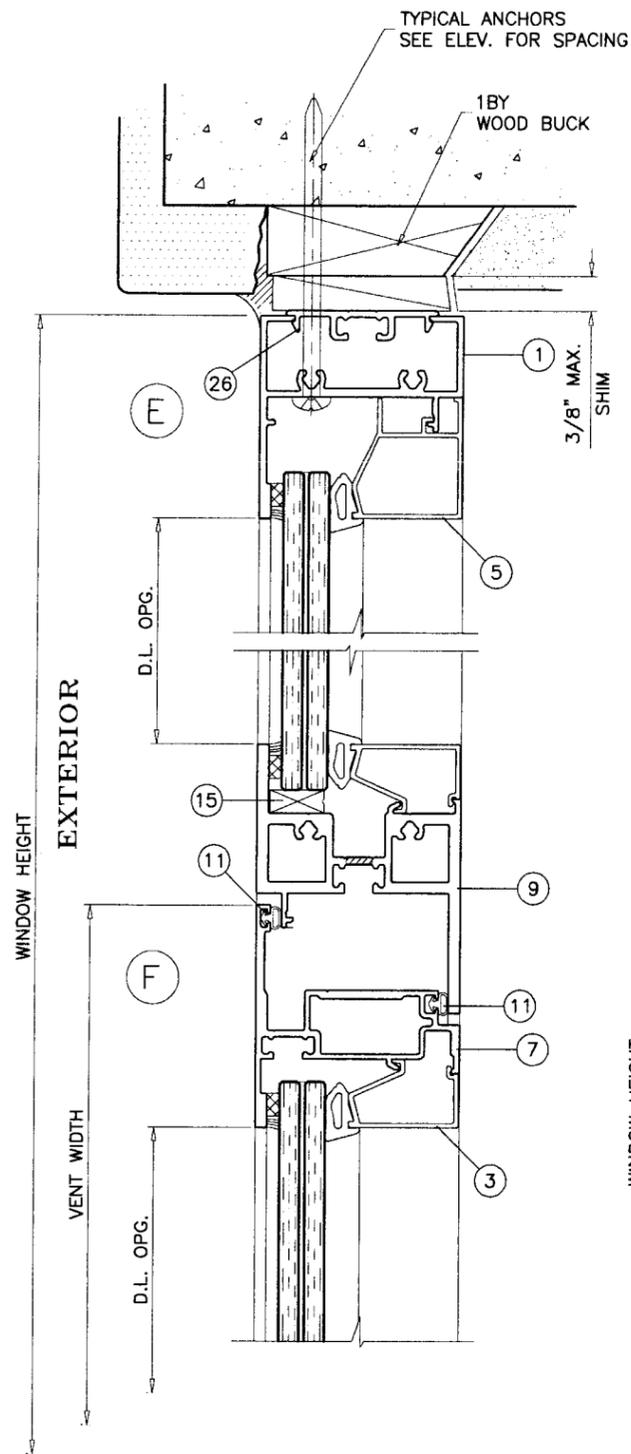

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

Approved as complying with the
Florida Building Code
Date **DEC 7 2006**
By **06-1016-04**
Miami Code Product Control
By *Mamud Drez*

SEP 29 2006

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

YKK AP AMERICA INC.
332 FIRETOWER ROAD
DUBLIN, GEORGIA 31021
TEL.(478) 277-1955 FAX(478) 277-1978

revisions:







no	date	by	description

date: 09-23-06
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W06-57
sheet 5 of 6

COMP-ANL\W06-57YKK

ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPLIER/REMARKS
1	E9-4536	2/ WDW	FRAME HEAD/SILL	6063-T5	YKK AMERICA INC.
2	E9-4537	2/ WDW	FRAME JAMB (VENT)	6063-T5	YKK AMERICA INC.
2A	E9-4538	AS REQD.	FRAME JAMB (FIX. LITE)	6063-T5	YKK AMERICA INC.
3	E9-4548	4/ WDW	GLAZING STOP (VENT)	6063-T5	YKK AMERICA INC.
5	E9-4549	4/ WDW	GLAZING STOP (FIX. LITE)	6063-T5	YKK AMERICA INC.
7	E9-4504	4/ WDW	VENT STILE	6063-T5	YKK AMERICA INC.
8	E9-4539	AS REQD.	HORIZ. IMPOST (X/X)	6063-T5	YKK AMERICA INC.
9	E9-4570	AS REQD.	HORIZ. IMPOST (X/O OR O/X)	6063-T5	YKK AMERICA INC.
10	E9-4513	AS REQD.	EXTERIOR GLAZING LEG	6063-T5	YKK AMERICA INC.
11	E2-0625	AS REQD.	BULB WEATHERSTRIPPING	PVC	YKK AMERICA INC.
12	E2-0051	AS REQD.	BULB W'STRIPPING AT MULLION	PVC	YKK AMERICA INC.
13	E2-0672	AS REQD.	WEDGE GASKET	EPDM	-
14	E2-0670	AS REQD.	BACKER TAPE FOR 1/8" F.C.	POLYURETHANE	-
15	E2-0737	AS REQD.	SETTING BLOCKS/SIDE BLOCKS (VENT)	EPDM	1/4" X 19/32" X 4" LONG
17	E2-0653	AS REQD.	SIDE BLOCKS (FIX. LITE)	EPDM	-
18	E2-0652	AS REQD.	SETTING BLOCKS (FIX. LITE)	EPDM	1/2" X 7/8" X 4" LONG
19	E1-1709	2/ VENT	16", 4-BAR SCISSOR HINGE	-	BRONZECRAFT
21	E1-1712	1/ CORNER	CORNER BLOCK	6063-T5	YKK AMERICA INC.
22	#10 X 1"	2/ CORNER	FRAME ASSEMBLY SCREWS	STEEL	PH SMS
23	E1-1711	2/ VENT	HINGE BASE	-	SECURED TO JAMB W/ (3) #10 X 3/4" FH SMS
24	E3-1105	2/ VENT	HINGE SPACER (10-1/2" LONG)	-	-
25	E3-1127	1/ WDW	WEEP COVER	NYLON	AT WEEP SLOTS (AT FIXED ONLY)
26	E9-4566	AS REQD.	FILLER PLATE, 3" LONG AT ANCHOR LOCATIONS	6063-T5	YKK AMERICA INC.
26A	E1-1779	AS REQD.	STRAP ANCHOR, 4-1/2" LONG AT ANCHOR LOCATIONS	6063-T5	YKK AMERICA INC.
29	#10 X 3/8"	3/ HINGE	HINGE INSTALLATION SCREWS	-	PH SMS
30	#10 X 1/2"	3/ HINGE	HINGE INSTALLATION SCREWS	-	PH SMS
31	E9-8431	AS REQD.	STRAP ANCHOR COVER	6063-T5	YKK AMERICA INC.

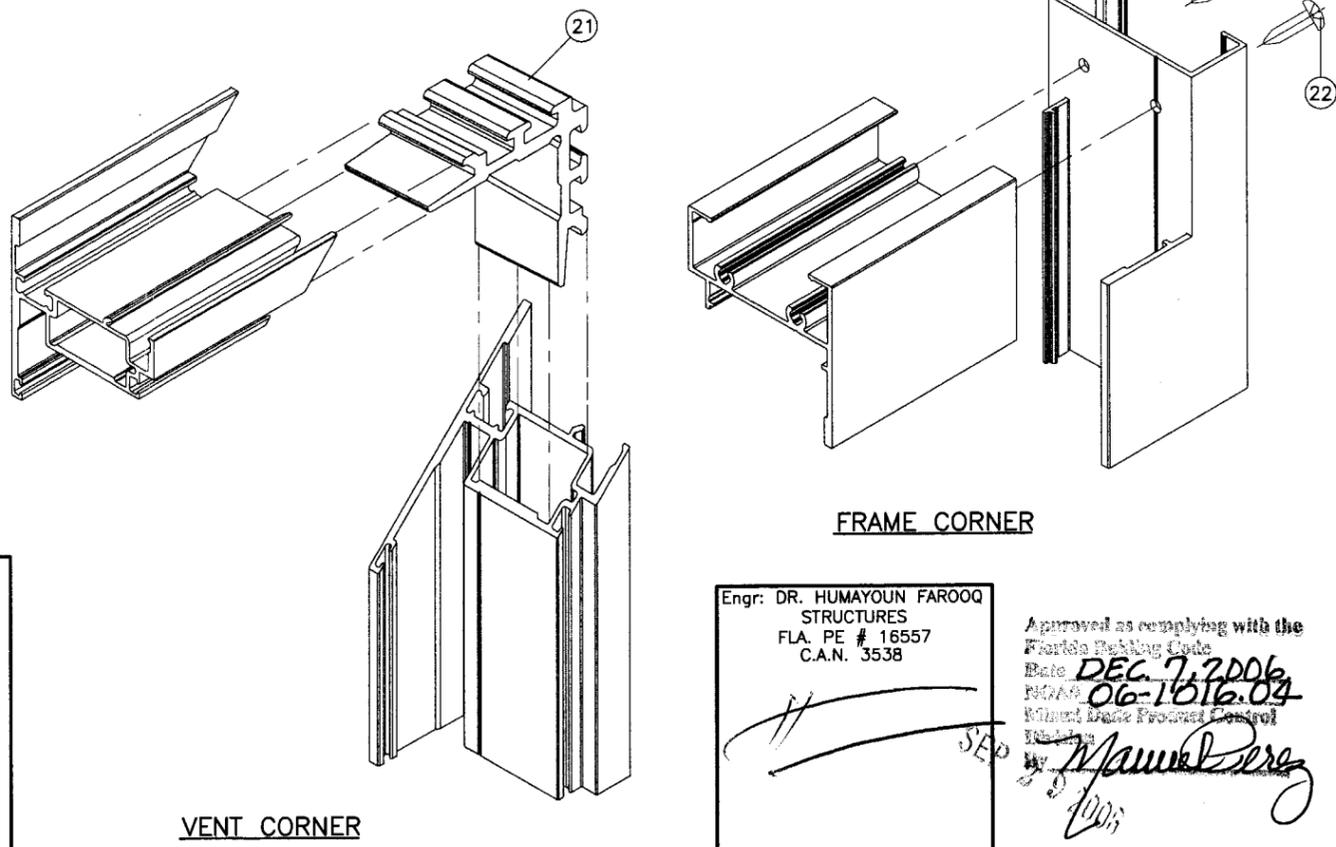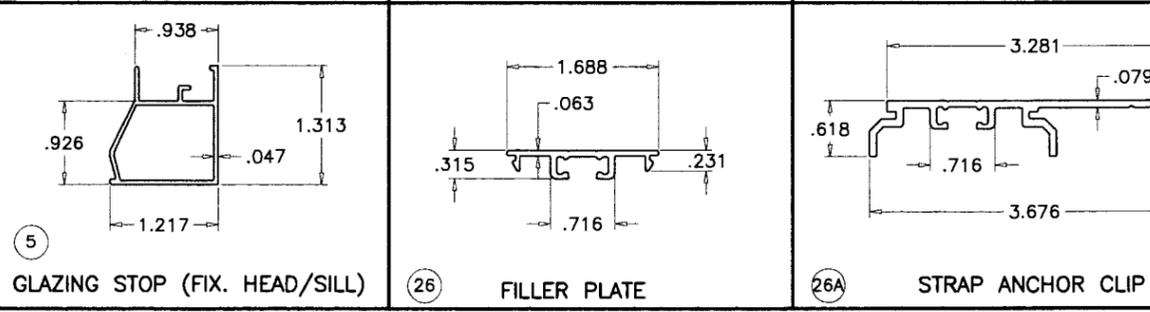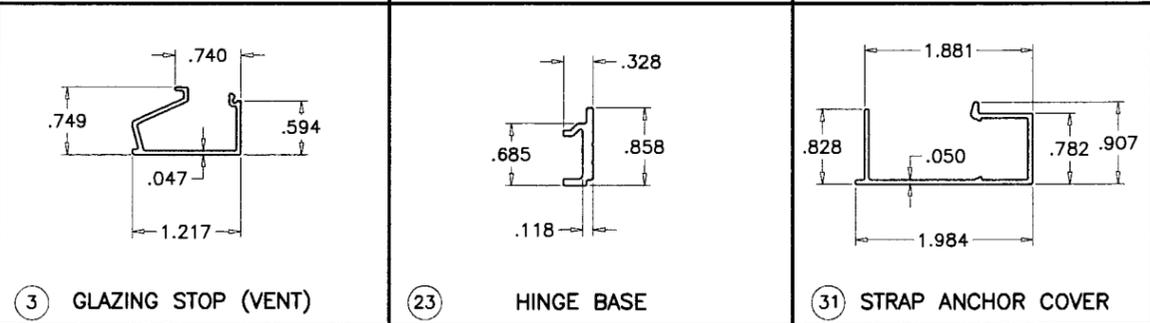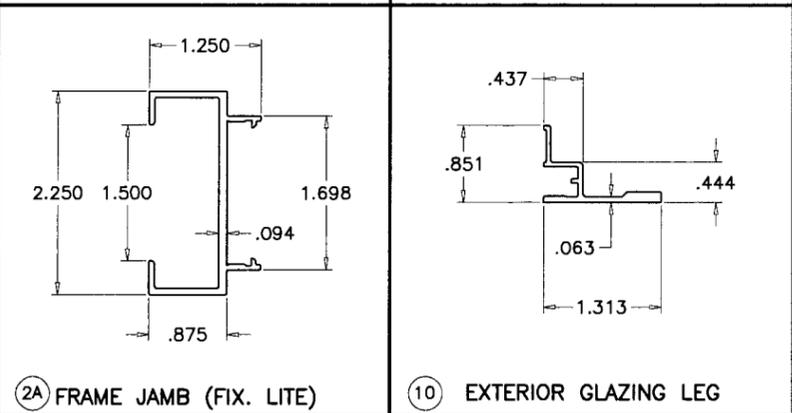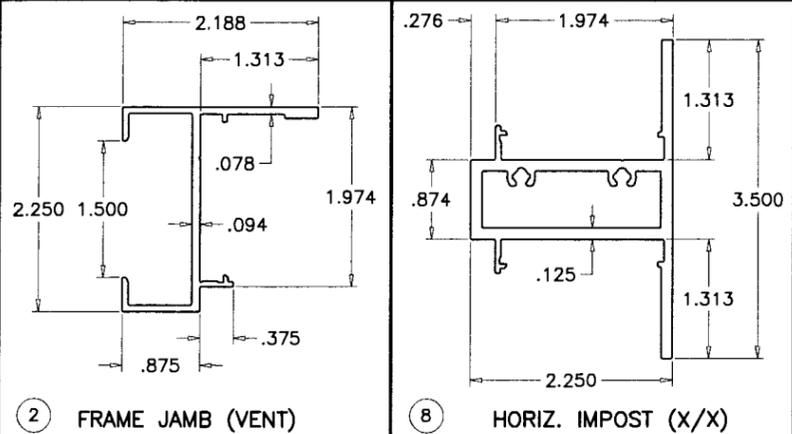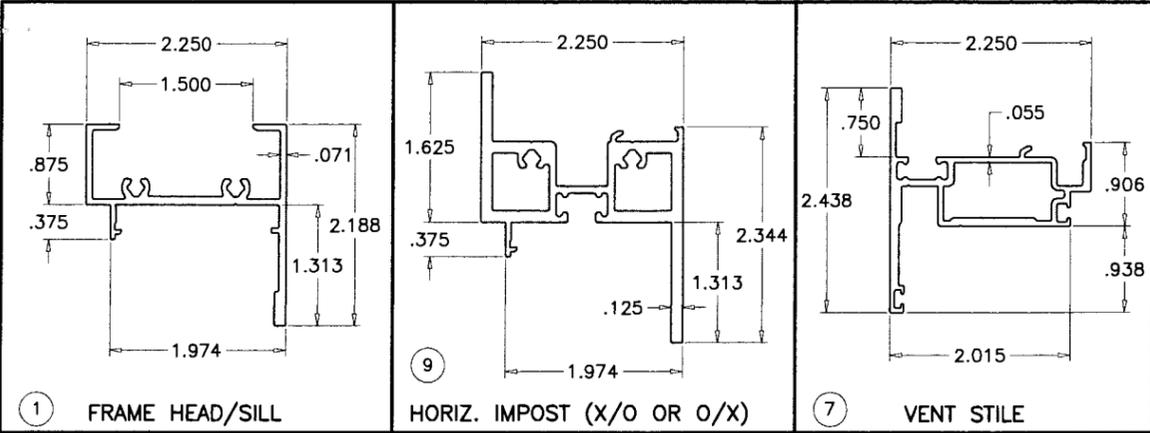

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

Approved as complying with the
Florida Building Code
Date DEC. 7, 2006
BY 06-1616.04
Must Make Final Control
Initials Maurice Perez

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W06-57YKK

YOW 225H NON THERMAL ALUM PROJECT OUT WDW. (S.M.I.)
YKK AP AMERICA INC.
332 FIRETOWER ROAD
DUBLIN, GEORGIA 31021
TEL.(478) 277-1955 FAX(478) 277-1978

revisions:	no	date	by	description
date:	09-23-06	scale:	1/2" = 1"	dr. by:
				HAMID
				chk. by:
drawing no.				
W06-57				
sheet 6 of 6				