



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

www.buildingcodeonline.com

**YKK AP America, Inc.
332 Firetower Road
Dublin, GA 31021**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series YOW 225H Non-Thermal Aluminum Fixed Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W06-60**, titled "YOW 225H Non Thermal Alum. Fixed Wdw. (L.M.I.)", sheets 1 through 5 of 5, dated 09/23/06, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No. 06-1016.07
Expiration Date: December 21, 2011
Approval Date: December 21, 2006
Page 1**

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W06-60**, Sheets 1 through 5 of 5, titled "YOW 225H Non Thermal Alum. Fixed Wdw. (L.M.I.)", dated 09/23/06, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Small Missile Impact Test per FBC, TAS 201-94
 - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 7) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94


along with marked-up drawings and installation diagram of an aluminum outswing casement window, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0231-1019-05**, Elev. A & B dated 10/28/05, Elev. C dated 11/03/05-11/09/05 and Elev. D dated 11/04/05-01/18/06, signed and sealed by Vinu J. Abraham, P. E.

2. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an aluminum project-out window, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0231-1019-05**, Elev. E dated 10/28/05-11/04/05 and Elev. O dated 11/08/05-01/18/06, signed and sealed by Vinu J. Abraham, P. E.

3. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Small Missile Impact Test per FBC, TAS 201-94
 - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of aluminum fixed window, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0231-1019-05**, Elev. F dated 10/28/05-01/23/06, Elev. G dated 10/28/05-01/24/06, Elev. H dated 11/07/05, Elev. I dated 01/23/06-01/26/06, Elev. J dated 10/28/05-01/25/06, Elev. J1 dated 11/07/05-01/24/06, Elev. K dated 11/01/05, Elev. L & M dated 10/31/05-01/20/06, and Elev. N dated 11/07/05-01/18/06, signed and sealed by Vinu J. Abraham, P. E.

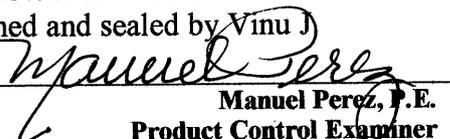
Manuel Perez, P.E.
Product Control Examiner
NOA No. 06-1016.07
Expiration Date: December 21, 2011
Approval Date: December 21, 2006

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

4. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum fixed window, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0231-0316-06**, Elev. H dated 03/27/06-03/28/06, signed & sealed by Vinu J. Abraham, P. E.

- C. **CALCULATIONS**
 1. Anchor Calculations and structural analysis, complying with FBC-2004, prepared by Al-Farooq Corporation, dated 09/15/06, signed and sealed by Humayoun Farooq, P.E.
Complies with ASTM E1300-02

- D. **QUALITY ASSURANCE**
 1. Miami Dade Building Code Compliance Office (BCCO).

- E. **MATERIAL CERTIFICATIONS**
 1. Notice of Acceptance No. **03-0415.13** issued to Solutia Inc. for their "**Vanceva Composites used for lamination of glass**" dated 12/11/03, expiring on 12/11/08.
 2. Notice of Acceptance No. **04-0816.02** issued to E.I. DuPont DeNemours for "**DuPont Butacite "ST" PVB Material**" dated 02/04/05, expiring on 02/04/10.
 3. Notice of Acceptance No. **01-0205.02** issued to Solutia Inc. for their "**Saflex / Keepsafe Maximum**" dated 05/17/01, expiring on 05/21/06.

- F. **STATEMENTS**
 1. Statement letter of conformance, dated September 15, 2006, signed and sealed by Humayoun Farooq, P.E.
 2. Statement letter of no financial interest, dated September 15, 2006, signed and sealed by Humayoun Farooq, P.E.
 3. Laboratory compliance letter for Test Reports No. HTL-0231-1019-05 and HTL-0231-0316-06, issued by Hurricane Test Laboratory, LLC, dated April 18, 2006, signed and sealed by Vinu J. Abraham, P.E.

- G. **OTHER**
 1. None.


Manuel Perez, P.E.

Product Control Examiner
NOA No. 06-1016.07

Expiration Date: December 21, 2011
Approval Date: December 21, 2006

THESE WINDOWS ARE RATED FOR LARGE MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

**YOW 225H
NON THERMAL ALUMINUM FIXED WINDOWS**

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIXED/FIXED OR FIXED WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION (REV. 2005) INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004 FLORIDA BLDG. CODE SECTION 2003.8.4 (SUPPLEMENT 2005).

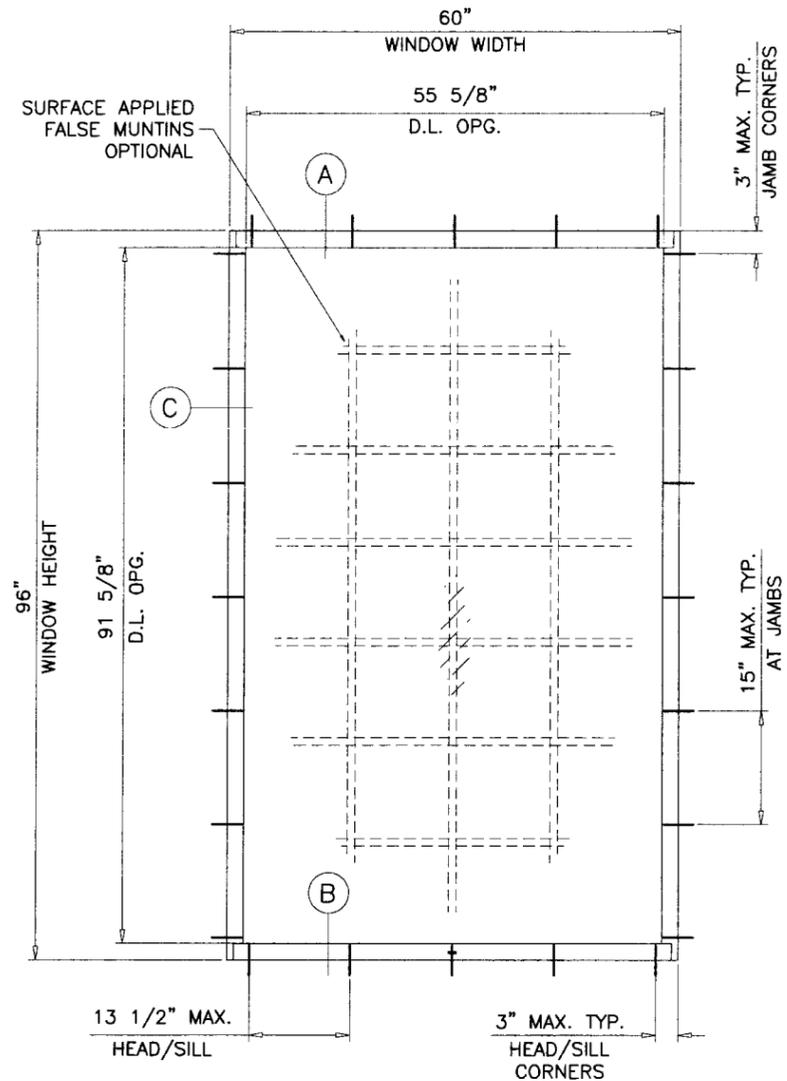

TYPICAL ELEVATION
TESTED UNIT

**LAMINATED GLASS
LARGE MISSILE IMPACT**

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538
NOV 27 2006

Approved as complying with the
Florida Building Code
Date DEC. 21 2006
NOAS 06-1016.07
Miami Dade Product Control
Division
By [Signature]

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W06-60YKK

YKK AP AMERICA INC.
332 FIRETOWER ROAD
DUBLIN, GEORGIA 31021
TEL.(478) 277-1955 FAX(478) 277-1978

YOW 225H NON THERMAL ALUM FIXED WDW. (L.M.I.)

no	date	by	description


date: 09-23-06
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W06-60




sheet 1 of 5

DESIGN LOAD CAPACITY - PSF					
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPES 'B' OR 'C'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
18"	36"	80.0	90.0	65.0	65.0
24"		80.0	90.0	65.0	65.0
30"		80.0	90.0	65.0	65.0
36"		80.0	90.0	65.0	65.0
42"		80.0	90.0	65.0	65.0
48"		80.0	90.0	65.0	65.0
54"		80.0	90.0	65.0	65.0
60"	80.0	90.0	65.0	65.0	
18"	48"	80.0	90.0	65.0	65.0
24"		80.0	90.0	65.0	65.0
30"		80.0	90.0	65.0	65.0
36"		80.0	90.0	65.0	65.0
42"		80.0	90.0	65.0	65.0
48"		80.0	90.0	65.0	65.0
54"		80.0	90.0	65.0	65.0
60"	80.0	90.0	65.0	65.0	
18"	60"	80.0	90.0	65.0	65.0
24"		80.0	90.0	65.0	65.0
30"		80.0	90.0	65.0	65.0
36"		80.0	90.0	65.0	65.0
42"		80.0	90.0	65.0	65.0
48"		80.0	90.0	65.0	65.0
54"		80.0	90.0	65.0	65.0
60"	80.0	90.0	65.0	65.0	
18"	72"	80.0	90.0	65.0	65.0
24"		80.0	90.0	65.0	65.0
30"		80.0	90.0	65.0	65.0
36"		80.0	90.0	65.0	65.0
42"		80.0	90.0	65.0	65.0
48"		80.0	90.0	65.0	65.0
54"		80.0	90.0	65.0	65.0
60"	70.0	90.0	65.0	65.0	
18"	84"	80.0	90.0	65.0	65.0
24"		80.0	90.0	65.0	65.0
30"		80.0	90.0	65.0	65.0
36"		80.0	90.0	65.0	65.0
42"		80.0	90.0	65.0	65.0
48"		80.0	90.0	65.0	65.0
54"		70.0	90.0	65.0	65.0
60"	70.0	90.0	-	-	
18"	90"	80.0	90.0	65.0	65.0
24"		80.0	90.0	65.0	65.0
30"		80.0	90.0	65.0	65.0
36"		80.0	90.0	65.0	65.0
42"		80.0	90.0	65.0	65.0
48"		70.0	90.0	65.0	65.0
54"		70.0	90.0	-	-
60"	70.0	90.0	-	-	

DESIGN LOAD CAPACITY - PSF					
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPES 'B' OR 'C'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
18"	96"	80.0	90.0	65.0	65.0
24"		80.0	90.0	65.0	65.0
30"		80.0	90.0	65.0	65.0
36"		80.0	90.0	65.0	65.0
42"		80.0	90.0	65.0	65.0
48"		70.0	90.0	65.0	65.0
54"		70.0	90.0	-	-
60"	70.0	90.0	-	-	
18"	108"	80.0	90.0	65.0	65.0
24"		80.0	90.0	65.0	65.0
30"		80.0	90.0	65.0	65.0
36"		80.0	90.0	65.0	65.0
42"		70.0	90.0	65.0	65.0
48"		70.0	90.0	-	-
54"		70.0	90.0	-	-
60"	70.0	90.0	-	-	
18"	120"	80.0	90.0	65.0	65.0
24"		80.0	90.0	65.0	65.0
30"		80.0	90.0	65.0	65.0
36"		70.0	90.0	65.0	65.0
42"		70.0	90.0	-	-
48"		70.0	90.0	-	-
54"		70.0	90.0	-	-

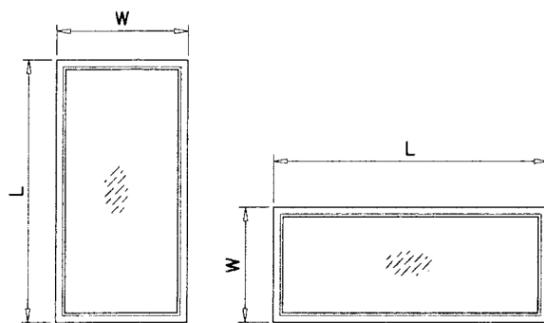

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

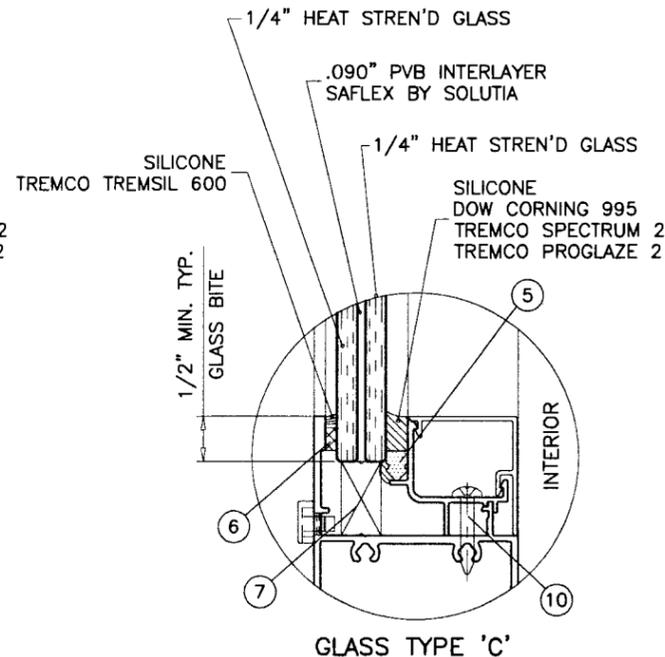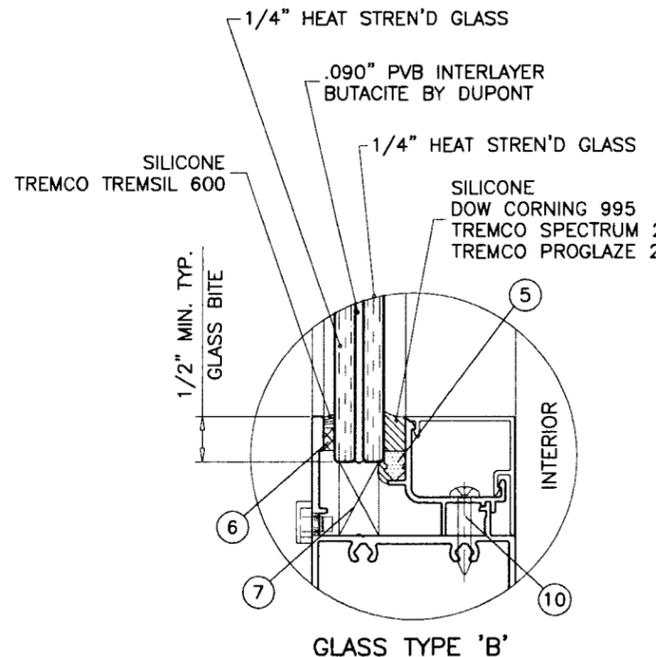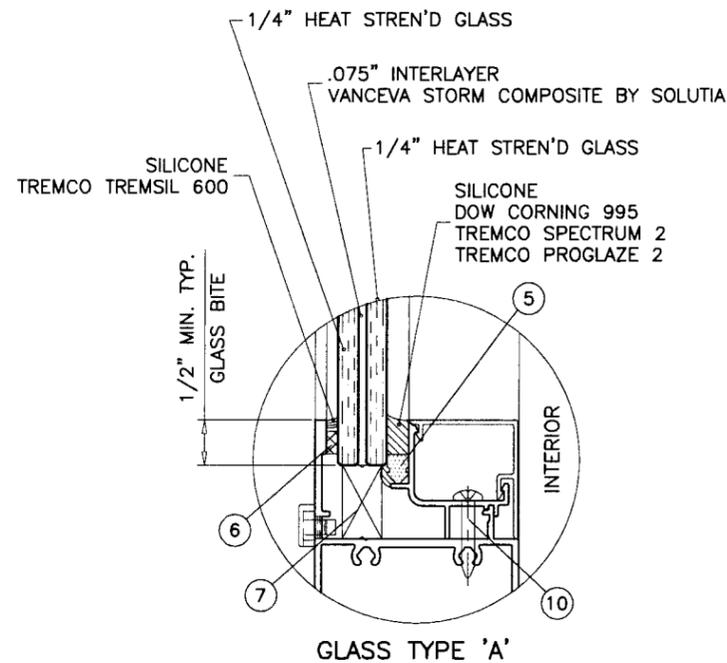

GLAZING OPTIONS

DESIGN LOAD CAPACITY - PSF					
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPES 'B' OR 'C'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	26"	80.0	90.0	65.0	65.0
26-1/2"		80.0	90.0	65.0	65.0
37"		80.0	90.0	65.0	65.0
48"		80.0	90.0	65.0	65.0
53-1/8"		80.0	90.0	65.0	65.0
19-1/8"	38-3/8"	80.0	90.0	65.0	65.0
26-1/2"		80.0	90.0	65.0	65.0
37"		80.0	90.0	65.0	65.0
48"	50-5/8"	80.0	90.0	65.0	65.0
53-1/8"		80.0	90.0	65.0	65.0
19-1/8"		58"	80.0	90.0	65.0
26-1/2"	80.0		90.0	65.0	65.0
37"	80.0		90.0	65.0	65.0
48"	80.0		90.0	65.0	65.0
53-1/8"	80.0		90.0	65.0	65.0
19-1/8"	63"	80.0	90.0	65.0	65.0
26-1/2"		80.0	90.0	65.0	65.0
37"		80.0	90.0	65.0	65.0
48"		80.0	90.0	65.0	65.0
53-1/8"		80.0	90.0	65.0	65.0
19-1/8"	74-1/4"	80.0	90.0	65.0	65.0
26-1/2"		80.0	90.0	65.0	65.0
37"		80.0	90.0	65.0	65.0
48"		80.0	90.0	65.0	65.0
53-1/8"		80.0	90.0	65.0	65.0

NOTE:
GLASS CAPACITIES ARE BASED ON
ASTM E1300-02 (3 SEC. GUSTS)

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538






Approved as complying with the
Florida Building Code
Date: DEC 21, 2006
MIAA 06-1016.07
Miami Dade Product Control
Division
By: *Manuel Diaz*

NOV 27 2006

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978


YKK AP AMERICA INC.
332 FIRETOWER ROAD
DUBLIN, GEORGIA 31021
TEL.(478) 277-1955 FAX(478) 277-1978

revisions:	no	date	by	description
date:	09-23-06	scale:	1/2" = 1"	
dr. by:	HAMID	chk. by:		
drawing no.	W06-60			
sheet	2 of 5			

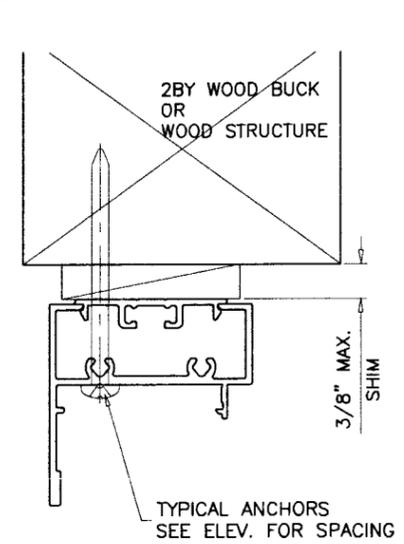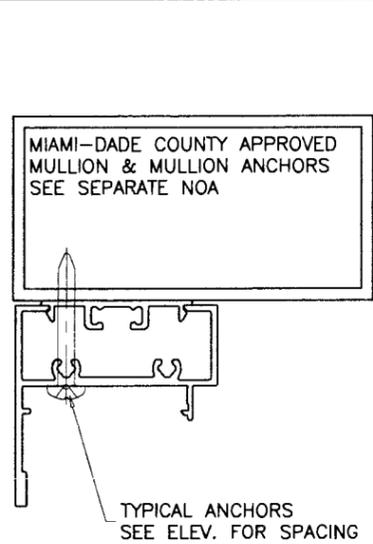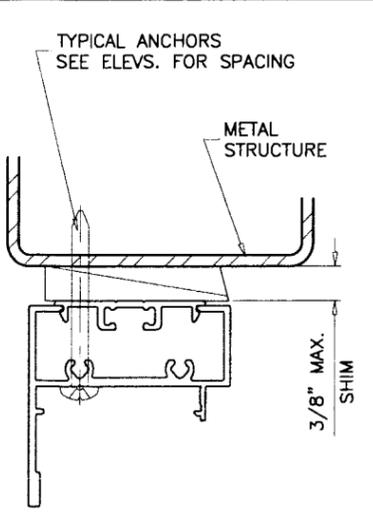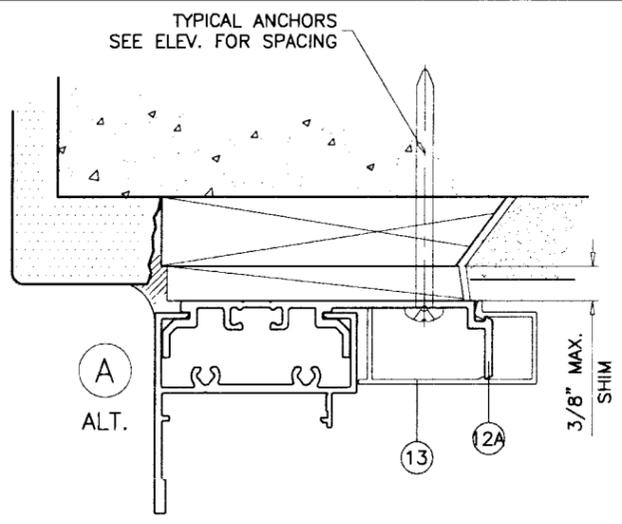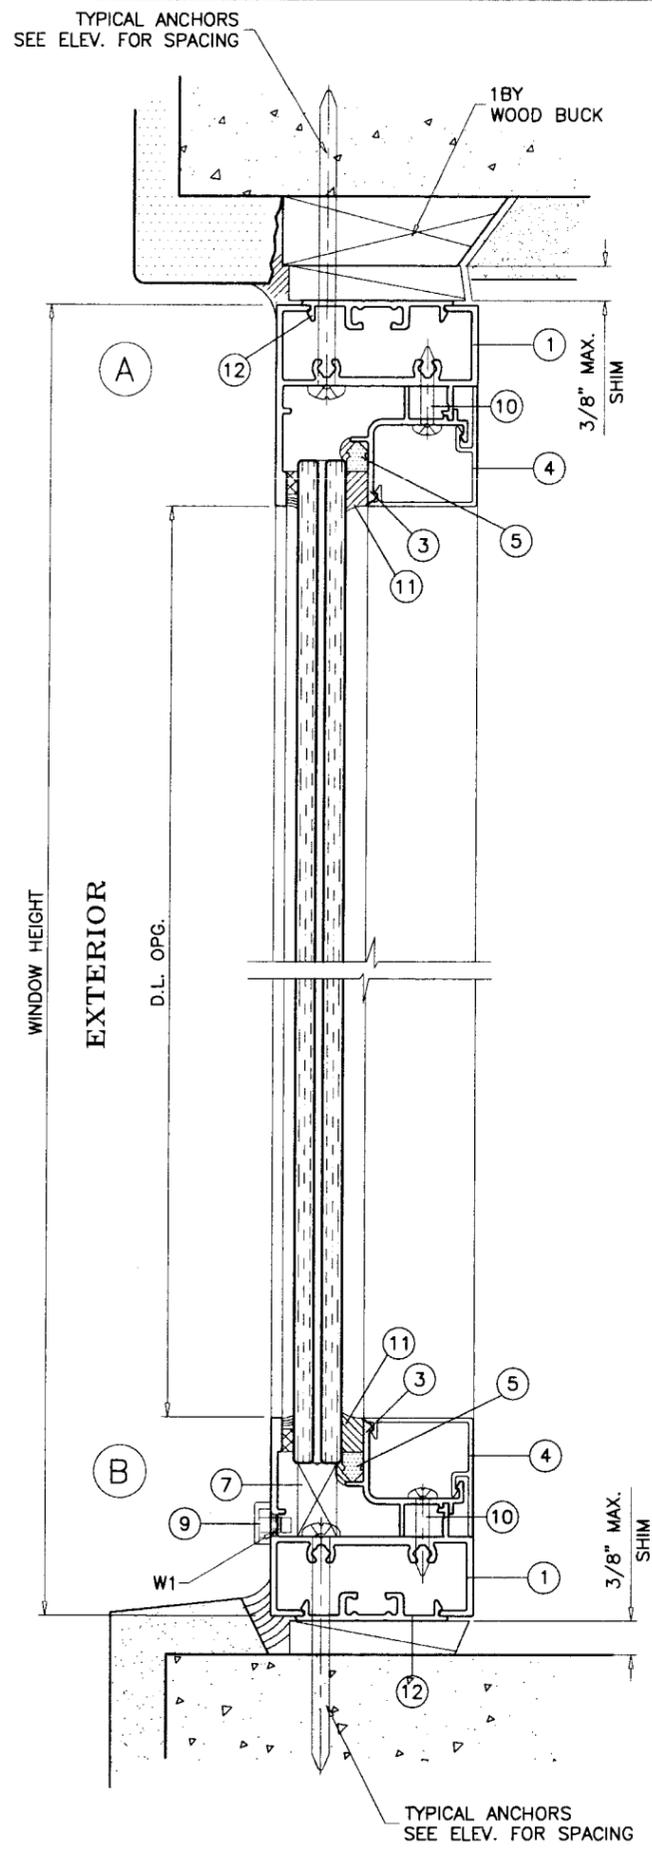

STRAP ANCHOR CLIP CAN BE USED AT ALL ANCHORAGE CONDITIONS.

WOOD BUCKS AND METAL STRUCTURE NOT BY YKK AMERICA INC. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

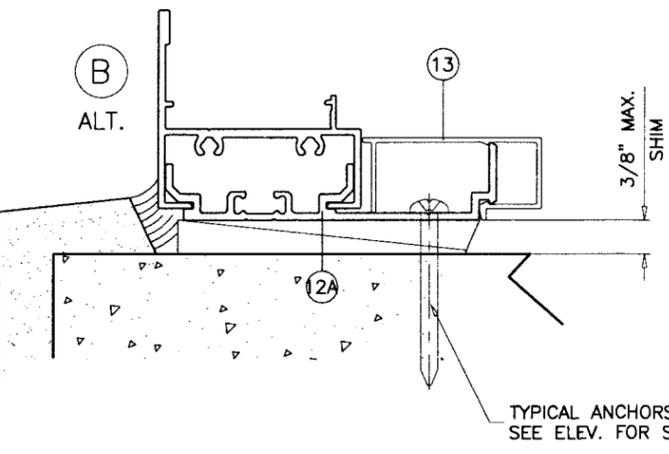

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

- 1/4" TAPCONS**
- INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD
- THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY
- DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

- 1/4" DIA. TEKS/DRIL-FLEX SELF DRILLING SCREWS**
- INTO METAL STRUCTURES
- STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
- ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
- (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

- #12 SMS OR SELF DRILLING SCREWS**
- INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
- (NO SHIM SPACE)

- TYPICAL EDGE DISTANCE**
- INTO CONCRETE AND MASONRY = 2" MIN.
- INTO WOOD STRUCTURE = 1" MIN.
- INTO METAL STRUCTURE = 1/2" MIN.

- SEALANTS:**
- FRAME CORNERS JOINTS SEALED WITH BUTYL RUBBER
- CORNER GASKET (#E2-0644).
- TREMCO SPECTRUM 2 SILICONE SEALANT AT PERIMETER.

- WEEP HOLES:**
- W1 = 1/4" X 1-1/16" WEEP SLOT AT CENTERLINE.

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

NOV 27 2006

Approved as complying with the
Florida Building Code
Date: DEC 21 2006
NOA# 06-1016-07
Miami Dade Product Control
Division
By: *Manuel Perez*





AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

YOW 225H NON THERMAL ALUM FIXED WDW. (L.M.I.)
YKK AP AMERICA INC.
332 FIRETOWER ROAD
DUBLIN, GEORGIA 31021
TEL.(478) 277-1955 FAX(478) 277-1978

revisions:	
no	date by description

date: 09-23-06	scale: 1/2" = 1"	dr. by: HAMID	chk. by:
drawing no. W06-60			
sheet 3 of 5			

afc
COMP-ANL\W06-60YKK

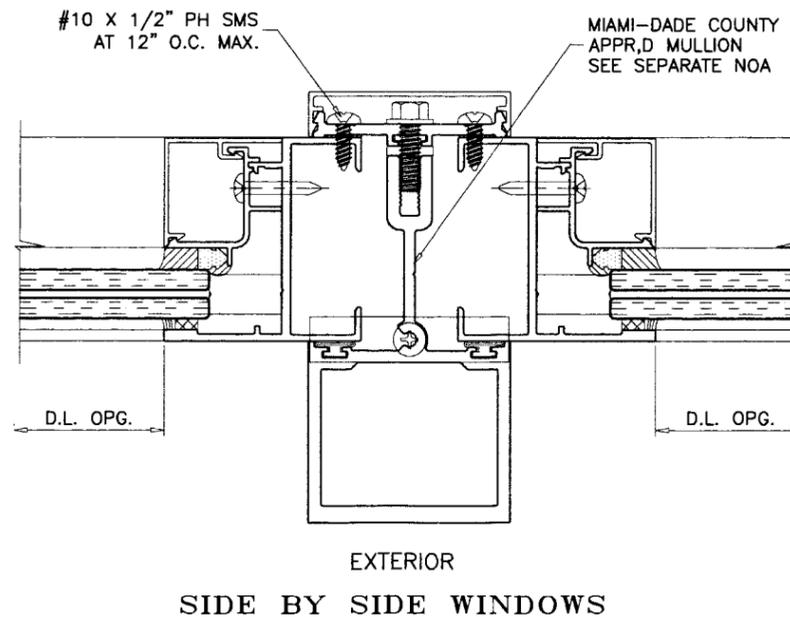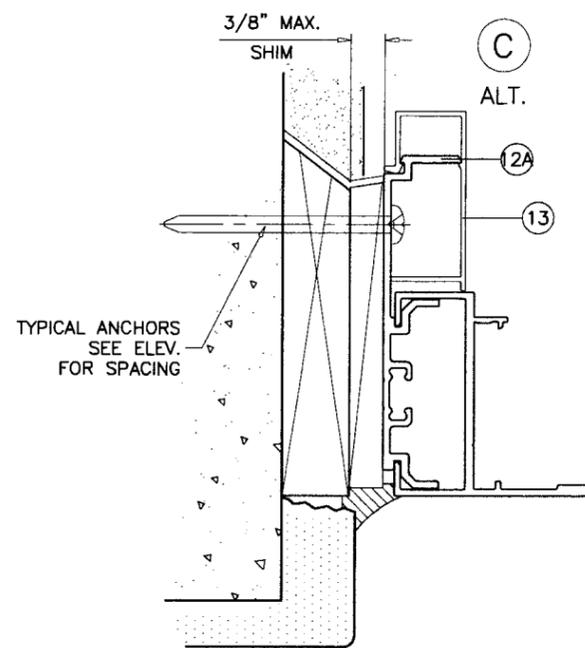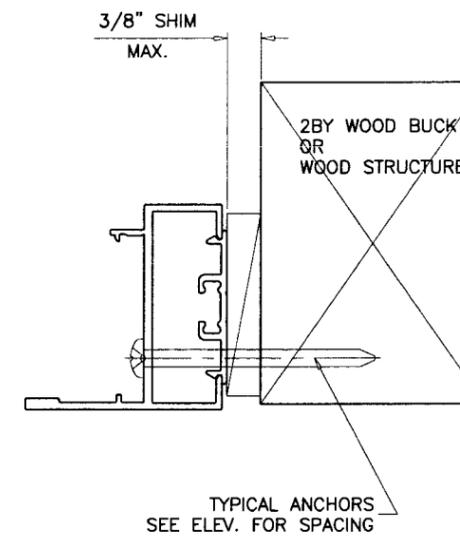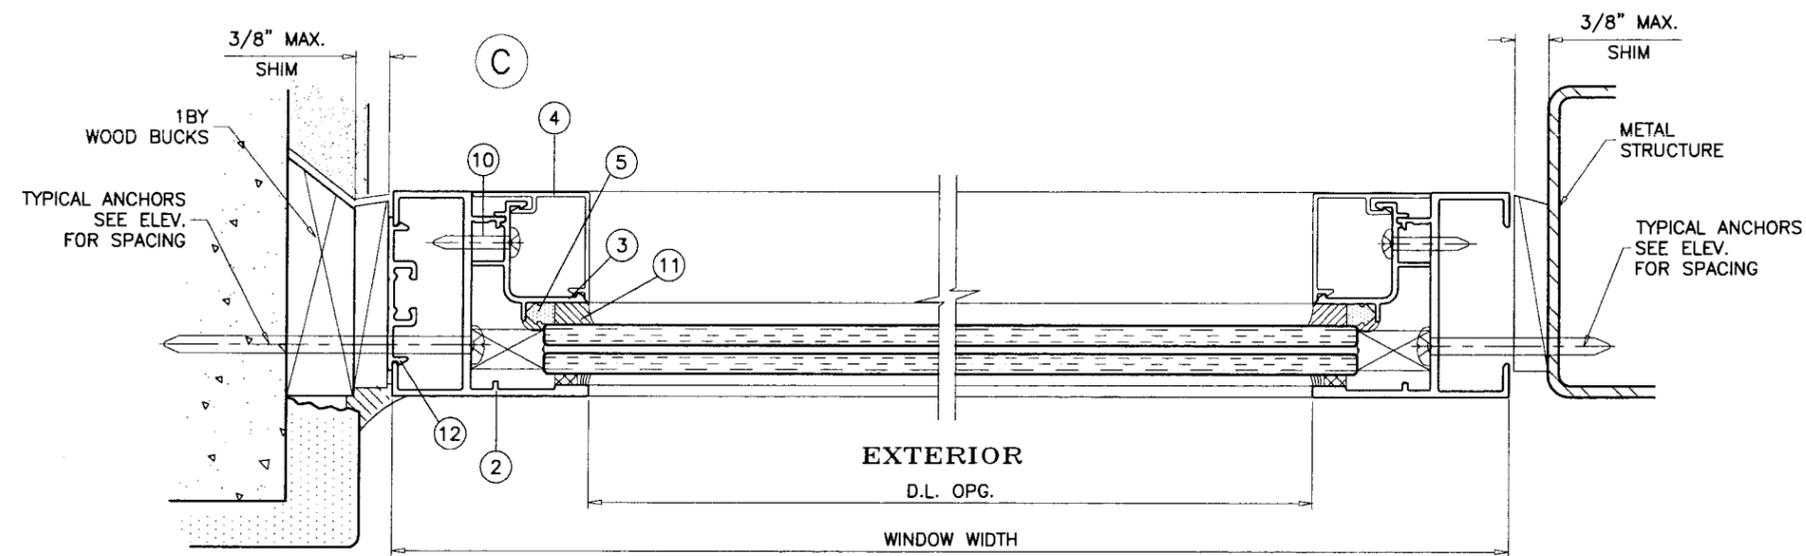

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

Approved as complying with the
Florida Building Code
Date **DEC. 21, 2006**
NOA# **06-1016-07**
Miami Dade Product Control
Division
By *Manuel Perez*

NOV 27 2006

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W06-60YKK

YOW 225H NON THERMAL ALUM FIXED WDW. (L.M.I.)


YKK AP AMERICA INC.
332 FIRETOWER ROAD
DUBLIN, GEORGIA 31021
TEL.(478) 277-1955 FAX(478) 277-1978

no	date	description


date: 09-23-06	scale: 1/2" = 1"	dr. by: HAMID	chk. by:
----------------	------------------	---------------	----------

drawing no.
W06-60


sheet 4 of 5

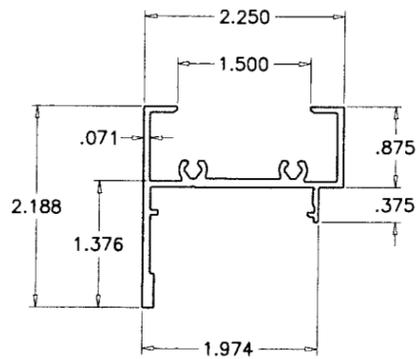


① FRAME HEAD/SILL

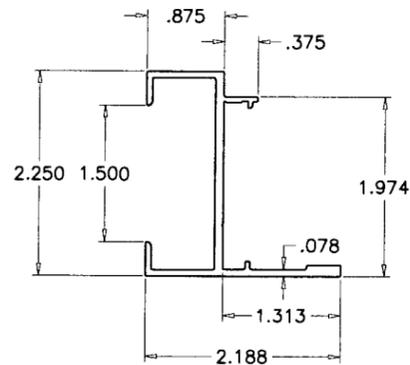


② FRAME JAMB

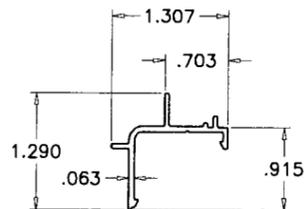


③ GLAZING STOP




④ GLAZING STOP COVER

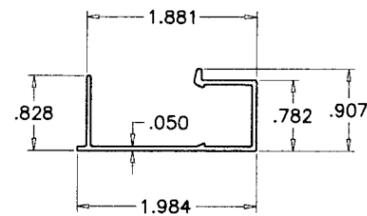

⑬ STRAP ANCHOR COVER

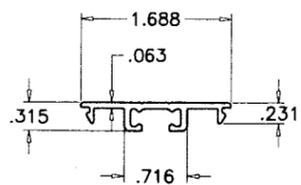


⑫ FILLER PLATE

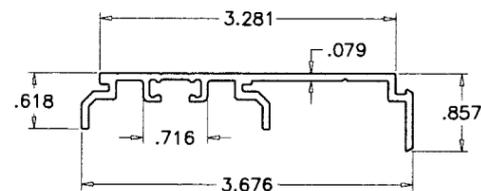

⑫A STRAP ANCHOR CLIP

ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPLIER/REMARKS
1	E9-4536	2/ WDW	FRAME HEAD/SILL	6063-T5	YKK AMERICA INC.
2	E9-4537	2/ WDW	FRAME JAMB	6063-T5	YKK AMERICA INC.
3	E9-4544	4/ WDW	GLAZING STOP	6063-T5	YKK AMERICA INC.
4	E9-4545	4/ WDW	GLAZING STOP COVER	6063-T5	YKK AMERICA INC.
5	E2-0359	AS REQD.	ARROW SPACER, 1" LONG	EPDM SPONGE	AT 3" FROM ENDS & 8" O.C. MAX.
6	E2-0670	AS REQD.	BACKER TAPE FOR 1/8" F.C.	POLYURETHANE	-
7	E2-0652	AS REQD.	SETTING BLOCKS/SIDE BLOCKS	EPDM	1/2" X 7/8" X 4" LONG
8	#10 X 1"	2/ CORNER	FRAME ASSEMBLY SCREWS	STEEL	PH SMS
9	E3-1127	1/ WDW	WEEP COVER	NYLON	AT WEEP SLOTS
10	#10 X 1"	-	GLAZING STOP SCREWS	-	PH SMS AT 3" FROM ENDS & 8" O.C.
11	-	AS REQD.	GLAZING COMPOUND	SILICONE	-
12	E9-4566	AS REQD.	FILLER PLATE, 3" LONG AT ANCHOR LOCATIONS	6063-T5	YKK AMERICA INC.
12A	E1-1779	AS REQD.	STRAP ANCHOR, 4-1/2" LONG AT ANCHOR LOCATIONS	6063-T5	YKK AMERICA INC.
13	E9-8431	AS REQD.	STRAP ANCHOR COVER	6063-T5	YKK AMERICA INC.

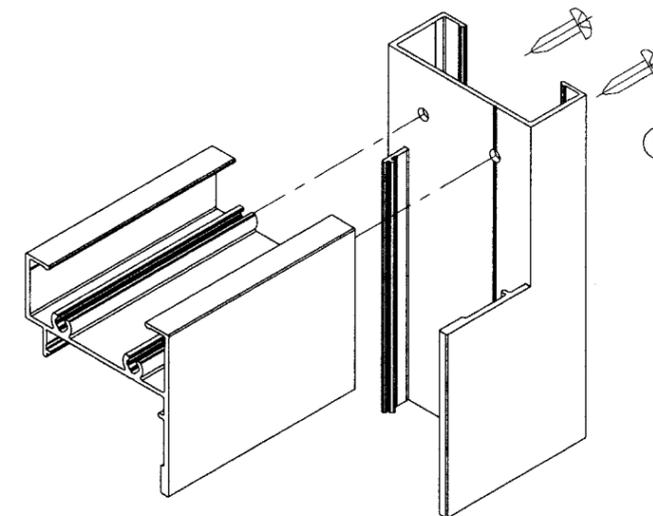

FRAME CORNER

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

Approved as complying with the
Florida Building Code
Date **DEC 21 2006**
By **06-1016.DJ**
Miami Date Product Control
By *[Signature]*

NOV 27 2006

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W06-60YKK

YOW 225H NON THERMAL ALUM FIXED WDW. (L.M.I.)
YKK AP AMERICA INC.
332 FIRETOWER ROAD
DUBLIN, GEORGIA 31021
TEL.(478) 277-1955 FAX(478) 277-1978

revisions:	no	date	by	description

date: 09-23-06
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W06-60
sheet 5 of 5