



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

www.buldingcodeonline.com

Jeld - Wen, Inc.
3737 Lakeport Blvd.
Klamath Falls, OR 97601

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Custom Collection" Wood Casement Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **Jeld0056**, titled "Custom Collection" Wood Casement Window, sheets 1 through 5 of 5, dated 10/12/06 with revision A dated 01/19/07, prepared by PTC, LLC, signed and sealed by Eric S. Nielsen, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P.E.**




J. Gascon
2/15/07

NOA No. 06-1024.05
Expiration Date: March 08, 2012
Approval Date: March 08, 2007
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED


- A. DRAWINGS**
1. Manufacturer's die drawings and sections.
 2. Drawing No **Jeld0056**, Sheets 1 through 5 of 5, titled "Custom Collection" Wood Casement Window, sheets 1 through 5 of 5, dated 10/12/06 with revision A dated 01/19/07, prepared by PTC, LLC, signed and sealed by Eric S. Nielsen, P.E.
- B. TESTS**
1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of a "Custom Collection" Wood Casement Window, prepared by National Certified Testing Laboratories, Test Report No. **NCTL-210-3304-1**, dated 07/25/06, signed and sealed by Gerard J. Ferrara, P.E.
- C. CALCULATIONS**
1. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by PTC, LLC, signed and sealed by Eric S. Nielsen, P.E.
Complies with ASTM E1300-02/03.
- D. QUALITY ASSURANCE**
1. Miami Dade Building Code Compliance Office (BCCO).
- E. MATERIAL CERTIFICATIONS**
1. Notice of Acceptance No. **06-1205.10** issued to E.I. DuPont DeNemours for "**DuPont Sentry Glass Plus**" dated 02/14/07, expiring on 01/14/08.
- F. STATEMENTS**
1. Statement letter of conformance, dated October 18, 2006, signed and sealed by Gerard J. Ferrara, P.E.
 2. Statement letter of no financial interest, October 18, 2006, signed and sealed by Gerard J. Ferrara, P.E.
- G. OTHER**
1. None



Jaime D. Gascon, P.E.


Chief, Product Control Division
NOA No. 06-1024.05

Expiration Date: March 08, 2012
Approval Date: March 08, 2007

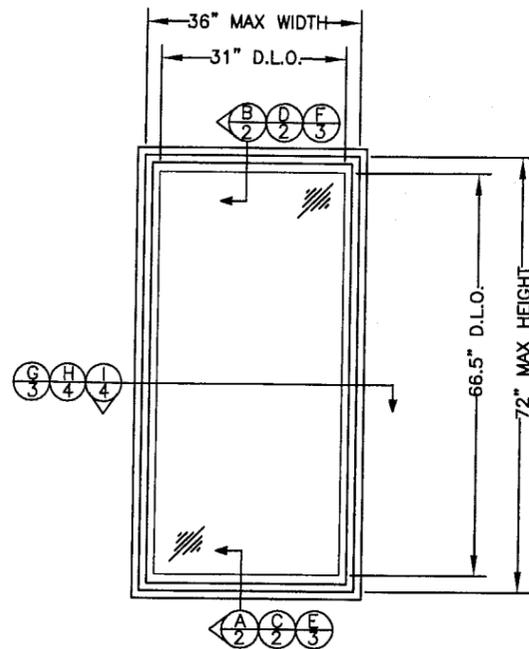


CASEMENT WINDOW

ELEVATION

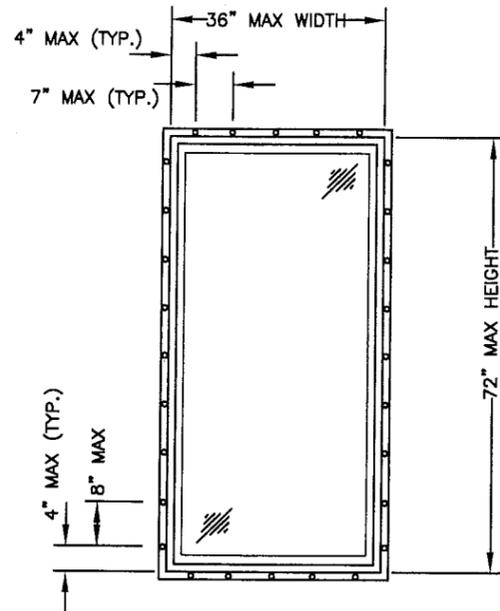


ANCHOR LAYOUT

FIN ANCHORING

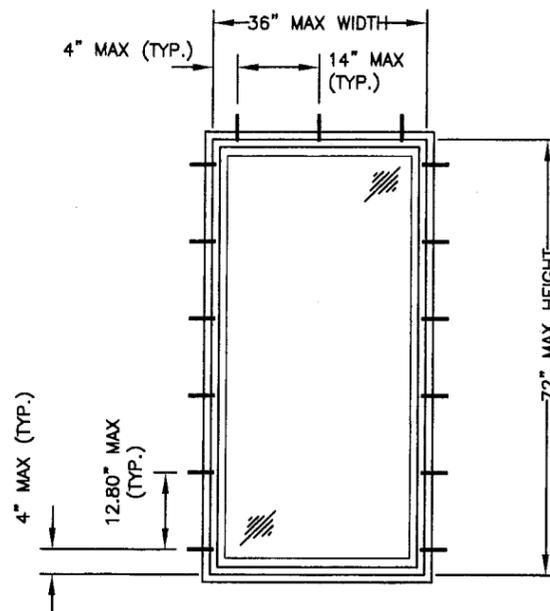

ANCHOR LAYOUT

FRAME ANCHORING

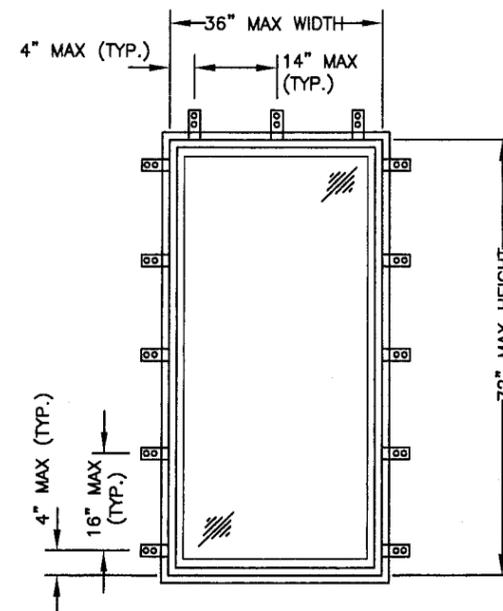

ANCHOR LAYOUT

GALVANIZED STEEL STRAP ANCHORING

DESIGN PRESSURE RATING
+65.0 PSF / -65.0 PSF

GENERAL NOTES:

- 1) THE PRODUCT SHOWN HEREIN IS DESIGNED TO COMPLY WITH THE 2004 FLORIDA BUILDING CODE INCLUDING (HVHZ) HIGH VELOCITY HURRICANE ZONE
- 2) MASONRY OPENING, 1X & 2X BUCKS ARE TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. MASONRY OPENING, 1X & 2X BUCKS ARE THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 3) PRODUCTS ARE APPROVED FOR USE WHERE LARGE MISSILE IMPACT RESISTANCE IS REQUIRED. IMPACT PROTECTION SYSTEM IS NOT REQUIRED FOR THIS PRODUCT.
- 4) SEE DESIGN PRESSURE RATINGS ON THIS SHEET 1.
- 5) SEE GLAZING OPTIONS ON SHEET 5
- 6) SHIM AS REQUIRED AT EACH ANCHOR WITH LOAD BEARING SHIMS. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
- 7) ALL INSTALLATION ANCHORS MUST BE MADE OF CORROSION RESISTANT MATERIAL.

INSTALLATION NOTES:

- 1) (1) ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- 2) INSTALLATION ON ONE BY BUCK TO MASONRY / CONCRETE AND DIRECTLY INTO MASONRY / CONCRETE USE 3/16" DIAMETER ELCO TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT.
- 3) INSTALLATION INTO WOOD FRAMING, USE #8 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE A 1 1/2" MINIMUM EMBEDMENT.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	ELEVATION, ANCHORING & GENERAL NOTES
2	VERTICAL CROSS SECTIONS
3	VERTICAL & HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS
5	B.O.M., GLAZING DETAILS & COMPONENTS


Approved as complying with the Florida Building Code
Date 3/8/07
NCA# 06-1024-05
Miami Dade Product Control Division
By [Signature]

SYM	REVISION	DATE	BY
A	AS REQUESTED BY MIAMI - DADE	01/19/07	TK


[Signature]
1/25/07
Eric S. Nielsen
Florida P. E. No. 41323
PTC, LLC
1535 Cogswell Street, Suite C25
Rockledge, Florida 32955
FBPE Certificate of Authorization NO. 25935

JELD-WEN, INC.
62845 BOYD ACRES ROAD - BEND OR. 97701
TITLE: CUSTOM WOOD CASEMENT WINDOW
ELEVATIONS, ANCHORING & GENERAL NOTES
PREPARED BY: **PTC**
PTC, LLC
DRN: SAM DATE: 10/12/06
SCALE: N.T.S. DWG. NO: JELD0056
REV: A SHEET: 1 of 5
Phone 321.690.1788 Fax 321.690.1789

B
2
VERTICAL CROSS SECTION
FIN ANCHORING

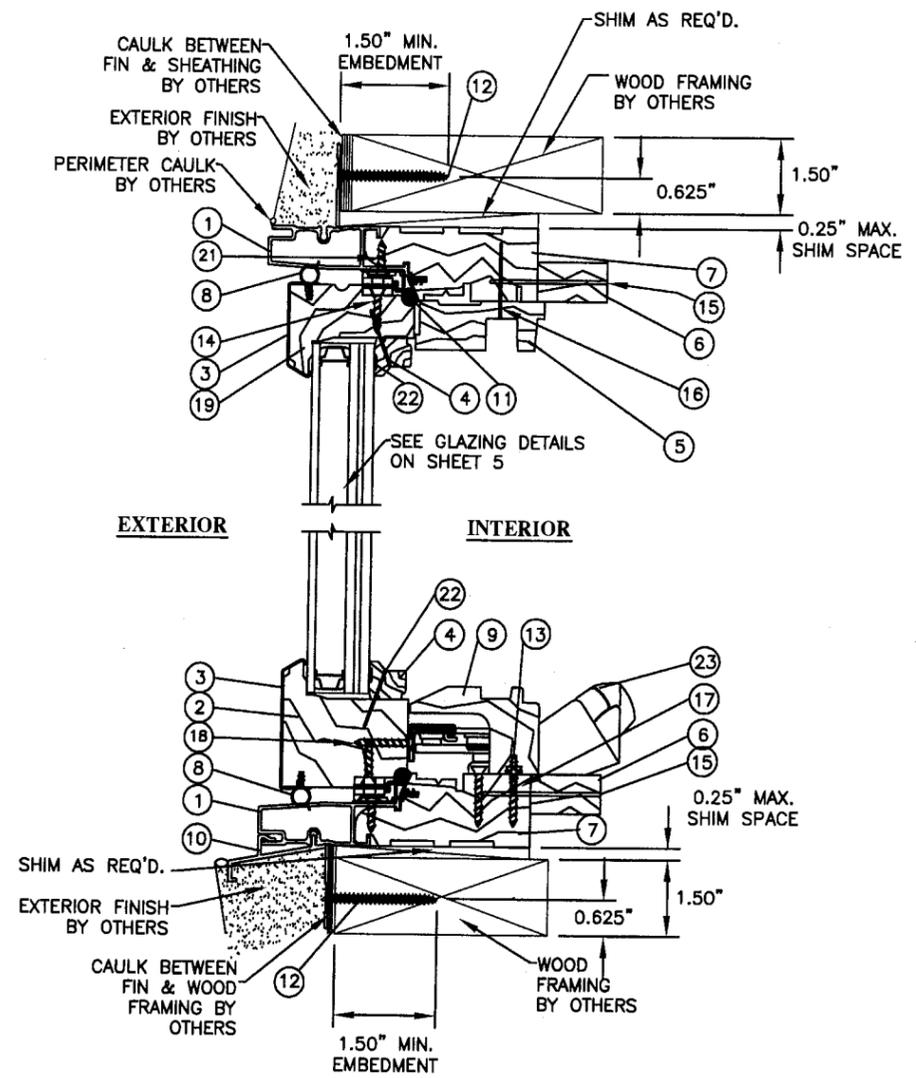

D
2
VERTICAL CROSS SECTION
FRAME ANCHORING

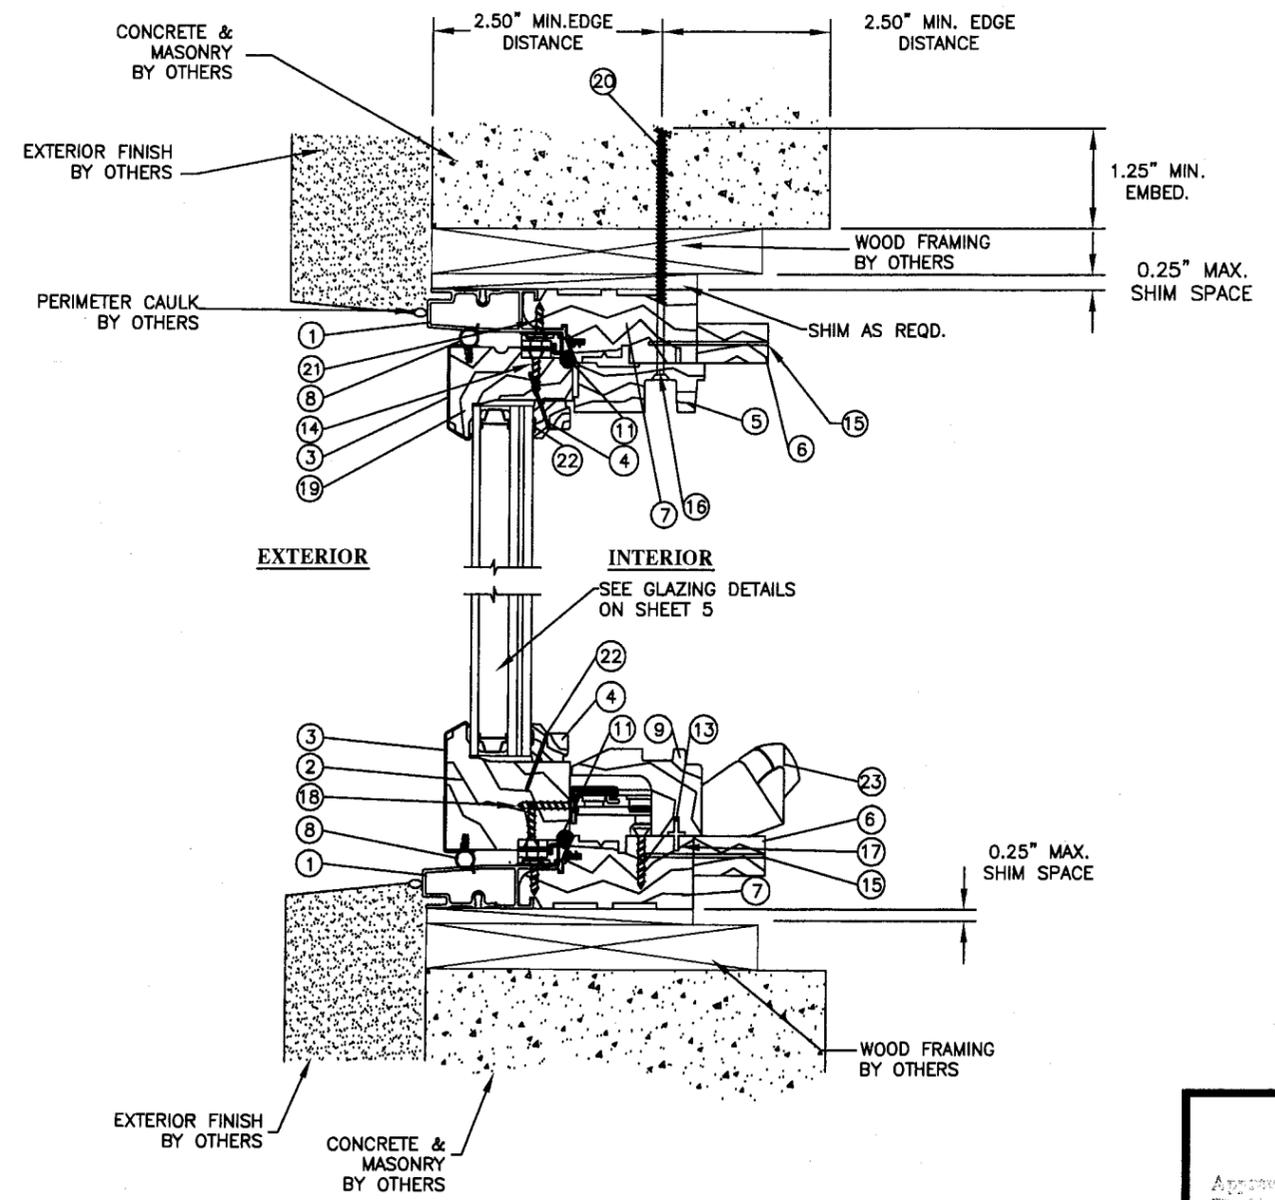

A
2
VERTICAL CROSS SECTION
FIN ANCHORING

C
2
VERTICAL CROSS SECTION
FRAME ANCHORING

Approved as complying with the
Florida Building Code
Date 3/8/07
NOAA 06-1024-05
Miami Dade Product Control
Division
By [Signature]

A	AS REQUESTED BY MIAMI - DADE	01/19/07	TK
SYM	REVISION	DATE	BY



ESN
1/25/07
Eric S. Nielsen
Florida P. E. No. 41323
PTC, LLC
1535 Cogswell Street, Suite C25
Rockledge, Florida 32955
FBPE Certificate of Authorization NO. 25935

JELD-WEN, INC.
62845 BOYD ACRES ROAD - BEND OR. 97701
TITLE: CUSTOM WOOD CASEMENT WINDOW
VERTICAL CROSS SECTIONS

PREPARED BY: PTC PTC, LLC	DRN: SAM	DATE: 10/12/06
SCALE: N.T.S.	DWG. NO.: JELDO056	
REV: A	SHEET: 2 of 5	

Phone 321.690.1788 Fax 321.690.1789

F
3 **VERTICAL CROSS SECTION**
GALVANIZED STEEL STRAP ANCHORING

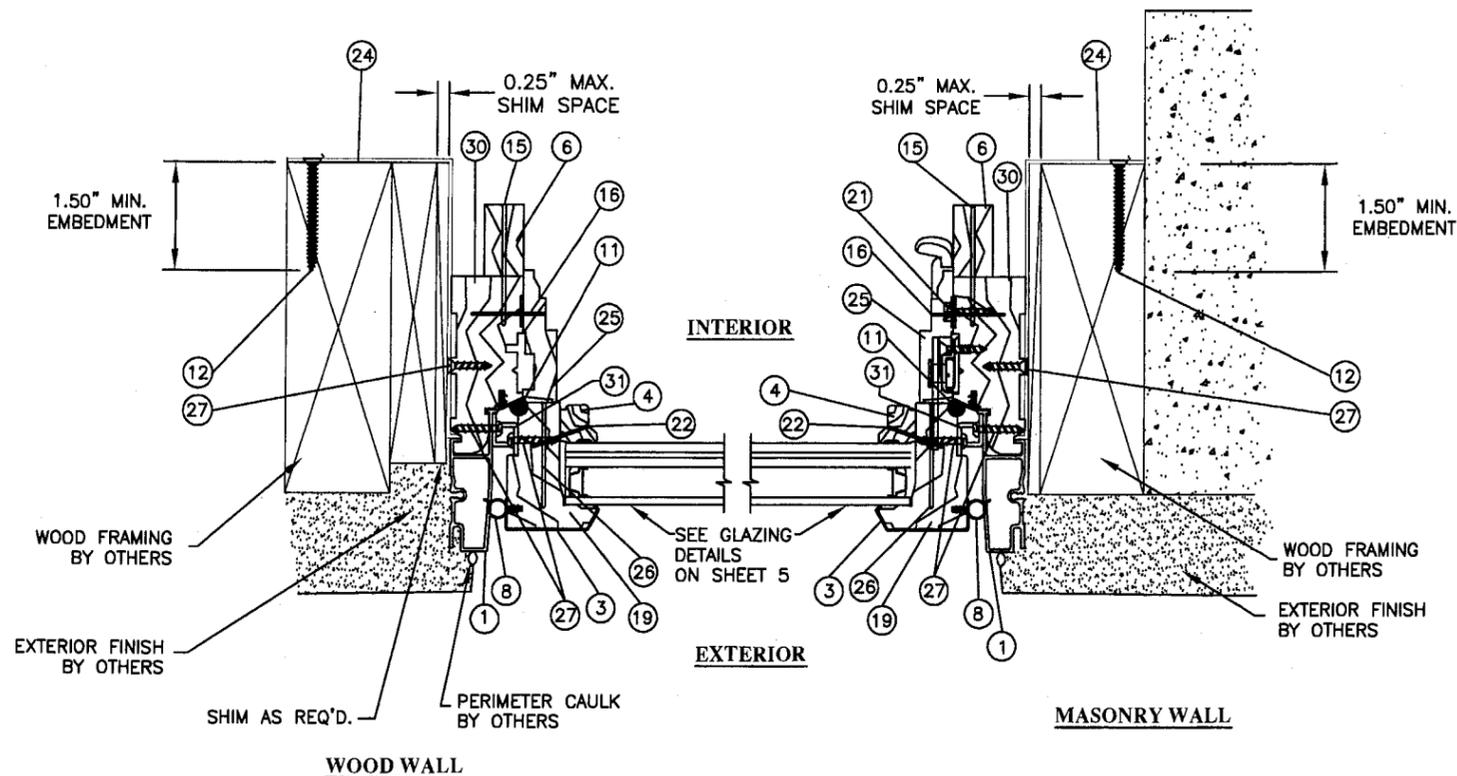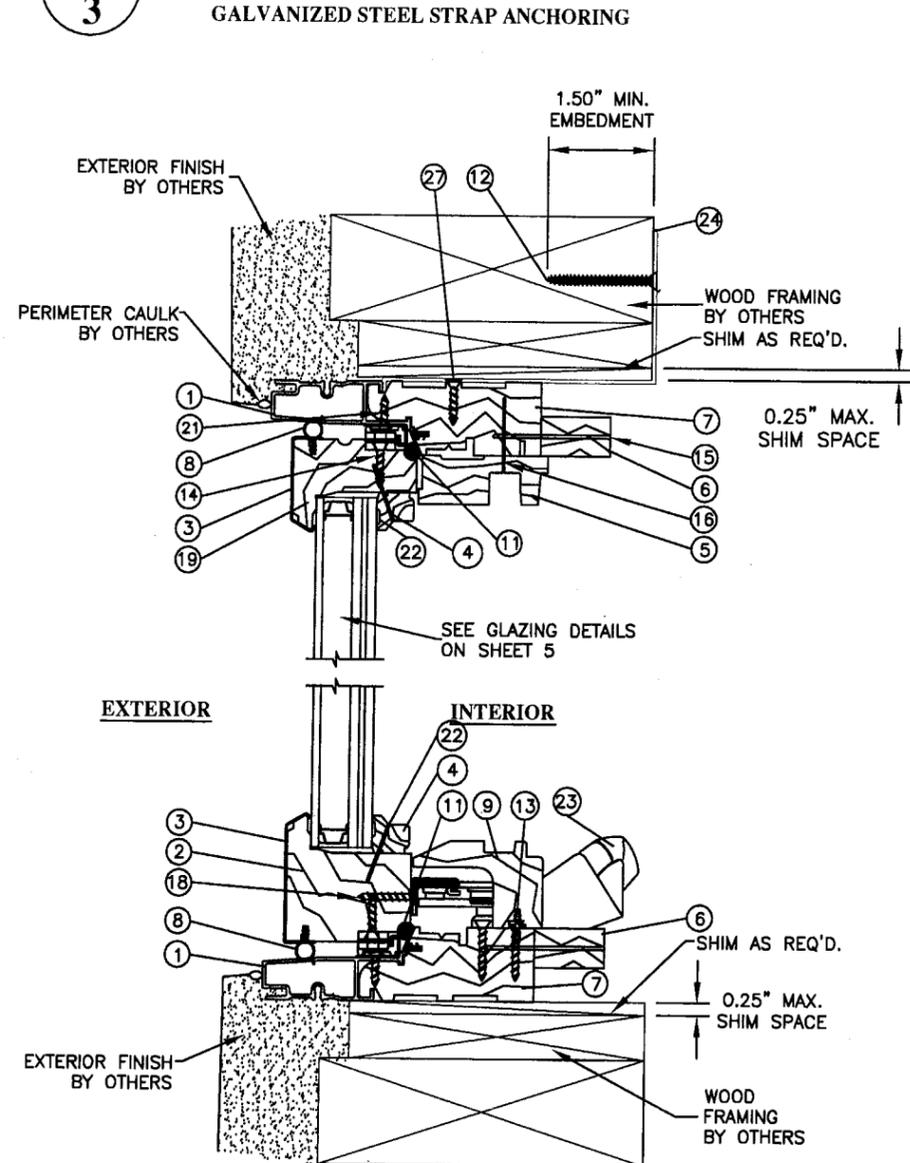

G
3 **HORIZONTAL CROSS SECTION**
GALVANIZED STEEL STRAP ANCHORING

E
3 **VERTICAL CROSS SECTION**
GALVANIZED STEEL STRAP ANCHORING

Approved for use with the
Miami-Dade County Code
Date: 3/8/07
Project: 06-1024.05
Miami-Dade Product Control
By: *[Signature]*

SYM	REVISION	DATE	BY
A	AS REQUESTED BY MIAMI - DADE	01/19/07	TK


[Signature]
11/25/07
Eric S. Nielsen
Florida P. E. No. 41323
PTC, LLC
1535 Cogswell Street, Suite C25
Rockledge, Florida 32955
FBPE Certificate of Authorization NO. 25935

JELD-WEN, INC.
62845 BOYD ACRES ROAD - BEND OR. 97701


TITLE: CUSTOM WOOD CASEMENT WINDOW
VERTICAL & HORIZONTAL CROSS SECTIONS

PREPARED BY: **PTC** PTC, LLC
DRN: SAM DATE: 10/12/06
SCALE: N.T.S. DWG. NO: JELD0056
REV: A SHEET: 3 of 5

Phone 321.690.1788 Fax 321.690.1788

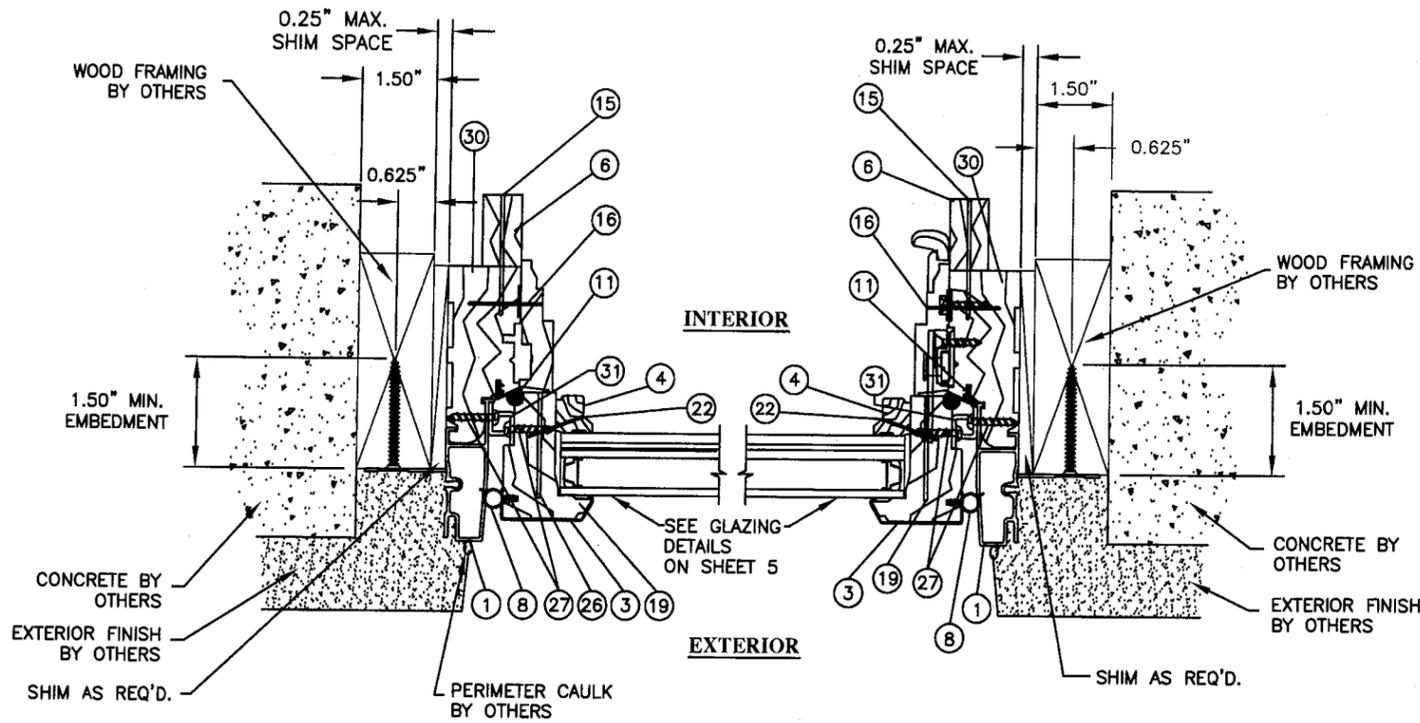

H HORIZONTAL CROSS SECTION
4 FIN ANCHORING

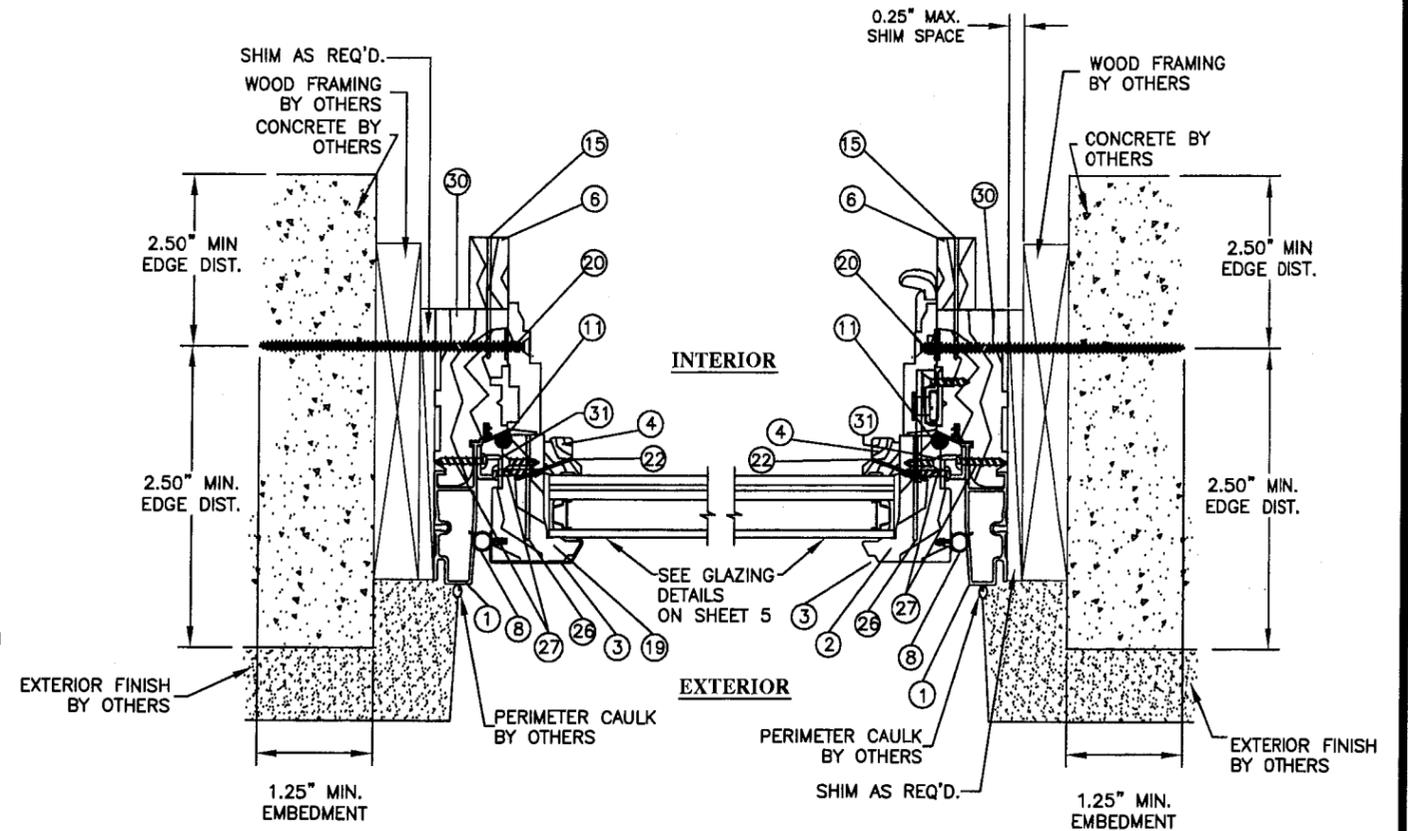

I HORIZONTAL CROSS SECTION
4 FRAME ANCHORING

Approved as complying with the
Florida Building Code
Date: 3/8/07
NOAH 06-1024.05
Miami Code Product Control
Division
By: *Eric S. Nielsen*

SYM	REVISION	DATE	BY
A	AS REQUESTED BY MIAMI - DADE	01/19/07	TK


ESN
1/25/07
Eric S. Nielsen
Florida P. E. No. 41323
PTC, LLC
1535 Cogswell Street, Suite C25
Rockledge, Florida 32955
FBPE Certificate of Authorization NO. 25935

JELD-WEN, INC.
62845 BOYD ACRES ROAD - BEND OR. 97701


TITLE: CUSTOM WOOD CASEMENT WINDOW
HORIZONTAL CROSS SECTIONS

PREPARED BY: **PTC** PTC, LLC
DRN: SAM DATE: 10/12/06
SCALE: N.T.S. DWG. NO: JELD0056
REV: A SHEET: 4 of 5

Phone 321.690.1788 Fax 321.690.1789

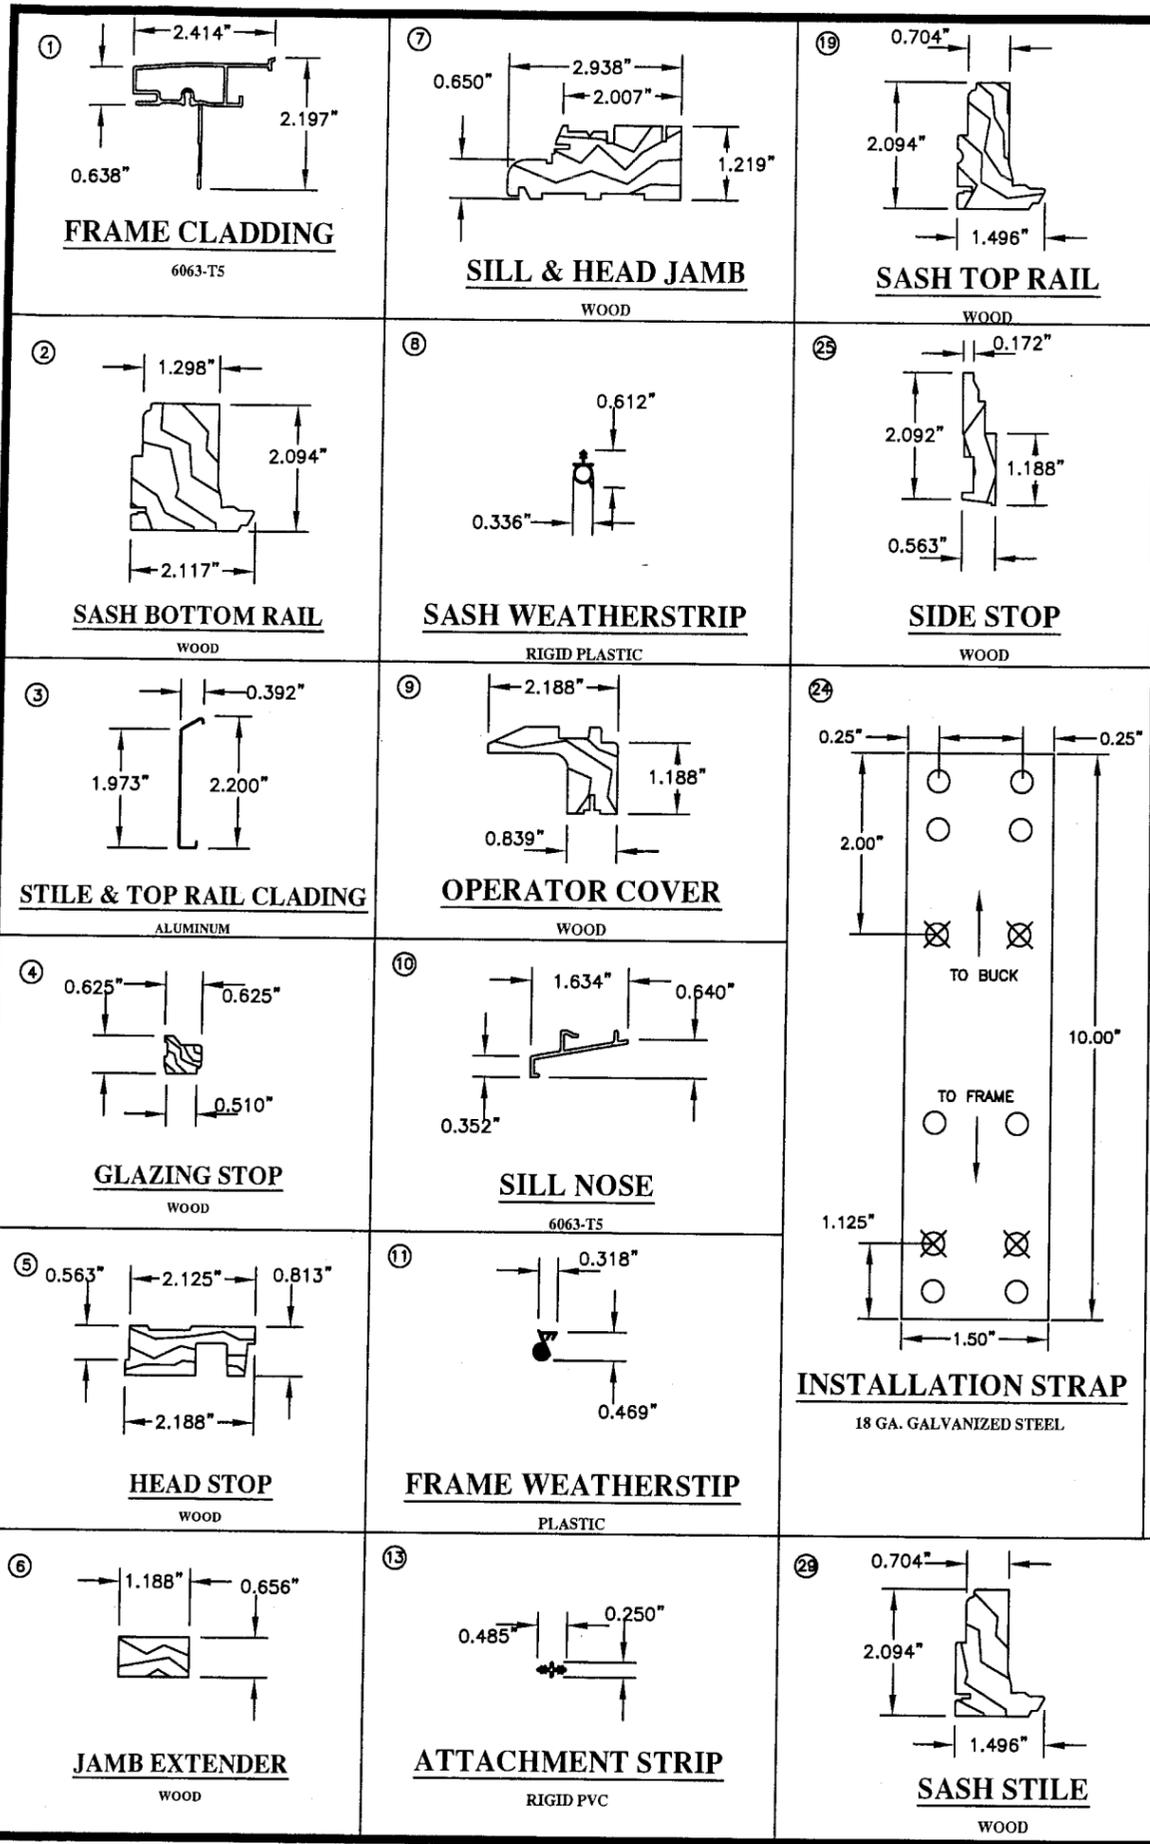

ITEM #	PART NO.	REQD.	DESCRIPTION	MATERIAL	MANF/SUPPLIER/REMARKS
1	VH-53638	1	EXTRUDED FRAME CLADDING	6063-T5	INDALEX
2	CA0148RA	1	SASH BOTTOM RAIL	WOOD	JELD-WEN CUSTOM
3	1A16047-01	1	ROLLED FORMED STILE & TOP RAIL CLADDING	ALUMINUM	HOMESHIELD
4	CA0278SP	1	GLAZING STOP	WOOD	JELD-WEN CUSTOM
5	CA0282SP	1	HEAD STOP	WOOD	JELD-WEN CUSTOM
6	CA260AJE	1	JAMB EXTENDER	WOOD	JELD-WEN CUSTOM
7	CA0151HJ	1	SILL & HEAD JAMB	WOOD	JELD-WEN CUSTOM
8	50468A	1/ LEAF	SASH WEATHERSTRIP	PVC	INTEK
9	CA01420C	1	OPERATOR COVER	WOOD	JELD-WEN CUSTOM
10	VS-53646	1	EXTRUDED SILL NOSE	6063-T5	INDALEX
11	12261	1/ LEAF	FRAME WEATHERSTRIP	PVC	AMESBURY
12	—	AS REQ'D.	#8 WOOD SCREWS W/ 1 1/2" MIN. EMBED.	STEEL	—
13	30263B	AS REQ'D.	OPERATOR COVER FASTENING STRIP	PVC	INTEK
14	—	AS REQ'D.	#7x3/4" P.F.H. SCREW	STEEL	—
15	—	AS REQ'D.	2" FINISHING NAIL	STEEL	—
16	—	AS REQ'D.	15GAx1 1/4" NAIL	STEEL	—
17	—	AS REQ'D.	#8x1" P.F.H. SCREW	STEEL	—
18	—	AS REQ'D.	#8x1" SCREW	STEEL	—
19	CA0147RA	2	SASH TOP RAIL	WOOD	JELD-WEN CUSTOM
20	—	AS REQ'D.	3/16" TAPCON W 1 1/4" MIN. EMBED.	STEEL	ELCO OR EQUIV.
21	—	AS REQ'D.	7x5/8" P.F.H. SCREW	STEEL	—
22	—	AS REQ'D.	18x1" NAILS @ 8" O.C.	STEEL	—
23	MAXIM	1	ROTO OPERATING HARDWARE	STEEL	TRUTH
24	—	AS REQ'D.	GALVANIZED INSTALLATION STRIP	ALUMINUM	—
25	CA0274SP	2	SIDE STOP	WOOD	JELD-WEN CUSTOM
26	—	AS REQ'D.	1-3/4" FINISHING NAILS	STEEL	—
27	—	AS REQ'D.	#8x3/4" P.F.H. WOOD SCREW	STEEL	—
28	1A16047-04	1	ROLLED FORMED BOTOM RAIL CLADDING	ALUMINUM	HOMESHIELD
29	CA0157ST	2	SASH STILE	WOOD	JELD-WEN CUSTOM
30	CA0174SJ	2	SIDE JAMB	WOOD	JELD-WEN CUSTOM
31	21642.92	AS REQ'D.	SNUBBERS	STEEL	TRUTH
32	—	AS REQ'D.	SILICONE SEALANT	899	DOW CORNING

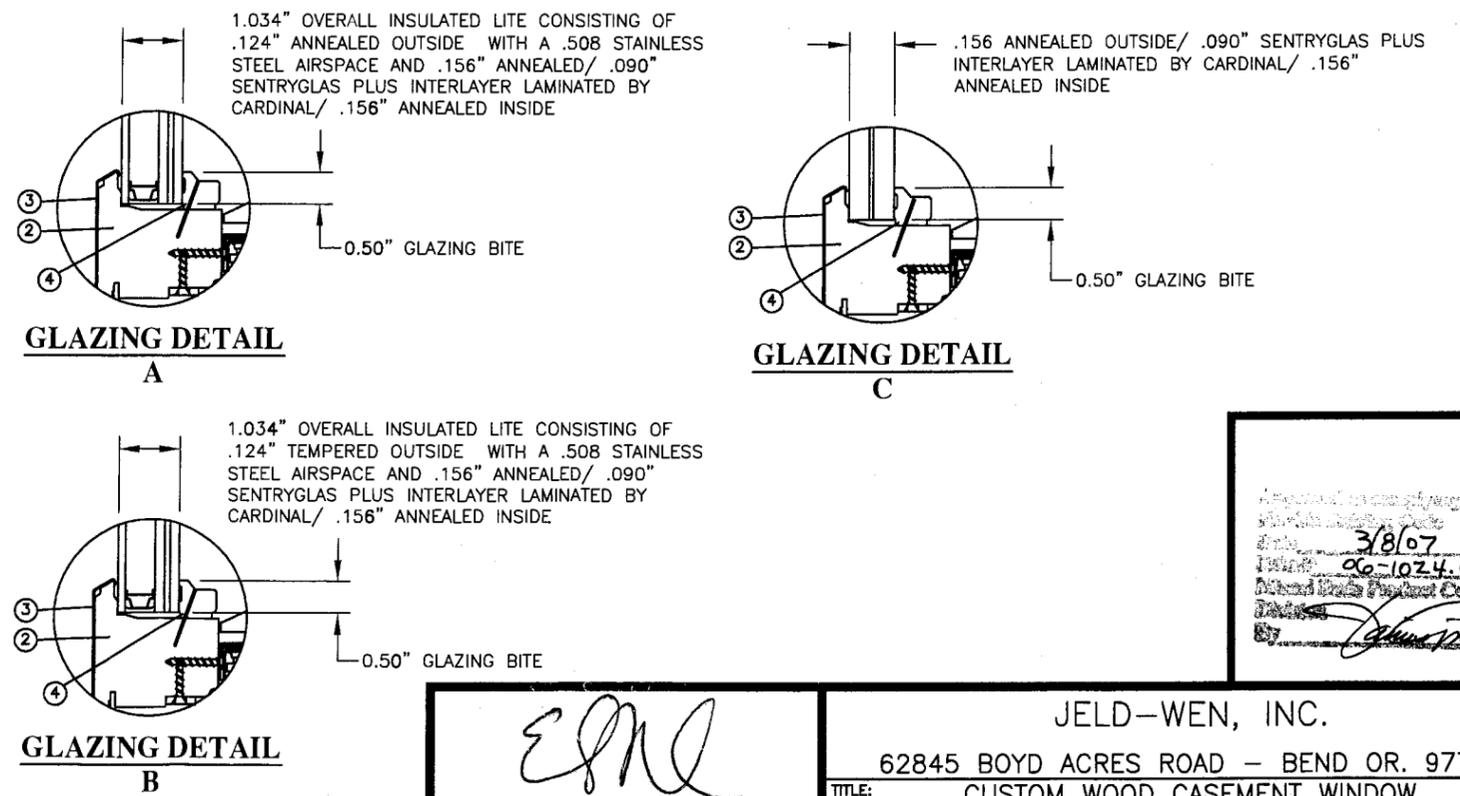

Approved as shown with the
 Date: 3/8/07
 Title: 06-1024.05
 Detail: Window Product Control
 [Signature]

SYM	REVISION	DATE	BY
A	AS REQUESTED BY MIAMI - DADE	01/19/07	TK

ESN
 1/25/07
 Eric S. Nielsen
 Florida P. E. No. 41323
 PTC, LLC
 1535 Cogswell Street, Suite C25
 Rockledge, Florida 32955
 FBPE Certificate of Authorization NO. 25935

JELD-WEN, INC.
 62845 BOYD ACRES ROAD - BEND OR. 97701
 TITLE: CUSTOM WOOD CASEMENT WINDOW
 B.O.M., GLAZING DETAILS & COMPONENTS

PREPARED BY: **PTC** PTC, LLC
 DRN: SAM DATE: 10/12/06
 SCALE: N.T.S. DWG. NO: JELD0056
 REV: A SHEET: 5 of 5

Phone 321.690.1788 Fax 321.690.1789