



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

www.buldingcodeonline.com

R.C. Aluminum Industries, Inc.
2805 NW 75 Ave
Miami, FL 33122

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series CM100 Aluminum Casement Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. W04-16, titled "CM100 Aluminum Casement Window (L.M.I.)", sheets 1 through 7 of 7, dated 03/01/04 with revision A dated 09/21/06, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises NOA # 04-0608.01 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 06-1130.01
Expiration Date: July 29, 2009
Approval Date: April 05, 2007
Page 1

R.C. Aluminum Industries, Inc.


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **W04-16**, titled "CM 100 Aluminum Casement Window (L.M.I.)", sheets 1 through 7 of 7, dated 03/01/04 with revision A dated 09/21/06, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1 (b) and TAS 202-94
along with marked-up drawings and installation diagram of an aluminum casement window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-03-1346**, dated September 16, 2003, signed and sealed by Rafael E. Droz-Seda, P.E. *(Submitted under previous NOA #04-0608.01)*
2. Test reports on 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum casement window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-03-1856**, dated September 17, 2003, signed and sealed by Rafael E. Droz-Seda, P.E. *(Submitted under previous NOA #04-0608.01)*
3. Test reports on 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum casement window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-03-1859**, dated January 16, 2004, signed and sealed by Rafael E. Droz-Seda, P.E. *(Submitted under previous NOA #04-0608.01)*
4. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1 (b) and TAS 202-94
along with marked-up drawings and installation diagram of an aluminum casement window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-03-1350**, dated October 14, 2003, signed and sealed by Rafael E. Droz-Seda, P.E. *(Submitted under previous NOA #04-0608.01)*

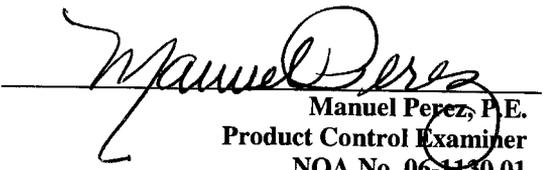
Manuel Perez, P.E.
Product Control Examiner
NOA No. 06-1130.01
Expiration Date: July 29, 2009
Approval Date: April 05, 2007

R.C. Aluminum Industries, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

5. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1 (b) and TAS 202-94
along with marked-up drawings and installation diagram of an aluminum casement window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-03-1344**, dated September 12, 2003, signed and sealed by Rafael E. Droz-Seda, P.E.
(Submitted under previous NOA #04-0608.01)
6. Test reports on 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum casement window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-03-1848**, dated September 17, 2003, signed and sealed by Rafael E. Droz-Seda, P.E.
(Submitted under previous NOA #04-0608.01)

C. CALCULATIONS

1. Revised anchor verification calculations and structural analysis, complying with FBC-2004, prepared by Al-Farooq Corporation, dated 09/19/06 and revised on 3/15/07, signed and sealed by Humayoun Farooq, P.E.
Complies with ASTM E1300-02
2. Anchor Calculations, ASTM-E1300, and structural analysis, prepared by AL-Farooq Corporation, dated 05/05/04, signed and sealed by Humayoun Farooq, P.E.
(Submitted under previous NOA #04-0608.01)

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **05-1208.02** issued to E.I. DuPont de Nemours for "DuPont Butacite PVB Interlayer", dated 01/05/06, expiring on 12/11/10.


F. STATEMENTS

1. Statement letter of compliance, dated September 18, 2006, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated September 18, 2006, signed and sealed by Humayoun Farooq, P.E.


G. OTHER

1. Notice of Acceptance No. **04-0608.01**, issued to R.C. Aluminum Industries, Inc. for their Series CM100 Aluminum Casement Window – L.M.I., approved on 07/29/04 and expiring on 07/29/09.

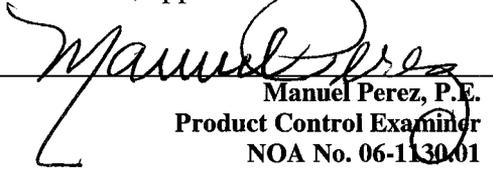

Manuel Perez, P.E.
Product Control Examiner
NOA No. 06-1130.01
Expiration Date: July 29, 2009
Approval Date: April 05, 2007

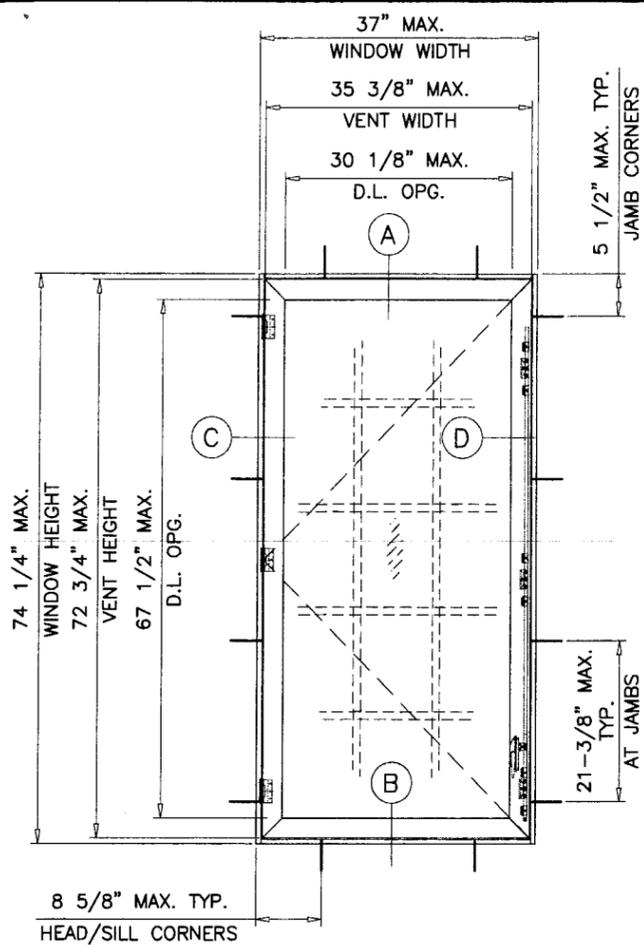



SINGLE VENT WDW.

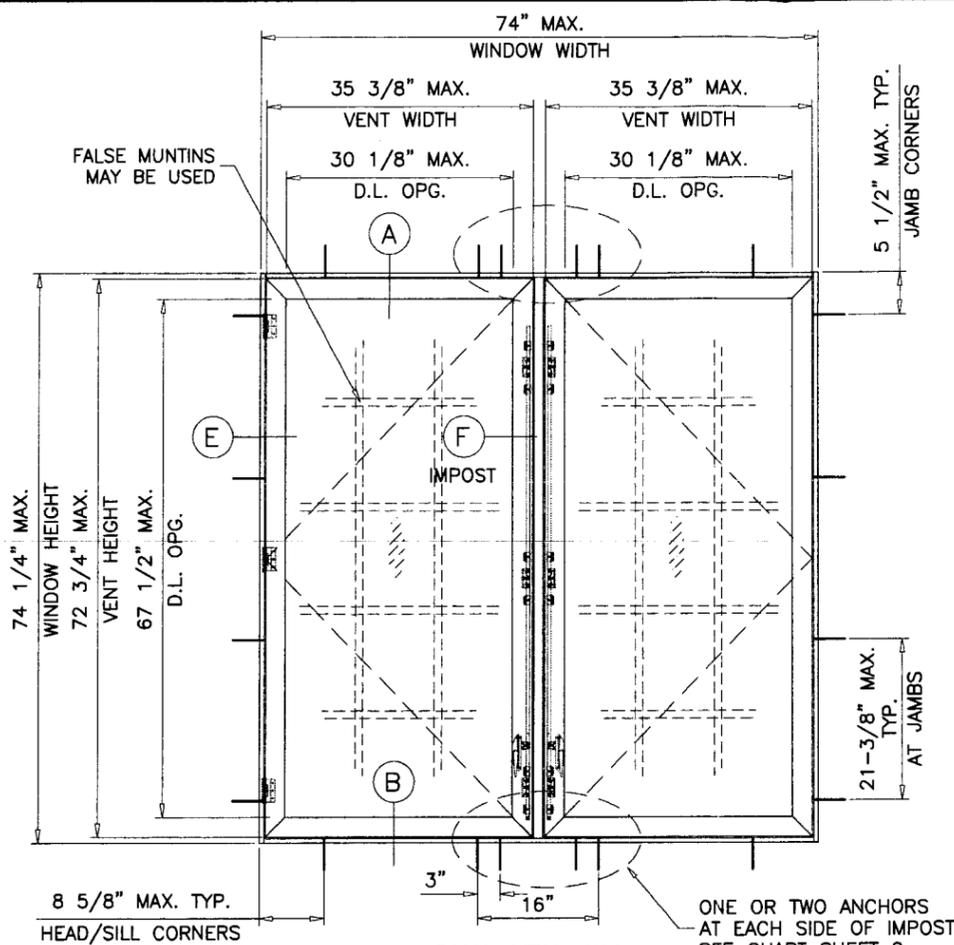

DUAL VENT WDW.

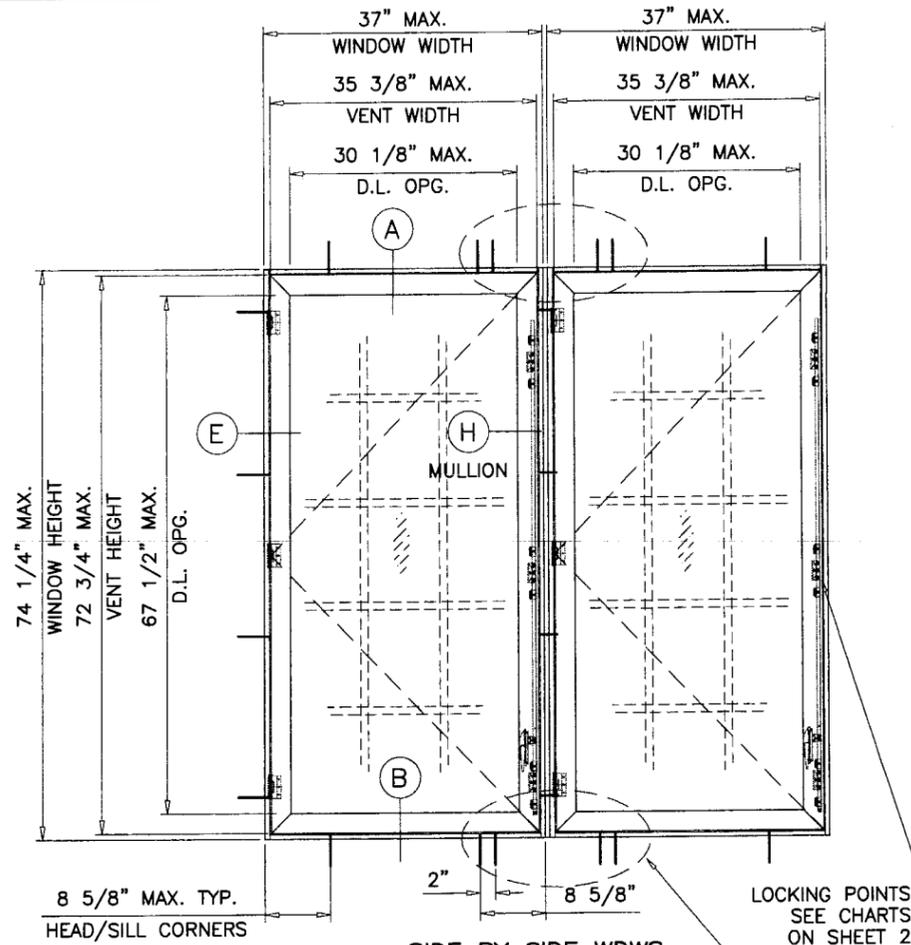

SIDE BY SIDE WDWs.

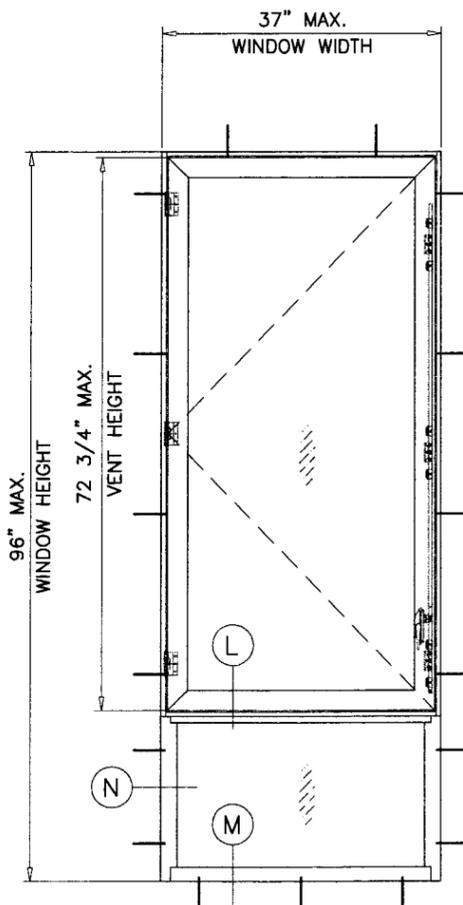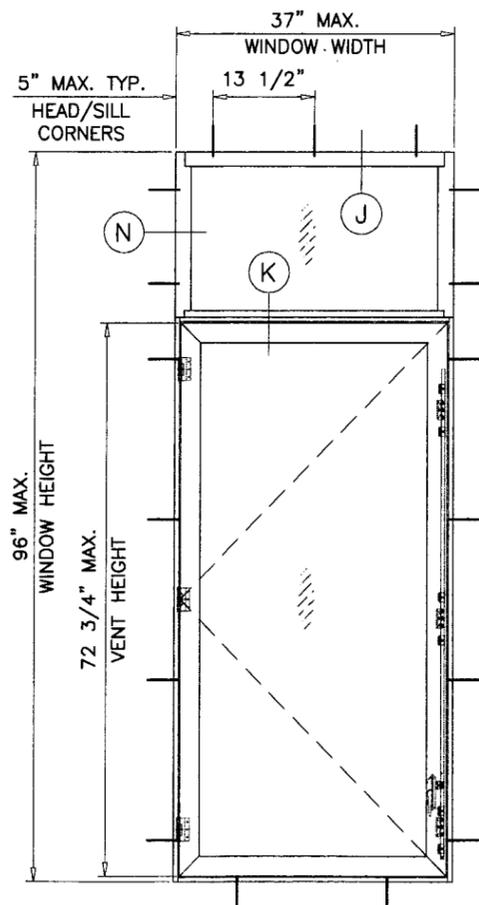

CM100 OPERATING/FIXED ALUMINUM CASEMENT WINDOWS

APPROVAL APPLIES TO SINGLE VENT WINDOWS OR DUAL VENT WINDOWS USING INTEGRAL IMPOST.

ALSO TOP AND BOTTOM COMBINATIONS OF FIXED AND CASEMENT WINDOWS USING STACKING HEAD/SILL WITHOUT MULLION.

ALSO TO SIDE BY SIDE COMBINATIONS OF CASEMENT/FIXED, CASEMENT/CASEMENT OR WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING APPROVED MULLIONS.

RATING OF FIXED WINDOWS UNDER SEPARATE NOA.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).




WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004 FLORIDA BLDG. CODE SECTION 2003.8.4.



THESE WINDOWS ARE RATED FOR LARGE MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHART SHOWN ON SHEET 2.

ONE OR TWO ANCHORS AT EACH SIDE OF MULLION SEE CHART SHEET 2

LOCKING POINTS SEE CHARTS ON SHEET 2

Engr. DR. HJUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

MAR 15 2007

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 06-1130.01
Expiration Date: JULY 29, 2009


By *Manuel Jose*
Miami Dade Product Control
Division

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-16RC

CM100 ALUMINUM CASEMENT WINDOW (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
2805 N.W. 75 TH AVE.
MIAMI, FL. 33122
TEL. (305) 592-1515 FAX. (305) 592-2184

revisions:	no.	date	by	description
	A	09.21.06		UPDATED FOR 2004 FEC
date:	03-01-04			
scale:	1/2"=1'-0"			
dr. by:	HAMID			
chk. by:				
drawing no.	W04-16			
sheet	1 of 7			


DESIGN LOAD CAPACITY - PSF SIDE BY SIDE SINGLE VENT WINDOWS				
WINDOW DIMS.		GLASS TYPES 'A' & 'B'		
		ONE ANCHOR AT EACH SIDE	TWO ANCHORS AT EACH SIDE	
WIDTH (W)	HEIGHT (H)	EXT.(+) & INT.(-)	EXT.(+) & INT.(-)	
19-1/8"	38-3/8"	80.0	80.0	
24"		80.0	80.0	
26-1/2"		80.0	80.0	
30"		80.0	80.0	
37"		80.0	80.0	
42"		80.0	80.0	
48"		80.0	80.0	
53-1/8"		78.8	80.0	
19-1/8"	48"	80.0	80.0	
24"		80.0	80.0	
26-1/2"		80.0	80.0	
30"		80.0	80.0	
37"		80.0	80.0	
42"		79.7	80.0	
48"		69.8	80.0	
53-1/8"		63.0	80.0	
19-1/8"	50-5/8"	80.0	80.0	
24"		80.0	80.0	
26-1/2"		80.0	80.0	
30"		80.0	80.0	
37"		80.0	80.0	
42"		75.6	80.0	
48"		66.1	80.0	
53-1/8"		59.8	80.0	
19-1/8"	60"	80.0	80.0	
24"		80.0	80.0	
26-1/2"		80.0	80.0	
30"		80.0	80.0	
37"		72.4	80.0	
42"		63.8	80.0	
19-1/8"		63"	80.0	80.0
24"			80.0	80.0
26-1/2"	80.0		80.0	
30"	80.0		80.0	
37"	68.9		80.0	
42"	60.7		80.0	
19-1/8"	66"		80.0	80.0
24"			80.0	80.0
26-1/2"		80.0	80.0	
30"		80.0	80.0	
37"		65.8	80.0	
19-1/8"		72"	80.0	80.0
24"			80.0	80.0
26-1/2"			80.0	80.0
30"	74.4		80.0	
37"	60.3		72.8	
19-1/8"	74-1/4"		80.0	80.0
24"			80.0	80.0
26-1/2"			80.0	80.0
30"		72.1	78.4	
37"		58.5	65.9	

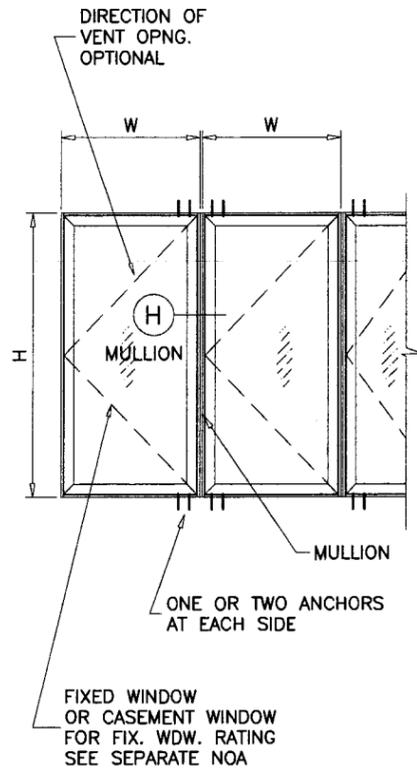

WDW. HEIGHT UPTO	NO. OF KEEPERS AT SASH	NO. OF HINGES AT SASH
29-1/4"	2	2
42"	3	2
44-1/4"	3	3
59-1/4"	4	3
74-1/4"	5	3

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE BASED ON
ASTM E1300-02 (3 SEC. GUSTS) WITH REDUCTIONS
FOR FLEXIBLE SUPPORTS TO COMPLY WITH SECTION
2403.2 OF FBC 2004 EDITION.

DESIGN LOAD CAPACITY - PSF DUAL VENTWINDOWS				
WINDOW DIMS.		GLASS TYPES 'A' & 'B'		
		ONE ANCHOR AT EACH SIDE	TWO ANCHORS AT EACH SIDE	
WIDTH (W)	HEIGHT (H)	EXT.(+) & INT.(-)	EXT.(+) & INT.(-)	
37"	38-3/8"	80.0	80.0	
48"		80.0	80.0	
53-1/8"		80.0	80.0	
60"		80.0	80.0	
72"		80.0	80.0	
74"		80.0	80.0	
84"		80.0	80.0	
96"		80.0	80.0	
106-1/4"		78.8	80.0	
37"		50-5/8"	80.0	80.0
48"	80.0		80.0	
53-1/8"	80.0		80.0	
60"	80.0		80.0	
72"	80.0		80.0	
74"	80.0		80.0	
84"	75.6		80.0	
96"	66.1		80.0	
106-1/4"	59.8		80.0	
37"	60"		80.0	80.0
48"		80.0	80.0	
53-1/8"		80.0	80.0	
60"		80.0	80.0	
72"		74.4	80.0	
74"		72.4	80.0	
84"		63.8	80.0	
37"		63"	80.0	80.0
48"			80.0	80.0
53-1/8"			80.0	80.0
60"	80.0		80.0	
72"	70.9		80.0	
74"	68.9		80.0	
84"	60.7		80.0	
37"	66"		80.0	80.0
48"			80.0	80.0
53-1/8"			80.0	80.0
60"		80.0	80.0	
72"		67.6	80.0	
74"		65.8	80.0	
37"		72"	80.0	80.0
48"			80.0	80.0
53-1/8"			80.0	80.0
60"			74.4	80.0
72"	62.0		80.0	
74"	60.3		80.0	
37"	74-1/4"		80.0	80.0
48"			80.0	80.0
53-1/8"			80.0	80.0
60"			72.1	80.0
72"		60.1	80.0	
74"		58.5	80.0	

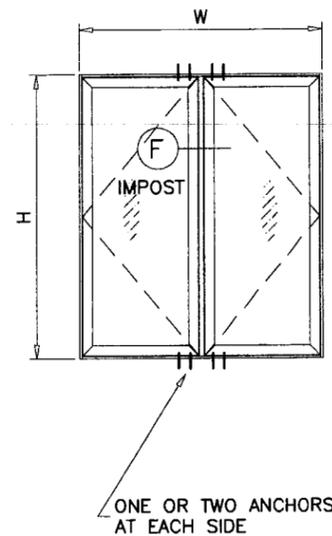

WDW. HEIGHT UPTO	NO. OF KEEPERS AT SASH	NO. OF HINGES AT SASH
42"	2	2
74-1/4"	3	3


DESIGN LOAD CAPACITY - PSF SINGLE VENT WINDOWS			
WINDOW DIMS.		GLASS TYPES 'A' & 'B'	
WIDTH (W)	HEIGHT (H)	EXT.(+) & INT.(-)	
19-1/8"	48"	80.0	
24"		80.0	
26-1/2"		80.0	
30"		80.0	
37"		80.0	
42"		80.0	
48"		80.0	
53-1/8"		80.0	
19-1/8"		50-5/8"	80.0
24"			80.0
26-1/2"	80.0		
30"	80.0		
37"	80.0		
42"	80.0		
48"	80.0		
53-1/8"	80.0		
19-1/8"	60"		80.0
24"			80.0
26-1/2"		80.0	
30"		80.0	
37"		80.0	
42"		80.0	
19-1/8"		63"	80.0
24"			80.0
26-1/2"			80.0
30"			80.0
37"	80.0		
42"	80.0		
19-1/8"	66"		80.0
24"			80.0
26-1/2"			80.0
30"			80.0
37"		80.0	
19-1/8"		72"	80.0
24"			80.0
26-1/2"			80.0
30"			80.0
37"			80.0
19-1/8"	74-1/4"		80.0
24"			80.0
26-1/2"			80.0
30"			80.0
37"			80.0

WDW. HEIGHT UPTO	NO. OF KEEPERS AT SASH	NO. OF HINGES AT SASH
42"	2	2
74-1/4"	3	3

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
F.I.A. PE # 16557
C.A.N. 3538

MAR 15 2007

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 06-1130.01
Expiration Date JULY 29, 2009
By *Manuel Sosa*
Miami Dade Product Control
Division

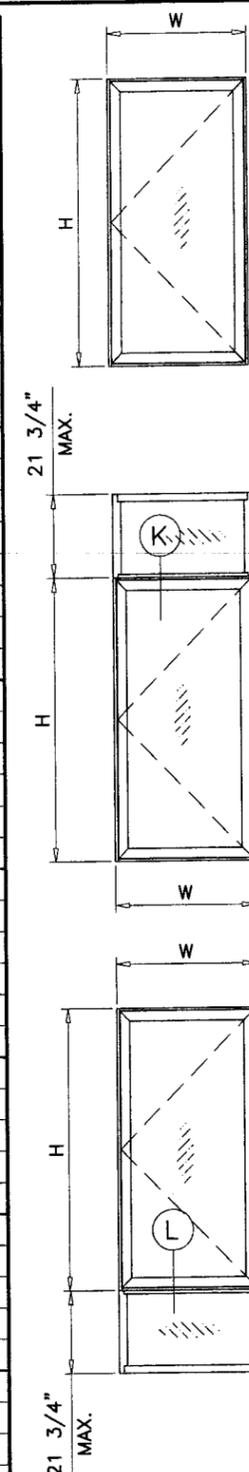

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-16RC


CM100 ALUMINUM CASEMENT WINDOW (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
2805 N.W. 75 TH AVE.
MIAMI, FL. 33122
TEL. (305) 592-1515 FAX. (305) 592-2184

revisions:
no. date by description
A 09.21.06 UPDATED FOR 2004 FBC


date: 03-01-04
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W04-16


sheet 2 of 7

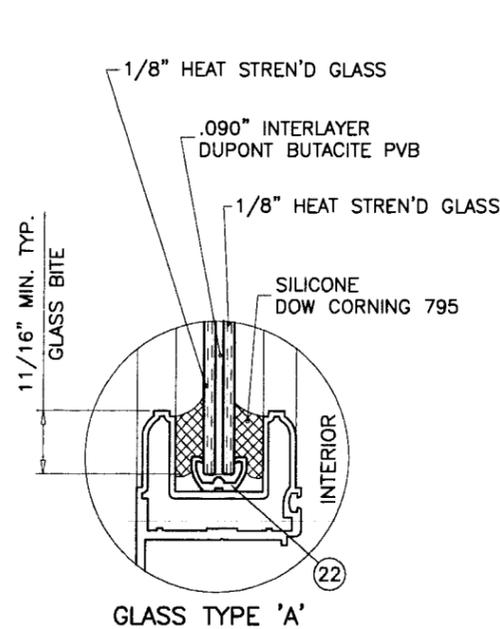


GLASS TYPE 'A'

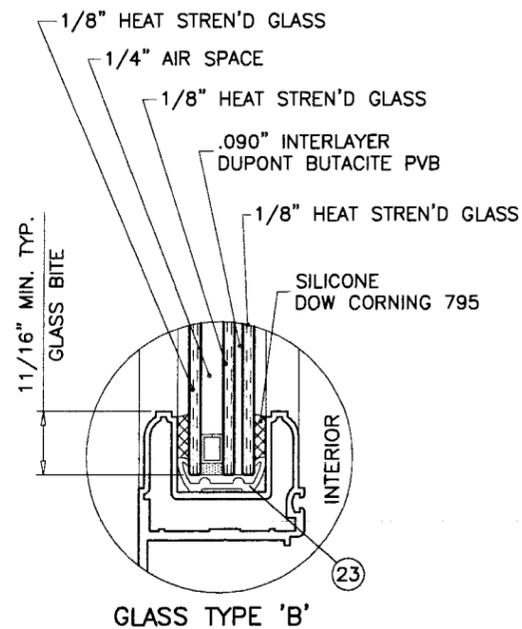

GLASS TYPE 'B'

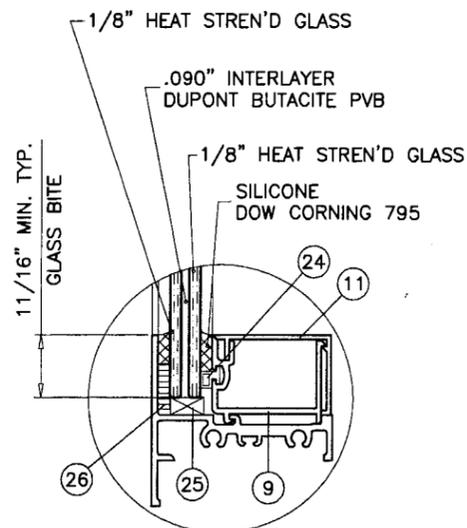

GLASS TYPE 'A'

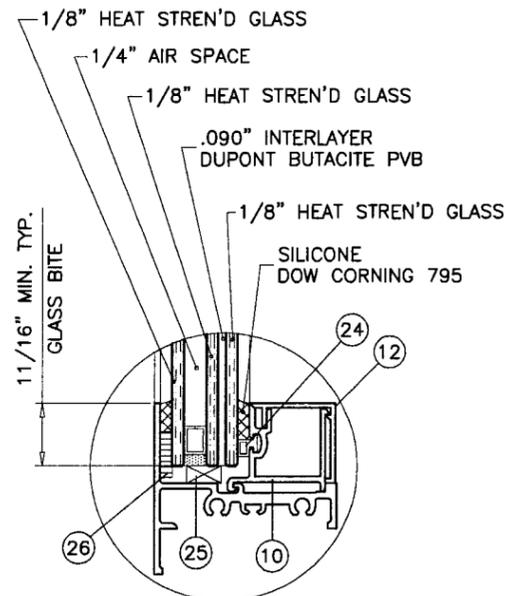

GLASS TYPE 'B'

GLAZING OPTIONS

ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPLIER/REMARKS
1	CM100-001	2/ WDW	FRAME JAMB	6063-T6	-
2	CM100-002	2/ WDW	FRAME HEAD AND SILL	6063-T6	-
3	CM100-007	AS REQD.	FRAME JAMB (FIX.)	6063-T6	FOR FIXED WINDOW
4	CM100-008	AS REQD.	HORIZ. IMPOST	6063-T6	FOR FIXED WINDOW
5	CM100-012	AS REQD.	JAMB ANCHOR CLIP	6063-T6	-
6	CM100-013	AS REQD.	VENT HINGE	6005-T5	INSTALLED WITH (3) #10 X 3/8" MS
7	CM100-014	AS REQD.	FRAME HINGE	6005-T5	INSTALLED WITH (2) #10 X 3/8" MS
8	CM100-015	AS REQD.	FRAME HEAD/SILL (FIX.)	6063-T6	FOR FIXED WINDOW
9	CM100-016	4/ WDW	GLAZING BEAD (LAM. GLASS)	6063-T6	FOR FIXED WINDOW
10	CM100-017	4/ WDW	GLAZING BEAD (LAM. INS. GLASS)	6063-T6	FOR FIXED WINDOW
11	CM100-018	4/ WDW	SNAP COVER (LAM. GLASS)	6063-T6	FOR FIXED WINDOW
12	CM100-019	4/ WDW	SNAP COVER (LAM. INSUL. GLASS)	6063-T6	FOR FIXED WINDOW
13	CM100-032	AS REQD.	VERTICAL IMPOST	6063-T6	-
14	CM100-021	2/ IMPOST	ANCHOR CLIP FOR VERTICAL IMPOST	6063-T6	-
15	CM100-022	-	ANCHOR ARM OPERATOR	6063-T6	-
16	-	AS REQD.	SCREENS	ALUMINUM	OPTIONAL
19	CM100-026	4	VENT FRAME	6063-T6	-
20	CM100-027	1/ CORNER	CORNER LOCK	6063-T6	-
21	V-033	AS REQD.	TREMCO TR-5804N SPONGE	NEOPRENE	-
22	V-054	AS REQD.	VINYL FOR LAM. GLASS - VENT	PVC	-
23	V-055	AS REQD.	VINYL FOR LAM. INSUL. GLASS - VENT	PVC	-
24	V-059	AS REQD.	VINYL FOR LAM. & LAM. INSUL. GLASS (FIX.)	PVC	-
25		AS REQD.	3/16" X 3/8" X 4" LG. SETTING BLOCK	-	-
26		AS REQD.	1/8" X 1/2" SINGLE FACE TAPE	-	-
27	P-025	-	PLASTIC CAM M & M	NYLON	-
30	CD25 & CD35	-	SINGLE ARM OPERATOR	ST. STEEL	ROTO HARDWARE SYSTEMS
31	-	-	-	-	-
32	LB05-6645	-	3 POINT LOCK ASSEMBLY	-	ROTO HARDWARE SYSTEMS
33	GT553	-	GUIDE HOUSING	-	ATTACHED W/ (3) #8 X 3/4" SMS
34	GS001	-	STRIKER	-	ATTACHED W/ (3) #8 X 1/2" SMS
35	#10 X 1"	2/ CORNER	FRAME ASSEMBLY SCREW	ST. STEEL	PH PHL. SMS
36	#10 X 1/2"	2/ CORNER	VENT ASSEMBLY SCREWS	ST. STEEL	FH PHL. SMS
37	#10 X 3/4"	4/ CORNER	IMPOST ASSEMBLY SCREWS	ST. STEEL	PH PHL. SMS
38	#10 X 3/4"	2/ SIDE	IMPOST ASSEMBLY SCREWS	ST. STEEL	FH PHL. SMS

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

MAR 15 2007

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 06-1130.01
Expiration Date JULY 29, 2009

By *Muhammad*
Miami Dade Product Control
Division

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-16RC




CM100 ALUMINUM CASEMENT WINDOW (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
2805 N.W. 75 TH AVE.
MIAMI, FL. 33122
TEL. (305) 592-1515 FAX. (305) 592-2184

revisions:

no	date	by	description
A	09.21.06		UPDATED FOR 2004 FBC

date: 03-01-04
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W04-16
sheet 3 of 7

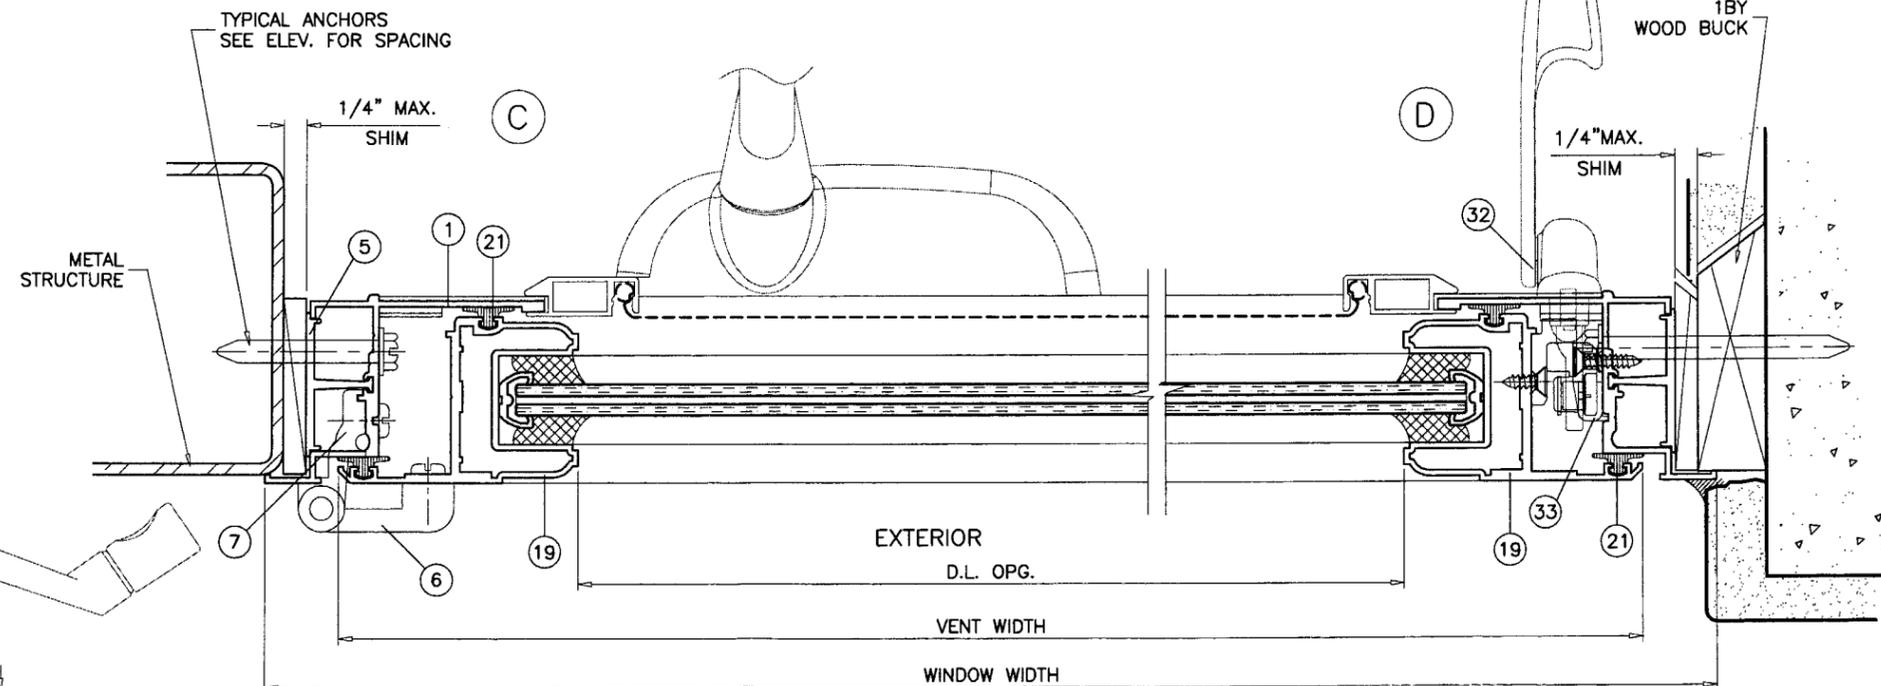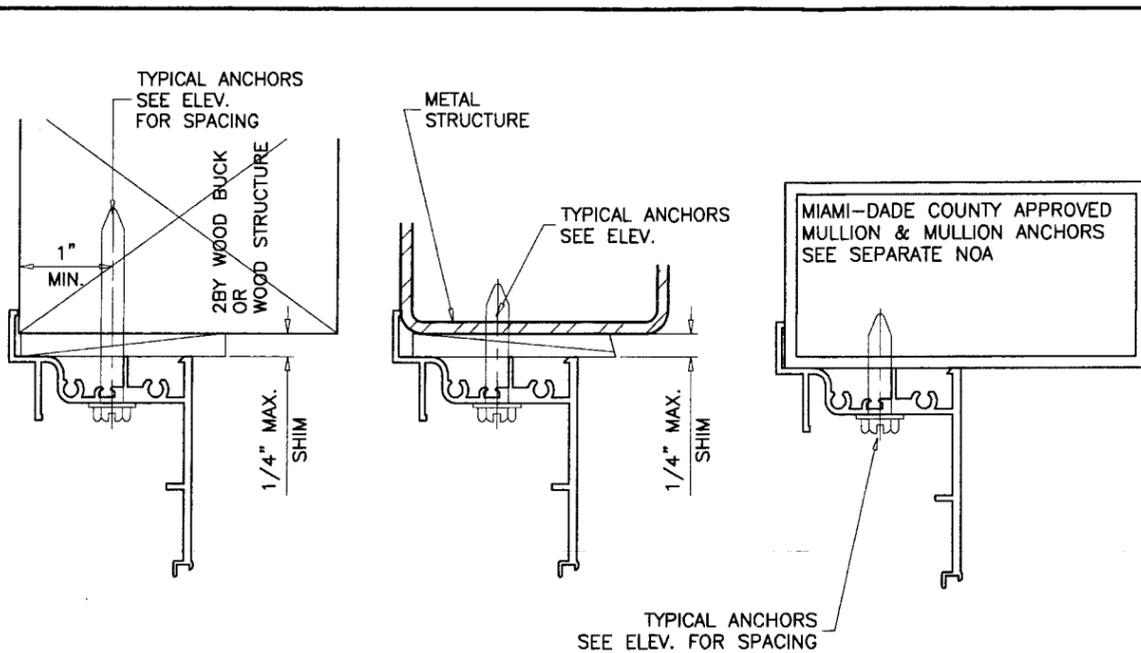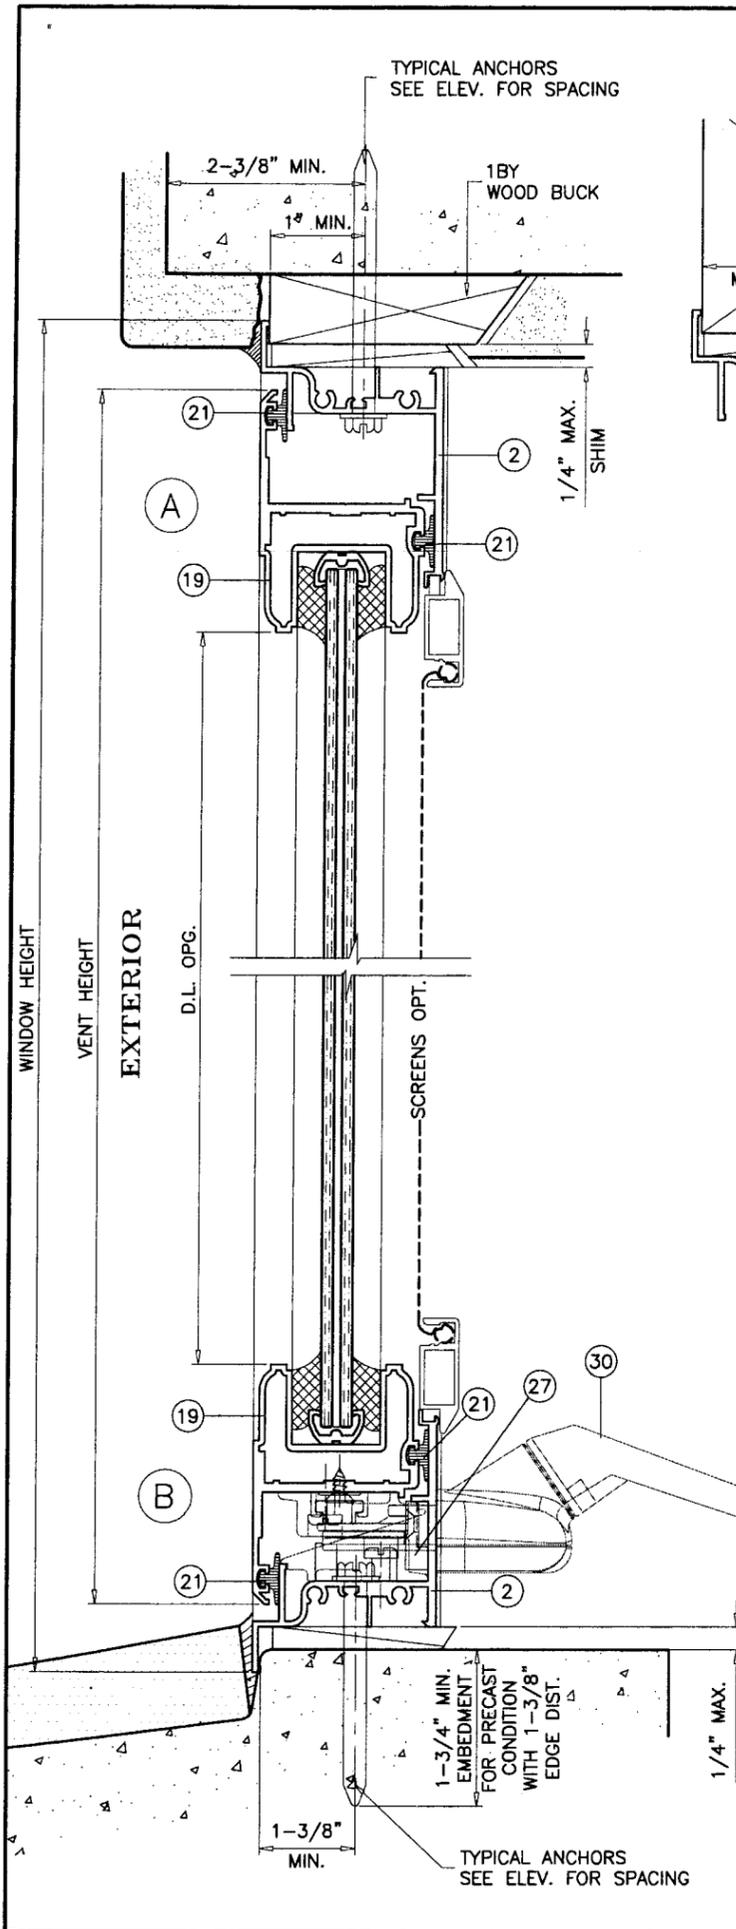

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
1/4" HILTI KWIK-CON II
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SMS OR SELF DRILLING SCREWS
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#14 SMS OR SELF DRILLING SCREWS
 INTO DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
 (NO SHIM SPACE)

ANCHOR EDGE DISTANCES
 INTO CONCRETE AND MASONRY = NOTED
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 1/2" MIN.

SEALANTS:
 ALL FRAME AND VENT CORNERS SEALED WITH
 JOINT SEALANT.

SINGLE VENT WINDOWS

WOOD BUCKS AND METAL STRUCTURE NOT BY RC ALUMINUM
 MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
 AND TRANSFER THEM TO THE BUILDING STRUCTURE.

Engr. DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538
 MAR 15 2007

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 06-1130.01
 Expiration Date. JULY 29, 2009
 By Maxwell
 Miami/Dade Product Control
 Division

af c

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W04-16RC


CM100 ALUMINUM CASEMENT WINDOW (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
 2805 N.W. 75 TH AVE.
 MIAMI, FL. 33122
 TEL. (305) 592-1515 FAX. (305) 592-2184

no	date	description
A	09.21.06	UPDATED FOR 2004 FBC


revisions:

date: 03-01-04
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W04-16
 sheet 4 of 7

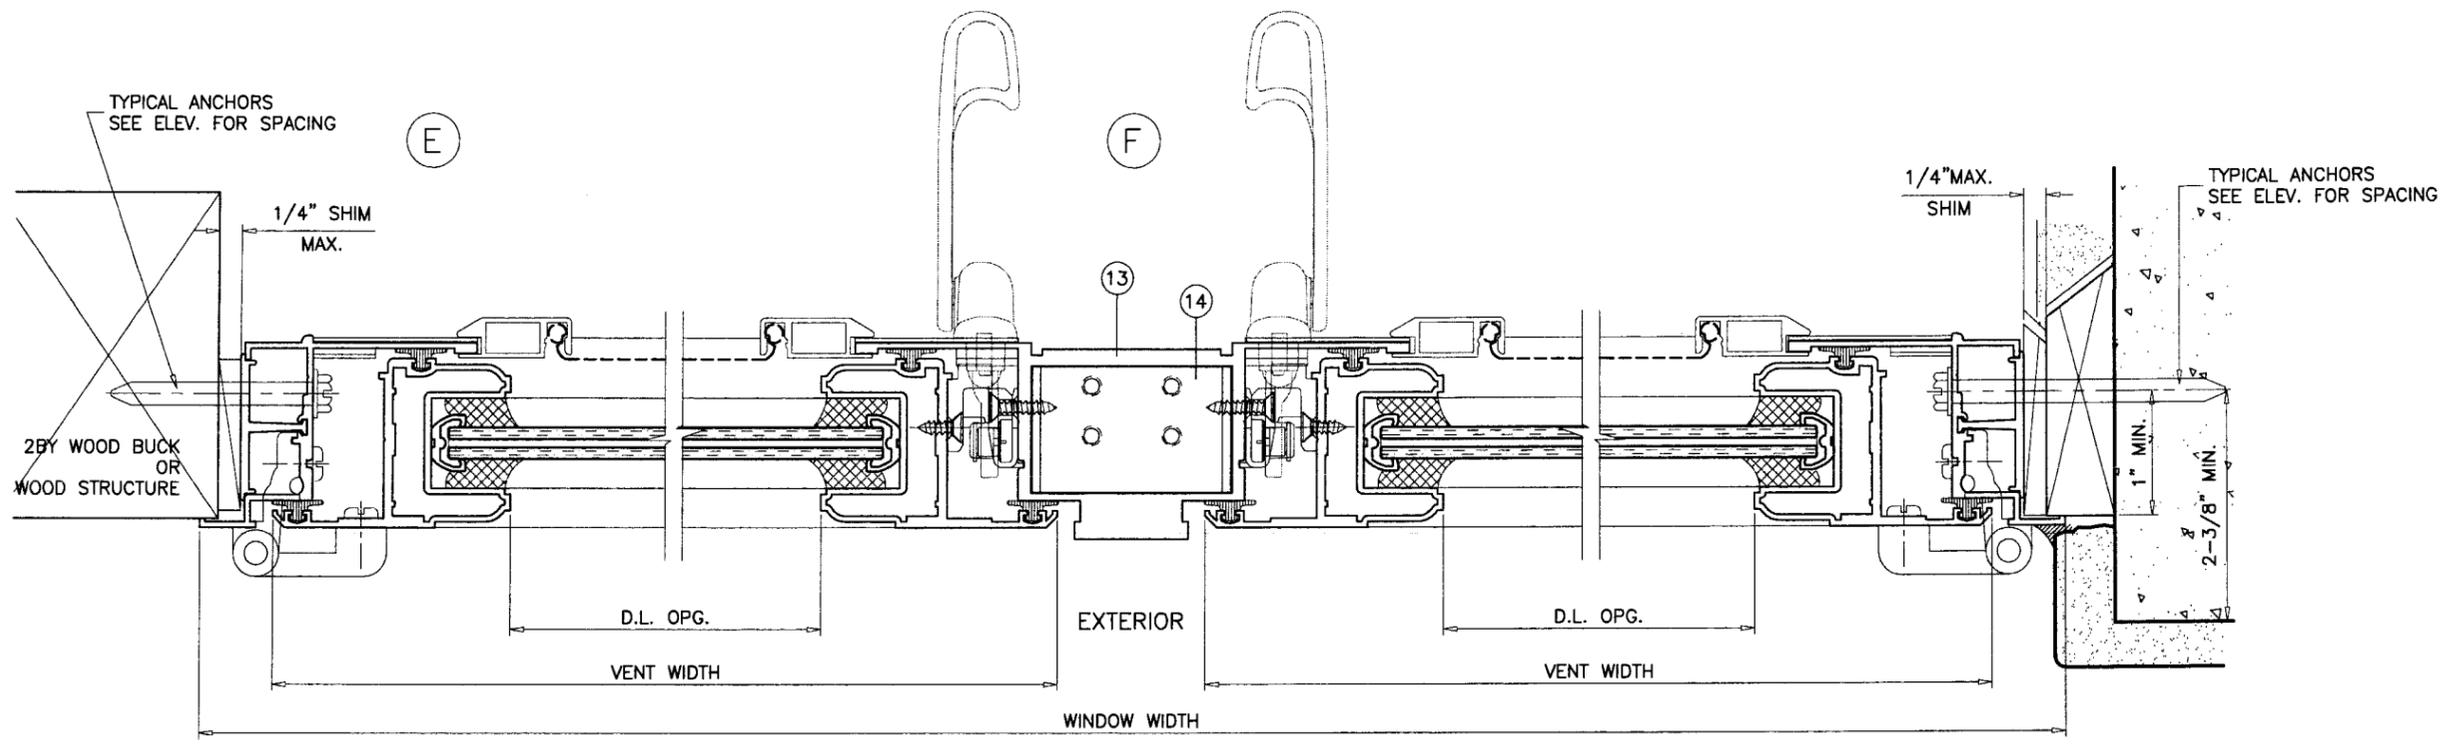

DUAL VENT WINDOWS

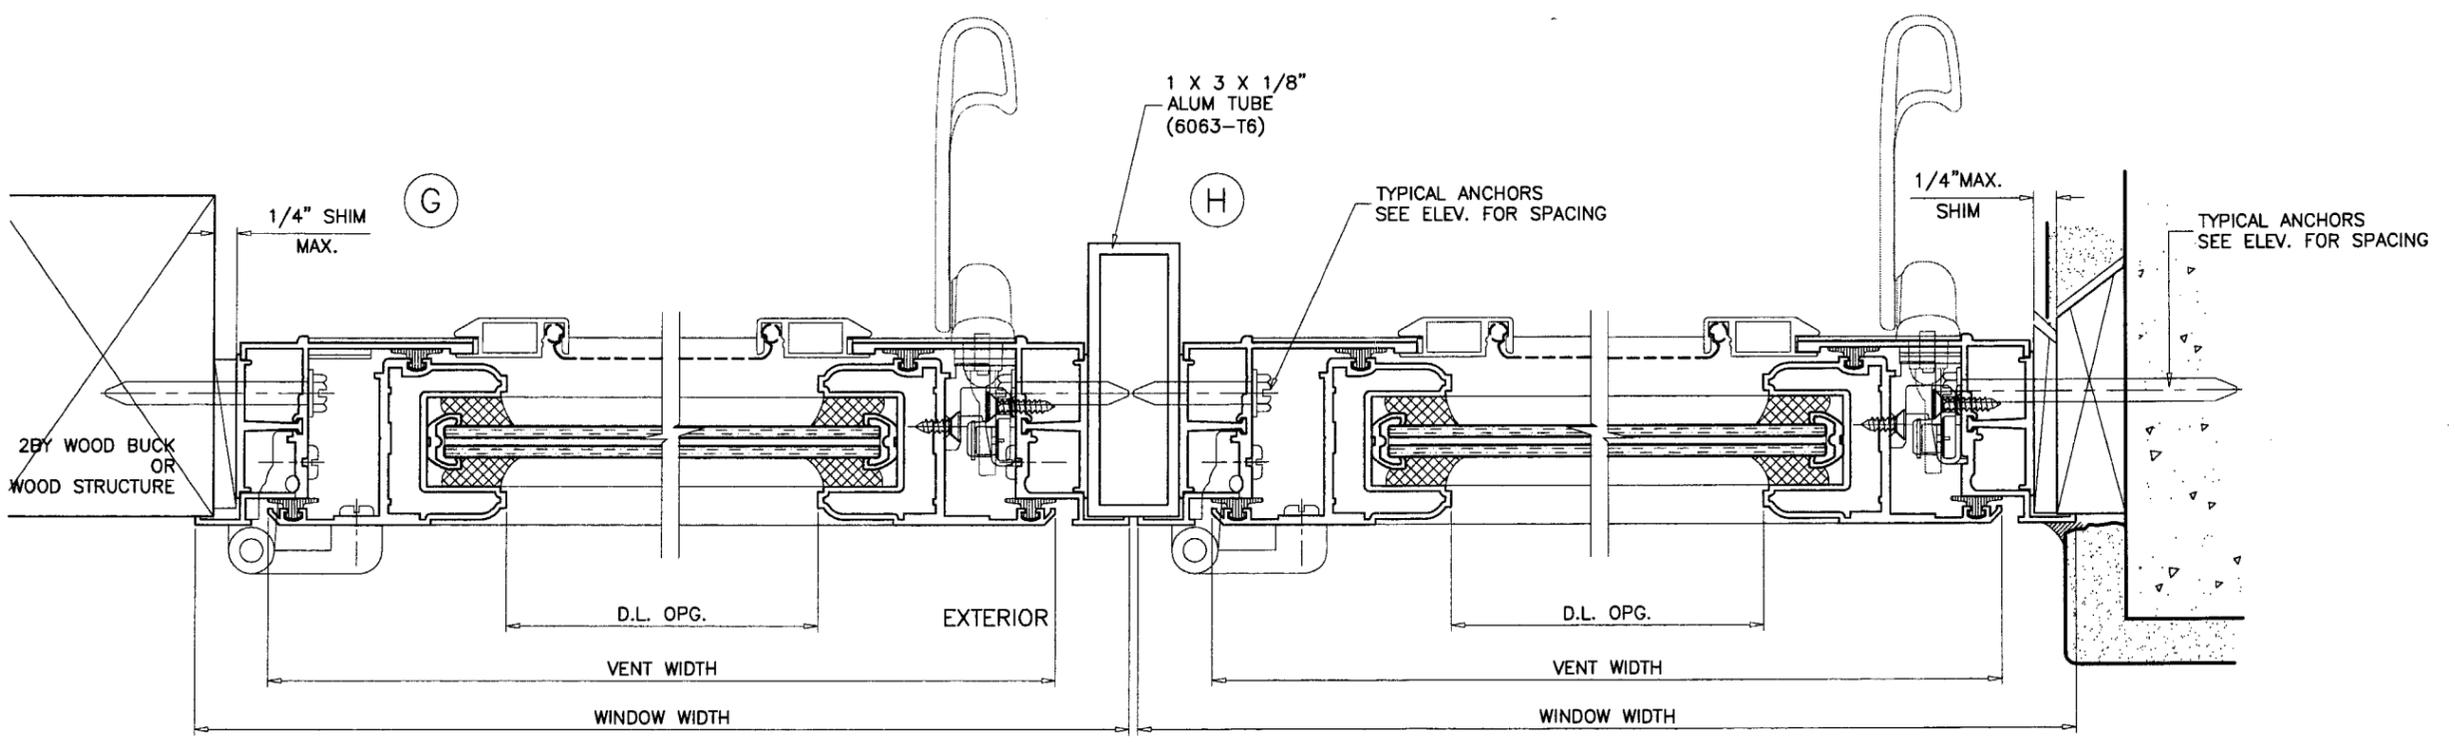

SIDE BY SIDE WINDOWS

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

[Signature]
MAR 15 2007

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 06-1130-01
Expiration Date JUL 29, 2009

By *[Signature]*
Miami Dade Product Control
Division



afc
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-16RC

CM100 ALUMINUM CASEMENT WINDOW (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
2805 N.W. 75 TH AVE.
MIAMI, FL. 33122
TEL. (305) 592-1515 FAX. (305) 592-2184

no	date	by	description
A	09.21.06		UPDATED FOR 2004 FBC

date: 03-01-04
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W04-16
sheet 5 of 7

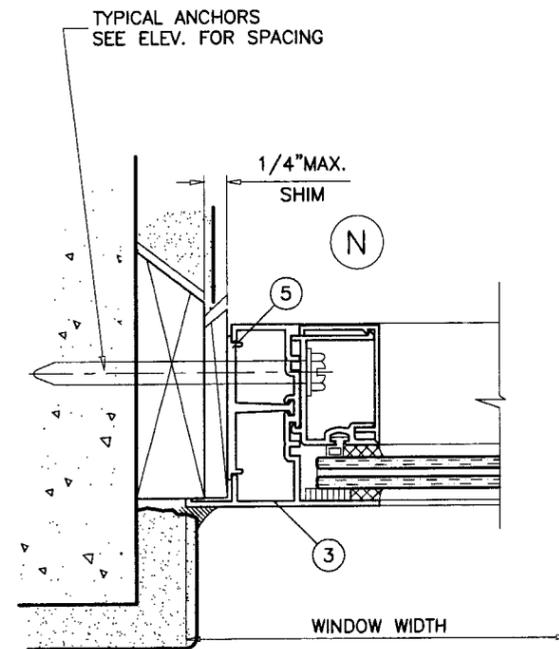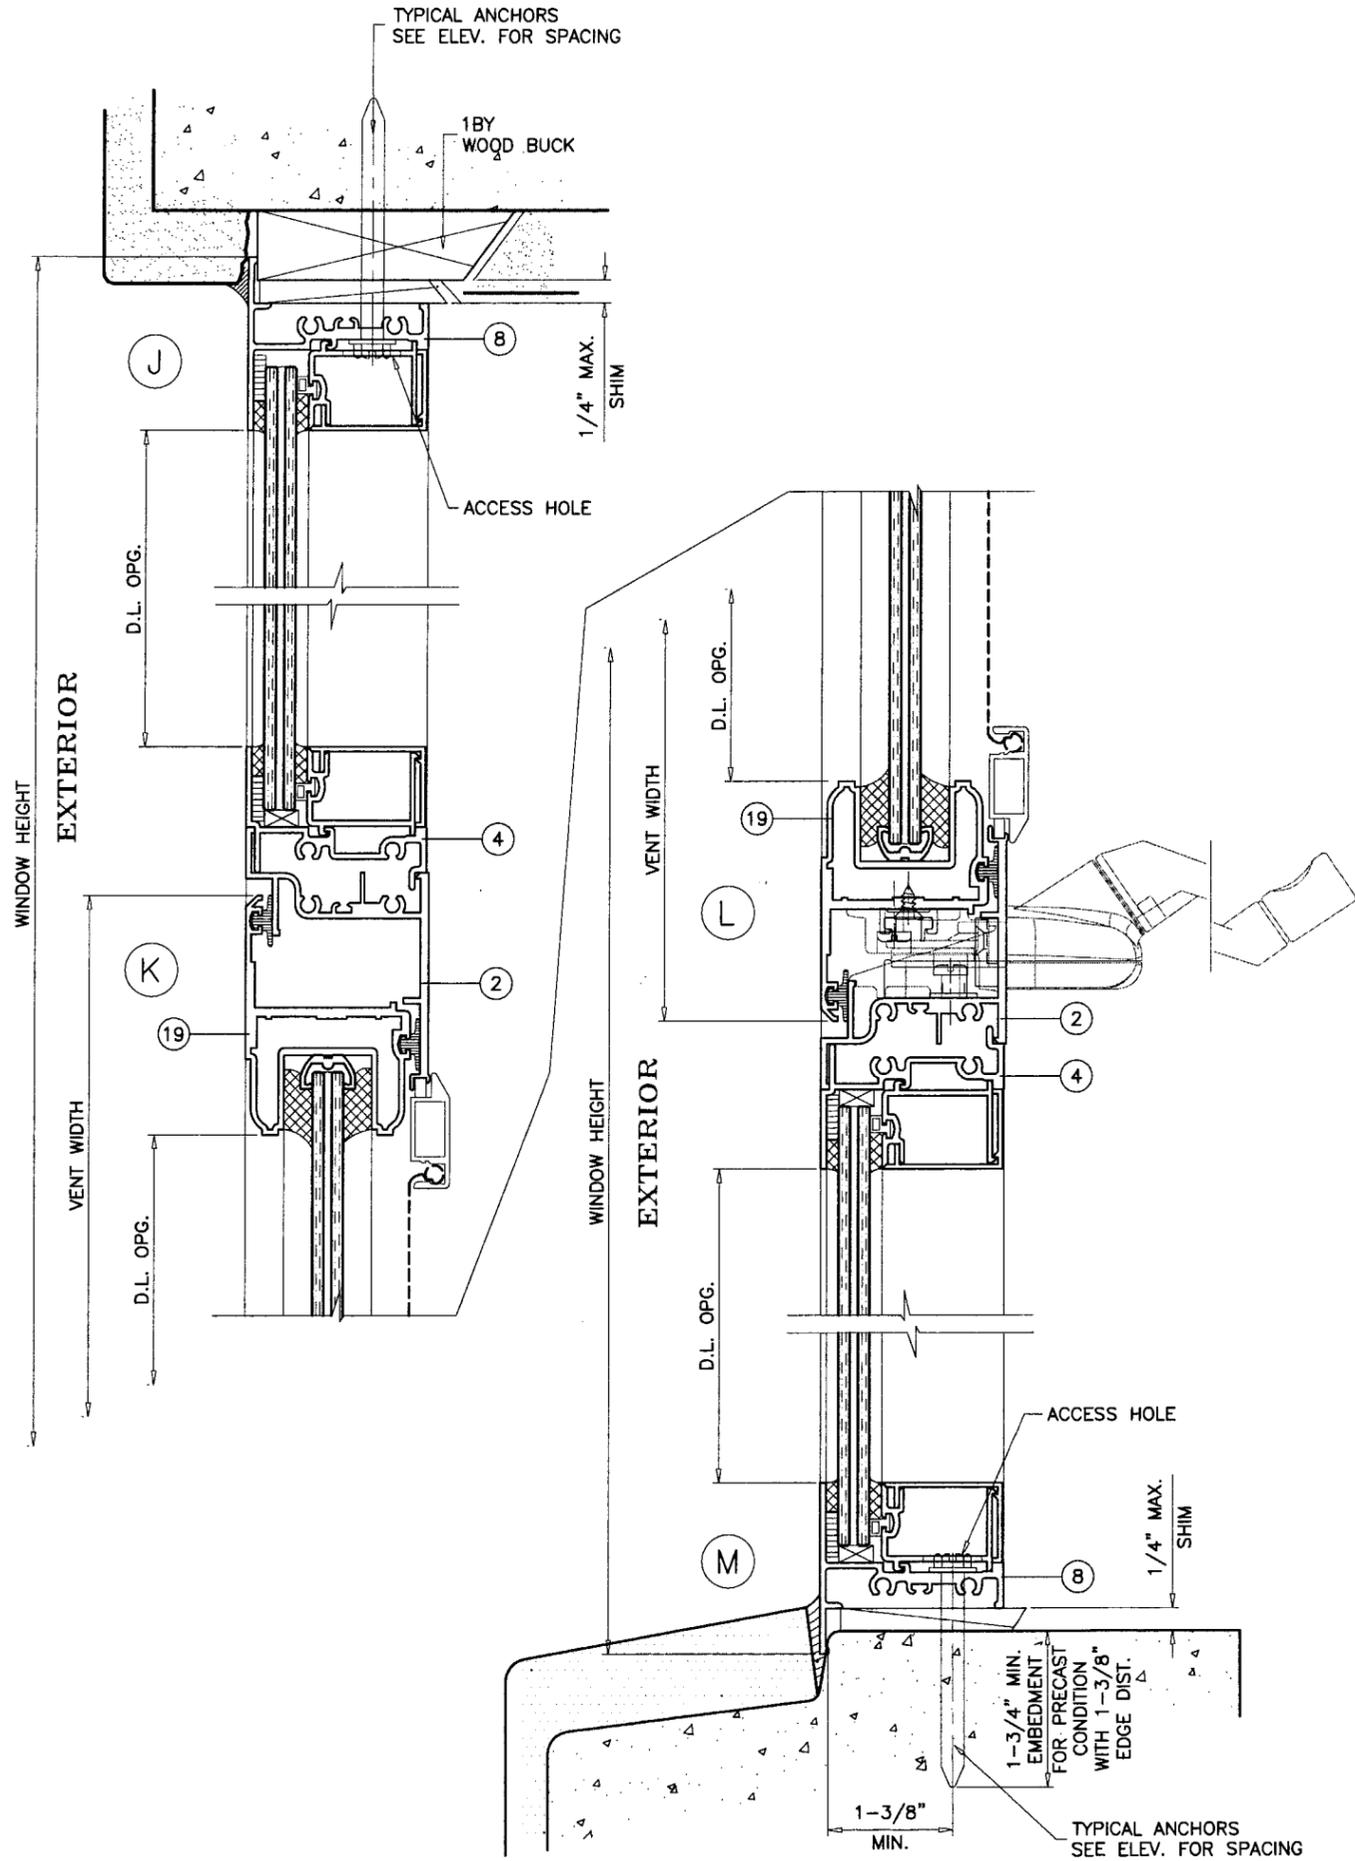

Engr. DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538
 MAR 15 2007


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 06-113D.01
 Expiration Date: JULY 29, 2009
 By *Manuel Perez*
 Miami Dade Product Control
 Division

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W04-16RC


CM100 ALUMINUM CASEMENT WINDOW (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
 2805 N.W. 75 TH AVE.
 MIAMI, FL. 33122
 TEL. (305) 592-1515 FAX. (305) 592-2184

revisions:	no	date	description
	A	09.21.06	UPDATED FOR 2004 FBC


date: 03-01-04	scale: 1/2" = 1"	dr. by: HAMID	chk. by:
drawing no. W04-16		sheet 6 of 7	

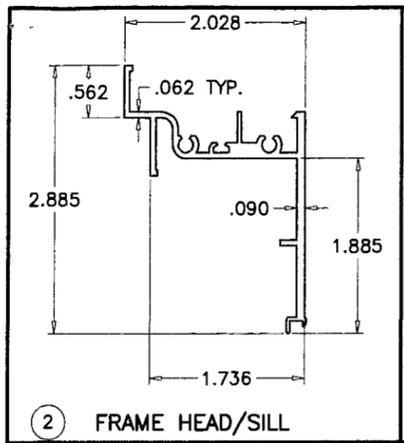


② FRAME HEAD/SILL

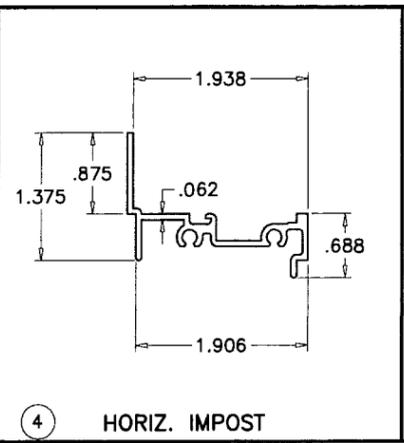


④ HORIZ. IMPOST

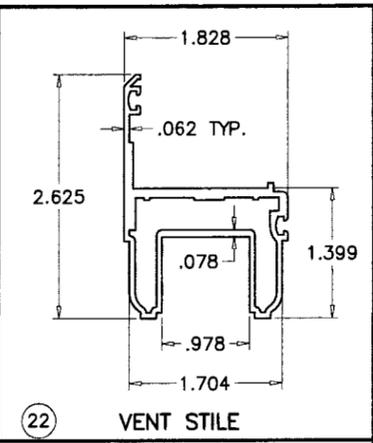


②② VENT STILE

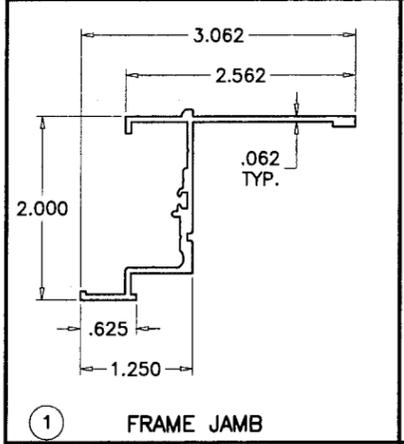


① FRAME JAMB

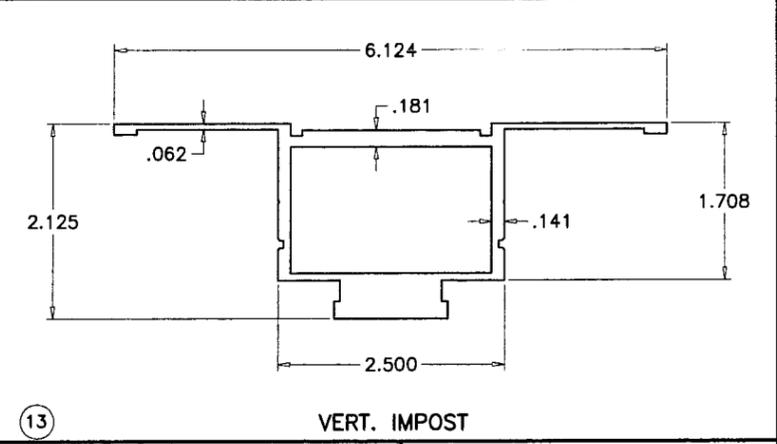


⑬ VERT. IMPOST

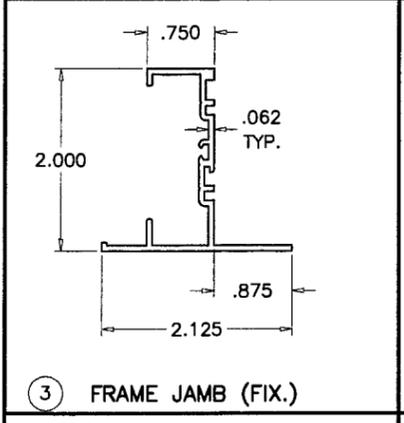


③ FRAME JAMB (FIX.)

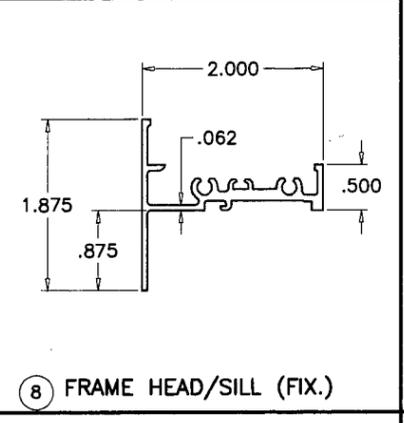


⑧ FRAME HEAD/SILL (FIX.)

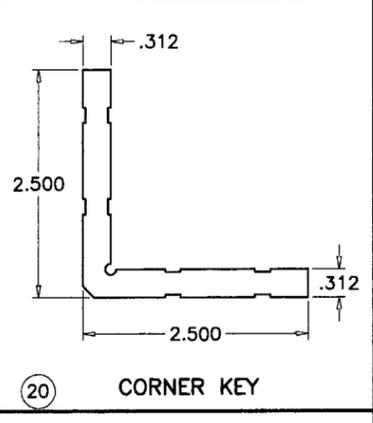


②⑦ CORNER KEY

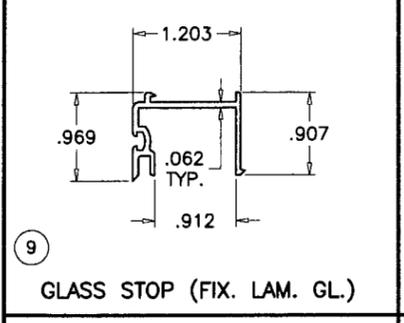


⑨ GLASS STOP (FIX. LAM. GL.)

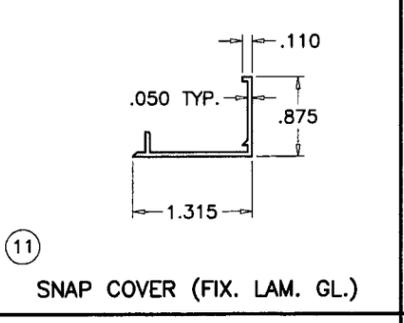


⑪ SNAP COVER (FIX. LAM. GL.)

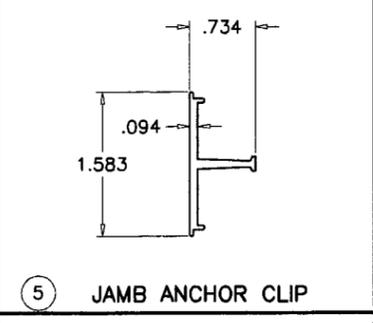


⑤ JAMB ANCHOR CLIP

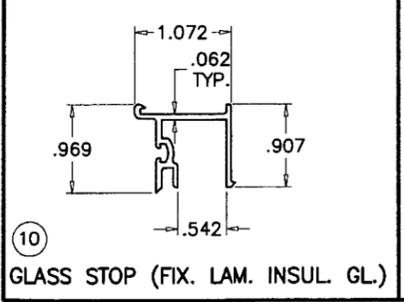


⑩ GLASS STOP (FIX. LAM. INSUL. GL.)

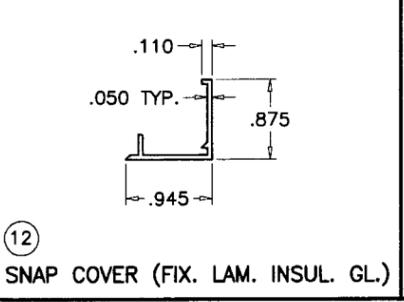


⑫ SNAP COVER (FIX. LAM. INSUL. GL.)

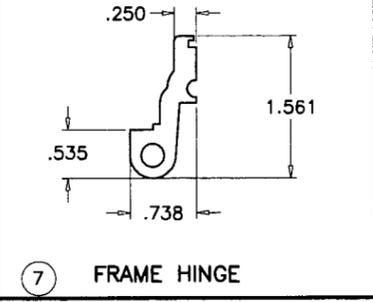


⑦ FRAME HINGE

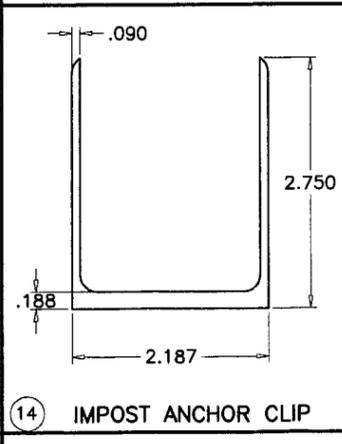


⑭ IMPOST ANCHOR CLIP

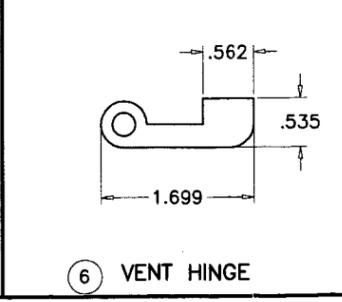


⑥ VENT HINGE

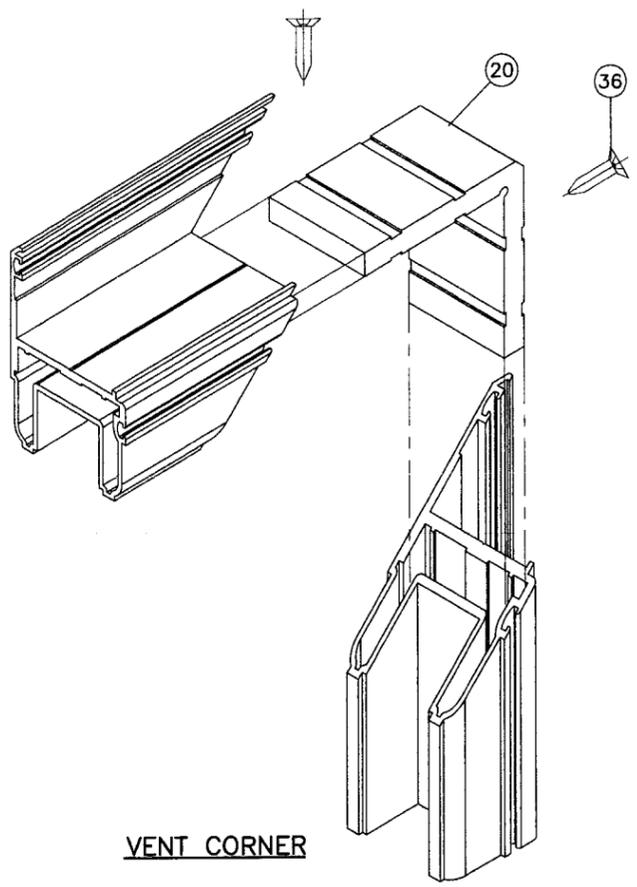

VENT CORNER

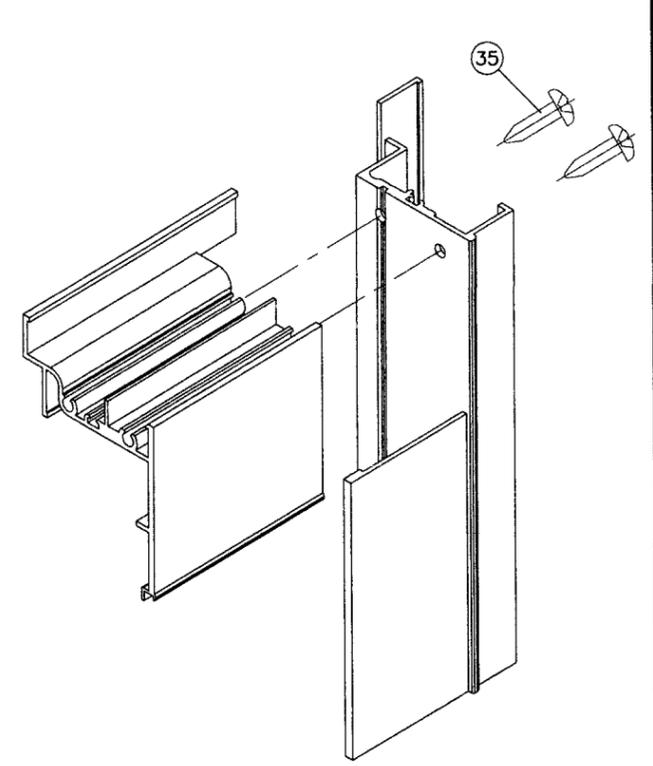

FRAME CORNER

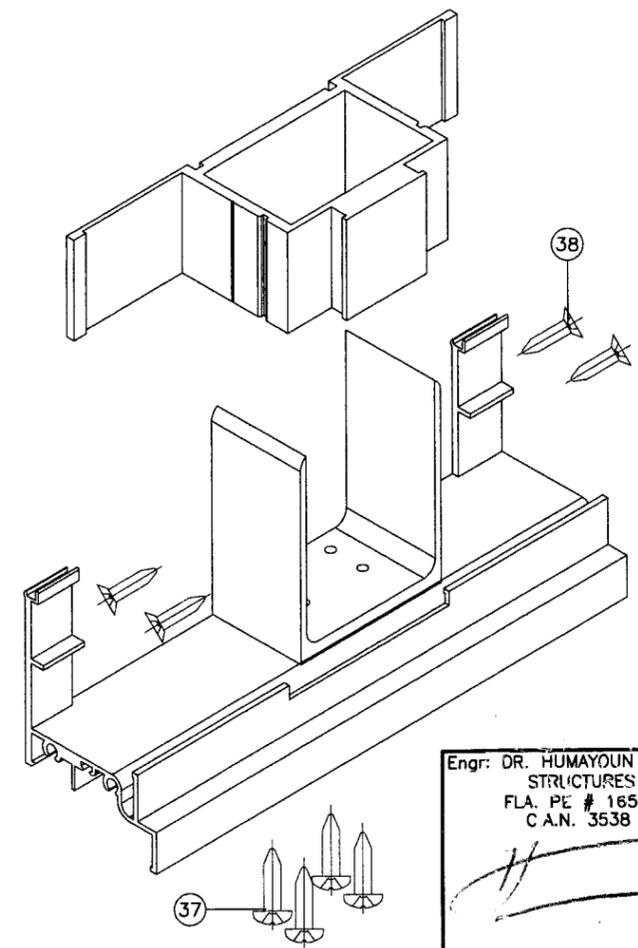

IMPOST CORNER

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

MAR 15 2007

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 06-1130.01
Expiration Date 06/29/2009

By: *Manuel Jara*
Miami Dade Product Control
Division

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-16RC

CM100 ALUMINUM CASEMENT WINDOW (L.M.I.)

R.C. ALUMINUM INDUSTRIES INC.
2805 N.W. 75 TH AVE.
MIAMI, FL. 33122
TEL. (305) 592-1515 FAX. (305) 592-2184

no	date	by	description
A	08.21.06		UPDATED FOR 2004 FBC

revisions:

date: 03-01-04
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no. **W04-16**
sheet 7 of 7