



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING

140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

www.miamidade.gov

NOTICE OF ACCEPTANCE (NOA)

Welbilt Walks-Ins, LP dba KYSOR PANEL SYSTEMS
4201 Janada Street
Ft. Worth, TX 76117

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Walk-In Coolers and Freezers

APPROVAL DOCUMENT: Drawing No. 98-18, titled "Walk-In Coolers and Freezers", sheets 1 through 6 of 6, prepared by Al-Farooq Corporation, dated April 27, 1998, last revision #C dated December 14, 1998, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 01-1115.02** and consists of this page 1, evidence submitted pages E-1, E-2, & E-3 as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**

Helmy A. Makar
 04/19/2007

NOA No 07-0104.07
Expiration Date: 01/07/2008
Approval Date: 04/19/2007
Page 1



Welbilt Walks-Ins, LP dba KYSOR PANEL SYSTEMS

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED


1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 98-0518.03

A. DRAWINGS

1. *Drawing No. 98-18, titled "Walk-in Coolers and Freezer", prepared by Al-Farooq Corporation, last revision #C dated December 14, 1998, sheets 1 through 6 of 6, signed and sealed by Humayoun Farooq, P.E.*

B. TESTS

1. *Test report on Uniform Static air Pressure Test on Galvanized Steel Sheathed Polyurethane Foam Filled Modular Panel Walk-in Coolers / Freezers, prepared by Hurricane Engineering & Testing, Inc., Report No. HETI-98-718, dated March 20, 1998, signed and sealed by Hector M. Medina, P.E.*
2. *Test report on Large Missile Impact Test and Cyclic Load Test on Galvanized Steel Sheathed Polyurethane Foam Filled Modular Panel Walk-in Coolers / Freezers, prepared by Hurricane Engineering & Testing, Inc., Report No. HETI-98-721, dated March 27, 1998, signed and sealed by Hector M. Medina, P.E.*
3. *Test report on Continuous Span Uniform Static air Pressure Test on Galvanized Steel Sheathed Polyurethane Foam Filled Modular Panel Walk-in Coolers / Freezers, prepared by Hurricane Engineering & Testing, Inc., Report No. HETI-98-725, dated April 10, 1998, signed and sealed by Hector M. Medina, P.E.*
4. *Test report on 24 Hour Live Load Test on Galvanized Steel Sheathed Polyurethane Foam Filled Modular Panel Walk-in Coolers / Freezers, prepared by Hurricane Engineering & Testing, Inc., Report No. HETI-98-719, dated April 15, 1998, signed and sealed by Hector M. Medina, P.E.*
5. *Test report on Racking Load Test on Galvanized Steel Sheathed Polyurethane Foam Filled Modular Panel Walk-in Coolers / Freezers, prepared by Hurricane Engineering & Testing, Inc., Report No. HETI-98-734, dated May 4, 1998, signed and sealed by Hector M. Medina, P.E.*
6. *Test report on Compression Load Test on Galvanized Steel Sheathed Polyurethane Foam Filled Modular Panel Walk-in Coolers / Freezers, prepared by Hurricane Engineering & Testing, Inc., Report No. HETI-98-732, dated May 8, 1998, signed and sealed by Hector M. Medina, P.E.*
7. *Standard Test Method for Determining Ignition Properties of Plastics, Report No. 8903-103245, per ASTM D1929-96, prepared by Omega Point Laboratories, dated May 4, 1998, signed and sealed by John W. Dougherty.*
8. *Surface Burning Characteristics of Building Materials, Report No. 8903-103246, per ASTM E-84-95, prepared by Omega Point Laboratories, dated May 4, 1998, signed and sealed by John W. Dougherty.*



Henry A. Makar, P. E., M.S.
Product Control Examiner
NOA No 07-0104.07
Expiration Date: 01/07/2008
Approval Date: 04/19/2007

Welbilt Walks-Ins, LP dba KYSOR PANEL SYSTEMS

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Calculation titled "Panel Calculations", dated May 14, 1998, 22 pages, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E.

D. MATERIAL CERTIFICATIONS

1. Mill Certified Test Report issued by Industrias Monterrey, S.A.DE C.V., dated 12/24/97, with the Chemical analysis and Mechanical Properties for 0.0190", G-60 Steel conforming to ASTM A-653.
2. Tensile Test Report No. HETI-98-T83, prepared by Hurricane Engineering & Testing, Inc., dated 04/13/98, signed and sealed by Hector M. Medina, P.E.

2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 01-1115.02

A. DRAWINGS

See NOA 98-0518.03

B. TESTS

See NOA 98-0518.03

C. CALCULATIONS

See NOA 98-0518.03

D. MATERIAL CERTIFICATIONS

See NOA 98-0518.03

E. STATEMENTS

See NOA 98-0518.03

F. OTHER

See NOA 98-0518.03


3. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. None.

B. TESTS

1. None.



Helmy A. Makar, P. E., M.S.
Product Control Examiner
NOA No 07-0104.07
Expiration Date: 01/07/2008
Approval Date: 04/19/2007

Welbilt Walks-Ins, LP dba KYSOR PANEL SYSTEMS

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS


1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *None.*




Helmy A. Makar, P. E., M.S.

Product Control Examiner


NOA No 07-0104.07

Expiration Date: 01/07/2008

Approval Date: 04/19/2007

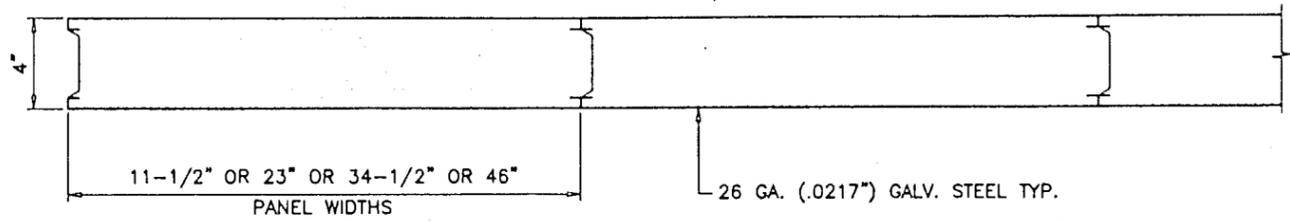

KYSOR STRUCTURAL STEEL/FOAM PANELS
SCALE: 1/8" = 1"

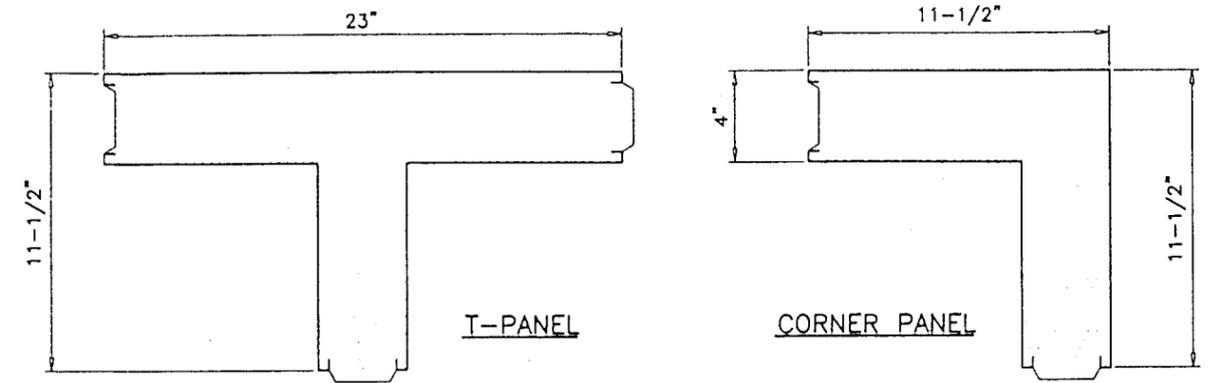


WALL PANELS-SINGLE SPAN $\Delta = L/180$	
DESIGN WIND LOAD	ALLOWABLE SPAN
30 PSF	12'-8"
40 PSF	11'-6"
50 PSF	10'-8"
60 PSF	10'-0"

ROOF PANELS-SINGLE SPAN $\Delta = L/240$	
DESIGN WIND LOAD	ALLOWABLE SPAN
30 PSF	10'-0"
40 PSF	10'-0"
50 PSF	9'-8"
60 PSF	9'-1"

FOR LIVE LOAD 30 PSF, MAXIMUM SPAN = 10'-0"
USE SMALLER SPAN ALLOWED BY WIND OR LIVE LOAD

MAX. RACKING LOAD = 1200 Lbs./LIN. FT. OF PANEL LENGTH
COMPRESSION LOAD = 650.0 Lbs./LIN. FT. OF PANEL WIDTH

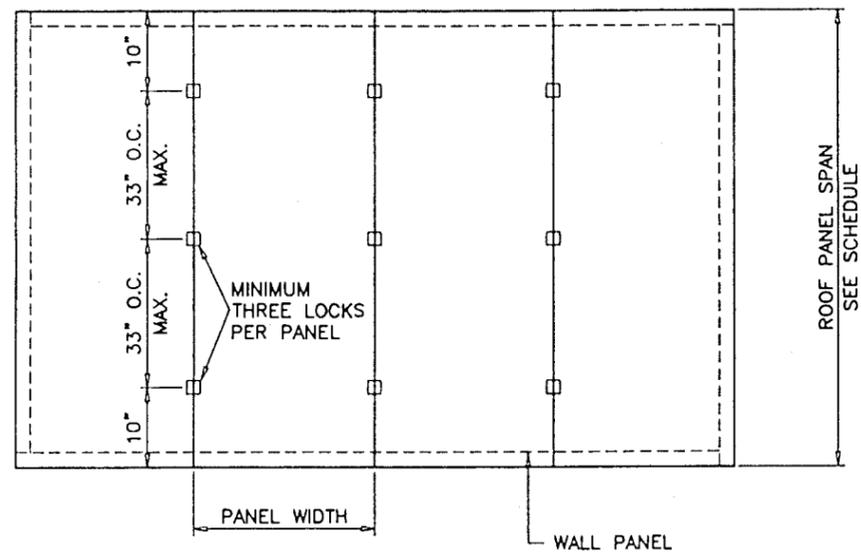

ROOF PLAN
SCALE: 1/4" = 1'-0"


SHEET #	INDEX OF DRAWING
1 TO 3	SHOWS TYPICAL PANEL/DOOR ELEV. & DETAILS
4	SHOWS BEAM AND COLUMN CONNECTION DETAILS
5 & 6	SHOWS ADDITIONAL DETAILS FOR VARIOUS COOLERS/FREEZERS ARRANGEMENTS

GENERAL NOTES


- THIS STRUCTURE IS DESIGNED AS PER THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR DADE COUNTY. ALSO FOR WIND LOADS AS PER ASCE 7-88 USING CORRESPONDING LOADS.
- STRUCTURAL STEEL SHALL CONFORM TO ASTM DESIGNATION A-36 AND STEEL SHEET SHALL CONFORM TO ASTM DESIGNATION A-653, GALVANIZED WITH A COATING DESIGNATION OF G90. MIN. Y.S. = 48,380 PSI.
- ALL CONCRETE SHALL HAVE A 28 DAY COMPRESSIVE STRENGTH OF 3000 PSI.
- ELECTRICAL AND MECHANICAL DETAILS ARE NOT PART OF THIS APPROVAL.
- POLYURETHANE SHALL BE RIGID FOAM MIN. DENSITY #2 C.F.
- MAX. FLAME SPREAD RATING = 15 AS PER ASTM E-84. SMOKE DEVELOPED INDEX = 125. SPONTANEOUS-IGNITION TEMPERATURE = 743°F.
- ALL STEEL TO BE SHOP PRIMED BEFORE ASSEMBLY.
- DISSIMILAR MATERIALS IN CONTACT WITH EACH OTHER SHALL BE PROTECTED IN ACCORDANCE WITH S.F.B.C. CHAPTER 30, SECTION 3004.4. MIN. SOIL BEARING CAPACITY = 2500 PSF.

DESIGN LOADS SHALL BE CALCULATED AS PER REQUIREMENTS OF ASCE 7-88, BASED ON 110 MPH WIND VELOCITY.

NOTE: COOLERS/FREEZERS LARGER THAN 400 SQ. FT. IN AREA SHALL BE EQUIPPED WITH AN APPROPRIATE FIRE SUPPRESSION SYSTEM, AS REQUIRED BY THE SFBC SUBSECTION 3505.3 (b) 2.
NOTE: THE MAX. LENGTH OF BUILDING SHOULD NOT EXCEED TWO TIMES THE WIDTH OF THE BUILDING. FOR BUILDING LENGTHS GREATER THAN TWO TIMES WIDTH INTERIOR DIAPHRAGM WALL WILL BE PROVIDED.

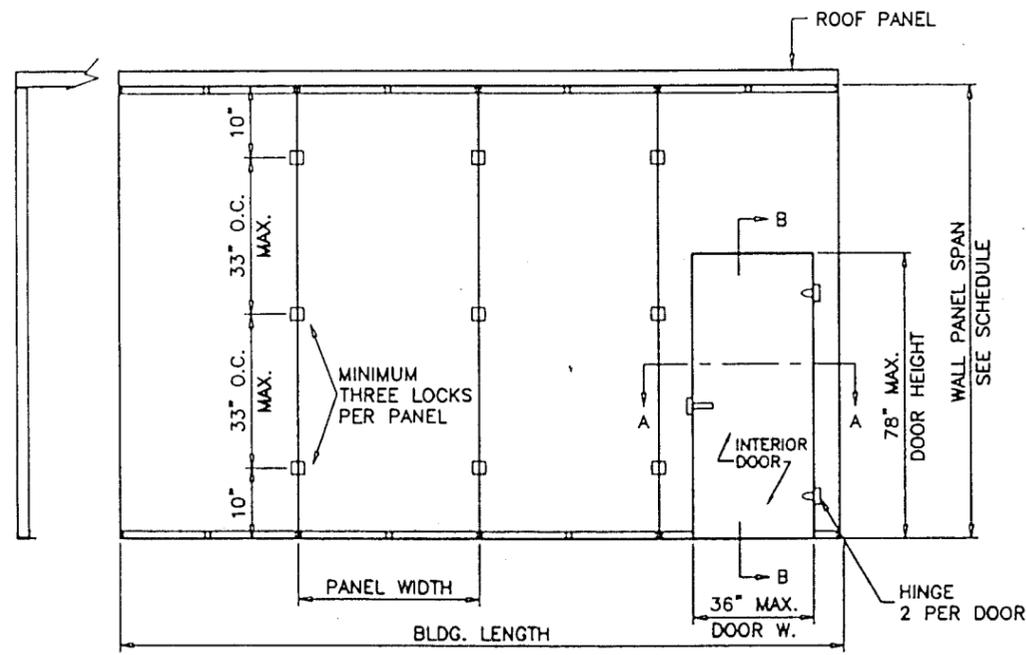

FRONT ELEVATION
SCALE: 1/4" = 1'-0"

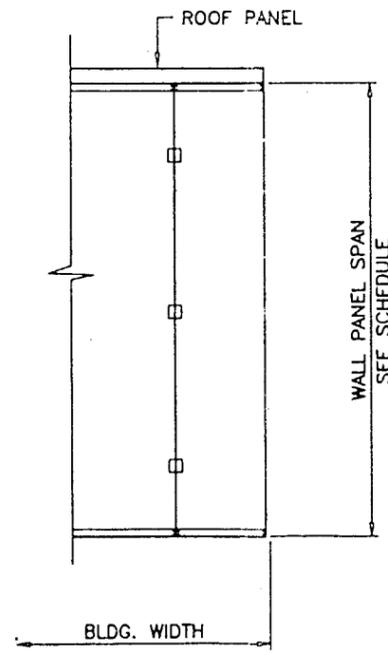

SIDE ELEVATION
SCALE: 1/4" = 1'-0"

PRODUCT RENEWED
as complying with the Florida Building Code
Acceptance No. 07-0104.07
Expiration Date 01/07/2008
By Helmy H. Metwally
Miami Under Product Control Division

PRODUCT RENEWED
ACCEPTANCE No. 01-1115.02
EXPIRATION DATE January 7, 2007
By [Signature]
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

Engr. DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 18557

DEC 15 1998

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE January 07, 1999
BY Helmy H. Metwally
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 98-0518.03


AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COOLER/98-18KPS

WALK-IN COOLERS AND FREEZERS
KYSOR PANEL SYSTEMS
4201 JANADA STREET
FORT WORTH, TEXAS 76117
TEL (800) 633-3426 FAX (817) 281-5521


revisions:	no	date	by	description
	A	8.15.98		SHEETS 5, 6 & 7 ADDED
	B	11.21.98		GENERAL REVISION
	C	12.14.98		GENERAL REVISION

date: 04-27-98
scale: NOTED
dr. by: HAMID
chk. by:


drawing no.
98-18
sheet 1 of 6

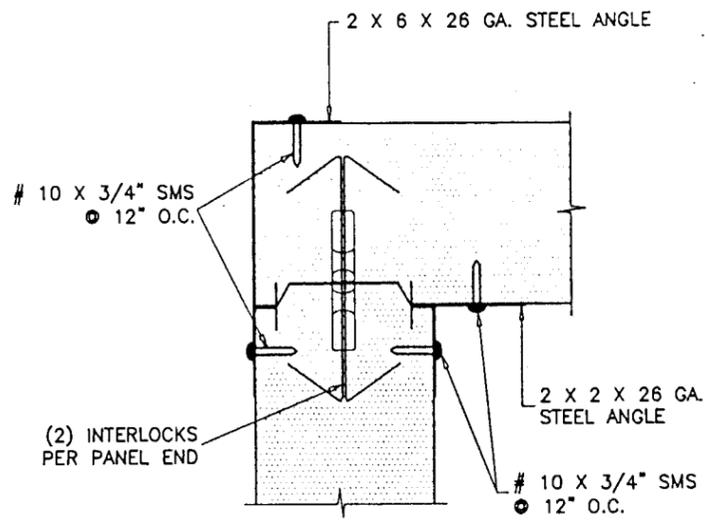


ROOF PANEL CONNECTION TO WALL

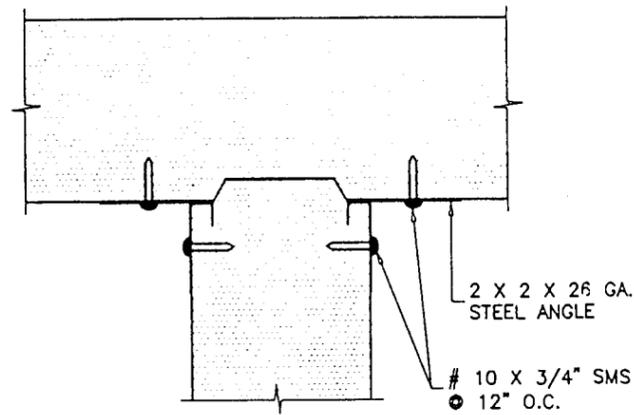


ROOF PANEL CONNECTION TO PARTITION WALL OR 'T' PANEL

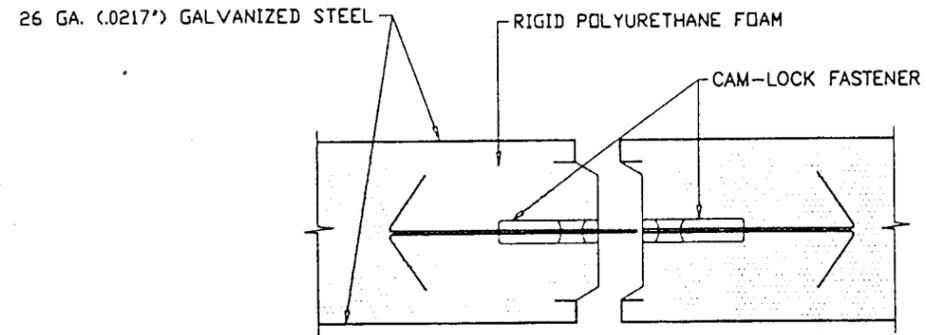


PANEL INTERLOCK DETAIL

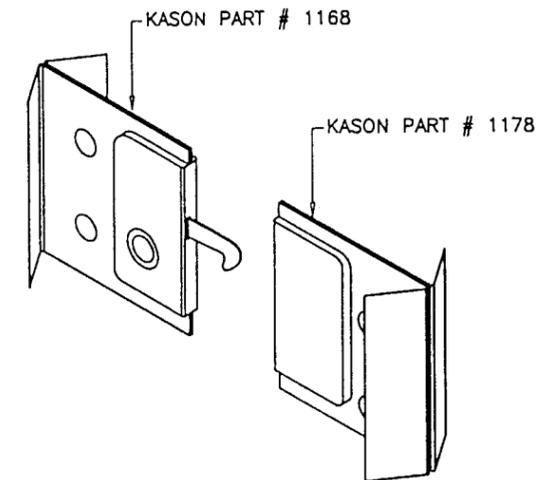


CAM-LOCK FASTENER

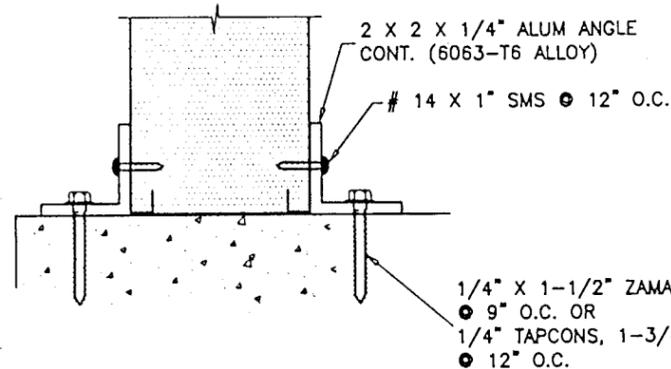


WALL CONNECTION TO FLOOR BOTH SIDES @ EXPOSED WALLS

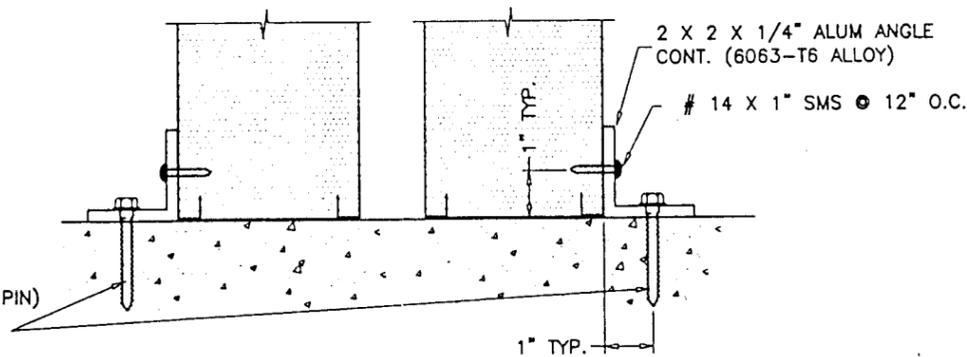

WALL CONNECTION TO FLOOR ONE SIDE WHEN ADJACENT TO COOLER/FREEZER OR BLDG. WALL

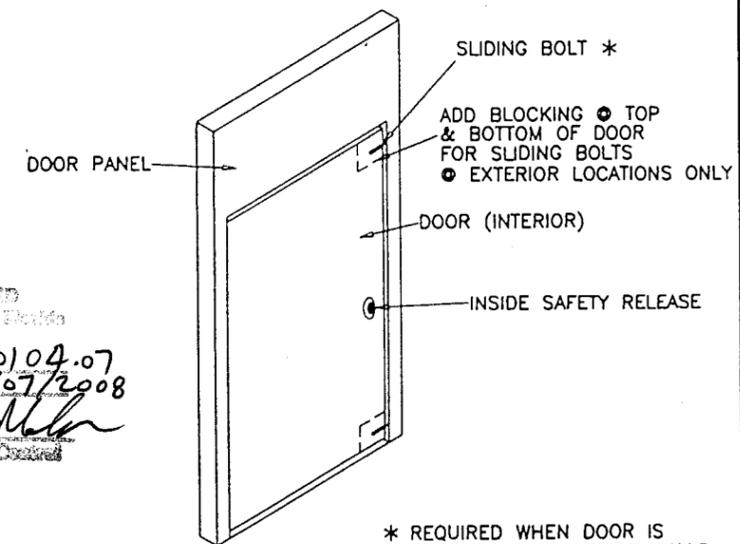

* REQUIRED WHEN DOOR IS INSTALLED IN EXTERIOR WALLS

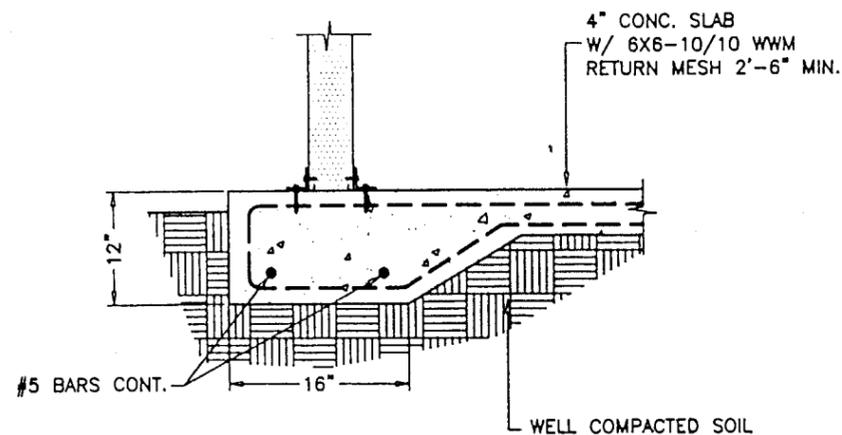

TYPICAL FOOTING

SCALE: 1/16\"/>

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 07-0104.07
 Expiration Date 01/07/2008
 By Helmy A. Mohr
 Miami Code Product Control
 Division

PRODUCT RENEWED

ACCEPTANCE No. 01-1115.02

EXPIRATION DATE January 7, 2007

By *[Signature]*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

Engr. DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 18557

DEC 15 1998

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE January 07, 1999
 BY *[Signature]*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 98-0518.03

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978

KYCOR PANEL SYSTEMS
 WALK-IN COOLERS AND FREEZERS
 4201 JANADA STREET
 FORT WORTH, TEXAS 76117
 TEL (800) 633-3426 FAX (817) 281-5521

no	date	by description

revisions:
 date: 04-27-98
 scale: 1/4\"/>

drawing no.
98-18


sheet 2 of 6

COOLER/98-18KPS


afc

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COOLER/98-18KPS


WALK-IN COOLERS AND FREEZERS
KYSOR PANEL SYSTEMS
 4201 JANADA STREET
 FORT WORTH, TEXAS 76117
 TEL (800) 633-3426 FAX (817) 281-5521

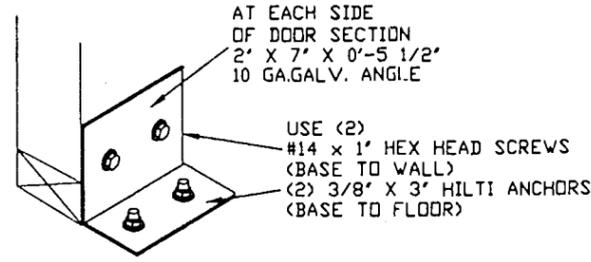


② DETAIL-DOOR STABILIZER

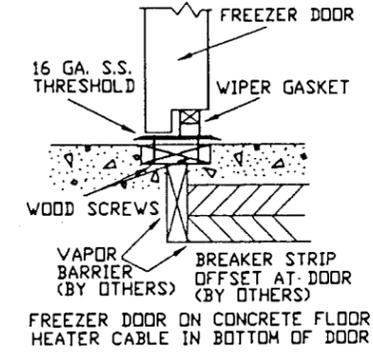


③ DETAIL-THRESHOLD AT FREEZER

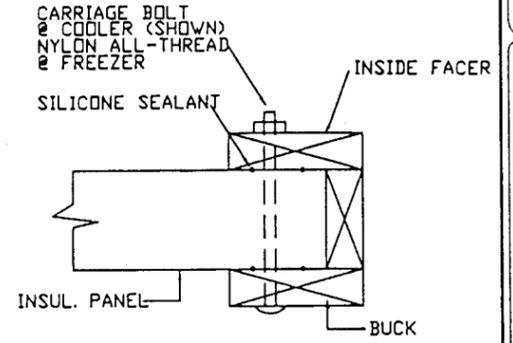

⑧ DETAIL-DOOR BUCK

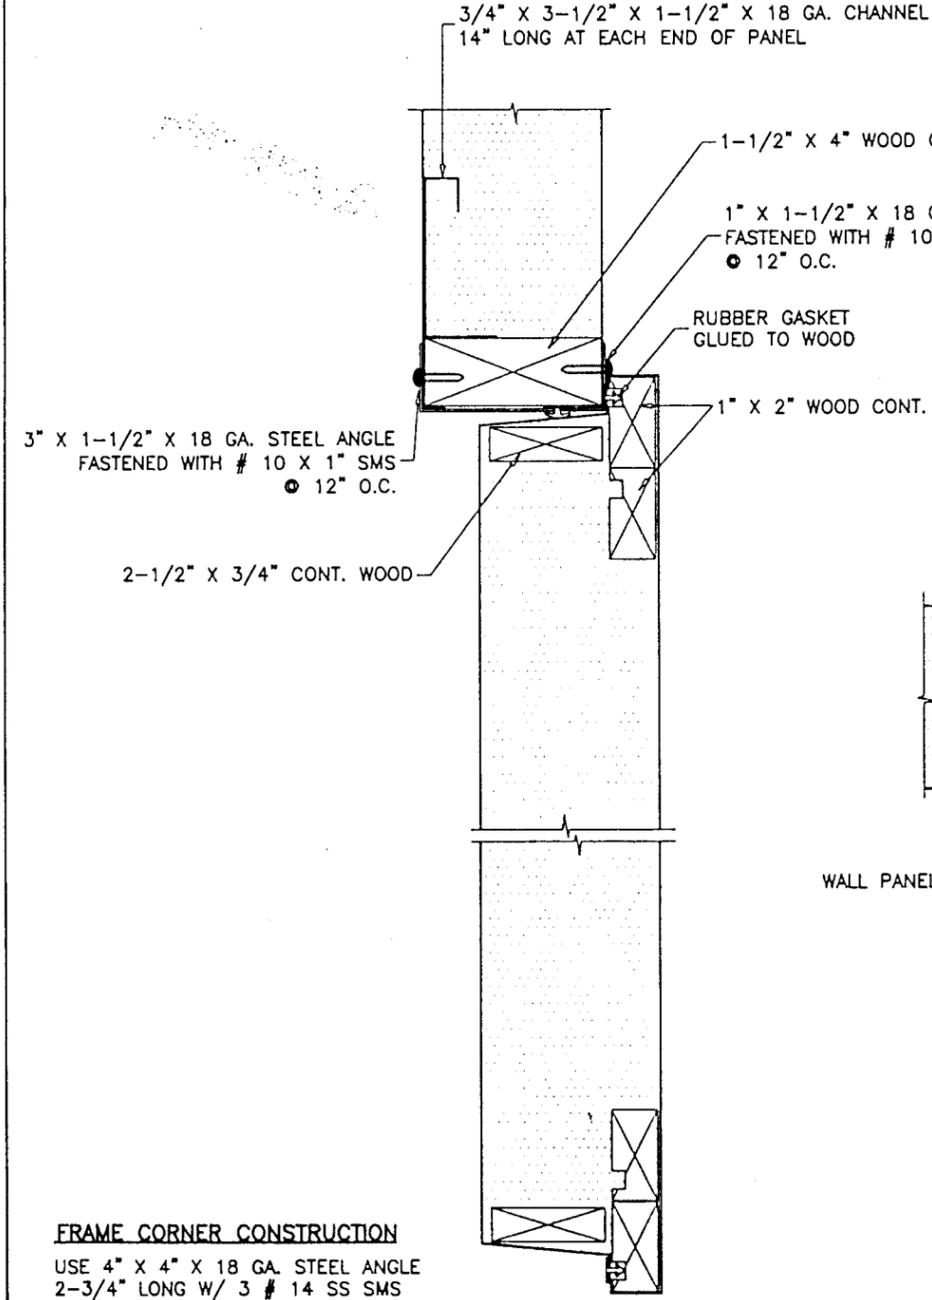

SECTION B-B

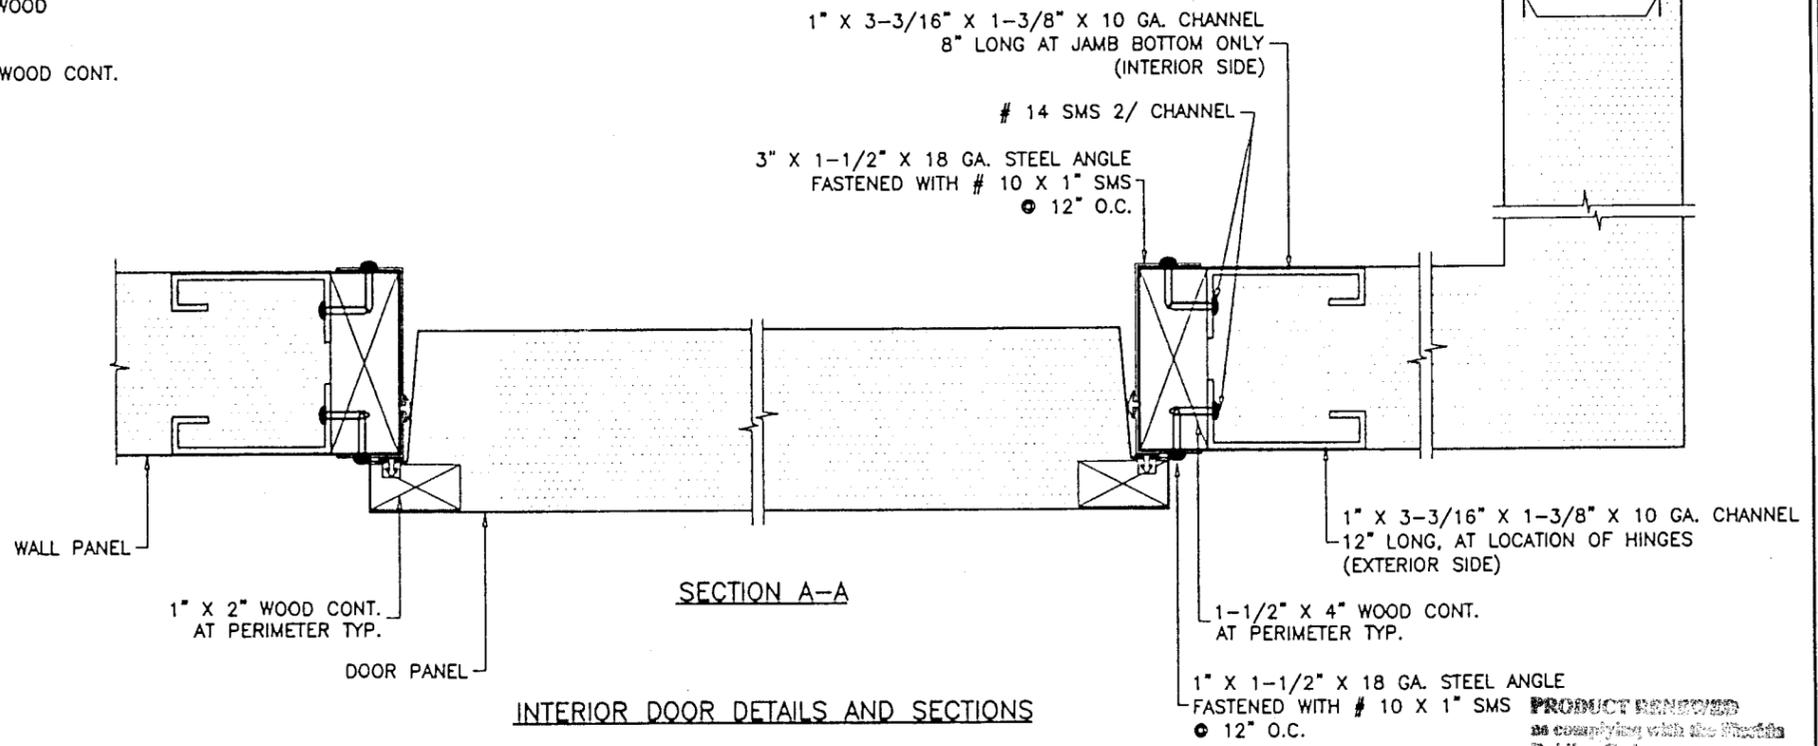

SECTION A-A
 INTERIOR DOOR DETAILS AND SECTIONS

FRAME CORNER CONSTRUCTION
 USE 4" X 4" X 18 GA. STEEL ANGLE
 2-3/4" LONG W/ 3 # 14 SS SMS

HARDWARE SUPPORT NOT SHOWN FOR CLARITY

- A. FIVE 2X6 WOOD STUDS 8" LONG, LOCATED AT FOUR CORNERS ONE AT 36" FROM BOTTOM SASH.
- B. 12" X 12" X 1" PLYWOOD LOCATED AT PANIC DEVICE LOCATION AT 33" FROM FLOOR GLUED TO INTERIOR SKIN.
- C. TWO RIVETS PER INTERIOR SKIN CORNER.

PRODUCT RENEWED

ACCEPTANCE No. 01-1115.07
 EXPIRATION DATE January 7, 2007
 By: [Signature]
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

Engr. DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557

DEC 15 1998


PRODUCT RENEWED
 as complying with the Florida Building Code
 Acceptance No. 07-0104.07
 Expiration Date: 01/07/2008
 By: Helmy A. Mahr
 Miami Code Product Control Division

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE January 07, 1999
 BY: Helmy A. Mahr
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 98-0518.03

no	date	description


date: 04-27-98
 scale: 1/4" = 1"
 dr. by: HAMD
 chk. by:

drawing no. 98-18
 sheet 3 of 6

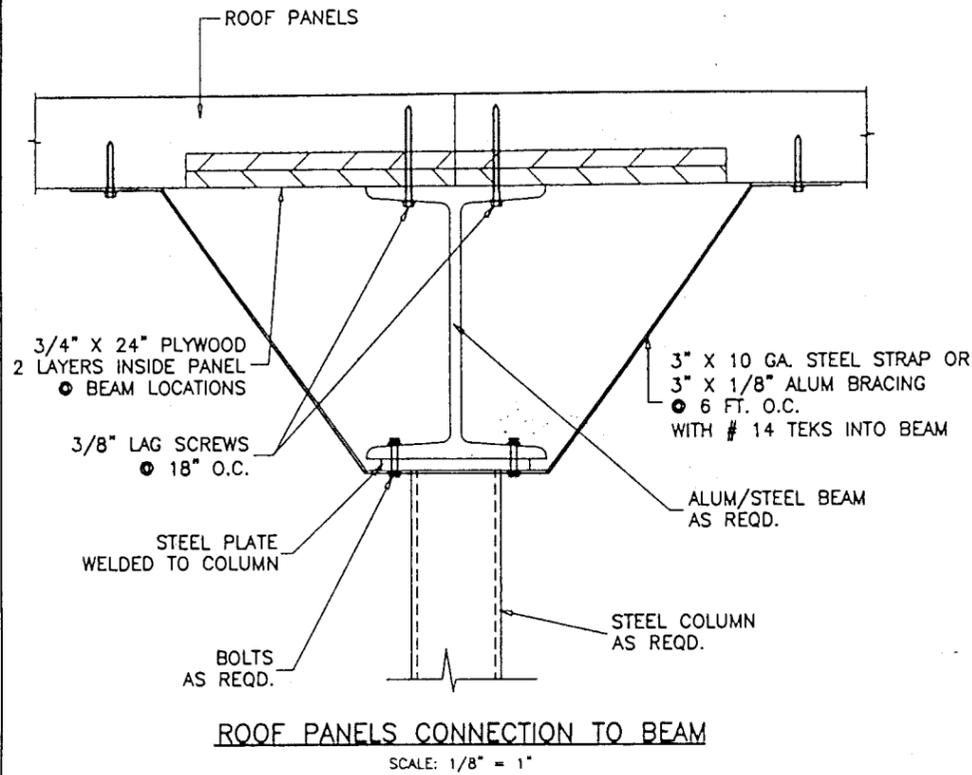

ROOF PANELS CONNECTION TO BEAM


SCALE: 1/8" = 1"

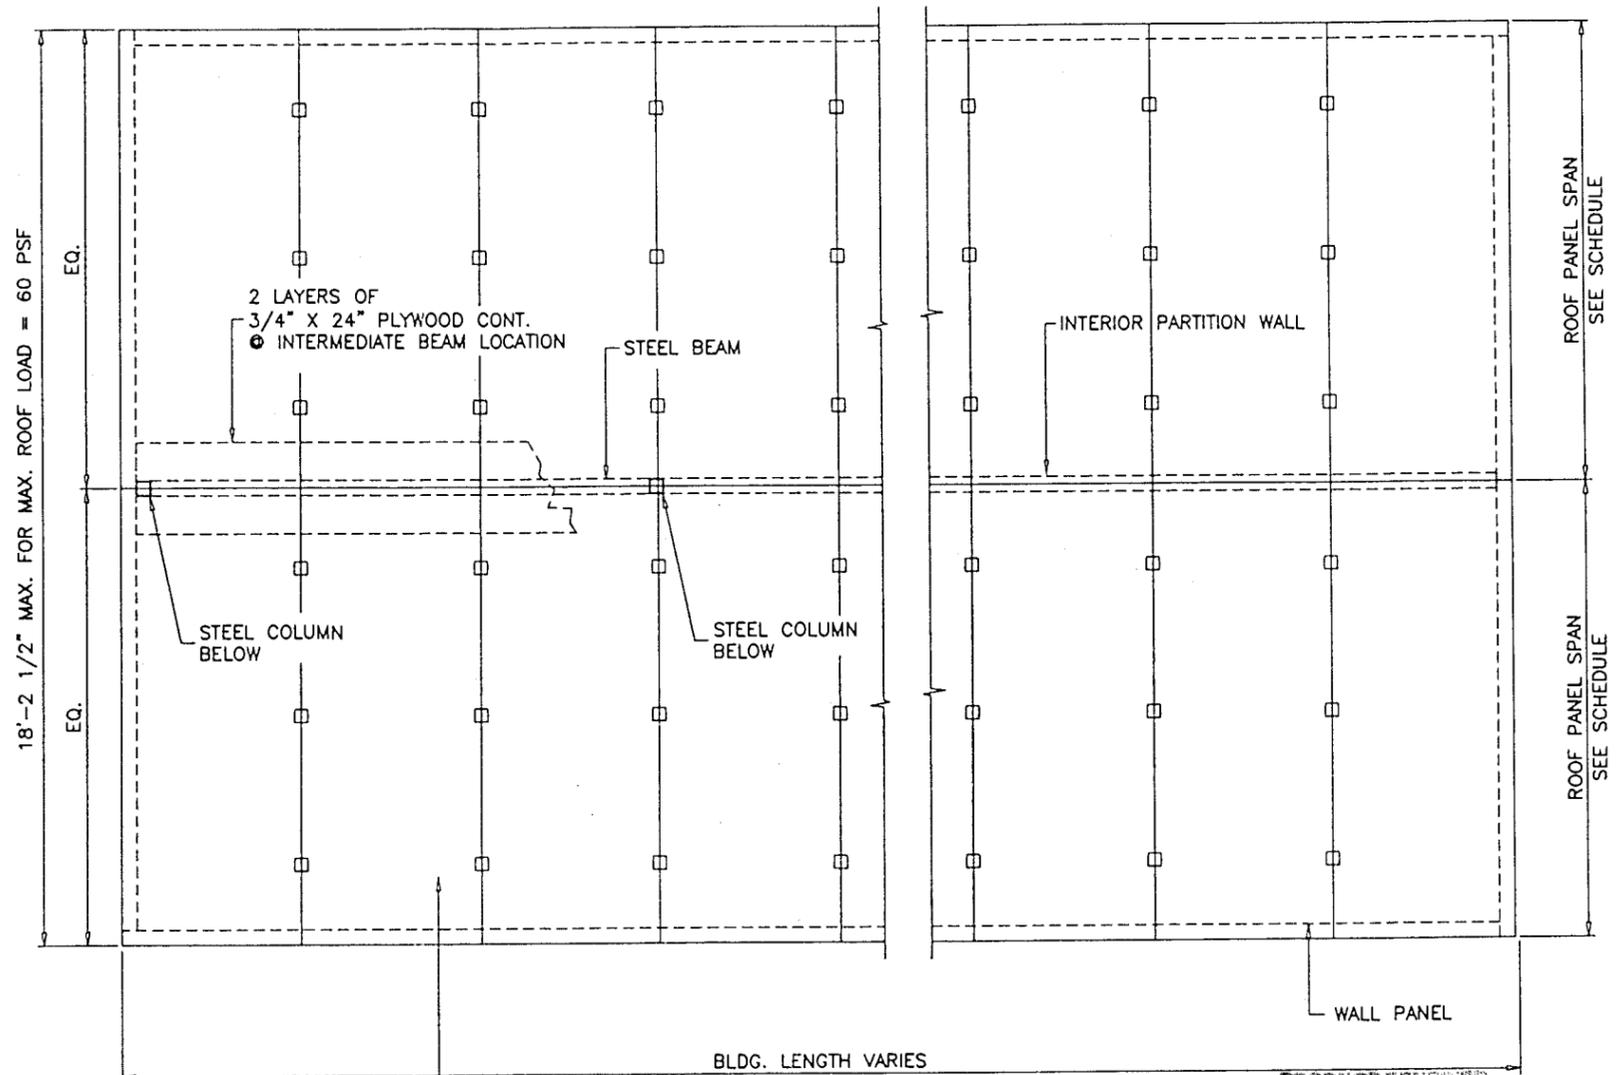

ROOF PLAN WITH STEEL BEAM & COLUMN


SCALE: 1/4" = 1'-0"

PANELS CAN BE ORIENTED IN ANY DIRECTION

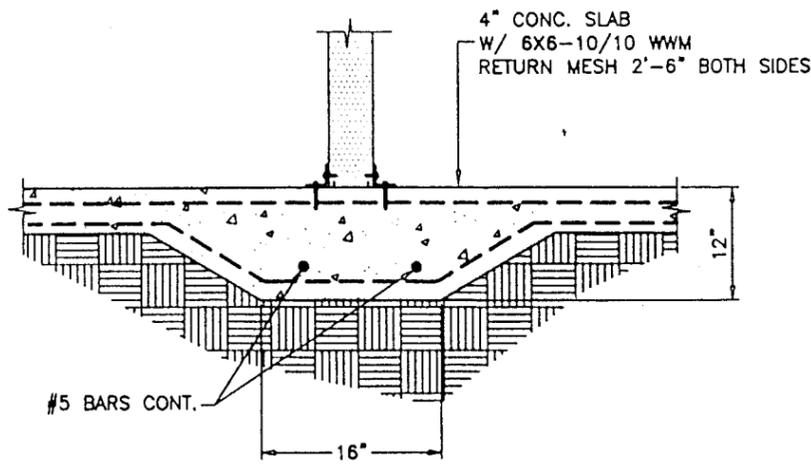

TYPICAL FOOTING AT PARTITION WALL

SCALE: 1/16" = 1"

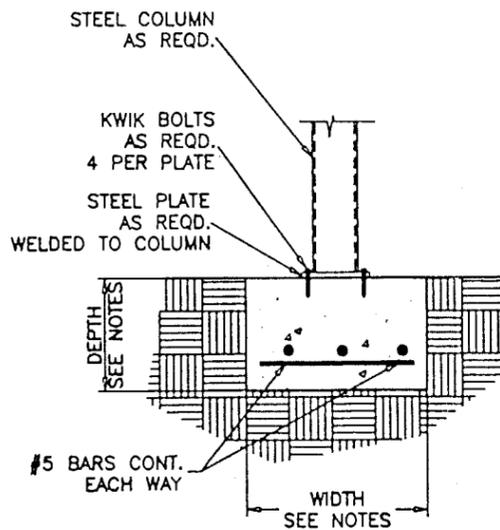

TYPICAL FOOTING AT COLUMN

SCALE: 1/16" = 1"

NOTE:

- A. EACH EXTERIOR INSTALLATION SHALL HAVE A FOUNDATION DESIGN BY A FLORIDA REGISTERED ENGINEER.
- B. FOR ROOF PLAN WITH STEEL BEAMS AND COLUMNS; THE BEAMS, COLUMNS AND FOOTING SIZE AND REINFORCEMENT ARE NOT PART OF THIS APPROVAL AND SHALL BE REVIEWED BY THE CORRESPONDING BUILDING DEPARTMENT FOR EACH JOB.
- C. ALL CONCRETE ANCHORS SHALL BE MINIMUM AS SPECIFIED ON THESE DRAWINGS. THE EMBEDMENT LENGTHS NOTED SHALL NOT INCLUDE FINISH MATERIAL.

PRODUCT RENEWED

ACCEPTANCE No. 01-1115.02

EXPIRATION DATE January 7, 2007

By: *[Signature]*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557

DEC 15 1998

APPROVED AS COMPLYING WITH THE

SOUTH FLORIDA BUILDING CODE

DATE January 07, 1999

BY: *[Signature]*

PRODUCT CONTROL DIVISION

BUILDING CODE COMPLIANCE OFFICE

ACCEPTANCE NO. 98-0518-03

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 07-0104.07
Expiration Date 01/07/2008
By: *[Signature]*
Miami Dept. of Technical Control
Division

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COOLER\98-18KPS

WALK-IN COOLERS AND FREEZERS
KYSOR PANEL SYSTEMS
4201 JANADA STREET
FORT WORTH, TEXAS 76117
TEL. (800) 633-3426 FAX. (817) 281-5521

revisions:	no	date	by	description

date: 04-27-98	scale: 1/4" = 1'	dr. by: HAMID	chk. by:
drawing no. 98-18			
sheet 4 of 6			


afc

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978


KYSOR PANEL SYSTEMS
 WALK-IN COOLERS AND FREEZERS
 4201 JANADA STREET
 FORT WORTH, TEXAS 76117
 TEL (800) 633-3426 FAX (817) 281-5521

no	date	by	description


date	04-27-98
scale	NONE
dr. by	HAMID
chk. by	
drawing no.	98-18
sheet	5 of 6

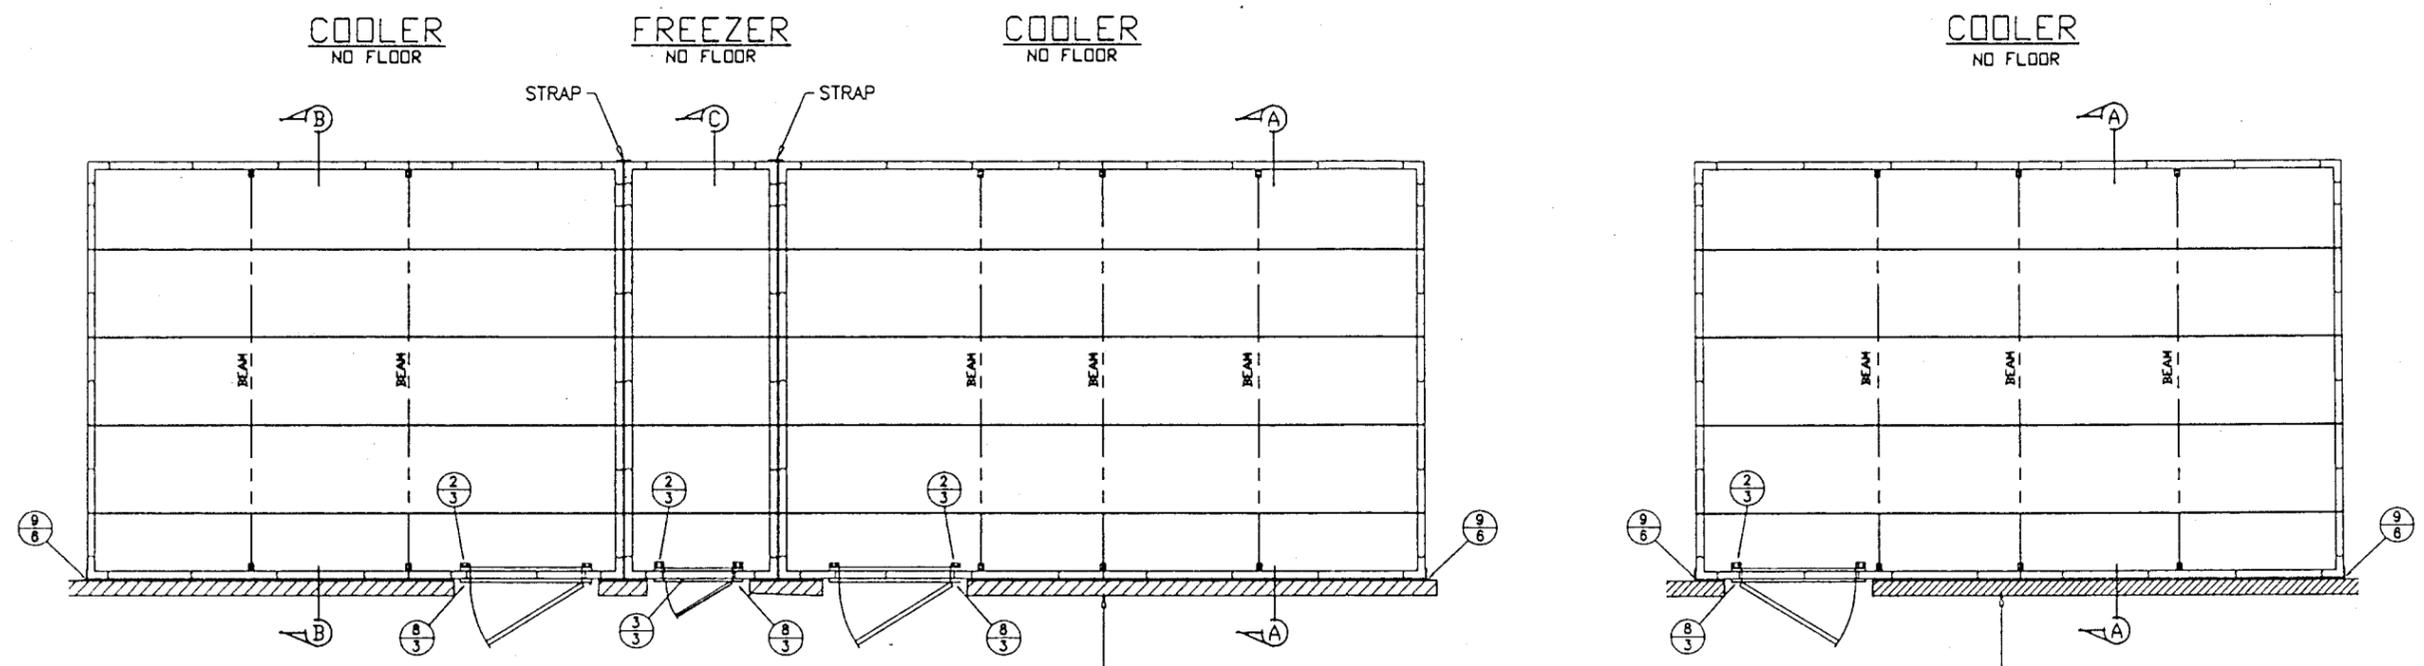


1/4" ZAMAC NAIL-IN
 1-1/2" EMBED
 OR 1/4" TAPCONS
 WITH 1-3/4" EMBED
 AT 12" O.C.

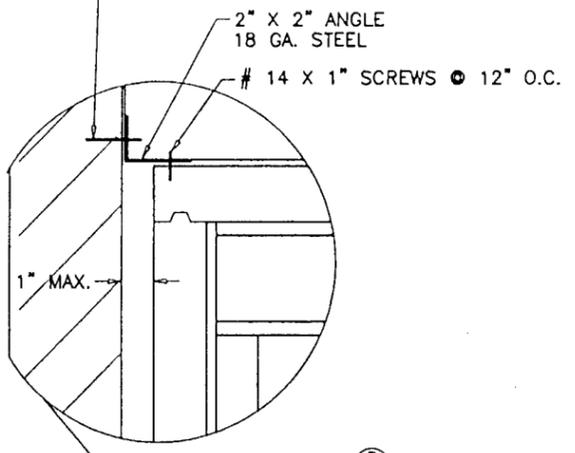


EXISTING STRUCTURE WALL
 BLOCK OR CONC.

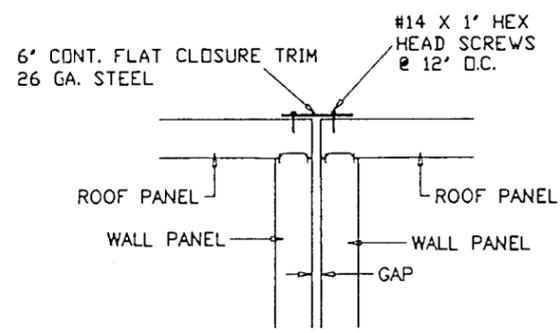


SIDE BY SIDE UNITS
 ELEVATION

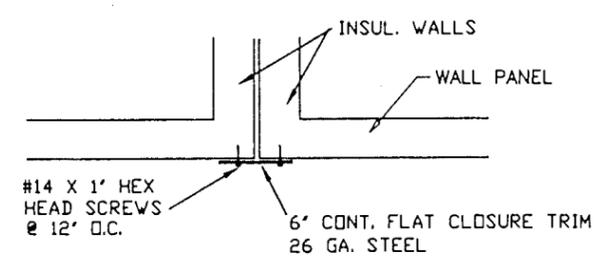


SIDE BY SIDE UNITS
 PLAN VIEW

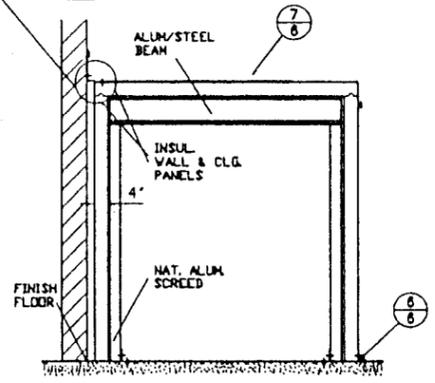

(A) SECTION NO SCALE

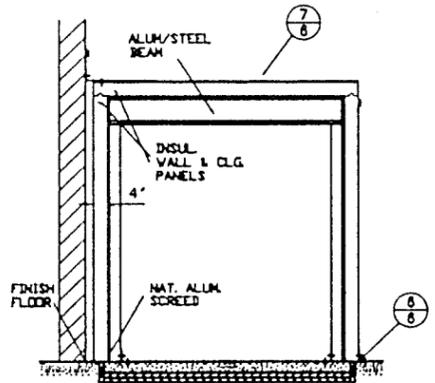

(B) SECTION NO SCALE

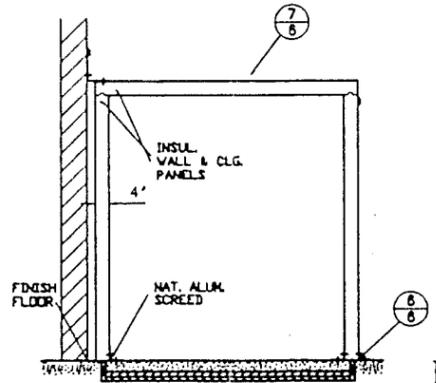

(C) SECTION NO SCALE

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 07-0104.07
 Expiration Date 01/07/2008
 By *Helmy A. Maher*
 Miami Desk Product Control
 Division

PRODUCT RENEWED


ACCEPTANCE No. 01-1115.07
 EXPIRATION DATE January 7, 2007
 By *Helmy A. Maher*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 18557


APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE January 27, 1999
 BY *Helmy A. Maher*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 98-0518.03

DEC 15 1998

ANCHORS EDGE DISTANCE = 2-1/2' MIN. TYP.

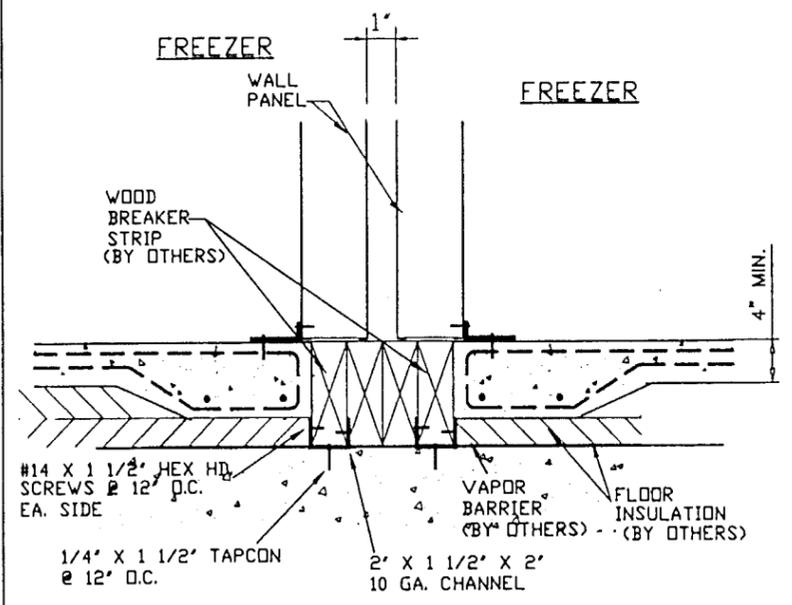


⑤ DETAIL-SECTION BETWEEN FREEZERS
 EXTERIOR UNITS

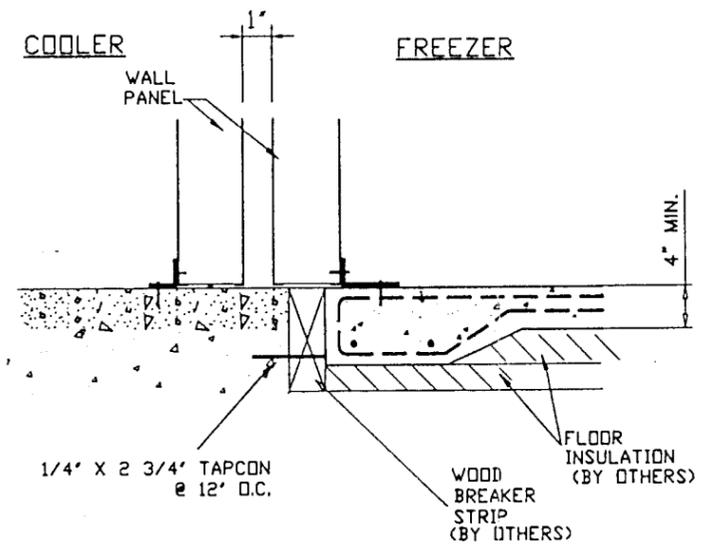


⑥ DETAIL-SECTION BETWEEN COOLER/FREEZER
 EXTERIOR UNITS

FREEZER INSULATION / WOOD SEPARATION AND THEIR CONNECTION TO SLAB SHOWN AS CONSTRUCTION DETAIL ARE NOT PART OF APPROVAL.

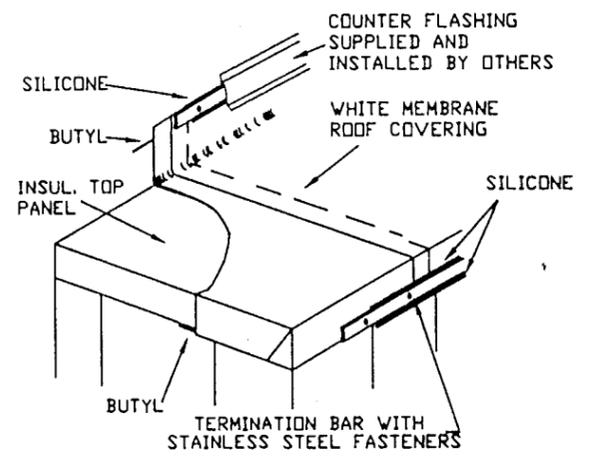

⑦ DETAIL-MEMBRANE ROOF
 DURO-LAST
 WATER PROOFING NOT PART OF APPROVAL

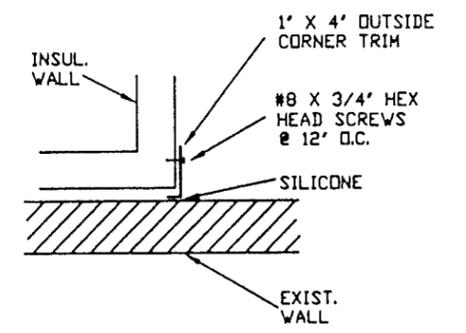

⑨ WATER PROOFING CORNER DETAIL
 PLAN VIEW

PRODUCT RENEWED
 ACCEPTANCE No. 01-1115.02
 EXPIRATION DATE January 7, 2007
 By *[Signature]*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

Engr. DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 DEC 15 1998

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE January 07, 1999
 BY *[Signature]*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 98-0518.03

WALK-IN COOLERS AND FREEZERS
KYSOR PANEL SYSTEMS
 4201 JANADA STREET
 FORT WORTH, TEXAS 76117
 TEL (800) 633-3426 FAX. (817) 281-5521

no	date	by description

date: 04-27-98
 scale: NONE
 dr. by: HAMID
 chk. by:
 Drawing no. 98-18
 sheet 6 of 6

PRODUCT RENEWED
 as compliance with the Florida
 Building Code
 Acceptance No. 07-0104.07
 Expiration Date 01/07/2008
 By *[Signature]*
 Division