



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908  
www.buildingcodeonline.com

**NOTICE OF ACCEPTANCE (NOA)**

American Skylight, Inc.  
525 113<sup>th</sup> Street  
Arlington, TX 76011

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series Curb Mount Skylight with Polycarbonate Domes**

**APPROVAL DOCUMENT:** Drawing No. **Dade-06**, titled "Series Dade County Approved Curb Mount", dated April 16, 2007, sheets 1 of 1, prepared by manufacturer, signed and sealed by Richard Boyette, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 06-0215.05**, consists of this page 1, Evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P. E.**



4/24/17

**NOA No. 07-0104.08**  
**Expiration Date: May 21, 2012**  
**Approval Date: May 17, 2007**  
Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No. **Dade-06**, titled "Series Dade County Approved Curb Mount", dated April 16, 2007, sheets 1 of 1, prepared by manufacturer, signed and sealed by Richard Boyette, P.E.

**B. TESTS** Test report on 1) Air Infiltration Test per FBC, TAS 202-94

- 2) Uniform Static Air Pressure Test Loading per FBC, TAS 202-94
- 3) Water Resistance Test per FBC, TAS 202-94.
- 4) Large Missile Impact Test per FBC, TAS 201-94
- 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with manufacturer's parts and marked-up drawings of Curb mount polycarbonate double Dom Skylight, dated 11/01/06, prepared by Architectural Testing Inc., Test Report No. **65541.01-801-18**, signed and sealed by Joseph A. Reed, P.E.

2. Additional test report on (transferred from file # **06-0215.05**) Original test conducted per FBC, PA 201, 202 & 203-94 now known as FBC, TAS 201, 202 & 203-94.

- 1) Air Infiltration Test per SFBC, PA 202-94
- 2) Uniform Static Air Pressure Test Loading per SFBC, PA 202-94
- 3) Water Resistance Test per SFBC, PA 202-94.
- 4) Large Missile Impact Test per SFBC, PA 201-94
- 5) Cyclic Wind Pressure Loading per SFBC, PA 203-94

Along with manufacturer's parts and section drawing marked-up drawings of Pressure Test on "DTCM Polycarbonate Glazed, Curb Mount Skylight", prepared by Architectural Testing, Inc., Report No. 01-30519.01, dated 12/22/97, signed and sealed by A. N. Reeves, PE.

**C. CALCULATIONS**

1. Anchor verification complying w/ FBC 2004, dated 04-16, 2007, prepared, signed and sealed by Richard Boyette, P.E.

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**


1. Notice of Acceptance No. 07-0313.04 issued to Sheffied Plastic Inc. for "Hyzod Polycarbonate Sheet GP, Sl, & AR", expiring on 08/27/08.

**F. STATEMENTS**


1. Statement letter of conformance and no financial interest, dated 04-15-07, signed by Richard Boyette, P.E.
2. Letter of lab compliance, part of the above test reports.

**G. OTHER**

1. This NOA **renews** NOA# **06-0215.05**, expiring 04-21-07.
2. Re-verification test.

  
Ishaq I. Chanda, P.E.  
Product Control Examiner  
NOA No. 07-0104.08  
Expiration Date: May 21, 2012  
Approval Date: May 17, 2007

- 1) All Aluminum Corners To Be Mitered & Welded.
- 2) Curb Shall Have A Minimum Clear Distance Of 4" Between Lower End Of Lip Angle And Roof Substrate; For Single And Non Insulated Bur with Gravel Finish. For Tile Roof Add The Tile Height To The 4" Minimum Distance.

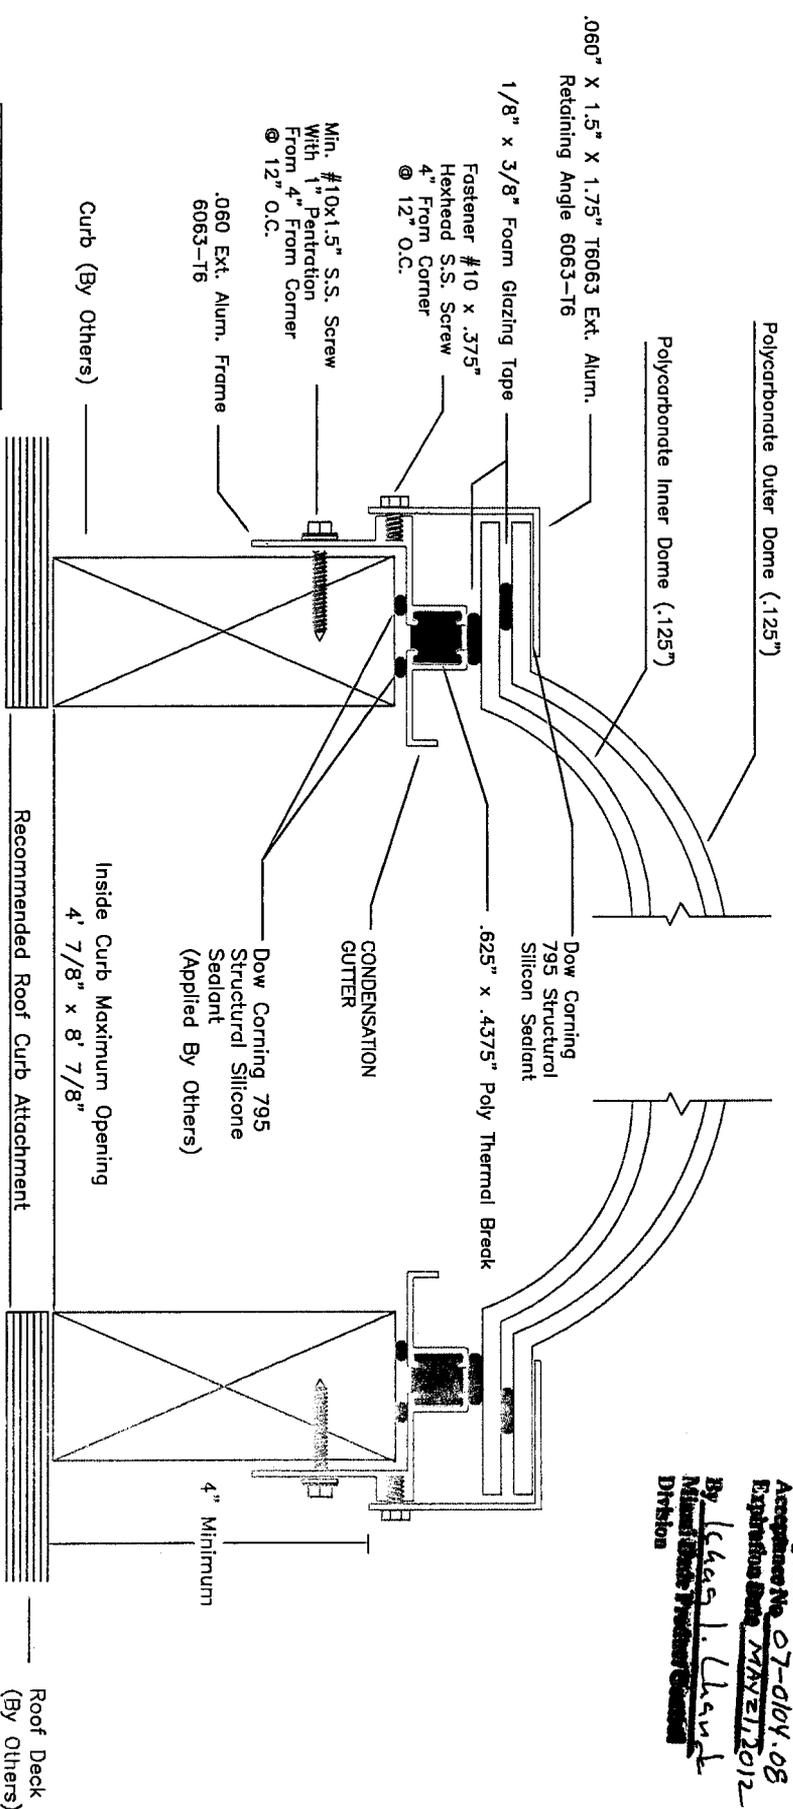

Curb, Roof Deck And Roof Framing Are By Others. Detail Shows Suggested Construction Only

**PRODUCT RENEWED**  
 as complying with the Florida Building Code  
 Acceptance No. 07-0104.08  
 Expiration Date MAY 21, 2012  
 By John J. Hunt  
 Miami-Dade Planning Division



**AMERICAN SKYLITES**  
 425 113th STREET, ARLINGTON TEXAS 76011  
 Phone 800.772.7401 Fax 800.445.7282

**DADE COUNTY APPROVED CURB MOUNT**

**RICHARD BOYETTE**  
 FL PE # 42485  
 4031 COCONUT BLVD  
 ROYAL PALM BEACH FL 33411  
 561-790-5766

*Richard Boyette*

APR 16 2007

DADE THERMALLY BROKEN CURB MOUNT  
 DESIGN PRESSURE = 60 psf +-  
 SKYLIGHT ID = 51.75" X 99.75"