



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

Dryvit Systems, Inc.
One Energy Way
West Warwick, RI 02893

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone.

DESCRIPTION: Exterior Insulation & Finish System.

APPROVAL DOCUMENT: Drawing titled "DCSS Dryvit Outsulation System-Small Scale Missile-Sheathing Substrate", sheets 1 through 3 of 3, prepared by Dryvit Systems Inc, dated 05/21/07, signed and sealed by R. E. Kroll P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Small Missile Impact

LABELING: Each component shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved or MDCPCA", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews and revises** NOA # **06-0608.05** and consists of this page 1, evidence page E-1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



Signature
8/23/07

NOA No 07-0108.01
Expiration Date: September 17, 2011
Approval Date: August 23, 2007
Page 1

Dryvit Systems, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE PAGE

A DRAWINGS

- 1 Drawing titled "DCSS Dryvit Outsulation System-Small Scale Missile-Sheathing Substrate", sheets 1 through 3 of 3, prepared by Dryvit Systems Inc, dated 05/21/07, signed and sealed by R. E. Kroll P.E.

B TESTS

- 1 Test report on Small Missile Impact Test, Cyclic Load Test and Static Air Pressure Test on Exterior Insulation & Finish System, prepared by ETC Laboratories, Report # ETC-06-1059-17955.0, dated 11/14/06, signed and sealed by Joseph L. Doldan, P.E.
- 2 Tensile Test per ASTM C297 by ETC Laboratories on Primus Product, Report No. ETC-06-1059-18353.1, dated 12/01/06 and on Genesis Products, Report No. ETC-06-1059-18355.1 and ETC-06-1059-18357.1, dated 12/01/06 and 12/05/06 respectively, all signed and sealed by Joseph L. Doldan, P.E.

C QUALITY ASSURANCE

1. Building Code Compliance Office.

D MATERIAL CERTIFICATION

- 1 None

E STATEMENTS


- 1 Statement of compliance issued by ETC Laboratories, dated 11/14/06, signed and sealed by Joseph L. Doldan, P.E.
- 2 No financial interest letter issued by R. J. Kenney Associates, Inc., dated 03/06/07, signed and sealed by R. E. Kroll, P.E.
- 3 No change letter issued by Dryvit Systems, Inc., dated 03/08/07, signed by William M. Preston, Senior Engineer/Code Specialist.



8/23/07

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No 07-0108.01

Expiration Date: September 17, 2011
Approval Date: August 23, 2007

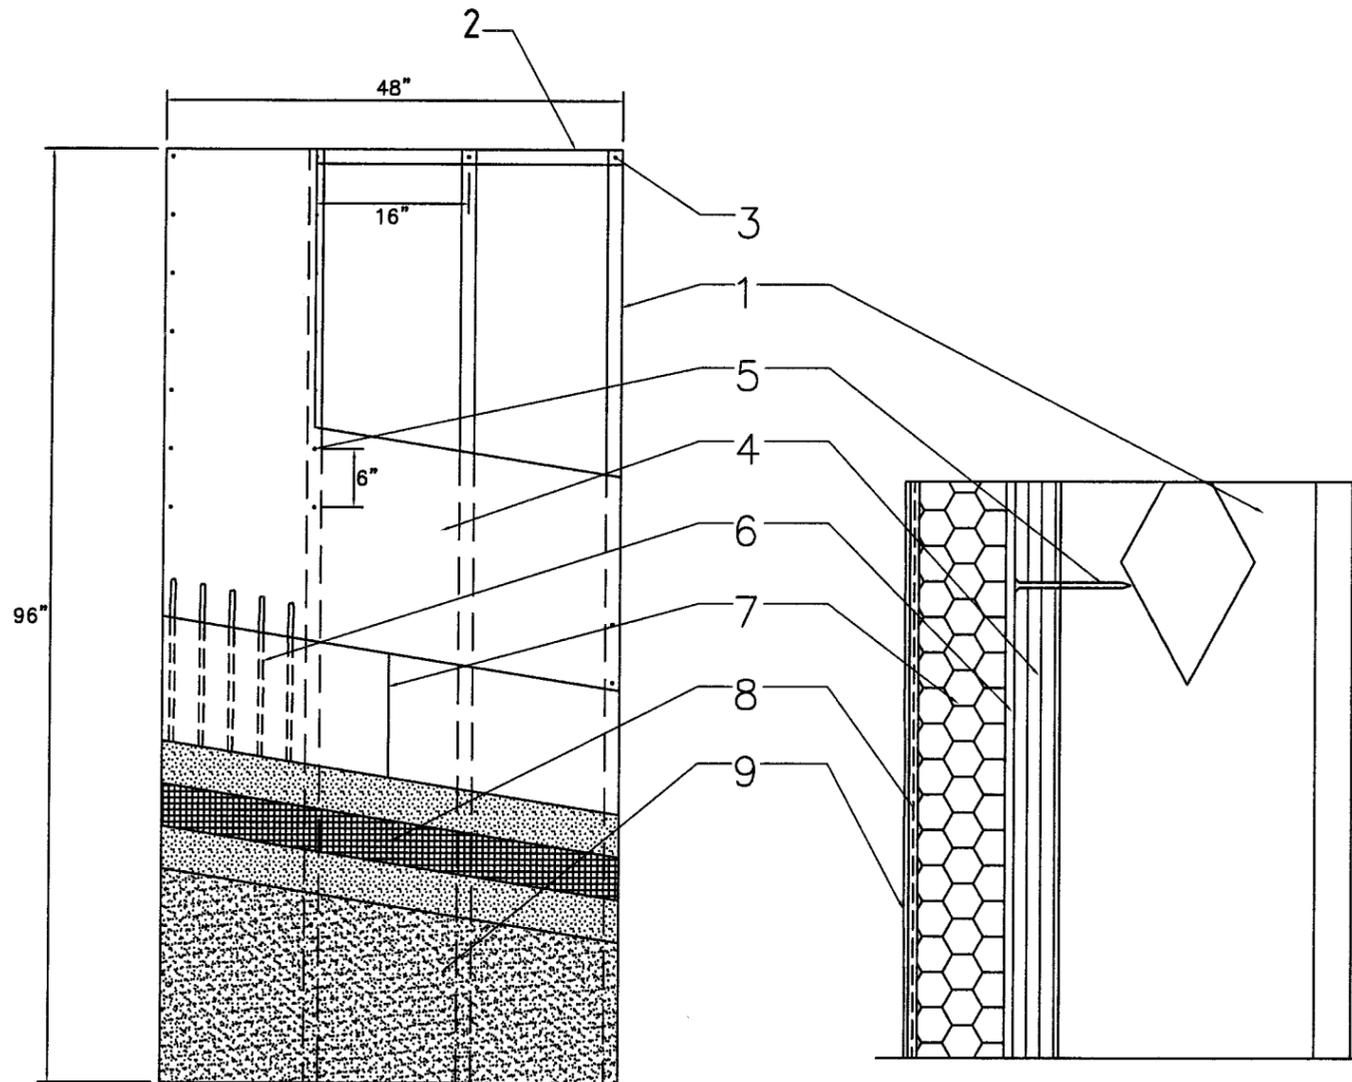

MATERIAL LIST

- ① 3 5/8" X 1 5/8" X 18 GAUGE STEEL STUDS AT 16" O.C.
- ② 3 5/8" X 18 GA. STEEL TRACK
- ③ MINIMUM 1/2 TEK SCREWS TO SECURE STEEL TRACK TO STEEL STUDS ON INTERIOR AND EXTERIOR
- ④ 1/2" EXTERIOR GRADE GYPSUM SHEATHING MEETING ASTM C 1396 (FORMALLY ASTM C 79) OR 1/2" DENS-GLASS GOLD MEETING ASTM C 1177
- ⑤ MINIMUM NO. 8 X 1 5/8" WAFER HEAD SCREWS SPACED AT 6" O.C. ALONG VERTICAL STUDS
- ⑥ ADHERE THE EXPANDED POLYSTYRENE (EPS) INSULATION BOARD WITH DRYVIT'S PRIMUS, GENESIS OR GENESIS DM MIXTURE. THE ADHESIVE IS APPLIED WITH A 3/8" X 3/8" NOTCHED TROWEL WITH NOTCHES SPACED A MAXIMUM OF 1 1/2" O.C. THE ADHESIVE SHALL BE APPLIED TO THE BACK SIDE OF THE EPS IN A VERTICAL ORIENTATION
- ⑦ MINIMUM 1" THICK INSULATION BOARD MEETING DRYVIT SPECIFICATION DS131. INSULATION BOARD SUPPLIER SHALL POSSESS A CURRENT NOA WITH MIAMI DADE COUNTY
- ⑧ DRYVIT'S STANDARD REINFORCING MESH: 4.3 OZ/SQ. YD FIBERGLASS REINFORCING MESH EMBEDDED IN THE DRYVIT BASE COAT. THE STANDARD REINFORCING MESH SHALL BE LAPPED A MINIMUM OF 2 1/2" AT ALL EDGES.
- ⑨ DRYVIT FINISH: A 100 PERCENT ACRYLIC BASED MATERIAL AVAILABLE IN VARIOUS TEXTURES.

GENERAL NOTES


- 1. THE SYSTEM HAS BEEN DESIGNED IN ACCORDANCE WITH THE SOUTH FLORIDA BUILDING CODE 2004 EDITION AND ITS LATEST SUPPLEMENTS.
- 2. THIS SYSTEM HAS BEEN TESTED IN ACCORDANCE WITH MIAMI DADE COUNTY PROTOCOLS TAS 201, TAS 202 AND TAS 203; IMPACT, STRUCTURAL AND CYCLIC TESTING
- 3. THIS SYSTEM SHALL BE APPLIED BY A LICENSED PLASTERING CONTRACTOR FOLLOWING THIS NOTICE OF ACCEPTANCE THE RECOMMENDATION OF DRYVIT SYSTEMS, INC. AND THE APPLICABLE SECTIONS OF THE SOUTH FLORIDA BUILDING CODE.
- 4. THE ENGINEER AND/OR ARCHITECT OF RECORD FOR EACH PROJECT USING THIS SYSTEM SHALL SIZE ALL STUD FRAMING TO ENSURE CONFORMANCE WITH STUD DEFLECTION AND STRESS LIMITATIONS AS REQUIRED BY ALL GOVERNING CODES AND THIS DOCUMENT.
- 5. INSULATION BOARDS SHALL BE POSITIONED IN A RUNNING BOND PATTERN.
- 6. ALL STUDS USED WITH THIS SYSTEM SHALL BE COMPLETELY SHEATHED AT THE INTERIOR FLANGE OR BRACED AT A MAXIMUM OF EVERY 5' OF STUD LENGTH OR AS SPECIFIED BY THE STUD MANUFACTURER.
- 7. ALL STEEL STUDS SHALL BE STRUCTURAL WITH 1 5/8" MINIMUM FLANGE WIDTH AND HAVE A MINIMUM YIELD STRENGTH OF 33000 PSI.
- 8. DETAILS ON SHEETS 2 AND 3 OF 3 ARE TYPICAL AND SHOW INTENT TO PREVENT WATER INFILTRATION INTO AND BEHIND THIS SYSTEM. ALTERNATE DETAILS AND SPECIFIC CONDITIONS NOT COVERED BY THE TYPICAL DETAILS ARE THE RESPONSIBILITY OF THE LICENSED DESIGN PROFESSIONALS

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 07-0108.01
 Expiration Date 09/17/2011
 By [Signature]
 Miami Dade Product Control
 Division


Florida P.E. [Signature]
 R.E.Kroll
 P.E. Registration No. 38477 7/18/07

DESIGN PRESSURE
± 75 PSF


DRYVIT SYSTEMS, INC.	
One Energy Way West Warwick, Rhode Island	
DWG. NO.: DCSS Dryvit Outsulation System- Small Scale Missile- Sheathing Substrate	
SHEET NO: 1 OF 3	ISSUE DATE: 05/21/07 REV./DATE:

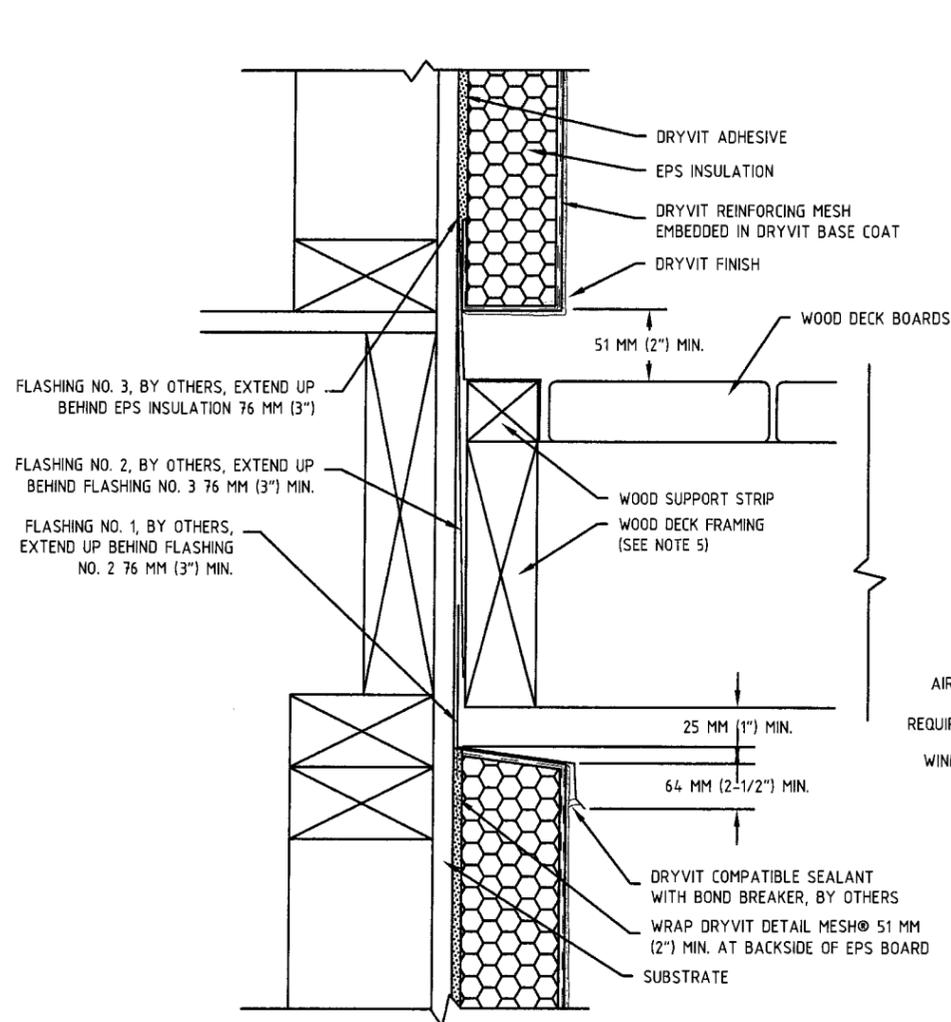


DECK TERMINATION

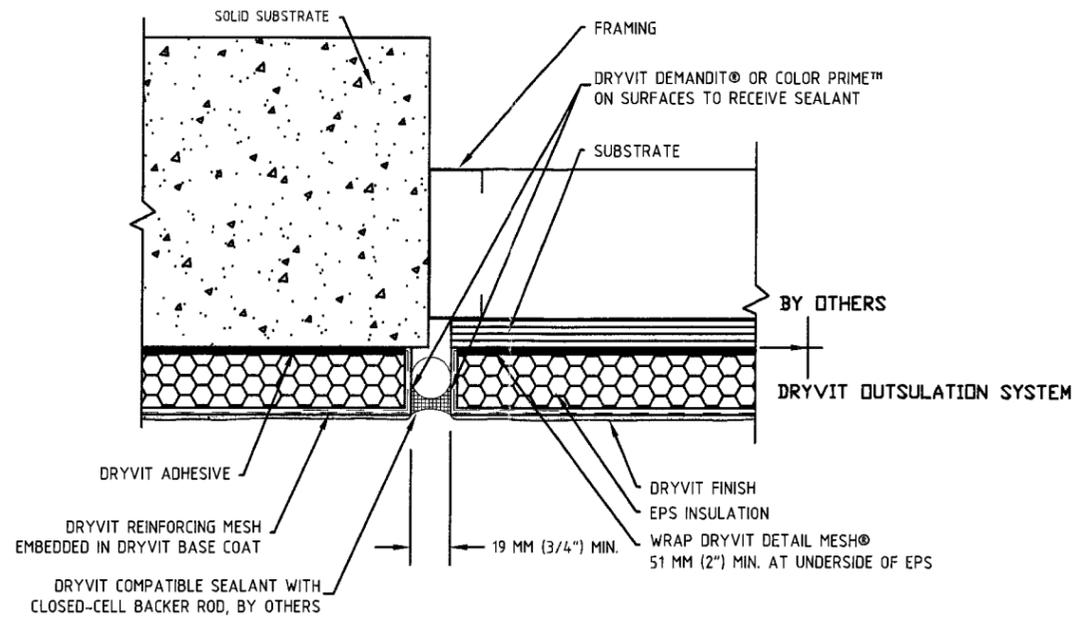

EXPANSION JOINT

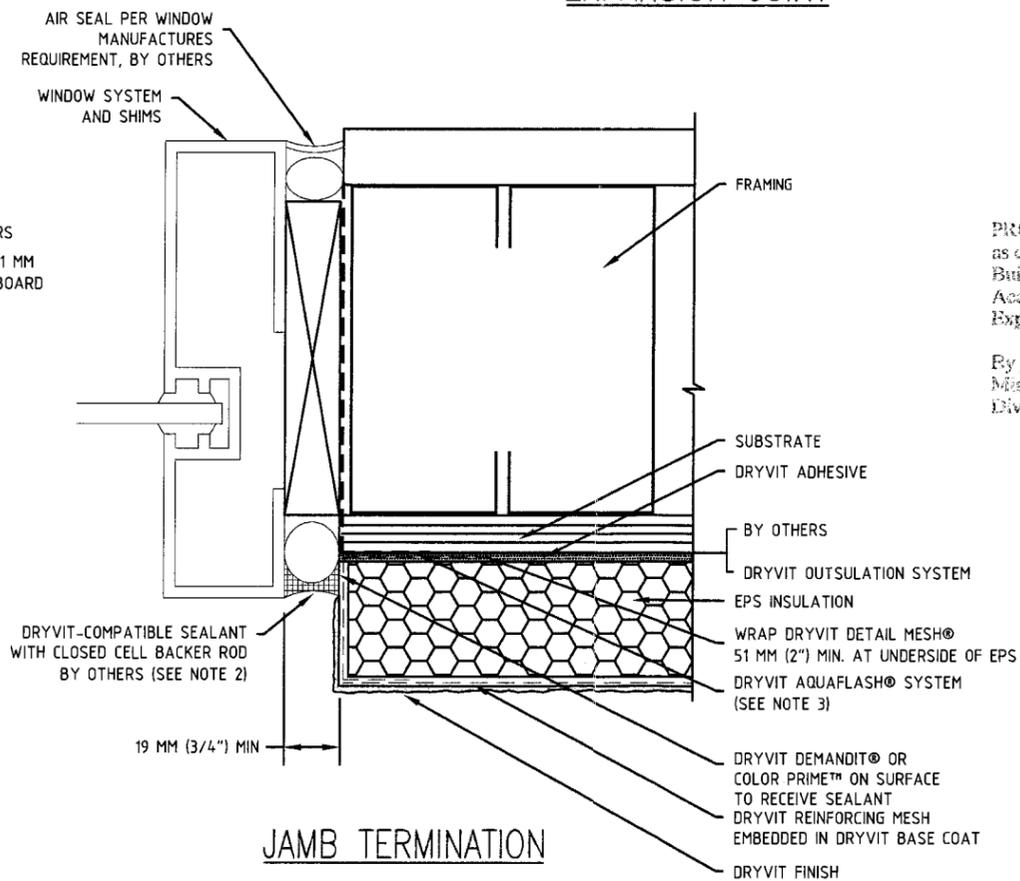

JAMB TERMINATION

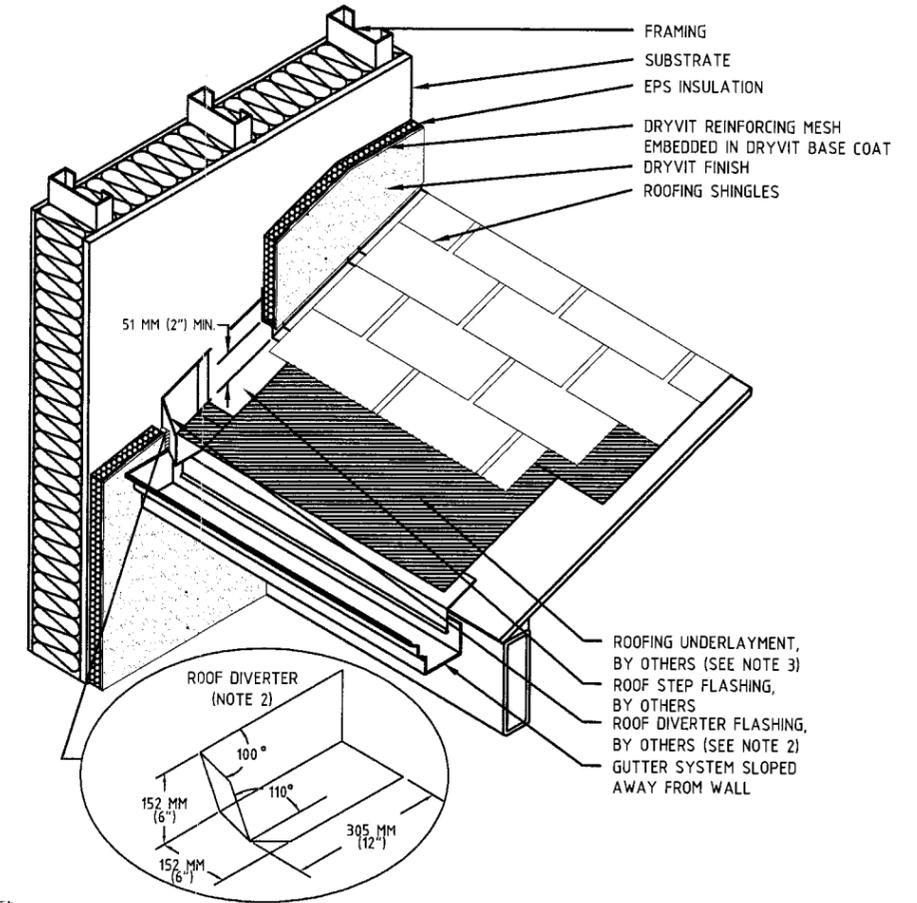

TERMINATION AT SLOPED ROOF



PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 07-0108-01
 Expiration Date 09/17/2011
 By *[Signature]*
 Miami Code Product Council
 Division

- Notes:**
1. Gap wood sheathing edge and end joints in accordance with APA (American Plywood Association) recommendations.
 2. Seal Penetrations through flashing where attached to framing
 3. Distance of EIFS to deck varies with climate. Allow sufficient distance to prevent snow/ice and ponding water against system.
 4. Provide end dams where flashings terminate at ends of deck.
 5. Pressure treated wood (space from flashing or rout backside to provide drainage)


Florida P.E. *R. E. Kroll*
 R.E.Kroll
 P.E. Registration No. 38477 7/18/07

DESIGN PRESSURE
± 75 PSF


DRYVIT SYSTEMS, INC.  One Energy Way West Warwick, Rhode Island		
DWG. NO.: DCSS Dryvit Outsulation System— Small Scale Missile— Sheathing Substrate		
SHEET NO: 2 OF 3	ISSUE DATE: 05/21/07	REV./ DATE:

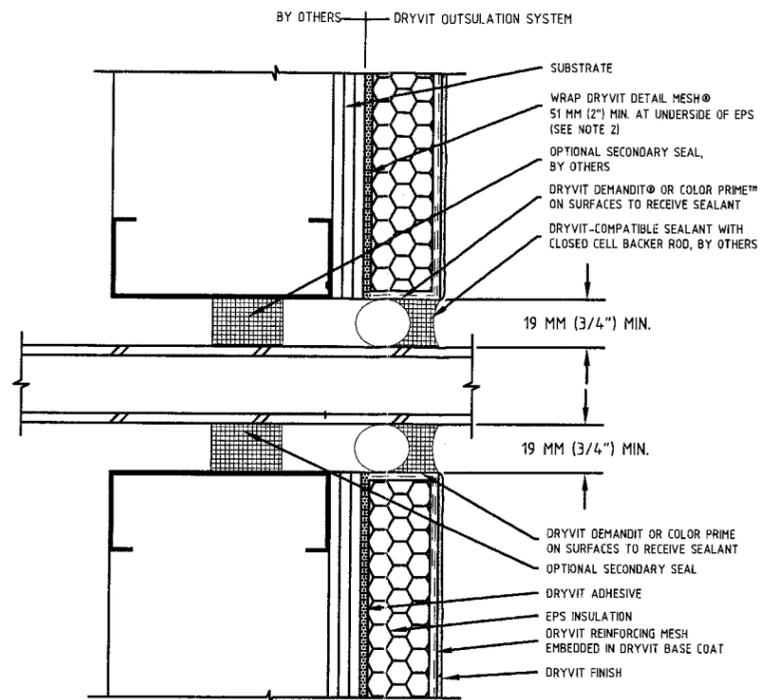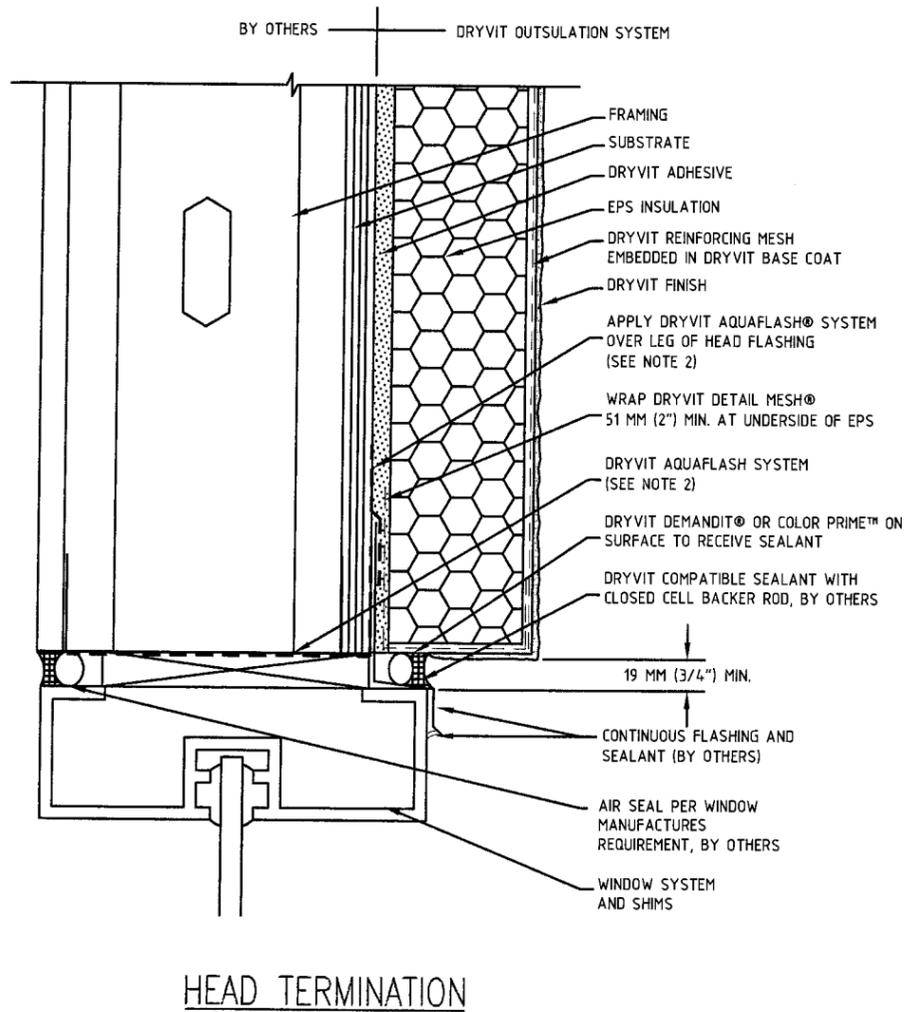

PENETRATIONS

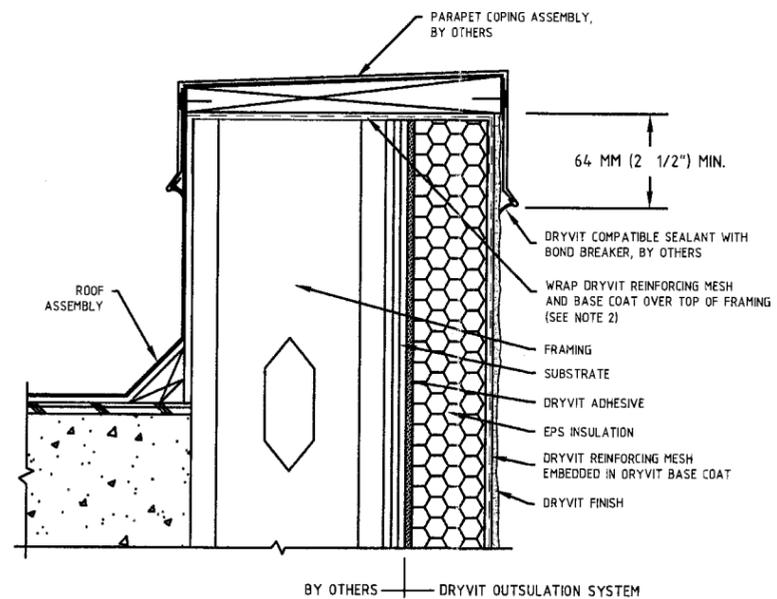

PARAPET

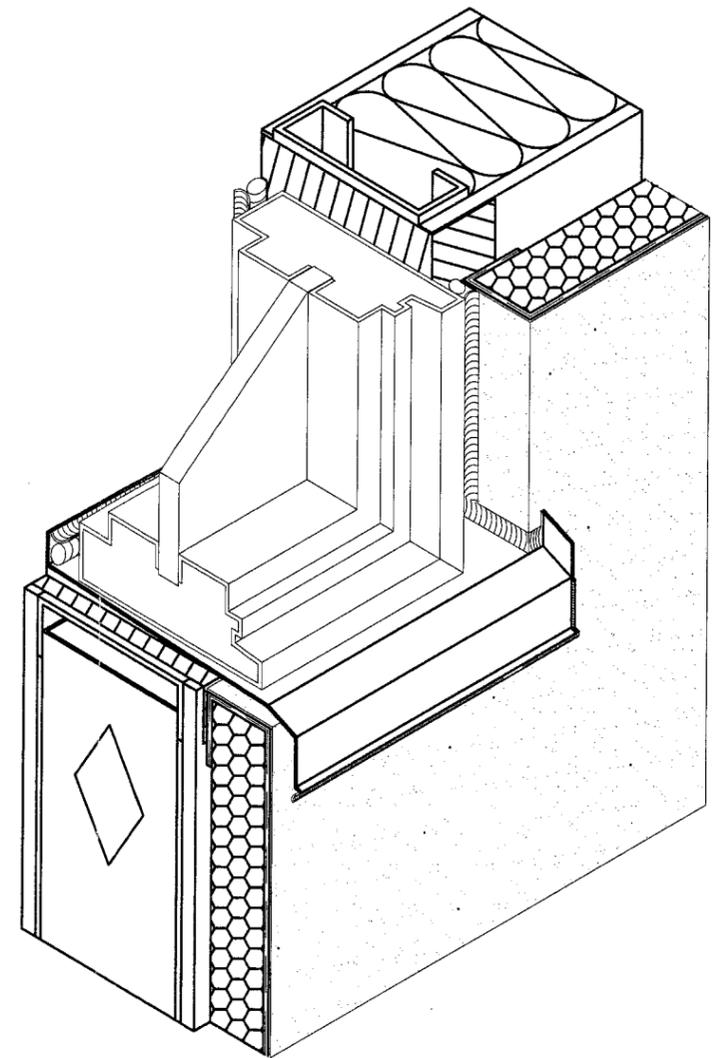

WINDOW OPENING

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 07-0108.01
Expiration Date 09/17/2011
By *[Signature]*
Miami Data Product Control
Division

Florida P.E.
R.E. Kroll
P.E. Registration No. 38477 7/18/07

[Handwritten Signature]

DESIGN PRESSURE

± 75 PSF

DRYVIT SYSTEMS, INC. 
One Energy Way
West Warwick, Rhode Island

DWG. NO.: DCSS Dryvit Outsulation System—
Small Scale Missile— Sheathing Substrate

SHEET NO: 3 OF 3	ISSUE DATE: 05/21/07	REV / DATE:
---------------------	-------------------------	----------------