



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Lamoti Roof Tile
1360 N.W. 29th st.
Miami, FL 33142**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Flat Bermuda Concrete Tile

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises #05-0929.11 and consists of pages 1 through 5.
The submitted documentation was reviewed by Alex Tigera.



**NOA No.:07-0109.01
Expiration Date: 02/01/11
Approval Date: 07/26/07
Page 1 of 5**

ROOFING ASSEMBLY APPROVAL

Category: Roofing
Sub-Category: Tile
Material: Concrete

1. SCOPE:

This renews and revises a roofing system using Lamoti "Flat Bermuda", as manufactured Lamoti Roof Tile, Inc. described in Section 2 of this Notice of Acceptance, designed to comply with the Florida Building Code, High Velocity Hurricane Zone. For the locations where the pressure requirements, as determined by applicable Building Code does not exceed the design pressure values obtain by calculations in compliance with RAS 127 using the values listed in table 2 herein. The attachment calculations shall be done as a moment based system.

2. PRODUCT DESCRIPTION:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
Flat Bermuda Concrete Tile	Length : 16" Width : 10" Thickness : ½"	TAS 112	Flat profile, interlocking, concrete roof tile. For direct deck, mortar or adhesive set applications only.
Trim Pieces	Length : varies Width : varies Varying thickness	TAS 112	Accessory trim, concrete roof pieces for use at hips, rakes, ridges and valley terminations. Manufactured for each tile profile.

3. EVIDENCE SUBMITTED:

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
Testwell Craig Laboratories & Consultants, Inc.	Lab #: QC-4	Static Uplift Testing TAS 101 (Mortar Set)	May 1995
IBA Consultants, Inc.	2358-45	Static Uplift Testing TAS 101 (Adhesive Set)	08/05/05
Testwell Craig Laboratories & Consultants, Inc.	Lab #: QC-7 Tech: M. Presciti	Physical Properties TAS 112	May 1995



NOA No.:07-0109.01
 Expiration Date: 02/01/11
 Approval Date: 07/26/07
 Page 2 of 5

4. LIMITATIONS:

- 4.1 Fire classification is not part of this acceptance
- 4.2 For mortar or adhesive set tile applications, a static field uplift test shall be performed in accordance with RAS 106.
- 4.3 Applicant shall retain the services of a Miami-Dade County Certified Laboratory to perform quarterly test in accordance with TAS 112, appendix 'A'. Such testing shall be submitted to the Building Code Compliance Office for review.
- 4.4 Minimum underlayments shall be in compliance with the applicable Roofing Application Standard listed section 4.1 herein.
- 4.5 30/90 hot mopped underlayment applications may be installed perpendicular to the roof slope unless stated otherwise by the underlayment material manufacturers published literature.
- 4.6 This acceptance is for wood deck applications. Minimum deck requirements shall be in compliance with applicable building code.
- 4.7 May be installed on slopes 2":12" to 7":12"

5. INSTALATION:

- 5.1 Lamoti 'Flat Bermuda Concrete Tile' and its components shall be installed in strict compliance with Roofing Application Standard RAS 120.
- 5.2 Data for Attachment Calculations:

Table 1: Average Weight (W) and Dimensions (l x w)			
Tile Profile	Weight-W (lbf)	Length - l (feet)	Width-w (feet)
Flat Bermuda Concrete Tile	7.20	1.36	0.84

Table 2: Aerodynamic Multipliers - λ (ft ³)		
Tile Profile	λ (ft ³) Batten Application	λ (ft ³) Direct Deck Application
Flat Bermuda Concrete Tile	N/A	0.23

Table 3: Restoring Moments due to Gravity - M_g (ft-lbf)												
Tile Profile	2":12"		3":12"		4":12"		5":12"		6":12"		7":12" or greater	
	Battens	Direct Deck	Battens	Direct Deck								
Flat Bermuda Concrete Tile	N/A	5.56	N/A	5.49	N/A	5.39	N/A	5.24	N/A	5.03	N/A	4.77

Table 7: Attachment Resistance Expressed as a Moment - M_f (ft-lbf) for Single Patty Adhesive Set Systems		
Tile Profile	Tile Application	Minimum Attachment Resistance
Flat Bermuda Concrete Tile	Polyfoam PolyPro™	50.68 ¹

¹ Large paddy placement of 26.7grams of PolyPro™.



Table 8: Attachment Resistance Expressed as a Moment - M_f (ft-lbf) for Mortar Set Systems		
Tile Profile	Tile Application	Attachment Resistance
Flat Bermuda Concrete Tile	Mortar Set ¹	70.70

6. LABELING :

All tiles shall bear the imprint or identifiable marking of the manufacturer's name or logo (See Detail Below), or following statement: "Miami-Dade County Product Control Approved".

LRT

**FLAT BERMUDA CONCRETE TILE
LOCATED UNDERNEATH TILE**


7. BUILDING PERMIT REQUIREMENTS:

- 7.1 Application for building permit shall be accompanied by copies of the following:
 - 7.1.1 this Notice of Acceptance.
 - 7.1.2 Any other documents required by Building Official or Applicable building code in order to properly evaluate the installation of this system.



NOA No.:07-0109.01
 Expiration Date: 02/01/11
 Approval Date: 07/26/07
 Page 4 of 5

PROFILE DRAWING

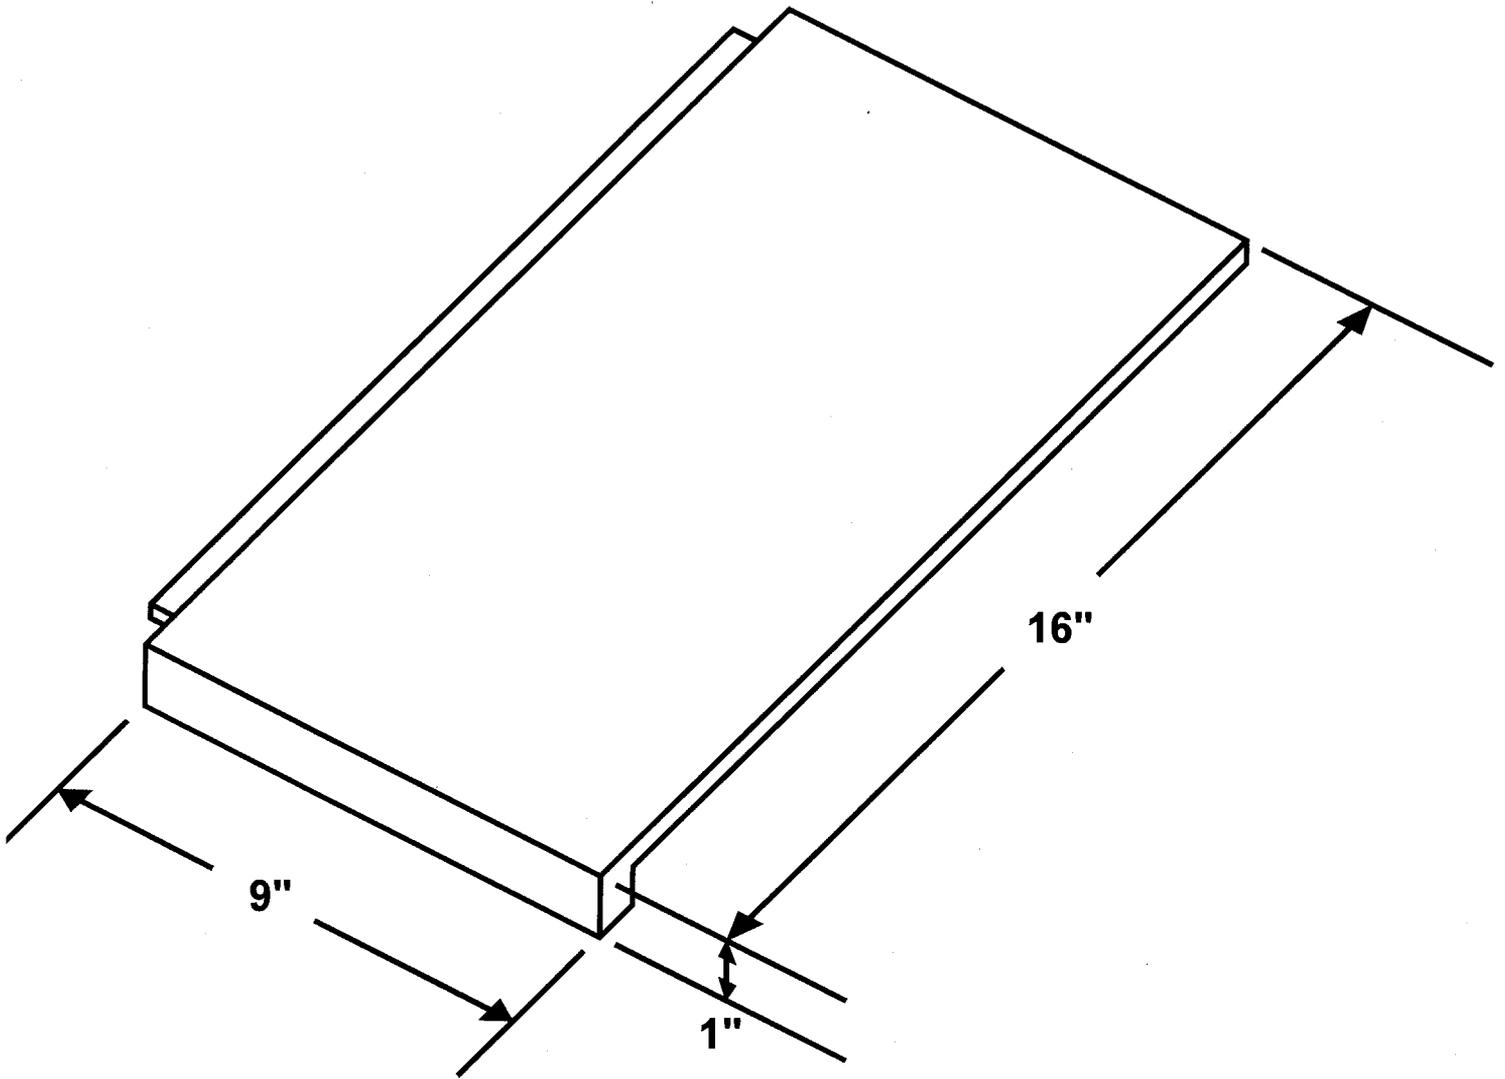

LAMOTI ROOF TILE "FLAT BERMUDA"

END OF THIS ACCEPTANCE



NOA No.:07-0109.01
Expiration Date: 02/01/11
Approval Date: 07/26/07
Page 5 of 5



NOA No.:07-0109.01
Expiration Date: 02/01/11
Approval Date: 07/26/07
Page 6 of 5