



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Wayne -Dalton Corporation
14512 Lincoln Way E.
Dalton, Ohio, 44618**

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series 800 Service Door

APPROVAL DOCUMENT: Drawing No. 035-0034 titled Dade County Test Doors and Approved Modifications, Series 800 Service Door, HVHZ, +47, -47 psf Design up to 22' wide X 24' high, page 1 & 2, dated 01/03/07, prepared by Wayne- Dalton Corporation, signed and sealed on 04/09/07 by David Monsour, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved or MDCPCA", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page, evidence page E 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Mohammed Iqbal Shaikh, P.E.**



Md
04/23/07

**NOA No. 07-0124.03
Expiration Date: May 17, 2012
Approval Date: May 17, 2007
Page 1**

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. 035-0034 titled Dade County Test Doors and Approved Modifications, Series 800 Service Door, HVHZ, +47, -47 psf Design up to 22' wide X 24' high, page 1 & 2, dated 01/03/07, prepared by Wayne- Dalton Corporation, signed and sealed on 04/09/07 by David Monsour, P.E.

B. TESTS.

1. Architectural Testing Report No. 67891.01-109-18, 16 pages, dated 12/20/06 , signed and sealed on 12/21/06 by Joseph A. Reed, P.E. for Testing Standards TAS 201, TAS 202 and TAS 203.

C. CALCULATIONS

1. Calculations for attachment of guide angles to steel or concrete jamb prepared by David Monsour, P.E., dated 01/03/07, 4 pages, signed and sealed on 01/12/07 by David Monsour, P.E.

D. MATERIAL CERTIFICATIONS




1. Architectural Testing Report No. 67891.01-109-18, 6 pages, dated 12/20/06 , signed and sealed on 12/21/06 by Joseph A. Reed, P.E. for Testing. Standard. ASTM E8, Tensile Test for slat.

E. STATEMENTS

1. 2004 Code Compliance letter and no financial interest letter dated 01/12/07, signed and sealed by David Monsour, P.E.



Mohammed Iqbal Shaikh, P.E.
Sr. Building Code Compliance Specialist
NOA No. 07-0124.03
Expiration Date: May 17, 2012
Approval Date: May 17,, 2007

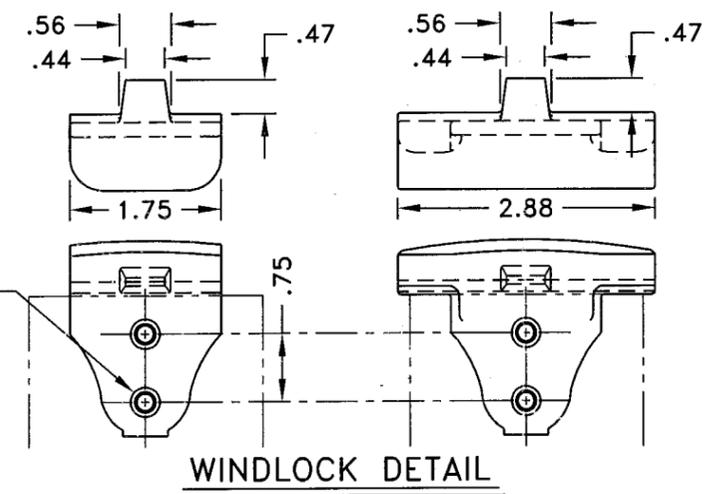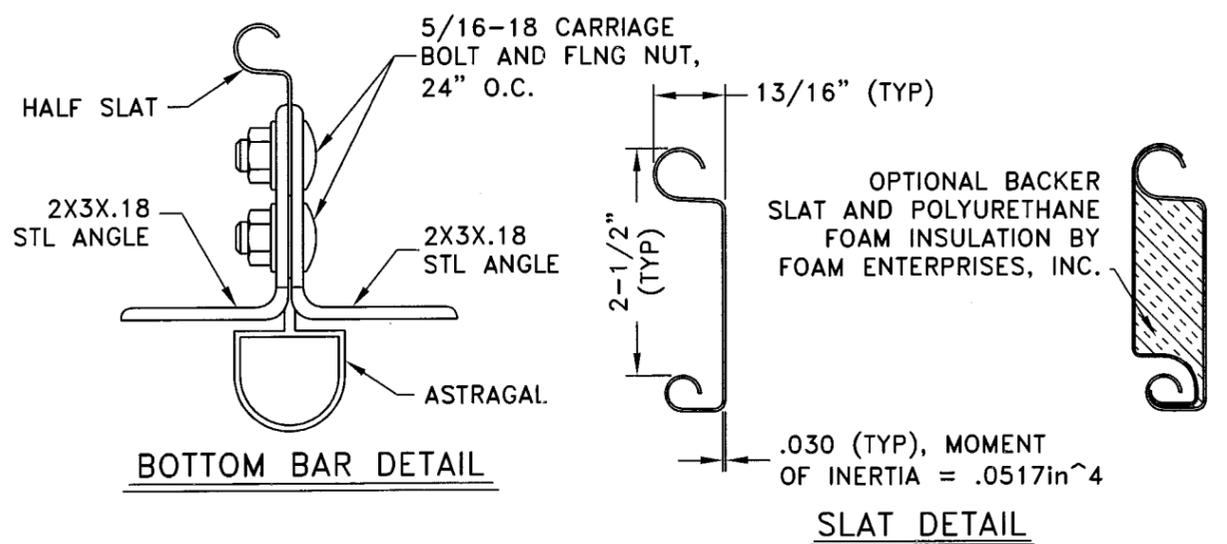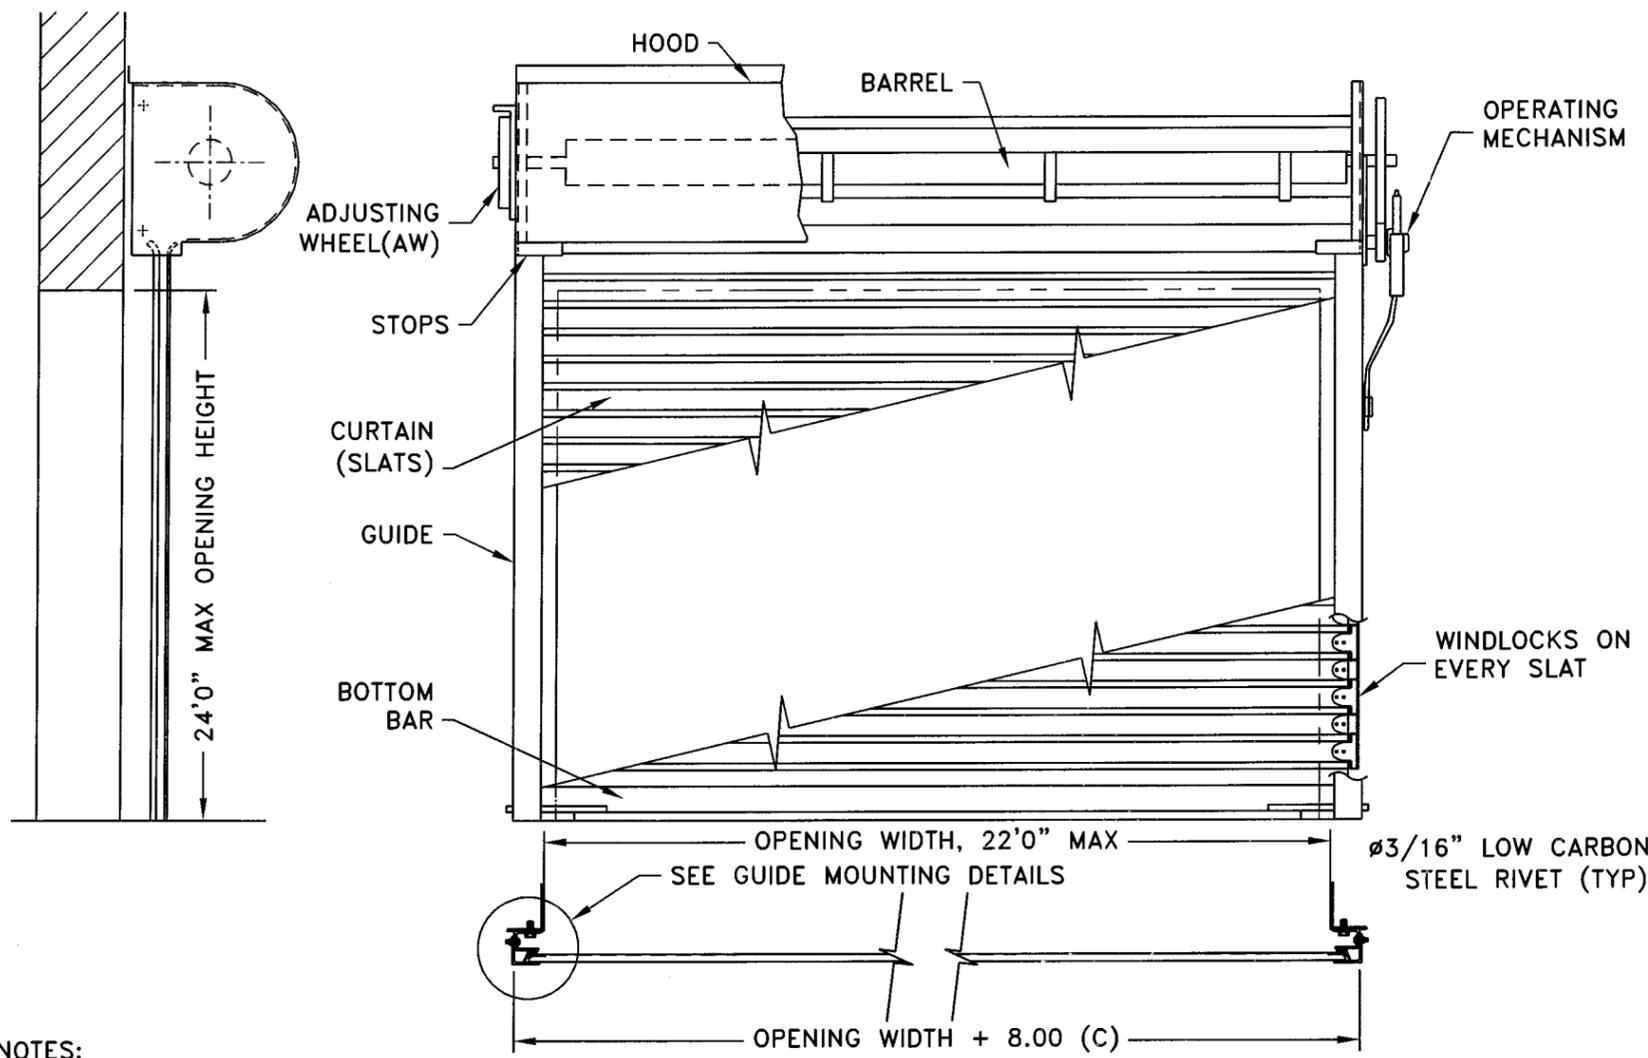

Approved as complying with the Florida Building Code
 Date: 05/17/07
 NOAS: 07-0124.03
 Miami Dade Product Control Division
 By: M. Monsour

Approved: David Monsour
 David Monsour, P.E.
 3395 ADDISON DR., PENSACOLA, FL 32514
 FLORIDA CERTIFICATION NO. 46475
 OHIO CERTIFICATION NO. E-55077
 MISSISSIPPI CERTIFICATION NO. 11946
 LOUISIANA CERTIFICATION NO. 25457
 Date: 5-7-07

NOTES:

1. DESIGN PRESSURE = ±47 PSF, TESTED IN ACCORDANCE WITH TAS 201, TAS 202, AND TAS 203 BY ARCHITECTURAL TESTING, INC.
2. ALL WELDING TO CONFORM TO AMERICAN WELDING SOCIETY'S LATEST EDITION AND FLORIDA BUILDING CODE. USE A.W.S. A5.1 OR A5.5 E70XX ELECTRODES.
3. THE CONTRACTOR SHALL ENSURE THAT THE WALL CAN SUPPORT THE JAMB FORCES INDICATED ON THIS DRAWING.
4. WINDLOCKS ON BOTH ENDS OF ALL SLATS.
5. HOODS ARE 24GA GALVANIZED STEEL, STAINLESS STEEL, OR ALUMINUM.
6. ALL GALVANIZING PER ASTM A 653. SHOP COAT OF RUST INHIBITIVE PRIMER ON NONGALVANIZED STEEL SURFACES.
7. DOOR MAY BE LIFT UP, CRANK, HOIST, OR ELECTRIC OPERATION.
8. THIS DOOR CAN BE INSTALLED WITH EITHER SIDE OF THE SLAT (CONVEX OR CONCAVE) FACING THE EXTERIOR.
9. CURTAIN IS .028 MIN STEEL PER ASTM A 653, GR.40, G90 GALVANIZED.
10. GUIDE ANGLES ARE STRUCTURAL STEEL PER ASTM A 36.
11. BOTTOM BAR ANGLES ARE ROLLFORM HSLAS STEEL GRADE 50 PER ASTM A 1011.
12. TESTING PERFORMED ON A 22' WIDE X 8' HIGH DOOR (SHOWN), APPROVAL APPLIES TO DOORS UP TO 22' WIDE X UP TO 24' HIGH WITH COMPONENTS OF EQUAL OR GREATER STRENGTH AND SIZE.
13. OPERATING MECHANISM NOT PART OF THIS APPROVAL MUST BE CERTIFIED BY AN INDEPENDANT THIRD PARTY.

PART NUMBER	WEIGHT (LB.)	TITLE DADE COUNTY TEST DOORS AND APPROVED MODIFICATIONS, SERIES 800 SERVICE DOOR, HVHZ, ±47 PSF DESIGN UP TO 22' WIDE x UP TO 24' HIGH	DRAWN BY M. DAUS 01/03/2007	CHECKED BY	APPVD. BY	TOLERANCES (UNLESS OTHERWISE SPECIFIED) LINEAR .X ± .060 LINEAR .XX ± .030 LINEAR .XXX ± .010 ANGULAR ± .50° DIMENSIONS IN INCHES	 Wayne Dalton Rolling Door Division 14512 Lincoln Way E. Dalton, Ohio 44618	
REFERENCE PAGE 1 OF 2		MATERIAL AS SHOWN	SCALE - WHEN THIS BOX IS .50" HIGH NONE	ORIGINAL RELEASE				
REV.	REVD. BY	APPVD. BY	RELEASE	DESCRIPTION		SIZE B	DRAWING NO. 035-0034	REVISION
REVISIONS								