



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

www.buldingcodeonline.com

NOTICE OF ACCEPTANCE (NOA)

Securities Impact Windows, LLC
975 South Congress Avenue, Suite 102
Delray Beach, Fl 33445

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 100 Storm Safe Aluminum Single Hung Window

APPROVAL DOCUMENT: Drawing No. **W07-07**, titled "Series 100 Aluminum Single Hung Wdw. (L.M.I.)", sheets 1 through 5 of 5 dated 01/29/07, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., on 02/07/07 bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Mohammed Iqbal Shaikh, P.E.**



NOA No 07-0214.05
Expiration Date: May 10, 2012
Approval Date: May 10 2007
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **W07-07**, titled "Series 100 Aluminum Single Hung Wdw. (L.M.I.)", sheets 1 through 5 of 5 dated 01/29/07, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., on 02/07/07.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per TAS 202
2) Uniform Static Air Pressure Test, Loading per TAS 202
3) Water Resistance Test, per TAS 202
4) Large Missile Impact Test per TAS 201
5) Cyclic Wind Pressure Loading per TAS 203
6) Forced Entry Test, per AAMA 1302.5 and TAS 202
along with marked-up drawings, prepared by Hurricane Engineering and Testing, Inc., Test Report No. **HETI-06-4040, 4041, 4042, 4043, 4044, 4045A, 4045B, 4046, 4047, 4047A, 4047B, 4050 AND 2122** dated 09/21/06, signed and sealed by Rafael E.Droz-Seda, P.E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by Al-Farooq Corporation, dated 02/06/07, 33 pages signed and sealed by Humayoun Farooq, P.E. on 02/07/07.
Complies with ASTM E1300-02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance **NO.06-0216.06** issued to Solutia Inc. for ".SAFELEX IIIG" expiring on 03/21/2011

F. STATEMENTS

1. Statement letter of conformance, dated January 27, 2007, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated January 27, 2007, signed and sealed by Humayoun Farooq, P.E.



Mohammed Iqbal Shaikh P.E.
Sr. Building Code Compliance Specialist
NOA No. 07-0214.05
Expiration Date: May 10, 2012
Approval Date: May 10, 2007

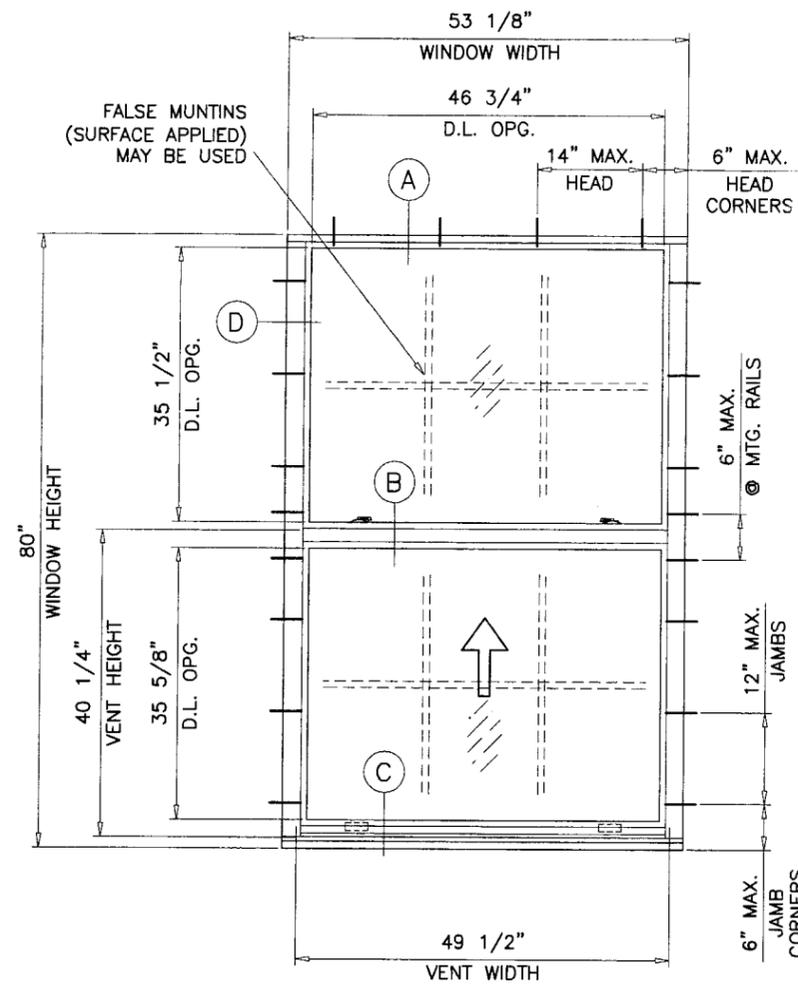

EQUAL LITES

TYPICAL ELEVATION
TESTED UNIT

THESE WINDOWS ARE RATED FOR LARGE MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

SERIES 100 ALUMINUM SINGLE HUNG WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER
CHARTS SHOWN ON SHEETS 1 & 2.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE
COMBINATIONS OF S.H./S.H. OR SINGLE HUNG WITH OTHER
WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING
MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN.
LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL
WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION INCLUDING
HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER
LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS
EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS
ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF
ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO
CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS
OF 2004 FLORIDA BLDG. CODE SECTION 2003.8.4.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-02 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

EQUAL LITES WINDOWS											
DESIGN LOAD CAPACITY - PSF											
FLANGE DIMS.		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'		GLASS TYPE 'D'		GLASS TYPE 'E'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)								
19-1/8"	26" (4)	70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
26-1/2"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
32"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
37"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
42"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
48"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
53-1/8"	38-3/8" (4)	70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
19-1/8"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
26-1/2"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
32"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
37"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
42"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
48"	70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0	
53-1/8"	50-5/8" (6)	70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
19-1/8"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
26-1/2"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
32"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
37"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
42"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
48"	70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0	
53-1/8"	63" (6)	70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
19-1/8"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
26-1/2"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
32"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
37"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
42"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
48"	70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0	
53-1/8"	74-1/4" (8)	70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
19-1/8"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
26-1/2"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
32"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
37"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
42"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
48"	-	-	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0	
53-1/8"	78" (8)	-	-	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
19-1/8"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
26-1/2"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
32"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
37"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
42"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
48"	-	-	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0	
53-1/8"	-	-	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0	

SHOWN EXT.(+) LOADS REQUIRE ADD-ON SILL RAMP
REDUCE EXT.(+) LOADS CAPACITY TO +70.0 PSF WITHOUT RAMP.

* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 18557
C.A.N. 3538

Approved as complying
Florida Building Code
Date 05/10/05
NOAA 07-0214-05
Miami Dade Product Control
Division
By *M. Khan*

FEB 07 2007


afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W07-07SIW

SERIES 100 ALUMINUM SINGLE HUNG WDW. (L.M.I.)
SECURITY IMPACT WINDOWS
975 S. CONGRESS AVE. #102
DELRAY BEACH, FL. 33445
TEL. (561) 274-9392 FAX. (561) 274-9262

no	date	by	description


date: 01-29-07
scale: 1/2"=1'-0"
dr. by: HAWID
chk. by:

drawing no.
W07-07
sheet 1 of 5

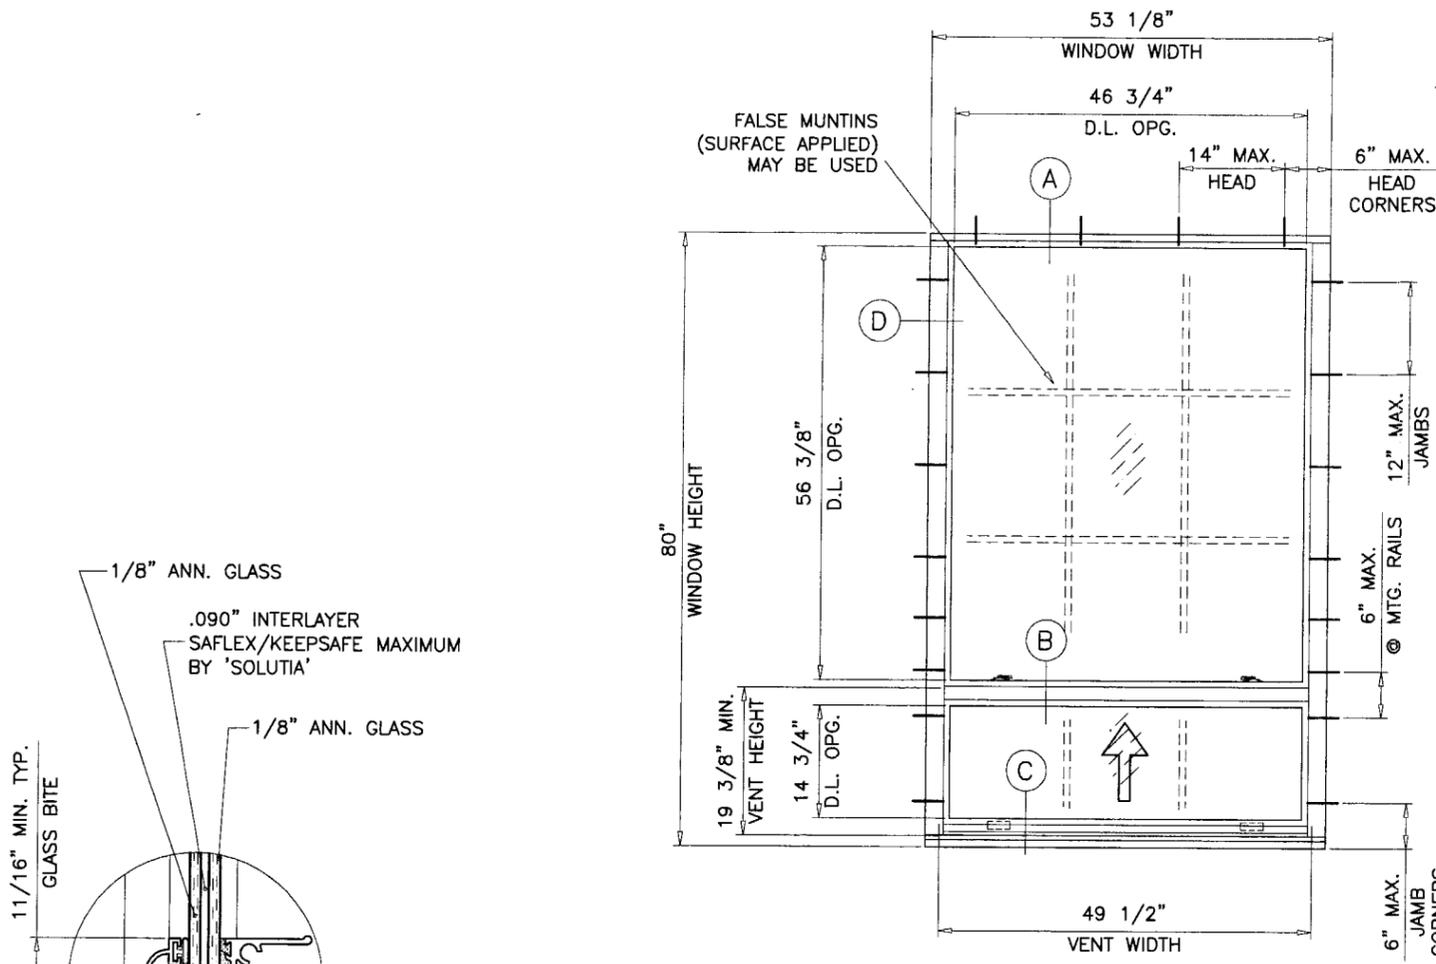


UNEQUAL LITES (ORIEL TYPE)


TYPICAL ELEVATION TESTED UNIT

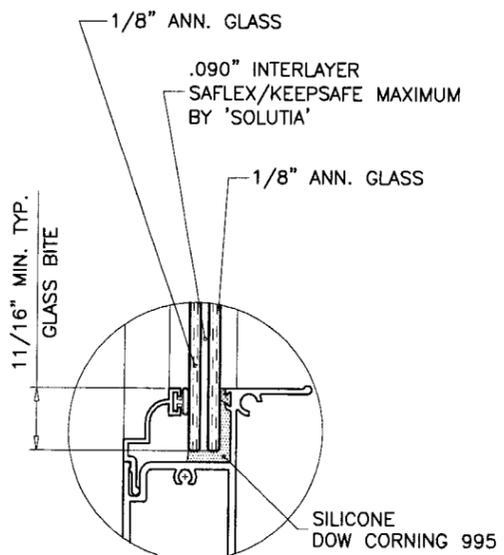


GLASS TYPE 'A'

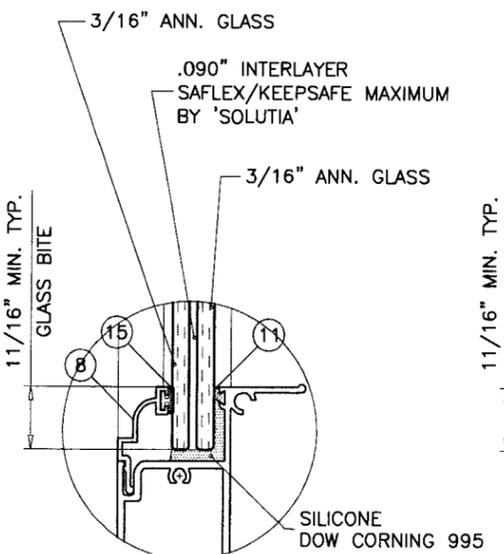


GLASS TYPE 'B'

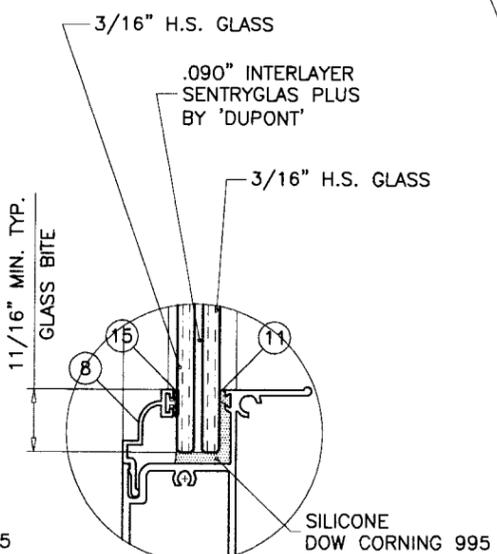

GLASS TYPE 'C'

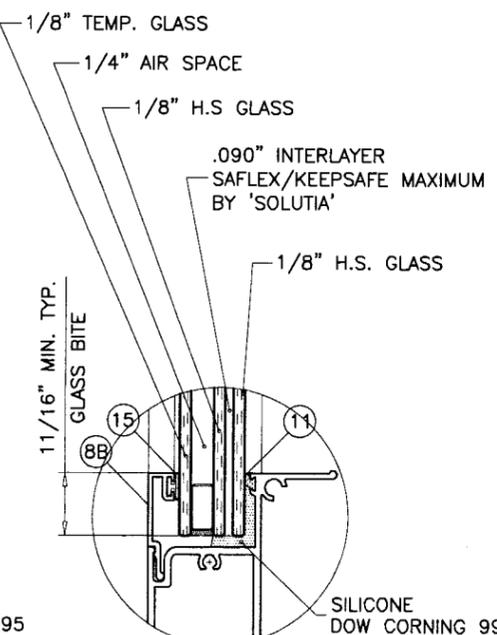

GLASS TYPE 'D'

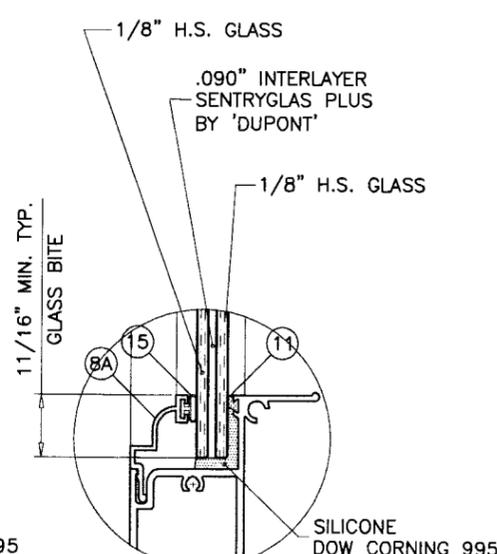

GLASS TYPE 'E'

GLAZING OPTIONS

UNEQUAL LITES WINDOWS											
DESIGN LOAD CAPACITY - PSF											
FLANGE DIMS.		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'		GLASS TYPE 'D'		GLASS TYPE 'E'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)								
19-1/8"	50-5/8" (5)	70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
26-1/2"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
32"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
37"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
42"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
48"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
53-1/8"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
19-1/8"	63" (6)	70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
26-1/2"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
32"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
37"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
42"		-	-	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
48"		-	-	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
53-1/8"		-	-	60.0	60.0	80.0	120.0	70.0	70.0	-	-
19-1/8"	74-1/4" (8)	70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
26-1/2"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
32"		-	-	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
37"		-	-	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
42"		-	-	60.0	60.0	80.0	120.0	70.0	70.0	-	-
48"		-	-	60.0	60.0	80.0	120.0	70.0	70.0	-	-
53-1/8"		-	-	60.0	60.0	80.0	120.0	70.0	70.0	-	-
19-1/8"	78" (8)	70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
26-1/2"		70.0	70.0	80.0	80.0	80.0	120.0	70.0	70.0	80.0	120.0
32"		-	-	60.0	60.0	80.0	120.0	70.0	70.0	80.0	120.0
37"		-	-	60.0	60.0	80.0	120.0	70.0	70.0	-	-
42"		-	-	60.0	60.0	80.0	120.0	70.0	70.0	-	-
48"		-	-	60.0	60.0	80.0	120.0	70.0	70.0	-	-
53-1/8"		-	-	60.0	60.0	80.0	120.0	70.0	70.0	-	-

SHOWN EXT.(+) LOADS REQUIRE ADD-ON SILL RAMP
REDUCE EXT.(+) LOADS CAPACITY TO +70.0 PSF WITHOUT RAMP.

* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538
FEB 07 2007






Approved as complying with the
Florida Building Code
Date: 05/10/07
NOA# 07-0214-05
Miami Dade Product Control
Division
By: *M. Hark*

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W07-07SIW

SERIES 100 ALUMINUM SINGLE HUNG WDW. (L.M.I.)
SECURITY IMPACT WINDOWS
975 S. CONGRESS AVE. #102
DELRAY BEACH, FL. 33445
TEL. (561) 274-9392 FAX. (561) 274-9262

no	date	by	description

date: 01-29-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:
drawing no. **W07-07**
sheet 2 of 5

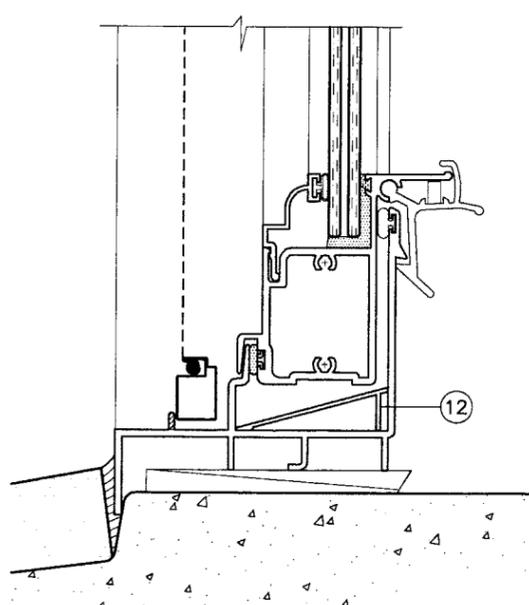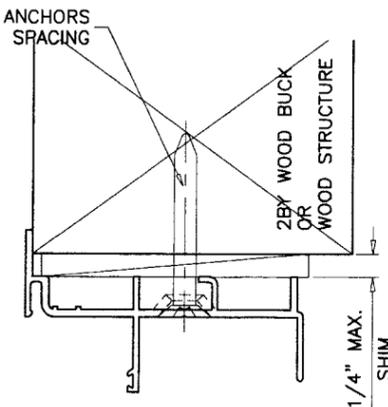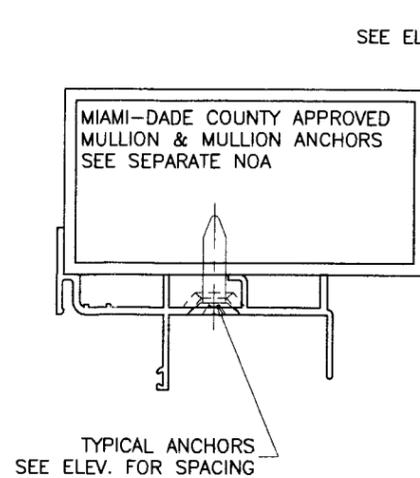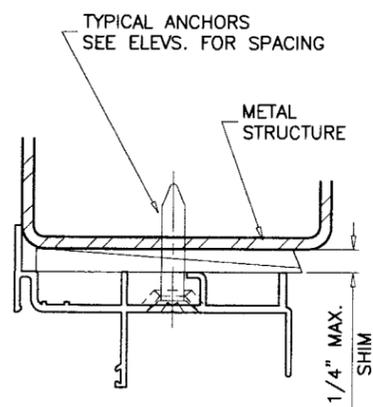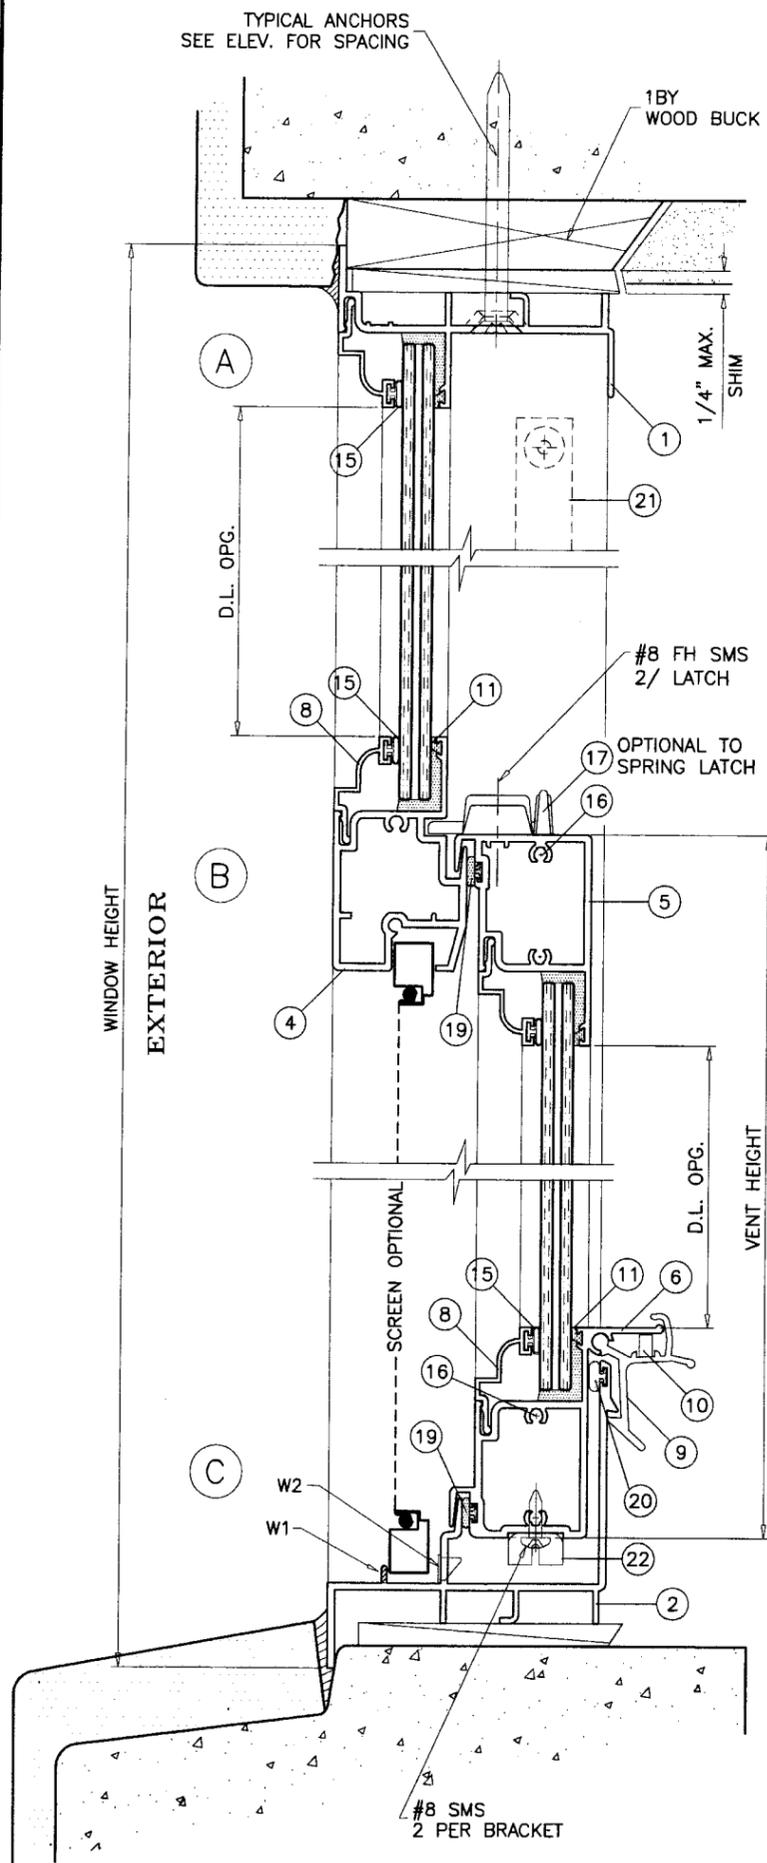

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
1/4" TAPCONS BY 'ELCO'

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SMS OR SELF DRILLING SCREWS
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#12 SMS OR SELF DRILLING SCREWS
 INTO DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
 (NO SHIM SPACE)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 1/2" MIN.

SEALANTS:
 ALL JOINTS AND FRAME CONNECTIONS SEALED WITH SILICONE OR ACRYLIC SEALANT.

WEEPHOLES:
 W1 = 1/2" LONG NOTCH AT EACH END
 AT 3" FROM EACH END
 W2 = 1/4" WEEP HOLE WITH PLASTIC BAFFLE
 AT 8-1/4" FROM EACH END AND AT CENTER

Engr. DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

[Signature]
 FEB 07 2007

Florida State Seal
 Date: 05/10/07
 NOA#: 07-0214-05
 Miami Dade Product Control
 Division
 By: *[Signature]*

WOOD BUCKS AND METAL STRUCTURE NOT BY S.I. WINDOWS
 MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
 AND TRANSFER THEM TO THE BUILDING STRUCTURE.


a f c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W07-07SIW

SERIES 100 ALUMINUM SINGLE HUNG WDW. (L.M.I.)
SECURITY IMPACT WINDOWS
 975 S. CONGRESS AVE. #102
 DELRAY BEACH, FL. 33445
 TEL. (561) 274-9392 FAX. (561) 274-9262



revisions:	no	date	by	description

date: 01-29-07
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W07-07
 sheet 3 of 5

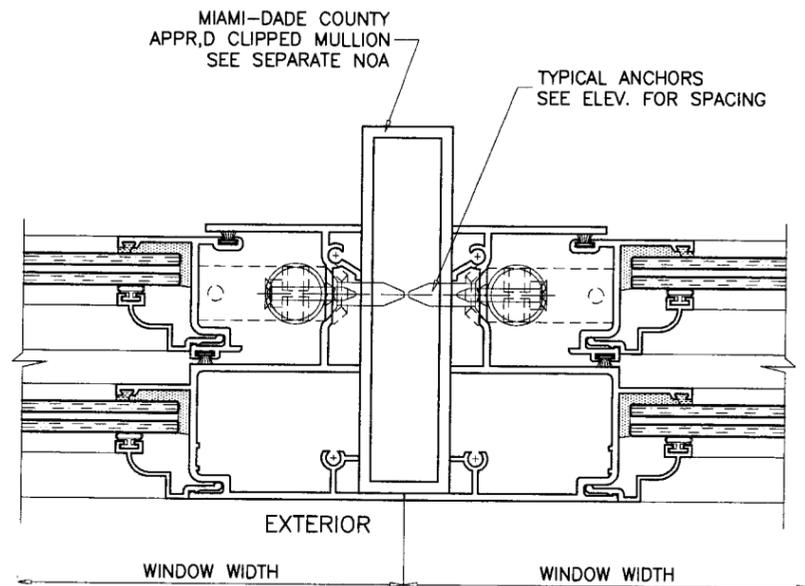

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	SIW101	1	FRAME HEAD	6063-T6	-
2	SIW102	1	FRAME SILL	6063-T6	-
3	SIW103	2	FRAME JAMB	6063-T6	-
4	SIW104	1	FIXED MTG. RAIL	6063-T6	-
5	SIW105	1	VENT TOP RAIL	6063-T6	-
6	SIW106	1	VENT BOTTOM RAIL	6063-T6	-
7	SIW107	2	VENT SIDE RAIL	6063-T6	-
8	SIW108	AS RQD.	GLAZING BEAD (7/16" GLASS)	6063-T6	-
8A	SIW112	AS RQD.	GLAZING BEAD (3/8" GLASS)	6063-T6	-
8B	SIW117	AS RQD.	GLAZING BEAD (LAM. INSUL. GLASS)	6063-T6	-
9	SIW109	2/VENT	VENT LATCH @ 9-3/4" FROM ENDS	6063-T6	-
10	-	1/LATCH	LATCH SPRING	ST. STEEL	-
11	SIW113	AS REQD.	GLAZING LEG SPACER	SANTOPRENE	-
12	SIW124	1	SILL RAMP	6063-T5	-
13	-	-	-	-	-
14	-	4/ VENT	VENT GUIDE	NYLON	-
15	E20218KN4020	AS REQD.	GLAZING BULB VINYL	NEOPRENE	ULTRAFAB
16	#10 X 1-1/2"	20	FRAME & VENT ASSEMBLY SCREWS	CRS	PH SMS
17	-	2/VENT	SWEEP LATCH (OPTIONAL)	ZAMAK	BUILDERS HARDWARE
18	W23201NG0000	AS REQD.	VENT W'STRIPPING @ EXTERIOR (.187"W X .200"H)	-	ULTRAFAB OR EQUIV.
18A	W33321NG0000	AS REQD.	VENT W'STRIPPING @ INTERIOR (.187"W X .320"H)	-	ULTRAFAB OR EQUIV.
19	CIB301NW	AS REQD.	BULB W'STRIPPING @ VENT HORIZ. (.187"W X .300"H)	-	CENTRAL PLASTICS
20	938BL	AS REQD.	FRAME SILL W'STRIPPING (.18"W X .325"H)	POLYPROPYLENE	CENTRAL PLASTICS
21	-	2/VENT	SPIRAL BALANCE	-	UNIQUE BALANCE
22	-	1/ BAL.	ULTRALIFT BRACKET	STEEL	-
23	-	2	SASH STOP	-	NOT SHOWN
24	-	1	7/16" BOX SCREEN	-	OPTIONAL

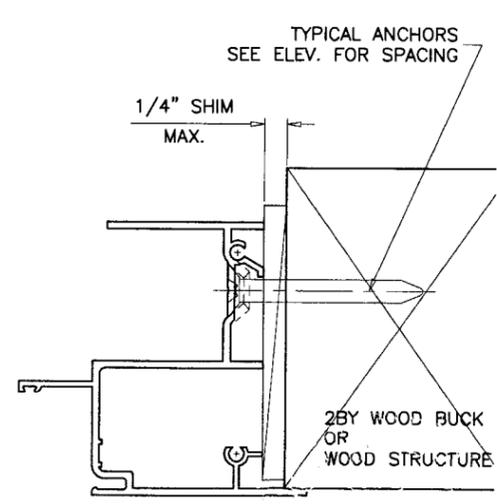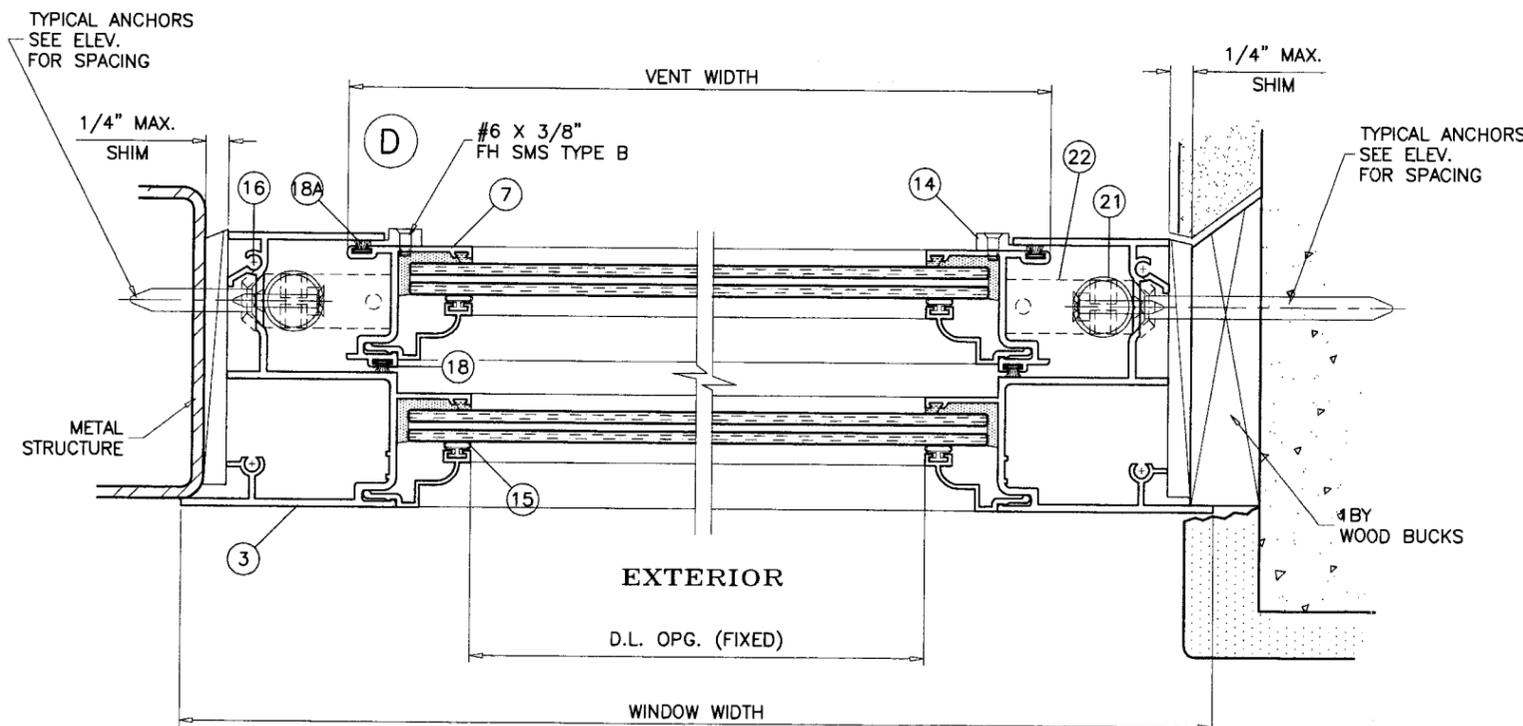

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. P.E. # 16557
C.A.N. 3538

FEB 07 2007

date: 05/10/07
NOA: 07-0214.05
Miami Dade Product Control
By: *M. Khan*


afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANL W07 - 07SIW

SERIES 100 ALUMINUM SINGLE HUNG WDW. (L.M.I.)
SECURITY IMPACT WINDOWS
975 S. CONGRESS AVE. #102
DELRAY BEACH, FL. 33445
TEL. (561) 274-9392 FAX. (561) 274-9262


revisions:	no.	date	description

date: 01-29-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


drawing no.
W07-07
sheet 4 of 5

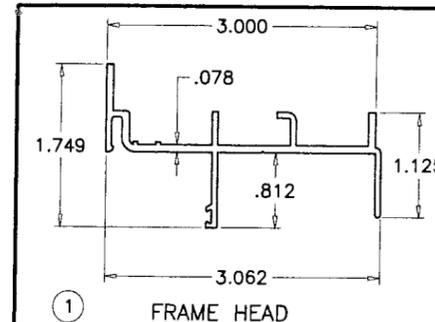


1 FRAME HEAD

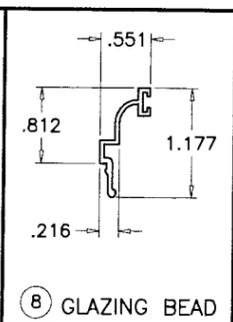


B GLAZING BEAD

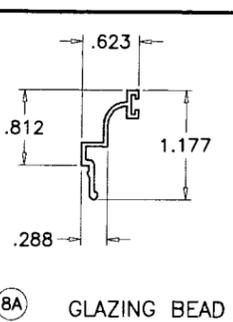


BA GLAZING BEAD

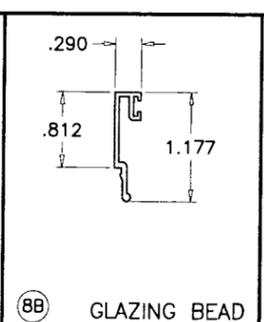


BB GLAZING BEAD

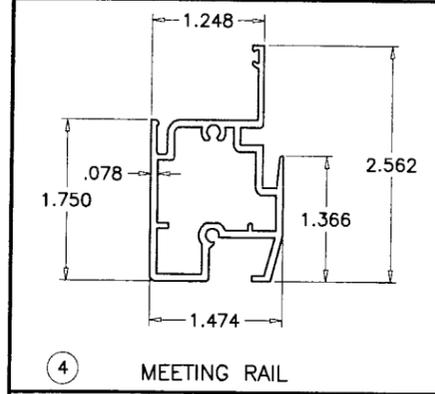


4 MEETING RAIL

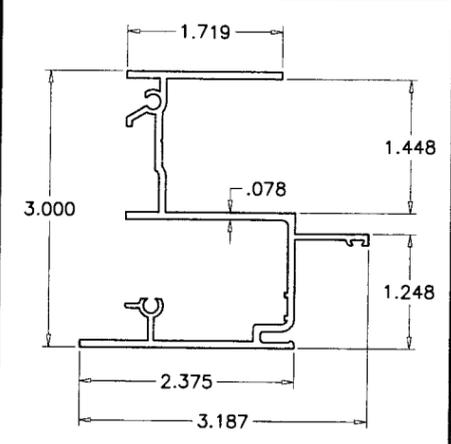


3 FRAME JAMB

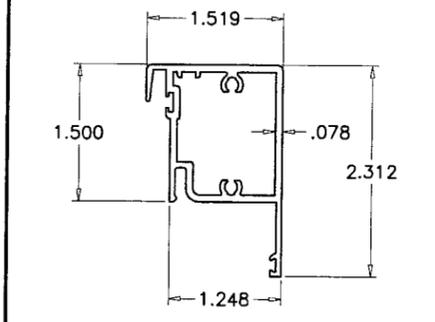


5 VENT TOP RAIL

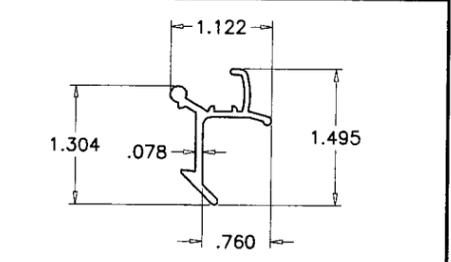


9 VENT LATCH

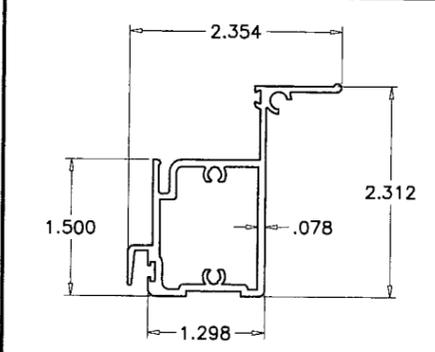


6 VENT BOTTOM RAIL

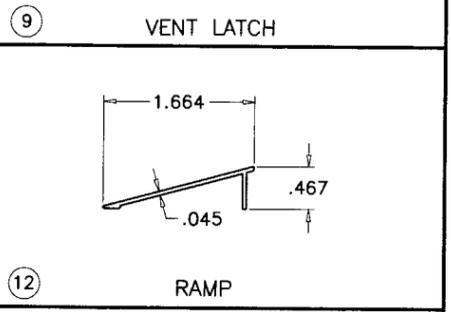


12 RAMP

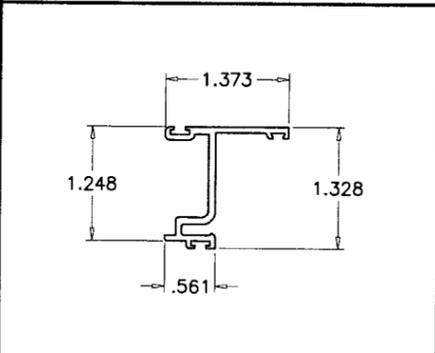


7 VENT SIDE RAIL

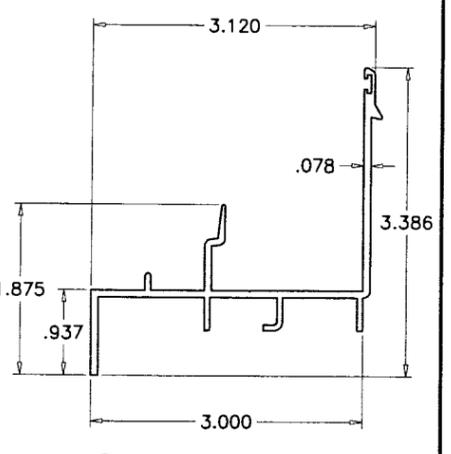


2 FRAME SILL

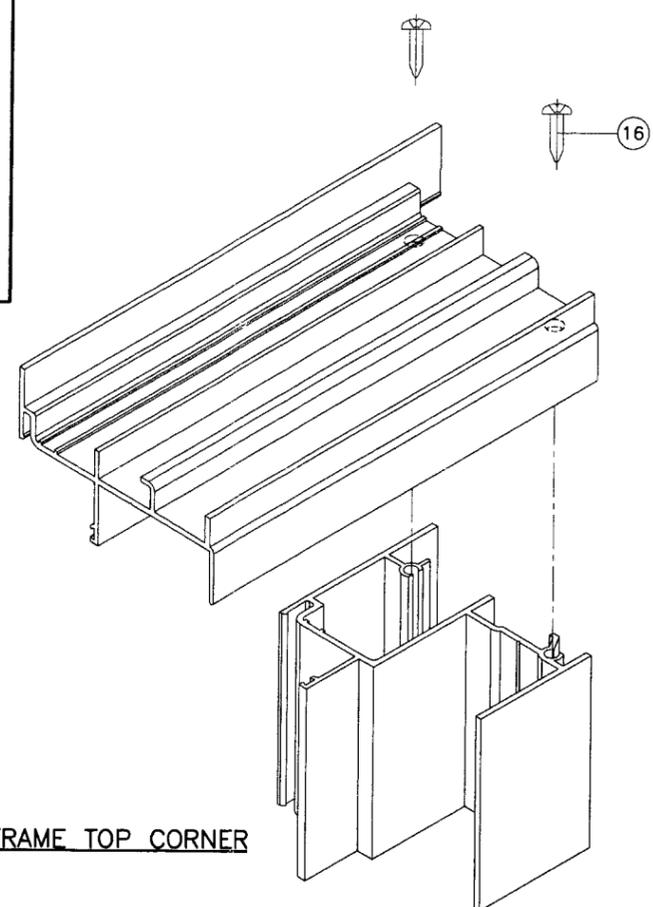


FRAME TOP CORNER

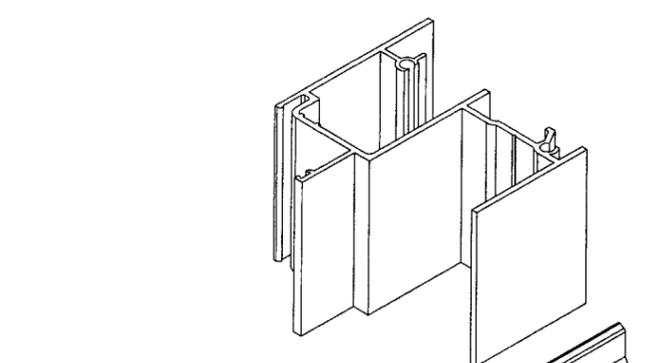

FRAME BOTTOM CORNER

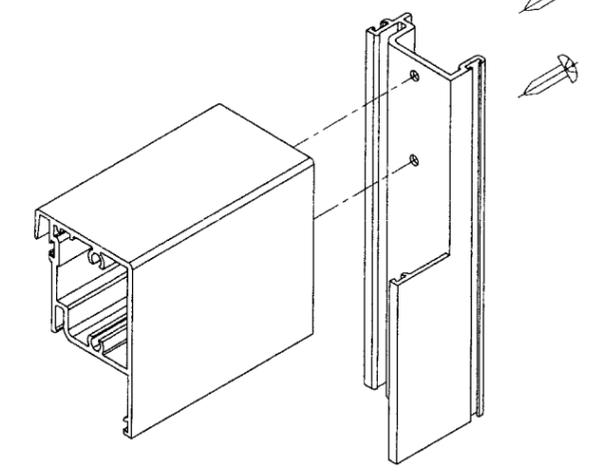

VENT TOP CORNER

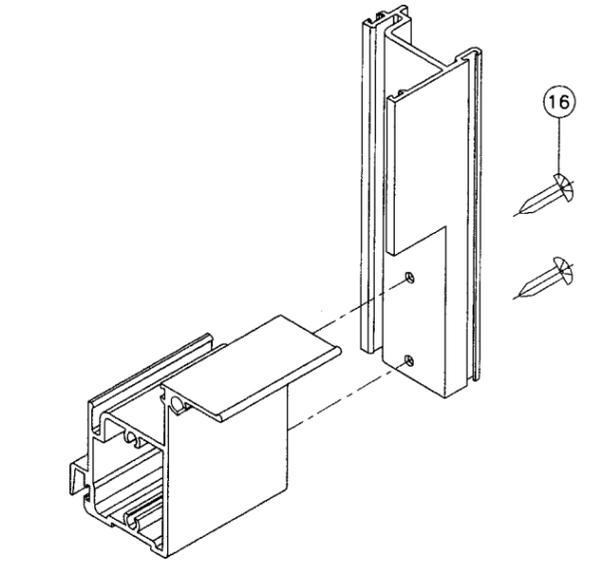

VENT BOTTOM CORNER

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538
FEB 07 2007

Approved by: *M. Khan*
Date: 05/10/07
NOA: 07-0214-05
Checked by: *M. Khan*

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W07-07SIW

SERIES 100 ALUMINUM SINGLE HUNG WDW. (L.M.I.)
SECURITY IMPACT WINDOWS
975 S. CONGRESS AVE. #102
DELRAY BEACH, FL. 33445
TEL. (561) 274-9392 FAX. (561) 274-9262

no	date	description

date: 01-29-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W07-07
sheet 5 of 5