



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

www.buldingcodeonline.com

**Diebold, Incorporated
818 Mulberry Road S.E.
Canton, OH 44707**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Bullet Resistant Drive-Up" Steel Fixed Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **07-023**, titled "Series Bullet Resistant Drive-Up Steel Fixed Window", sheets 1 through 4 of 4, dated 1/24/07, prepared by EngCo Inc., signed and sealed by Pedro De Figueiredo, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises and renews NOA # **01-0628.02** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 07-0214.13
Expiration Date: December 24, 2007
Approval Date: April 12, 2007
Page 1**

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **07-023**, Sheets 1 through 4 of 4, titled "Series Bullet Resistant Drive-Up Steel Fixed Window", dated 1/24/07, prepared by EngCo Inc., signed and sealed by Pedro De Figueiredo, P.E.

B. TESTS

1. Test reports on 1) Large Missile Impact Test per SFBC, PA 201-94
2) Cyclic Wind Pressure Loading per SFBC, PA 203-94
along with marked-up drawings and installation diagram of a steel fixed window, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0084-0509-97**, dated 5/19/97, signed and sealed by Timothy Marshall, P.E.
(Submitted under previous NOA #98-0121.12)
2. Test reports on 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
along with marked-up drawings and installation diagram of a steel fixed window, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0084-1006-97**, dated 5/19/97, signed and sealed by Timothy Marshall, P.E.
(Submitted under previous NOA #98-0121.12)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004, dated 12/23/06, prepared by EngCo Inc., signed and sealed by Pedro De Figueiredo, P.E.
Complies with ASTM E1300-02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "Saflex HIG Clear or colored interlayer." dated 05/04/06 and expiring on 05/21/11.


Manuel Perez, P.E.
Product Control Examiner
NOA No 07-0214.13

Expiration Date: December 24, 2007
Approval Date: April 12, 2007

Diebold, Incorporated

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of conformance and no financial interest, dated January 25, 2007, signed and sealed by Pedro De Figueiredo, P.E.
2. Statement letter from manufacturer stating that the product has not changed and requesting a One-Year Renewal to allow the time to perform a verification test, dated December 23, 2006, signed by Pedro De Figueiredo < P.E., Consulting Engineer.
3. Letter from laboratory confirming manufacturer has contracted and scheduled verification tests, issued by Hurricane Test Laboratory, LLC, dated 12/18/06, signed by Vinu Abraham, P.E.

G. OTHER

1. Notice of Acceptance No. **01-0628.02**, issued to Diebold, Inc. for their Series "Bullet Resistant Drive-Up" Window, approved on 02/21/02 and expiring on 12/24/06.


Manuel Perez, P.E.
Product Control Examiner
NOA No 07-0214.13
Expiration Date: December 24, 2007
Approval Date: April 12, 2007

INDEX:


- SHEET 1 of 4
GENERAL NOTES, WINDOW ELEVATION, NOTES AND DESIGN PRESSURE RATING
- SHEET 2 of 4
SECTION DD, DETAILS B AND C AND GLAZING DETAIL
- SHEET 3 of 4
SECTION AA, FF, EE AND DETAIL G
- SHEET 4 of 4
INSTALLATION INSTRUCTION, SECTION GG AND BILL OF MATERIAL

GENERAL NOTES:

- 1- CODE: THIS PRODUCT HAS BEEN TESTED AND DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 2004 INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ).
- 2- DEFINITION: THIS PRODUCT IS A STEEL FIXED WINDOW IMPACT RESISTANT.
- 3- POSTING: 'SERIES 'BULLET RESISTANT DRIVE-UP' STEEL FIXED WINDOW - LARGE MISSILE IMPACT DIELBOLD, INC - CANTON - FLORIDA DADE COUNTY PRODUCT CONTROL APPROVED'
- 4- DESIGN LOADS: THE DESIGNED LOADS MUST BE CALCULATED BY A PROFESSIONAL ARCHITECT OR ENGINEER FOR EACH SPECIFIC PROJECT. THE CALCULATED DESIGNED PRESSURE MUST NOT EXCEED THE ALLOWABLE APPROVED PRESSURE.
- 5- MATERIAL: ALL CARBON STEEL PARTS COMPONENTS ARE COATED WITH SHERWIN - WILLIAMS 'POWDURA' POLYESTER URETHANE POWDER FROM 1-3 MILLS THICK AND GLAZING TO BE LAMINATED IMPACT RESISTANT GLASS AS SPECIFIED ON THIS APPROVAL.
- 6- FASTENERS: ASSEMBLY SCREWS AND ANCHORS SHALL BE AS SPECIFIED IN THE CURRENT SET OF DRAWINGS. INSTALLATION AND LOADS AS PER THIS APPROVAL. ANCHOR QUANTITY & SPACING MUST NOT EXCEED THE MAXIMUM LIMITS SPECIFIED BY THIS APPROVAL.
- 7- USE: IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR, ARCHITECT OR ENGINEER OF RECORD TO VERIFY THE FOLLOWING:
 - 7.1- THE STABILITY OF THE STRUCTURE WHERE THE PRODUCT IS TO BE ATTACHED INSURING PROPER ANCHORAGE.
 - 7.2- THE SITE SPECIFIC PROJECT CRITERIA, SUCH AS BUT NOT LIMITED TO, LOCAL CODE REQUIREMENTS, DESIGNED PRESSURES ETC.
 - 7.3- THAT THIS APPROVAL IS ADEQUATE TO THE SPECIFIC PROJECT.
- 8- 33 1/3% INCREASE IN ALLOWABLE LOADS HAVE NOT BEEN USED IN THE DESIGN OF THE ANCHORS FOR THIS PRODUCT APPROVAL.
- 9- DISSIMILAR MATERIALS: MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL, THAT COME IN CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004 FLORIDA BUILDING CODE SECTION 2003.8.4.

SERIAL NUMBER LABEL & UL LABEL MUST BE LOCATED ON INSIDE UPPER LEFT SURFACE

TYPICAL EXTERIOR ELEVATION

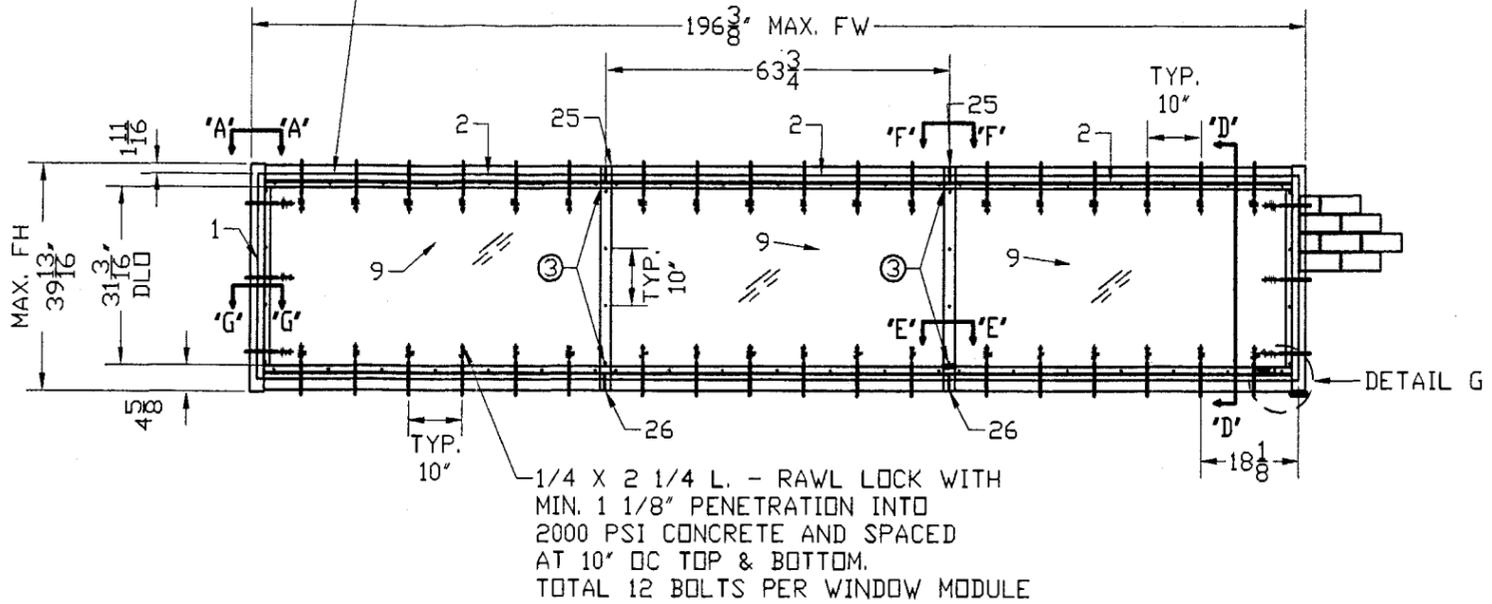

**DESIGN PRESSURE RATING
±50 PSF**

- NOTES:**
- ① TO BE FURNISHED BY GENERAL CONTRACTOR
 - ② DRILL AT INSTALLATION (2) .086 DIA. HOLES FOR SCREWS FURNISHED WITH KIT ITEM #3
 - ③ BEFORE PUTTING ON TOP, BOTTOM & CENTER SPLICES, CAULK BEHIND THEM FIRST. CAULK WILL KEEP THESE PARTS IN PLACE.
 - ④ THIS WINDOW IS NOT CONSIDERED TO BE FIRE RESISTIVE.
 - ⑤ THIS WINDOW IS CONSIDERED INOPERATIVE.
 - ⑥ THIS WINDOW IS CONSIDERED AS A LAMINATED ANNEALED GLASS INSTALLATION AND FURTHERMORE NOT INTENDED TO MEET THE REQUIREMENTS OF SAFETY GLAZING AND SHALL NOT BE CONSIDERED AS MEETING THE REQUIREMENTS FOR SAFETY GLAZING.
 - ⑦ CONTINUOUS GLAZING RABBET AND RETAINER SHALL BE UTILIZED.
 - ⑧ RESILIENT SETTING MATERIAL SHALL BE UTILIZED.
 - ⑨ RESILIENT SETTING MATERIAL SHALL BE UTILIZED.
 - ⑩ MINIMUM EDGE GLASS CLEARANCE: 5/16"
 - ⑪ THE RTV SHOULD BE RTV-732 SILICON RUBBER OR EQUIVALENT.

MANUFACTURER:

DIEBOLD
INCORPORATED
818 MULBERRY ROAD SE
CANTON, OH - 44707
TEL.: (800) 456-1286
FAX: (330) 489-4140

PRODUCT:
Series "Bullet
Resistant Drive-Up"
Steel Fixed
Window

Engineering:
EngCo Inc.
CA 8116
6971 W. SUNRISE BLVD. 104
PLANTATION, FL. 33313
TEL.: (954) 585-0304
FAX.: (954) 585-0305


FEB 12 2007
Engineer Seal
Pedro De Figueiredo
PE 52609

Date: 1/24/07
Scale: NA
Design by: PPMF

PRODUCT CONTROL DIVISION:
PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 07-024-13
Expiration Date DEC 24, 2007
By *Maurice Perez*
Miami Dade Product Control
Division


Drawing Number
07-023

Sheet
1 of 4

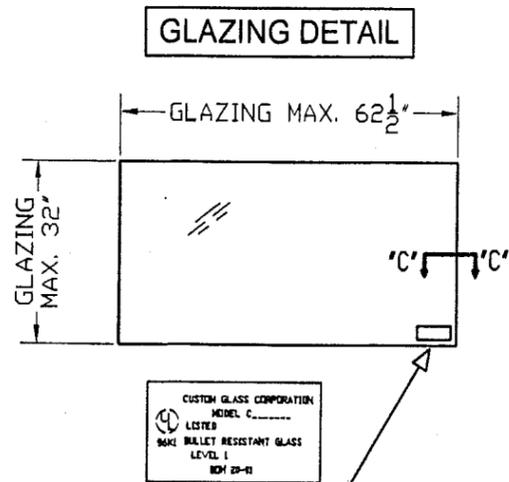


MANUFACTURE'S MARK TO BE ETCHED (SAND BLASTED) ON OUTSIDE OF WINDOW GLASS. CHARACTERS MUST BE .062" HIGH MINIMUM


1 3/16" BRG-1 LAMINATED GLASS BY CUSTOM GLASS CORPORATION

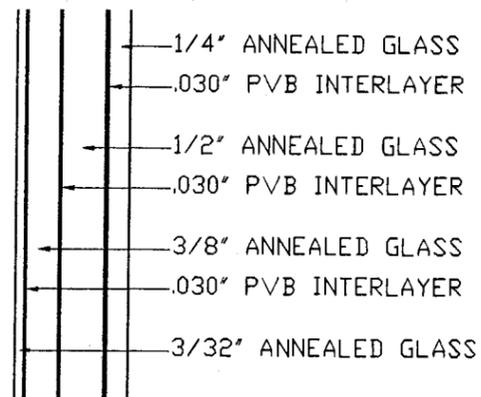


SECTION CC

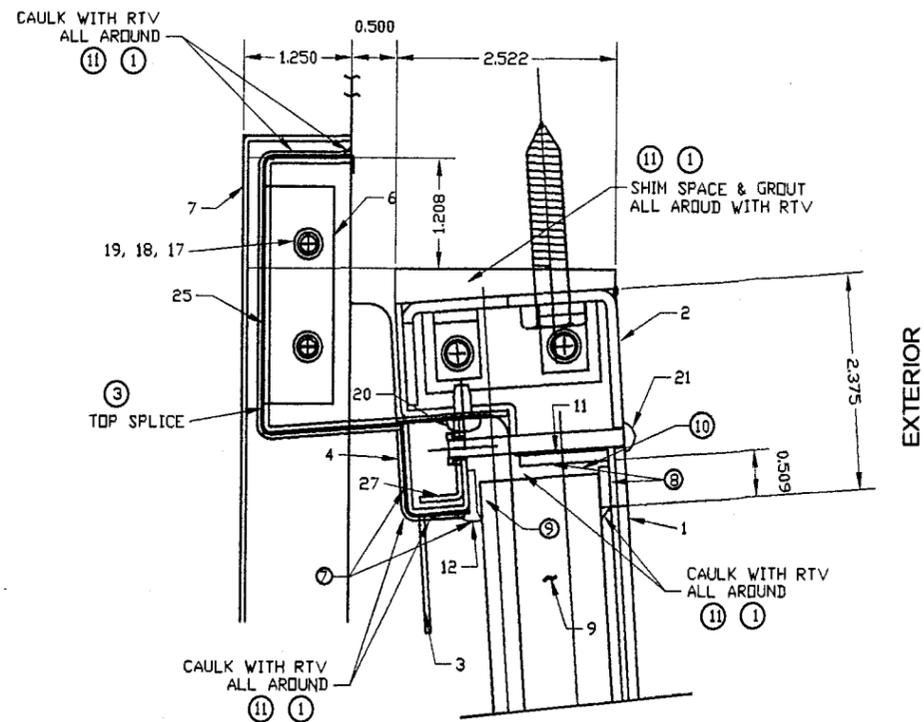

HEADER DETAIL - C

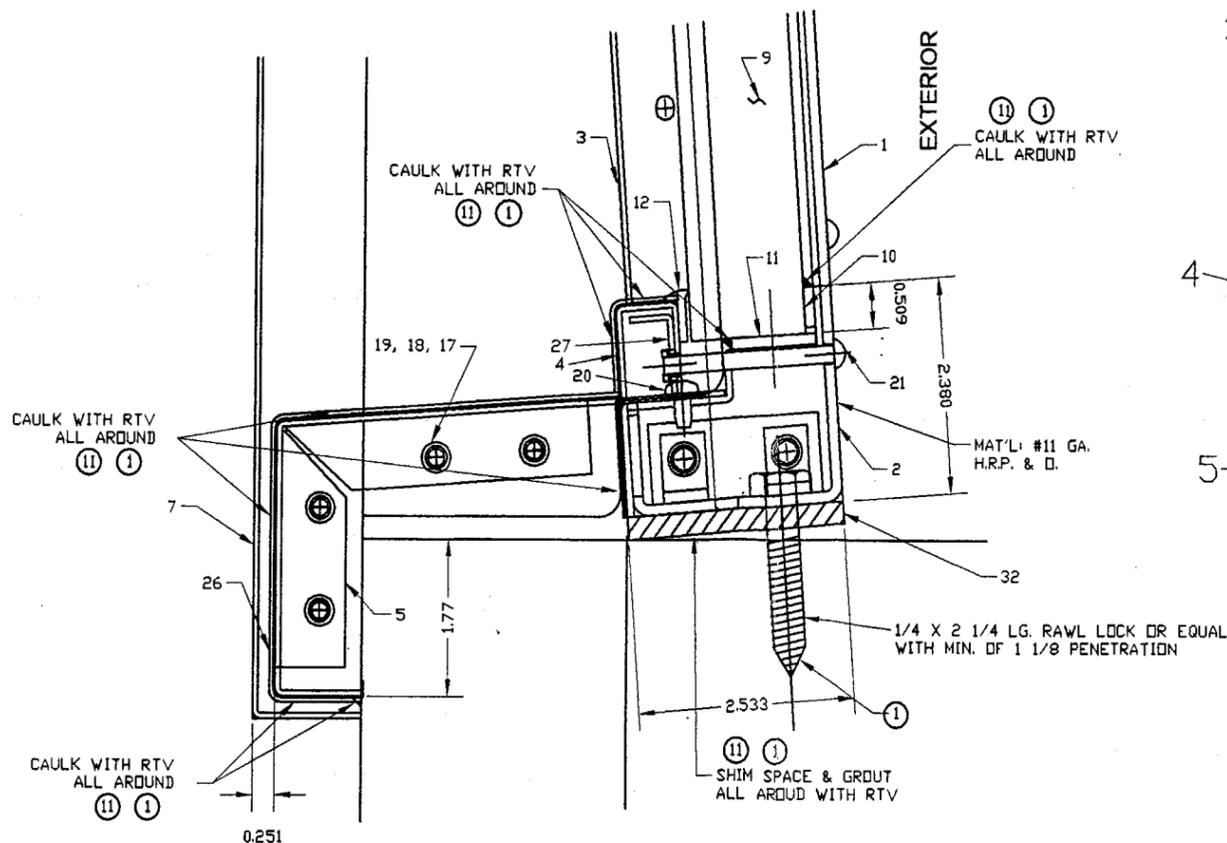

SILL DETAIL - B

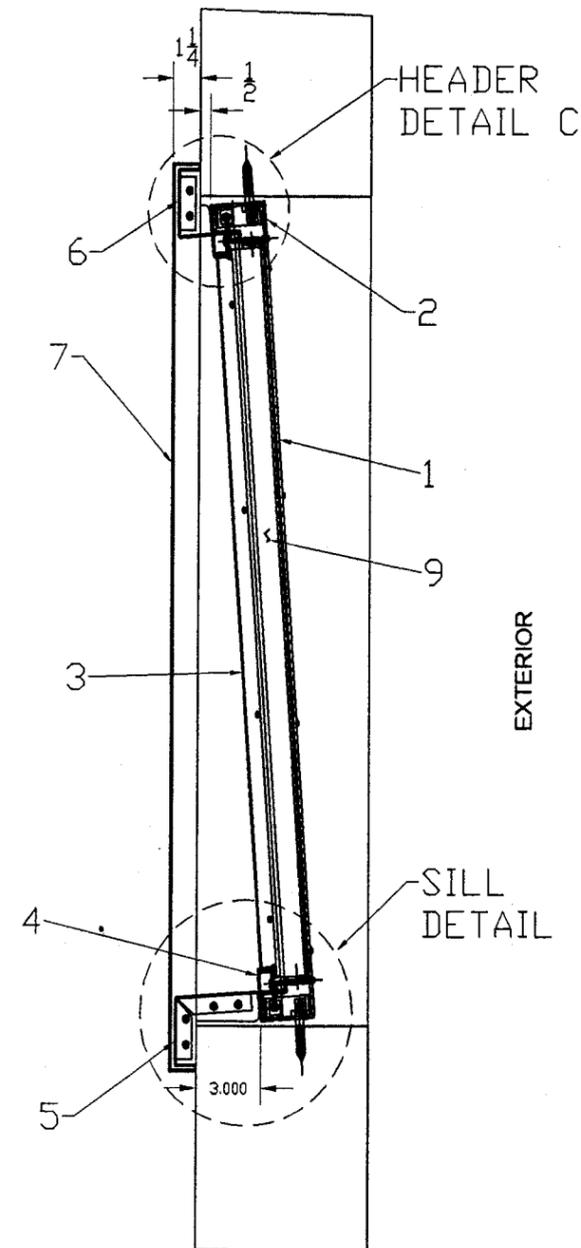

VERTICAL SECTION - DD

MANUFACTURER:

DEBOLD
INCORPORATED

818 MULBERRY ROAD SE
CANTON, OH - 44707
TEL.: (800) 456-1286
FAX: (330) 489-4140

PRODUCT:
Series "Bullet
Resistant Drive-Up"
Steel Fixed
Window

Engineering:
EngCo Inc.

CA 8116
6971 W. SUNRISE BLVD. 104
PLANTATION, FL. 33313
TEL.: (954) 585-0304
FAX.: (954) 585-0305

FEB 12 2007

Engineer Seal
Pedro De Figueiredo
PE 52609

Date: 1/24/07
Scale: NA
Design by: PPMF

PRODUCT CONTROL DIVISION:

PRODUCT REVISED
to comply with the Florida
Building Code
Acceptance No. 07-0214.13
Expiration Date: DEC 24, 2007
Manuel Pera
Product Control
Division

Drawing Number
07-023

Sheet
2 of 4

MANUFACTURER:

DIEBOLD
INCORPORATED

818 MULBERRY ROAD SE
CANTON, OH - 44707
TEL.: (800) 456-1286
FAX: (330) 489-4140

PRODUCT:
Series "Bullet
Resistant Drive-Up"
Steel Fixed
Window

Engineering:
EngCo Inc.

CA 8116
6971 W. SUNRISE BLVD. 104
PLANTATION, FL. 33313
TEL.: (954) 585-0304
FAX.: (954) 585-0305


FEB 2 2007
Engineer Seal
Pedro De Figueredo
PE 52609





Date: 1/24/07
Scale: NA
Design by: PPMF

PRODUCT CONTROL DIVISION:
PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **07-0214.13**
Expiration Date **DEC. 24, 2007**

Manuel Jara Product Control
Division

Drawing Number
07-023

Sheet
3 of 4

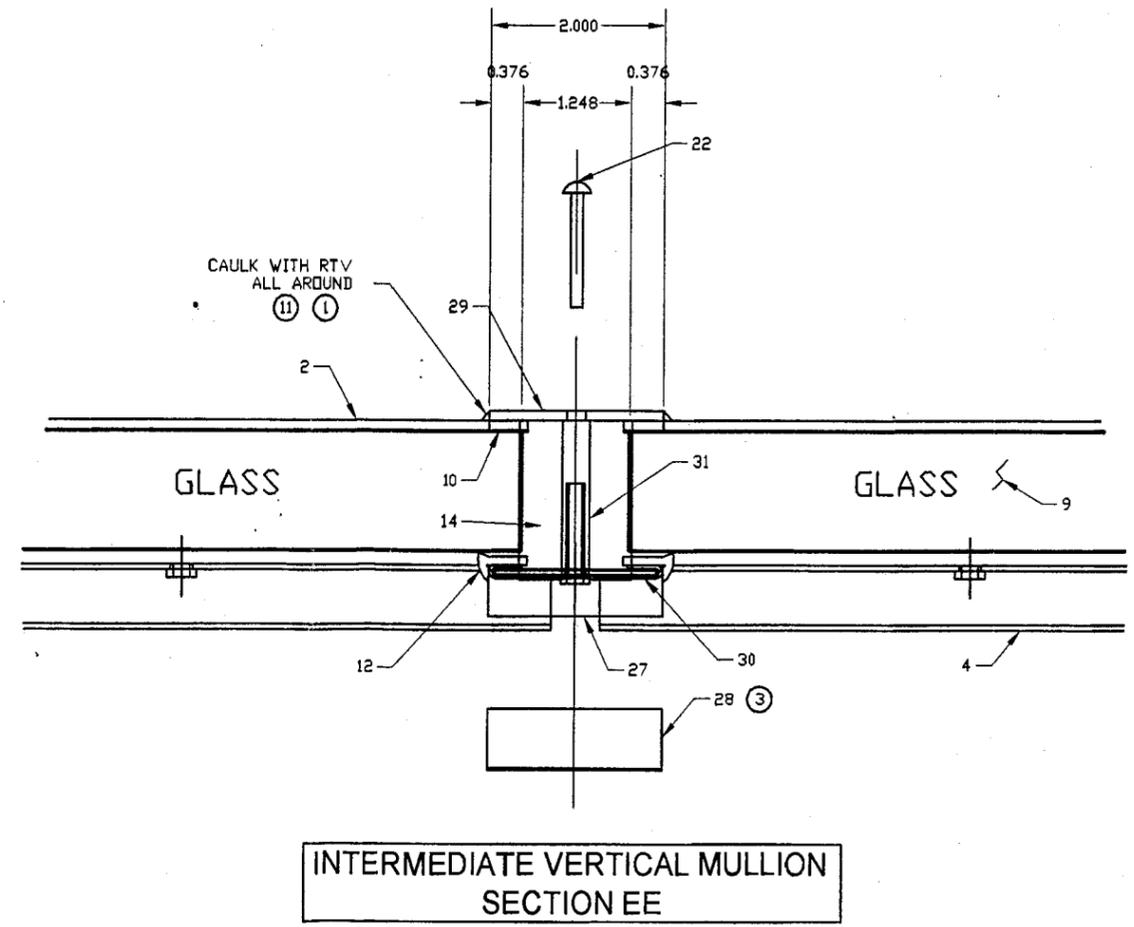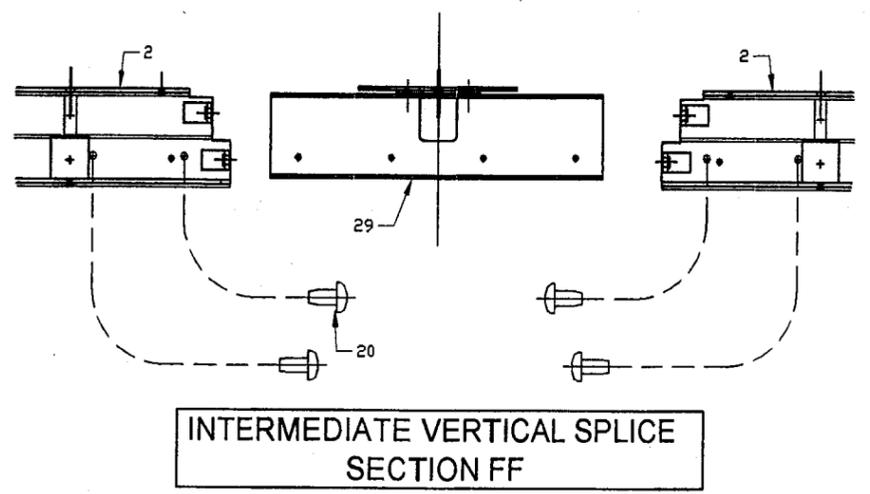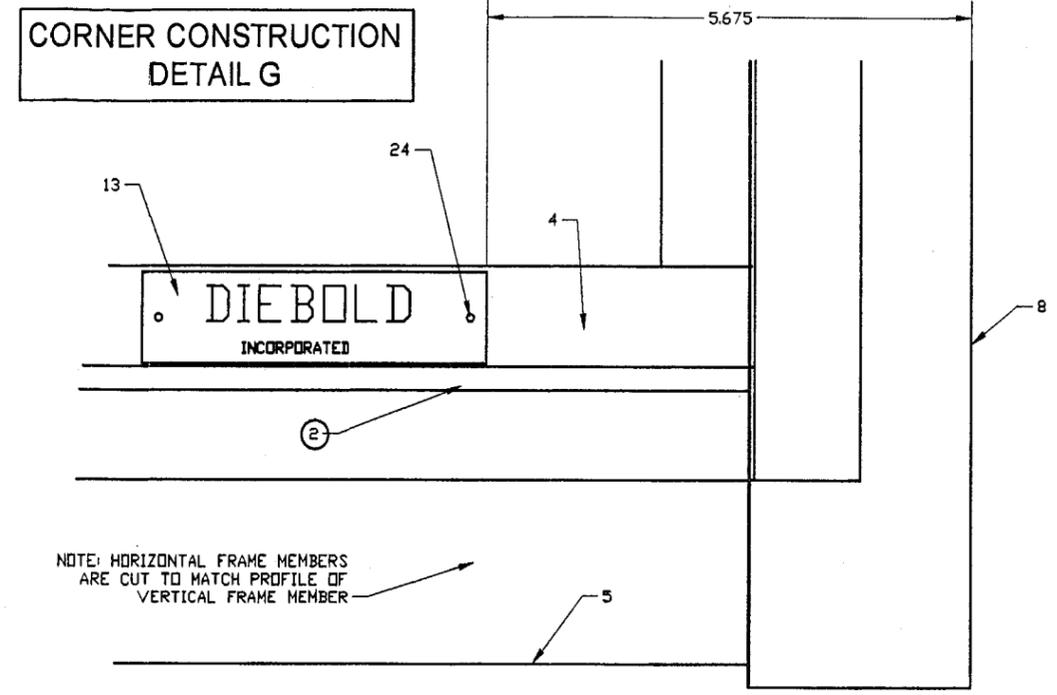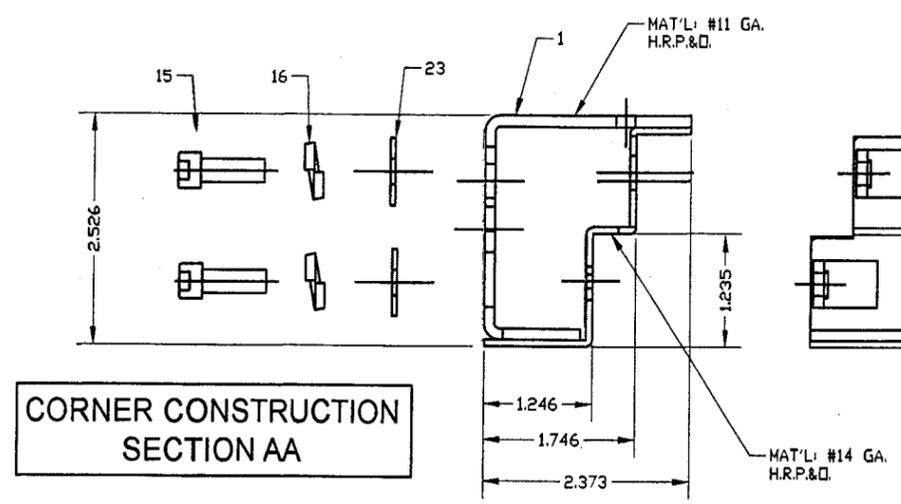

WINDOW INSTALLATION INSTRUCTION


- FASTEN (4) HORIZONTAL ASSEMBLIES TO (2) VERTICAL ASSEMBLIES (SEE SECTION 'A' - 'A')
- INSERT SPLICE/MULLION ASSEMBLY INTO FRAME END ASSEMBLY. (SEE SECTION 'F'-'F') TAP IN WITH A NON-METALLIC HAMMER. INSERT THE SECOND FRAME END ASSEMBLY INTO THE SPLICE/MULLIAN ASSEMBLY AND TAP IN WITH A NON-METALLIC HAMMER. INSTALL HORIZONTAL ASSEMBLIES BETWEEN THESE TWO SECTIONS. INSTALL SCREWS THROUGH THE FRAME ASSEMBLY INTO THE SPLICE/MULLIAN ASSEMBLY. TIGHTEN ALL SCREWS.
- FASTEN R.H. SIDE CLADDING TO BOTTOM CLADDING AND TOP CLADDING. SEE DETAIL 'B' AND DETAIL 'C'. REPEAT PROCEDURE WITH L.H. SIDE CLADDING. PLACE R.H. SIDE CLADDING ASSEMBLY AND L.H. SIDE CLADDING ASSEMBLY INTO FRAME ASSEMBLY. START SCREWS. INSTALL BOTTOM CLADDING & TOP CLADDING IN BETWEEN THESE ASSEMBLIES. ALIGN CLADDING SEAMS, FLUSH, AND TIGHTEN SCREWS. SEE DETAIL 'B' & 'C'
- FASTEN THE FRAME INTO THE OPENING, THROUGH THE FRAME MEMBERS. SHIM AS REQUIRED.
- APPLY NEOPRENE GASKET .12 X 1 AROUND BASE AREA OF WINDOW FRAME ON 4 SIDES (SEE DETAIL 'B'). APPLY NEOPRENE GASKET .12 X .44 TO RETAINER LIP ON 4 SIDES OF WINDOW FRAME AND TO INSIDE SPLICE/MULLION (SEE DETAIL 'B' & SECTION 'E-E'). INSERT (2) SCREWS THROUGH THE UPPER AND LOWER INSIDE SPLICE/MULLION CLAMP HOLES. INSTALL (2) CENTER BACKUP CLAMPS. DO NOT TIGHTEN. TURN IN ONLY 2 TO 3 TURNS (SEE VIEW 'D' - 'D'). POSITION (1) PIECE OF B.R. GLASS IN THE OPENING. APPLY RTV AROUND GLASS AND MULLION AS SHOWN ON SECTION 'E-E' & DETAIL 'C'. INSTALL (2) CENTER BACKUP CLAMP, THEN BRING THE OTHER END TIGHT TO THE LEFT HORIZONTAL CLAMPS, BY SLIPPING THE END OF THE CLAMP, INTO THE CENTER BACKUP CLAMP, THEN BRING THE OTHER END TIGHT TO THE LEFT SIDE CLADDING. INSTALL (5) SCREWS THROUGH THE FRAME, INTO THE CLAMP. DO NOT TIGHTEN. POSITION (1) VERTICAL CLAMP IN FRAME. INSTALL (4) SCREWS THROUGH THE FRAME, INTO THE CLAMP. DO NOT TIGHTEN (SEE DETAIL 'B'). POSITION SECOND PIECE OF GLASS AND REPEAT PROCEDURE. POSITION THIRD PIECE OF GLASS AND REPEAT PROCEDURE.

SLIDE NUT PLATE INTO MULLION OUTSIDE TO MAKE THE OUTSIDE MULLION ASSEMBLY (SEE SECTION 'E-E'). ALIGN STANDOFFS IN NUT PLATE, WITH OPENINGS IN REAR SPLICE/MULLIAN ASSEMBLY. INSTALL (4) SCREWS THROUGH INSIDE SPLICE/MULLION INTO OUTSIDE MULLION ASSEMBLY. DO NOT TIGHTEN. REPEAT FOR SECOND MULLION ASSEMBLY.

MEASURE AND CUT FRONT WINDOW GASKET, AND INSTALL AROUND THE 4 SIDES OF THE WINDOW OPENING BETWEEN THE CLAMPS AND MULLION, AND THE B.R. GLASS (SEE DETAIL 'B' & SECTION 'D-D'). TIGHTEN THE CLAMP AND MULLION SCREWS. TIGHTEN CENTER CLAMP SCREWS TO ALIGN THE CLAMPS AT THE CENTER JOINT. DO NOT OVER TIGHTEN.

CUT TOP SPLICE AND BOTTOM SPLICE TO FIT (SEE SECTION 'D-D'). APPLY RTV SEALANT TO UNDERSIDE OF TOP SPLICE AND BOTTOM SPLICE. CENTER SPLICES AND SNAP INTO PLACE. APPLY RTV SEALANT TO INSIDE OF (2) CENTER SPLICES. INSTALL CENTER SPLICES OVER CENTER GAPS IN CLAMPS. APPLY RTV SEALANT TO THE JOINT BETWEEN THE CENTER SPLICE AND THE OUTSIDE MULLION AS WELL AS THE JOINTS BETWEEN THE CENTER SPLICES AND THE TOP AND BOTTOM SPLICES.

- INSTALL DIEBOLD NAMEPLATE (21-004697-0000) SEE DETAIL 'G' DRILL AT INSTALLATION (2) .086 DIA. HOLES FOR SCREWS FURNISHED WITH KIT IT.#3.
- AFTER INSTALLATION, CAULK AROUND THE OUTSIDE OF THE WINDOW, WHERE THE FRAME ASSEMBLY CONTACTS THE BUILDING WALL. CAULK THE CORNER JOINTS WHERE THE VERTICAL AND HORIZONTAL FRAME CONNECT.

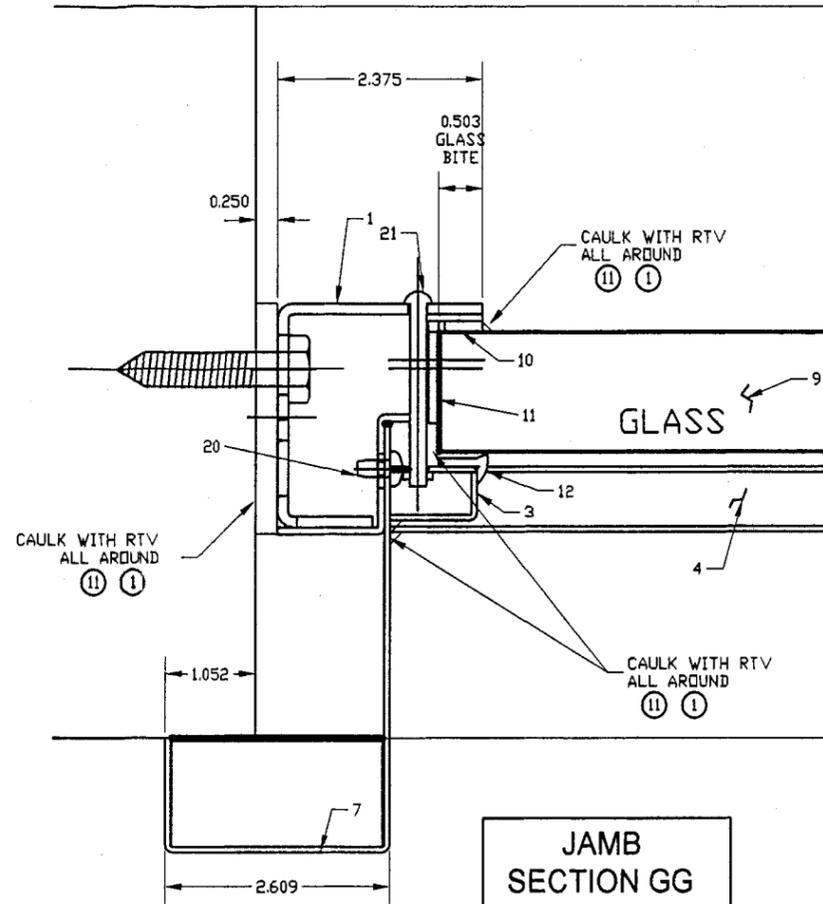

BILL OF MATERIALS

QTY.	FIND NO.	PART NUMBER	DESCRIPTION
2	1	31-018558-000B	VERTICAL ASSY - 2.38' X 2.53' X 35.9' - # 14 GA & # 11 GA - ASTM A569 - H.R.P. & D. STL
6	2	31-018555-000B	HORIZONTAL ASSY - 5' - 2.38' X 2.53' X 63.75' - #14 GA & # 11 GA - ASTM A569 - H.R.P. & D. STL.
2	3	31-018561-000C	VERTICAL CLAMP DELUX - 1.0' X .39' X 31.2' - #16 GA. ASTM A480 STN. STL.
6	4	31-018563-000C	HORIZONTAL CLAMP 5' DELUX - 1.0' X .72' X 63.6' - # 16 GA. ASTM A480 STN. STL.
3	5	31-018551-000A	BOTTOM CLADDING 5' DELUX - 3.0' X 5.1' X 63.6' #16 GA. ASTM A480 STN. STL.
3	6	31-018549-000A	TOP CLADDING 5' DELUX - 3.0' X 2.81' X 63.6' - #16 GA. ASTM A480 STN. STL.
1	7	41-015421-000A	LEFT SIDE CLADDING - 5.39' X 2.61' X 39.84' - #16 GA. ASTM A480 STN. STL.
1	8	41-015422-000A	RIGHT SIDE CLADDING - 5.39' X 2.61' X 39.84' - #16 GA. ASTM A480 STN. STL.
3	9	41-016078-000A	1 3/16" B.R. WINDOW 32.0' X 62.5' X 1 3/16" (SEE SHEET 2 OF 4)
49 ft.	10	89-002116-0068	NPRNE GASKET .12' X .44'
49 ft.	11	89-012128-0068	NPRNE GASKET .12' X 1'
49 ft.	12	89-003360-0068	GASKET(FRONT OF WINDOW)
1	13	21-004697-0000	NAMEPLATE (DIEBOLD) - 1' X 4' X .062 THICK
2	14	31-019431-000A	SEAL - 1.3' X 1.75' X 36.13' - 7.4# PVC MULTIFOAM
8	15	-	SOCKET HEAD 25 - 20 X .75 - BLACK OXIDE
8	16	-	LOCKWASHER 1/4 HEL. SPRING - ZINC
12	17	-	HEX HEAD MS #10 HEL. SPR. - ZINC
12	18	-	LOCKWASHER #10 HEL. SPR. - ZINC
12	19	-	FLATWASHER #10 SAE - ZINC
66	20	-	PHIL PAN HEAD TYPE B #10-.38 - ZINC
54	21	-	TR. HEAD MS 10-32 X 2' PHIL. - BLACK OXIDE
8	22	-	TR. HEAD MS 6-32 X 1.25' PHIL - BLACK OXIDE
8	23	-	FLATWASHER 1/4 TYPE 'B' ZINC
2	24	-	RD. HEAD DRIVE SCREW TYPE-U #2 X 3/16
2	25	21-017828-000A	SPLICE TOP - 2.71' X 3.05' X 2.0' - #24 GA. ASTM A480 STN. STL.
2	26	21-017829-000A	SPLICE BOTTOM - 5.04' X 3.05' X 2.0' #24 GA. ASTM A480 STN. STL.
4	27	11-037320-000A	CENTER BACKUP CLAMP - .51' X .88' X 2.0' - #16 GA. ASTM A480 STN. STL.
4	28	11-037319-000B	CENTER SPLICE - 1.1' X .84' X 2.0' - #24 GA. ASTM A480 STN. STL.
2	29	31-018564-000A	SPLICE ASSY - 2.27' X 9.0' X 35.88' - #14 GA & # 11 GA - ASTM A569 - H.R.P. & D. STL.
2	30	21-017832-000A	MULLIAN OUTSIDE - .15' X 2.0' X 31.18' - #20 GA. ASTM 480 STN. STL.
2	31	21-017833-000A	NUT PLATE - MULLIAN - .06' X 1.85' X 31.13' - #16 GA. ASTM A569 - H.R.P. & D. STL.
1	32	41-018801-000C	HURRICANE SILL PLATE KIT,15 FT

MANUFACTURER:

DIEBOLD
INCORPORATED

818 MULBERRY ROAD SE
CANTON, OH - 44707
TEL.: (800) 456-1286
FAX: (330) 489-4140

PRODUCT:
**Series "Bullet
Resistant Drive-Up"
Steel Fixed
Window**

Engineering:
EngCo Inc.

CA 8116
6971 W. SUNRISE BLVD. 104
PLANTATION, FL. 33313
TEL.: (954) 585-0304
FAX.: (954) 585-0305

FEB 12 2007

Engineer Seal
Pedro De Figueiredo
PE 52609

Date: 1/24/07
Scale: NA
Design by: PPMF

PRODUCT CONTROL DIVISION:

PRODUCT REVISED
on complying with the Florida
Building Code
Acceptance No. 07-0214-13
Expiration Date DEC. 24, 2007
By: *M. J. [Signature]*
Product Control
Division

Drawing Number
07-023

Sheet
4 of 4