



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
 PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
 METRO-DADE FLAGLER BUILDING  
 140 WEST FLAGLER STREET, SUITE 1603  
 MIAMI, FLORIDA 33130-1563  
 (305) 375-2901 FAX (305) 375-2908

[www.buldingcodeonline.com](http://www.buldingcodeonline.com)

**NOTICE OF ACCEPTANCE (NOA)**

**Weather Shield Manufacturing, Inc.**  
**One Weather Shield Plaza**  
**Medford, WI 54451**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "Contempra TFT" Outswing Aluminum Clad Wood Casement Window – LMI**

**APPROVAL DOCUMENT:** Drawing No. 1052, titled "Contempra TFT Outswing Casement Window", sheets 1 through 4 of 4, dated 06/06/01, prepared by W.W. Schaeffer Engineering & Consulting, P.A, signed and sealed by Warren W. Schaefer, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews** NOA # 01-0831.02 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



*Manuel Perez*

NOA No 07-0301.03  
 Expiration Date: April 15, 2008  
 Approval Date: May 3, 2007  
 Page 1

Weather Shield Manufacturing, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No. **1052**, titled "Contempra TFT Outswing Casement Window", sheets 1 through 4 of 4, dated 06/06/01, prepared by W.W. Schaeffer Engineering & Consulting, P.A, signed and sealed by Warren W. Schaefer, P.E.

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per TAS 202-94.  
3) Water Resistance Test, per TAS 202-94.  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with the manufacturer's parts drawings, installation diagram and marked-up drawings of a wood operable casement window prepared by Hurricane Test Laboratory, Inc. Test Report No. **HTL-0037-0305-00**, dated 03/02/00 with addendum letter dated 12/26/01, all signed and sealed by Vinu J. Abraham, P.E..
2. Test reports on: 1) Large Missile Impact Test per SFBC, PA 201-94  
2) Cyclic Wind Pressure Loading per SFBC, PA 203-94  
along with the manufacturer's parts drawings, installation diagram and marked-up drawings of a wood operable casement window prepared by Hurricane Test Laboratory, Inc. Test Report No. **HTL-0037-0209-98**, dated 03/10/98, signed and sealed by Timothy S. Marshall, P.E. (*Test submitted as reference for side-by-side installation*)
3. Test reports on: 1) Large Missile Impact Test per SFBC, PA 201-94  
2) Cyclic Wind Pressure Loading per SFBC, PA 203-94  
along with the manufacturer's parts drawings, installation diagram and marked-up drawings of a wood operable casement window prepared by Hurricane Test Laboratory, Inc. Test Report No. **HTL-0037-0304-98**, dated 03/05/98, signed and sealed by Timothy S. Marshall, P.E. (*Test submitted under original file No. 98-0728.06*)
4. Test reports on: 1) Uniform Load Static Air Pressure Test, per PA 202-94.  
along with the manufacturer's parts and section drawings marked-up by Architectural Testing, Inc., Test Report No. **ATI-20304-N**, prepared by Architectural Testing, Inc., dated 06/19/97, signed and sealed by Allen N. Reeves, P.E.

  
Manuel Perez, P.E.  
Product Control Examiner

NOA No 07-0301-03

Expiration Date: April 15, 2008

Approval Date: May 3, 2007

Weather Shield Manufacturing, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC-2004, dated 06/28/05, prepared by W.W. Schaefer & Consulting P.A., signed and sealed by Warren W. Schaefer, P.E. **Complies with ASTM E1300-98**
2. Anchor calculations and structural analysis, dated 06/06/01, prepared by W.W. Schaeffer Engineering & Consulting, P.A., signed and sealed by Warren Schaeffer, P.E.  
*(Submitted under NOA # 01-0831.02)*

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **01-0205.02** issued to Solutia Inc. for their "Saflex /Keepsafe Maximum" dated 05/17/01, expiring on 05/21/06.
2. Notice of Acceptance No. **04-0115.01**, issued to Viracon, Inc. for their "HRG-2 Laminated Glass", approved on 02/12/04 and expiring on 02/12/09.
3. Notice of Acceptance No. **03-0421.01** issued to Solutia Inc. for their "Saflex HP" dated 05/22/03, expiring on 04/14/08.

**F. STATEMENTS**

1. Statement letter of conformance, dated June 8, 2001, signed and sealed by Warren W. Schaefer, P.E.
2. Statement letter of no financial interest, dated June 8, 2001, signed and sealed by Warren W. Schaefer, P.E.
3. Statement letter from manufacturer stating that the product has not changed and requesting a One-Year Renewal to allow the time to perform a verification test, dated February 15, 2007, signed by Sue Schreiber, Testing & Certification Coordinator.
4. Letter from laboratory confirming manufacturer has contracted and scheduled verification tests, issued by Stork Twin City Testing Corporation, dated February 9, 2007, signed by John Bordagaray.

**G. OTHER**

1. Notice of Acceptance No. **01-0831.02**, issued to Weather Shield Manufacturing, Inc. their Series "Contempra TFT" Outswing Aluminum Clad Wood Casement Window - Impact, approved on 12/26/02 and expiring on 04/15/07.




Manuel Perez, P.E.  
Product Control Examiner  
NOA No 07-0301.03


Expiration Date: April 15, 2008

Approval Date: May 3, 2007


DRAWN BY: W.W.S.	CHECKED BY: W.W.S.
PLOT: 1=16	DATE: 06/06/01
NO.	REVISION DESCRIPTION

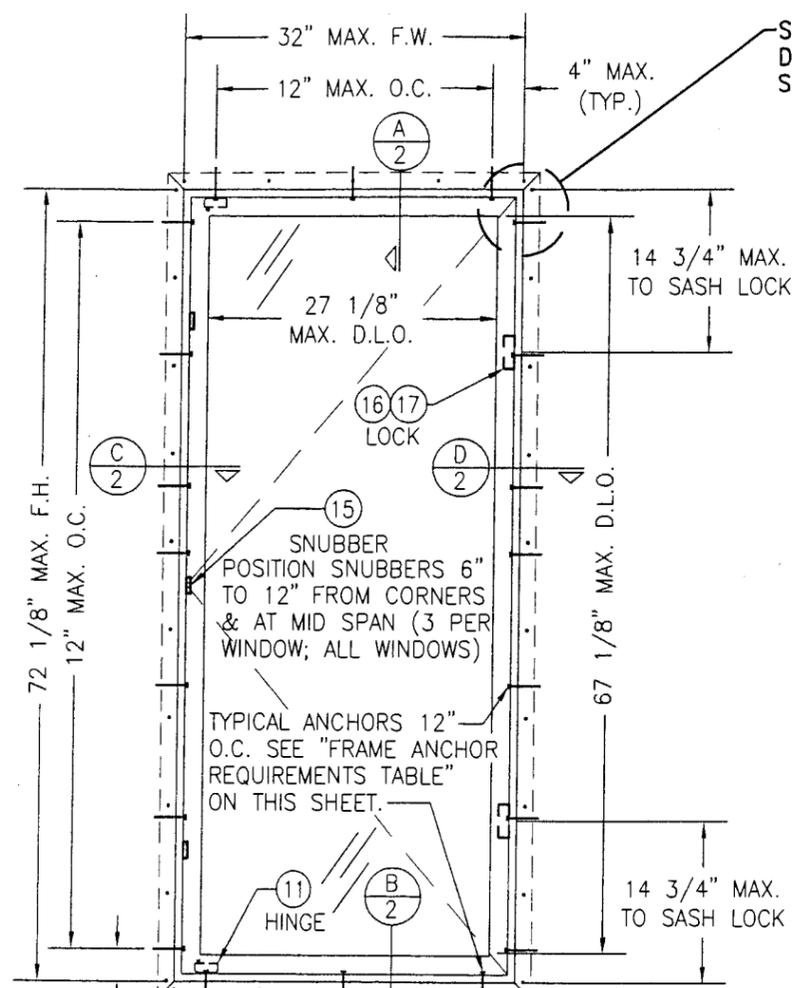

**EXTERIOR ELEVATION  
SINGLE VENTED CASEMENT**  
(32" MAXIMUM WINDOW WIDTH)

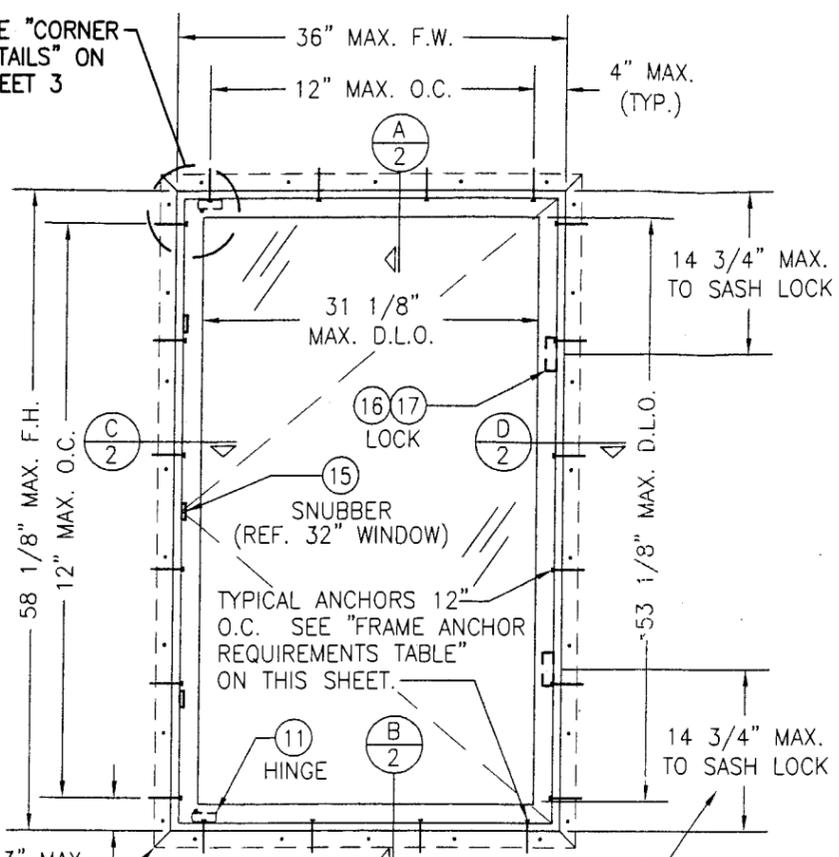

**EXTERIOR ELEVATION  
SINGLE VENTED CASEMENT**  
(36" MAXIMUM WINDOW WIDTH)

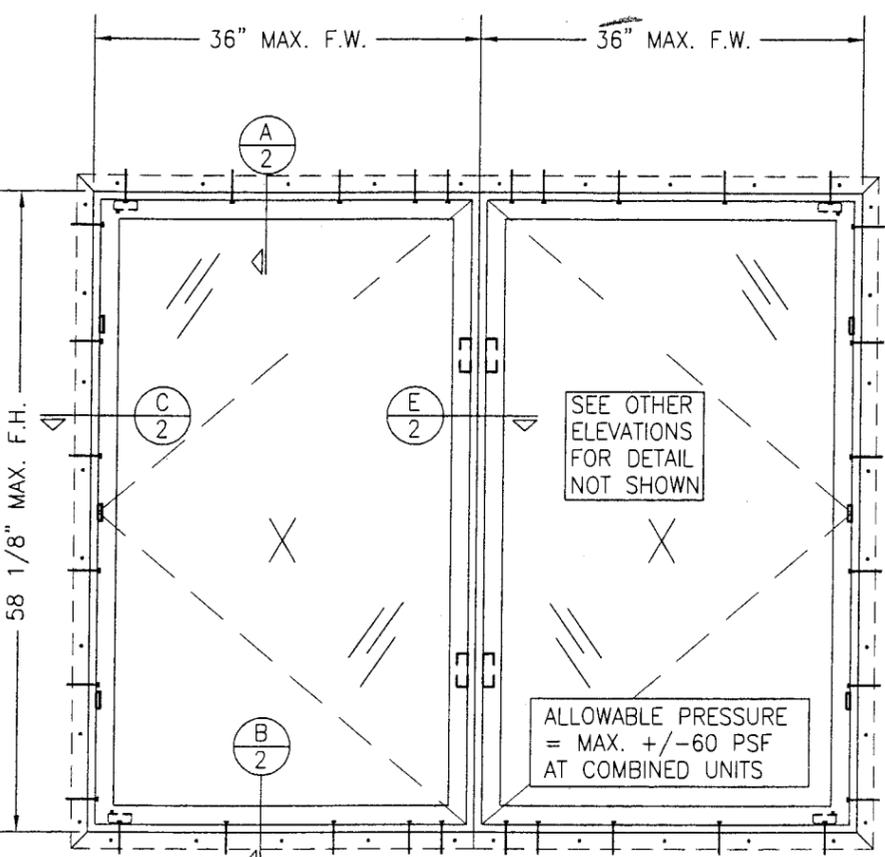

**EXTERIOR ELEVATION  
MULTIPLE VENTED CASEMENTS**  
(MAX. FOUR UNITS MAY BE COMBINED)

SEE OTHER ELEVATIONS FOR DETAIL NOT SHOWN

ALLOWABLE PRESSURE = MAX. +/-60 PSF AT COMBINED UNITS

NAILING FIN IS OPTIONAL & MAY BE SCORED & REMOVED WHEN REQUIRED FOR A DIRECT MOUNT CONDITION.

SASH LOCKS MOVE CLOSER TO THE FRAME CORNER WHEN THE WINDOW FRAME HEIGHT (F.H.) IS LESS THAN 48"

FOR ALLOWABLE DESIGN WIND PRESSURE ON SINGLE WINDOWS, SEE LOAD TABLES ON SHEET 4.

**IMPACT RESISTANT WINDOWS  
SHUTTERS NOT REQUIRED**

- NOTES**
1. THIS STRUCTURE IS DESIGNED AS PER THE FLORIDA BUILDING CODE (FBC).
  2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
  3. ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
  4. ANCHORING OR LOADING CONDITION NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

FRAME ANCHOR REQUIREMENTS TABLE			
OPENING TYPE (SUBSTRATE)	JAMB TO OPENING FASTENER TYPE	MINIMUM EMBEDMENT	MINIMUM EDGE DIST.
2X_ WOOD FRAME OR BUCK	NO. 10 SMS SCREW	1 3/8"	1"
CMU/CONCRETE	3/16" TAPCON	1 1/4"	2"

**ANCHOR NOTE:** FRAME MAY BE EITHER DIRECT MOUNTED TO THE OPENING, MOUNTED ONTO A 1X4 P.T. CONTINUOUS SPACER, OR ANCHORED TO A MIN. 2X4 NO. 2 SOUTHERN PINE WOOD BUCK. WHEN ANCHORED TO A 2X4 BUCK, NO. 10 SCREWS SHALL BE USED. WHEN DIRECT MOUNTED OR MOUNTED WITH SPACER, 3/16" TAPCONS SHALL BE USED. SEE "ANCHOR REQUIREMENTS TABLE" FOR EMBED REQUIREMENTS. PROPER MATERIAL SHALL BE USED BETWEEN ALL DISIMILAR MATERIALS (BLOCK/CONCRETE & ALUMINUM).

- MULTIPLE UNIT NOTES:**
1. COMBINED OPERABLE CASEMENTS ARE RESTRICTED TO THE MAX. FRAME HEIGHT & WIDTH SHOWN AND MAY NOT EXCEED THE MAX. DIMENSIONS SHOWN.
  2. THE MAXIMUM ALLOWABLE PRESSURE FOR A COMBINED UNIT IS RESTRICTED BY THE LESSER OF THE INDIVIDUAL WINDOW ALLOWABLE PRESSURE OR +/-60 PSF UNLESS A CLIPPED MULLION IS USED PER WEATHERSHIELD'S MULLION APPROVAL.
  3. FOR OPERABLE CASEMENT MULLED TO A FIXED CASEMENT/PICTURE WINDOW, SEE "FIXED CASEMENT WINDOW" DRAWING NO. 1053 UNDER SEPERATE APPROVAL.
  4. FOR CLIPPED MULLION COMBINATIONS, SEE DRAWINGS NO. M96-05 & M96-06 UNDER SEPERATE APPROVAL.

**PRODUCT RENEWED**  
as complying with the Florida Building Code  
Acceptance No. 07-0301.03  
Expiration Date APRIL 15, 2008  
By *Manuel Perez*  
Miami Dade Product Control Division

Approved as complying with the Florida Building Code  
Date DEC. 26, 2002  
NO. 01.0831.02  
Miami Dade Product Control Division  
By *Manuel Perez*




DRAWING TITLE: 'CONTEMPRA' TFT OUTSWING CASEMENT WINDOW

CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.  
600 SANDTREE DRIVE, SUITE 203B  
PALM BEACH GARDENS, FL 33403  
PHONE: 561-775-4902 FAX: 561-775-4903

MANUFACTURER: WEATHER SHIELD WINDOWS & DOORS  
ONE WEATHER SHIELD PLAZA  
MEDFORD, WI 54451  
715-748-6555

CERTIFICATION  
SEP 20 2002  
WARREN W. SCHAEFER, P.E.  
P.E. NO. 44155


DRAWING NO. 1052  
SHEET NO. 1 OF 4

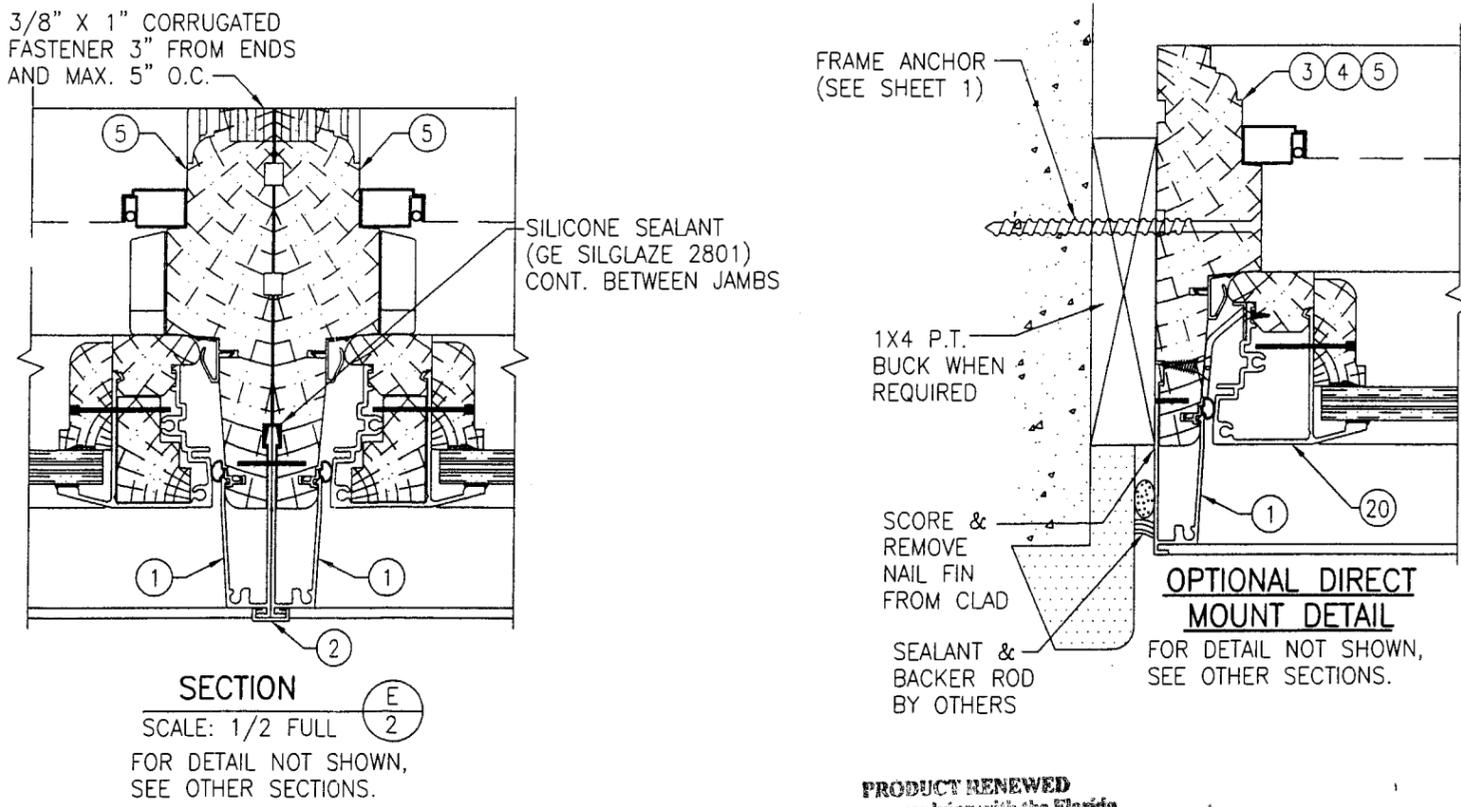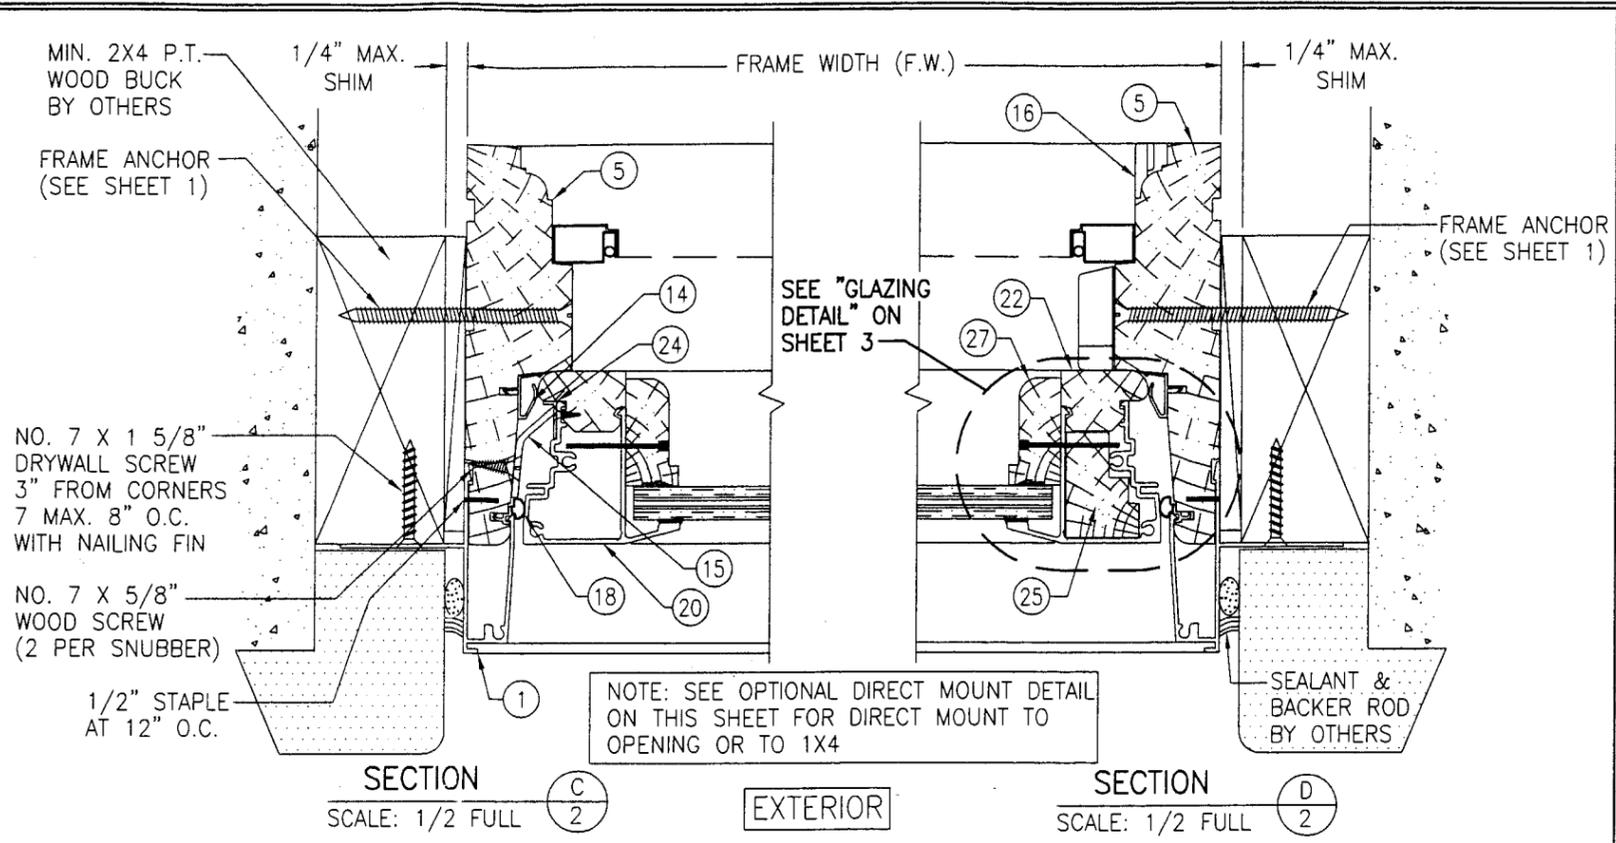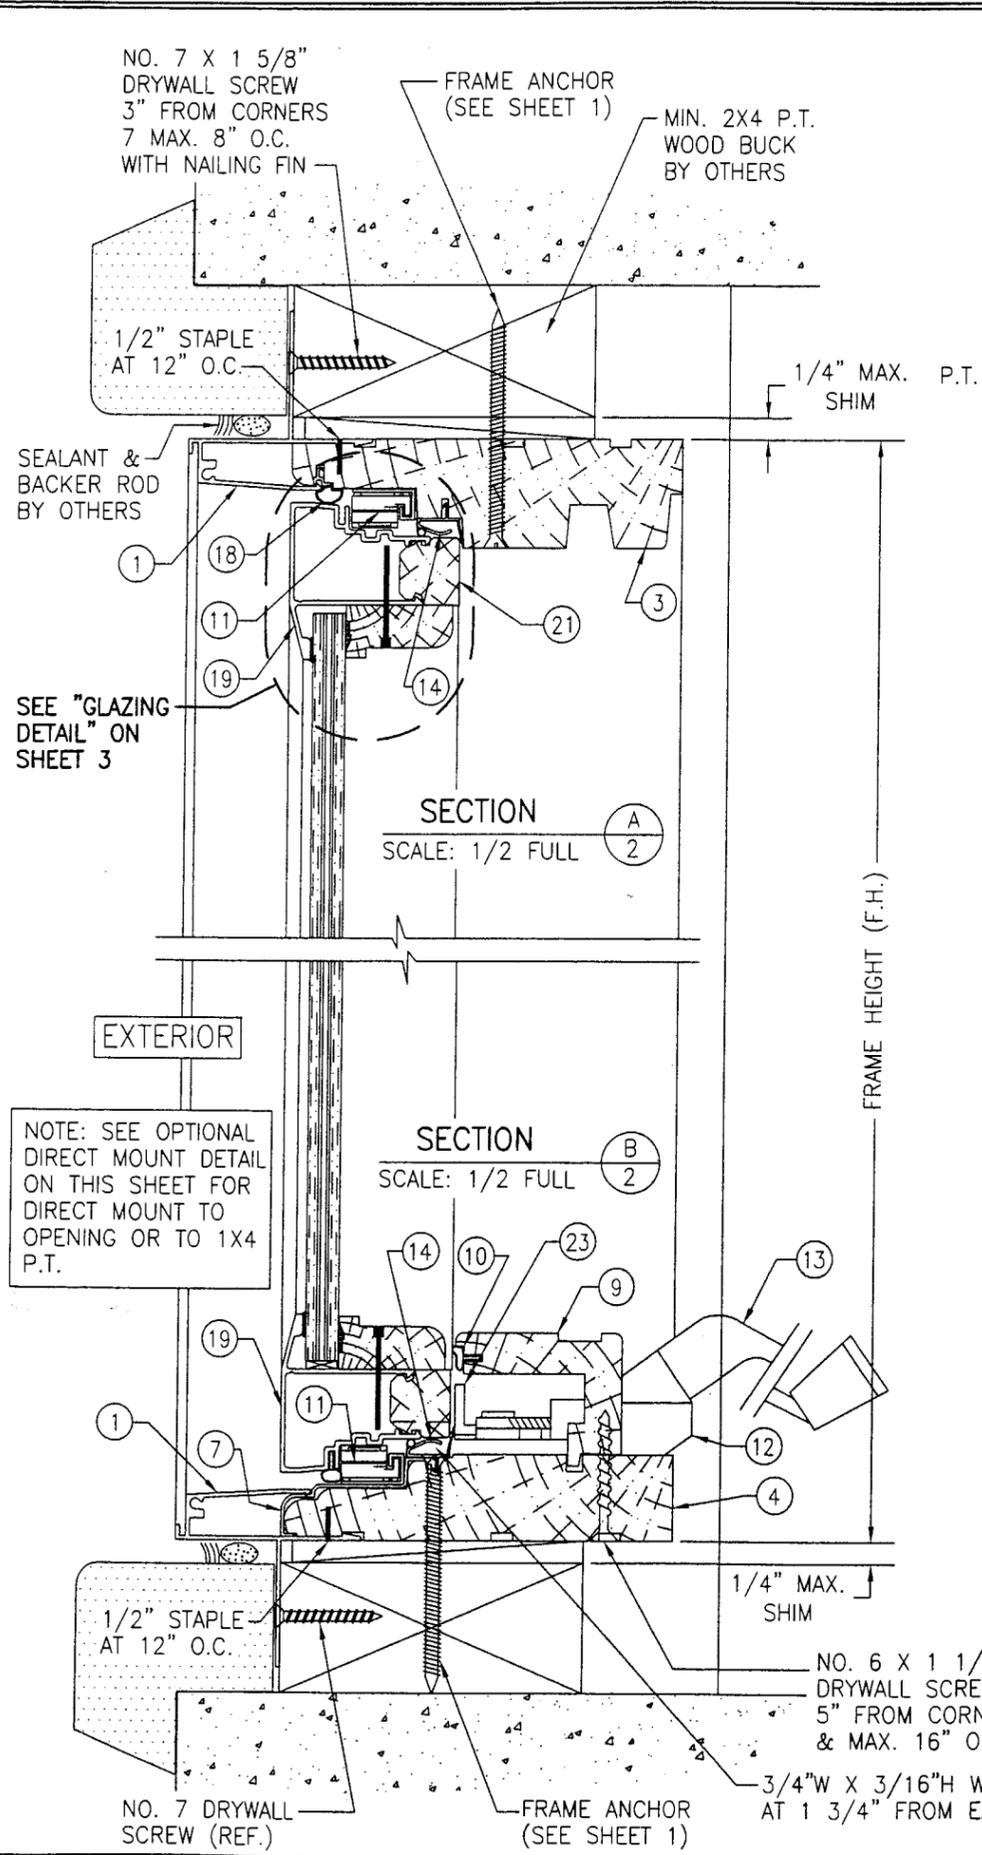


**PRODUCT RENEWED**  
 as complying with the Florida Building Code  
 Acceptance No. 07-0301-03  
 Expiration Date APRIL 15, 2008

Approved as complying with the Florida Building Code  
 Date DEC. 26, 2002  
 NOAH 01.0831.02  
 Miami Dade Product Control Division  
 By *Manuel Perez*


DRAWN BY: W.W.S.	CHECKED BY: W.W.S.
PLOT: 1=2	DATE: 06/06/01
DATE	
BY	
REVISION DESCRIPTION	
NO.	
DRAWING TITLE <b>'CONTEMPRA' TFT OUTSWING CASEMENT WINDOW</b>	
CONSULTANTS <b>W. W. SCHAEFER ENGINEERING &amp; CONSULTING, P.A.</b> 600 SANDTREE DRIVE, SUITE 203B PALM BEACH GARDENS, FL 33403 PHONE: 561-775-4902 FAX: 561-775-4903	
MANUFACTURER <b>WEATHER SHIELD WINDOWS &amp; DOORS</b> ONE WEATHER SHIELD PLAZA MEDFORD, WI 54451 715-748-6555	
CERTIFICATION <b>SEP 20 2002</b>	WARREN W. SCHAEFER, P.E. P.E. NO. 44135
DRAWING NO. <b>1052</b>	REV.
SHEET NO. <b>2</b>	OF <b>4</b>

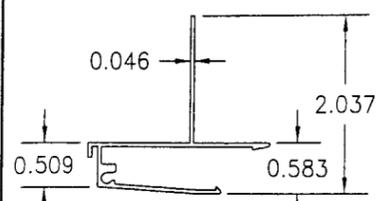

① JAMB CLAD

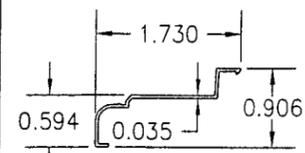


⑦ SILL CLAD




⑳ GLASS STOP




② MULLION CLIP

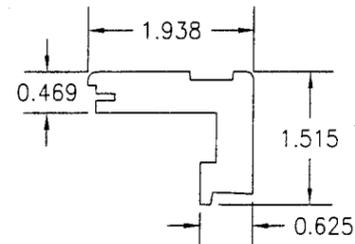


⑨ SILL OPERATOR COVER

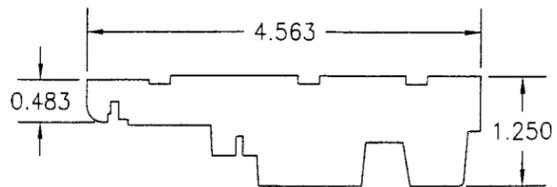


③ FRAME HEAD JAMB

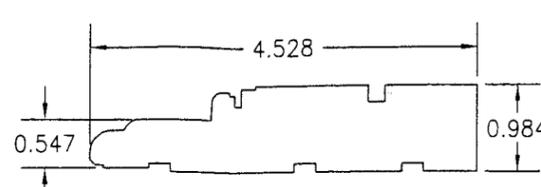


④ FRAME SILL

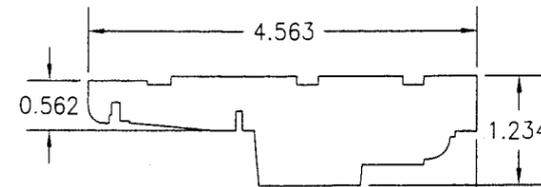


⑤ FRAME SIDE JAMB




⑱ SASH RAIL COVER




⑳ SASH STILE COVER




㉑ SASH RAIL

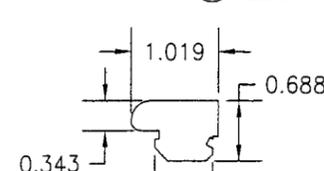


㉒ SASH STILE

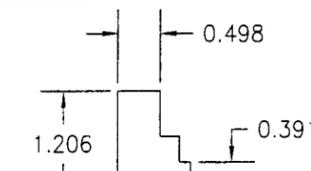

㉕ SASH REINFORCEMENT

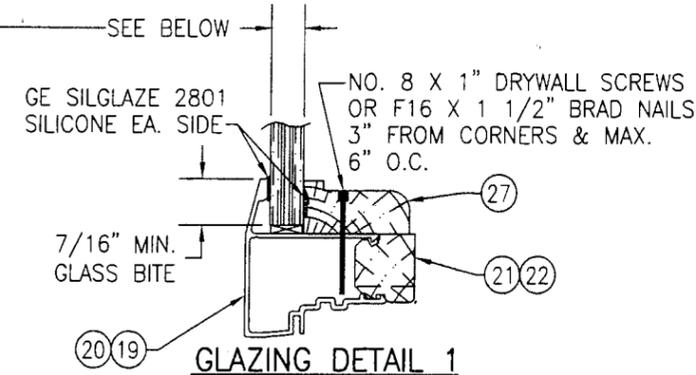


GLAZING DETAIL 1

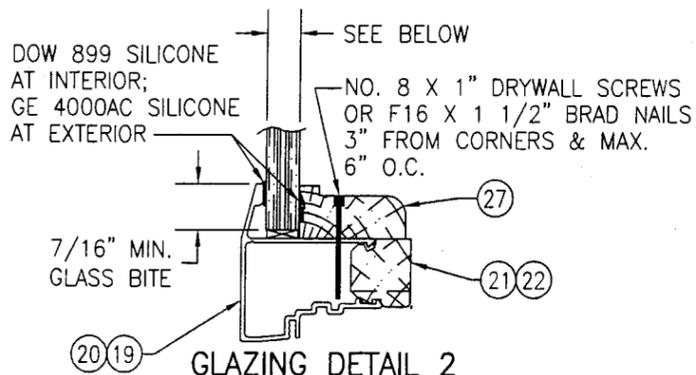

GLAZING DETAIL 2


GLAZING OPTIONS (TYP. FOR DETAIL 1 & 2):

- GLAZING OPTION 1) 3/8" THK. GLOBE AMERADA P380 (1/8" CHEM TEM/0.035 URETHANE/1/16" POLY CARBONATE/0.035 URETHANE/1/8" CHEM TEM)
- GLAZING OPTION 2) 7/16" THK. GLOBE AMERADA L716 WIND-PANE (3/16" CHEM TEM/0.09 MONSANTO SAFLEX PVB/3/16" CHEM TEM)
- GLAZING OPTION 3) 7/16" THK. SOLUTIA SAFLEX (3/16" AN/0.09 SOLUTIA SAFLEX PVB/3/16" AN)

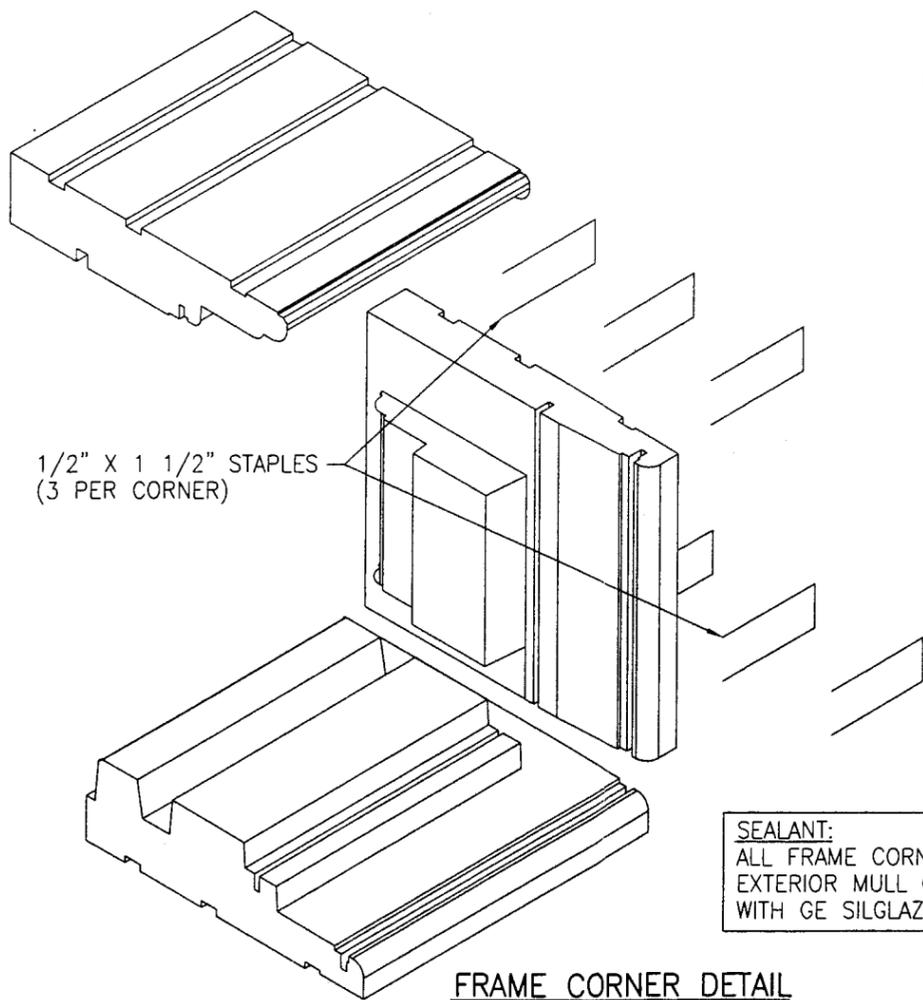

FRAME CORNER DETAIL

SEALANT:  
ALL FRAME CORNERS, JOINTS &  
EXTERIOR MULL CLIP SEALED  
WITH GE SILGLAZE 2801

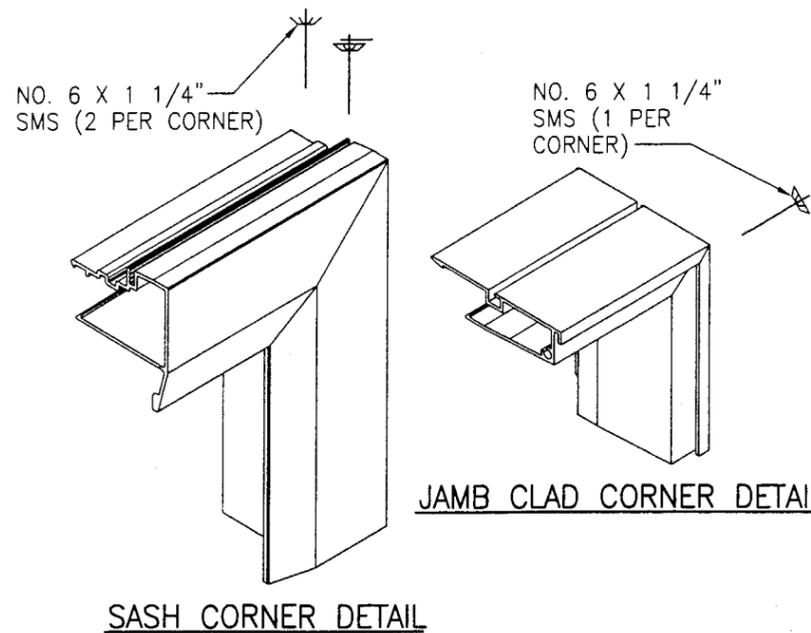

SASH CORNER DETAIL

JAMB CLAD CORNER DETAIL

DRAWN BY: W.W.S.		CHECKED BY: W.W.S.	
PLOT: 1=2		DATE: 06/06/01	
NO.	REVISION DESCRIPTION	BY	DATE
DRAWING TITLE <b>'CONTEMPRA' TFT OUTSWING CASEMENT WINDOW</b>			
CONSULTANTS <b>W. W. SCHAEFER ENGINEERING &amp; CONSULTING, P.A.</b>		MANUFACTURER <b>WEATHER SHIELD WINDOWS &amp; DOORS</b>	
600 SANDTREE DRIVE, SUITE 203B PALM BEACH GARDENS, FL 33403 PHONE: 561-775-4902 FAX: 561-775-4903		ONE WEATHER SHIELD PLAZA MEDFORD, WI 54451 715-748-6555	
CERTIFICATION <b>SEP 20 2002</b>	WARREN W. SCHAEFER, P.E. P.E. NO. 44135		
DRAWING NO. <b>1052</b>	REV.		
SHEET NO. <b>3</b>	OF <b>4</b>		

PRODUCT RENEWED  
as complying with the Florida  
Building Code  
Approval No. **07-0301.03**  
Expiration Date **APRIL 15, 2008**  
By *Manuel Perez*  
Miami Dade Product Control

Approved as complying with the  
Florida Building Code  
Date **DEC. 26, 2002**  
NOAH **01-0831.02**  
Miami Dade Product Control  
Division  
By *Manuel Perez*

DESIGN LOAD CAPACITY - PSF (FOR GLAZING DETAILS 1 & 2 AND GLAZING OPTIONS 1 & 2)			
WINDOW DIMENSIONS		POSITIVE (PSF)	NEGATIVE (PSF)
WIDTH	HEIGHT		
20"	24-1/8"	60.0	85.0
24"		60.0	85.0
28"		60.0	85.0
32"		60.0	75.0
36"		60.0	75.0
20"	28-1/8"	60.0	85.0
24"		60.0	85.0
28"		60.0	85.0
32"		60.0	75.0
36"		60.0	75.0
20"	32-1/8"	60.0	85.0
24"		60.0	85.0
28"		60.0	85.0
32"		60.0	75.0
36"		60.0	75.0
20"	36-1/8"	60.0	85.0
24"		60.0	85.0
28"		60.0	85.0
32"		60.0	75.0
36"		60.0	75.0
20"	40-1/8"	60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"		60.0	75.0
36"		60.0	75.0
20"	44-1/8"	60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"		60.0	75.0
36"		60.0	75.0
20"	48-1/8"	60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"		60.0	75.0
36"		60.0	75.0
20"	54-1/8"	60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"		60.0	75.0
36"		60.0	75.0
20"	58-1/8"	60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"		60.0	75.0
36"		60.0	75.0
16"	62-1/8"	60.0	75.0
20"		60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"	60.0	75.0	
16"	72-1/8"	60.0	75.0
20"		60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"	60.0	75.0	

DESIGN LOAD CAPACITY - PSF (FOR GLAZING DETAILS 1 & 2 AND GLAZING OPTION 3)			
WINDOW DIMENSIONS		POSITIVE (PSF)	NEGATIVE (PSF)
WIDTH	HEIGHT		
20"	24-1/8"	60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"		60.0	75.0
36"		60.0	75.0
20"	28-1/8"	60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"		60.0	75.0
36"		60.0	75.0
20"	32-1/8"	60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"		60.0	75.0
36"		60.0	75.0
20"	36-1/8"	60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"		60.0	75.0
36"		60.0	75.0
20"	40-1/8"	60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"		60.0	75.0
36"		60.0	75.0
20"	44-1/8"	60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"		60.0	75.0
36"		60.0	75.0
20"	48-1/8"	60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"		60.0	75.0
36"		60.0	75.0
20"	54-1/8"	60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"		60.0	75.0
36"		60.0	75.0
20"	58-1/8"	60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"		60.0	75.0
36"		60.0	75.0
16"	62-1/8"	60.0	75.0
20"		60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"	60.0	75.0	
16"	72-1/8"	60.0	75.0
20"		60.0	75.0
24"		60.0	75.0
28"		60.0	75.0
32"	60.0	75.0	

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./REMARKS
1	900508	4	HEAD, SILL & SIDE JAMB CLAD (TFT)	6063-T5 ALUMINUM	CAPITOL
2	780959	1	CONTINUOUS MULLION CLIP	6063-T5 ALUMINUM	CAPITOL
3	310003	1	HEAD JAMB	* WOOD	WEATHER SHIELD
4	310004	1	SILL	* WOOD	WEATHERSHIELD
5	310021	2	SIDE JAMBS	* WOOD	WEATHER SHIELD
7	969911	1	SILL CLAD	6063-T5 ALUMINUM	CAPITOL
9	314709	1	OPERATOR COVER	-	WEATHER SHIELD
10	760068	1	OPERATOR COVER WEATHER STRIP	-	WEATHER SHIELD
11	900528C	2	HINGE AT TOP AND BOTTOM RAIL	-	TRUTH
12	900526D	1	SPLIT ARM OPERATOR	-	TRUTH
13	900526D	1	OPERATOR HANDLE	-	TRUTH
14	7600611	4	WEATHER STRIP	-	AMESBURY
15	980727	3	INT. SASH SNUBBER	-	MITCHELL METAL
16	900527C	2	SASH LOCK AT MAX. 14-3/4" FROM TOP & BOTTOM	ZINC CHRMT'D STEEL	TRUTH
17	900527C	2	KEEPERS AT LOCK LOCATIONS	ZINC CHRMT'D STEEL	TRUTH
18	760013	3	HEAD & SIDE JAMB WEATHER STRIP	VINYL	WEATHER SHIELD
19	969378	2	SASH RAIL COVER	6063-T5 ALUMINUM	CAPITOL
20	969381	2	SASH STILE COVER	6063-T5 ALUMINUM	CAPITOL
21	-	2	SASH RAIL	* WOOD	WEATHER SHIELD
22	-	2	SASH STILE	* WOOD	WEATHER SHIELD
23	972010	1	SASH BRACKET	-	TRUTH
24	972524	3	SASH SNUBBER RETAINER	-	WEATHER SHIELD
25	91412	1	SASH REINFORCEMENT	* WOOD	WEATHER SHIELD
27	-	4/SASH	GLASS STOP	* WOOD	WEATHER SHIELD

\* WOOD USED WITH TEST UNITS WAS PONDEROSA PINE. ALTERNATE WOOD SPECIES TO BE APPLICABLE WITH THESE WINDOWS IS MIN. GRADE 2 MAHOGANY, SOUTHERN PINE, OAK, CHERRY, MAPLE, DOUGLAS FIR & CYPRUS.

DRAWN BY: W.W.S. PLOT: 1=2	CHECKED BY: W.W.S. DATE: 06/06/01
DATE BY REVISION DESCRIPTION NO.	'CONTEMPRA' TFT OUTSWING CASEMENT WINDOW MANUFACTURER WEATHER SHIELD WINDOWS & DOORS ONE WEATHER SHIELD PLAZA MEDFORD, WI 54451 715-748-6555
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 600 SANDTREE DRIVE, SUITE 203B PALM BEACH GARDENS, FL 33403 PHONE: 561-775-4902 FAX: 561-775-4903	CERTIFICATION SEP 20 2002 WARREN W. SCHAEFER, P.E. P.E. NO. 44135
PRODUCT RENEWED as complying with the Florida Building Code Acceptance No. 07-0301.03 Expiration Date APRIL 15, 2008 By: <i>Manuel Perez</i> Miami Dade Product Control Division	Approved as complying with the Florida Building Code Date DEC. 26, 2002 NOA# 01-0831.02 Miami Dade Product Control Division By: <i>Manuel Perez</i>
DRAWING NO. 1052	REV. SHEET NO. 4 OF 4