



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**NOTICE OF ACCEPTANCE (NOA)**

[www.buldingcodeonline.com](http://www.buldingcodeonline.com)

**TRACO Security Windows and Doors, Inc.**

71 Progress Avenue  
Cranberry Township, PA 16066

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series 2100 Aluminum Fixed Window**

**APPROVAL DOCUMENT:** Drawing No. **04-113-0003**, titled "Series 2100 Aluminum Fixed Window - Non-Impact Resistant", sheets 1 through 3 of 3, dated 05/03/04 with revision "4" dated 12/09/05, prepared by Frank L. Bennardo, P.E., Inc. Consulting Engineers, signed and sealed by Frank L. Bennardo, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: None**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name:

<b>TRACO</b>	<b>TRACO</b>	<b>Security (TRACO)</b>
71 Progress Avenue	2304 Silverdale Road	5100 N.W. 72 <sup>nd</sup> Avenue
Cranberry Township, PA 16066	Johnson City, TN 37601	Miami, FL 33166

and the following statement: "Miami-Dade County Product Control Approved".

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 05-0812.03** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 07-0309.01  
Expiration Date: April 25, 2008  
Approval Date: May 10, 2007  
Page 1

**TRACO Security Windows and Doors, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **04-113-0003**, Sheets 1 through 3 of 3, titled "Series 2100 Aluminum Fixed Window - Non-Impact Resistant", dated 05/03/04 with revision "4" dated 12/09/05, prepared by Frank L. Bennardo, P.E. Consulting Engineers, signed and sealed by Frank L. Bennardo, P.E.

**B. TESTS**

1. Test report on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading FBC, TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
along with installation diagram of a series "2100 Aluminum Fixed Window" aluminum fixed picture window prepared by Fenestration Testing Laboratory, Inc., report No. **FTL-1298**, dated September 26, 1995, signed and sealed by Jamil Kuri, P.E.  
*(Submitted under NOA # 04-0819.01)*
2. Test report on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading FBC, TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
along with installation diagram of a series "2100 Aluminum Fixed Window" aluminum fixed picture window prepared by Fenestration Testing Laboratory, Inc., report No. **FTL-1228**, File No. 95-128, dated September 27, 1995, signed and sealed by Yamil Kuri, P.E.  
*(Submitted under NOA # 04-0819.01)*
3. Test report on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading FBC, TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
along with installation diagram of a series "2100 Aluminum Fixed Window" aluminum fixed picture window prepared by Farabaugh Engineering and Testing, Inc., report No. **FET-04004**, dated March 10, 2004, signed and sealed by Daniel G. Farabaugh, P.E.  
*(Submitted under NOA # 04-0819.01)*

  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 07-0309.01

Expiration Date: April 25, 2008  
Approval Date: May 10, 2007

**TRACO Security Windows and Doors, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**C. CALCULATIONS**

1. Revised Anchor Calculations, and structural analysis, complying with FBC 2004, prepared by Frank L. Bennardo, P.E. Consulting Engineers, dated 07/13/05, signed and sealed by Frank L. Bennardo, P.E.  
**Complies with ASTM E1300-02**

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**

1. None.

**F. STATEMENTS**

1. Statement letter of conformance, dated July 13, 2005, signed and sealed by Frank L. Bennardo P.E.
2. Statement letter of no financial interest, dated July 13, 2005, signed and sealed by Frank L. Bennardo, P.E.
3. Statement letter from manufacturer stating that the product has not changed and requesting a One-Year Renewal to allow the time to perform a verification test, dated February 16, 2007, signed by John Heinlein, TRACO Testing Coordinator.
4. Letter from laboratory confirming manufacturer has contracted and scheduled verification tests, issued by Farabaugh Engineering and Testing, Inc., dated January 24, 2007, signed by Patrick Farabaugh, P.E. Vice President.

**G. OTHER**

1. Notice of Acceptance No. **05-0812.03**, issued to TRACO Windows & Doors for their "Series 2100 Aluminum Fixed Window – Non-Impact", approved on 02/02/06 and expiring on 04/25/07.

  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 07-0309.01

Expiration Date: April 25, 2008


Approval Date: May 10, 2007

F:\01-Project Files\Traco (TRA)\2004 Jobs\04-113-0003 2100 Fixed Window (Non-Impact) 2100 Fixed Window (Non-Impact) 03b Traco - 2100 Fixed Window (Non-Impact) .dwg 12/09/2005 - 3:27pm clangley

**TABLE ① DESIGN LOAD CAPACITY (PSF)**

WINDOW WIDTH (in)	WINDOW HEIGHT (in)	MAX ANCHOR SPACING		3/16" ANNEALED		3/16" TEMPERED		1/2" INSUL. ANNEALED		1/2" INSUL. TEMPERED	
		HEAD/SILL (in)	JAMBS (in)	POS (psf)	NEG (psf)	POS (psf)	NEG (psf)	POS (psf)	NEG (psf)	POS (psf)	NEG (psf)
19.13	26.00	7.13	7.00	60.0	99.2	70.0	180.6	60.0	99.2	70.0	171.1
26.50		7.25	7.00	60.0	90.6	70.0	164.8	60.0	90.6	70.0	156.2
37.00		8.33	7.00	60.0	71.2	70.0	129.4	60.0	71.2	70.0	122.7
53.13		10.28	7.00	60.0	61.1	70.0	111.2	60.0	61.1	70.0	105.4
19.13	38.375	7.13	8.79	60.0	83.6	70.0	152.0	60.0	83.6	70.0	144.1
26.50		7.25	8.79	60.0	69.2	70.0	125.8	60.0	69.2	70.0	119.3
37.00		8.33	8.79	60.0	62.6	70.0	113.9	60.0	62.6	70.0	108.0
53.13		10.28	8.79	48.9	48.9	70.0	89.1	48.9	48.9	70.0	84.4
19.13	50.625	7.13	9.65	60.0	77.4	70.0	140.7	60.0	77.4	70.0	133.4
26.50		7.25	9.65	60.0	61.3	70.0	111.6	60.0	61.3	70.0	105.8
37.00		8.33	9.65	51.1	51.1	70.0	93.0	51.1	51.1	70.0	88.1
53.13		10.28	9.65	45.3	45.3	70.0	82.4	45.3	45.3	70.0	78.1
19.13	57.00	7.13	11.25	60.0	75.4	70.0	128.6	60.0	75.4	70.0	128.6
26.50		7.25	11.25	59.0	59.0	70.0	100.6	59.0	59.0	70.0	100.6
37.00		8.33	11.25	48.0	48.0	70.0	81.9	48.0	48.0	70.0	81.9
53.13		10.28	11.25	42.3	42.3	70.0	72.1	42.3	42.3	70.0	72.1
19.13	63.00	7.13	10.20	60.0	74.0	70.0	134.6	60.0	74.0	70.0	127.6
26.50		7.25	10.20	57.3	57.3	70.0	104.3	55.0	55.0	70.0	98.9
37.00		8.33	10.20	45.9	45.9	70.0	83.5	45.9	45.9	70.0	79.2
53.13		10.28	10.20	39.1	39.1	70.0	71.1	39.1	39.1	67.3	67.3
19.13	74.25	7.13	10.37	60.0	72.0	70.0	131.0	60.0	72.0	70.0	124.2
26.50		7.25	10.37	54.5	54.5	70.0	100.3	45.5	45.5	70.0	95.1
37.00		8.33	10.37	37.9	37.9	70.0	78.6	43.2	43.2	70.0	74.5
53.13		10.28	10.37	34.8	34.8	64.0	64.0	34.5	34.5	60.7	60.7
24.00	24.00	12.00	12.00	60.0	100.0	70.0	181.9	60.0	100.0	70.0	172.4
36.00		12.00	12.00	60.0	75.0	70.0	121.5	60.0	75.0	70.0	121.5
48.00		12.00	12.00	60.0	66.7	70.0	108.0	60.0	66.7	70.0	108.0
60.00		12.00	12.00	60.0	62.5	70.0	101.3	60.0	62.5	70.0	101.3
72.00		12.00	12.00	60.0	60.0	70.0	97.2	52.4	52.4	70.0	97.2
24.00	36.00	12.00	12.00	60.0	75.0	70.0	121.5	60.0	75.0	70.0	121.5
36.00		12.00	12.00	60.0	65.6	70.0	108.0	60.0	66.7	70.0	108.0
48.00		12.00	12.00	53.3	53.3	70.0	86.4	53.3	53.3	70.0	86.4
60.00		12.00	12.00	47.6	47.6	70.0	77.1	47.6	47.6	70.0	77.1
72.00		12.00	12.00	39.4	39.4	70.0	72.0	44.4	44.4	70.0	72.0
24.00	48.00	12.00	12.00	60.0	66.7	70.0	108.0	60.0	66.7	70.0	108.0
36.00		12.00	12.00	53.3	53.3	70.0	86.4	53.3	53.3	70.0	86.4
48.00		12.00	12.00	50.0	50.0	70.0	81.0	50.0	50.0	70.0	81.0
60.00		12.00	12.00	41.7	41.7	67.5	67.5	41.7	41.7	67.5	67.5
72.00		12.00	12.00	37.5	37.5	60.8	60.8	37.5	37.5	60.8	60.8
24.00	60.00	12.00	12.00	60.0	62.5	70.0	101.3	60.0	62.5	70.0	101.3
36.00		12.00	12.00	47.6	47.6	70.0	77.1	47.6	47.6	70.0	77.1
48.00		12.00	12.00	41.7	41.7	67.5	67.5	41.7	41.7	67.5	67.5
60.00		12.00	12.00	38.5	38.5	64.8	64.8	36.8	36.8	64.8	64.8
72.00		12.00	12.00	32.2	32.2	55.5	55.5	31.0	31.0	55.5	55.5
24.00	72.00	12.00	12.00	60.0	60.0	70.0	97.2	52.4	52.4	70.0	97.2
36.00		12.00	12.00	39.4	39.4	70.0	72.0	44.4	44.4	70.0	72.0
48.00		12.00	12.00	37.5	37.5	60.8	60.8	37.5	37.5	60.8	60.8
60.00		12.00	12.00	32.2	32.2	55.5	55.5	31.0	31.0	55.5	55.5
72.00		12.00	12.00	27.5	27.5	54.0	54.0	26.1	26.1	54.0	54.0
24.00	84.00	12.00	12.00	58.3	58.3	70.0	94.5	47.8	47.8	70.0	94.5
36.00		12.00	12.00	32.2	32.2	68.7	68.7	37.1	37.1	68.7	68.7
48.00		12.00	12.00	31.0	31.0	56.7	56.7	34.0	34.0	56.7	56.7
60.00		12.00	12.00	28.1	28.1	50.4	50.4	27.1	27.1	50.4	50.4
72.00		12.00	12.00	24.0	24.0	47.3	47.3	22.9	22.9	47.3	47.3
24.00	96.00	12.00	12.00	57.1	57.1	70.0	92.6	45.5	45.5	70.0	92.6
36.00		12.00	12.00	28.3	28.3	66.5	66.5	30.5	30.5	66.5	66.5
48.00		12.00	12.00	25.8	25.8	54.0	54.0	29.9	29.9	54.0	54.0
60.00		12.00	12.00	24.7	24.7	47.1	47.1	24.5	24.5	47.1	47.1
72.00		12.00	12.00	21.2	21.2	43.2	43.2	20.0	20.0	43.2	43.2

# SERIES 2100 FIXED WINDOW (NON-IMPACT RESISTANT)

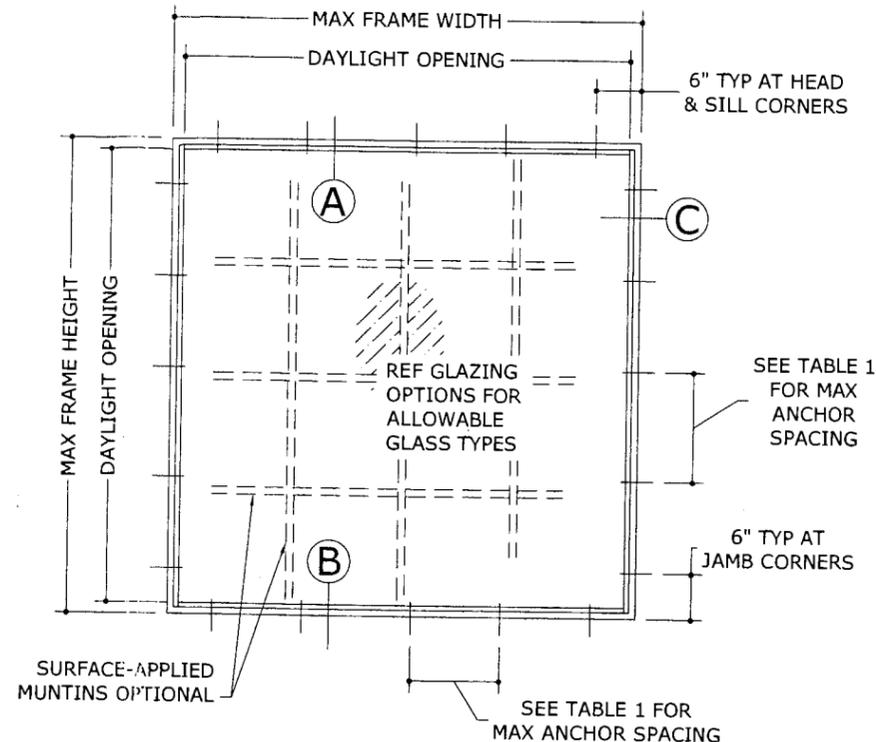

**① TYPICAL EXTERIOR ELEVATION**  
① 3/4" = 1'-0"

### GENERAL NOTES:

- 1) THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED IN COMPLIANCE WITH THE FLORIDA BUILDING CODE 2004 (HIGH VELOCITY HURRICANE ZONE) AND HVHZ TEST PROTOCOL TAS 202.
- 2) NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
- 3) POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE.
- 4) MULTIPLE WINDOW UNITS MUST BE INSTALLED USING MIAMI-DADE COUNTY BCCO-APPROVED STRUCTURAL MULLIONS (e.g. NOA #01-1218.01 OR #01-1218.02).
- 5) THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
- 6) PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS.
- 7) ALL WINDOWS SHALL BE PROTECTED WITH MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS FOR ALL INSTALLATIONS.
- 8) ALL STEEL IN CONTACT WITH ALUMINUM SHALL BE PAINTED OR PLATED IN ACCORDANCE WITH THE 2004 FLORIDA BUILDING CODE.

**PRODUCT RENEWED**  
as complying with the Florida Building Code  
Acceptance No. **07-0309.01**  
Expiration Date **APRIL 25, 2008**

By *Mauricio Perez*  
Miami-Dade Product Control Division

**PRODUCT REVISED**  
as complying with the Florida Building Code  
Acceptance No. **05-0812.03**  
Expiration Date **04/25/07**

By *M. Thanti*  
Miami-Dade Product Control Division

FRANK L. BENNARDO, P.E., # PE0046549

12/09/2005

**FRANK L. BENNARDO, P.E., INC.**  
CONSULTING ENGINEERS  
4441 NORTH DIXIE HIGHWAY  
BOCA RATON, FL 33431  
(561) 391-2888 FAX: (561) 391-2862  
WWW.FLBENGINEERING.COM

**TRACO**  
Windows & Doors Inc.  
71 Progress Avenue  
Cranberry Township, PA 16166  
Tel: (724) 776-7000

SERIES 2100 ALUMINUM FIXED WINDOW  
NON-IMPACT RESISTANT


REMARKS	INIT ISSUE	2004 FBC	COUNTY COMMENTS	MAX ANCHOR SPCC IN TABLE	CHKD	DATE
					CL	FLB
					5/3/04	6/11/04
					7/13/05	10/11/05
					12/9/05	

04-113-0003

PAGE SCALE:  
DESCRIPTION:

1

F:\01 Project Files\Traco (TRA)\2004 Jobs\04-113-0003 2100 Fixed Window (Non-Impact).dwg  
12/09/2005 - 3:28pm  
clangley

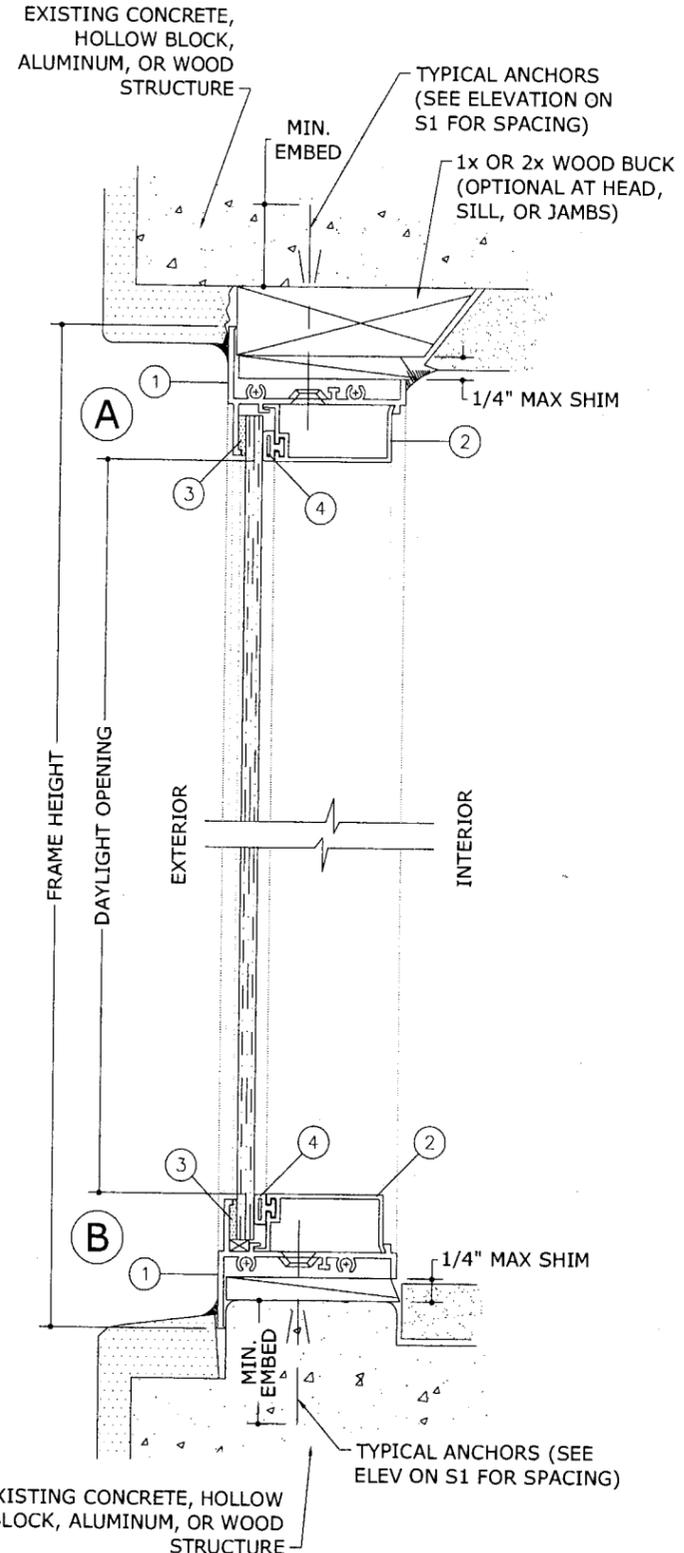

**1** SINGLE GLAZED VERTICAL SECTION  
2 6" = 1'-0"

WOOD BUCKS, NOT BY TRACO, MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

**TYPICAL ANCHORS:**

- 1) 3/16" TAPCONS (BY ELCO OR ITW) OR EQUIV CONC ANCHOR HOLDING CURRENT NOTICE OF ACCEPTANCE.
  - INTO 2x WOOD BUCKS OR WOOD STRUCTURE (1-3/8" MIN PENETRATION INTO WOOD).
  - THRU 1x WOOD BUCKS INTO MASONRY OR DIRECTLY INTO MASONRY (1-1/4" MIN EMBED INTO CONCRETE OR MASONRY).
- 2) #10 THREAD-FORMING SAE GRADE 5 SCREW TO 6063-T5 OR 6063-T6 ALUMINUM (1/8" MIN THICKNESS).


**SEALANT:**

ALL FRAME AND VENT CORNERS, AND HEADS OF INSTALLATION SCREWS AT SILL TO BE SEALED WITH WHITE/ALUM COLORED SEALANT, FIXED MEETING RAIL AT ENDS SEALED WITH GE SILICONE.


**ANCHOR NOTES:**

- 1) ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
- 2) WOOD BUCKS (NOT BY THIS MANUFACTURER) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
- 3) WOOD BUCKS AND/OR HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
- 4) ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN HEREIN. MINIMUM EDGE DISTANCE AND EMBEDMENT TO BASE STRUCTURE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES.
- 5) WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS.

MATERIALS LIST					
ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MFR/SUPLIER/REMARKS
1	050-00-015	4/ WINDOW	FRAME	ALUMINUM	6063-T5
2	050-00-032	4/ WINDOW	GLAZING BEAD (SINGLE)	ALUMINUM	6063-T5
3	026-16-010	AS REQD.	3/16" X 1/2" GLAZING TAPE	BUTYL	-
4	046-16-010	-	BULB VINYL	VINYL	-
5	012-02-835	2/ CORNER	#8x1" PPH METAL SCREWS	S.S.	ASSEMBLY SCREWS
6	046-16-107	AS REQD.	SETTING BLOCK, 1" LONG	RIGID VINYL	-
7	050-00-062	4/ WINDOW	GLAZING BEAD (INSUL.)	ALUMINUM	6063-T5

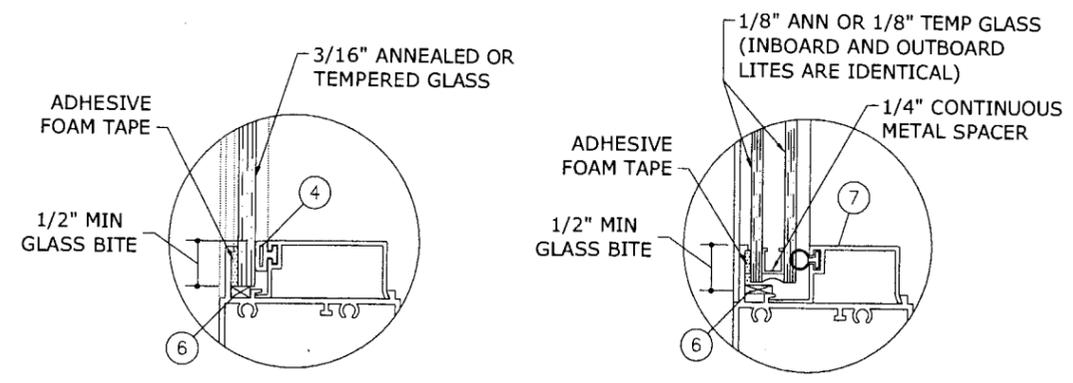

**3** GLAZING DETAILS  
2 6" = 1'-0"

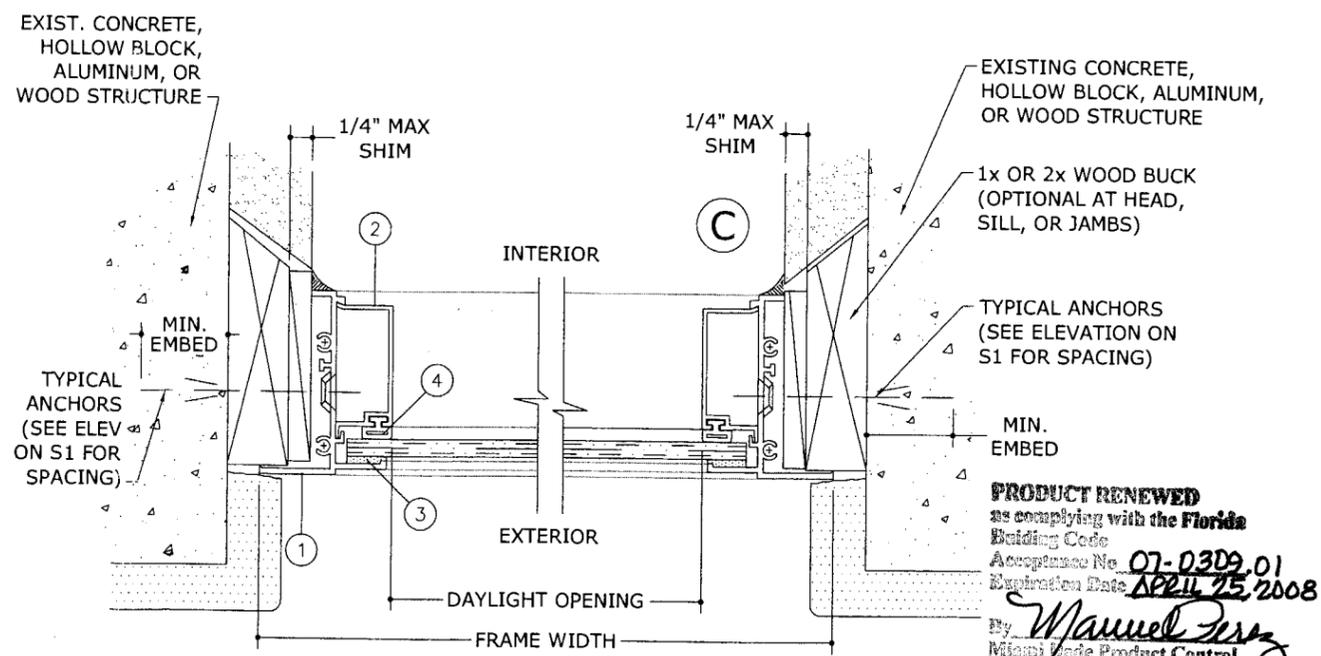

**2** SINGLE GLAZED HORIZONTAL SECTION  
2 6" = 1'-0"

**PRODUCT RENEWED**  
as complying with the Florida Building Code  
Acceptance No. 07-0309.01  
Expiration Date April 25, 2008  
By *Manuel Ferraz*  
Miami Dade Product Control Division

**PRODUCT REVISED**  
as complying with the Florida Building Code  
Acceptance No. 05-0812.03  
Expiration Date 04/25/07  
By *M. Hank*  
Miami Dade Product Control Division

FRANK L. BENNARDO, P.E.  
# PE0046549

12/09/2005

FRANK L. BENNARDO, P.E., INC.  
CONSULTING ENGINEERS  
4441 NORTH DIXIE HIGHWAY  
BOCA RATON, FL 33431  
(561) 391-2888 FAX: (561) 391-2862  
WWW.FLBENGINEERING.COM

**TRACO**  
Windows & Doors Inc.  
71 Progress Avenue  
Cranberry Township, PA 16166  
Tel: (724) 776-7000  
SERIES 2100 ALUMINUM FIXED WINDOW  
NON-IMPACT RESISTANT

REMARKS	CHKD	DATE
INIT ISSUE	FLB	5/3/04
COUNTY COMMENTS	CL	6/11/04
2004 FBC	CL	7/13/05
COUNTY COMMENTS	CL	10/11/05
MAX ANCHOR SPC IN TABLE	CL	12/9/05

04-113-0003

PAGE SCALE:  
DESCRIPTION:

12/09/2005 - 3:28pm clargley F:\01 Project Files\Traco (TRA)\2004 Jobs\04-113-0003 2100 Fixed Window (Non-Impact).dwg

FRANK L. BENNARDO, P.E.  
# PF0046549

12/09/2005

**FRANK L. BENNARDO, P.E., INC.**  
**CONSULTING ENGINEERS**  
4441 NORTH DIXIE HIGHWAY  
BOCA RATON, FL 33431  
(561) 391-2888 FAX: (561) 391-2862  
WWW.FLBENGINEERING.COM


**TRACO**  
Windows & Doors Inc.  
71 Progress Avenue  
Cranberry Township, PA 16166  
Tel: (724) 776-7000

REMARKS	DWN	CHKD	DATE
INIT ISSUE	CL	FLB	5/3/04
COUNTY COMMENTS	CL	FLB	6/11/04
2004 FBC	CL	FLB	7/13/05
COUNTY COMMENTS	CL	FLB	10/11/05
MAX ANCHOR SPG IN TABLE	CL	FLB	12/9/05


04-113-0003

PAGE SCALE:  
DESCRIPTION:


3

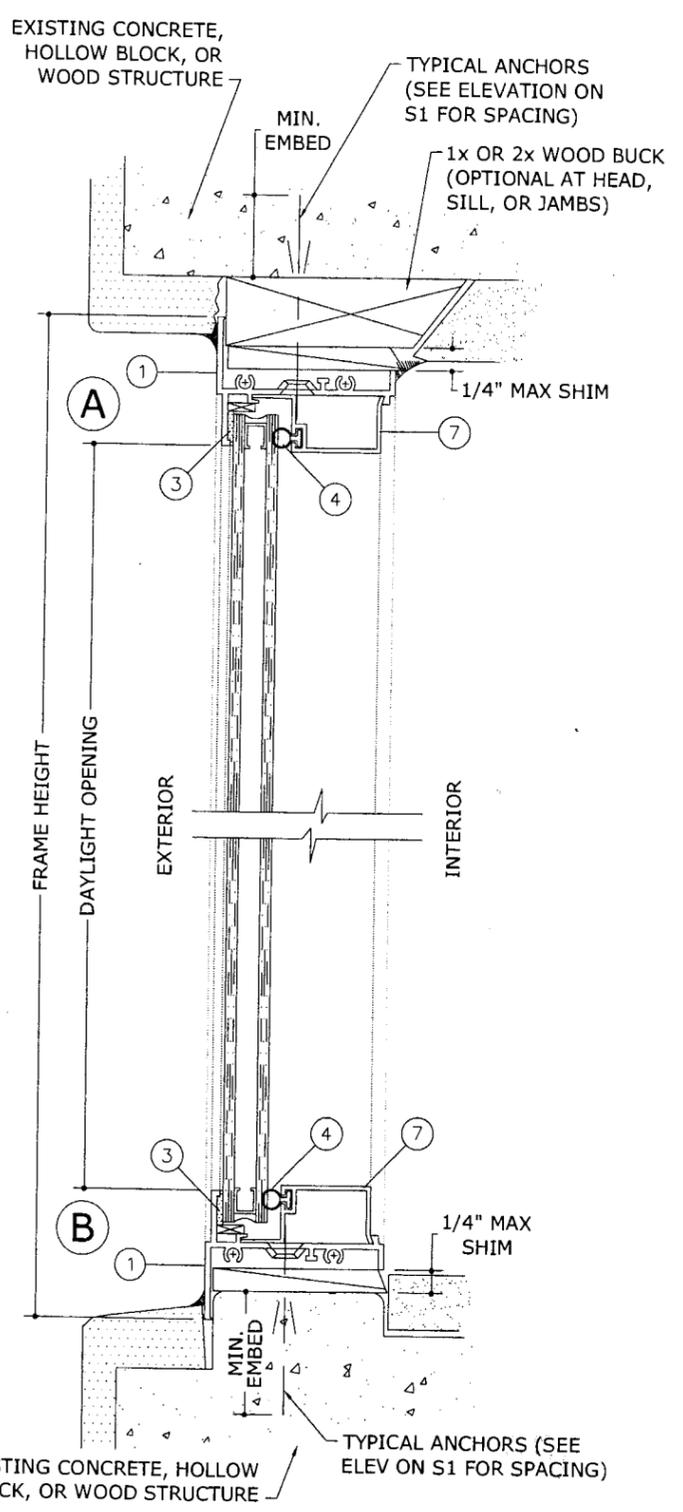


**1** INSUL. DOUBLE GLAZED VERTICAL SECTION  
**3** 6" = 1'-0"

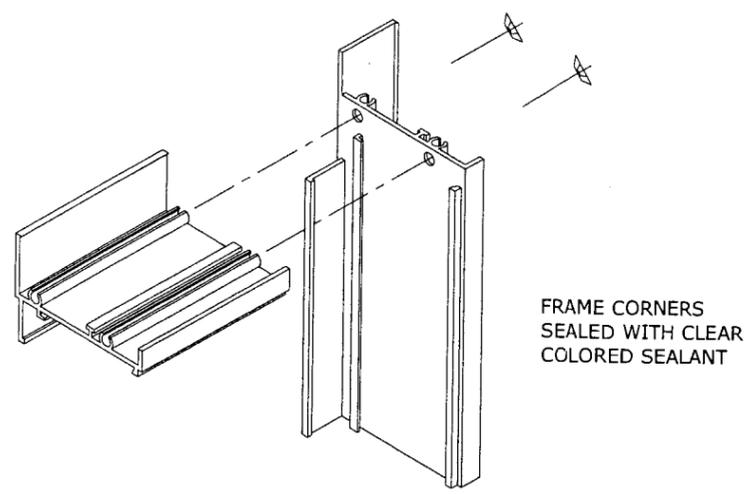

**3** FRAME CORNER ASSEMBLY  
**3** N.T.S.

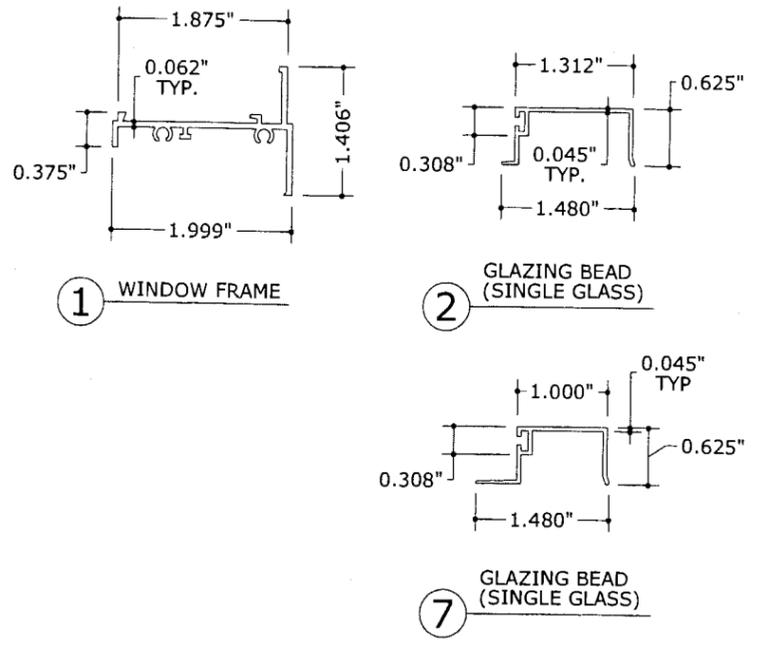

**4** EXTRUSIONS  
**3** 6" = 1'-0"

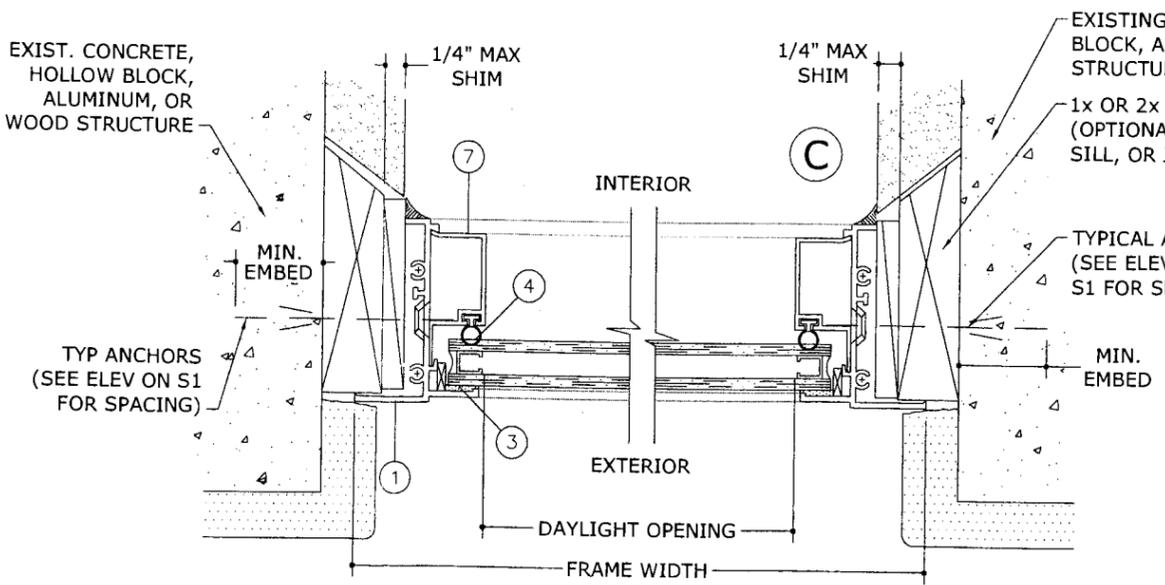

**2** INSUL. DOUBLE GLAZED HORIZONTAL SECTION  
**3** 6" = 1'-0"

**PRODUCT RENEWED**  
as complying with the Florida Building Code  
Acceptance No. 07-0309.01  
Expiration Date APRIL 25, 2008  
By Manuel Perez  
Miami Dade Product Control Division

**PRODUCT REVIEWED**  
as complying with the Florida Building Code  
Acceptance No. 05-0812.03  
Expiration Date 04/25/07  
By M. Shark  
Miami Dade Product Control Division