



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

[www.buildingcodeonline.com](http://www.buildingcodeonline.com)

## NOTICE OF ACCEPTANCE (NOA)

GlassWall, LLC  
3550 N. W. 49 Street  
Miami, FL 33142

### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

### DESCRIPTION: Series "200S" Aluminum Sliding Glass Door -S.M.I.

**APPROVAL DOCUMENT:** Drawing No. **W06-82**, titled "Series 200S Alum Sliding Glass Door (S.M.I.)", sheets 1 through 8 of 8, prepared by AL-Farooq Corporation, dated 12/05/06 and last revised on Jul 26, 2007, signed and sealed by Dr. Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

### MISSILE IMPACT RATING: Large Missile Impact Resistant

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA(s) # **04-0316.02** & **04-0702.03** consists of this page 1 and evidence pages E-1 & E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**


NOA No 07-0309.10  
Expiration Date: May 29, 2009  
Approval Date: August 23, 2007  
Page 1



8/1/07


**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

- A. DRAWINGS** (transferred from file # **04-0316.02 & 04-0702.03**)
1. Manufacturer's die drawings and sections.
  2. Drawing No. **W06-82**, titled "Series 200S Alum Sliding Glass Door (S.M.I.)", sheets 1 through 8 of 8, prepared by AL-Farooq Corporation, dated 12/05/06 and last revised on Jul 26, 2007, signed and sealed by Dr. Humayoun Farooq, P.E.
- B. TESTS** (transferred from file # **04-0316.03 & 04-0702.01**)
1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Small Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
6) Forced Entry Test, per FBC 2411 3.2.1 (b) and TAS 202-94  
along with marked-up drawings and installation diagram of an aluminum sliding glass door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4266**, dated 08/15/04 and **FTL-4000** dated 11/26/03, both signed and sealed by Edmundo Largaespada, P.E.
  2. Additional Reference Test reports  
1) Large Missile Impact Test per SFBC, PA 201-94  
2) Cyclic Wind Pressure Loading per SFBC, PA 203-94  
along with marked-up drawings and installation diagram of aluminum sliding glass door, prepared by Construction Testing Corp., Test Report No. **05-040**, dated Nov. 16, 2005, signed and sealed by Yamil G. Kuri, P.E.
- C. CALCULATIONS**
1. Anchor verification calculations and structural analysis complying w/ FBC 2004, prepared by Al Farooq Corporation, dated 12/06/06, signed and sealed by Dr. Humayoun Farooq, P.E.
  2. Glazing complies w/ ASTM E-1300-02
- D. QUALITY ASSURANCE**
1. Miami Dade Building Code Compliance Office (BCCO).
- E. MATERIAL CERTIFICATIONS**
1. Notice of Acceptance No. **06-0216.06**, issued to Solutia Inc., for their "Saflex III G clear & color interlayer ®", expiring on 05/21/11.
- G. STATEMENTS**
1. Statement letters of conformance and "No financial interest", dated 12/04/06, prepared, signed and sealed by Dr. Humayoun Farooq, P.E.
  2. Statement letter of Lab compliance, as part of test report, issued by above Testing Laboratories.
- H. OTHER**
1. This NOA revises NOA(s) # **04-0316.02 & 04-0702.03**, expiring on May 29, 2009.

  
\_\_\_\_\_  
Ishaq I. Chanda, P.E.  
Product Control Examiner  
NOA No 07-0309.10  
Expiration Date: May 29, 2009  
Approval Date: August 23, 2007

no.	date	description
A	07.25.07	REV. PER BCCO COMMENTS

date: 12-05-06	scale: 1/2"=1'-0"	dr. by: HAMID	chk. by:
----------------	-------------------	---------------	----------

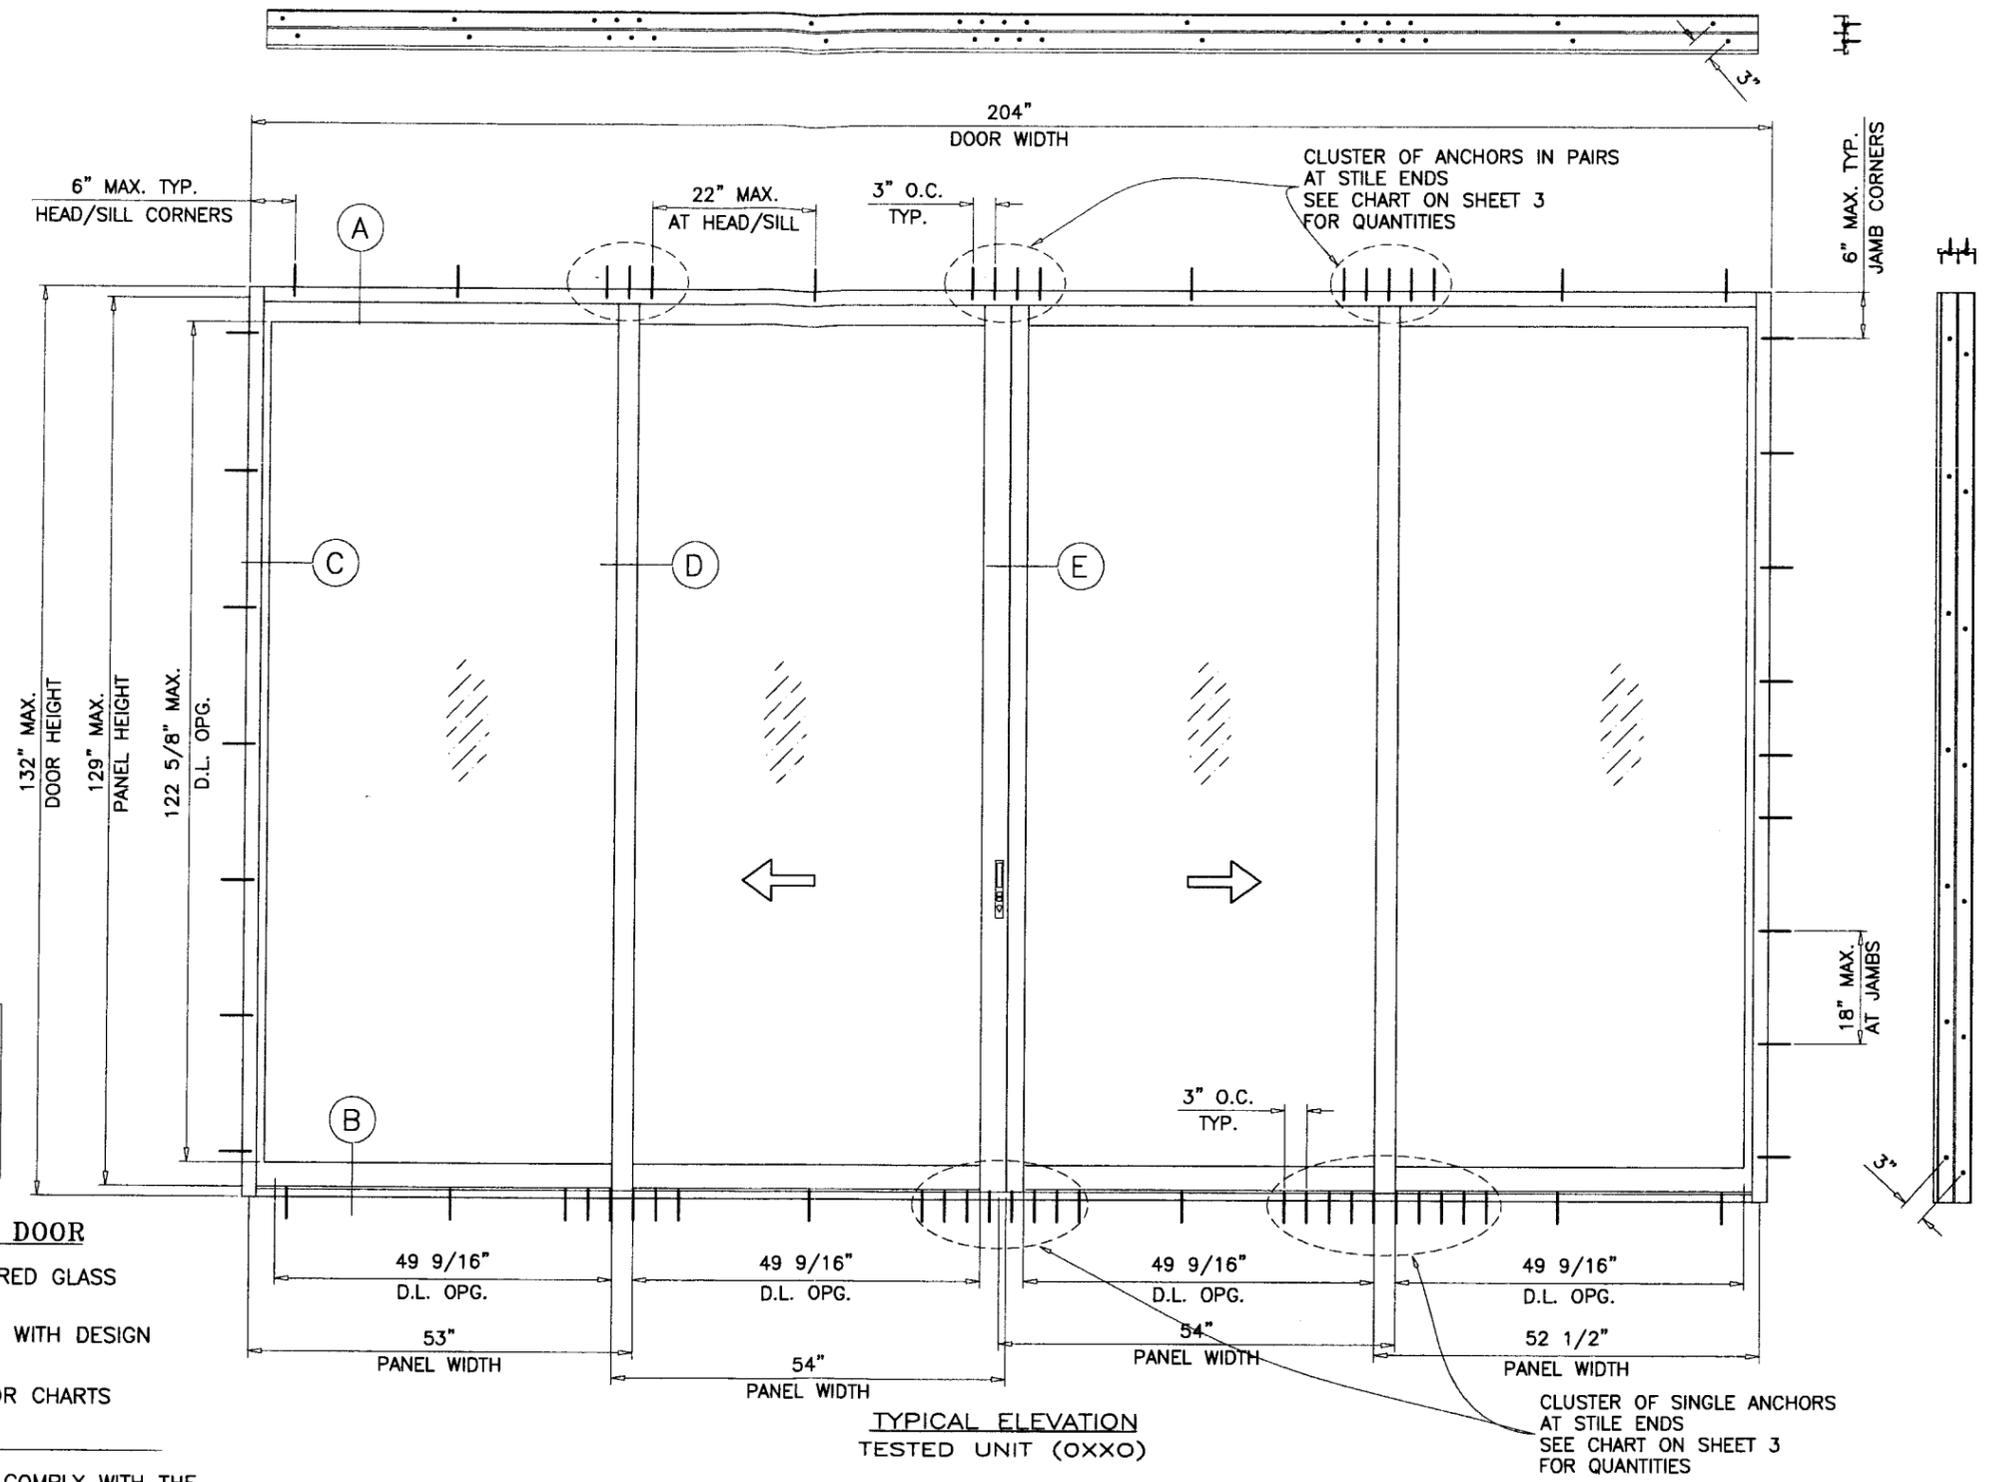


DOORS ARE RATED FOR SMALL MISSILE IMPACT. MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS ARE REQUIRED FOR INSTALLATIONS UP TO 30 FT. OF GRADE. SHUTTERS NOT REQD. FOR INSTALLATIONS ABOVE 30 FT. OF GRADE.

**SERIES 200S ALUMINUM SLIDING GLASS DOOR**

SEE SHEET 2 FOR DESIGN LOAD CAPACITY OF DESIRED GLASS SIZE BASED ON APPLICABLE WIND DURATION. USING CHART ON SHEET 3 SELECT ANCHOR OPTION WITH DESIGN RATING MORE THAN DESIGN LOADS REQUIRED. LOWER DESIGN PRESSURES FROM GLASS OR ANCHOR CHARTS WILL APPLY TO ENTIRE SYSTEM.




THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ). WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE. ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL. A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY. MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004 FLORIDA BLDG. CODE SECTION 2003.8.4.

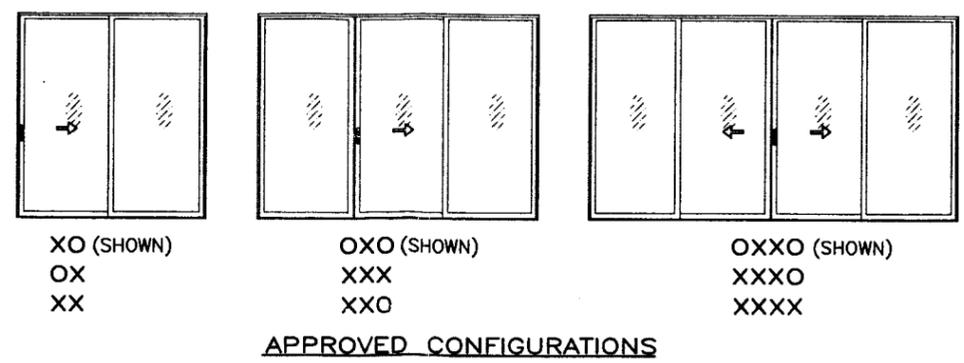


Engr: DR. HUMAYOON FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 C.A.N. 3538  
 JUL 26 2007

**LAMINATED GLASS**  
**SMALL MISSILE IMPACT**  
 PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No 07-0309-10  
 Expiration Date May 29, 2009  
 By Ghag I. Chanda  
 Miami Dade Product Control  
 Division

DESIGN LOAD CAPACITY - PSF			
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	STANDARD INTERLOCKS	HEAVY INTERLOCKS
		EXT. (+) INT. (-)	EXT. (+) INT. (-)
30	96	110.0	110.0
36		110.0	110.0
42		110.0	110.0
48		110.0	110.0
54		110.0	110.0
60		110.0	110.0
30	102	110.0	110.0
36		110.0	110.0
42		110.0	110.0
48		110.0	110.0
54		110.0	110.0
60		110.0	110.0
30	108	110.0	110.0
36		110.0	110.0
42		110.0	110.0
48		110.0	110.0
54		110.0	110.0
60		-	110.0
30	114	110.0	110.0
36		110.0	110.0
42		110.0	110.0
48		110.0	110.0
54		-	110.0
60		-	110.0
30	120	110.0	110.0
36		110.0	110.0
42		110.0	110.0
48		110.0	110.0
51		110.0	110.0
54		-	110.0
30	126	-	110.0
36		-	110.0
42		-	110.0
48		-	110.0
51		-	110.0
54		-	110.0
30	132	-	110.0
36		-	110.0
42		-	110.0
48		-	110.0
51		-	110.0
54		-	110.0

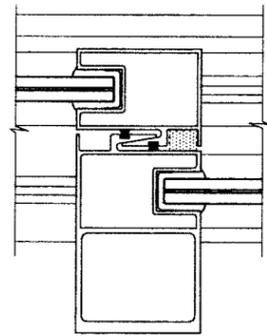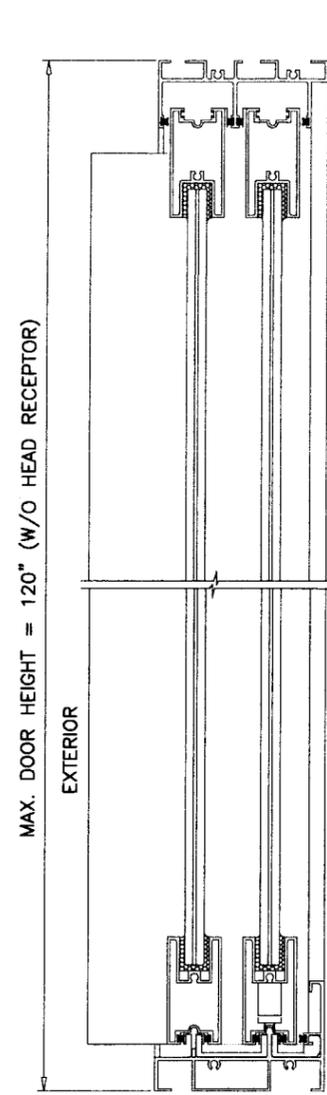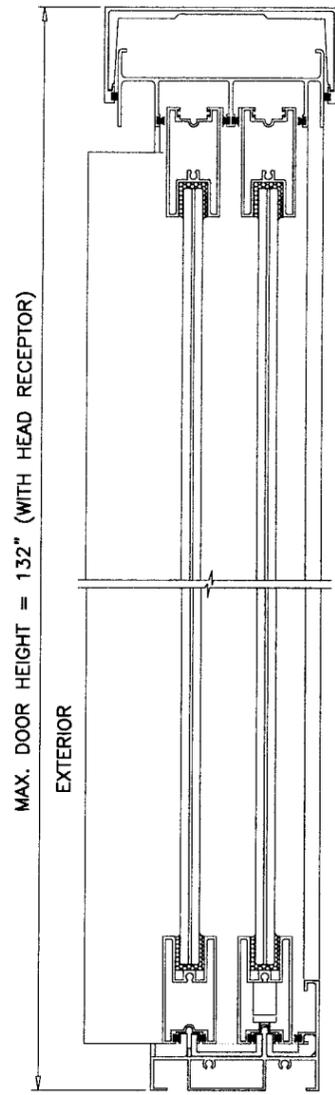


STANDARD INTERLOCKS

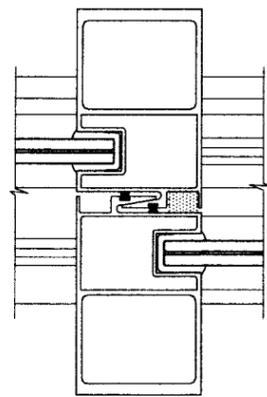

HEAVY INTERLOCKS

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 07-0309.10  
Expiration Date MAY 29, 2009  
By Ishag I. Khalil  
Miami Dade Product Control  
Division

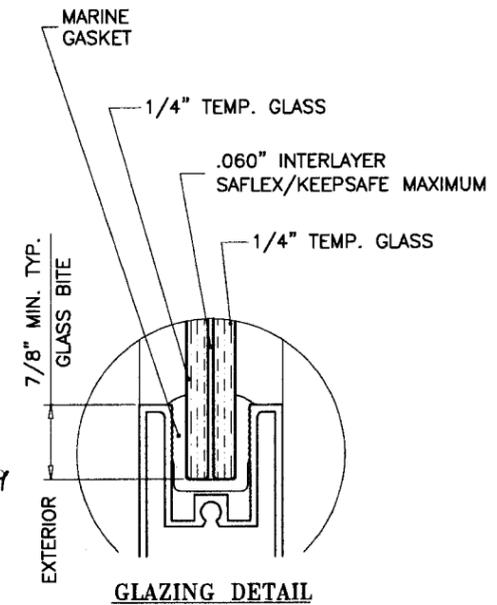

NOTE:  
GLASS CAPACITIES ON THIS SHEET ARE  
BASED ON ASTM E1300-02 (3 SEC. GUSTS)  
AND FLORIDA BUILDING COMMISSION  
DECLARATORY STATEMENT DCA05-DEC-219

Engr: DR. HUMAYOON FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

JUL 26 2007

**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W06-82GWL

SERIES 200S ALUM SLIDING GLASS DOOR (S.M.I.)

**GLASSWALL, LLC**  
3550 N.W. 49 STREET  
MIAMI, FL. 33142  
TEL. (305) 638-5151 FAX. (305) 638-5158

no.	date	description	REV. PER	COMMENTS
A	07.25.07			

date: 12-05-06  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W06-82**

sheet 2 of 8

DESIGN LOAD CAPACITY - PSF (ANCHORS)								
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	DOORS W/O HEAD RECEPTOR						
		ANCHORS TYPE A						ANCHORS TYPE B
		3" MIN. EDGE D.	2" MIN. EDGE DIST.		1-5/8" MIN. EDGE DIST.			3/4" MIN. EDGE D.
		CLUSTER OF 6 ANCHORS	CLUSTER OF 6 ANCHORS	CLUSTER OF 8 ANCHORS	CLUSTER OF 6 ANCHORS	CLUSTER OF 8 ANCHORS	CLUSTER OF 10 ANCHORS	CLUSTER OF 6 ANCHORS
EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	
30	84	110.0	110.0	110.0	110.0	110.0	110.0	110.0
36		110.0	110.0	110.0	110.0	110.0	110.0	110.0
42		110.0	110.0	110.0	110.0	110.0	110.0	110.0
48		110.0	110.0	110.0	110.0	110.0	110.0	110.0
54		110.0	110.0	110.0	110.0	110.0	110.0	110.0
60		110.0	110.0	110.0	110.0	110.0	110.0	110.0
30	90	110.0	110.0	110.0	110.0	110.0	110.0	110.0
36		110.0	110.0	110.0	110.0	110.0	110.0	110.0
42		110.0	110.0	110.0	110.0	110.0	110.0	110.0
48		110.0	110.0	110.0	110.0	110.0	110.0	110.0
54		110.0	110.0	110.0	110.0	110.0	110.0	110.0
60		110.0	110.0	110.0	110.0	110.0	110.0	110.0
30	96	110.0	110.0	110.0	110.0	110.0	110.0	110.0
36		110.0	110.0	110.0	110.0	110.0	110.0	110.0
42		110.0	110.0	110.0	110.0	110.0	110.0	110.0
48		110.0	110.0	110.0	110.0	110.0	110.0	110.0
54		110.0	110.0	110.0	109.1	110.0	110.0	110.0
60		110.0	110.0	110.0	102.6	110.0	110.0	110.0
30	102	110.0	110.0	110.0	110.0	110.0	110.0	110.0
36		110.0	110.0	110.0	110.0	110.0	110.0	110.0
42		110.0	110.0	110.0	110.0	110.0	110.0	110.0
48		110.0	110.0	110.0	108.5	110.0	110.0	110.0
54		110.0	110.0	110.0	100.3	110.0	110.0	110.0
60		110.0	110.0	110.0	94.1	110.0	110.0	110.0
30	108	110.0	110.0	110.0	110.0	110.0	110.0	110.0
36		110.0	110.0	110.0	110.0	110.0	110.0	110.0
42		110.0	110.0	110.0	110.0	110.0	110.0	110.0
48		110.0	110.0	110.0	100.8	110.0	110.0	110.0
54		110.0	110.0	110.0	92.9	110.0	110.0	110.0
60		110.0	107.7	110.0	86.8	110.0	110.0	110.0
30	114	110.0	110.0	110.0	110.0	110.0	110.0	110.0
36		110.0	110.0	110.0	110.0	110.0	110.0	110.0
42		110.0	110.0	110.0	104.0	110.0	110.0	110.0
48		110.0	110.0	110.0	94.1	110.0	110.0	110.0
54		110.0	107.3	110.0	86.5	110.0	110.0	110.0
60		110.0	110.0	110.0	110.0	110.0	110.0	110.0
30	120	110.0	110.0	110.0	110.0	110.0	110.0	110.0
36		110.0	110.0	110.0	110.0	110.0	110.0	110.0
42		110.0	110.0	110.0	97.7	110.0	110.0	110.0
48		110.0	109.4	110.0	88.2	110.0	110.0	110.0
54		110.0	100.4	110.0	80.9	107.9	110.0	110.0
60		110.0	110.0	110.0	110.0	110.0	110.0	110.0
30	126	110.0	110.0	110.0	110.0	110.0	110.0	110.0
36		110.0	110.0	110.0	104.5	110.0	110.0	110.0
42		110.0	110.0	110.0	92.1	110.0	110.0	110.0
48		110.0	102.9	110.0	83.0	110.0	110.0	110.0
54		110.0	110.0	110.0	110.0	110.0	110.0	110.0
60		110.0	110.0	110.0	110.0	110.0	110.0	110.0
30	132	110.0	110.0	110.0	110.0	110.0	110.0	110.0
36		110.0	110.0	110.0	99.0	110.0	110.0	110.0
42		110.0	108.1	110.0	87.2	110.0	110.0	110.0
48		110.0	97.2	110.0	78.4	104.6	110.0	110.0
54		110.0	92.8	110.0	74.8	99.8	110.0	110.0
60		110.0	110.0	110.0	110.0	110.0	110.0	110.0


Engr: DR. HUMAYOON FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

*[Signature]*

JUL 26 2007

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 07-0309-10  
Expiration Date MAY 29, 2009

By *[Signature]*  
Miami Dade Product Control  
Division



**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL/W06-82GWL

---

SERIES 200S ALUM SLIDING GLASS DOOR (S.M.I.)

**GLASSWALL, LLC**  
3550 N.W. 49 STREET  
MIAMI, FL. 33142  
TEL. (305) 638-5151 FAX. (305) 638-5158




no.	date	description
A	07.25.07	REV. PER BCCO COMMENTS

revisions:

date: 12-05-06  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W06-82**

sheet 3 of 8

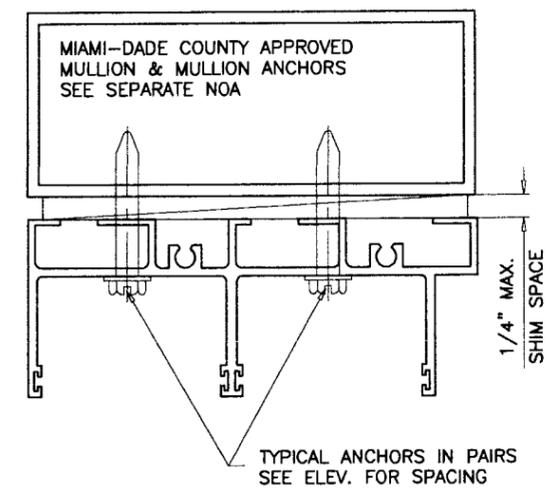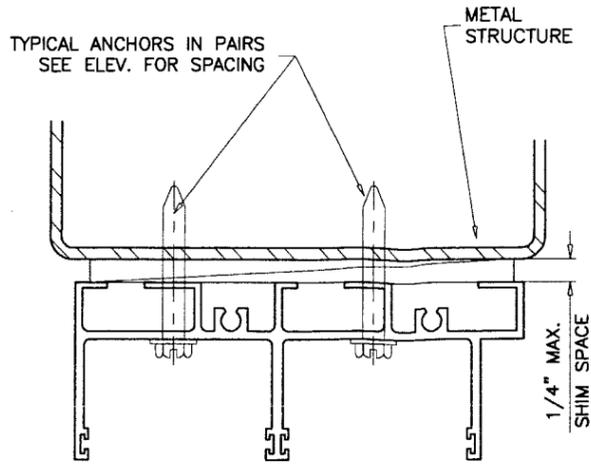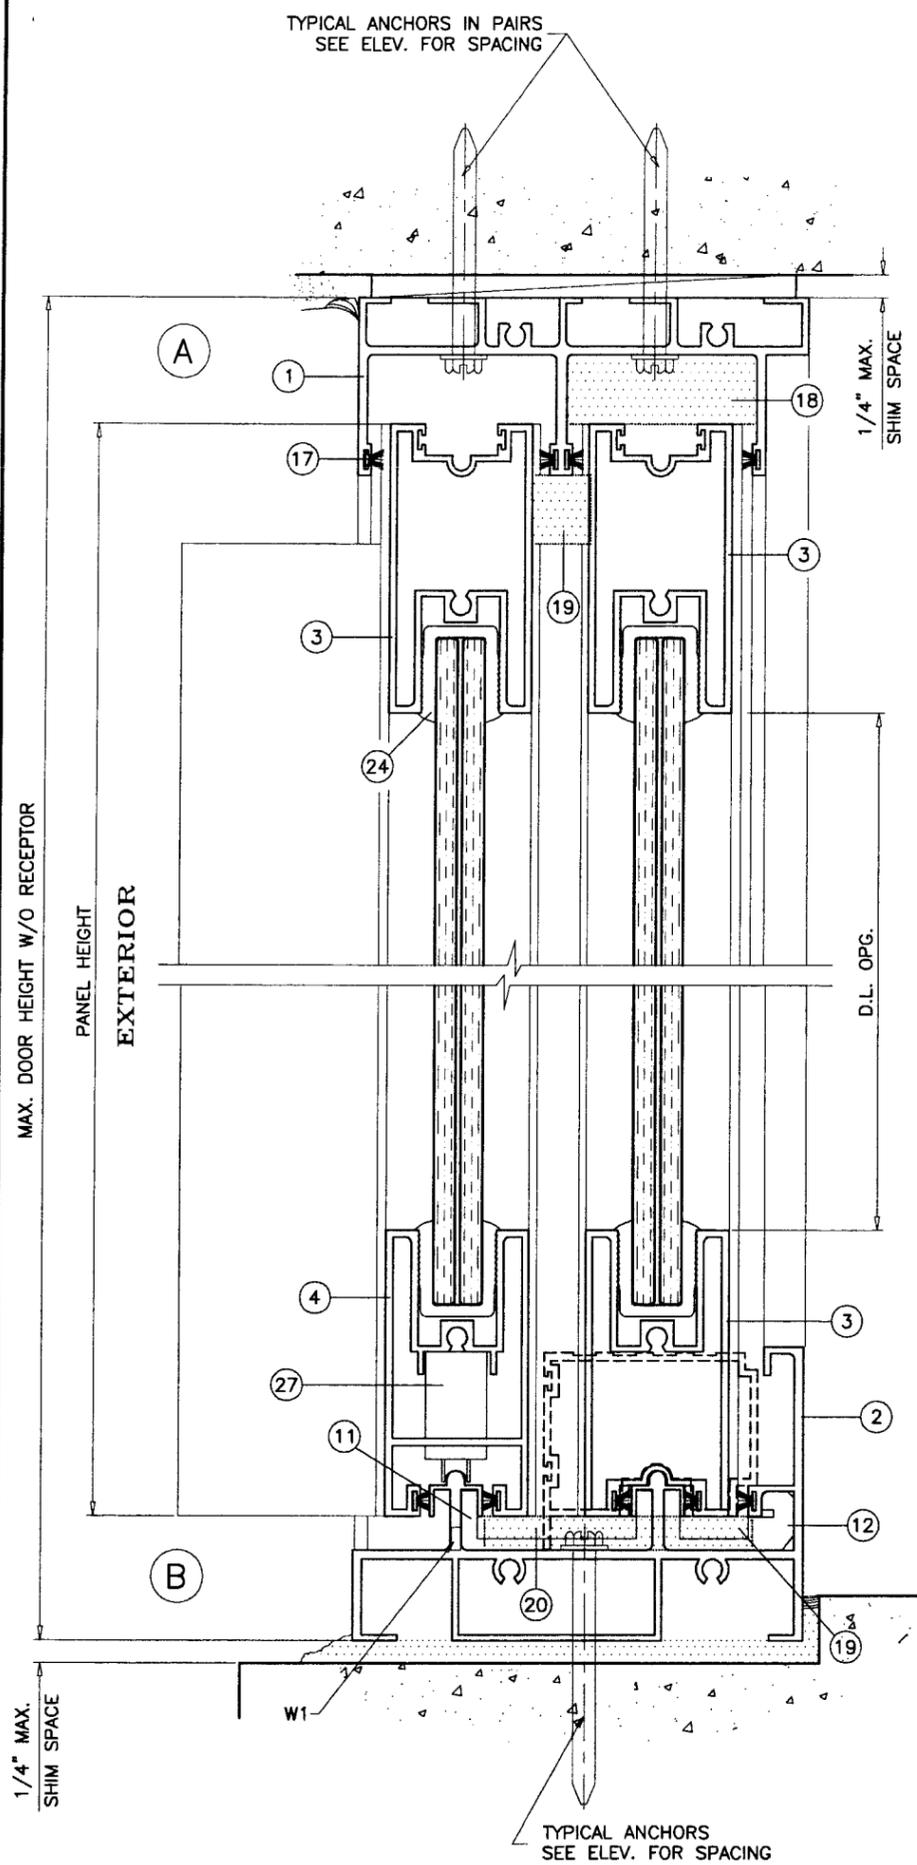

METAL STRUCTURES NOT BY GLASSWALL MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

**TYPICAL ANCHORS:** SEE ELEV. FOR SPACING

TYPE 'A'- 1/4" HILTI KWIK-CON II

DIRECTLY INTO CONC. OR MASONRY  
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

TYPE 'B'- 1/4"-20 KWIK-FLEX SELF DRILLING SCREWS BY 'HILTI'  
INTO METAL STRUCTURES

STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)  
ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)  
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPE 'B'- #14 SMS OR SELF DRILLING SCREWS GRADE 5

INTO DADE COUNTY APPROVED MULLIONS (MIN. THK. = 1/8")

**ANCHOR EDGE DISTANCES**

INTO CONCRETE AND MASONRY = SEE SHEET 3  
INTO METAL STRUCTURE = 3/4" MIN.

**SEALANTS:**

ALL FRAME AND PANEL JOINT, INSTALLATION SCREWS AND HEADS OF ANCHOR SCREWS AT SILL TO BE SEALED WITH BLACK/ALUM COLORED SILICONE.

**WEEPS:**

W1 = 1/4" X 2-1/2" WEEP SLOTS AT 10" FROM ENDS

**PRODUCT REVISED**  
as complying with the Florida Building Code  
Acceptance No. 07-0309-10  
Expiration Date MAY 29, 2009  
By Iskag I. Chande  
Miami Dade Product Control Division

Engr. DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

JUL 26 2007

**afc**

**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W06-82GWL

SERIES 200S ALUM SLIDING GLASS DOOR (S.M.I.)


**GLASSWALL, LLC**  
3550 N.W. 49 STREET  
MIAMI, FL. 33142  
TEL. (305) 638-5151 FAX. (305) 638-5158

no.	date	by	description
A	07.25.07	REV. PER	BCCO COMMENTS

revisions:



date: 12-05-06  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no. **W06-82**  
sheet 4 of 8

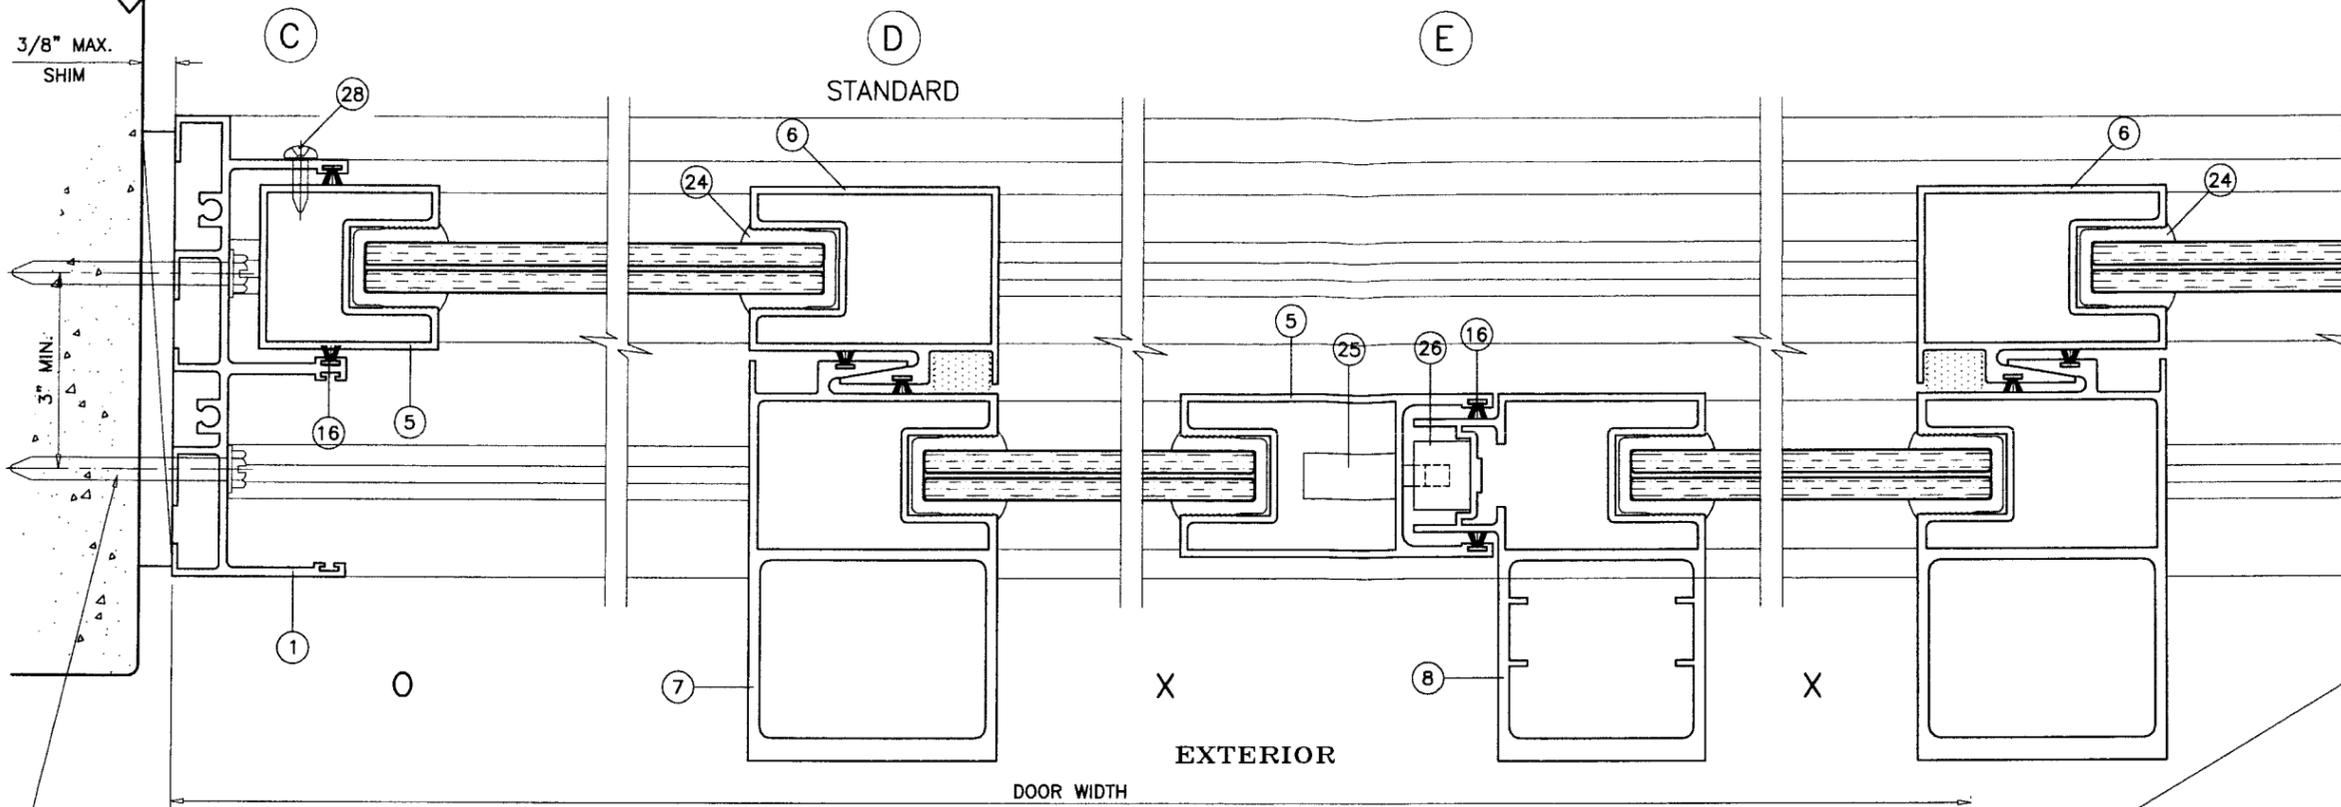

TYPICAL ANCHORS  
SEE ELEV. FOR SPACING

TYPICAL ANCHORS  
SEE ELEV. FOR SPACING

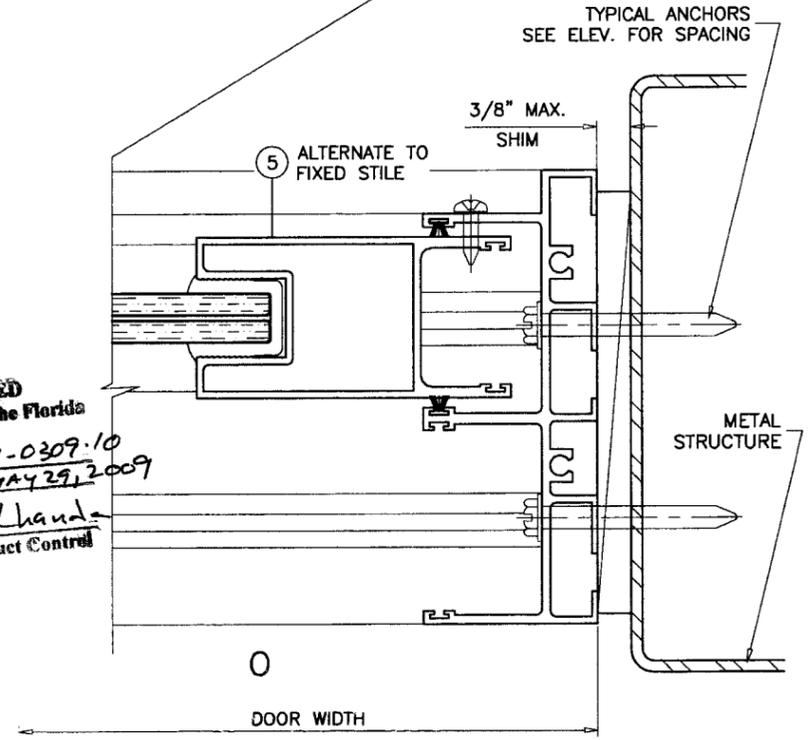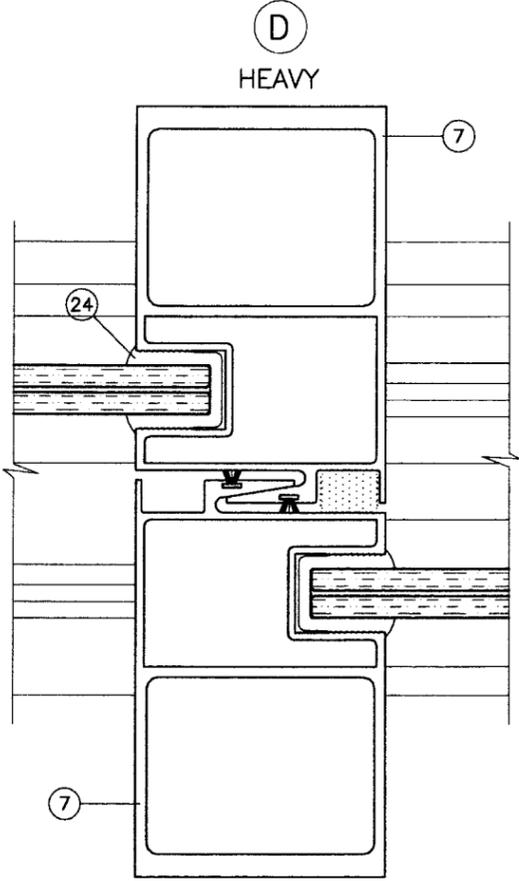

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No 07-0309-10  
Expiration Date MAY 29, 2009  
By Ishtag I. Chanda  
Miami Dade Product Control  
Division

Engr. DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

*JUL 26 2007*

**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W06-82GWL



SERIES 200S ALUM SLIDING GLASS DOOR (S.M.I.)  
**GLASSWALL, LLC**  
3550 N.W. 49 STREET  
MIAMI, FL. 33142  
TEL. (305) 638-5151 FAX. (305) 638-5158

no	date	by	description	REV. PER	COMMENTS
A	07.25.07				

date: 12-05-06  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W06-82**

sheet 5 of 8

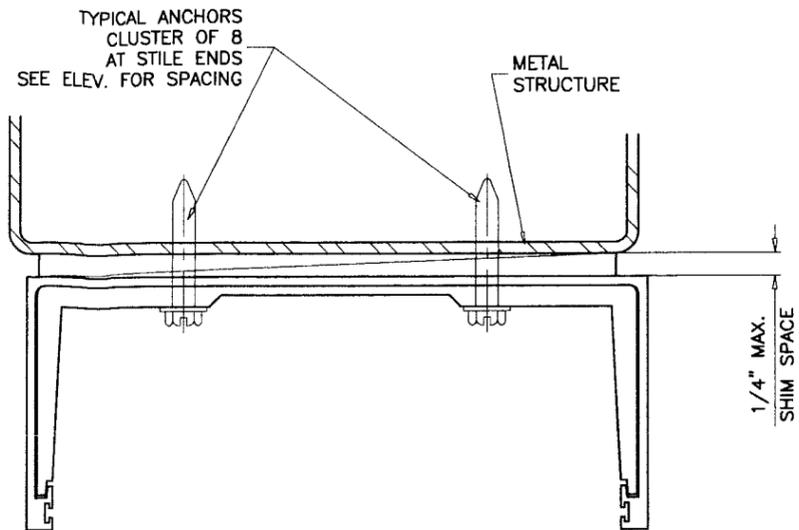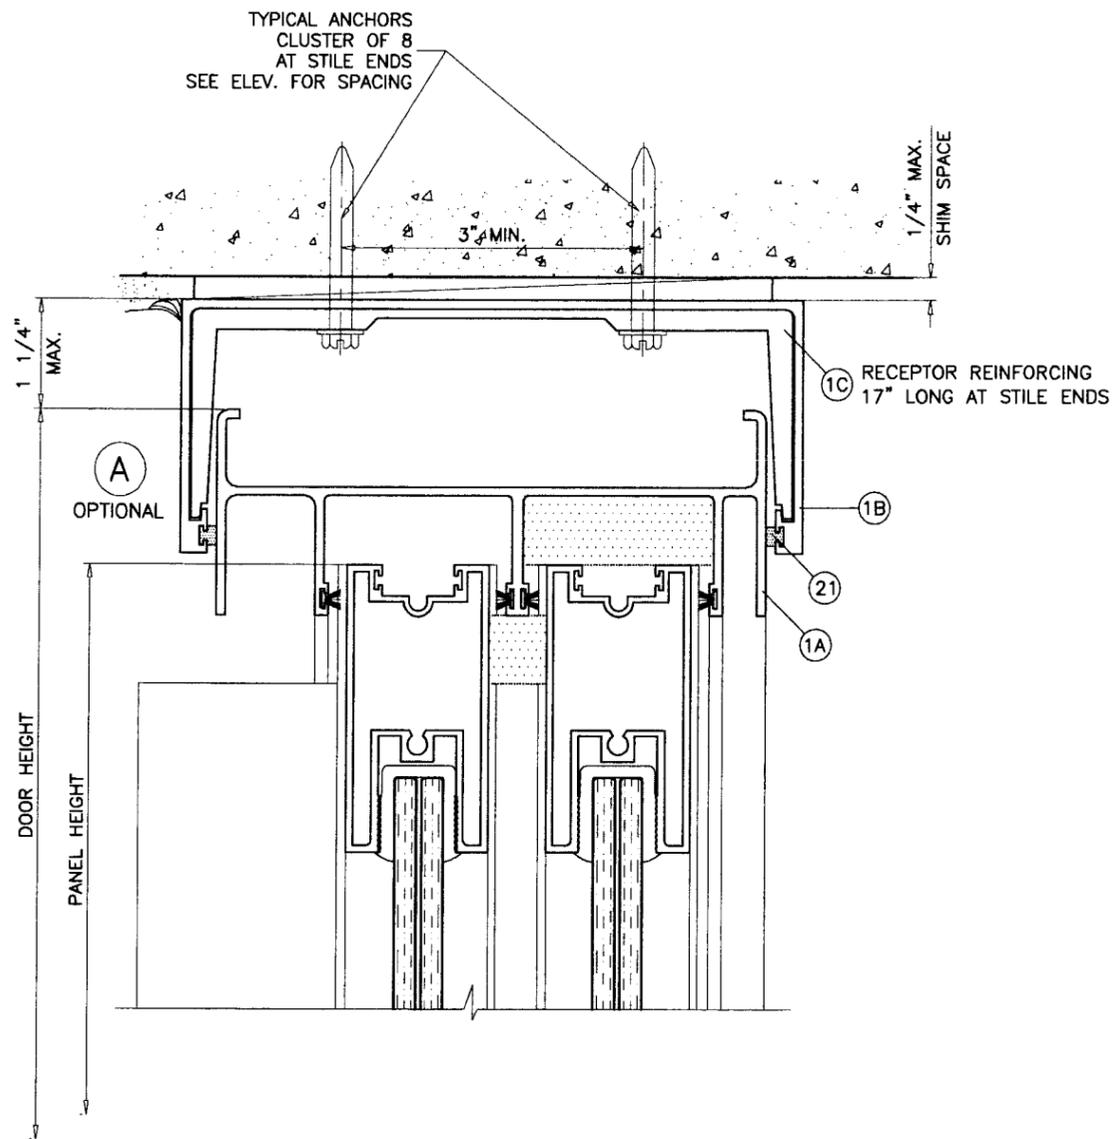

**TYPICAL ANCHORS:** SEE ELEV. FOR SPACING  
AT HEAD RECEPTOR

**1/4" HILTI KWIK-CON II**

DIRECTLY INTO CONC.  
1-3/4" MIN. EMBED INTO CONC.

**1/4-20 KWIK-FLEX SELF DRILLING SCREWS BY 'HILTI'**  
INTO METAL STRUCTURES

STEEL : 1/8 THK. MIN. (Fy = 36 KSI MIN.)  
ALUMINUM : 1/4" THK. MIN. (6063-T5 MIN.)  
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

**ANCHOR EDGE DISTANCES**

INTO CONCRETE AND MASONRY = 3" MIN.  
INTO METAL STRUCTURE = 1/2" MIN.

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No *07-0309.10*  
Expiration Date *MAY 29, 2009*  
  
By *Iskag I. Chauda*  
Miami Dade Product Control  
Division

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

*JUL 26 2007*


**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W06-82GWL

SERIES 200S ALUM SLIDING GLASS DOOR (S.M.I.)  
**GLASSWALL, LLC**  
3550 N.W. 49 STREET  
MIAMI, FL. 33142  
TEL. (305) 638-5151 FAX. (305) 638-5158


revisions:	no	date	by	description
	A	07.25.07		REV. PER BCCO COMMENTS

date: 12-05-06  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:


drawing no.  
**W06-82**  
sheet 6 of 8

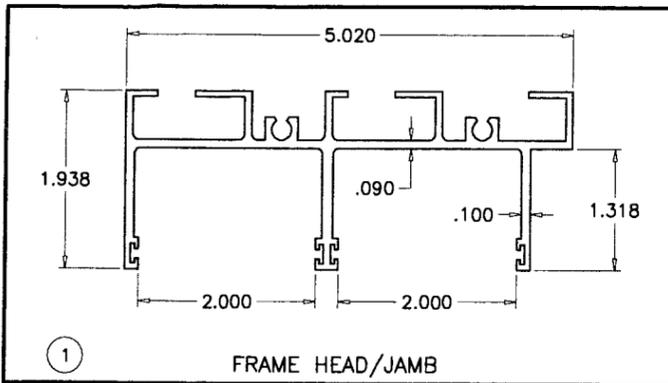


① FRAME HEAD/JAMB

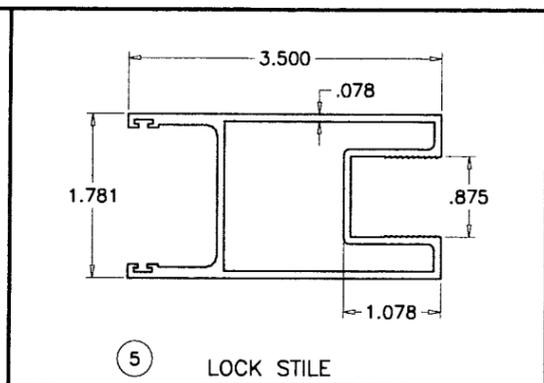


⑤ LOCK STILE

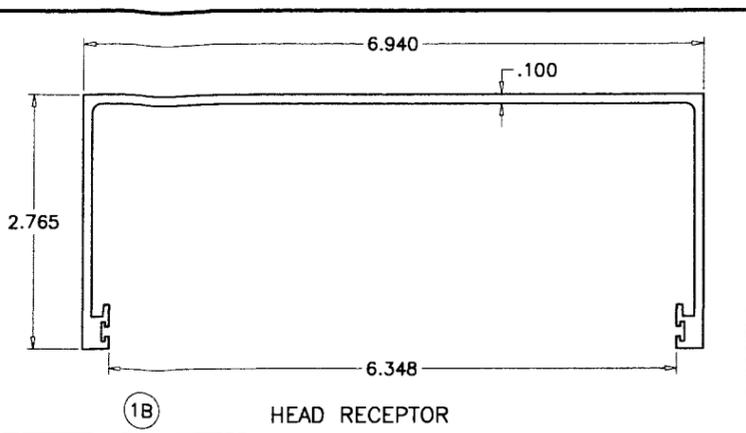


①B HEAD RECEPTOR

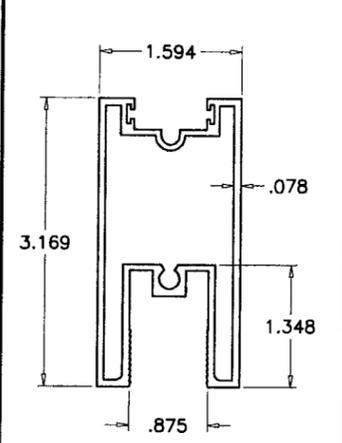


③ PANEL TOP RAIL  
FIX. PANEL BOTTOM RAIL

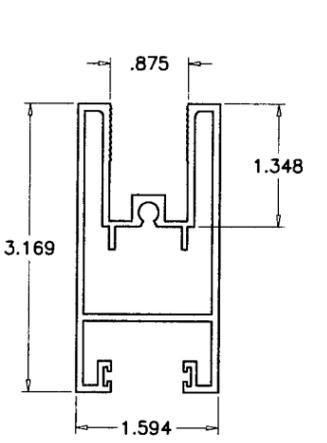


④ MOV. PANEL BOTTOM RAIL

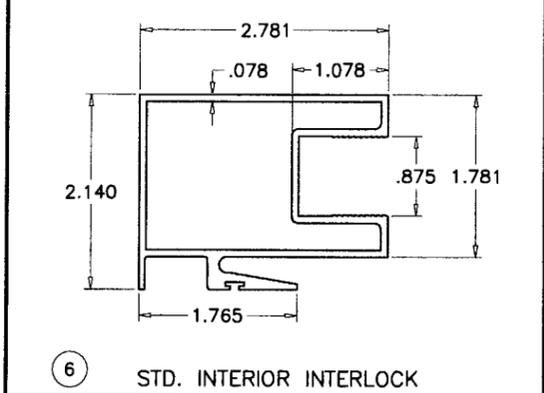


⑥ STD. INTERIOR INTERLOCK

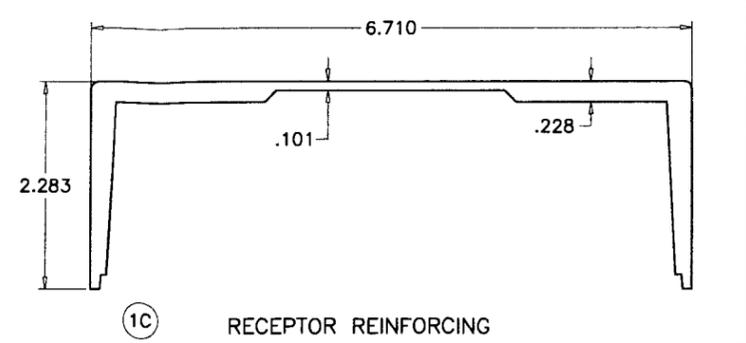


①C RECEPTOR REINFORCING

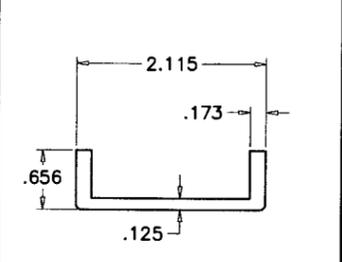


⑪ SILL CHANNEL

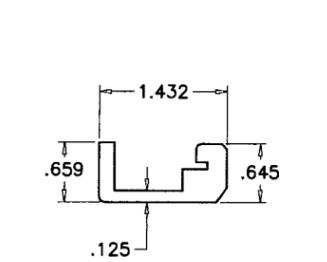


⑫ SILL CHANNEL

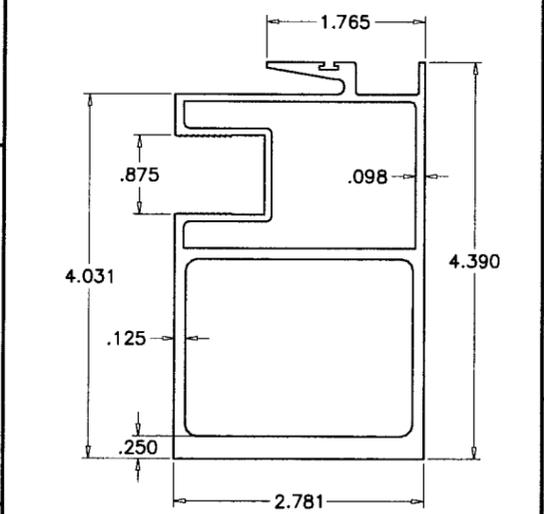


⑦ EXTERIOR/INTERIOR INTERLOCK

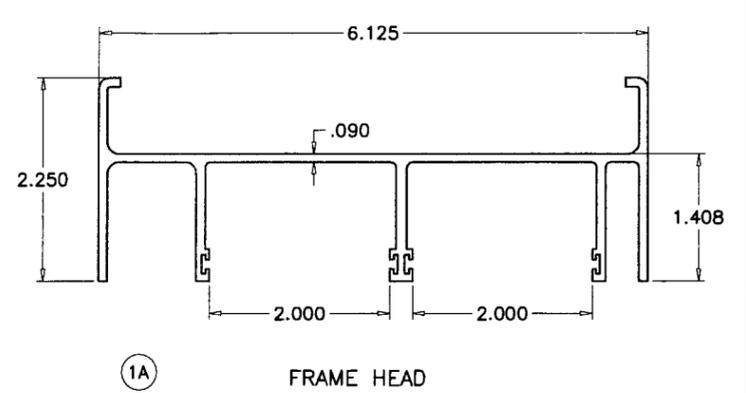


①A FRAME HEAD

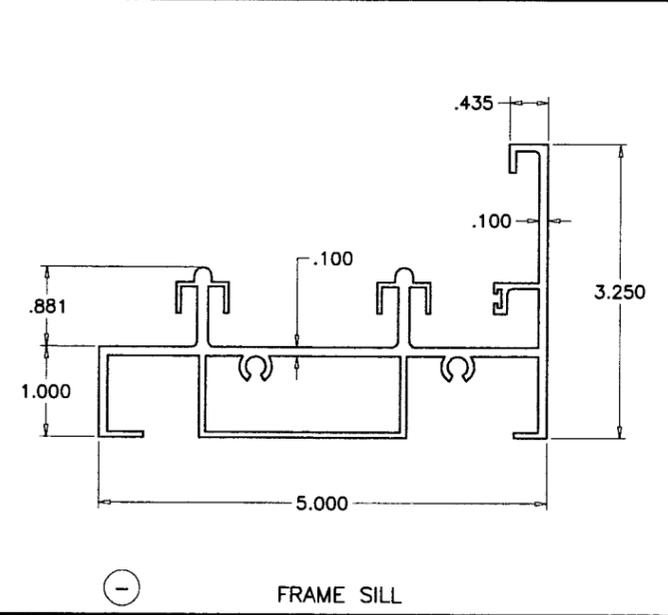


① FRAME SILL

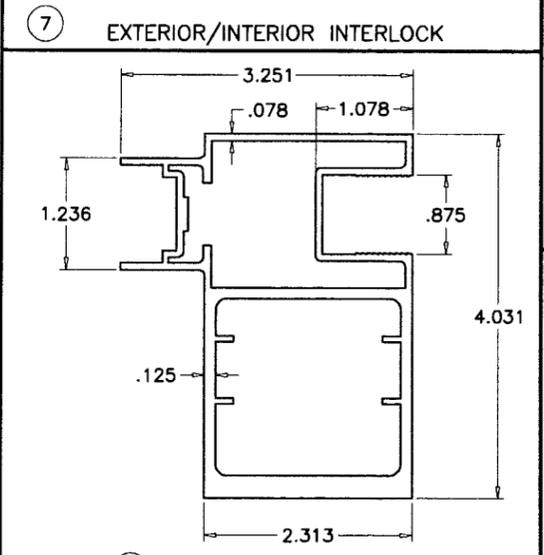

⑧ ASTRAGAL STILE

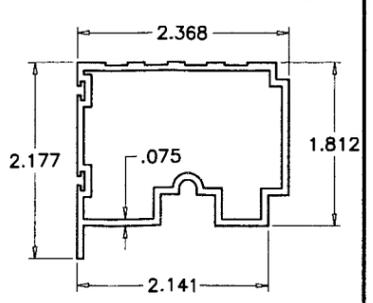

⑨ THRESHOLD

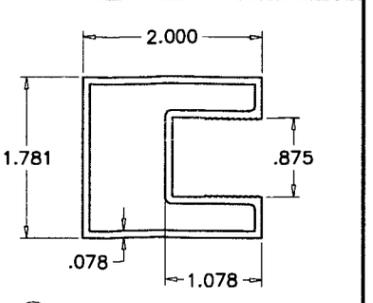

⑤A JAMB STILE

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 07-0309.10  
Expiration Date MAY 29, 2009  
  
By Shag I. Chanda  
Miami Dade Product Control  
Division

Engr: DR. HUMAYOON FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

*[Signature]*  
JUL 26 2007


**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W06-82CWL

SERIES 200S ALUM SLIDING GLASS DOOR (S.M.I.)  
**GLASSWALL, LLC**  
3550 N.W. 49 STREET  
MIAMI, FL. 33142  
TEL. (305) 638-5151 FAX. (305) 638-5158


no	date	by	description
A	07.25.07	REV. PER	BCCO COMMENTS

date: 12-05-06  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:


drawing no.  
**W06-82**  
sheet 7 of 8

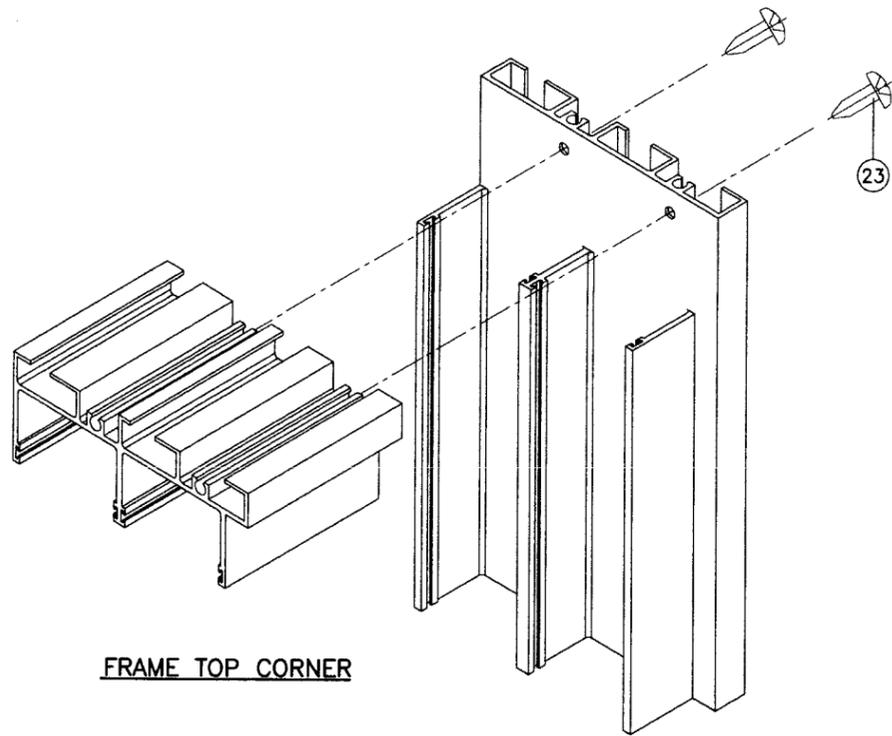


FRAME TOP CORNER

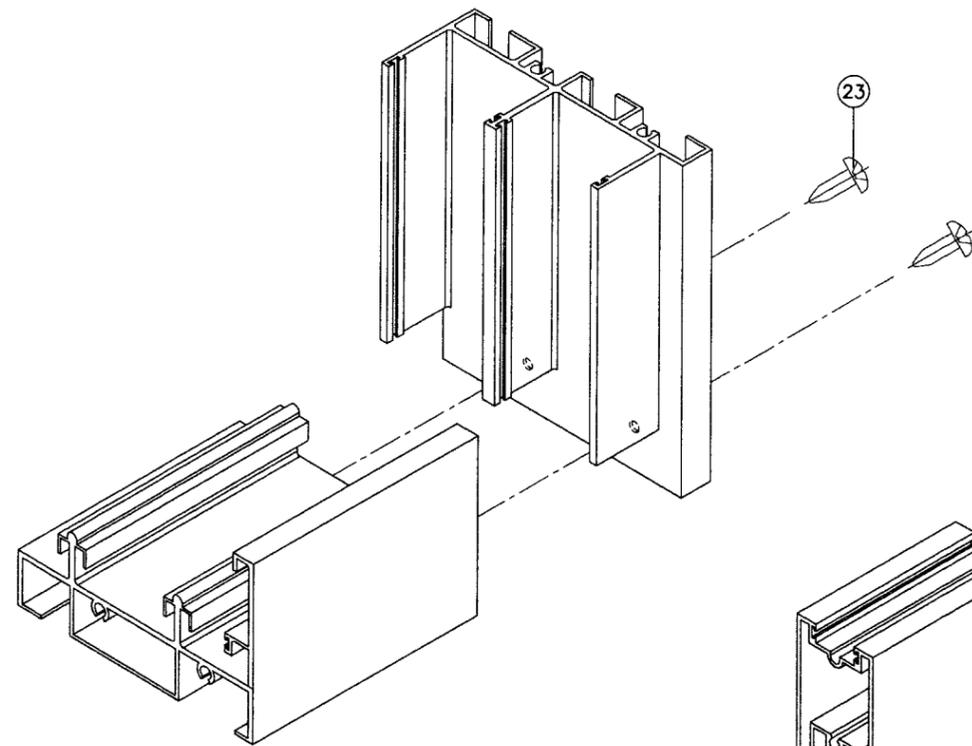

FRAME BOTTOM CORNER

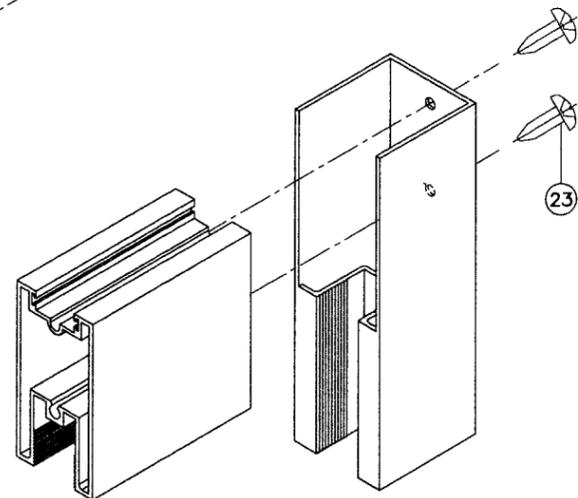

PANEL TOP CORNER

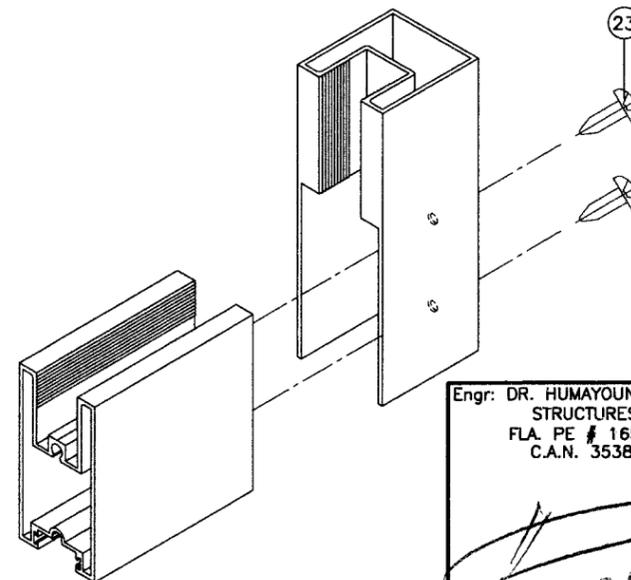

PANEL BOTTOM CORNER

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	100-001	AS REQD.	FRAME HEAD/JAMB	6063-T6	-
1A	100-009	AS REQD.	FRAME HEAD	6005-T5	-
1B	100-019	AS REQD.	HEAD RECEPTOR	6005-T5	-
1C	100-020	AS REQD.	RECEPTOR REINFORCING	6005-T5	ABOVE LOCK & INTERLOCK STILES
2	100-021	1	FRAME SILL	6063-T6	-
3	100-025	AS REQD.	PANEL TOP RAIL/FIX. PANEL BOTTOM RAIL	6005-T5	-
4	100-024	1/ MOV. PANEL	MOVING PANEL BOTTOM RAIL	6005-T5	-
5	100-004	AS REQD.	LOCK STILE	6005-T5	-
5A	100-023	AS REQD.	JAMB STILE	6063-T6	-
6	100-005	AS REQD.	STD. INTERIOR INTERLOCK	6063-T6	-
7	100-007	AS REQD.	EXTERIOR/INTERIOR INTERLOCK	6063-T6	-
8	100-006	AS REQD.	ASTRAGAL STILE	6005-T5	-
9	100-022	1	THRESHOLD	6063-T6	-
11	100-013	-	SILL CHANNEL CLIP	-	-
12	100-014	-	SILL CHANNEL CLIP	-	-
16	568-61279	-	FIN SEAL W'STRIPPING (.270 HT.)	-	PROTOTYPE PLASTICS
17	568-62379	-	FIN SEAL W'STRIPPING (.370 HT)	-	PROTOTYPE PLASTICS
18	P1000AFK(PC)2	-	ADHESIVE BACK PILE PAD	-	ULTRAFAB
19	P6309AFK(PC).75	-	ADHESIVE BACK PILE PAD	-	ULTRAFAB
20	P5009AFK(PC)1.75	-	ADHESIVE BACK PILE PAD	-	ULTRAFAB
21	7P448	AS REQD.	RECEPTOR GASKET	-	PROTOTYPE PLASTICS
23	#14 X 1"	-	FRAME AND PANEL ASS'Y SCREWS	ST/ST	PH SMS
24	FP-687	AS REQD.	GLAZING GASKET	VINYL	PROTOTYPE PLASTICS
25	D-60C	1	3 POINT MORTISE HOOK LOCK	-	DOOR & WINDOW HARDWARE
26	KP-60	1	LOCK KEEPER	ALUMINUM	DOOR & WINDOW HARDWARE
27	-	2/ PANEL	PANEL ROLLERS AT 6" FROM ENDS	ST/ST	DOOR & WINDOW HARDWARE
28	#10 X 3/4"	-	FIXED PANEL SCREWS	ST/ST	PH SMS

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No 07-0309.10  
 Expiration Date MAY 29, 2009  
 By: Ishaq J. Lhanda  
 Miami Dade Product Control  
 Division

Engr: DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 C.A.N. 3538  
 JUL 26 2007

**af c**

**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W06-82GWL

SERIES 200S ALUM SLIDING GLASS DOOR (S.M.I.)

**GLASSWALL, LLC**  
 3550 N.W. 49 STREET  
 MIAMI, FL. 33142  
 TEL. (305) 638-5151 FAX. (305) 638-5158

no.	date	by	description
A	07.25.07		REV. PER BCCO COMMENTS

date: 12-05-06  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W06-82**

sheet 8 of 8