



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**NOTICE OF ACCEPTANCE (NOA)**

[www.buldingcodeonline.com](http://www.buldingcodeonline.com)

**Hurd Windows & Doors, Inc.**  
575 South Whelen Avenue  
Medford, WI 54451

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series Feel Safe Aluminum Clad Wood Fixed Window – L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. 1404, titled "Feel Safe Aluminum Clad Wood Impact Fixed Casement Window", sheets 1 through 4 of 4, dated 07/21/05 with revision A1 dated 03/27/07, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 06-0130.04 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 07-0329.02  
Expiration Date: June 29, 2011  
Approval Date: June 14, 2007  
Page 1

**Hurd Windows & Doors, Inc.**


**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **1404**, Sheets 1 through 4 of 4, titled "Series Feel Safe Aluminum Clad Wood Impact Fixed Casement Window", dated 07/21/05 with revision A1 dated 03/27/07, prepared by W. W. Schaefer Engineering and Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Stork Twin City Testing Corporation, Test Report No. **TCTC-180-7251**, dated 11/20/06, signed and sealed by Thomas Kolden, P.E.
2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Stork Twin City Testing Corporation, Test Report No. **TCTC-180-7252**, dated 11/20/06, signed and sealed by Thomas Kolden, P.E.
3. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94  
along with marked-up drawings and installation diagram of 6 specimens each consisting of three-panel configuration of aluminum clad wood casement windows, prepared by Architectural Testing, Inc., Test Report No. **ATI-52274.04-602-18**, dated 07/07-28/04, signed and sealed by Joseph A. Reed, P.E.  
*(Submitted under previous NOA #06-013.04)*

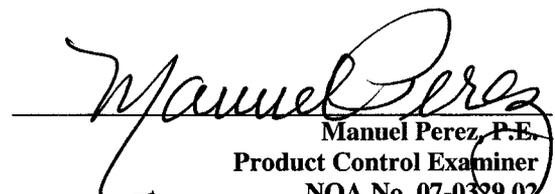  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 07-0329.02  
Expiration Date: June 29, 2011  
Approval Date: June 14 2007

Hurd Windows & Doors, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

4. Test reports on 1) Large Missile Impact Test per FBC, TAS 201-94  
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of 6 specimens each consisting of three-panel configuration of aluminum clad wood fixed windows, prepared by Architectural Testing, Inc., Test Report No. **ATI-57726.01-201-44**, dated 07/07-28/04, signed and sealed by Joseph A. Reed, P.E.  
*(Submitted under previous NOA #06-0130.04)*
5. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of 6 specimens each consisting of three-panel configuration of aluminum clad fixed and casement stationary windows, prepared by Architectural Testing, Inc., Test Report No. **ATI-58961.01-602-18**, dated 07/28/05, signed and sealed by Joseph A. Reed, P.E.  
*(Submitted under previous NOA #06-0130.04)*

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC-2004, dated 05/25/06, prepared by W. W. Schaefer Engineering and Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E..  
**Complies with ASTM E1300-02**

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**


1. Notice of Acceptance No. **03-0415.13** issued to Old Castle Glass for their "DuPont Stormglass Laminated Glass" dated 12/11/03, expiring on 12/18/08.
2. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "Saflex III G Clear or colored interlayer" dated 01/08/04, expiring on 05/21/06.


**F. STATEMENTS**

1. Statement letter of conformance, dated January 24, 2006, signed and sealed by Warren W. Schaefer, P.E.
2. Statement letter of no financial interest, dated January 24, 2006, signed and sealed by Warren W. Schaefer, P.E.

**G. OTHER**

1. Notice of Acceptance No. **06-0130.04**, issued to Hurd Windows & Doors, Inc. for their Series Feel Safe Aluminum Clad Wood Fixed Window – L.M.I., approved on 06/29/06 and expiring on 06/29/11.

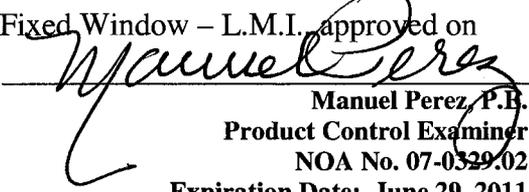  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 07-0329.02  
Expiration Date: June 29, 2011  
Approval Date: June 14, 2007

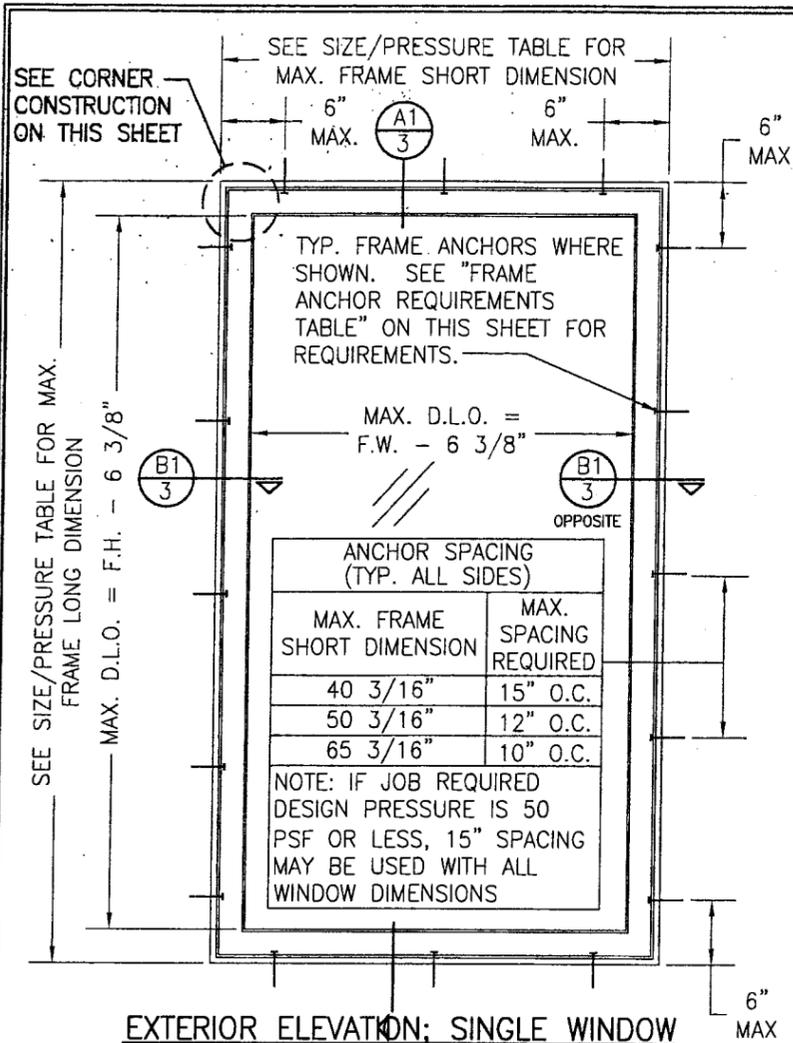

EXTERIOR ELEVATION; SINGLE WINDOW  
(FRAME SCREW MOUNT)  
SCALE: 3/4"=1'-0"

**GENERAL NOTES**


1. THESE WINDOW SYSTEMS HAVE BEEN TESTED, ANALYZED & APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN THE "ALLOWABLE DESIGN PRESSURE" TABLE.
2. BUCKING, OPENINGS & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
3. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & MAY NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS.
4. THESE WINDOW SYSTEMS HAVE BEEN DESIGNED IN ACCORDANCE WITH & MEET THE REQUIREMENTS OF THE 2004 FLORIDA BUILDING CODE (F.B.C.) INCLUDING HVHZ (HIGH VELOCITY HURRICANE ZONES).
5. THESE WINDOWS HAVE BEEN TESTED IN ACCORDANCE WITH THE 2004 FLORIDA BUILDING CODE PROTOCOLS TAS-201, TAS-202 & TAS-203.
6. THESE WINDOW SYSTEMS ARE LARGE MISSILE IMPACT RATED & NEED NOT BE SHUTTERED.
7. ALL WINDOW SIZES SPECIFIED AS ALLOWABLE ARE AS CONTROLLED BY THE TESTED UNITS.
8. GLASS SHALL BE AS SPECIFIED IN THE GLAZING DETAIL(S).
9. ALL FRAME ANCHORS SECURING WINDOW FRAME TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
10. ALL ANCHOR EMBEDMENTS SPECIFIED SHALL BE BEYOND WALL FINISHES.
11. MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004 FLORIDA BUILDING CODE SECTION 2003.8.4.

**CORNER CONSTRUCTION:**

- WOOD FRAME: SQUARE CUT, RABBETED, SILICONE SEALED & SECURED WITH THREE (3) 16 GA. X 1/2" X 2" CROWN STAPLES.
- FRAME CLAD: MITER CUT, JOINED WITH A CORNER KEY & TWO (2) NO. 7 X 1/2" SCREWS & SEALED WITH A FOAM GASKET.
- WOOD SASH: MORTISE & TENON CONSTRUCTION AND SECURED WITH TWO (2) 14 GA. X 2 1/2" T-NAILS.
- SASH CLAD: SQUARE CUT, BUTTED TOGETHER AND SNAP FIT TO SASH AND SEALED WITH SILICONE.

ALLOWABLE SINGLE WINDOW SIZE/DESIGN PRESSURE									
MAXIMUM FRAME LONG DIMENSION (IN.)	MAXIMUM FRAME SHORT DIMENSION (IN.)	ALLOWABLE PRESSURE (PSF)							
		GLASS OPTION 1		GLASS OPTION 2		GLASS OPTION 3		GLASS OPTION 4	
		POS	NEG	POS	NEG	POS	NEG	POS	NEG
144	45					65.0	80.0		
	29			65.0	70.0	65.0	80.0	65.0	70.0
	18	65.0	70.0	65.0	85.0	65.0	80.0	65.0	70.0
132	50					65.0	80.0		
	32			65.0	70.0	65.0	80.0	65.0	70.0
	22			65.0	85.0	65.0	80.0	65.0	70.0
	18	65.0	70.0	65.0	85.0	65.0	80.0	65.0	70.0
120	55					65.0	80.0		
	36			65.0	70.0	65.0	80.0	65.0	70.0
	24			65.0	85.0	65.0	80.0	65.0	70.0
	21	65.0	70.0	65.0	85.0	65.0	80.0	65.0	70.0
108	61					65.0	80.0		
	40			65.0	70.0	65.0	80.0	65.0	70.0
	24	65.0	70.0	65.0	85.0	65.0	80.0	65.0	70.0
101	65					65.0	80.0		
	42			65.0	70.0	65.0	80.0	65.0	70.0
	28			65.0	85.0	65.0	80.0	65.0	70.0
	24	65.0	70.0	65.0	85.0	65.0	80.0	65.0	70.0
96	65					65.0	80.0		
	44			65.0	70.0	65.0	80.0	65.0	70.0
	30			65.0	85.0	65.0	80.0	65.0	70.0
	27	65.0	70.0	65.0	85.0	65.0	80.0	65.0	70.0
90	65					65.0	80.0		
	48			65.0	70.0	65.0	80.0	65.0	70.0
	32			65.0	85.0	65.0	80.0	65.0	70.0
	29	65.0	70.0	65.0	85.0	65.0	80.0	65.0	70.0
84	65					65.0	80.0		
	51			65.0	70.0	65.0	80.0	65.0	70.0
	34			65.0	85.0	65.0	80.0	65.0	70.0
	31	65.0	70.0	65.0	85.0	65.0	80.0	65.0	70.0
78	65					65.0	80.0		
	55			65.0	70.0	65.0	80.0	65.0	70.0
	37			65.0	85.0	65.0	80.0	65.0	70.0
	33	65.0	70.0	65.0	85.0	65.0	80.0	65.0	70.0
72	65					65.0	80.0		
	60			65.0	70.0	65.0	80.0	65.0	70.0
	40			65.0	85.0	65.0	80.0	65.0	70.0
	36	65.0	70.0	65.0	85.0	65.0	80.0	65.0	70.0
64	65					65.0	80.0		
	45			65.0	85.0	65.0	80.0	65.0	70.0
	40	65.0	70.0	65.0	85.0	65.0	80.0	65.0	70.0
60	60					65.0	80.0		
	48			65.0	70.0	65.0	80.0	65.0	70.0
	43	65.0	70.0	65.0	85.0	65.0	80.0	65.0	70.0
52	52					65.0	80.0		
	50	65.0	70.0	65.0	85.0	65.0	80.0	65.0	70.0
48	48	65.0	70.0	65.0	85.0	65.0	80.0	65.0	70.0

- NOTES:**
1. SEE GLAZING DETAILS FOR GLAZING OPTIONS
  2. CROSSED OUT BOXES DESIGNATE SIZES NOT ACCEPTABLE FOR THE RESPECTIVE GLASS OPTION.
  3. ALL DIMENSIONS ARE +/- 3/16"

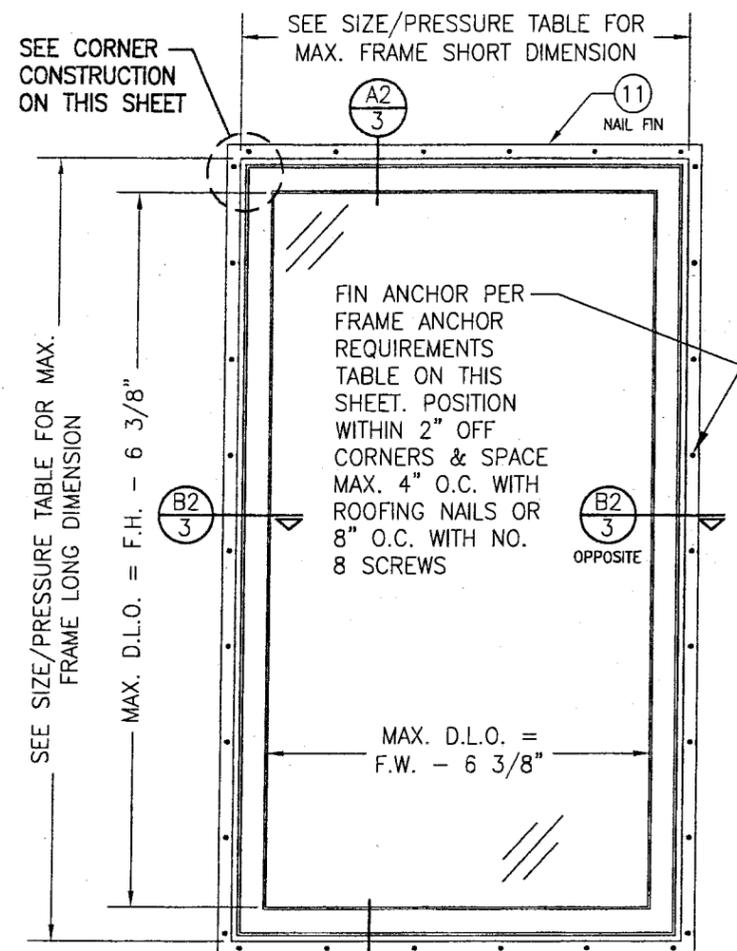


EXTERIOR ELEVATION; SINGLE WINDOW  
(FIN MOUNT)  
SCALE: 3/4"=1'-0"

**PRODUCT REVISED**  
as complying with the Florida Building Code  
Acceptance No. 07-0329.02  
Expiration Date: JUNE 29, 2011  
*Manuel Perez*  
Miami/Dade Product Control Division

FRAME ANCHOR REQUIREMENTS TABLE			
FRAME SCREW MOUNT			
OPENING TYPE (SUBSTRATE)	JAMB TO OPENING FASTENER TYPE	MINIMUM EMBED	MINIMUM EDGE DIST.
2X_ WOOD FRAME OR BUCK	NO. 10 SMS SCREW	1 1/4"	3/4"
CMU/CONCRETE	(1) 3/16" CONCRETE SCREW	1 1/4"	2"
FIN MOUNT			
2X_ WOOD FRAME OR BUCK	NO. 8 X 1 1/4" SMS SCREWS	1 1/8"	1/2"
2X_ WOOD FRAME OR BUCK	11 GA. X 2" ROOFING NAILS	1 3/4"	1/2"

(1) CONCRETE SCREWS SHALL BE ELCO OR ITW RAMSET/RED HEAD TAPCONS, HILTI KWIK-CON II OR POWERS RAWL TAPPER (HARDENED STEEL OR S.S.).

DRAWN BY: S.T.R.	CHECKED BY: W.W.S.		
PLOT: 1=16	DATE: 7/21/05		
NO.	REVISION DESCRIPTION	BY	DATE
A1	REVISED WINDOW SIZES, GLASS & GLAZING		
DRAWING TITLE: FEEL SAFE ALUMINUM CLAD WOOD IMPACT FIXED CASEMENT WINDOW			
MANUFACTURER: HURD WINDOWS & DOORS, INC. 575 S. WHELEN AVE. MEDFORD, WI 54451 800-433-4873			
CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 8885 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903			
DRAWING NO. 1404			
REV. A			
SHEET NO. 1 OF 4			

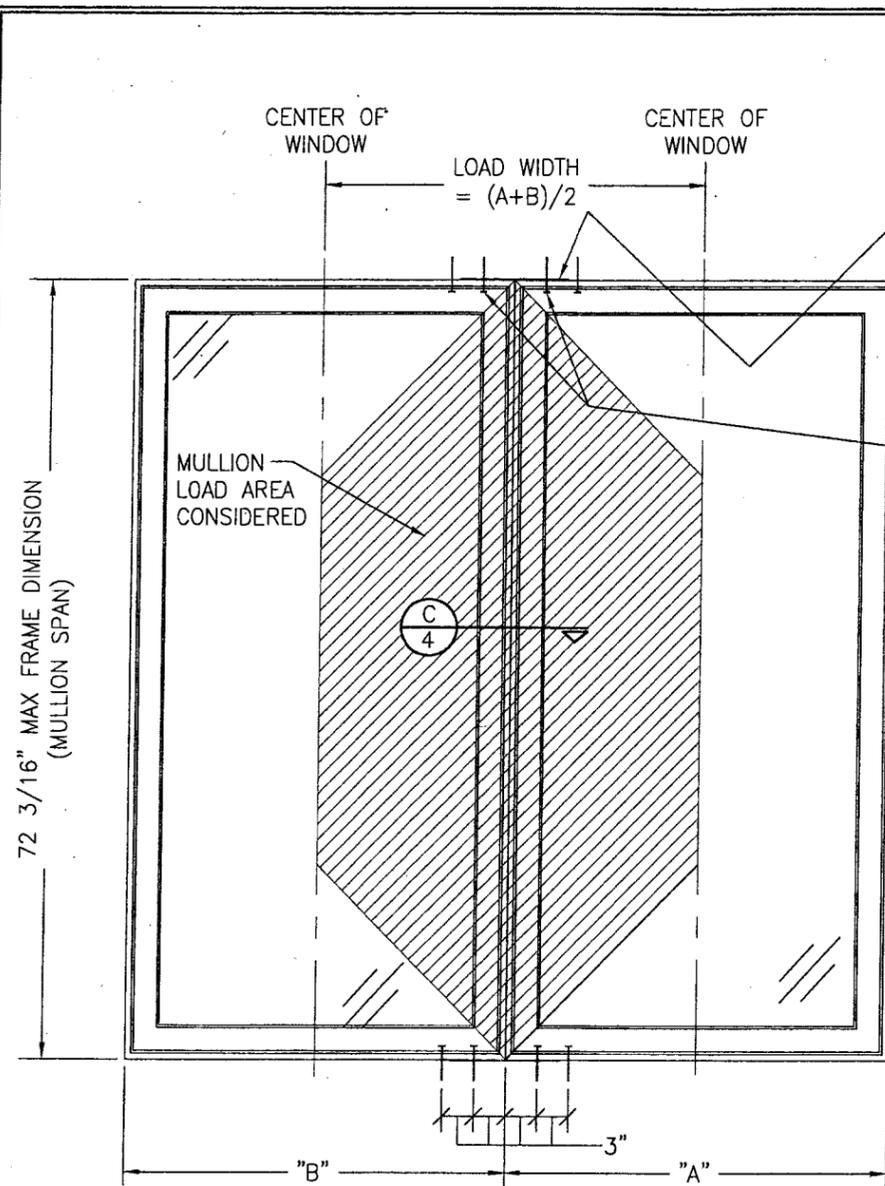

**EXTERIOR ELEVATION  
MULTIPLE FIXED WINDOWS**

SCALE: 3/4"=1'-0"

(FOR INDIVIDUAL WINDOW INSTALLATION & DETAILS, SEE SINGLE WINDOW ELEVATIONS)

(DOUBLE WINDOW SHOWN. MORE THAN 2 WINDOWS MAY BE MULLED TOGETHER IN ONE DIRECTION INTO ONE OPENING.)

NOTE: MULLION MAY BE HORIZONTAL OR VERTICAL

**MULTIPLE UNIT NOTES:**


1. THE MAXIMUM ALLOWABLE PRESSURE FOR A COMBINED UNIT IS RESTRICTED BY THE LESSER OF THE INDIVIDUAL WINDOW ALLOWABLE PRESSURE OR THE ALLOWABLE MULLION PRESSURE. SEE MULLION LOAD TABLE ON THIS SHEET FOR ALLOWABLE UNIT PRESSURE.
2. WINDOWS MAY BE STACKED HORIZONTAL OR VERTICAL. (IF VERTICALLY STACKED, MANUFACTURER MUST INSURE THAT THE DEAD WEIGHT OF THE WINDOWS DOES NOT CAUSE ANY WINDOW FAILURES OR DEFORMATIONS)

25 GA. X 2 3/8" X 10 1/4" GALVANIZED MULLION END REINFORCEMENT PLATE STAPLED TO EACH JAMB WITH FIVE (5) 16 GA. X 7/16" X 9/16" LONG STAPLES. (TYP. EACH END OF EACH MULLION)

NO. 10 SCREWS PER FRAME ANCHOR REQUIREMENTS TABLE. FOUR (4) TOTAL PER MULLION END WHETHER WINDOW IS SCREW MOUNTED OR FIN MOUNTED.

ALLOWABLE PRESSURE (MULLED UNITS)			
MAXIMUM MULLION SPAN (IN.)	MAXIMUM LOAD WIDTH (IN.)	ALLOWABLE PRESSURE (P.S.F.)	
		POSITIVE	NEGATIVE
72	60	61.8	66.5
	54	65	70
66	66	65	70
60	72	65	70
60	48	65	85


LESSER OF THE PRESSURE SHOWN IN THIS TABLE & THAT ALLOWED FOR THE INDIVIDUAL WINDOW SHALL CONTROL AS ALLOWABLE FOR THE OVERALL UNIT.  
LOAD WIDTH VALUES ARE +/- 1/2"

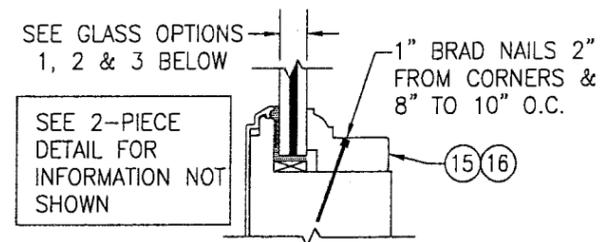

**NON-IG GLAZING DETAIL WITH  
1-PIECE GLAZING BEAD**

WHEN USING TREMCO S900, THE OVERALL WINDOW FRAME AREA MAY NOT EXCEED 30.4 S.F.


TREMCO S900, TREMCO S700 OR DOW 995 AT EXTERIOR & GLASS EDGE

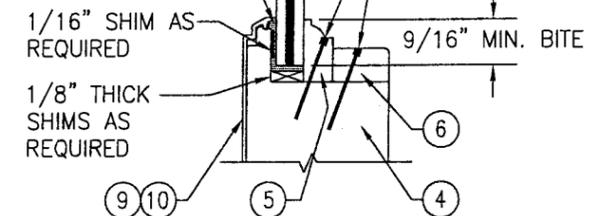

**NON-IG GLAZING DETAIL WITH  
2-PIECE GLAZING BEAD**

WHEN USING TREMCO S900, THE OVERALL WINDOW FRAME AREA MAY NOT EXCEED 29.9 S.F.

TREMCO S900, TREMCO S700 OR DOW 995 AT EXTERIOR & GLASS EDGE

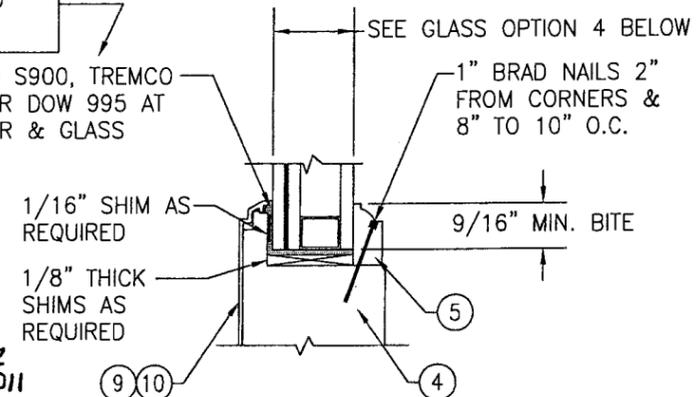


**IG GLAZING DETAIL WITH  
1-PIECE GLAZING BEAD**


**PRODUCT REVISED**  
as complying with the Florida Building Code  
Acceptance No. 07-0329.02  
Expiration Date, JUNE 29, 2011  
By *Mauro Pera*  
Miami Dade Product Control Division

- OPTION 1: 3/8" LAMINATED GLASS BY SOLUTIA (5/32" AN/0.09 SOLUTIA SAFLEX IIIIG PVB/5/32" AN).
- OPTION 2: 9/16" LAMINATED OLDCASTLE STORMGLASS (1/4" AN/0.075 SOLUTIA VANCEVA/1/4" AN).
- OPTION 3: 9/16" LAMINATED OLDCASTLE STORMGLASS (1/4" HT. ST./0.075 SOLUTIA VANCEVA/1/4" HT. ST.).
- OPTION 4: IG GLASS WITH 3/8" EXTERIOR LAMINATED GLASS BY SOLUTIA (5/32" HT. ST./0.09 SOLUTIA SAFLEX IIIIG PVB/5/32" HT. ST.), 7/16" SPACER & 5/32" TEMPERED AT INTERIOR

DRAWN BY: S.T.R.	CHECKED BY: W.W.S.
PLOT: 1-16	DATE: 7/21/05
NO.	REVISION DESCRIPTION
BY	DATE
DRAWING TITLE FEEL SAFE ALUMINUM CLAD WOOD IMPACT FIXED CASEMENT WINDOW	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 8895 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903	
MANUFACTURER HURD WINDOWS & DOORS, INC. 575 S. WHELEN AVE. MEDFORD, WI 54451 800-433-4873	
CERTIFICATION MAY 21 2007 WARREN W. SCHAEFER, P.E. P.E. NO. 44135	
DRAWING NO. 1404	REV. A
SHEET NO. 2 OF 4	

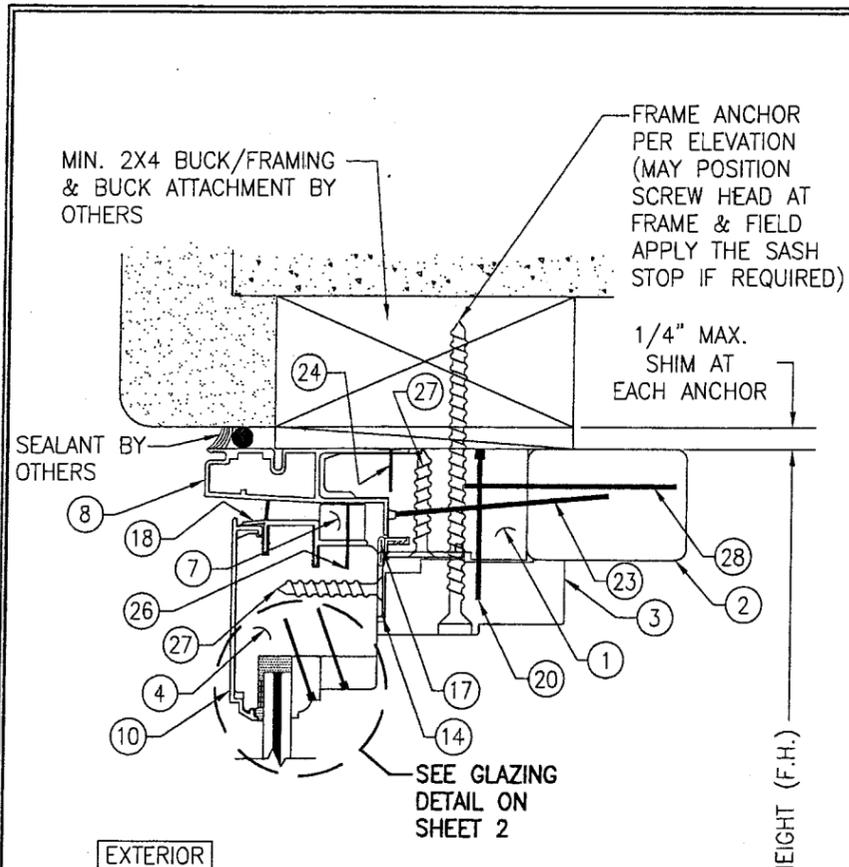


SECTION A1  
SCALE: 1/2 FULL  
3

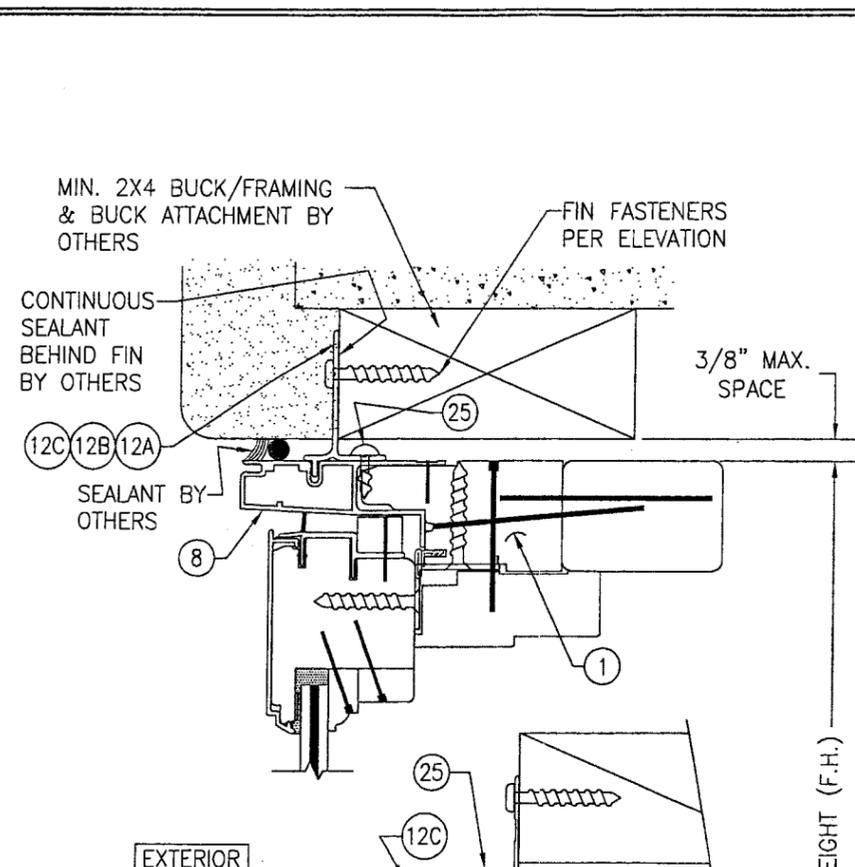


SECTION A2  
SCALE: 1/2 FULL  
3


(SEE SECTION A1/3 FOR DETAILS NOT SHOWN)

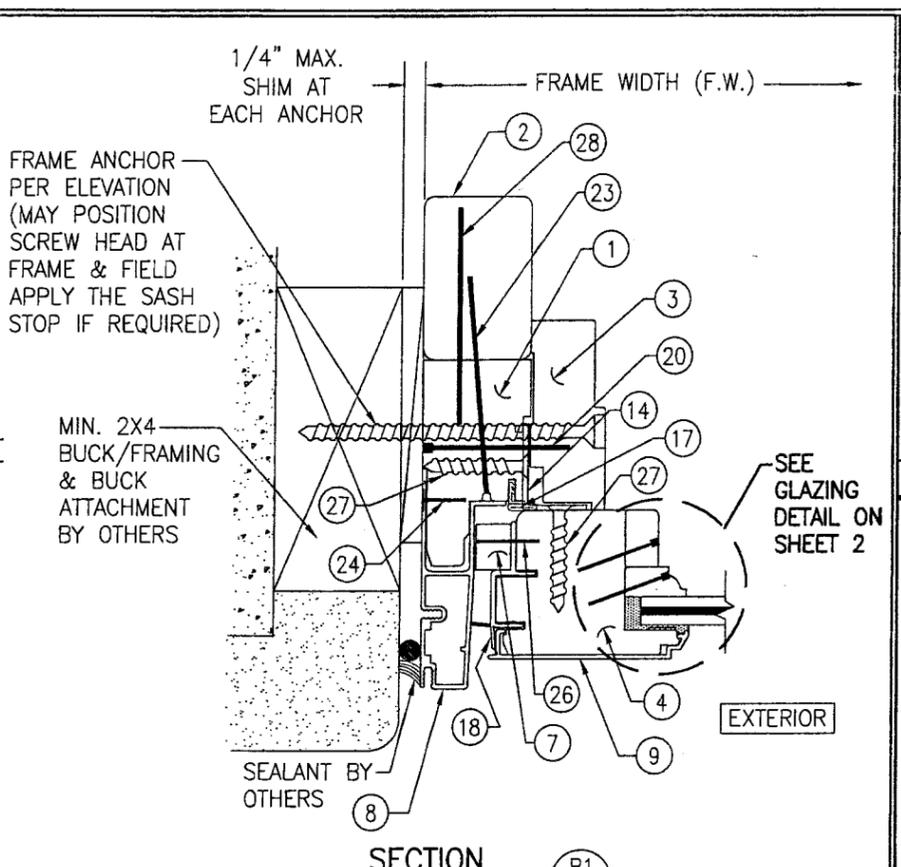

SECTION B1  
SCALE: 1/2 FULL  
3

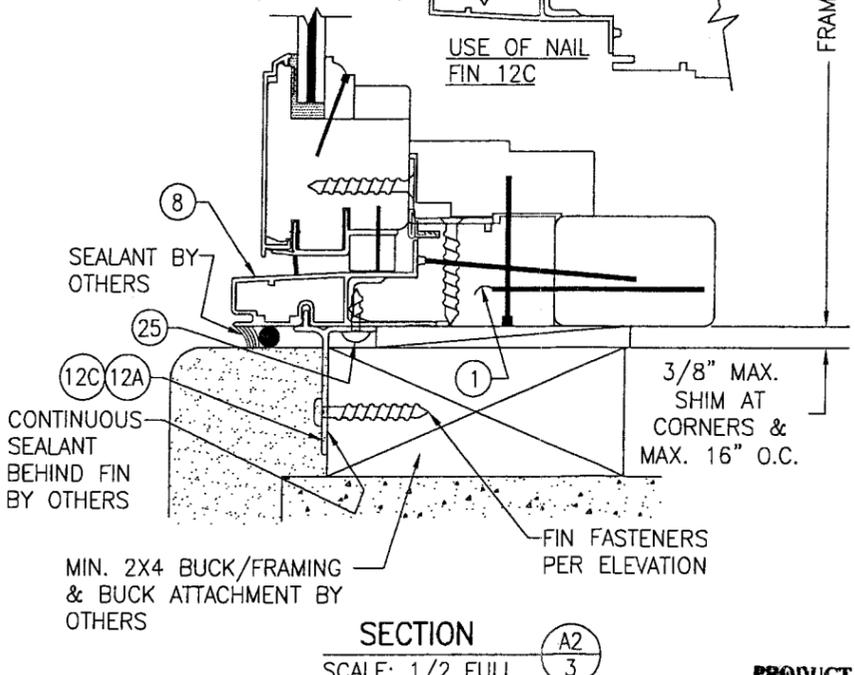

SECTION A2  
SCALE: 1/2 FULL  
3

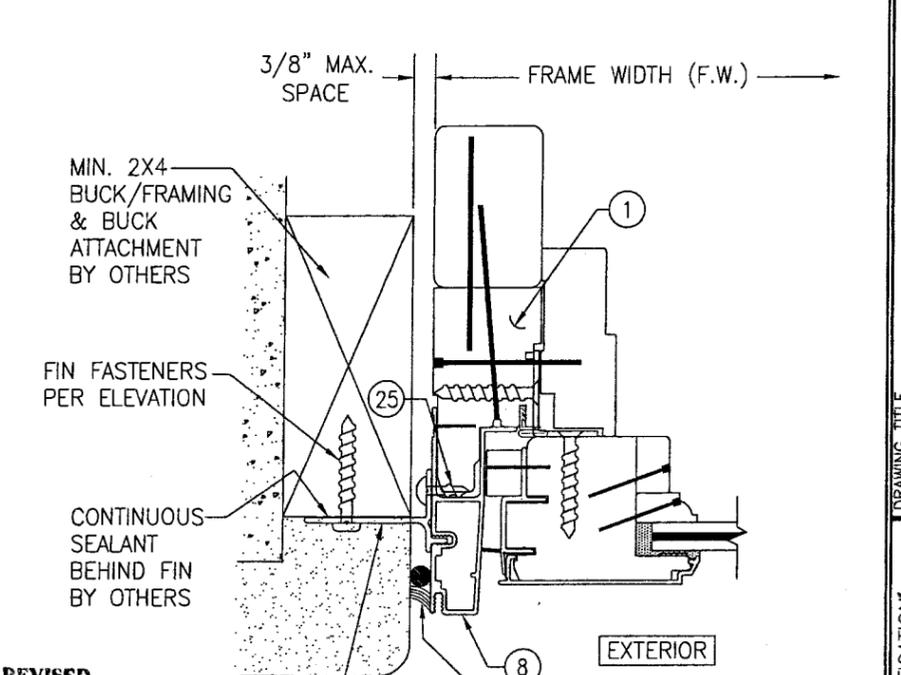


SECTION B2  
SCALE: 1/2 FULL  
3

(SEE DETAIL B1/3 FOR DETAILS NOT SHOWN)


**PRODUCT REVISED**  
as complying with the Florida Building Code  
Acceptance No. 07-0379.02  
Expiration Date ~~JUNE 29, 2011~~  
By *Michael Are*  
Miami Dade Product Control Division

DRAWN BY: S.T.R.	CHECKED BY: W.W.S.
PLOT: 1=2	DATE: 7/21/05
NO.	REVISION DESCRIPTION
DATE	BY
NO.	REVISION DESCRIPTION
DATE	BY
DRAWING TITLE FEEL SAFE ALUMINUM CLAD WOOD IMPACT FIXED CASEMENT WINDOW	
MANUFACTURER HURD WINDOWS & DOORS, INC. 575 S. WHELEN AVE. MEDFORD, WI 54451 800-433-4873	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 8895 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903	
CERTIFICATION MAY 21 2007 WARREN W. SCHAEFER, P.E. P.E. NO. 44135	
DRAWING NO. 1404	REV. A
SHEET NO. 3 OF 4	

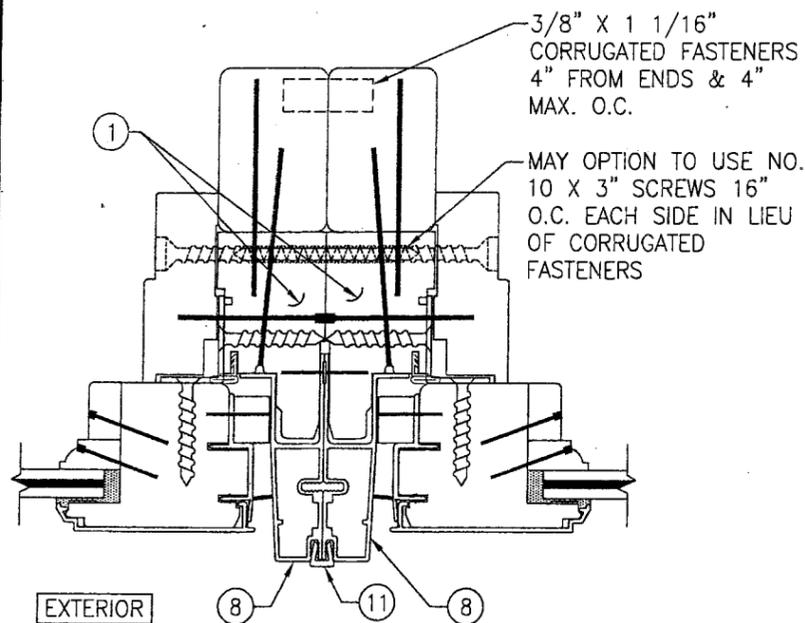

SECTION C  
SCALE: 1/2 FULL  
4


(SEE SECTION B1/3 FOR DETAILS NOT SHOWN)

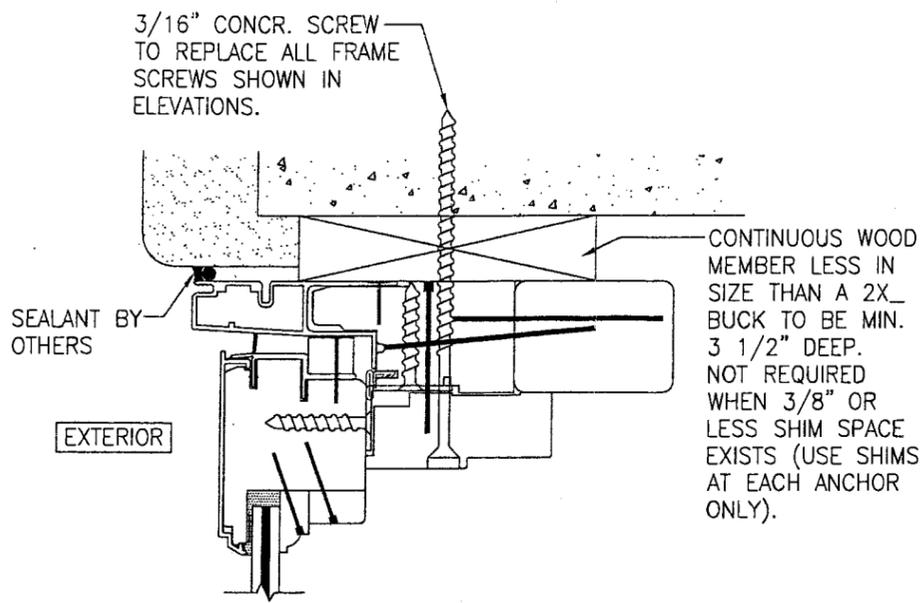

OPTIONAL DIRECT MOUNT DETAIL TO BLOCK OR CONCRETE WITH SPACER OR SHIM  
HEAD SECTION SHOWN, SIDES AND SILL SIMILAR

ITEM #	PART #	ITEM DESCRIPTION	MANUFACTURER/NOTES
PARTS			
1	CCSE 223	HEAD, SILL, & SIDE JAMB	* PONDEROSA/SUGAR PINE
2	CCSE 225	JAMB EXTENDER	* PONDEROSA/SUGAR PINE
3	HC 155	JAMB STOP	* PONDEROSA/SUGAR PINE
4	ECSE 200	STILE AND RAIL	* PONDEROSA/SUGAR PINE
5	ALWD 375	GLAZING BEAD	* PONDEROSA/SUGAR PINE
6	300-0025	STATIONARY BLOCK	* PONDEROSA/SUGAR PINE
7	CCSE 300	SASH SPACER BLOCK	* PONDEROSA/SUGAR PINE
8	CCSE 440	JAMB CLAD	6063-T6 ALUMINUM
9	ECSE 400	RAIL/STILE CLAD	6063-T5 ALUMINUM
10	ECSE 405	OPTIONAL RAIL CLAD	6063-T5 ALUMINUM
11	PA 115	MULLION CLIP	6060-T5 ALUMINUM
12A	-	STANDARD NAIL FIN	6063-T6 ALUMINUM
12B	-	STANDARD NAIL FIN WITH DRIP	6063-T6 ALUMINUM
12C	-	DRIP CAP NAIL FIN	6063-T6 ALUMINUM
13	CCSE 620	JAMB CORNER KEY	NYLON 66 MATERIAL
14	-	STATIONARY SASH CLIP	5" FROM CORNERS & 10" O.C.
15	216273	1-PIECE GLAZING BEAD	* PONDEROSA/SUGAR PINE
16	216275	1-PIECE GLAZING BEAD	* PONDEROSA/SUGAR PINE
SEALS AND SEALANTS			
17	020546	FRAME WEATHERSTRIP	GREY SANTOPRENE FOAM
18	ECSE 625	SASH WEATHERSTRIP	VINYL
FASTENERS			
20	092748	13 GA. 1 1/2" RING SHANK OR SPIRAL NAIL	4" FROM CORNERS & 6" TO 12" O.C.
23	024617	2 1/2" X 1" CROWN STAPLE	2" FROM CORNERS & 10" O.C. (REQUIRED WHEN WINDOW FRAME DIMENSION IN EITHER DIRECTION IS 72 3/16" OR LESS)
24	019892	#18 X 1/2" GSN STAPLE	2" FROM CORNERS & 7" TO 10" O.C.
25	-	#6 X 5/8" PH SCREW	2" FROM CORNERS & 9" O.C.
26	-	18 GA. X 3/4" STAPLE	1 PER SPACER BLOCK
27	-	#8 X 1 1/4" S.S. SMS	2 PER CLIP
28	-	AUTO-NAIL WIRE	4" FROM CORNERS & 8" O.C. (REQUIRED WHEN WINDOW FRAME DIMENSION IN EITHER DIRECTION IS GREATER THAN 72 3/16")

\* WOOD USED WITH TEST UNITS WAS GRADE 2 PONDEROSA PINE. ALTERNATE WOOD SPECIES TO BE APPLICABLE WITH THESE WINDOWS IS MIN. GRADE 2 MAHOGANY, SOUTHERN PINE, OAK, CHERRY, MAPLE, DOUGLAS FIR & CYPRUS.  
NOTE: ALL WOOD IS RECEIVED BY HURD MILLWORK AS GRADE 2, BUT IS MACHINED BY HURD TO A SELECT GRADE USE.

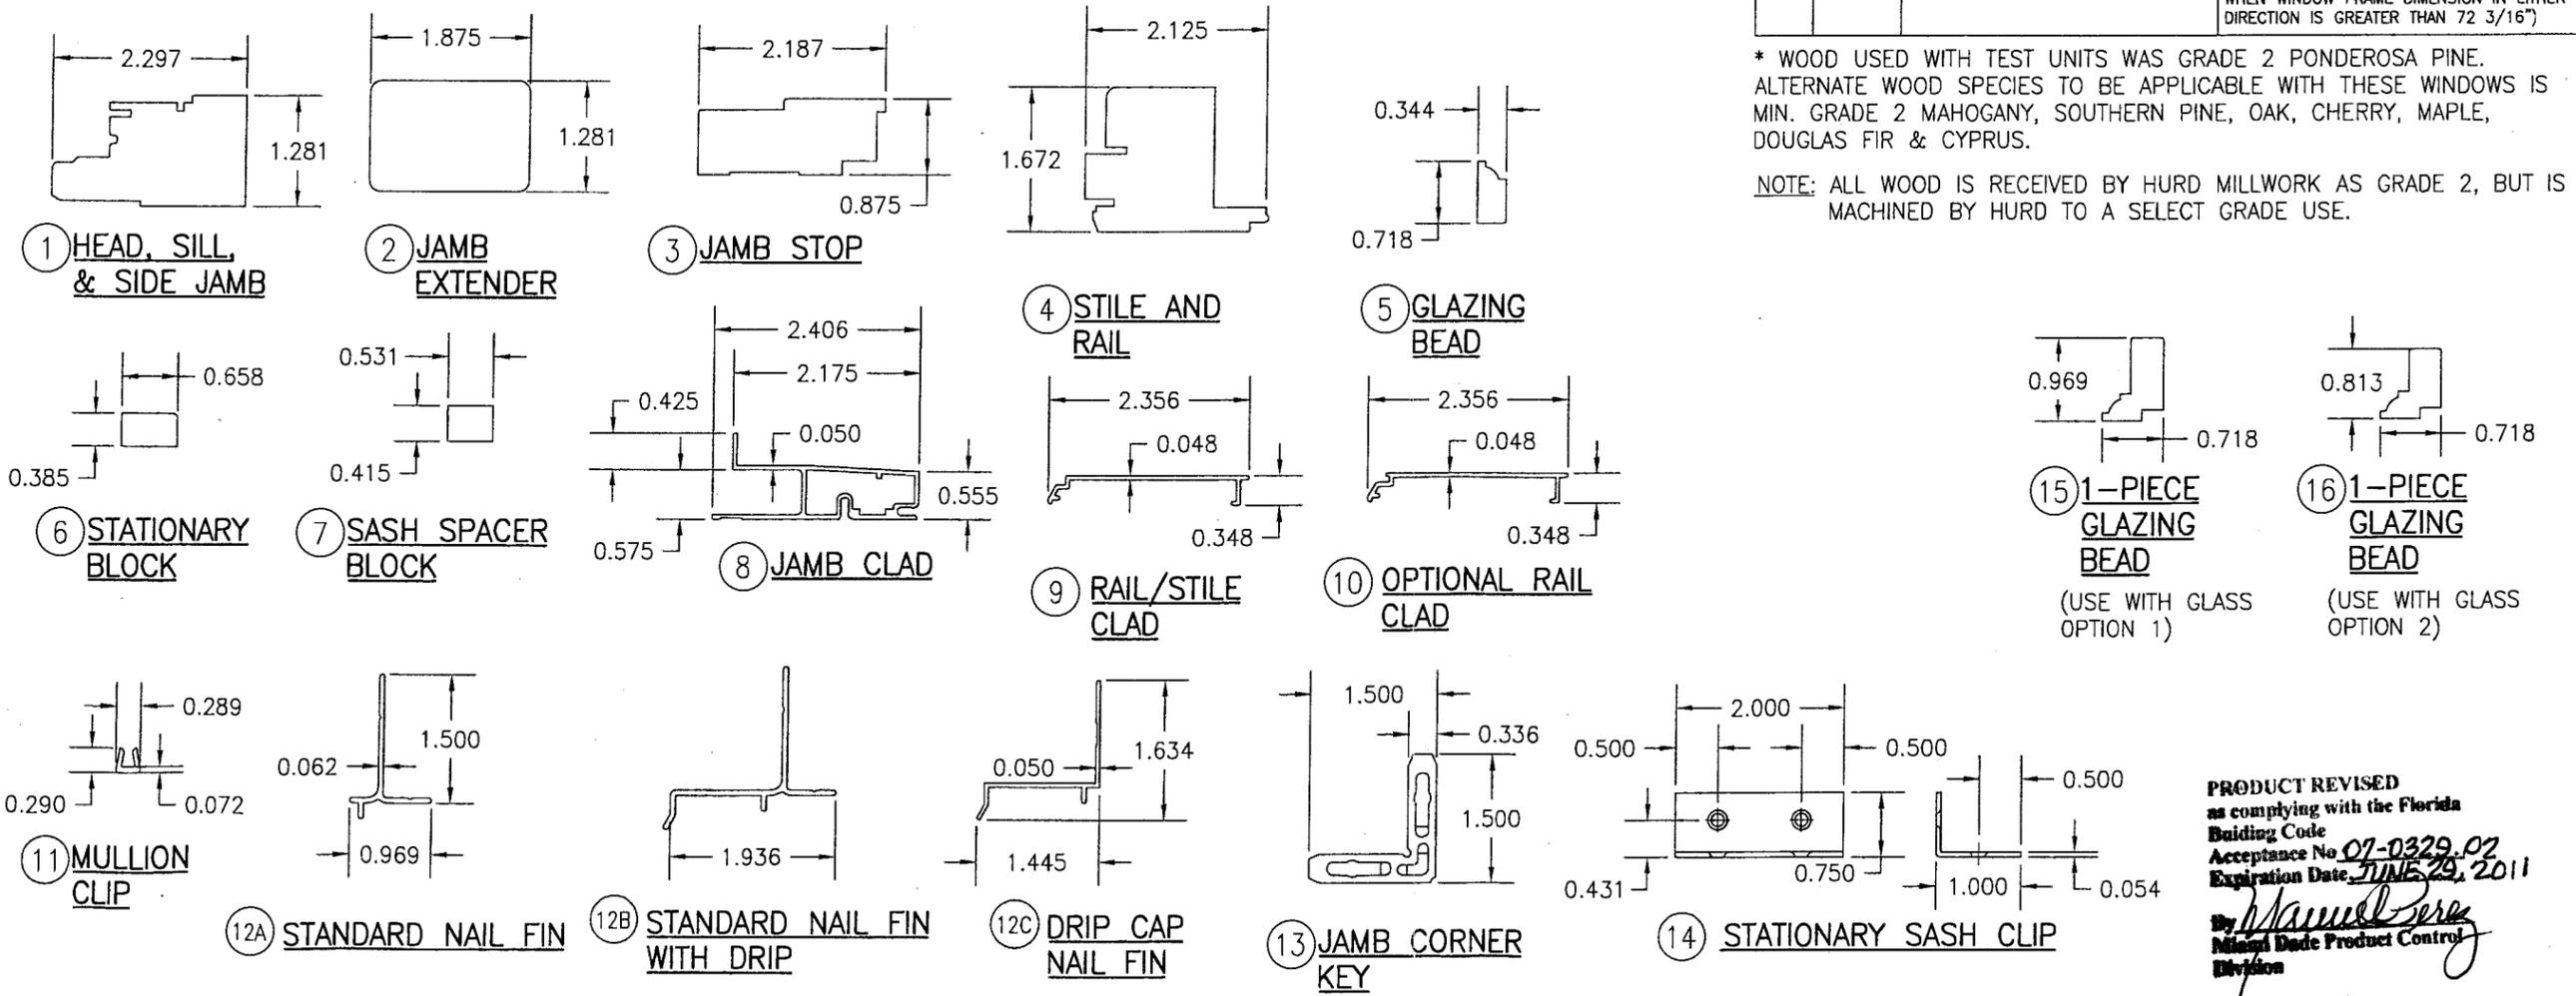

DRAWN BY: S.T.R. CHECKED BY: W.W.S.  
PLOT: 1=2 DATE: 7/21/05

REVISION DESCRIPTION

DRAWING TITLE: FEEL SAFE ALUMINUM CLAD WOOD IMPACT FIXED CASEMENT WINDOW

MANUFACTURER: HURD WINDOWS & DOORS, INC.  
575 S. WHELEN AVE.  
MEDFORD, WI 54451  
800-433-4873

CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.  
8895 N. MILITARY TRAIL, SUITE C-204  
PALM BEACH GARDENS, FL 33410  
PHONE: 561-775-4902 FAX: 561-775-4903

CERTIFICATION: *Warren W. Schaefer, P.E.*  
MAY 21 2007  
WARREN W. SCHAEFER, P.E.  
P.E. NO. 44135

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 07-0329.02 Expiration Date: JUNE 29, 2011  
By: *Warren W. Schaefer*  
Miami Dade Product Control Division

DRAWING NO. 1404 REV. A  
SHEET NO. 4 OF 4