



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**NOTICE OF ACCEPTANCE (NOA)**

[www.buldingcodeonline.com](http://www.buldingcodeonline.com)

**Hurd Windows & Doors, Inc.**  
575 South Whelen Avenue  
Medford, WI 54451

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "Feel Safe Energy Saver" Direct Set Aluminum Clad Wood Fixed Window – L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. 1515, titled "Feel Safe Energy Saver Clad Direct Set Impact Window", sheets 1 through 5 of 5, dated 02/13/07, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 07-0329.03  
Expiration Date: June 07, 2012  
Approval Date: June 07, 2007  
Page 1

**Hurd Windows & Doors, Inc.**


**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **1515**, Sheets 1 through 5 of 5, titled "Feel Safe Energy Saver Clad Direct Set Impact Window", dated 02/13/07, prepared by W. W. Schaefer Engineering and Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of a Feel Safe Energy Saver clad direct set window, prepared by Stork Twin City Testing Corporation, Test Report No. **TCTC-180-7143.1**, dated 05/26/06, signed and sealed by Thomas Kolden, P.E.
2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of a Feel Safe Energy Saver clad direct set window, prepared by Stork Twin City Testing Corporation, Test Report No. **TCTC-180-7143.2**, dated 05/26/06, signed and sealed by Thomas Kolden, P.E.
3. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of a Feel Safe Energy Saver clad direct set windows mullied together, prepared by Stork Twin City Testing Corporation, Test Report No. **TCTC-180-7144**, dated 06/22/06, signed and sealed by Thomas Kolden, P.E.

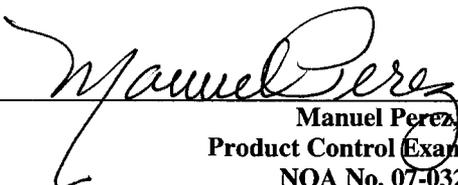  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 07-0329.03  
Expiration Date: June 07, 2012  
Approval Date: June 07, 2007

**Hurd Windows & Doors, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

4. Test reports on
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of a Feel Safe Energy Saver clad direct set windows mulled together, prepared by Stork Twin City Testing Corporation, Test Report No. **TCTC-180-7249**, dated 12/12/06, signed and sealed by Thomas Kolden, P.E.

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC-2004, dated 02/27/07, prepared by W. W. Schaefer Engineering and Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E..  
**Complies with ASTM E1300-02**

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **03-0415.13** issued to Old Castle Glass for their "DuPont **Stormglass Laminated Glass**" dated 12/11/03, expiring on 12/18/08.
2. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "**Saflex III G Clear or colored interlayer**" dated 01/08/04, expiring on 05/21/06.
3. Notice of Acceptance No. **06-1205.10** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass ® Plus**" dated 02/15/07, expiring on 01/14/08.

**F. STATEMENTS**


1. Statement letter of conformance, dated February 27, 2007, signed and sealed by Warren W. Schaefer, P.E.
2. Statement letter of no financial interest, dated February 27, 2007, signed and sealed by Warren W. Schaefer, P.E.

**G. OTHER**

1. None.

  
\_\_\_\_\_  
**Manuel Perez, P.E.**  
**Product Control Examiner**  
**NOA No. 07-0329.03**  
**Expiration Date: June 07, 2012**  
**Approval Date: June 07, 2007**



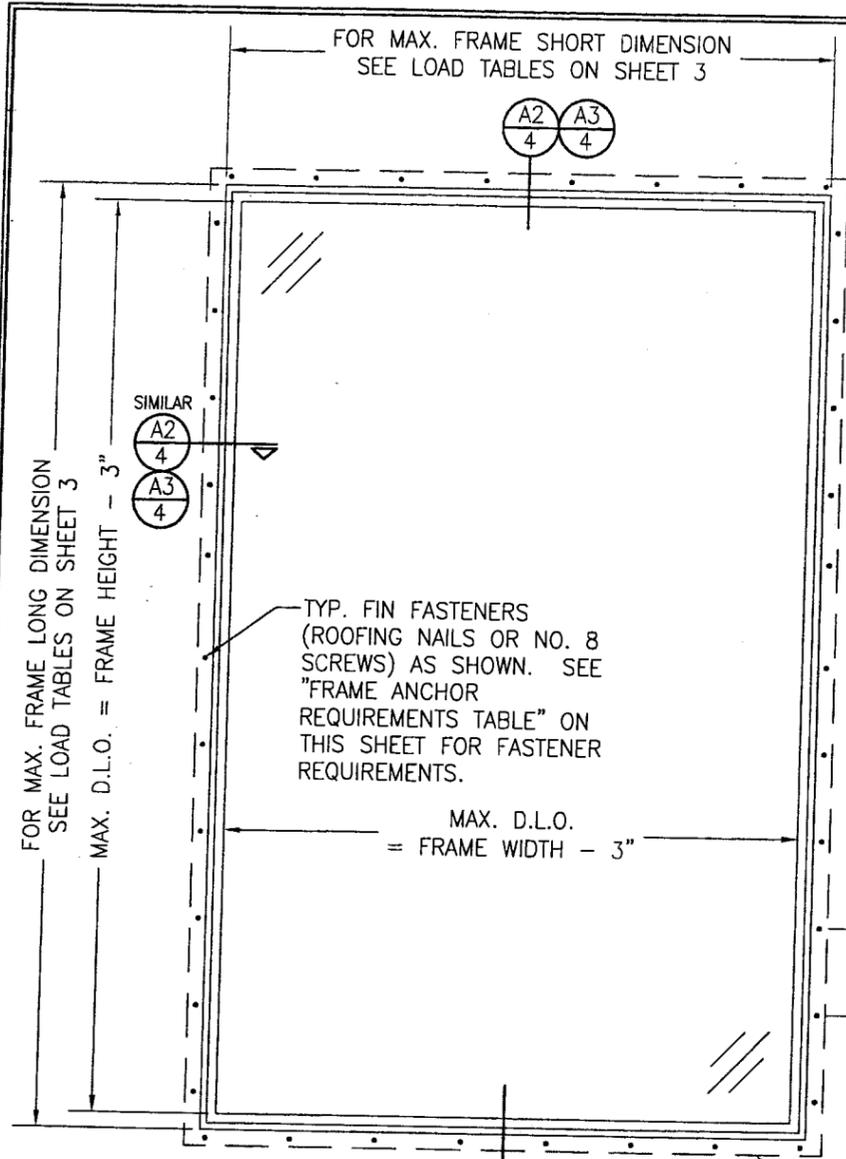


**EXTERIOR ELEVATION  
SINGLE DIRECT GLAZED WINDOW**  
SCALE: N.T.S.  
(NAIL FIN CONDITION)

⑧ NAIL FIN

4" MAX. O.C WITH ROOFING NAILS OR 8" MAX. O.C. WITH NO. 8 SCREWS (MAX. CORNER DISTANCE = 2")


SEE MULTIPLE UNIT NOTE 6 ON SHEET 1 FOR ON BELOW FOR SPECIAL LOAD WIDTH CONDITIONS

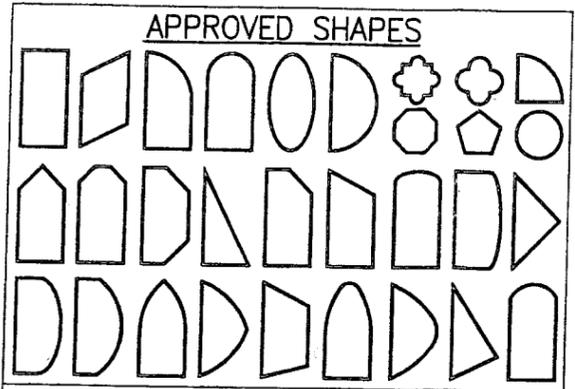

**NOTES:**  
1. OTHER SHAPES MAY APPLY PROVIDING THEY ARE SIMILAR TO THOSE SHOWN & HAVE CORNER CONSTRUCTION AS DESCRIBED ON THIS SHEET.  
2. ALL SHAPED UNITS MUST FIT INSCRIBED INTO THE ALLOWABLE RECTANGULAR UNITS & BE GOVERNED BY THE ALLOWABLE PRESSURE OF THE RESPECTIVE RECTANGULAR UNIT.

RECTANGULAR WINDOWS SHOWN. ANCHORING OF SHAPED WINDOWS IS THE SAME WITH REQUIRED ANCHOR SPACING ALONG THE FRAME CIRCUMFERENCE BEING THE SAME AS SPECIFIED FOR A STRAIGHT FRAME.

SEE LOAD TABLE ON SHEET 3 FOR MAX. LOAD WIDTH

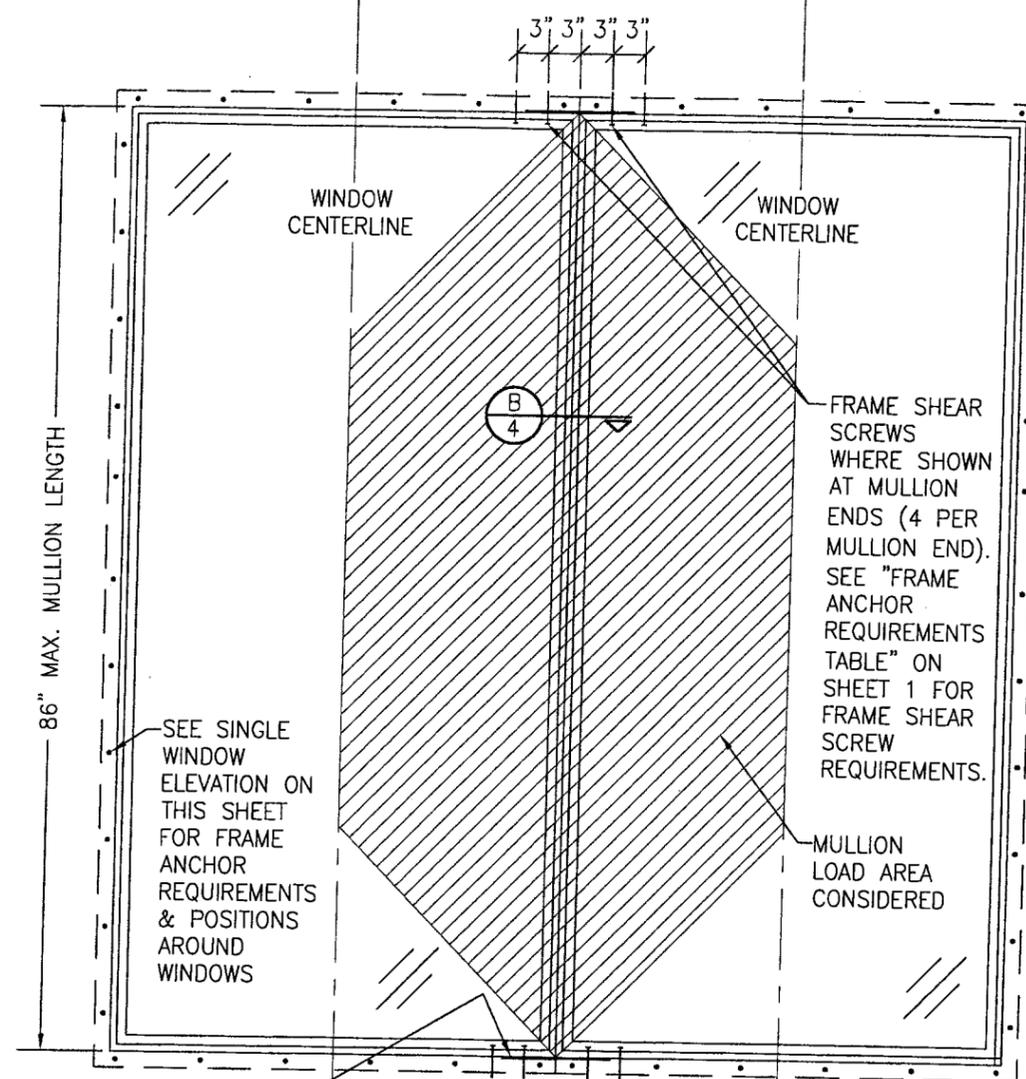

**EXTERIOR ELEVATION  
MULTIPLE FIXED WINDOW UNIT**  
SCALE: N.T.S.  
(NAIL FIN CONDITION)

2.385" X 10.25" X 0.02" THICK GALVANIZED METAL STRIP ACROSS MULLION JOINT & SECURED TO EACH JAMB WITH (15) 7/16" X 5/8" STAPLES) TYP. EACH MULLION END

(FOR MULTIPLE WINDOW UNIT NOTES, SEE ELEVATION ON SHEET 1)

**FRAME ANCHOR REQUIREMENTS TABLE**

NAILING FIN & DRIP CAP			
OPENING TYPE (SUBSTRATE)	FRAME/CLIP/NAIL FIN TO OPENING FASTENER TYPE	MINIMUM EMBED	MINIMUM EDGE DIST.
2X_ WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 8 X 1 1/4" SMS	1 1/8"	1/2"
2X_ WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	2" X 11 GA. ROOFING NAIL	1 7/8"	1/2"
MIN. 1/8" THK A36 STEEL	NO. 8 SELF TAP/DRILLING SCREW	FULL	1/2"
MIN. 1/8" THK 6063-T5 ALUM.	NO. 8 SELF TAP/DRILLING SCREW	FULL	1/2"

DRAWN BY: W.R.M.	CHECKED BY: W.W.S.
PLOT: 1-16	DATE: 02/13/07
NO.	REVISION DESCRIPTION
BY	DATE

DRAWING TITLE: FEEL SAFE ENERGY SAVER CLAD DIRECT SET IMPACT WINDOWS

MANUFACTURER: HURD MILLWORK CO., INC.  
575 S. WHELEN AVE.  
MEDFORD, WI 54451  
800-433-4873


CONSULTANTS: W. W. SCHAEFFER ENGINEERING & CONSULTING, P.A.  
8895 N. MILITARY TRAIL, SUITE C-204  
PALM BEACH GARDENS, FL 33410  
PHONE: 561-775-4902 FAX: 561-775-4903

CERTIFICATION: MAR 23 2007

WARREN W. SCHAEFFER, P.E.  
P.E. NO. 44135

Approved as complying with the Florida Building Code  
Date: JUNE 7, 2007  
NO. 07-0329.03  
Miami Dade Product Control  
By: *Mamuel Perry*

DRAWING NO. 1515	REV.
SHEET NO. 2	OF 5

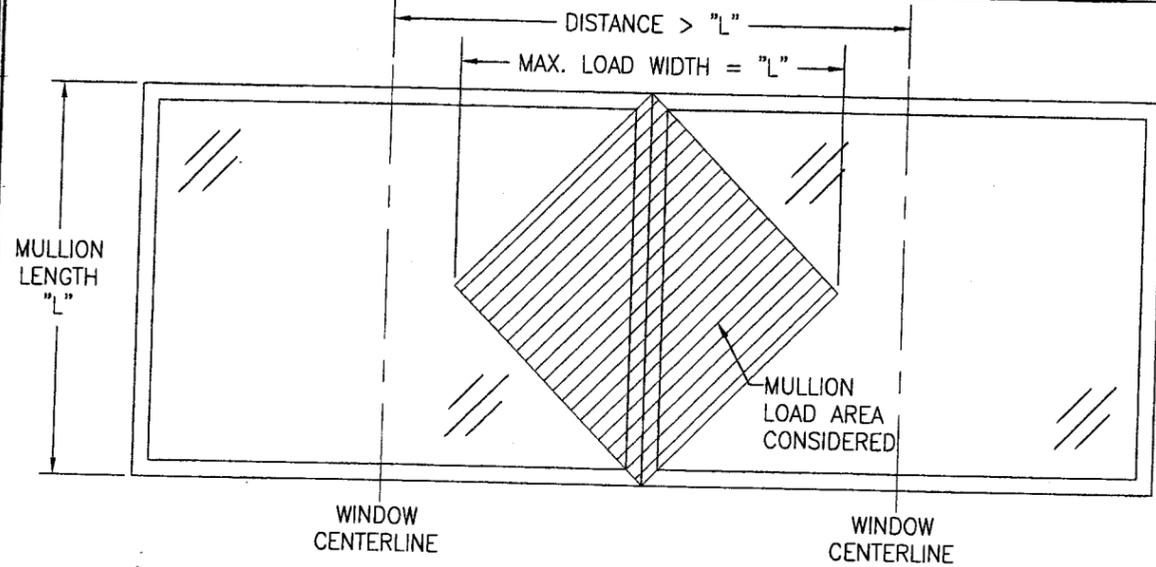

**MULLED DIAGRAM WHEN DISTANCE BETWEEN WINDOW CENTERLINES EXCEEDS MULLION LENGTH (SEE MULLION LOAD TABLE)**  
SEE OTHER ELEVATIONS FOR WINDOW DETAIL NOT SHOWN

MAXIMUM MULLION SPAN (IN.)	MAXIMUM LOAD WIDTH (IN.)	ALLOWABLE PRESSURE (PSF)					
		SHEAR SCREW MOUNT CONDITION				NAIL FIN MOUNT CONDITION	
		4 END FRAME SCREWS		6 END FRAME SCREWS		4 END FRAME SCREWS	
		POS.	NEG.	POS.	NEG.	POS.	NEG.
86	62	56.3	58.8	56.3	60.7	56.3	60.7
	60	57.4	59.7	57.4	61.9	57.4	61.9
	54	61.4	62.9	61.4	66.2	61.4	66.2
	50	65.0	65.7	65.0	70.0	65.0	70.0
	48	65.0	67.4	65.0	71.7	65.0	71.7
	42	65.0	73.4	65.0	78.2	65.0	78.2
	36	65.0	81.9	65.0	85.0	65.0	85.0
	34	65.0	85.0	65.0	85.0	65.0	85.0
84	62	59.6	61.0	59.6	64.1	59.6	64.1
	60	60.8	61.9	60.8	65.5	60.8	65.5
	54	64.4	65.1	64.4	69.4	64.4	69.4
	48	65.0	69.6	65.0	74.1	65.0	74.1
	42	65.0	75.8	65.0	80.7	65.0	80.7
	36	65.0	84.4	65.0	85.0	65.0	85.0
	62	65.0	68.8	65.0	73.3	65.0	73.3
	60	65.0	69.6	65.0	74.1	65.0	74.1
78	54	65.0	72.8	65.0	77.5	65.0	77.5
	48	65.0	77.3	65.0	82.4	65.0	82.4
	42	65.0	83.7	65.0	85.0	65.0	85.0
	62	65.0	78.9	65.0	84.0	65.0	84.0
72	60	65.0	79.5	65.0	84.7	65.0	84.7
	54	65.0	82.5	65.0	85.0	65.0	85.0
	48	65.0	85.0	65.0	85.0	65.0	85.0
66	62	65.0	85.0	65.0	85.0	65.0	85.0

LESSER OF THE PRESSURE SHOWN IN THIS TABLE & THAT ALLOWED FOR THE INDIVIDUAL WINDOW SHALL CONTROL AS ALLOWABLE FOR THE OVERALL UNIT.

MAXIMUM FRAME LONG DIMENSION (IN.)	MAXIMUM FRAME SHORT DIMENSION (IN.)	ALLOWABLE SINGLE WINDOW DESIGN PRESSURE							
		ALLOWABLE PRESSURE (PSF)							
		GLASS OPTION 1 & 2		GLASS OPTION 3		GLASS OPTION 4 & 5		GLASS OPTION 6	
		POS	NEG	POS	NEG	POS	NEG	POS	NEG
144	42	65.0	85.0			65.0	85.0		
	30	65.0	85.0			65.0	85.0	65.0	70.0
	20	65.0	85.0	65.0	70.0	65.0	85.0	65.0	70.0
132	46	65.0	85.0			65.0	85.0		
	32	65.0	85.0			65.0	85.0	65.0	70.0
	22	65.0	85.0	65.0	70.0	65.0	85.0	65.0	70.0
120	48	65.0	85.0			65.0	85.0		
	36	65.0	85.0			65.0	85.0	61.9	61.9
	30	65.0	85.0			65.0	85.0	65.0	70.0
108	24	65.0	85.0	65.0	70.0	65.0	85.0	65.0	70.0
	54	65.0	85.0			65.0	85.0		
	36	65.0	85.0			65.0	85.0	65.0	65.0
98	30	65.0	85.0			65.0	85.0	65.0	70.0
	27	65.0	85.0	65.0	70.0	65.0	85.0	65.0	70.0
	62	65.0	85.0			65.0	85.0		
90	42	65.0	85.0			65.0	85.0	58.4	58.4
	36	65.0	85.0			65.0	85.0	65.0	70.0
	30	65.0	85.0	65.0	70.0	65.0	85.0	65.0	70.0
86	62	65.0	85.0			65.0	85.0		
	48	65.0	85.0			65.0	85.0	58.5	58.5
	42	65.0	85.0			65.0	85.0	64.5	64.5
78	36	65.0	85.0			65.0	85.0	65.0	70.0
	32	65.0	85.0	65.0	70.0	65.0	85.0	65.0	70.0
	62	65.0	85.0			65.0	85.0		
72	50	65.0	85.0			65.0	85.0	60.2	60.2
	48	65.0	85.0			65.0	85.0	61.8	61.8
	42	65.0	85.0			65.0	85.0	65.0	67.7
64	36	65.0	85.0			65.0	85.0	65.0	70.0
	34	65.0	85.0	65.0	70.0	65.0	85.0	65.0	70.0
	62	65.0	85.0			65.0	85.0		

NOTES:  
1. SEE GLAZING DETAILS FOR GLAZING OPTIONS  
2. CROSSED OUT BOXES DESIGNATE SIZES NOT ACCEPTABLE FOR THE RESPECTIVE GLASS OPTION.






DRAWN BY: W.R.M.	CHECKED BY: W.W.S.
PLOT: 1=16	DATE: 02/13/07
DATE	
BY	
REVISION DESCRIPTION	
NO.	

FEEL SAFE ENERGY SAVER CLAD DIRECT SET IMPACT WINDOWS  
MANUFACTURER  
**HURD MILLWORK CO., INC.**  
575 S. WHELEN AVE.  
MEDFORD, WI 54451  
800-433-4873

CONSULTANTS  
**W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.**  
8895 N. MILITARY TRAIL, SUITE C-204  
PALM BEACH GARDENS, FL 33410  
PHONE: 561-775-4902 FAX: 561-775-4903


DRAWING TITLE  
CERTIFICATION  
**MAR 23 2007**  
DRAWING NO. 1515  
SHEET NO. 3 OF 5  
WARREN W. SCHAEFER, P.E.  
P.E. NO. 44135

Approved as complying with the Florida Building Code  
Date **JUNE 7, 2007**  
NGAS **07-0329.03**  
Miami Dade Program Control  
By *Warren W. Schaefer*

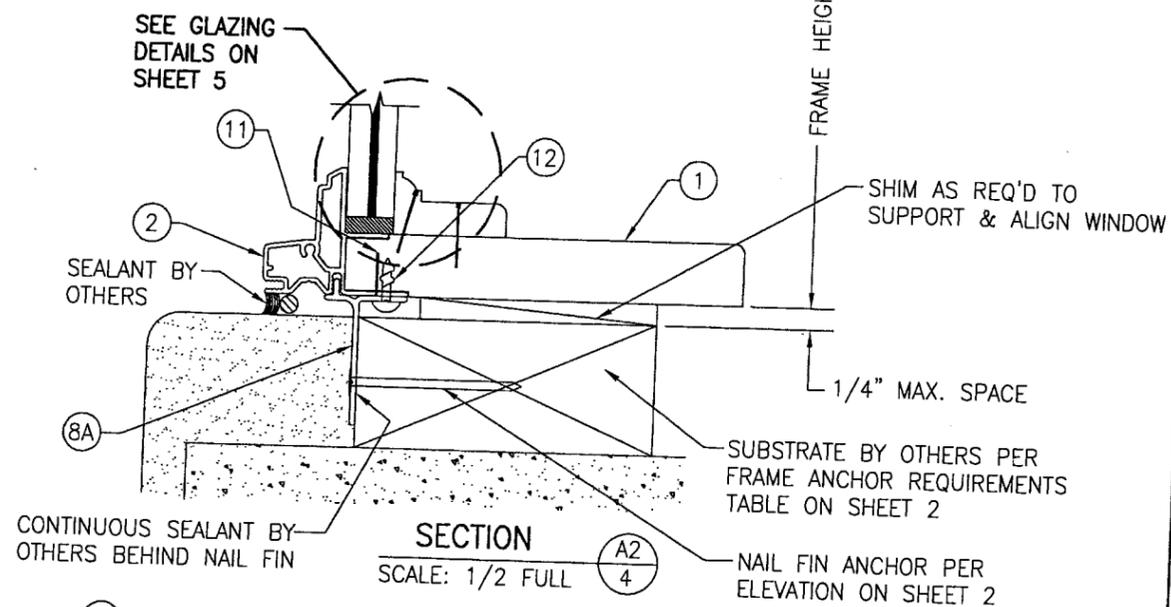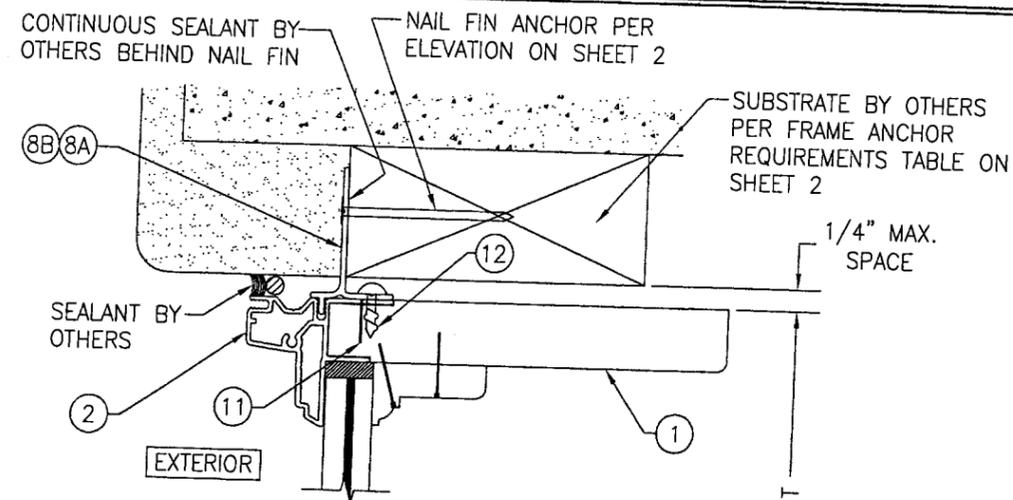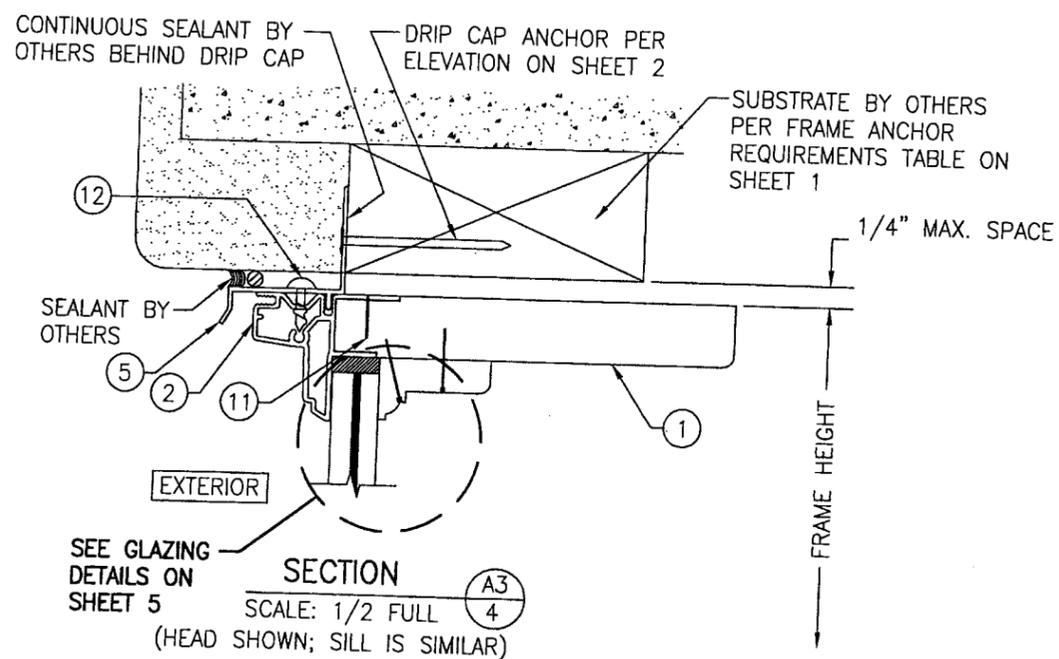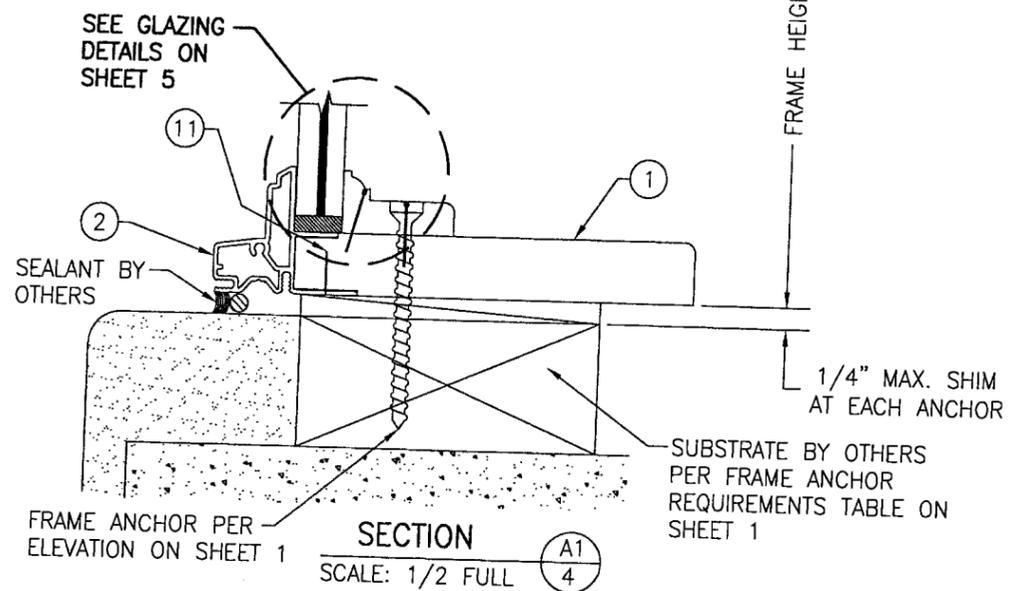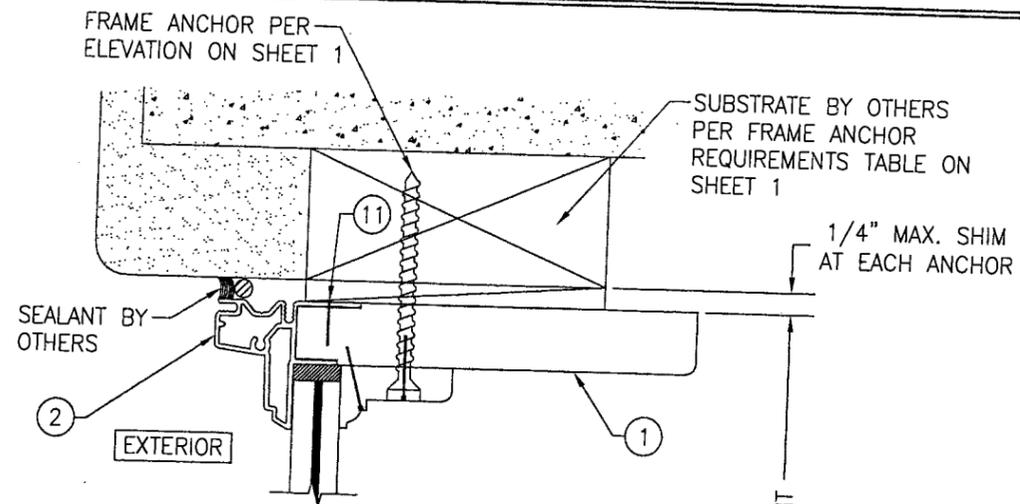

**OPTIONAL FIELD MULLING:**  
 WHEN FIELD MULLED, THE CORRUGATED FASTENERS & 1" SCREW MAY BE REPLACED WITH NO. 10 X 1 1/4" SCREWS AT EACH JAMB THROUGH PLATE WITHIN 4" OF ENDS & MAX. 15" O.C.

CONTINUOUS SILICONE (BOTH SIDES OF MULLION)

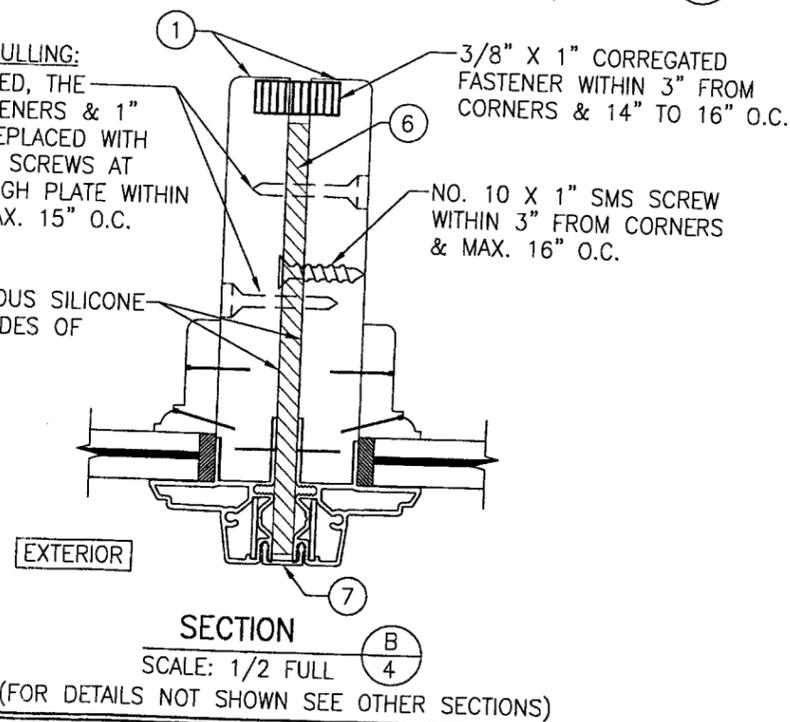

Approved as complying with the Florida Building Code  
 Date **JUNE 7, 2007**  
 NO. **07-0329.03**  
 Miami Dade Product Control  
 By *Manuel Perez*

DRAWN BY:	W.R.M.	CHECKED BY:	W.W.S.
PLOT:	1-2	DATE:	02/13/07
NO.		REVISION DESCRIPTION	DATE


**FEEL SAFE ENERGY SAVER CLAD DIRECT SET IMPACT WINDOWS**  
 MANUFACTURER  
**HURD MILLWORK CO., INC.**  
 575 S. WHELEN AVE.  
 MEDFORD, WI 54451  
 800-433-4873

CONSULTANTS  
**W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.**  
 8895 N. MILITARY TRAIL, SUITE C-204  
 PALM BEACH GARDENS, FL 33410  
 PHONE: 561-775-4902 FAX: 561-775-4903

CERTIFICATION  
**MAR 23 2007**  
 WARREN W. SCHAEFER, P.E.  
 NO. 44135

DRAWING NO.	1515	REV.	
SHEET NO.	4	OF	5


WHEN USING TREMCO S900, THE OVERALL WINDOW FRAME AREA MAY NOT EXCEED 20.3 S.F.

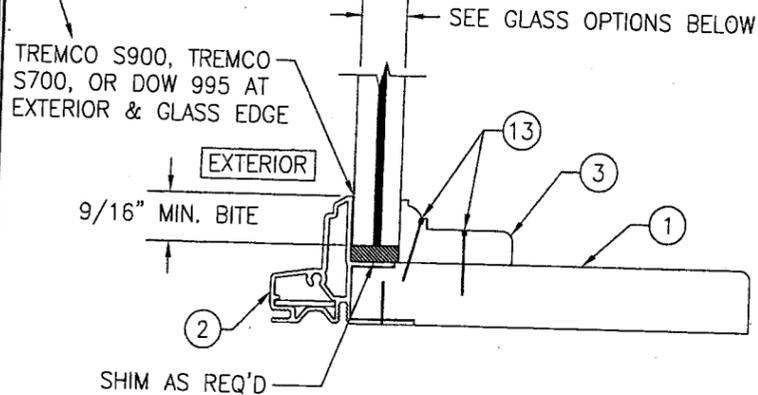

**NON-I.G. GLAZING DETAIL  
GLASS OPTIONS 1 & 2**

- GLASS OPTION 1: 9/16" LAMINATED GLASS BY OLD CASTLE (1/4" HT. ST./0.075" SOLUTIA VANCEVA/1/4 HT. ST.)
- GLASS OPTION 2: 9/16" LAMINATED GLASS BY DUPONT (1/4" HT. ST./0.09" DUPONT SGP/1/4 HT. ST.)


WHEN USING TREMCO S900, THE OVERALL WINDOW FRAME AREA MAY NOT EXCEED 20.3 S.F.

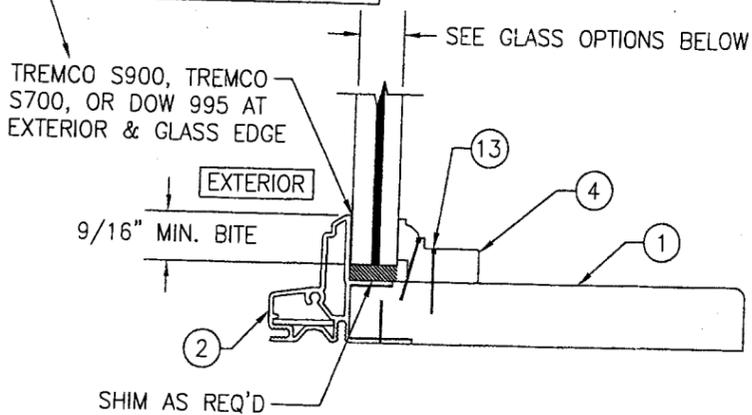

**NON-I.G. GLAZING DETAIL  
GLASS OPTION 3**

- GLASS OPTION 3: 7/16" LAMINATED GLASS BY SOLUTIA (5/32" AN./0.09" SOLUTIA SALFEX III G PVB/5/32" AN.)


WHEN USING TREMCO S900, THE OVERALL WINDOW FRAME AREA MAY NOT EXCEED 20.3 S.F.

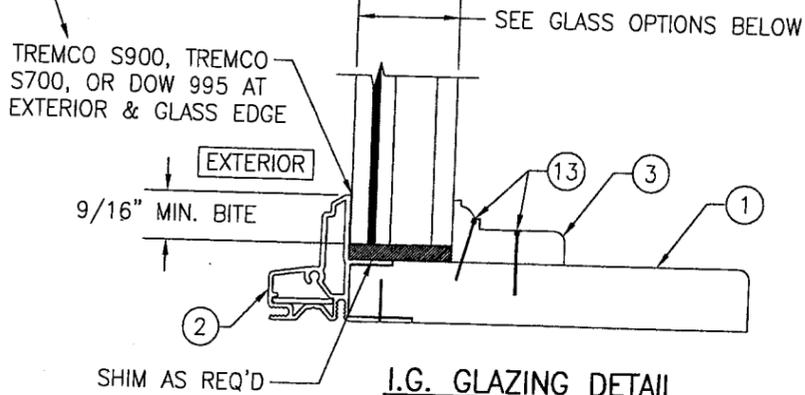


**I.G. GLAZING DETAIL  
GLASS OPTIONS 4, 5, & 6**

- GLASS OPTION 4: 1 1/8" TO 1 1/4" LAMINATED I.G. WITH 9/16" LAMINATED EXTERIOR GLASS BY OLD CASTLE (1/4" HT. ST./0.075" SOLUTIA VANCEVA/1/4" HT. ST.), 7/16" AIR SPACE & 5/32" TO 1/4" TEMPERED INTERIOR
- GLASS OPTION 5: 1 1/8" TO 1 1/4" LAMINATED I.G. WITH 9/16" LAMINATED EXTERIOR GLASS BY DUPONT (1/4" HT. ST./0.09" DUPONT SGP/1/4" HT. ST.), 7/16" AIR SPACE & 5/32" TO 1/4" TEMPERED INTERIOR
- GLASS OPTION 6: 7/8" TO 1" LAMINATED I.G. WITH 7/16" LAMINATED EXTERIOR GLASS BY SOLUTIA (5/32" AN./0.09" SOLUTIA SALFEX III G PVB/5/32" AN.), 7/16" AIR SPACE & 5/32" TO 1/4" TEMPERED INTERIOR


ITEM #	ITEM DESCRIPTION	MANUFACTURER/NOTES
PARTS		
1	JAMB	PINE
2	JAMB CLAD	6063-T5 ALUMINUM
3	GLAZING BEAD	PINE
4	GLAZING BEAD	PINE
5	DRIP CAP NAIL FIN	6063-T5 ALUMINUM
6	CONT. MULLION REINFORCEMENT BAR	6061-T6 ALUMINUM
7	MULLION COVER	6063-T5 ALUMINUM
8A	STANDARD NAIL FIN	6063-T6 ALUMINUM
8B	STANDARD NAIL FIN WITH DRIP	6063-T6 ALUMINUM
FASTENERS		
11	18 GA. X 1/2" STAPLE	WITHIN 2" OF CORNERS & 9" TO 11" O.C.
12	NO. 6 X 1/2" SMS SCREW	WITHIN 2" OF CORNERS & 8" TO 10" O.C.
13	18 GA. X 1" T-NAIL	WITHIN 2" OF CORNERS & 8" TO 10" O.C.

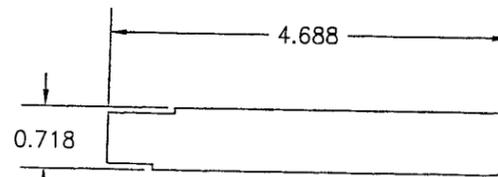


① JAMB

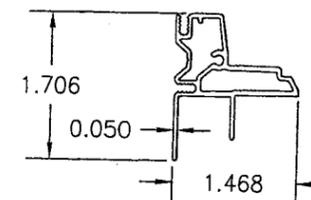


② JAMB CLAD

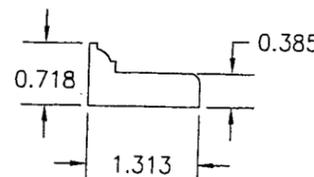


③ GLAZING BEAD

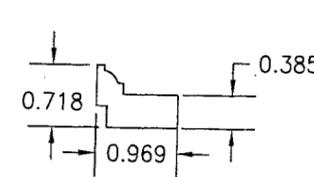


④ GLAZING BEAD




⑤ DRIP CAP NAIL FIN

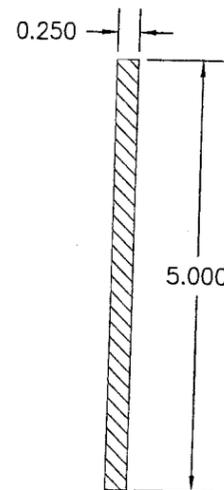


⑥ CONTINUOUS MULLION REINFORCEMENT BAR



⑦ MULLION COVER



⑧A STANDARD NAIL FIN

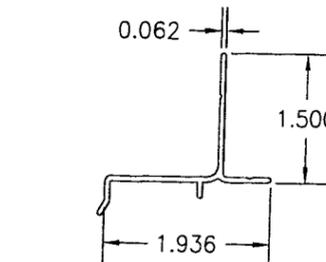

⑧B STANDARD NAIL FIN WITH DRIP

Approved as complying with the Florida Building Code  
Date **JUNE 7, 2007**  
NOA# **07-0329.03**  
Miami Code Product Control  
By *Manuel Perez*

DRAWING TITLE <b>FEEL SAFE ENERGY SAVER CLAD DIRECT SET IMPACT WINDOWS</b>	DRAWN BY: W.R.M.	CHECKED BY: W.W.S.
PLOT: 1-2	DATE: 02/13/07	
REVISION DESCRIPTION NO.	DATE	
MANUFACTURER <b>HURD MILLWORK CO., INC.</b> 575 S. WHELEN AVE. MEDFORD, WI 54451 800-433-4873		
CONSULTANTS <b>W. W. SCHAEFER ENGINEERING &amp; CONSULTING, P.A.</b> 8895 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903		
CERTIFICATION <b>MAR 23 2007</b>	DRAWING NO. <b>1515</b>	REV.
	SHEET NO. <b>5</b>	OF <b>5</b>