



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 372-6339

## NOTICE OF ACCEPTANCE (NOA)

[www.miamidade.gov/buildingcode](http://www.miamidade.gov/buildingcode)

Jeld-Wen, Inc. (OR)  
3737 Lakeport Boulevard  
Klamath Falls, OR 97601

### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

### DESCRIPTION: Series 6'8" S/E Outswing Glazed Steel Door w/wo Sidelites – N.I.

**APPROVAL DOCUMENT:** Drawing No. S-2103-01, titled "Series Outswing Glazed Steel Edge Door Units, Up to 9'-0" x 6'-8" with and without Sidelites", sheets 1 through 7 of 7, dated 12/23/2001 with revision B dated 05/18/2007, prepared by PTC, LLC, dated 05/24/2007, signed and sealed by Eric S. Nielsen, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

### MISSILE IMPACT RATING: None

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises and renews NOA # 02-0109.01 and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P.E.**



*Jaime D. Gascon*  
12/13/07

NOA No. 07-0618.09  
Expiration Date: July 03, 2012  
Approval Date: December 20, 2007  
Page 1

**Jeld-Wen, Inc. (OR)**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

- A. DRAWINGS**
1. Manufacturer's die drawings and sections.
  2. Drawing No **S-2103-01**, titled "Series Outswing Glazed Steel Edge Door Units, Up to 9'-0" x 6'-8" with and without Sidelites", sheets 1 through 7 of 7, dated 12/23/2001 with revision B dated 05/18/2007, prepared by PTC, LLC, dated 05/24/2007, signed and sealed by Eric S. Nielsen, P.E.
- B. TESTS**
1. Test reports on: 1) Air Infiltration Test, per PA 202-94  
2) Uniform Static Air Pressure Test, Loading per PA 202-94  
3) Water Resistance Test, per PA 202-94  
4) Forced Entry Test, per PA 202-94  
along with marked-up drawings and installation diagram of Outswing and Inswing steel edge glazed steel door, prepared by Certified Testing Laboratories, Test Report No. **CTLA-695W**, date 11/09/2001, signed and sealed by Ramesh Patel, P.E.  
*(Submitted under NOA# 02-0109.01)*
- C. CALCULATIONS**
1. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by PTC, LLC, dated 05/18/2007, signed and sealed by Eric S. Nielsen, P.E.  
**Complies with ASTM E 1300-02.**
- D. QUALITY ASSURANCE**
1. Miami Dade Building Code Compliance Office (BCCO).
- E. MATERIAL CERTIFICATIONS**
1. None
- F. STATEMENTS**
1. Statement letter of conformance, no financial interest and compliance, dated 05/25/2007 by PTC, LLC, signed and sealed by Eric S. Nielsen, P.E.
  2. Laboratory addendum letter for Test Report no. **CTLA-695W**, issued by Certified Testing Laboratories, dated 04/11/2002, signed and sealed by Ramesh Patel, P.E.  
*(Submitted under NOA# 02-0109.01)*
  3. Laboratory compliance letter for Test Report no. **CTLA-695W**, issued by Certified Testing Laboratories, dated 11/09/2001, signed and sealed by Ramesh Patel, P.E.  
*(Submitted under NOA# 02-0109.01)*
- G. OTHER**
1. Notice of Acceptance No. **02-0109.01**, issued to Jeld-Wen, Inc. (OR) for their Series "Outswing Glazed Steel Edge Door Units, Up to 9'-0" x 6'-8", approved on 07/03/2002 and expiring on 07/03/2007.

  
\_\_\_\_\_  
Jaime D. Gascon, P.E.  
Chief, Product Control Division  
NOA No. 07-0618.09  
Expiration Date: July 03, 2012  
Approval Date: December 20, 2007

# JELD-WEN® Steel

## 6'-8" OUTSWING STEEL EDGE GLAZED STEEL DOOR UNITS W/ & W/O SIDELITES

### GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE 2004 FLORIDA BUILDING CODE (WITH 2005 & 2006 SUPPLEMENTS) AND HIGH VELOCITY HURRICANE ZONE (HVHZ) REQUIREMENTS.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED PER ANCHOR LOCATION DRAWINGS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. SEE TABLE 1 ON THIS SHEET FOR DESIGN PRESSURE RATINGS.
5. THIS PRODUCT MEETS THE WATER REQUIREMENTS FOR "HVHZ" ZONES. SEE THE DESIGN PRESSURE CHART BELOW.
6. DOORS AND SIDELITES REQUIRE MIAMI-DADE APPROVED IMPACT RESISTANT SHUTTERS.
7. SIDELITES ARE AN OPTION AND CAN BE USED IN A SINGLE OR DOUBLE DOOR CONFIGURATION.

### RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

#### COMPONENT CONSTRUCTIONS:

**Face sheets:** 24 ga. (0.020") minimum thickness, Galvanized Steel A-525 commercial quality - AKDQ per ASTM 620 with average minimum yield strength  $F_y(\text{ave.}) = 25,000$  psi.

**Core design:** Expanded polystyrene with 1.0 to 1.25 lbs./cf density, by JELD-WEN, INC.


**Door Panel Construction:** The active and inactive door panels are constructed from 24GA. (0.020" min. galvanized steel. The face sheet bottoms are bent 90° over the 24 ga. (0.021" min. rollformed bottom rail measuring 1.67" wide x 1.21" high. The face sheet tops and sides are bent 90° over the 22 ga. (0.029" min. rollformed top rail and side stiles which measure 1.73" wide X 1.219" high. The side stile tabs are bent 90° over the bottom rail, and secured with a .25" x .50" x 16 ga. rivet at each corner. The interior cavity is filled with polystyrene, and the face sheets are glued to it.

**Side Lite Panel Construction:** The Side Lite Panels are constructed from 24GA. (0.020" min. galvanized steel. The four edges of the face sheets are bent 90° over the polystyrene core and glued to it. The panels are routed to receive the ODL Lite Frames, and glazed with 1/8" tempered glass.

**Frame Construction:** The frames are constructed from Ponderosa Pine jambs measuring 1.25" wide x 4.563" deep. The door and sidelite head jambs are mortised and butt joined to the side jambs. The door frames use a bump face threshold measuring 4.041" wide x 1.0" high. The sidelite frames use a pine head jamb as their threshold. All attachments are made with (3) 16GA., 2" x 7/16" crown wire staples at each corner.

### TABLE OF CONTENTS

SHT #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATIONS
2	VERTICAL CROSS SECTIONS AND BILL OF MATERIALS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS AND NOTES
5	ANCHORING LOCATIONS AND DETAILS
6	ANCHORING LOCATIONS AND GLAZING DETAILS
7	UNIT COMPONENTS

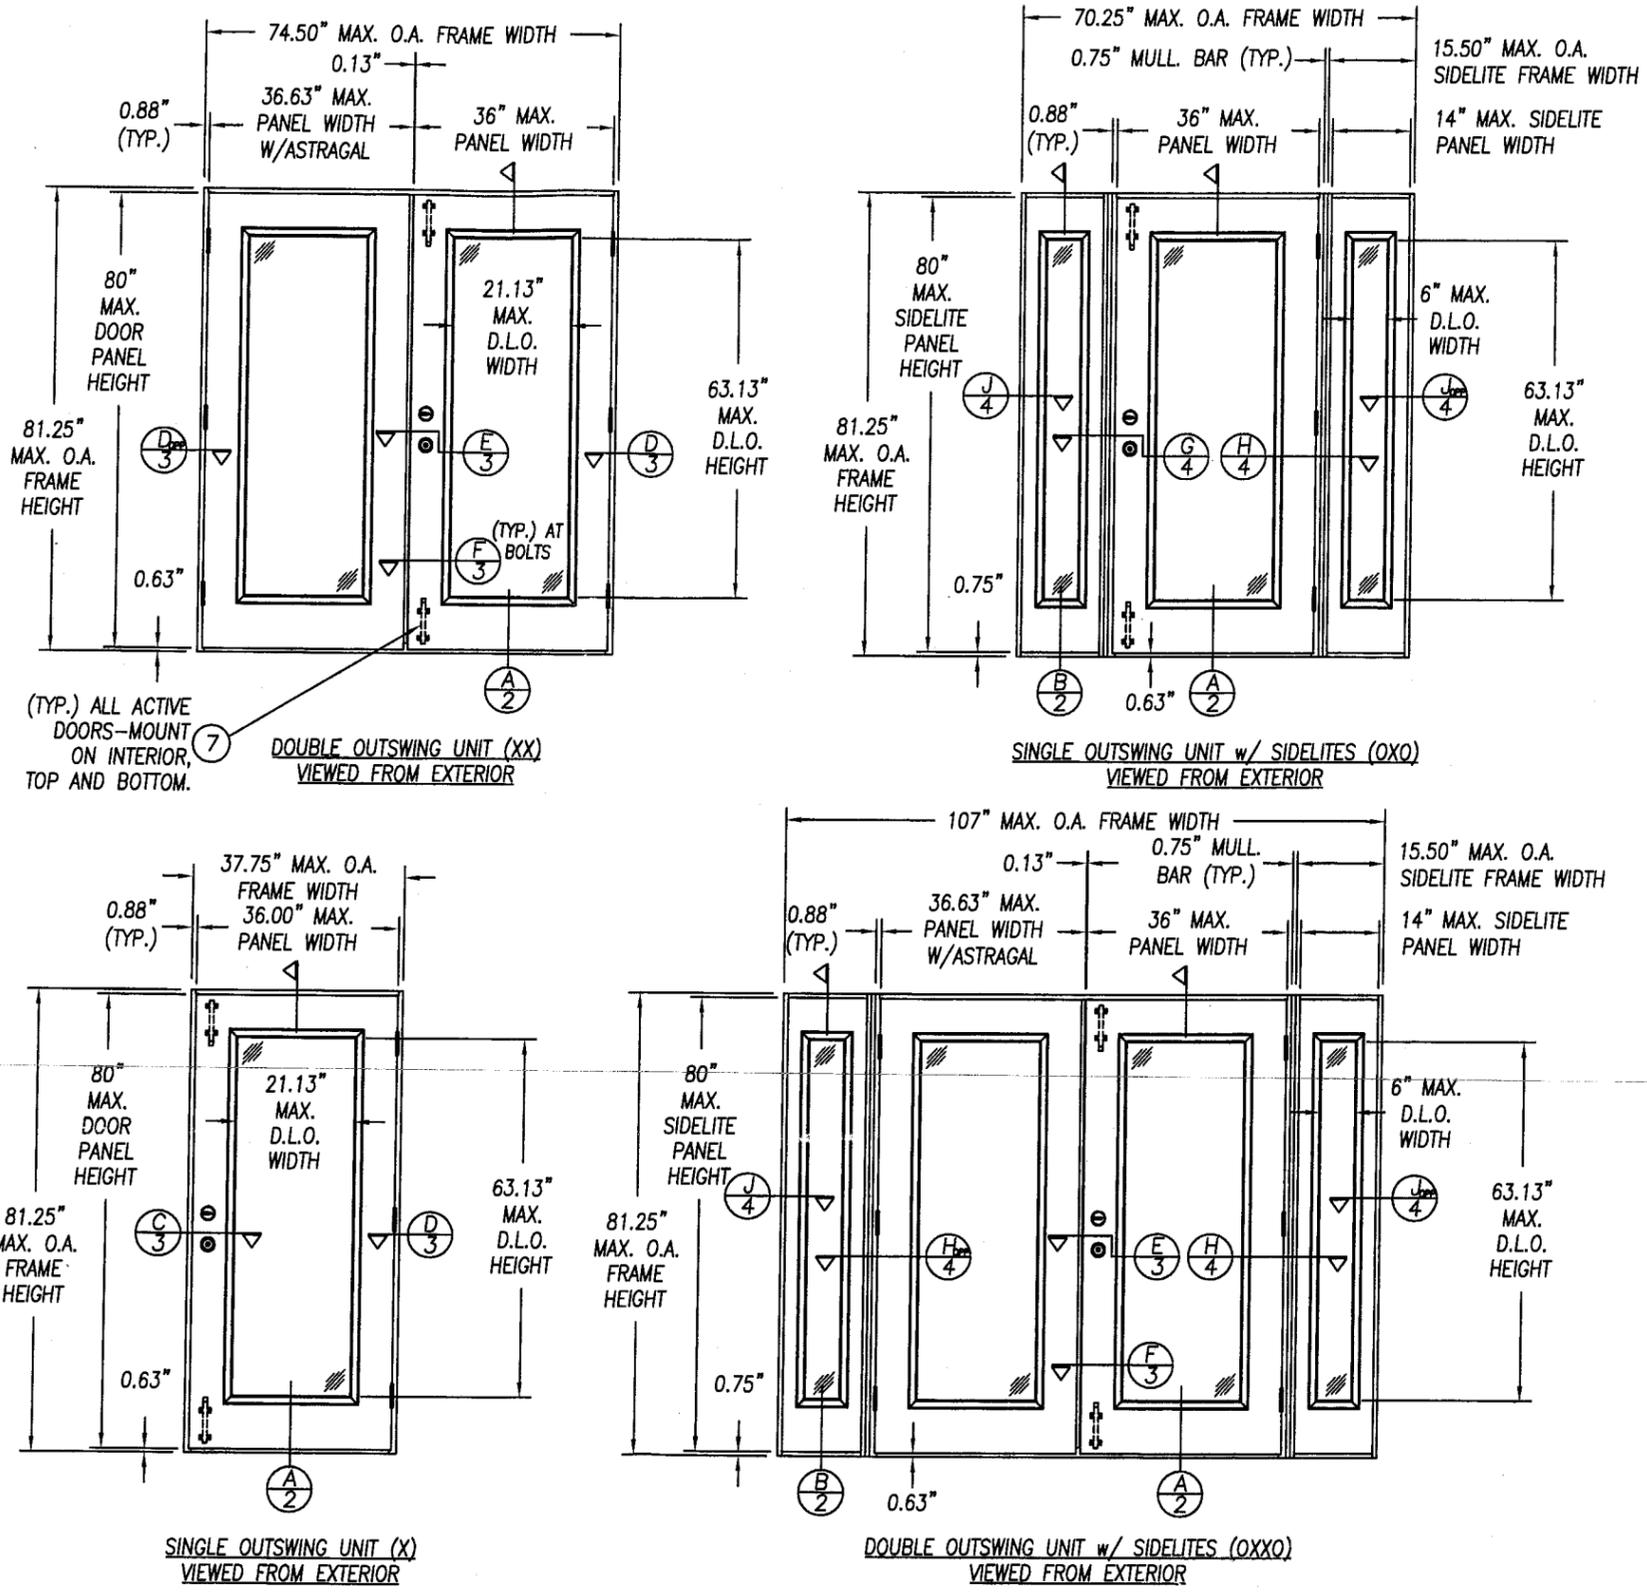

(TYP.) ALL ACTIVE DOORS—MOUNT ON INTERIOR, TOP AND BOTTOM. 7 DOUBLE OUTSWING UNIT (XX) VIEWED FROM EXTERIOR

SINGLE OUTSWING UNIT w/ SIDELITES (OXO) VIEWED FROM EXTERIOR

SINGLE OUTSWING UNIT (X) VIEWED FROM EXTERIOR

DOUBLE OUTSWING UNIT w/ SIDELITES (OXXO) VIEWED FROM EXTERIOR

TABLE 1:

DESIGN PRESSURE RATING WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	WITH BUMPFACE SILL	
	W/ SURFACE BOLTS	W/O SURFACE BOLTS
SINGLE W/WO SIDELITES (X, OX, XO, OXO)	+60 psf -60 psf	+42 psf -42 psf
DOUBLE W/WO SIDELITES (XX, OXX, XXO, OXXO)	+43 psf -43 psf	NOT APPROVED

*ESN*  
5/24/10

Eric S. Nielsen  
Florida P. E. No. 41323  
PTC, LLC  
1535 Cogswell Street, Suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935

Prepared By:  
**PTC**  
PTC, LLC  
Phone: 321-690-1788  
Fax: 321-690-1789


PRODUCT REVISED as complying with the Florida Building Code  
Acceptance No. 07-0618,09  
Expiration Date 6/7/03/2012  
By *[Signature]*  
Miami-Dade Product Control Division

JELD-WEN, INC.  
3737 LAKEPORT BLVD.  
KLAMATH FALLS, OR. 97601  
PH. 541.882.3451


PRODUCT: OUTSWING GLAZED STEEL EDGE DOOR UNITS, UP TO 9'-0" x 6'-8" WITH & WITHOUT SIDELITES  
PART OR ASSEMBLY: GENERAL NOTES AND TYPICAL ELEVATIONS

DATE	REVISIONS	BY
B 5-18-07	MODIFIED TO MEET THE 2004 FBC	WR
A 3-15-02	GENERAL REVISION	TJH

DATE: 12-23-01  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2103-01  
SHEET 1 OF 7

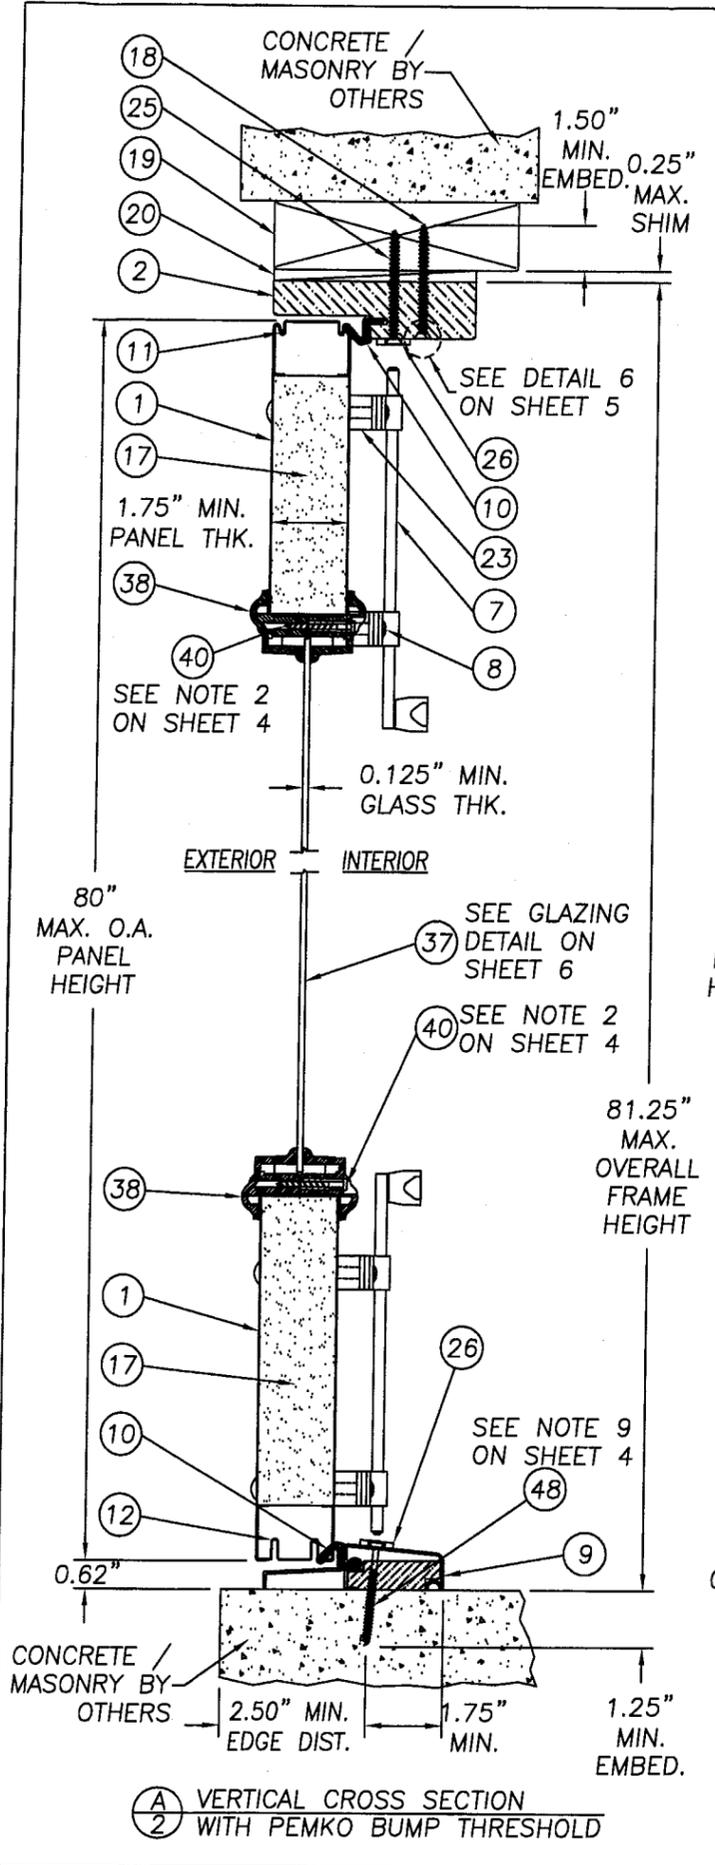

**(A) VERTICAL CROSS SECTION WITH PEMKO BUMP THRESHOLD**

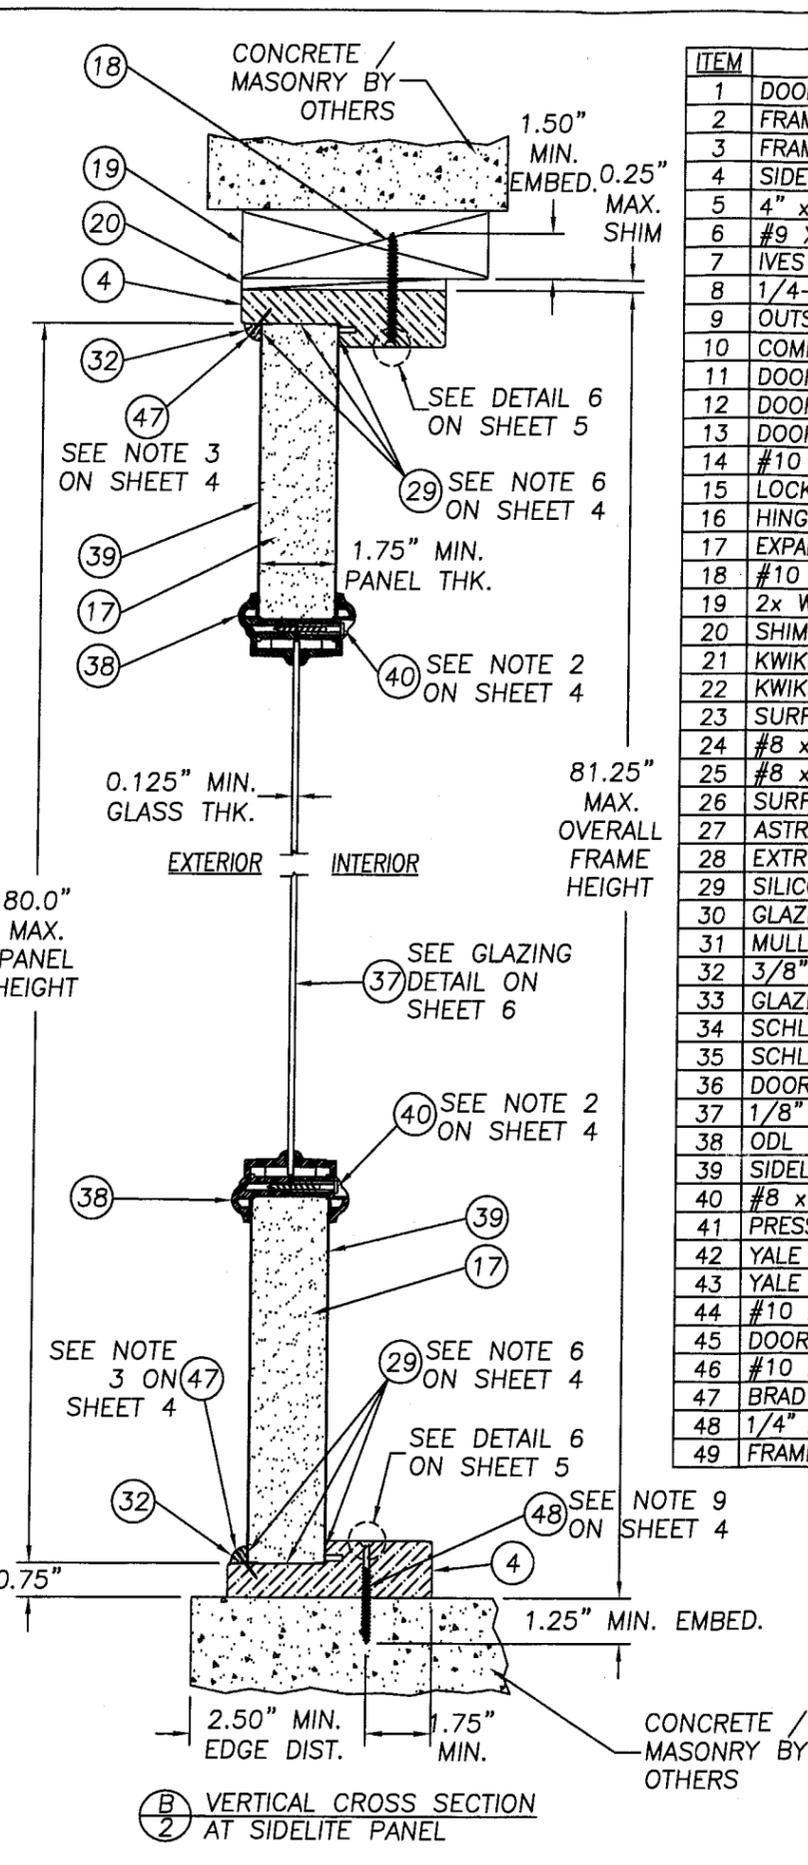

**(B) VERTICAL CROSS SECTION AT SIDELITE PANEL**

ITEM	DESCRIPTION	MATERIAL
1	DOOR STEEL FACE SHEET 24GA. (0.020" MIN.)	STEEL
2	FRAME HEAD (FINGER JOINTED PONDEROSA PINE)	WOOD
3	FRAME HINGE JAMB (FINGER JOINTED PONDEROSA PINE)	WOOD
4	SIDELITE FRAME HEAD, SILL AND JAMBS (FINGER JOINTED PONDEROSA PINE)	WOOD
5	4" x 4" BUTT HINGE 12ga. (BY HAGER)	STEEL
6	#9 X 1" PFH WOOD SCREW (HINGE TO DOOR)	STEEL
7	IVES SURFACE BOLT #454	STEEL
8	1/4-20 SEX BOLT W/1/4-20 FEMALE END x 1 3/4" LONG	STEEL
9	OUTSWING BUMP THRESHOLD (BY PEMKO)	ALUMINUM
10	COMPRESSION WEATHERSTRIP	FOAM
11	DOOR TOP RAIL	STEEL
12	DOOR BOTTOM RAIL	STEEL
13	DOOR SIDE STILE	STEEL
14	#10 x 1 3/4" PFH WOOD SCREW	STEEL
15	LOCK BLOCK (FINGER JOINTED PINE)	WOOD
16	HINGE STILE REINFORCEMENT (12.4" LONG)	MDF
17	EXPANDED POLYSTYRENE (1.0 to 1.25 lb./cf DENSITY) BY JELD-WEN	FOAM
18	#10 WOOD INSTALLATION SCREW W/ 1.50" MIN. EMBEDMENT	STEEL
19	2x WOOD SUB BUCK (BY OTHERS)	WOOD
20	SHIM MATERIAL (0.25" MAX. THK. HIGH DENSITY PLASTIC OR GREATER)	-
21	KWIKSET 400 SERIES KNOB	STEEL
22	KWIKSET TITAN 700 SERIES DEADBOLT (NOT SHOWN)	STEEL
23	SURFACE BOLT SPACER (BY IVES)	PLASTIC
24	#8 x 2" PFH WOOD SCREW	STEEL
25	#8 x 2 1/2" PFH WOOD SCREW	STEEL
26	SURFACE BOLT STRIKE PLATE (BY IVES)	STEEL
27	ASTRAGAL STRIKE PLATE (BY IMPERIAL)	STEEL
28	EXTRUDED ALUMINUM ASTRAGAL (BY IMPERIAL)	ALUMINUM
29	SILICONE CAULK (OR LAWRENCE 33 C)	SILICONE
30	GLAZING COMPOUND (QSD BY ODL)	SILICONE
31	MULLION CAP (81 1/2" LONG)	WOOD
32	3/8" QUARTER ROUND SIDELITE STOP	WOOD
33	GLAZING COMPOUND DOW 1199	SILICONE
34	SCHLAGE KNOB SET #F51	STEEL
35	SCHLAGE DEADBOLT #B360 (NOT SHOWN)	STEEL
36	DOOR LATCH STRIKE PLATE	STEEL
37	1/8" TEMPERED GLASS (BY PPG)	GLASS
38	ODL LITE FRAME 1/8" SG (HIGH PERFORMANCE POLYPROP.)	POLYPROP.
39	SIDELITE STEEL FACE SHEET 24GA. (0.020" MIN. STEEL)	STEEL
40	#8 x 1 1/2" PLASCREW (ODL LITE FRAME)	STEEL
41	PRESSURE TREATED MULLION BAR (3/4" x 4 9/16" x 81 1/2")	WOOD
42	YALE KNOB HERITAGE SERIES	STEEL
43	YALE DEADBOLT HERITAGE SERIES (NOT SHOWN)	STEEL
44	#10 x 1" PAN HEAD SHEETMETAL SCREW	STEEL
45	DOOR LATCH DEAD BOLT STRIKE PLATE	STEEL
46	#10 x 2" PFH WOOD SCREW	STEEL
47	BRAD TRIM NAIL 16GA. x 3/4" LONG	STEEL
48	1/4" ELCO TAPCON INSTALLATION ANCHOR W/ 1 1/4" MIN. EMBEDMENT (OR EQUIV.)	STEEL
49	FRAME LATCH JAMB (FINGER JOINTED PONDEROSA PINE)	WOOD

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 07-0618.09 Expiration Date 07/03/2012  
 By *[Signature]*  
 Miami Dade Product Control Division

**JELD-WEN, INC.**  
 3737 LAKEPORT BLVD.  
 KLAMATH FALLS, OR. 97601  
 PH. 541.882.3451


PRODUCT: OUTSWING GLAZED STEEL EDGE DOOR UNITS, UP TO 9'-0" x 6'-8" WITH & WITHOUT SIDELITES  
 PART OR ASSEMBLY: VERTICAL CROSS SECTIONS AND BILL OF MATERIALS

REV	DATE	BY
B	5-18-07	WR
A	3-15-02	TJH
#		BY

DATE: 12-23-01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2103-02  
 SHEET 2 OF 7

*[Signature]*  
 Eric S. Nielsen  
 Florida P. E. No. 41323  
 PTC, LLC  
 1535 Cogswell Street, Suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935



Prepared By:  
**PTC**  
 PTC, LLC  
 Phone: 321-690-1788  
 Fax: 321-690-1789

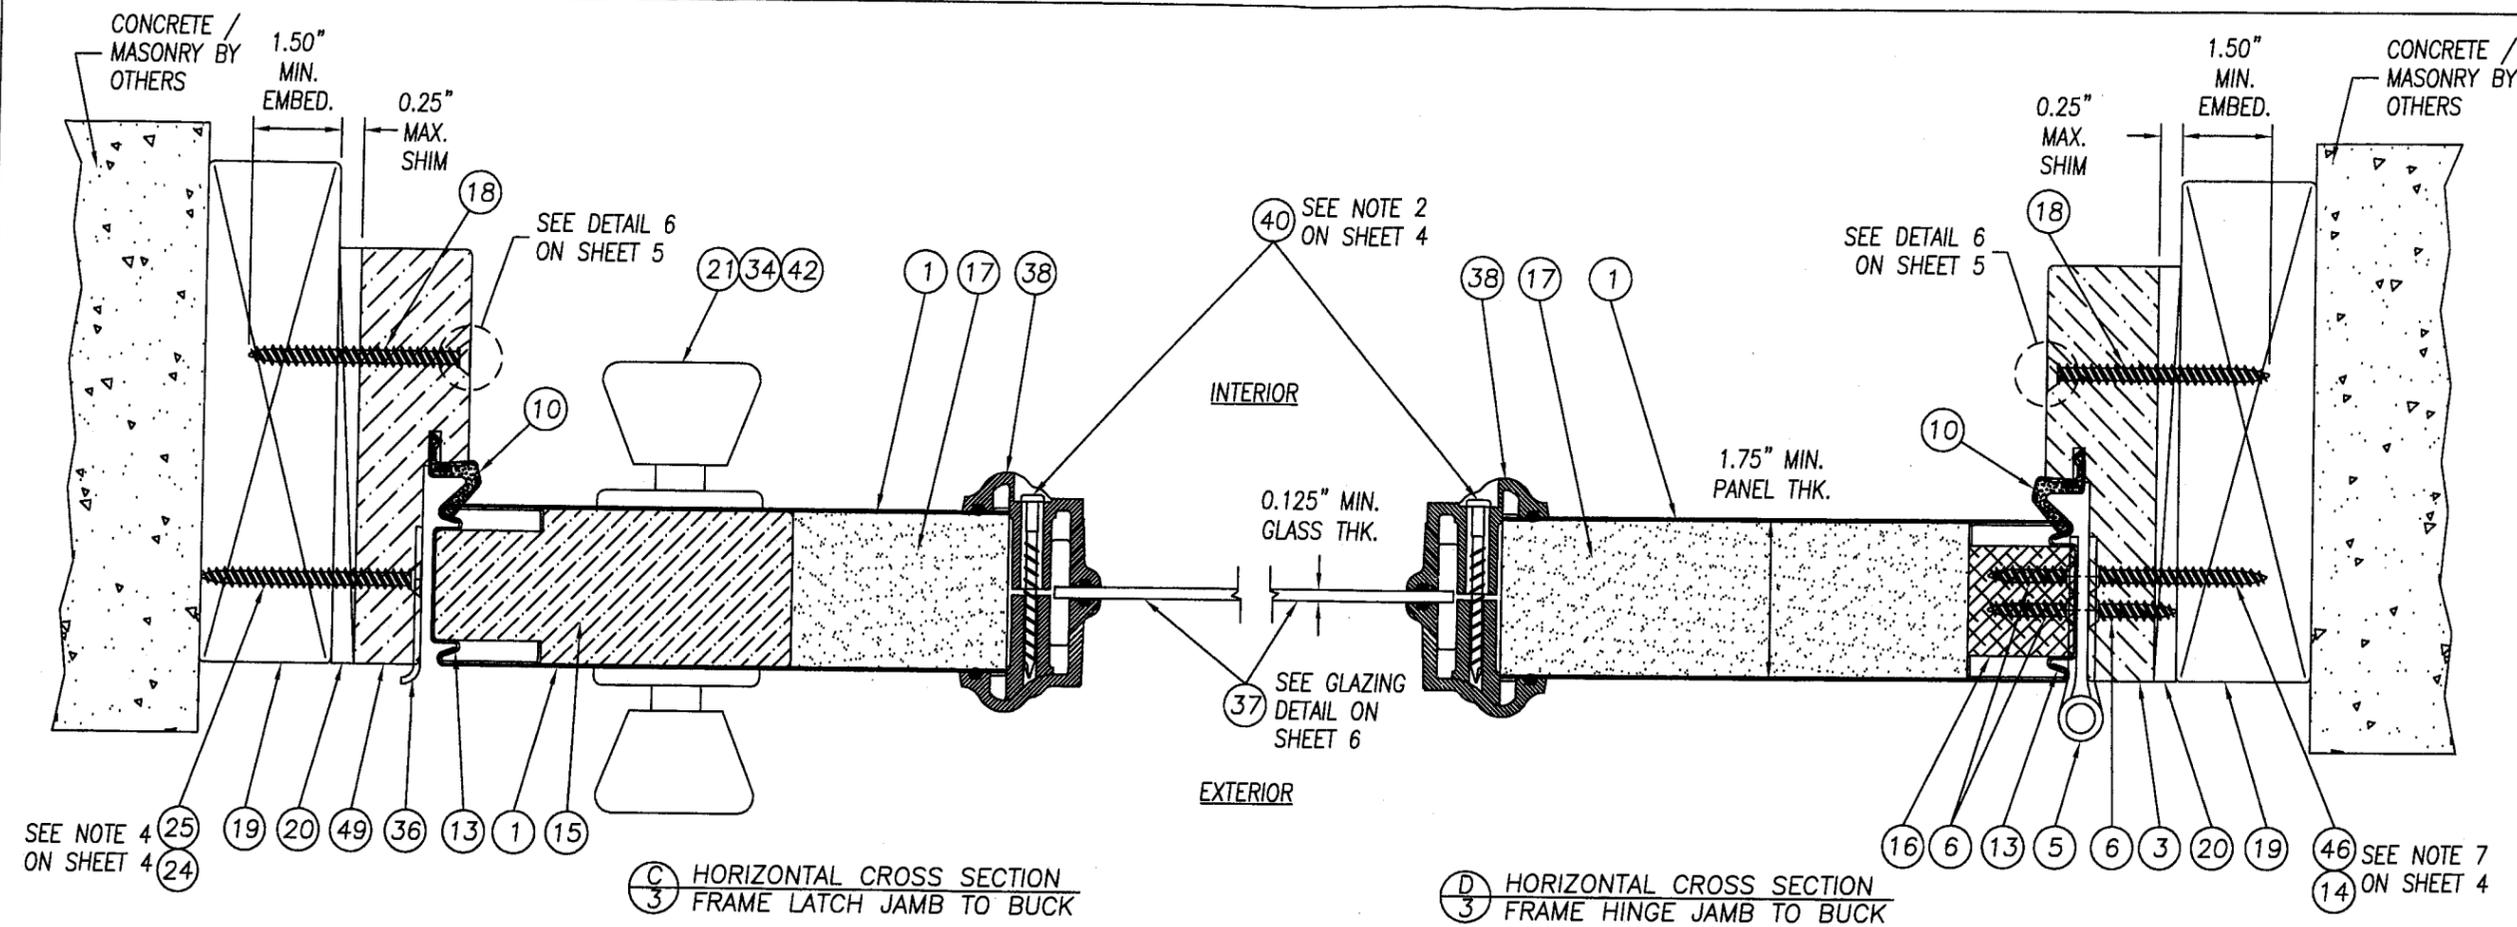

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 07-0618.09  
Expiration Date 07/03/2012  
By *[Signature]*  
Miami Made Product Control  
Division

**JELD-WEN, INC.**  
3737 LAKEPORT BLVD.  
KLAMATH FALLS, OR. 97601  
PH. 541.882.3451

PRODUCT: OUTSWING GLAZED STEEL EDGE  
DOOR UNITS, UP TO 9'-0" x 6'-8"  
WITH & WITHOUT SIDELITES  
PART OR ASSEMBLY:  
HORIZONTAL CROSS SECTIONS

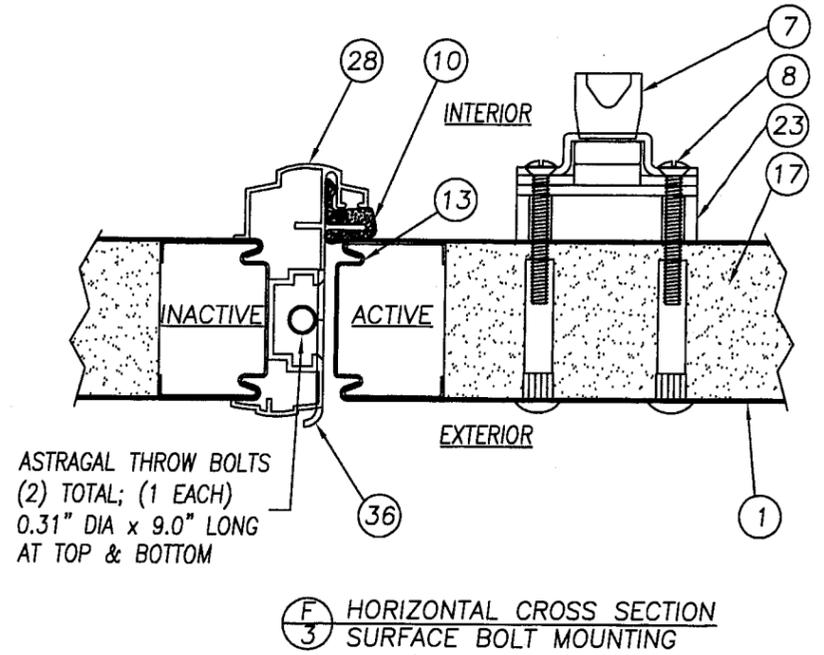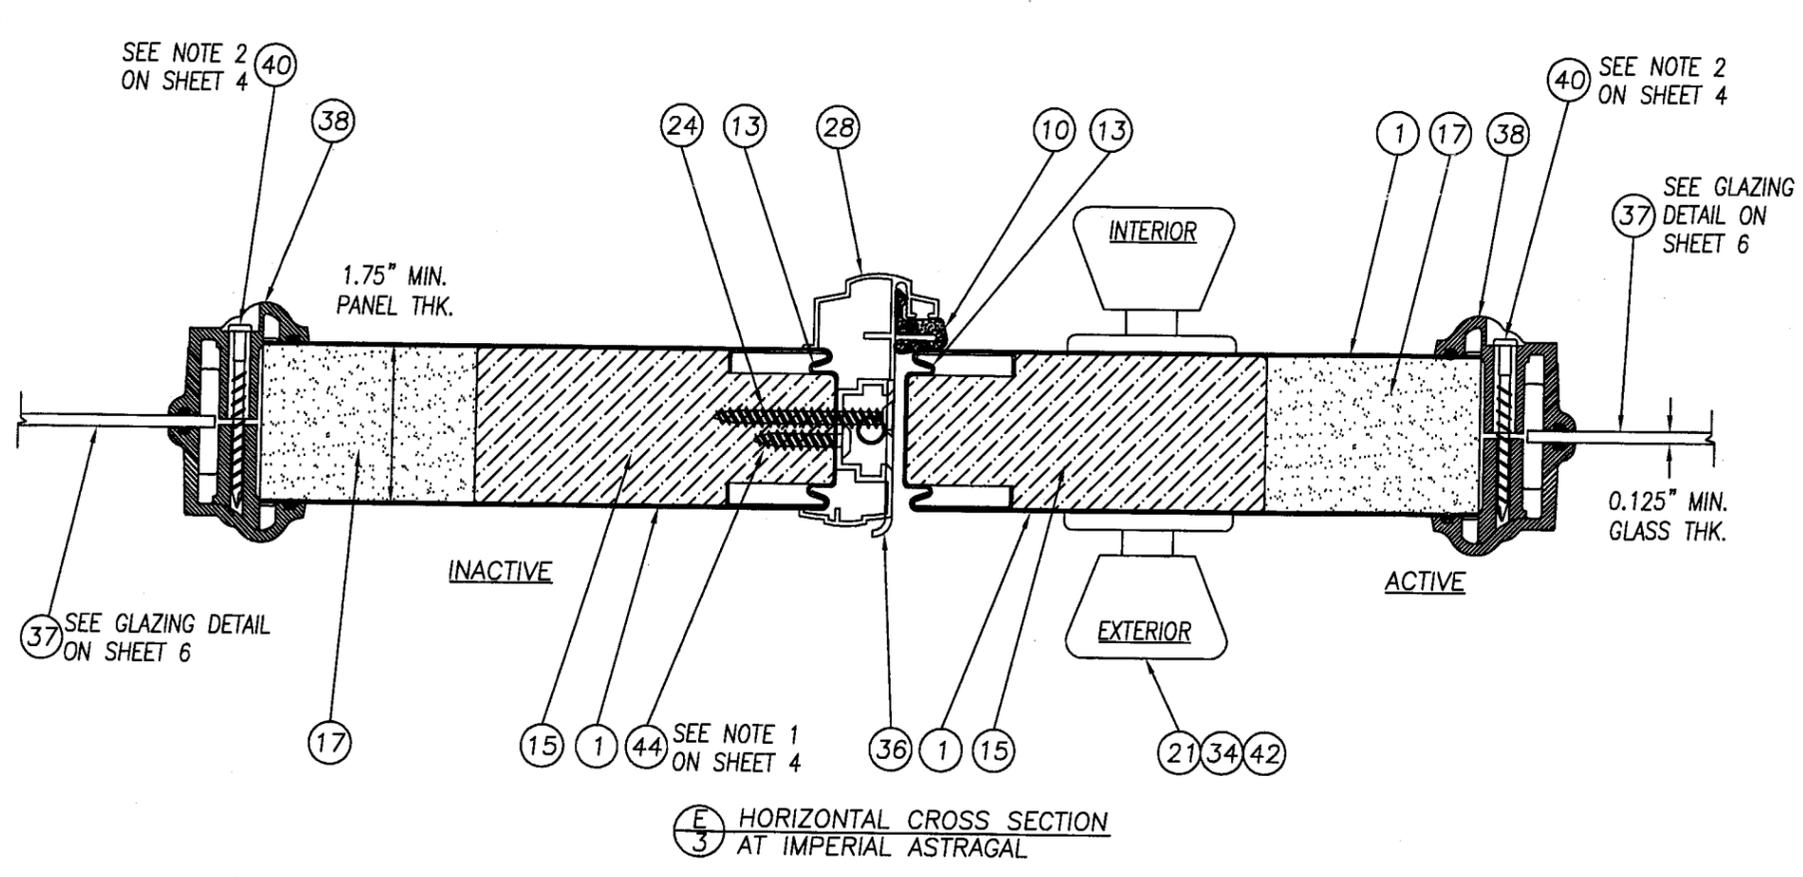


*[Signature]*  
5/24/07  
Eric S. Nielsen  
Florida P. E. No. 41323  
PTC, LLC  
1535 Cogswell Street, Suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935

Prepared By:  
**PTC**  
PTC, LLC  
Phone: 321-690-1788  
Fax: 321-690-1789

DATE	REVISIONS	BY	TU/H	WR
B 5-18-07	MODIFIED TO MEET THE 2004 FBC			
A 3-15-02	GENERAL REVISION			
#				


DATE: 12-23-01  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2103-03  
SHEET 3 OF 7

REVISIONS  
 as complying with the Florida  
 Building Code  
 Acceptance No. 07-0618.09  
 Expiration Date 07/03/2012  
 By: *[Signature]*  
 Miami Dade Product Control  
 Division

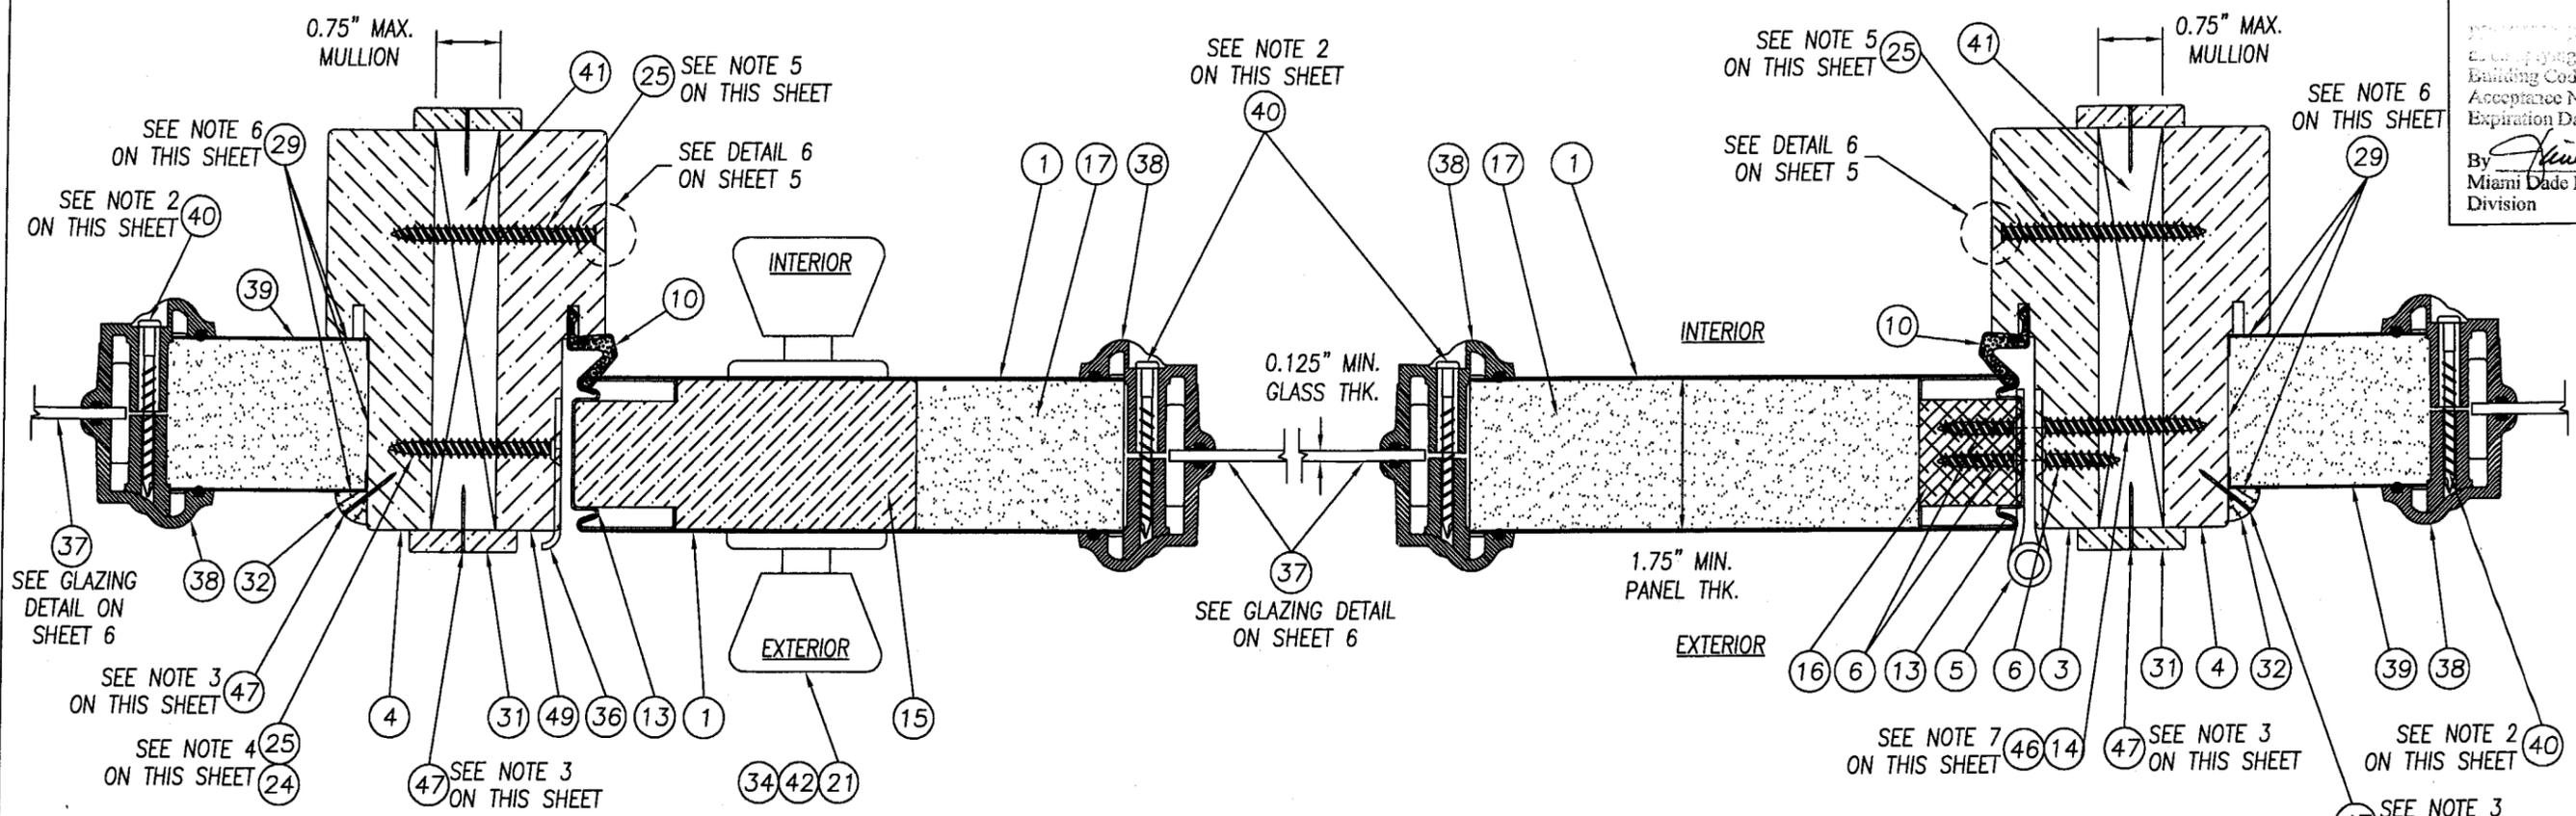

G HORIZONTAL CROSS SECTION  
 AT SIDELITE TO LATCH JAMB

H HORIZONTAL CROSS SECTION  
 AT SIDELITE TO HINGE JAMB

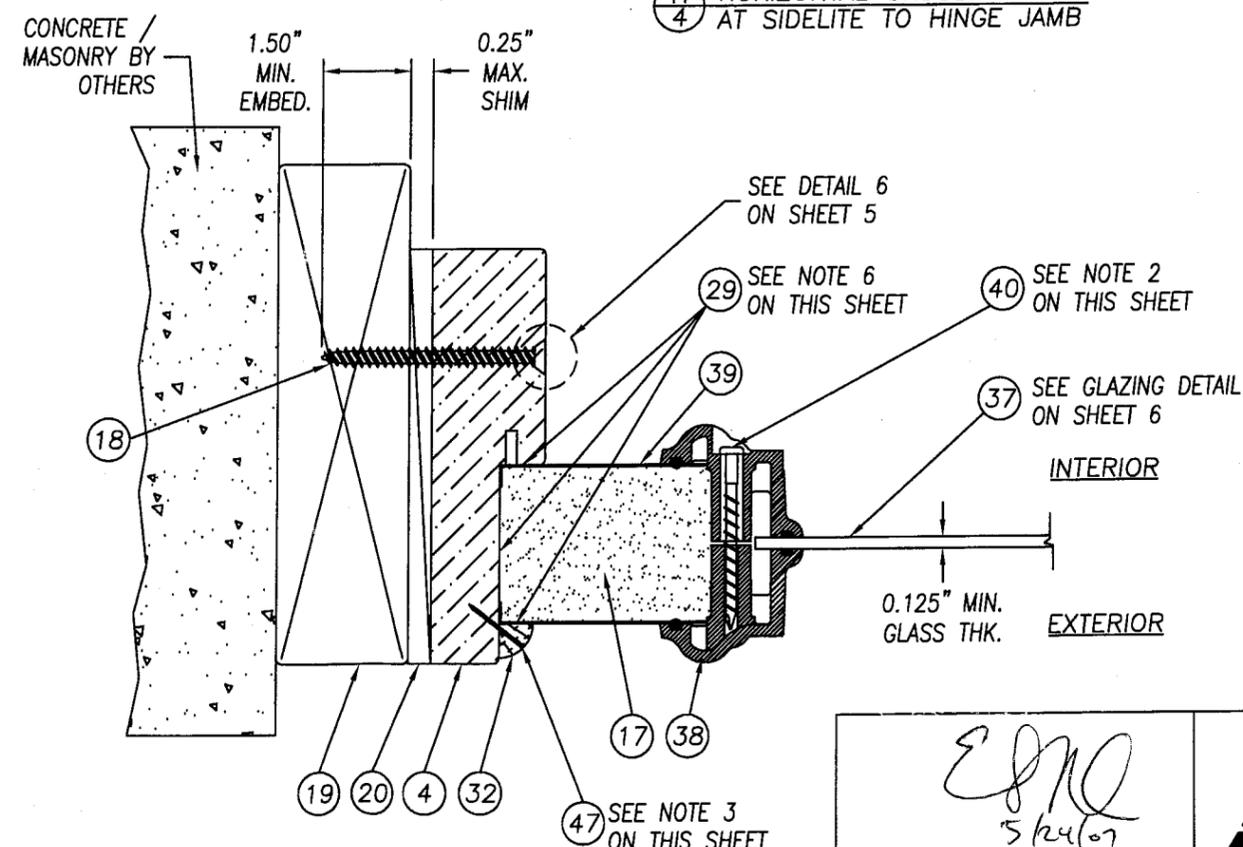

J HORIZONTAL CROSS SECTION  
 AT SIDELITE TO BUCK

- NOTES:**
- SPACING FOR ITEM #44 THE #10 x 1" PFH SCREWS ATTACHING THE IMPERIAL ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS:  
 FROM THE TOP DOWN & THE BOTTOM UP; 1.0", 2.5", 4.0", 5.5", 13.0", 18.0" & 26.0".
  - SPACING FOR ITEM #40 THE #8 x 1 1/2" PLASCREW IS AS FOLLOWS:  
 TOP & BOTTOM, HORIZONTALLY, DOOR PANEL; 3.0" IN FROM EACH CORNER, ONE IN CENTER.  
 TOP & BOTTOM, HORIZONTALLY, SIDELITE PANEL; 3.0" IN FROM EACH CORNER.  
 FROM TOP DOWN ON THE SIDES; 3.0", 13.5", 24.5", 36.0", 46.0", 57.5", 68.5" & 79.0".
  - SPACING FOR ITEM #47 THE 16GA x 3/4" BRAD TRIM NAIL ATTACHING THE QUARTER ROUND TO THE SIDELITE AND THE MULL CAP TO THE MULL BAR VERTICALLY IS AS FOLLOWS:  
 TOP & BOTTOM HORIZONTALLY; 1.25" IN FROM EACH CORNER WITH (1) NAIL MID-SPAN.  
 VERTICALLY; 1.25" FROM EACH END & SIX MORE EQUALLY SPACED ON THE FIELD.
  - WHEN ATTACHING THE STRIKE PLATE TO THE JAMB AND BUCK USE ITEM #25, A #8 x 2 1/2" PFH WOOD SCREW.  
 WHEN ATTACHING THE STRIKE PLATE TO THE JAMB AND SIDELITE JAMB AT THE MULLION USE ITEM #24, A #8 x 2" PFH WOOD SCREW.
  - SPACING FOR ITEM #25 THE #8 x 2 1/2" PFH WOOD SCREWS ATTACHING THE JAMBS TOGETHER AT THE MULLION, IS AS FOLLOWS: 6.0" FROM EACH VERTICAL CORNER WITH (4) MORE SCREWS EQUALLY SPACED ON THE FIELD.
  - THE SIDELITE IS SECURED INTO THE SIDELITE JAMB WITH ITEM #29 SILICONE CAULK ON THREE SIDES AND 3/8" QUARTER ROUNDS SECURED WITH ITEM #47 BRAD TRIM NAILS x 3/4" LONG.
  - WHEN ATTACHING THE HINGE TO THE JAMB AND BUCK USE ITEM #46, A #10 x 2" PFH SCREW.  
 WHEN ATTACHING THE HINGE TO THE JAMB AND SIDELITE JAMB AT THE MULLION USE ITEM #14, A #10 x 1 3/4" PFH WOOD SCREW.
  - USE ITEM #18 WHEN INSTALLING INTO WOOD SUBSTRATE AT HEAD AND JAMBS.  
 USE ITEM #48 WHEN INSTALLING INTO CONCRETE / MASONRY SUBSTRATE AT SILL.
  - ALTERNATE CONCRETE/MASONRY INSTALLATION ANCHORS OF EQUIVALENT PERFORMANCE CHARACTERISTICS CAN BE USED UPON APPROVAL OF THE ARCHITECT OR ENGINEER OF RECORD FOR THE PROJECT OF INSTALLATION.

**JELD-WEN, INC.**  
 3737 LAKEPORT BLVD.  
 KLAMATH FALLS, OR. 97601  
 PH. 541.882.3451

PRODUCT: OUTSWING GLAZED STEEL EDGE DOOR UNITS, UP TO 9'-0" x 6'-8" WITH & WITHOUT SIDELITES  
 PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS AND NOTES


NO.	DATE	REVISIONS	BY
B 5-18-07		MODIFIED TO MEET THE 2004 FBC	WR
A 3-15-02		GENERAL REVISION	TJH

DATE: 12-23-01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2103-04  
 SHEET 4 OF 7


*[Signature]*  
 Eric S. Nielsen  
 Florida P. E. No. 41323  
 PTC, LLC  
 1535 Cogswell Street, Suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935

Prepared By:  
**PTC**  
 PTC, LLC  
 Phone: 321-690-1788  
 Fax: 321-690-1789


PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. **07-0618.09**  
 Expiration Date **07/03/2012**  
 By *[Signature]*  
 Miami Trade Product Control  
 Division

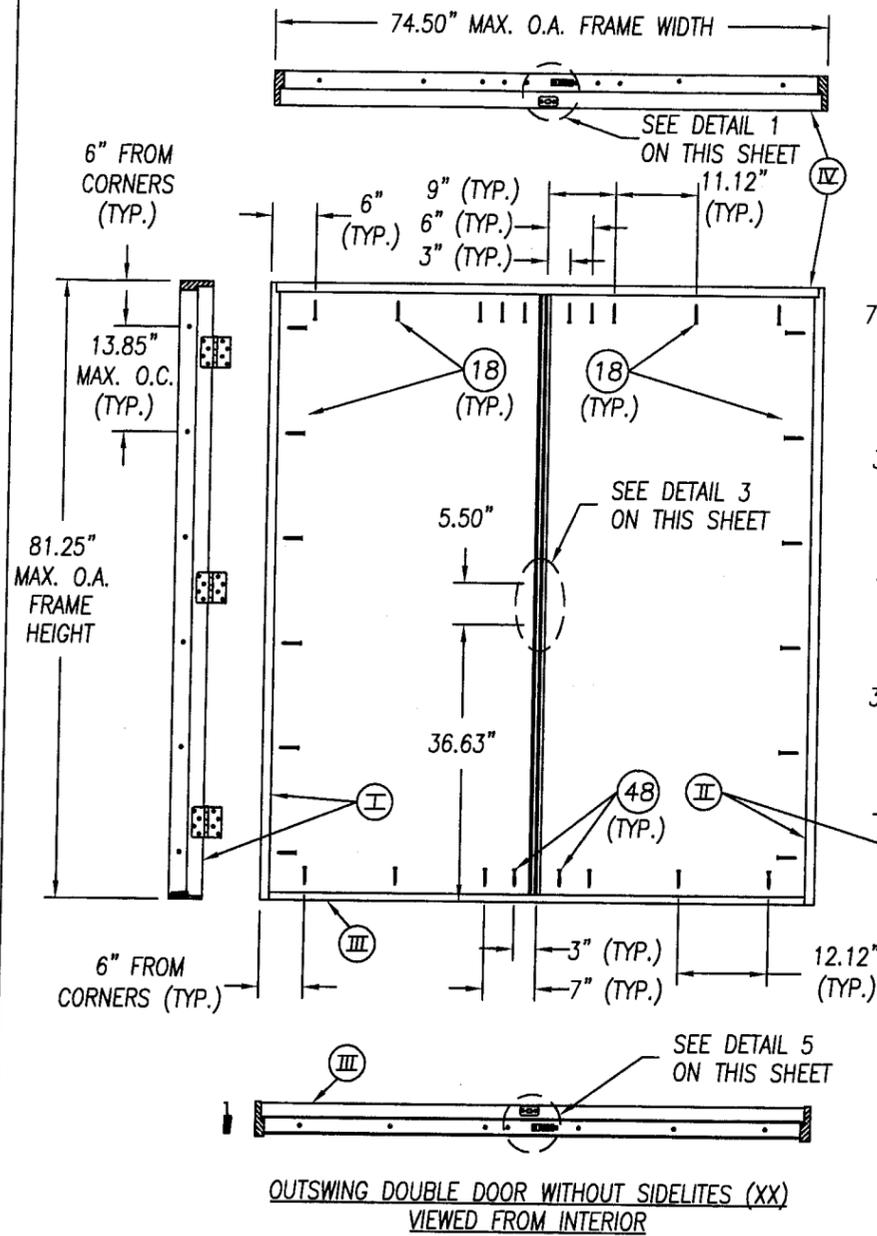

SEE DETAIL 2  
ON THIS SHEET

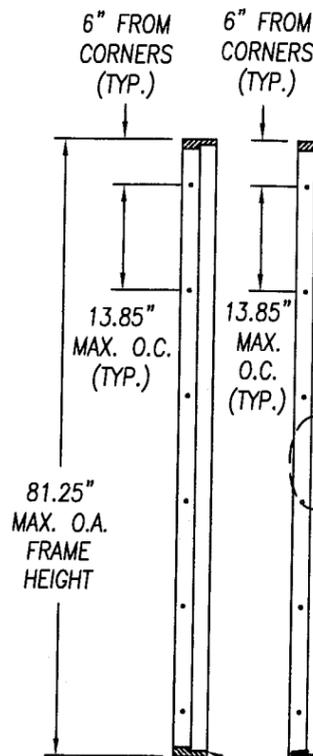


SEE DETAIL 4  
ON THIS SHEET

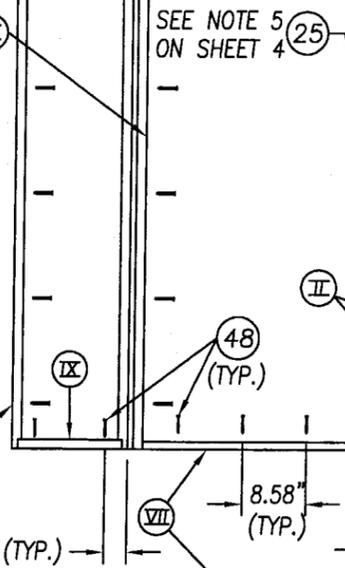


OUTSWING SINGLE DOOR WITH SIDELITES (OXO)  
VIEWED FROM INTERIOR


SEE DETAIL 2  
ON THIS SHEET

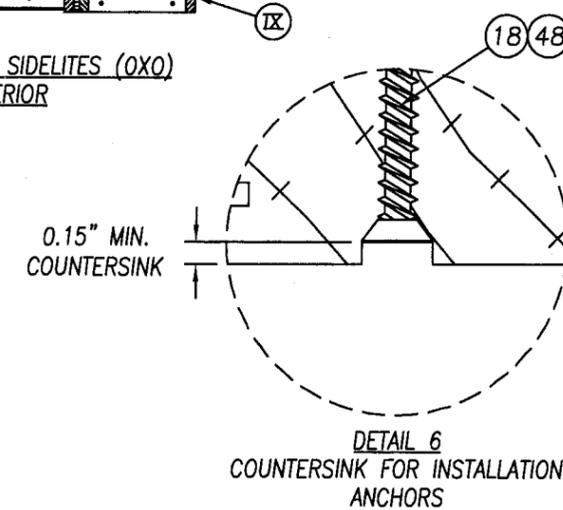


DETAIL 6  
COUNTERSINK FOR INSTALLATION  
ANCHORS

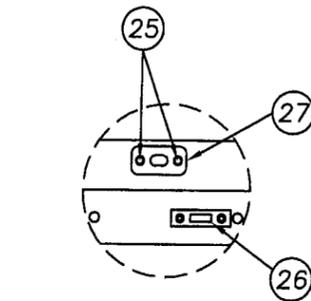

DETAIL 1 - AT HEAD JAMB  
ASTRAGAL STRIKE PLATE

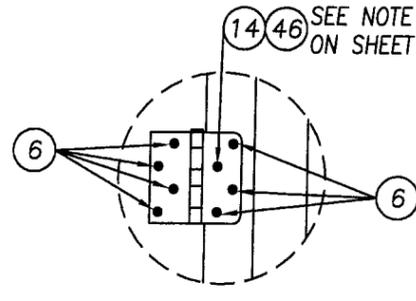


DETAIL 2  
HINGES TO JAMB & DOOR

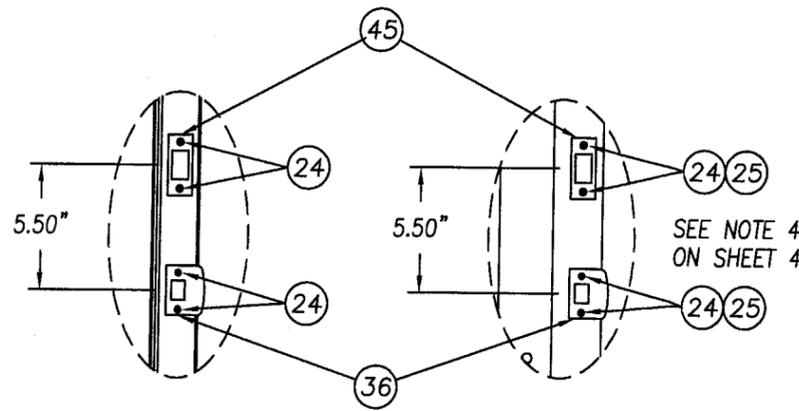

DETAIL 3  
STRIKE PLATES TO ASTRAGAL

DETAIL 4  
STRIKE PLATES TO JAMB



DETAIL 5 - AT THRESHOLD  
ASTRAGAL STRIKE PLATE

OUTSWING SINGLE DOOR WITH SIDELITES (OXO)  
VIEWED FROM INTERIOR

**JELD-WEN, INC.**  
**3737 LAKEPORT BLVD.**  
**KLAMATH FALLS, OR. 97601**  
**PH. 541.882.3451**

PRODUCT:  
OUTSWING GLAZED STEEL EDGE  
DOOR UNITS, UP TO 9'-0" x 6'-8"  
WITH & WITHOUT SIDELITES

PART OR ASSEMBLY:  
ANCHORING LOCATIONS  
AND DETAILS




#	DATE	REVISIONS	BY
B 5-18-07		MODIFIED TO MEET THE 2004 FBC	WR
A 3-15-02		GENERAL REVISION	TJH

DATE:	12-23-01
SCALE:	N.T.S.
DWG. BY:	WLN
CHK. BY:	RW
DRAWING NO.:	S-2103-05
SHEET	5 OF 7

*[Signature]*  
 Eric S. Nielsen  
 Florida P. E. No. 41323  
 PTC, LLC  
 1535 Cogswell Street, Suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935

Prepared By:  
**PTC**  
 PTC, LLC  
 Phone: 321-690-1788  
 Fax: 321-690-1789

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No 07-0618,09  
 Expiration Date 07/03/2012  
 By *[Signature]*  
 Miami Dade Product Control  
 Division

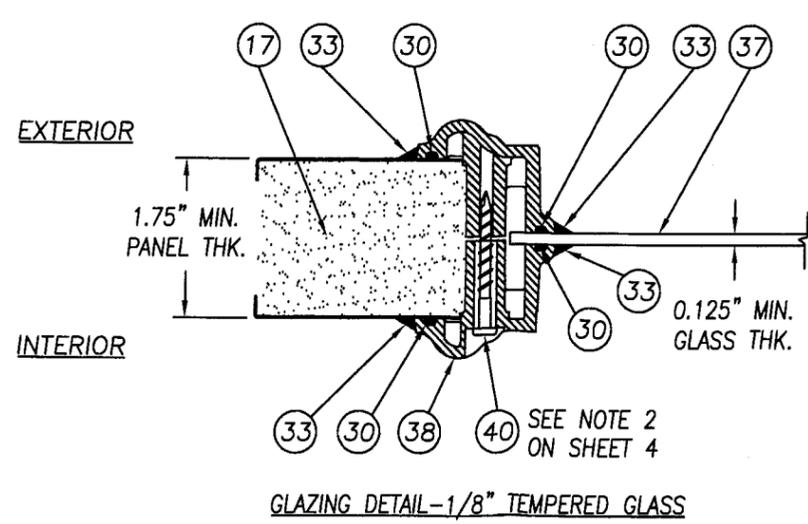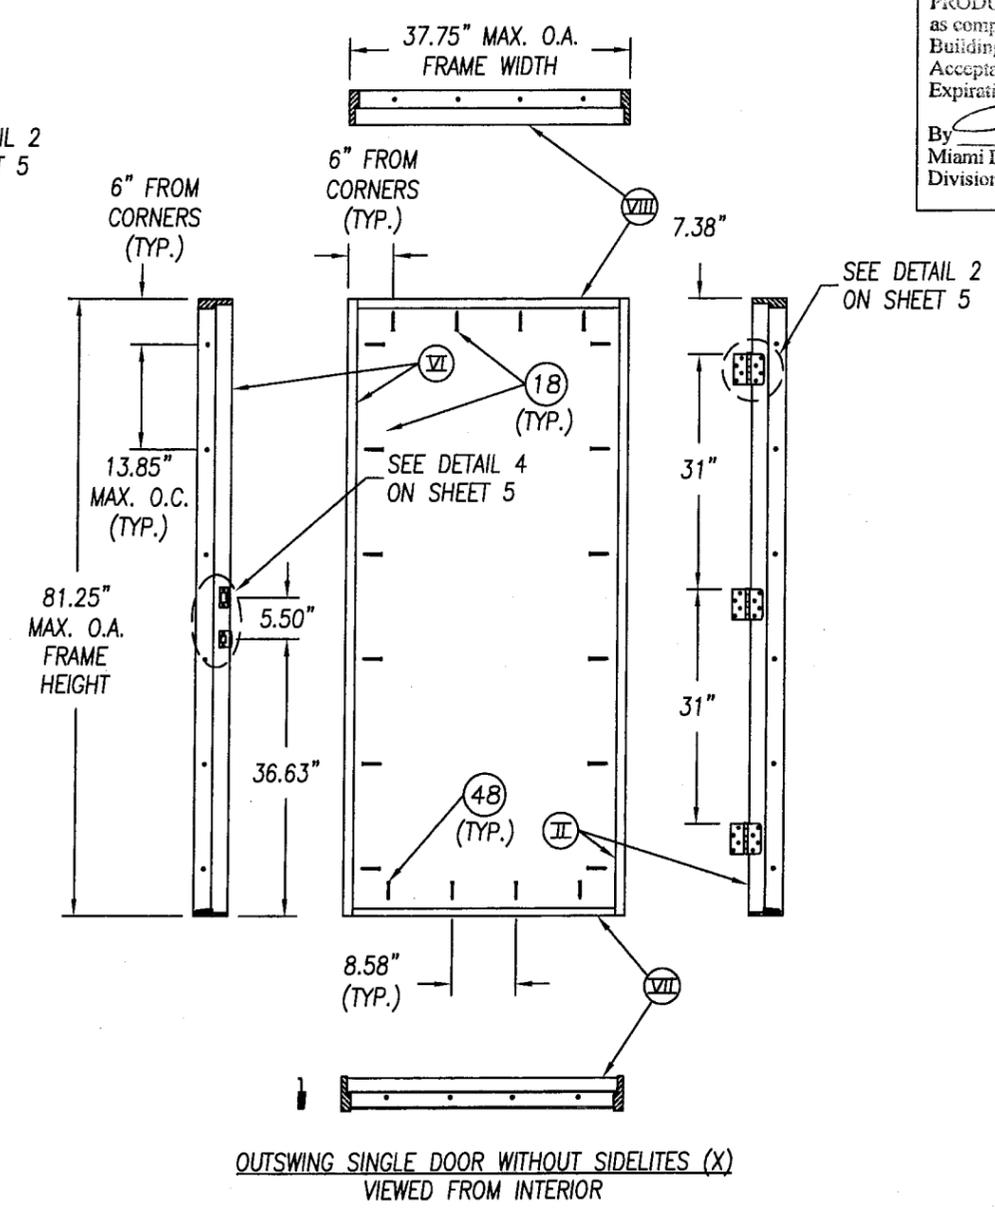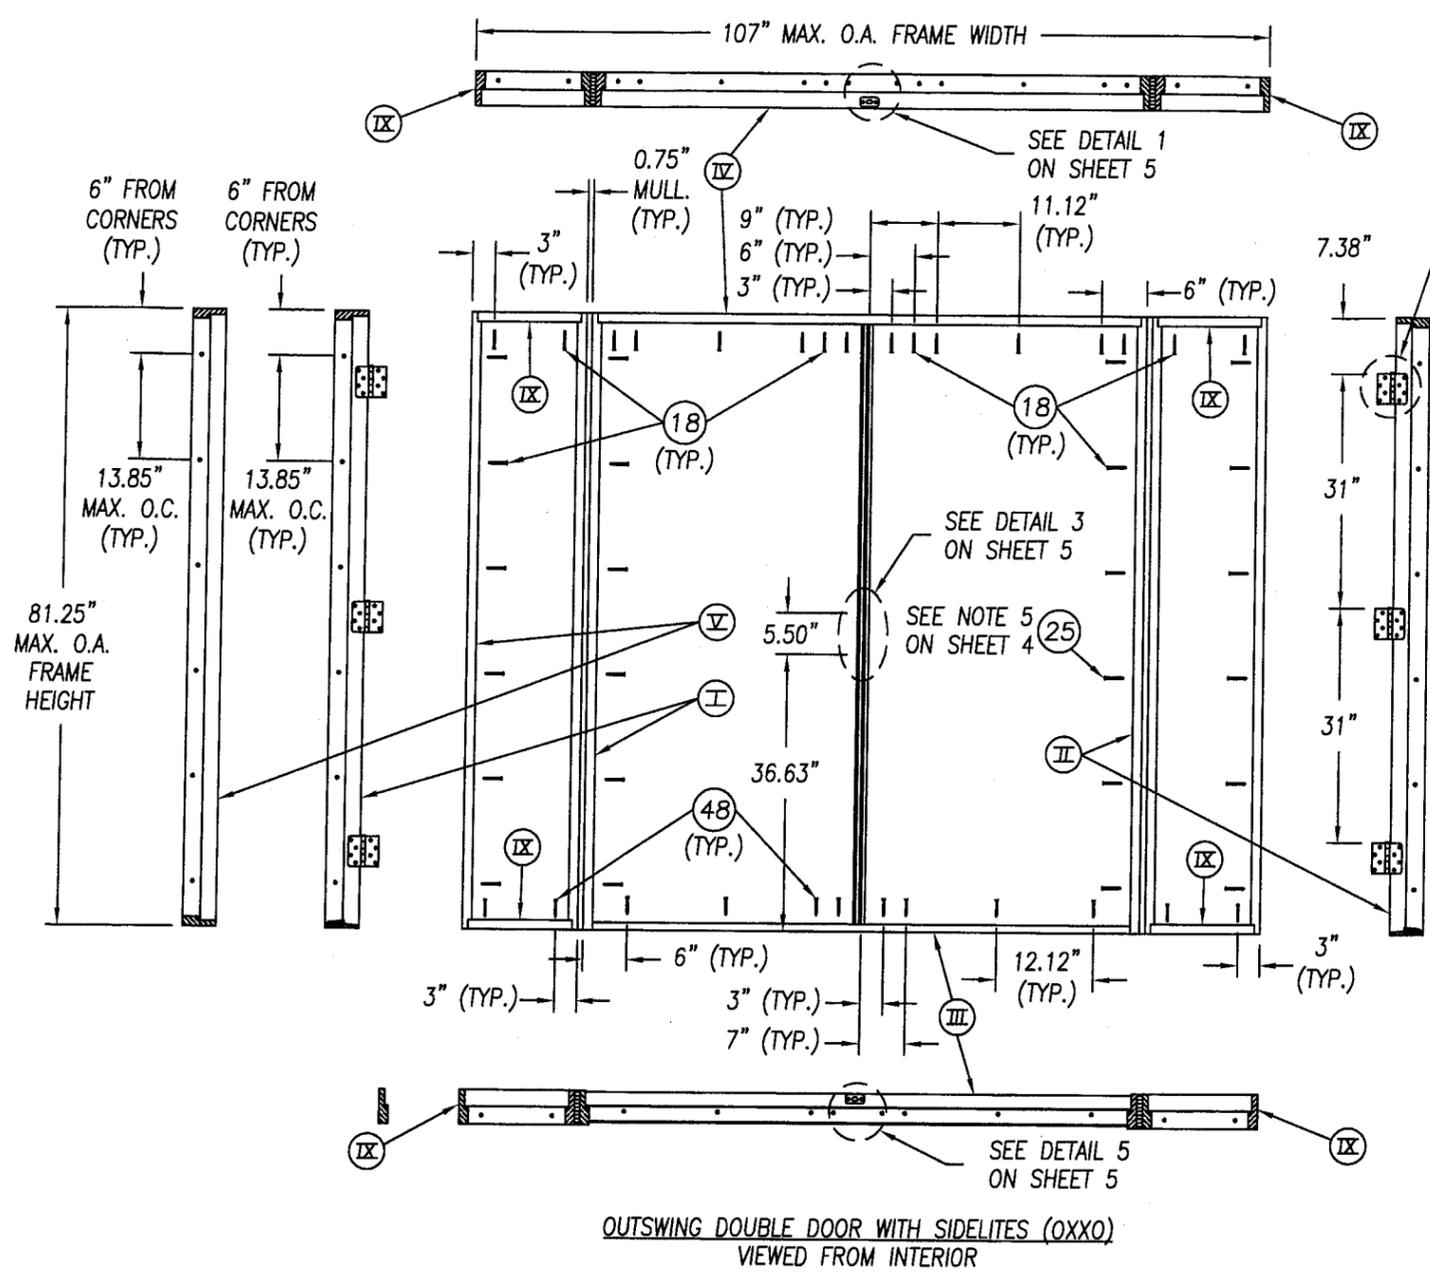

**JELD-WEN, INC.**  
 3737 LAKEPORT BLVD.  
 KLAMATH FALLS, OR. 97601  
 PH. 541.882.3451

PRODUCT: OUTSWING GLAZED STEEL EDGE DOOR UNITS, UP TO 9'-0" x 6'-8" WITH & WITHOUT SIDELITES

PART OR ASSEMBLY: ANCHORING LOCATIONS AND GLAZING DETAILS

REV	DATE	BY
B	5-18-07	WR
A	3-15-02	TJH
		BY

MODIFIED TO MEET THE 2004 FBC GENERAL REVISION REVISIONS

DATE: 12-23-01

SCALE: N.T.S.

DWG. BY: WLN

CHK. BY: RW

DRAWING NO.: S-2103-06


SHEET 6 OF 7

*[Signature]*  
 5/24/07


Eric S. Nielsen  
 Florida P. E. No. 41323  
 PTC, LLC  
 1535 Cogswell Street, Suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935

Prepared By:  
**PTC**  
 PTC, LLC  
 Phone: 321-690-1788  
 Fax: 321-690-1789


PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 07-0618.09  
 Expiration Date 07/03/2012  
 By *[Signature]*  
 Miami Dade Product Control  
 Division

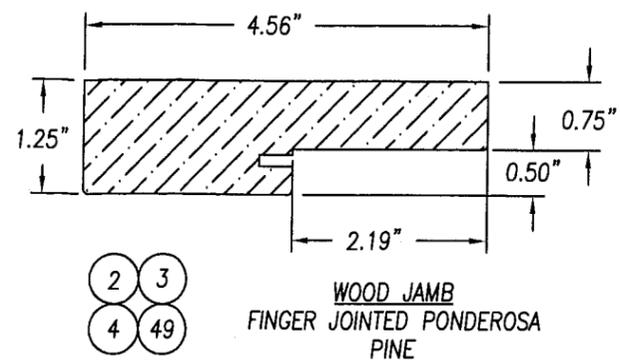

WOOD JAMB  
 FINGER JOINTED PONDEROSA  
 PINE

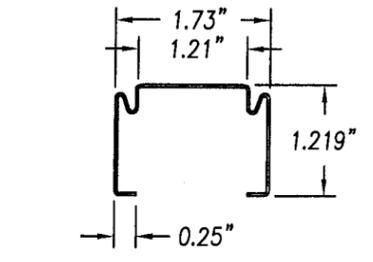


DOOR TOP RAIL & SIDE STILE  
 22GA (0.029\"/>

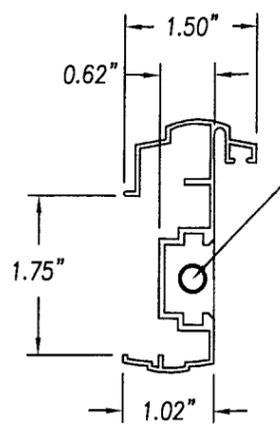


ASTRAGAL HAS TWO .312\"/>
 DIA. x 9\"/>


ASTRAGAL (IMPERIAL)  
 6063-T6 ALUMINUM

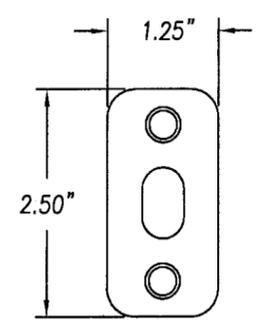


ASTRAGAL STRIKE PLATE  
 (IMPERIAL 0.125\"/>

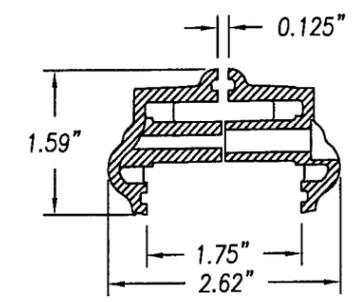


ODL LITE FRAME 1/8\"/>
 SG  
 HP POLYPROPELENE

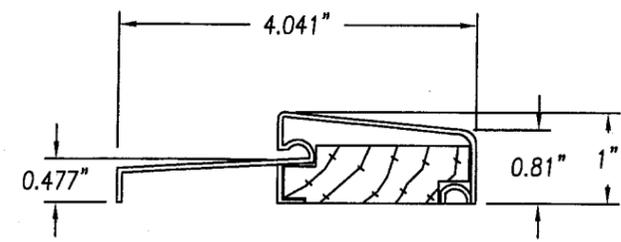


OUTSWING BUMP FACE THRESHOLD  
 0.051\"/>

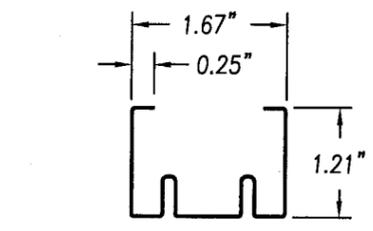


DOOR BOTTOM RAIL  
 24GA (0.021\"/>




MULLION CAP  
 PINE




HAGER STEEL BUTT HINGE  
 4\"/>

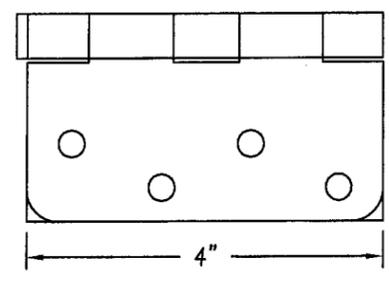


COMPRESSION WEATHERSRIP  
 SCHLEGEL Q-LON QDS 650

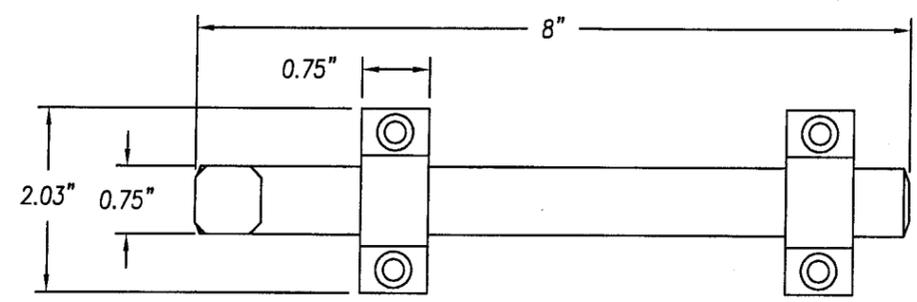


SURFACE BOLT IVES #454  
 (0.25\"/>




SURFACE BOLT SPACER  
 (0.50\"/>

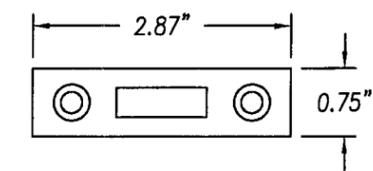


SURFACE BOLT STRIKE  
 (IVES .125\"/>

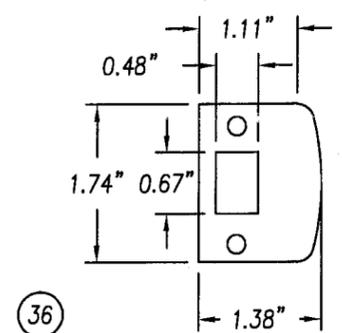


DOOR LATCH STRIKE PLATE

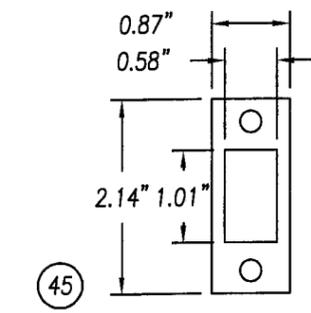

DOOR LATCH DEAD BOLT STRIKE PLATE

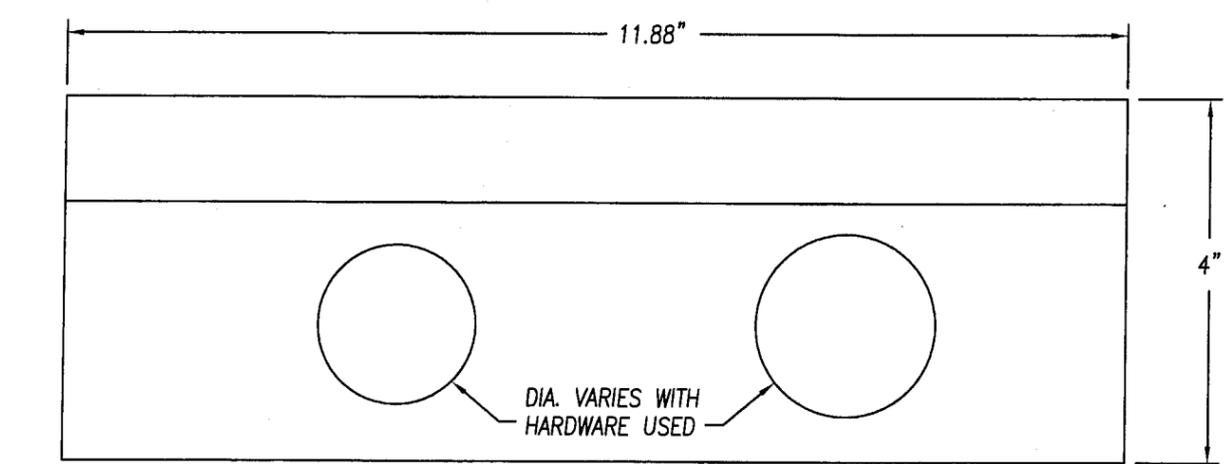

WOOD LOCK BLOCK  
 FINGER JOINTED PINE

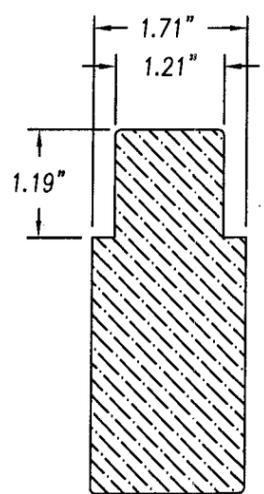

HINGE STILE  
 REINFORCEMENT (MDF)

*[Signature]*  
 5/24/07  
 Eric S. Nielsen  
 Florida P. E. No. 41323  
 PTC, LLC  
 1535 Cogswell Street, Suite G25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935

Prepared By:  
**PTC**  
 PTC, LLC  
 Phone: 321-690-1788  
 Fax: 321-690-1789

JELD-WEN, INC.  
 3737 LAKEPORT BLVD.  
 KLAMATH FALLS, OR. 97601  
 PH. 541.882.3451

PRODUCT:  
 OUTSWING GLAZED STEEL EDGE  
 DOOR UNITS, UP TO 9'-0" x 6'-8"  
 WITH & WITHOUT SIDELITES  
 PART OR ASSEMBLY:  
 UNIT COMPONENTS

#	DATE	REVISIONS	BY
B 15-18-07		MODIFIED TO MEET THE 2004 FBC	WR
A 3-15-02		GENERAL REVISION	TJH

DATE: 12-23-01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2103-07  
 SHEET 7 OF 7