



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339**

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

**Jeld-Wen, Inc.
3250 Lakeport Drive
Klamath Falls, OR 97601**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "DoorCraft" 6'8" S/E Single Inswing Opaque Steel Insulated Door - L.M.I.- w/wo Sidelites - N.I.

APPROVAL DOCUMENT: Drawing No. **S-2198**, titled "Steel Edge Opaque Steel Inswing Impact Door up to 5'-11" x 6'-8" w/ and w/o Non-Impact Sidelites", sheets 1 through 6, prepared by PTC, LLC, dated December 26, 2001, with revision D dated August 31, 2007, signed and sealed by Eric Nielsen, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Single Doors : Large and Small Missile Impact; Sidelites : Non-Impact

LIMITATION: Sidelites require Miami-Dade HVHZ approved impact resistant shutter.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

REVISION of this NOA shall be considered after a revision application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 02-0107.03** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P.E.**



*J. Gascon
9/12/07*

**NOA No 07-0709.03
Expiration Date: August 08, 2012
Approval Date: October 04, 2007
Page 1**

Jeld-Wen, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **S-2198**, titled "Steel Edge Opaque Steel Inswing Impact Door up to 5'-11" x 6'-8" w/ and w/o Non-Impact Sitelites", sheets 1 through 6, prepared by PTC, LLC, dated December 26, 2001, with revision D dated August 31, 2007, signed and sealed by Eric Nielsen, P.E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per PA 202-94
 - 2) Uniform Static Air Pressure Test, Loading per PA 202-94
 - 3) Water Resistance Test, per PA 202-94
 - 4) Forced Entry Test, per PA 202-94
 - 5) Large Missile Impact Test per PA 201-94
 - 6) Cyclic Wind Pressure Loading PA 203-94along with marked-up drawings and installation diagram of an Inswing steel edge steel door, prepared by Certified Testing Laboratories, Test Report No. **CTLA694W**, dated 4/20/01, signed and sealed by Ramesh Patel, P.E.
"Submitted under NOA# 020107.03"

2. Test reports on:
 - 1) Tensile Test, per ASTM E 8
 - 2) Tensile Test, per ASTM A 370along with marked-up drawings and installation diagram, prepared by Certified Testing Laboratories, Test Report No. **CTLA696W/DADE**, dated May 03, 2001 and May 30, 2001, signed and sealed by Ramesh Patel, P.E.
"Submitted under NOA# 020107.03"

3. Test reports on:
 - 1) Self Ignition Test, per ASTM D 1929-96
 - 2) Surface Burning Characteristics of Building Materials, per ASTM E 84-97Aalong with marked-up drawings and installation diagram, prepared by Intertek Testing Services NA, Inc., Test Report No. **ITS-J99006660-001**, dated April 08, 1999, signed and sealed by Douglas Keith Tucker, P.E.
"Submitted under NOA# 020107.03"

C. CALCULATIONS

1. Anchor Calculations and structural analysis, prepared by PTC, LLC, dated June 22, 2007, signed and sealed by Eric Nielsen, P.E.

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).



Jaime D. Gascon, P.E.
Chief, Product Control Division
NOA No 07-0709.03
Expiration Date: August 8, 2012
Approval Date: October 04, 2007

Jeld-Wen, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **05-0921.09** issued to ODL, Inc. for component "ODL/WR Doorlight Assemblies - Materials Approval" dated November 10, 2005, expiring on January 17, 2011.

F. STATEMENTS

1. Statement letter of conformance, compliance and no financial interest, dated June 22, 2007, signed and sealed by Eric Nielsen, P.E.

G. OTHER

1. Notice of Acceptance No. **02-0107.03**, issued to Jeld-Wen, Inc. for their Series "Steel Edge Opaque Steel Inswing Impact Door up to 5'-11" x 6'-8" w/ and w/o Non-Impact Sitelites", approved on August 08, 2002 and expiring on August 08, 2007.



Jaime D. Gascon, P.E.
Chief, Product Control Division
NOA No 07-0709.03
Expiration Date: August 8, 2012
Approval Date: October 04, 2007

JELD-WEN® Steel

6'-8" INSWING STEEL EDGE OPAQUE IMPACT STEEL DOOR
UNITS W/ & W/O NON-IMPACT SIDELITES

PRODUCT: JELD-WEN
as complying with the Florida
Building Code
Acceptance No. 07-0709.03
Expiration Date 08/08/2012
By: *[Signature]*
Miami-Dade Product Control
Division

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE 2004 FLORIDA BUILDING CODE (WITH 2005 & 2006 SUPPLEMENTS) AND HIGH VELOCITY HURRICANE ZONE (HVHZ) REQUIREMENTS.
2. 2X WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED PER ANCHOR LOCATION DRAWINGS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. SEE TABLE 1 ON THIS SHEET FOR DESIGN PRESSURE RATINGS.
5. THIS PRODUCT DOES NOT MEET THE WATER REQUIREMENTS FOR "HVHZ" ZONES WHEN USING THE SLOPED ADJUSTABLE ALUMINUM THRESHOLD. SEE NOTE ATTACHED TO THE DESIGN PRESSURE CHART BELOW.
6. SIDELITES REQUIRE MIAMI-DADE APPROVED IMPACT RESISTANT SHUTTERS.
7. SIDELITES ARE AN OPTION.
8. A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

COMPONENT CONSTRUCTIONS:

Face sheets: 24 ga. (0.020") minimum thickness, Galvanized Steel A-525 commercial quality - AKDQ per ASTM 620 with average minimum yield strength $F_y(\text{ave.}) = 25,000$ psi.

Core design: Expanded polystyrene with 1.0 to 1.25 lbs./cf density, by JELD-WEN, INC.

Door Panel Construction: The active and inactive door panels are constructed from 24GA. (0.020" min.) galvanized steel. The face sheet bottoms are bent 90° over the 24 ga. (0.021" min.) rollformed bottom rail measuring 1.73" wide x 1.21" high. The face sheet tops and sides are bent 90° over the 22 ga. (0.029" min.) rollformed top rail and side stiles which measure 1.73" wide X 1.219" high. The side stile tabs are bent 90° over the bottom rail, and secured with a 0.25" x 0.50" x 16 ga. rivet at each corner. The interior cavity is filled with polystyrene, and the face sheets are glued to it.

Sidelite Panel Construction: The sidelite panels are constructed from 24GA. (0.020" min.) galvanized steel. The four edges of the face sheets are bent 90° over the polystyrene core and glued to it. The panels are routed to receive the ODL Lite Frames, and glazed with 1/8" tempered glass.

Frame Construction: The frames are constructed from Ponderosa Pine jambs measuring 1.25" wide x 4.563" deep. The door and sidelite head jambs are mortised and butt joined to the side jambs. The door frames use an adjustable threshold measuring 4.56" wide x 1.15" high. The sidelite frames use a 4.56" wide x 1.15" high sidelite sill with integral saddle. All attachments are made with (3) 16GA., 2" x 7/16" crown wire staples at each corner.

TABLE OF CONTENTS

SHT #	DESCRIPTION
1	GENERAL NOTES AND ELEVATIONS
2	VERTICAL CROSS SECTIONS AND BILL OF MATERIALS
3	HORIZONTAL CROSS SECTIONS AND GLAZING DETAIL
4	HORIZONTAL CROSS SECTIONS AND NOTES
5	ANCHORING LOCATIONS AND DETAILS
6	UNIT COMPONENTS

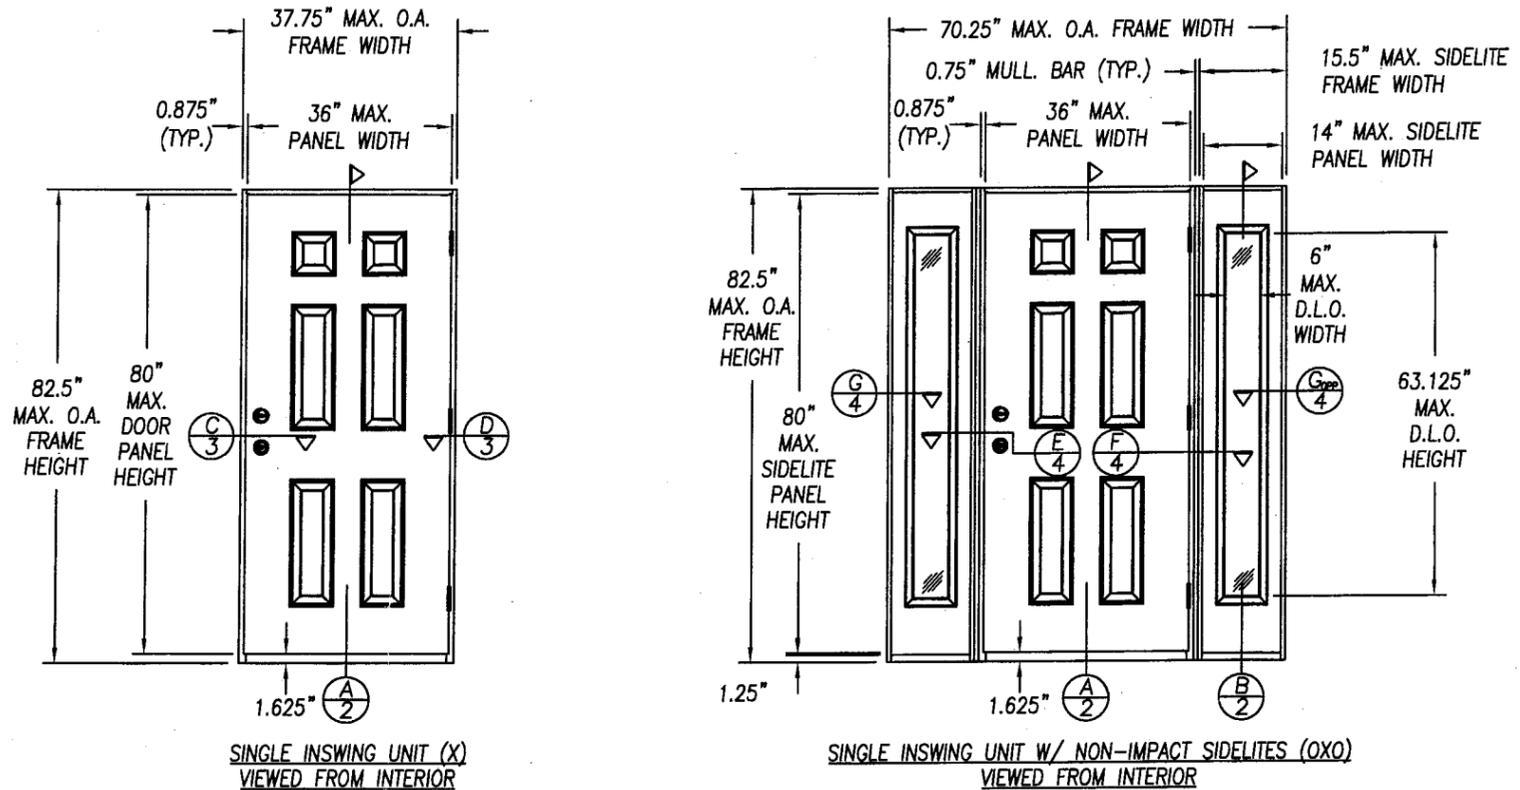


TABLE 1:

* DESIGN PRESSURE RATING WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED	W/ ADJUSTABLE THRESHOLD
SINGLE W/WO NON-IMPACT SIDELITES (X, OX, XO, OXO)	+60 psf -60 psf

*CAN BE USED WHERE OVERHANG REQUIREMENTS MEET THE 2004 FBC SECTION R 4410.2.3.2.1

[Signature]
8/3/10
Eric S. Nielsen
Florida P. E. No. 41323
PTC, LLC
1535 Cogswell Street, Suite C25
Rockledge, Florida 32955
FBPE Certificate of Authorization NO. 25935

Prepared By:
PTC
PTC, LLC
Phone: 321-690-1788
Fax: 321-690-1789

JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR. 97601
PH. 541.882.3451

PRODUCT: STEEL EDGE OPAQUE STEEL INSWING IMPACT DOOR UP TO 5'-11" X 6'-8" W/ AND W/O NON-IMPACT SIDELITES


PART OR ASSEMBLY:

GENERAL NOTES AND ELEVATIONS

#	DATE	REVISIONS	BY
D	08/31/07	AS REQUESTED BY MIAMI-DADE	CB
C	06/15/07	MODIFIED TO MEET THE 2004 FBC	WR
B	05/30/02	CORRECT B.O.M.	RW
A	03/13/02	GENERAL REVISION	TJH

DATE: 12-26-01
SCALE: N.T.S.
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2198-01
SHEET 1 OF 6

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 07-0709.03
 Expiration Date 08/08/2012
 By *[Signature]*
 Miami-Dade Product Control
 Division

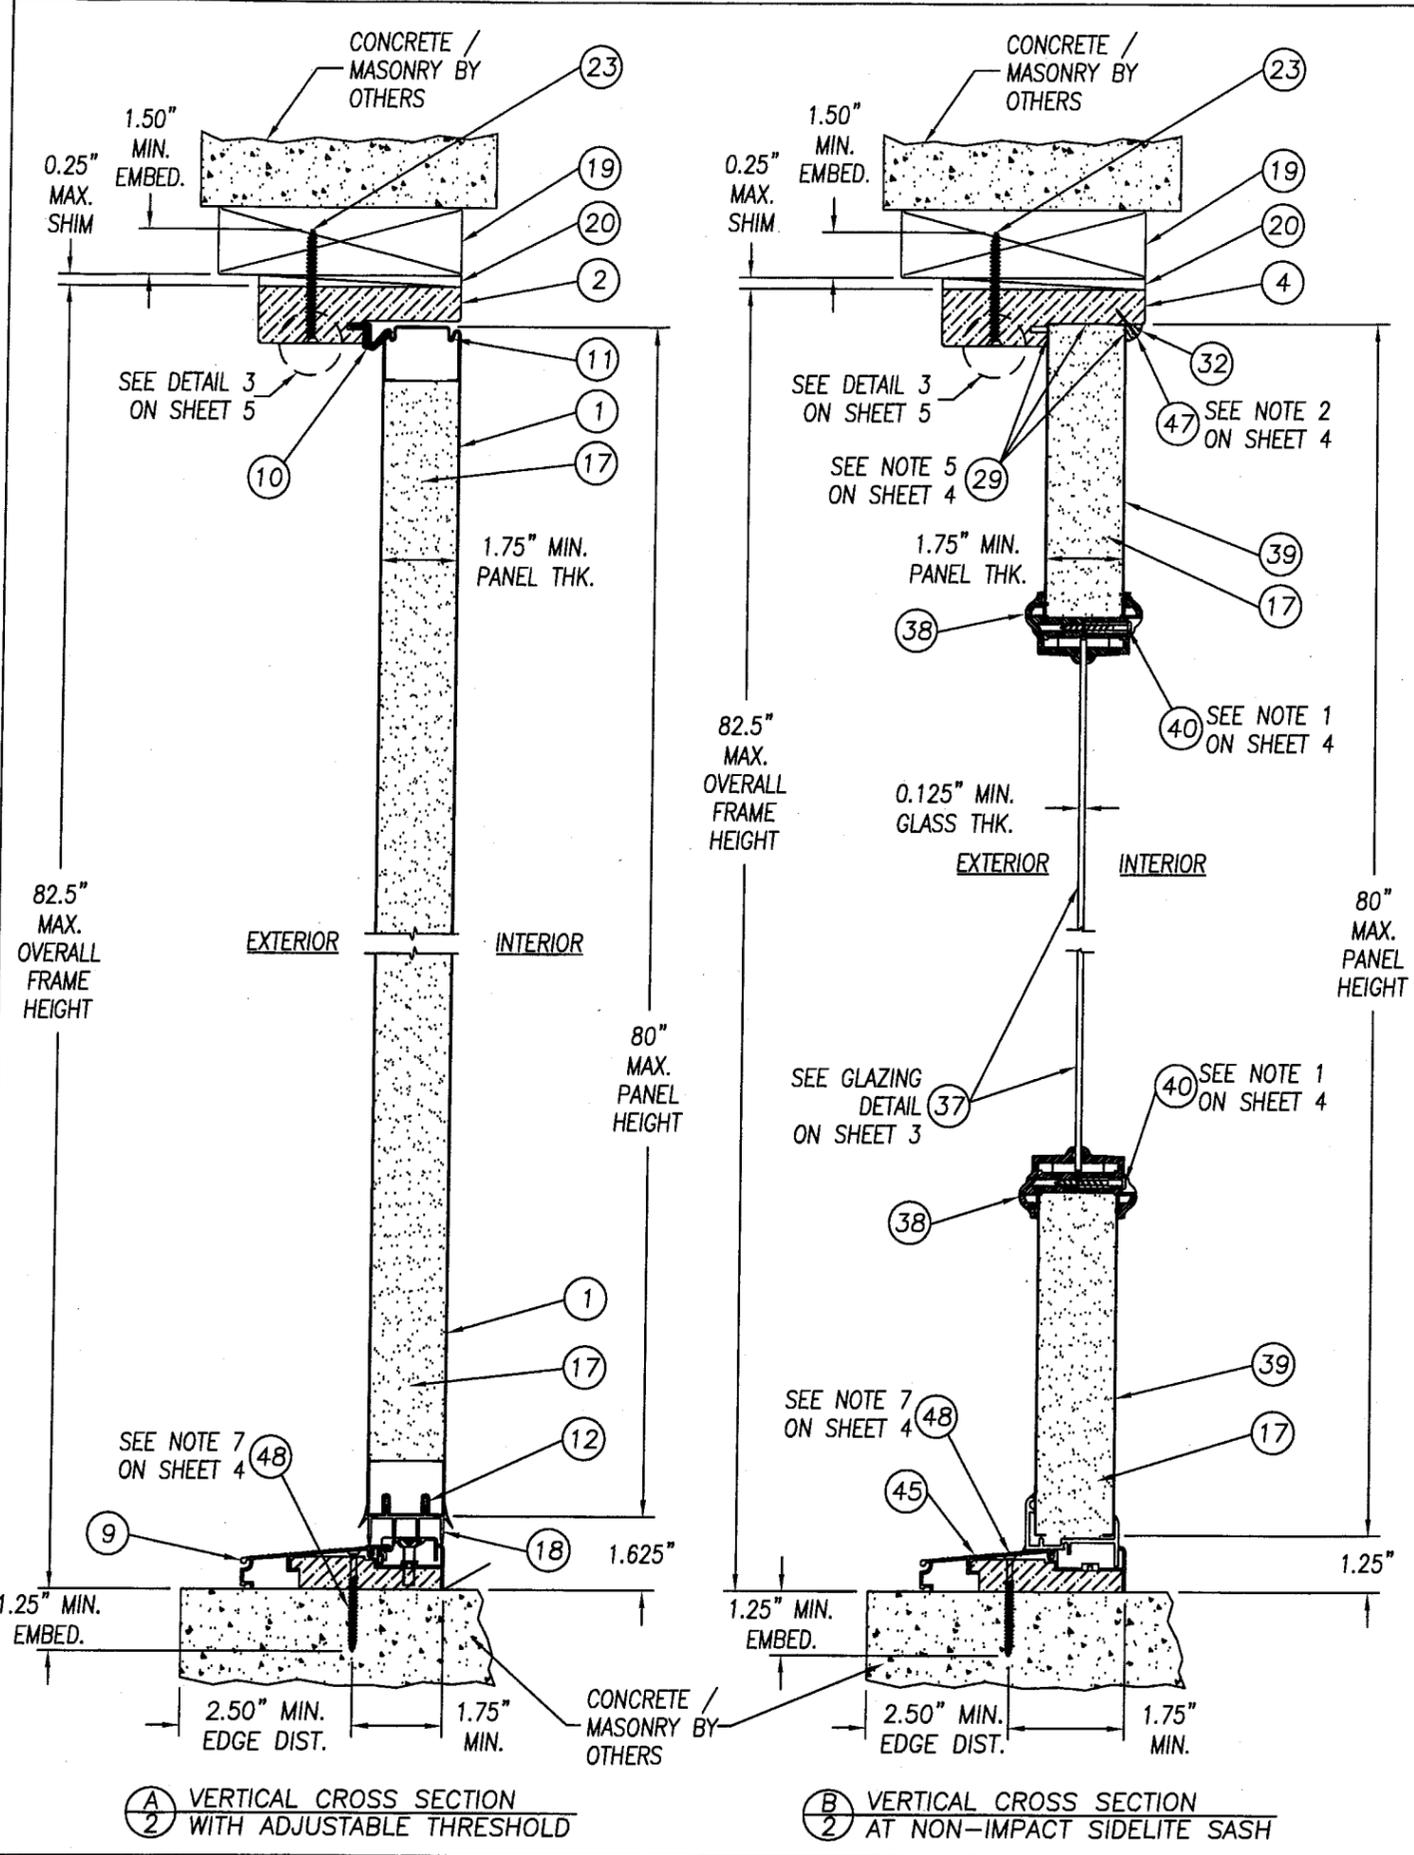

ITEM	DESCRIPTION	MATERIAL
1	DOOR STEEL FACE SHEET 24GA. (0.020" MIN.)	STEEL
2	FRAME HEAD (FINGER JOINTED PONDEROSA PINE)	WOOD
3	FRAME HINGE JAMB (FINGER JOINTED PONDEROSA PINE)	WOOD
4	SIDELITE FRAME HEAD AND JAMBS (FINGER JOINTED PONDEROSA PINE)	WOOD
5	4" X 4" BUTT HINGE 12ga. (BY HAGER)	STEEL
6	#9 X 1" PFH WOOD SCREW (HINGE TO DOOR)	STEEL
7	LATCH STILE REINFORCEMENT (44.5" LONG)	MDF
8	LATCH STILE REINFORCEMENT (32.125" LONG)	MDF
9	INSWING ADJUSTABLE THRESHOLD (BY IMPERIAL)	ALUMINUM
10	COMPRESSION WEATHERSTRIP	FOAM
11	DOOR TOP RAIL	STEEL
12	DOOR BOTTOM RAIL	STEEL
13	DOOR SIDE STILE	STEEL
14	#10 X 1 3/4" PFH WOOD SCREW	STEEL
15	LOCK BLOCK	LVL
16	HINGE STILE REINFORCEMENT (12.4" LONG)	MDF
17	EXPANDED POLYSTYRENE (1.0 to 1.25 lb./cf DENSITY) BY JELD-WEN	FOAM
18	INSWING VINYL DOOR BOTTOM SWEEP	VINYL
19	2x WOOD SUB BUCK (BY OTHERS)	WOOD
20	0.25" MAX. SHIM MATERIAL (MADE FROM HIGH DENSITY PLASTIC OR GREATER)	-
21	KWIKSET 400 SERIES KNOB	STEEL
22	KWIKSET TITAN 700 SERIES DEADBOLT (NOT SHOWN)	STEEL
23	#10 WOOD INSTALLATION SCREW W/ 1.50" MIN. EMBEDMENT	STEEL
24	#8 X 2" PFH WOOD SCREW	STEEL
25	#8 X 2 1/2" PFH WOOD SCREW	STEEL
26	DOOR LATCH STRIKE PLATE	STEEL
27	NOT USED	-
28	NOT USED	-
29	SILICONE CAULK (CR LAWRENCE 33 C)	SILICONE
30	GLAZING COMPOUND (QSD BY ODL)	SILICONE
31	MULLION CAP (82.5" LONG)	WOOD
32	3/8" QUARTER ROUND SIDELITE STOP	WOOD
33	DOOR LATCH DEAD BOLT STRIKE PLATE	STEEL
34	SCHLAGE KNOB SET #F51	STEEL
35	SCHLAGE DEADBOLT #B360 (NOT SHOWN)	STEEL
36	GLAZING COMPOUND DOW 1199	SILICONE
37	1/8" TEMPERED GLASS (BY PPG)	GLASS
38	ODL LITE FRAME 1/8" SG (SPARTECH POLYCOM PP5530 C13)	POLYPROP.
39	SIDELITE STEEL FACE SHEET 24GA. (0.020" MIN. STEEL)	STEEL
40	#8 X 1 1/2" PLASCREW (ODL LITE FRAME)	STEEL
41	PRESSURE TREATED MULLION BAR (0.75" X 4.563" X 82.5")	WOOD
42	YALE KNOB HERITAGE SERIES	STEEL
43	YALE DEADBOLT HERITAGE SERIES (NOT SHOWN)	STEEL
44	#10 X 1" PAN HEAD SHEET METAL SCREW	STEEL
45	SIDELITE THRESHOLD WITH INTEGRAL SADDLE (BY IMPERIAL)	ALUMINUM
46	#10 X 2" PFH WOOD SCREW	STEEL
47	BRAD TRIM NAIL 16 GA. X 0.75" LONG	STEEL
48	3/16" ELCO TAPCON ANCHOR W/ 1.25" MIN. EMBED.	STEEL
49	FRAME LATCH JAMB (FINGER JOINTED PONDEROSA PINE)	WOOD

JELD-WEN, INC.
 3737 LAKEPORT BLVD.
 KLAMATH FALLS, OR. 97601
 PH. 541.882.3451

PRODUCT: STEEL EDGE OPAQUE STEEL INSWING
 IMPACT DOOR UP TO 5'-11" X 6'-8"
 W/ AND W/O NON-IMPACT SIDELITES
 PART OR ASSEMBLY:
 VERTICAL CROSS SECTIONS
 AND BILL OF MATERIALS



DATE	BY	REVISIONS
D 08/31/07	AS REQUESTED BY MIAMI-DADE	
C 06/15/07	MODIFIED TO MEET THE 2004 FBC	
B 05/30/02	CORRECT B.O.M.	
A 03/13/02	GENERAL REVISION	

[Signature]
 Eric S. Nielsen
 Florida P. E. No. 41323
 PTC, LLC
 1535 Cogswell Street, Suite C25
 Rockledge, Florida 32955
 FBPE Certificate of Authorization NO. 25935

Prepared By:
PTC
 PTC, LLC
 Phone: 321-690-1788
 Fax: 321-690-1789

DATE: 12-26-01
 SCALE: N.T.S.
 DWG. BY: WLN
 CHK. BY: RW
 DRAWING NO.: S-2198-02
 SHEET 2 OF 6

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 07-9709-03
 Expiration Date 08/08/2012
 By *[Signature]*
 Miami Dade Product Control
 Division

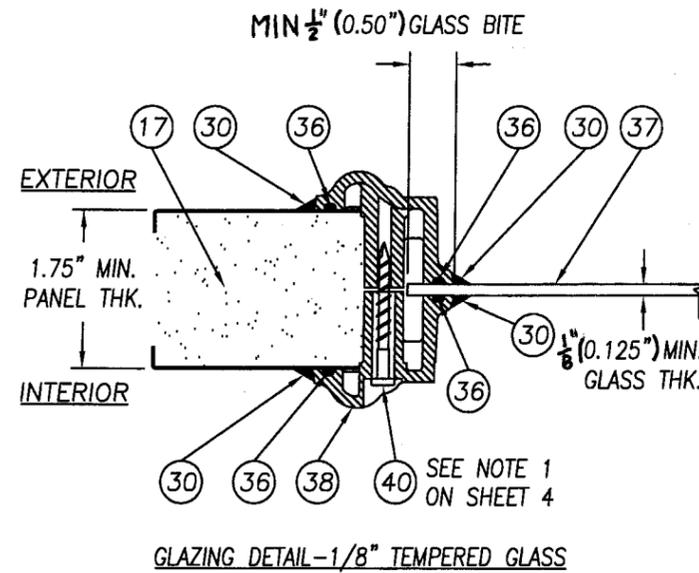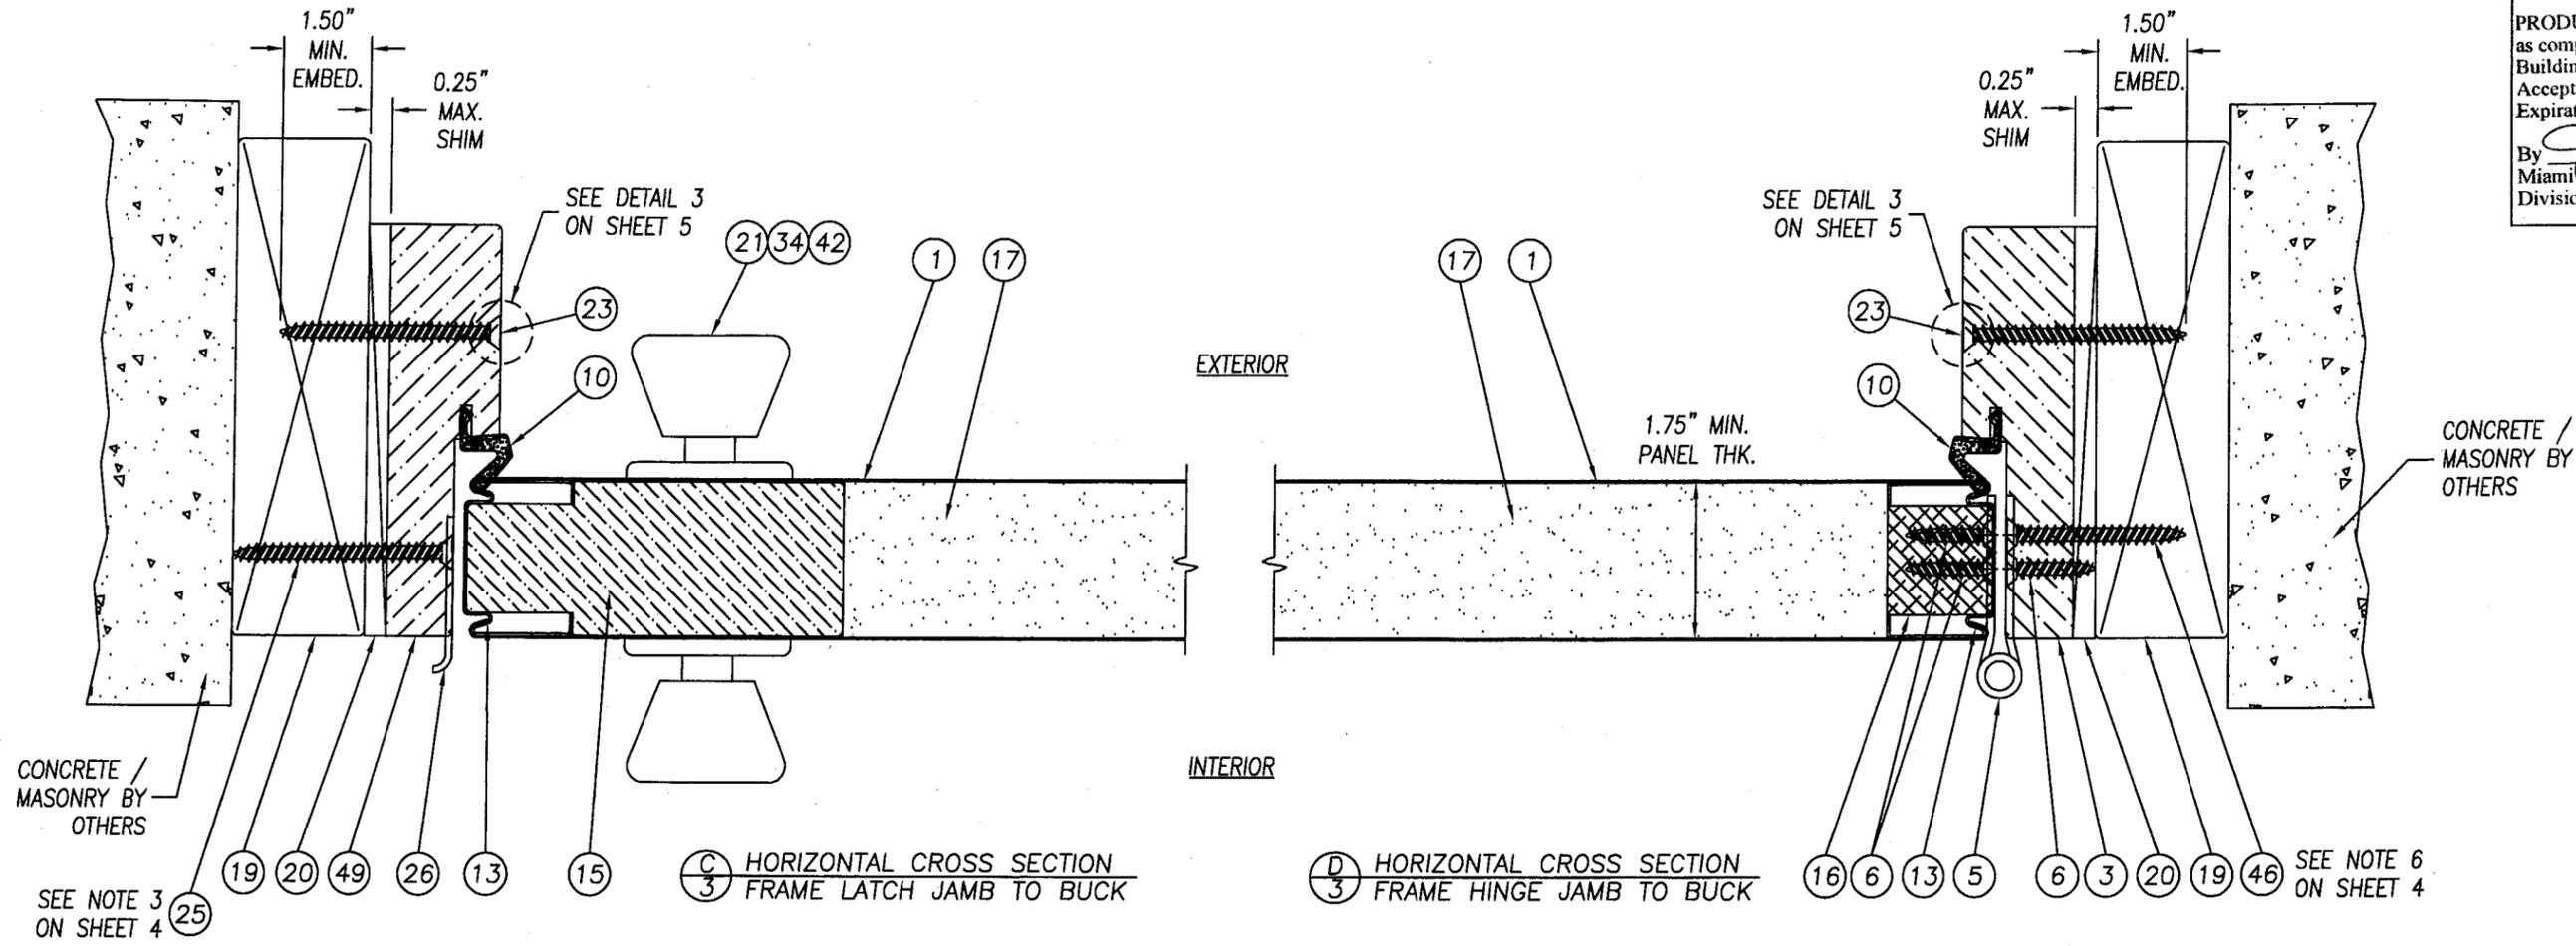

JELD-WEN, INC.
 3737 LAKEPORT BLVD.
 KLAMATH FALLS, OR. 97601
 PH. 541.882.3451


PRODUCT: STEEL EDGE OPAQUE STEEL INSWING
 IMPACT DOOR UP TO 5'-11" X 6'-8"
 W/ AND W/O NON-IMPACT SIDELITES
 PART OR ASSEMBLY:
 HORIZONTAL CROSS SECTIONS
 AND GLAZING DETAIL

#	DATE	REVISIONS	BY
D	08/31/07	AS REQUESTED BY MIAMI-DADE	CB
C	06/15/07	MODIFIED TO MEET THE 2004 FBC	WR
B	05/30/02	CORRECT B.O.M.	RW
A	03/13/02	GENERAL REVISION	TJH


[Signature]
 Eric S. Nielsen
 Florida P. E. No. 41323
 PTC, LLC
 1535 Cogswell Street, Suite C25
 Rockledge, Florida 32955
 FBPE Certificate of Authorization NO. 25935

Prepared By:
PTC
 PTC, LLC
 Phone: 321-690-1788
 Fax: 321-690-1789


DATE: 12-26-01
 SCALE: N.T.S.
 DWG. BY: WLN
 CHK. BY: RW
 DRAWING NO.: S-2198-03
 SHEET 3 OF 6

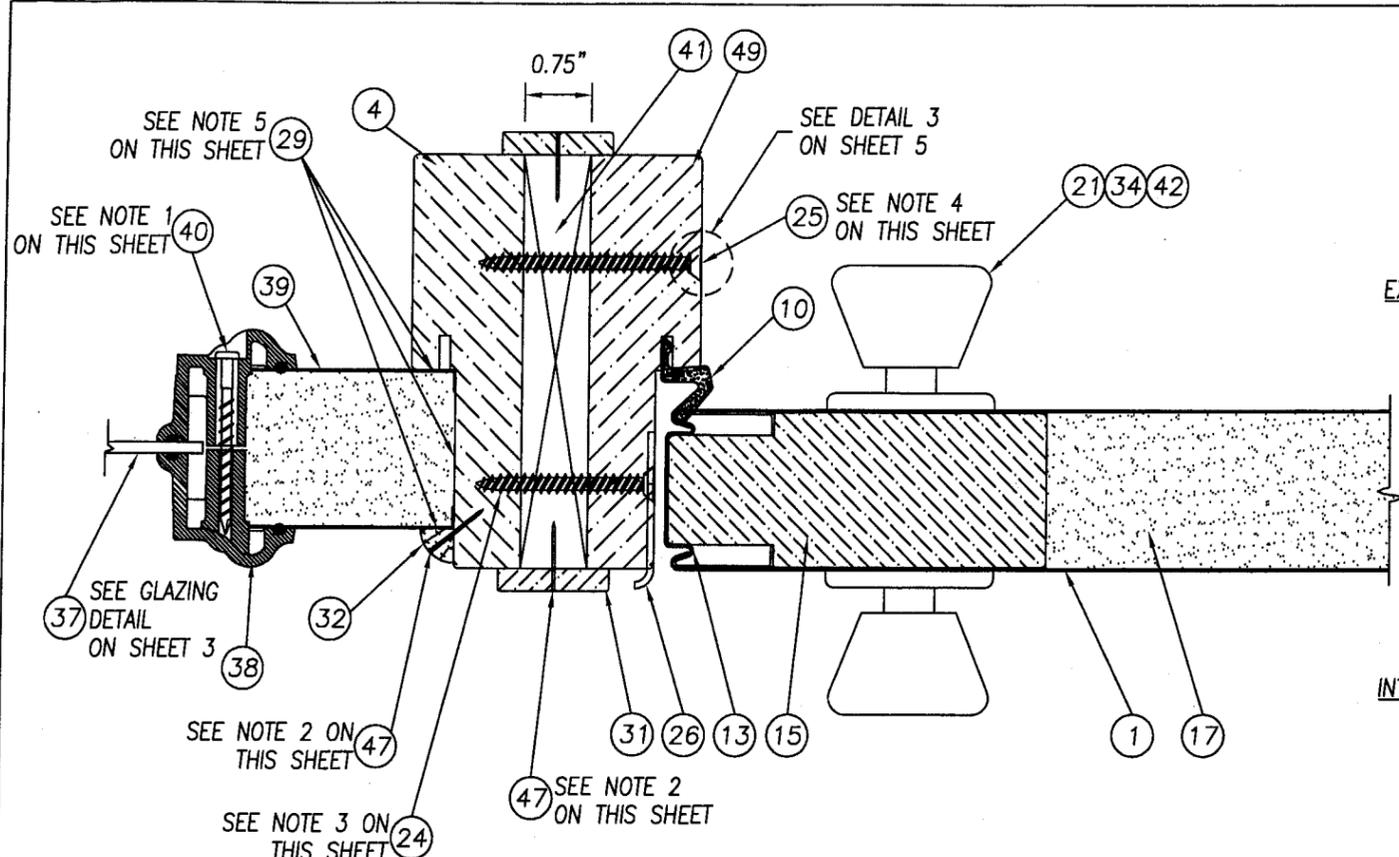

(E) HORIZONTAL CROSS SECTION
NON-IMPACT SIDELITE TO LATCH JAMB

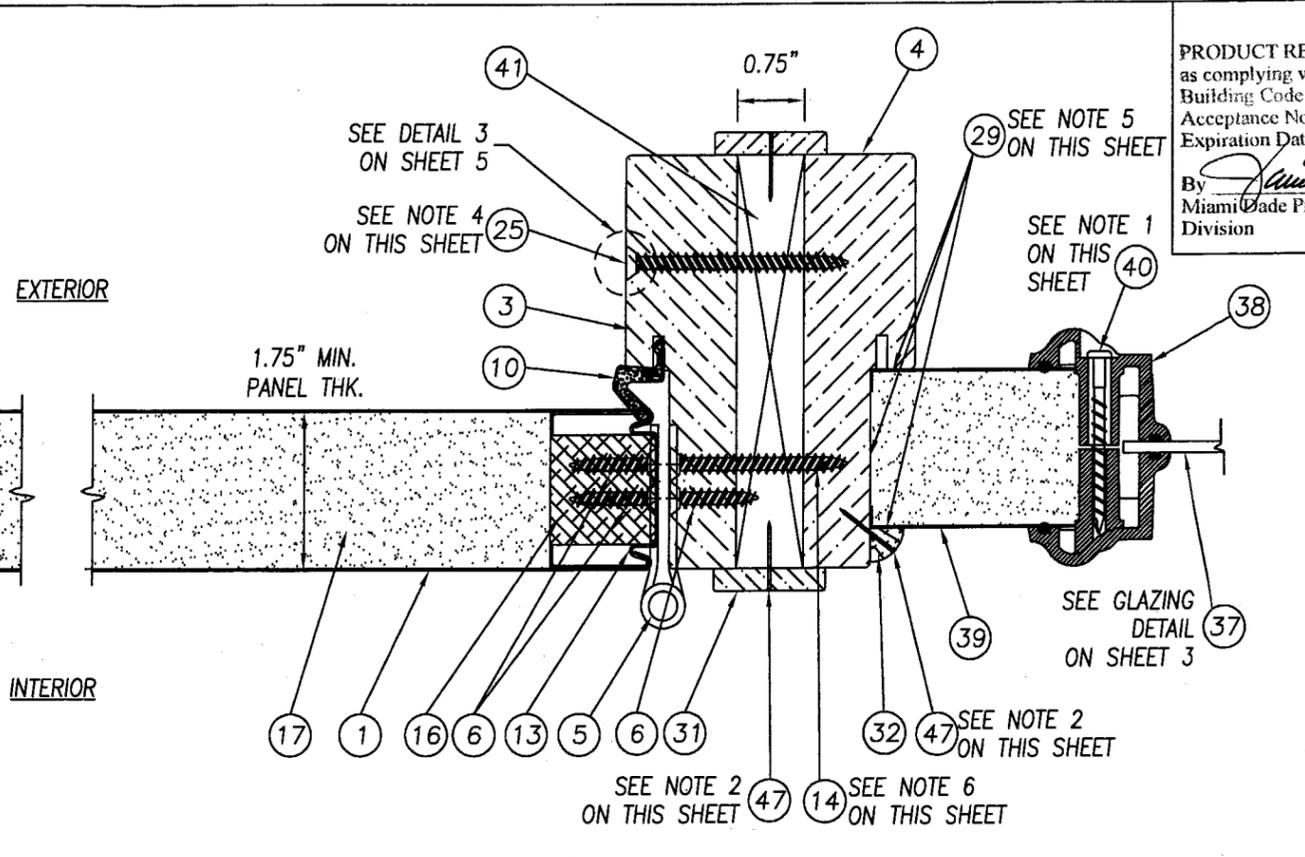

(F) HORIZONTAL CROSS SECTION
NON-IMPACT SIDELITE TO HINGE JAMB

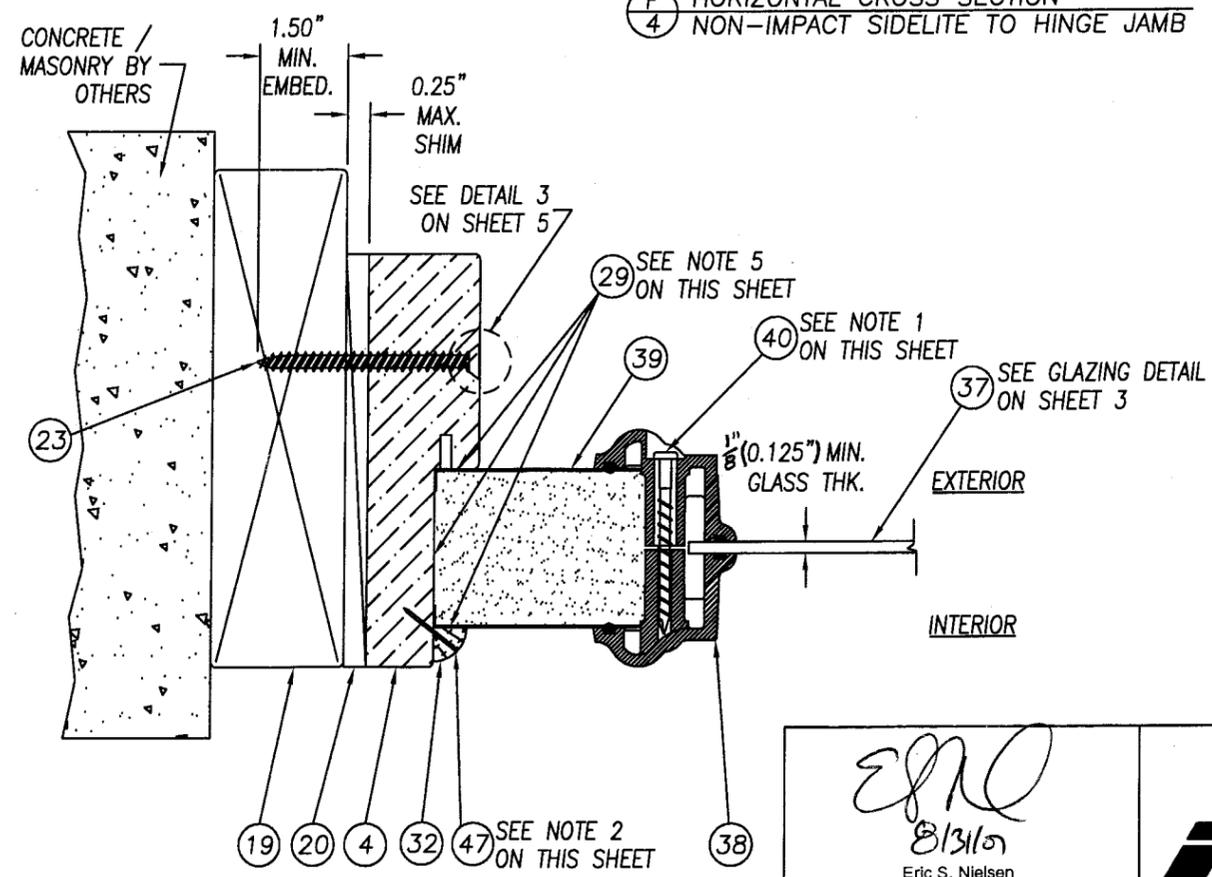

(G) HORIZONTAL CROSS SECTION
NON-IMPACT SIDELITE TO BUCK

NOTES:

1. SPACING FOR ITEM #40 THE #8 x 1 1/2" PLASCREW IS AS FOLLOWS:
TOP & BOTTOM, HORIZONTALLY, FOR DOOR PANEL; 3.0" IN FROM EACH CORNER, ONE IN CENTER.
TOP & BOTTOM, HORIZONTALLY, FOR SIDELITE PANEL; 3.0" IN FROM EACH CORNER.
FROM TOP DOWN ON THE SIDES; 3.0", 13.5", 24.5", 36.0", 46.0", 57.5", 68.5" & 79.0".
2. SPACING FOR ITEM #47 THE 16 GA. x 3/4" BRAD TRIM NAIL ATTACHING THE 3/8" QUARTER ROUND TO THE SIDELITE AND THE MULLION CAP TO THE MULLION BAR VERTICALLY, IS AS FOLLOWS:
TOP & BOTTOM HORIZONTALLY; 1.25" IN FROM EACH CORNER WITH (1) NAIL MID-SPAN.
VERTICALLY; 1.25" FROM EACH END & SIX MORE EQUALLY SPACED ON THE FIELD.
3. WHEN ATTACHING THE DOOR AND DEAD BOLT STRIKE PLATES TO THE JAMB AND BUCK USE ITEM #25, A #8 x 2 1/2" PFH WOOD SCREW.
WHEN ATTACHING THE DOOR AND DEAD BOLT STRIKE PLATES TO THE JAMB AND SIDELITE JAMB AT THE MULLION USE ITEM #24, A #8 x 2" PFH WOOD SCREW.
4. SPACING FOR ITEM #25, THE #8 x 2 1/2" PFH WOOD SCREWS ATTACHING THE JAMBS TOGETHER AT THE MULLION, IS AS FOLLOWS: 6.0" FROM EACH VERTICAL CORNER WITH (4) MORE SCREWS EQUALLY SPACED ON THE FIELD.
5. THE SIDELITE IS SECURED INTO THE SIDELITE FRAME WITH ITEM #29 SILICONE CAULK ON THREE FACES AND 3/8" QUARTER ROUNDS SECURED WITH ITEM #47 BRAD TRIM NAILS x 3/4" LONG.
6. WHEN ATTACHING THE HINGE TO THE JAMB AND BUCK USE ITEM #46, A #10 x 2" PFH SCREW.
WHEN ATTACHING THE HINGE TO THE JAMB AND SIDELITE JAMB AT THE MULLION USE ITEM #14, A #10 x 1 3/4" PFH WOOD SCREW.
7. ALTERNATE CONCRETE/MASONRY INSTALLATION ANCHORS OF EQUIV. PERFORMANCE CHARACTERISTICS CAN BE USED UPON APPROVAL OF THE ARCHITECT OR ENGINEER OF RECORD FOR THE PROJECT OF INSTALLATION.

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 07-0709-03
Expiration Date 08/08/2012
By *[Signature]*
Miami-Dade Product Control
Division

JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR. 97601
PH. 541.882.3451

PRODUCT: STEEL EDGE OPAQUE STEEL INSWING
IMPACT DOOR UP TO 5'-11" X 6'-8"
W/ AND W/O NON-IMPACT SIDELITES
PART OR ASSEMBLY:
HORIZONTAL CROSS
SECTIONS & NOTES


REV	DATE	BY	REVISIONS
D	08/31/07	AS REQUESTED BY MIAMI-DADE	
C	06/15/07	MODIFIED TO MEET THE 2004 FBC	
B	05/30/02	CORRECT B.O.M.	
A	03/13/02	GENERAL REVISION	

DATE: 12-26-01
SCALE: N.T.S.
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2198-04
SHEET 4 OF 6


[Signature]
8/31/07
Eric S. Nielsen
Florida P. E. No. 41323
PTC, LLC
1535 Cogswell Street, Suite C25
Rockledge, Florida 32955
FBPE Certificate of Authorization NO. 25935

Prepared By:
PTC
PTC, LLC
Phone: 321-690-1788
Fax: 321-690-1789


PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 07-0709.03
 Expiration Date 08/08/2012
 By *Eric S. Nielsen*
 Miami Dade Product Control
 Division

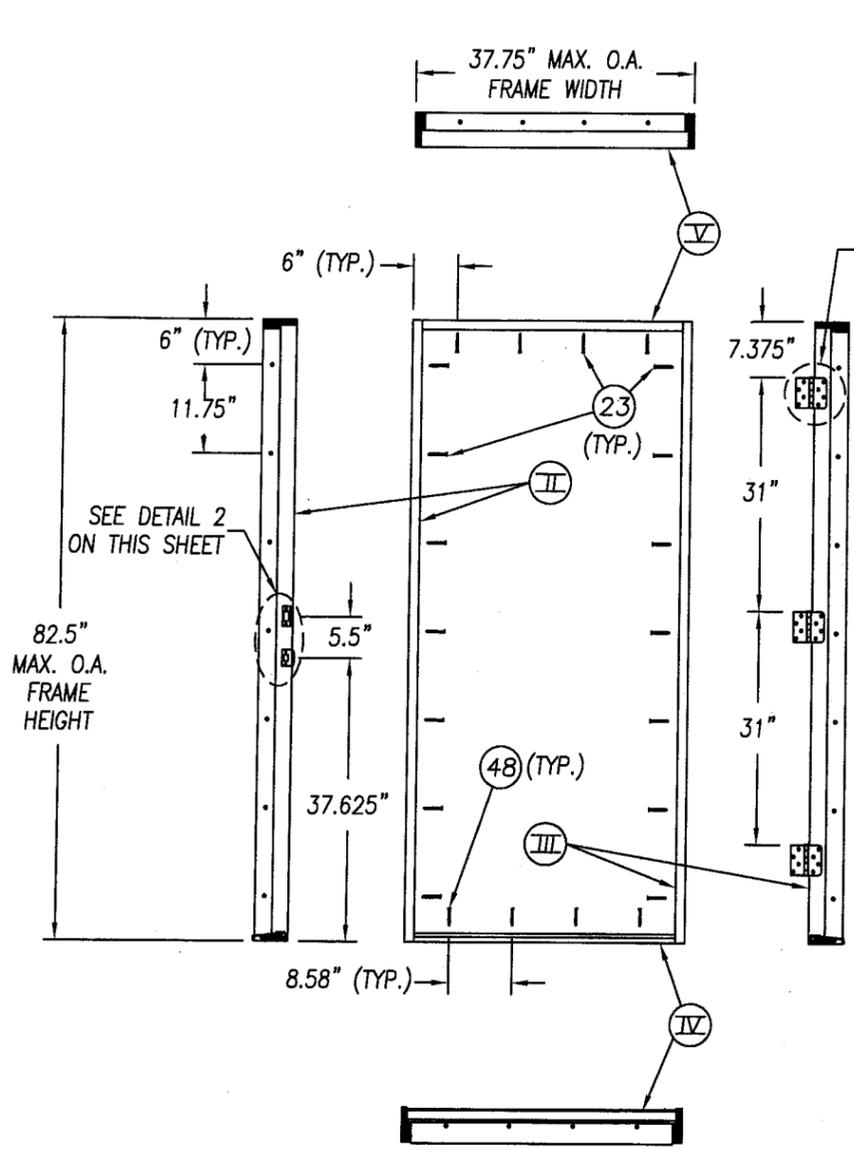


INSWING SINGLE DOOR WITHOUT NON-IMPACT SIDELITES (X)
 VIEWED FROM INTERIOR

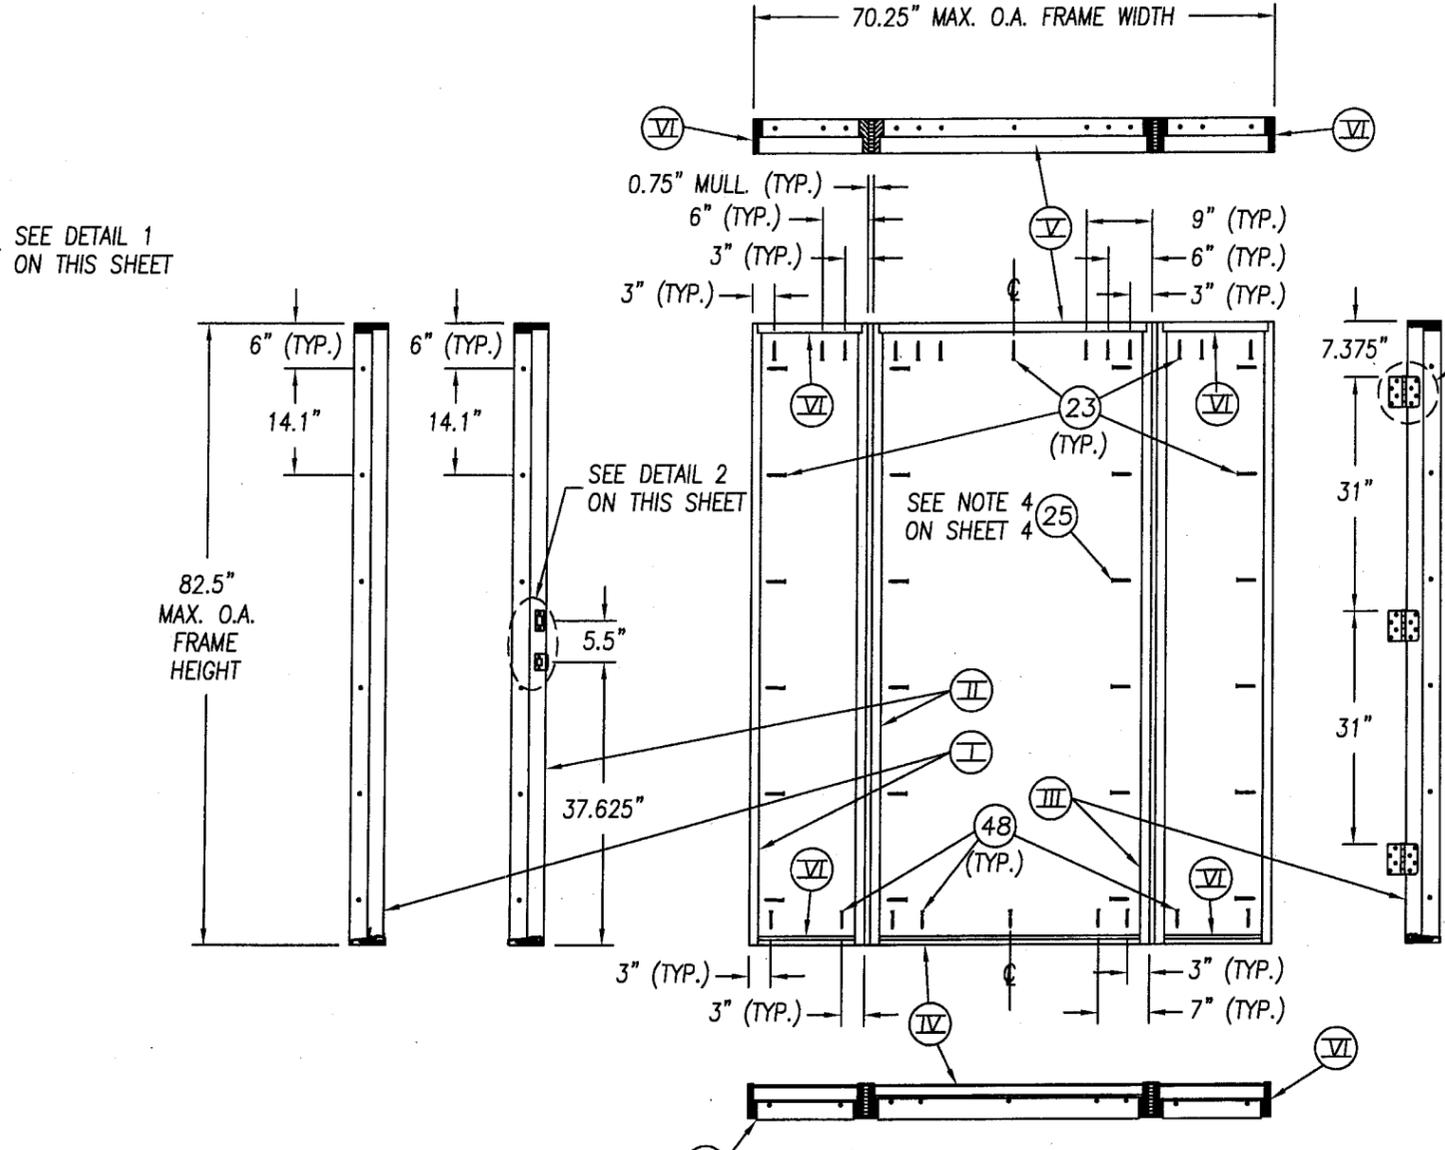


INSWING SINGLE DOOR WITH NON-IMPACT SIDELITES (OXO)
 VIEWED FROM INTERIOR

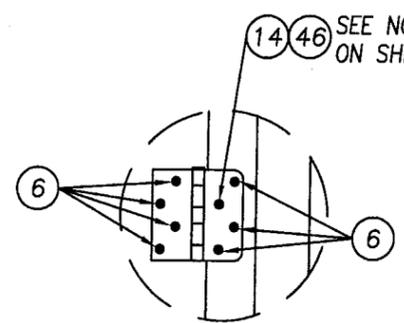

DETAIL 1
 HINGES TO JAMB & DOOR

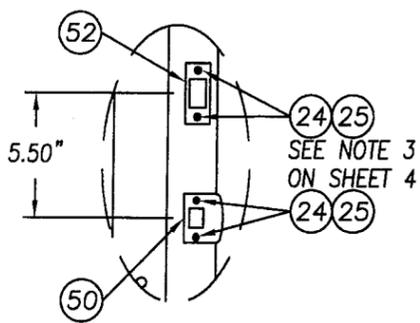

DETAIL 2
 STRIKE PLATES TO JAMB

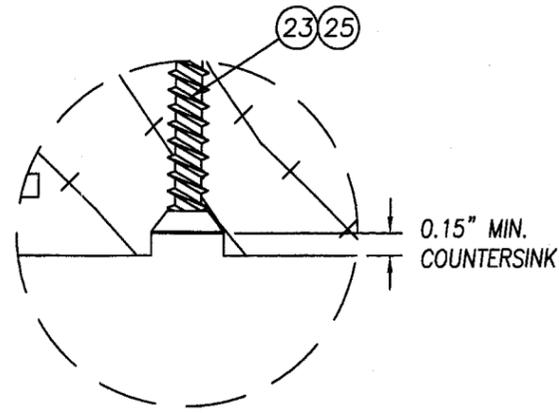

DETAIL 3
 COUNTERSINK FOR INSTALLATION
 ANCHORS

JELD-WEN, INC.
 3737 LAKEPORT BLVD.
 KLAMATH FALLS, OR. 97601
 PH. 541.882.3451

PRODUCT: STEEL EDGE OPAQUE STEEL INSWING
 IMPACT DOOR UP TO 5'-11" X 6'-8"
 W/ AND W/O NON-IMPACT SIDELITES
 PART OR ASSEMBLY:
 ANCHORING LOCATIONS
 AND DETAILS


#	DATE	REVISIONS	BY
D	08/31/07	AS REQUESTED BY MIAMI-DADE	CB
C	06/15/07	MODIFIED TO MEET THE 2004 FBC	WR
B	05/30/02	CORRECT B.O.M.	RW
A	03/13/02	GENERAL REVISION	TJH

DATE: 12-26-01
 SCALE: N.T.S.
 DWG. BY: WLN
 CHK. BY: RW
 DRAWING NO.: S-2198-05
 SHEET 5 OF 6


Eric S. Nielsen
 Eric S. Nielsen
 Florida P. E. No. 41323
 PTC, LLC
 1535 Cogswell Street, Suite C25
 Rockledge, Florida 32955
 FBPE Certificate of Authorization NO. 25935

Prepared By:
PTC
 PTC, LLC
 Phone: 321-690-1788
 Fax: 321-690-1789


PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. **07-0709.03**
 Expiration Date **08/08/2012**
 By: *[Signature]*
 Miami Dade Product Control
 Division

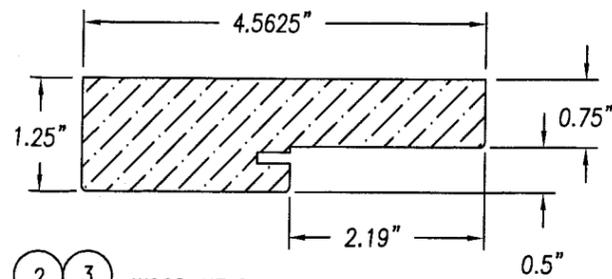


2 3
4 49
WOOD HEAD & JAMBS
FINGER JOINTED PONDEROSA PINE




11 13
DOOR TOP RAIL & SIDE STILE
22GA (0.029\") ROLL FORMED STEEL

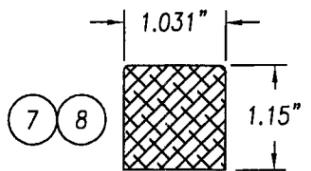


7 8
LATCH STILE REINFORCEMENTS
MDF

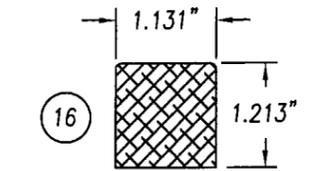


16
HINGE STILE REINFORCEMENTS
MDF

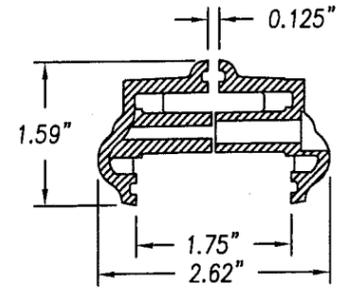


38
ODL LITE FRAME 1/8\" SG
HP POLYPROPELENE

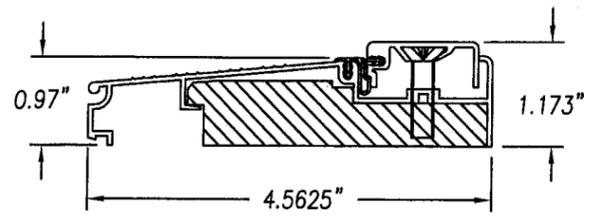


9
INSWING ADJUSTABLE THRESHOLD
0.051\" WALL ALUMINUM (IMPERIAL)




12
DOOR BOTTOM RAIL
24GA (0.021\") ROLL FORMED STEEL

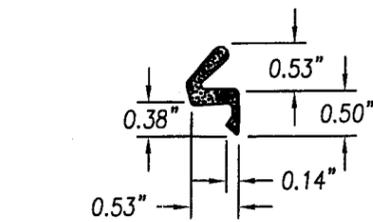


10
COMPRESSION WEATHERSRIP
SCHLEGEL Q-LON QDS 650




5
HAGER STEEL BUTT HINGE
4\" x 4\" x .097\" THK. STEEL

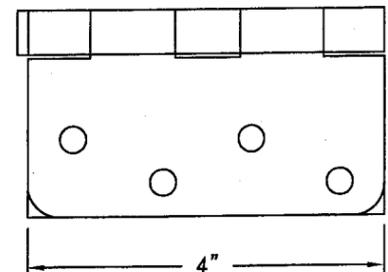


26
DOOR LATCH STRIKE PLATE

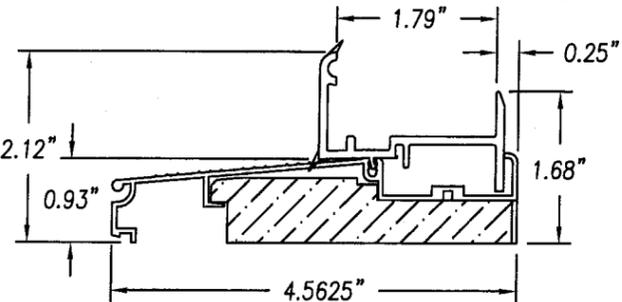


45
INSWING SIDELITE THRESHOLD
WITH SEAL BOOT (IMPERIAL)




18
DOOR BOTTOM SWEEP
EXTRUDED VINYL






31
MULLION CAP
PINE



32
3/8\" QUARTER ROUND
SIDELITE STOP
PINE

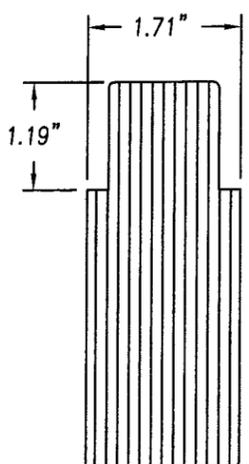

15
WOOD LOCK BLOCK
LVL

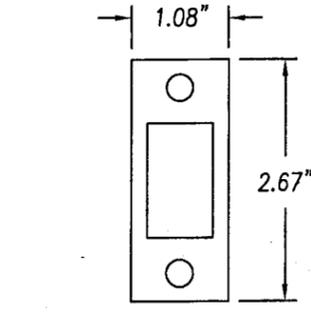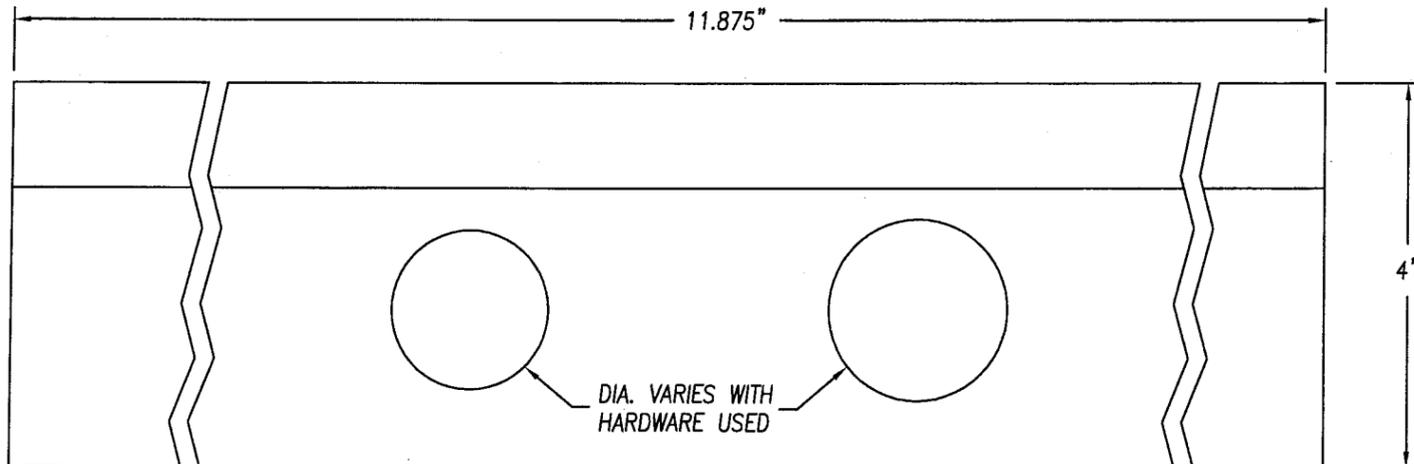

33
DOOR LATCH DEAD BOLT STRIKE PLATE

JELD-WEN, INC.
 3737 LAKEPORT BLVD.
 KLAMATH FALLS, OR. 97601
 PH. 541.862.3451

PRODUCT: STEEL EDGE OPAQUE STEEL INSWING
 IMPACT DOOR UP TO 5'-11\" x 6'-8\"
 W/ AND W/O NON-IMPACT SIDELITES
 PART OR ASSEMBLY: UNIT COMPONENTS

#	DATE	REVISIONS	TJH	RW	WR	CB	BY
A	03/13/02	GENERAL REVISION					
B	05/30/02	CORRECT B.O.M.					
C	06/15/07	MODIFIED TO MEET THE 2004 FBC					
D	08/31/07	AS REQUESTED BY MIAMI-DADE					

[Signature]
 Eric S. Nielsen
 Florida P. E. No. 41323
 PTC, LLC
 1535 Cogswell Street, Suite C25
 Rockledge, Florida 32955
 FBPE Certificate of Authorization NO. 25935

Prepared By:
PTC
 PTC, LLC
 Phone: 321-690-1788
 Fax: 321-690-1789

DATE: 12-26-01
 SCALE: N.T.S.
 DWG. BY: WLN
 CHK. BY: RW
 DRAWING NO.: S-2198-06
 SHEET 6 OF 6