



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372 -6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode.com

Palm City Millwork, Inc.
3313 S.W. 42nd Ave.
Palm City, FL 34990

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series Direct Sash Set Wood Fixed Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. 1039, titled "Direct Sash Set Mahogany Wood Windows", sheets 1 through 4 with revision A2, dated 08/14/2007, prepared by W. W. Schaefer Engineering & Consultant, P.A., signed and sealed by Warren Schaefer, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

REVISION of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA renews NOA # 02-0308.04 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P.E.**



J. Gascon
11/29/07

NOA No 07-0718.01
Expiration Date: August 1, 2012
Approval Date: December 20, 2007
Page 1

Palm City Millwork, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **1039**, titled "Direct Sash Set Mahogany Wood Windows", sheets 1 through 4 with revision A2, dated 08/14/2007, prepared by W. W. Schaefer Engineering & Consultant, P.A., signed and sealed by Warren Schaefer, P.E.

B. TESTS

1. Test reports on: 1) Cyclic Wind Pressure Loading per PA 203-94
2) Large Missile Impact Test per PA 201-94
along with marked-up drawings and installation diagram of a direct sash mahogany wood windows, prepared by Hurricane Test Laboratory, Test Report No. **HTL-0067-1119-01**, dated 11/20/2001, signed and sealed by Vinu Abraham, P.E.
(Submitted under previous NOA #02-0308.04)
2. Test reports on: 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 20294
3) Water Resistance Test, per PA 202-94
4) Large Missile Impact Test per PA 201-94
5) Cyclic Wind Pressure Loading per PA 203-94
along with marked-up drawings and installation diagram of a direct sash mahogany wood windows, prepared by Hurricane Test Laboratory, Test Report No. **HTL-0067-0301-01**, dated 2/28/2001, signed and sealed by Vinu Abraham, P.E.
(Submitted under previous NOA #02-0308.04)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004 (Supplements 2005, 2006 and 2007), prepared by W. W. Schaefer Engineering & Consulting, P.A., dated 08/14/2007, signed and sealed by Warren W. Schaefer, P.E.
Complies with ASTM E1300-98

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **03-0421.01** issued to Solutia Inc. for their "Saflex HP a polyvinyl butryal interlayer for lamination of glass" dated 05/22/2003, expiring on 04/14/2008.
2. Notice of Acceptance No. **07-0831.06** issued to Cardinal LG for their "Laminated Glass Cardinal Sea-Storm Type B" dated October 12, 2007, expiring on December 30, 2012.


Jaime D. Gascon, P.E.

Chief, Product Control Division
NOA No 07-0718.01

Expiration Date: August 1, 2012
Approval Date: December 20, 2007

Palm City Millwork, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS


1. Statement letter of conformance, no financial interest and compliance, dated 08/17/2007, signed and sealed by Warren Schaefer, P.E.

G. OTHER


1. Notice of Acceptance No. **02-0308.04**, issued to Palm City Millwork, Inc. for their Series "Direct Sash Set Wood Fixed Window", approved on 08/01/2002 and expiring on 08/01/2007.




Jaime D. Gascon, P.E.
Chief, Product Control Division
NOA No 07-0718.01
Expiration Date: August 1, 2012
Approval Date: December 20, 2007

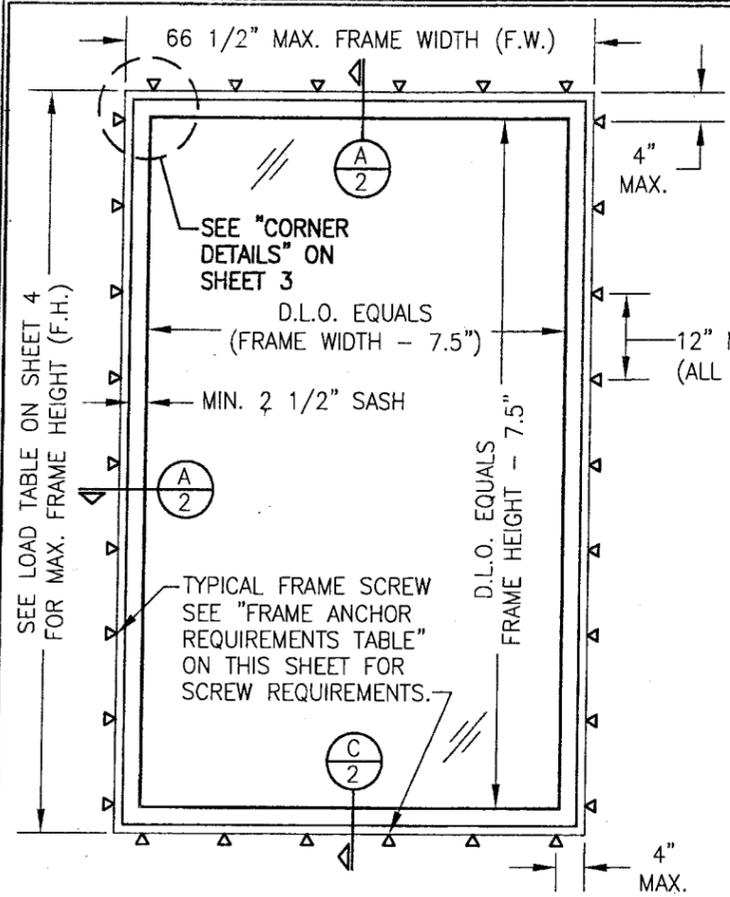

**EXTERIOR ELEVATION
SINGLE WINDOW WITH 2 1/2" SASH**
SCALE: 1/2"=1'-0"

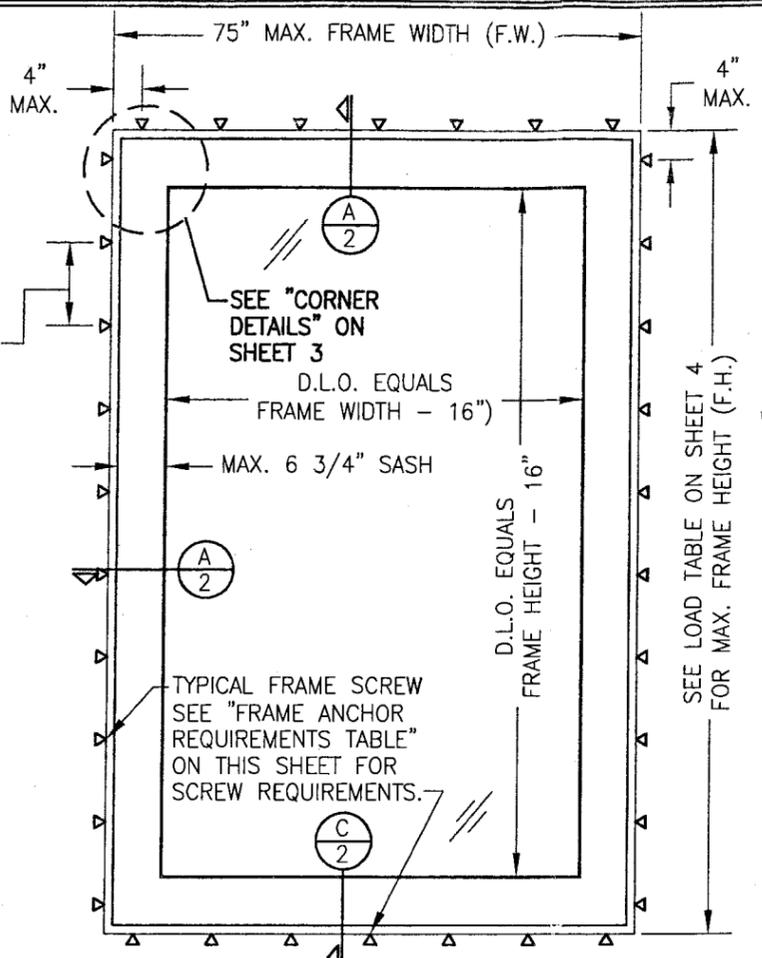

**EXTERIOR ELEVATION
SINGLE WINDOW WITH 6 3/4" SASH**
SCALE: 1/2"=1'-0"

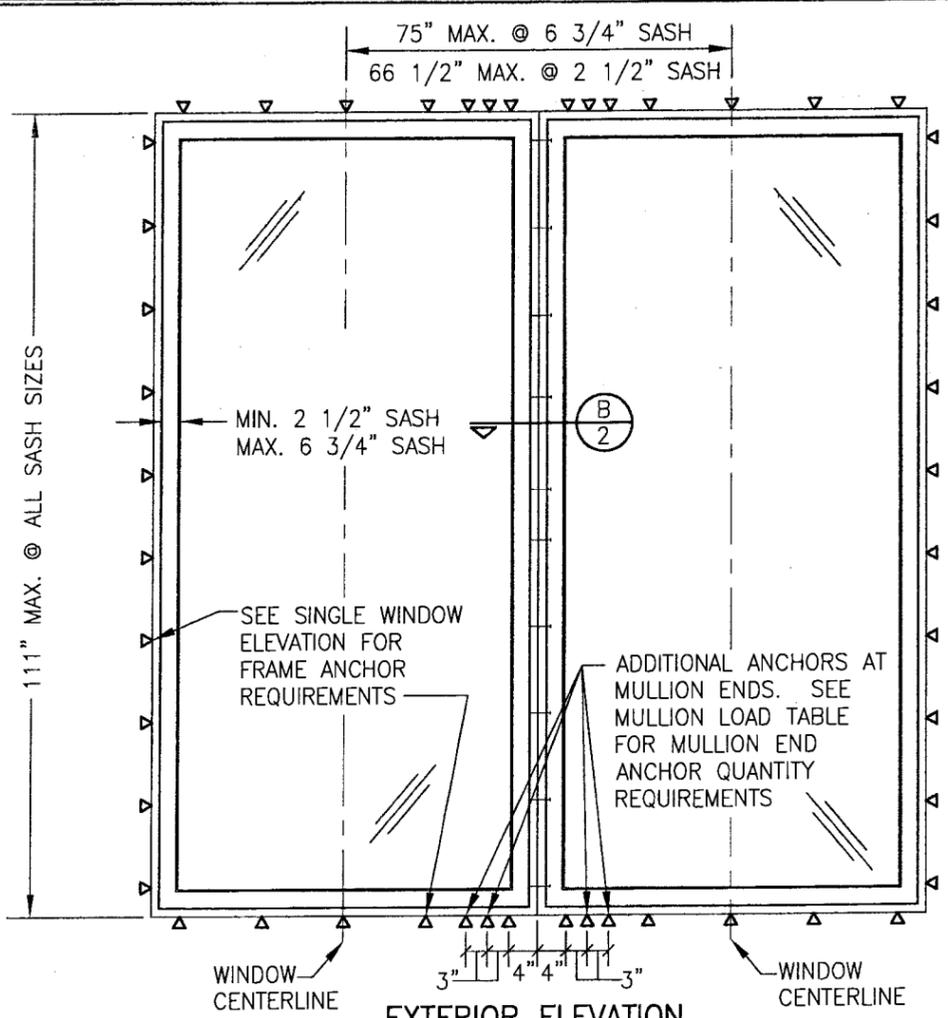


**EXTERIOR ELEVATION
MULTIPLE WINDOW UNIT
(MAX. FOUR UNITS MAY BE COMBINED)**
SEE OTHER ELEVATIONS FOR WINDOW DETAILS
SCALE: 1/2"=1'-0"

LONG DIMENSION OF WINDOWS MAY BE HORIZONTAL OR VERTICAL (HEIGHT & WIDTH MAY BE INTERCHANGED).

ALLOWABLE DESIGN LOADS
SEE DESIGN LOAD TABLES ON SHEET 4

GENERAL NOTES

1. THESE WINDOW SYSTEMS HAVE BEEN TESTED, ANALYZED AND APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN THE "ALLOWABLE DESIGN LOADS" TABLE(S).
2. BUCKING, OPENINGS & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
3. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & SHALL NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS.
4. THE DETAILS & SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS TESTED & PROPOSED FOR WATER, AIR, IMPACT, CYCLIC & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH THE 2004 FLORIDA BUILDING CODE PROTOCOLS TAS-201, 202 & 203 FOR LARGE MISSILE IMPACT WINDOWS.
5. THESE WINDOW SYSTEMS HAVE BEEN DESIGNED IN ACCORDANCE WITH THE 2004 FLORIDA BUILDING CODE (FBC) INCLUDING HIGH VELOCITY HURRICANE ZONES (HVHZ).
6. IMPACT SHUTTERS ARE NOT REQUIRED WITH THESE WINDOWS.
7. ALL ANCHORS SHALL BE INSTALLED AS SPECIFIED ON THESE DRAWINGS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
8. ALL FRAME ANCHORS SECURING WINDOW/DOOR FRAME TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
9. SASH WIDTHS MAY RANGE FROM 2 1/2" TO 6 3/4" PROVIDING MAXIMUM D.L.O.'S ARE NOT EXCEEDED.

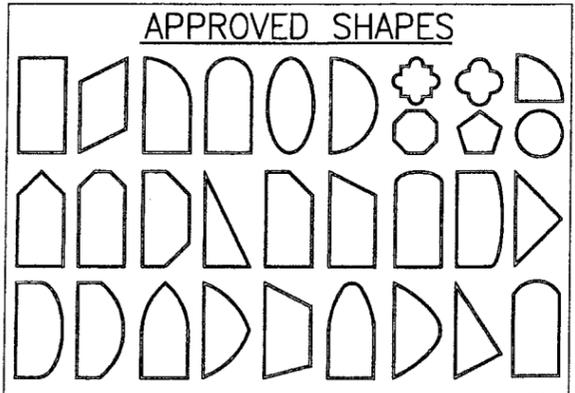

NOTES:
1. OTHER SHAPES MAY APPLY PROVIDING THEY ARE SIMILAR TO THOSE SHOWN & HAVE CORNER CONSTRUCTION PER CORNER DETAILS.
2. ALL SHAPED UNITS MUST FIT INSCRIBED INTO THE ALLOWABLE RECTANGULAR UNITS & BE GOVERNED BY THE ALLOWABLE PRESSURE OF THE RESPECTIVE RECTANGULAR UNIT.

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 07-0718-01
Expiration Date 08/16/2012
By *Warren W. Schaefer*
Miami Dade Product Control
Division

MULTIPLE UNIT NOTES:






1. ALL WINDOWS ARE RESTRICTED BY THE DIMENSIONS SHOWN.
2. THE MAXIMUM ALLOWABLE PRESSURE FOR A COMBINED UNIT IS RESTRICTED BY THE LESSER OF THE INDIVIDUAL WINDOW ALLOWABLE PRESSURE OR THE ALLOWABLE MULLION PRESSURE. SEE LOAD TABLES ON SHEET 4.

| FRAME ANCHOR REQUIREMENTS TABLE | | | |
|--|--|---------------|--------------------|
| FRAME SHEAR SCREWS | | | |
| OPENING TYPE (SUBSTRATE) | FRAME/CLIP/NAIL FIN TO OPENING FASTENER TYPE | MINIMUM EMBED | MINIMUM EDGE DIST. |
| 2X_ WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55) | NO. 10 SMS OR WOOD SCREW | 1 1/4" | 3/4" |
| MIN. 18 GA. 33 KSI METAL STUD | NO. 10 SELF TAP/DRILLING SCREW | FULL | 1/2" |
| MIN. 1/8" THK A36 STEEL | NO. 10 SELF TAP/DRILLING SCREW | FULL | 1/2" |
| MIN. 1/8" THK 6063-T5 ALUM. | NO. 10 SELF TAP/DRILLING SCREW | FULL | 1/2" |
| C-90 CMU/2500 PSI CONCRETE | (1) 1/4" CONCRETE SCREW | 1 1/4" | 2" |


(1) CONCRETE SCREWS SHALL BE ELCO OR ITW RAMSET/RED HEAD TAPCONS OR HILTI KWIK-CON II'S (HARDENED STEEL OR S.S.).

AUG 16 2007




| | | | |
|---|-----|--------------------|-------------------------------|
| DRAWN BY: W.W.S. | | CHECKED BY: W.W.S. | |
| PLOT: 1-24 | | DATE: 02/15/02 | |
| DATE | BY | NO. | REVISION DESCRIPTION |
| 08/14/07 | WWS | A1 | UPDATE TO 2004 CODE COMPLIANT |
| 08/14/07 | WWS | A2 | ADDED ALTERNATE SUBSTRATES |
| DRAWING TITLE: DIRECT SASH SET MAHOGANY WOOD WINDOWS | | | |
| MANUFACTURER: PALM CITY MILLWORK, INC. 3313 S.W. 42ND AVE. PALM CITY, FL 34990 800-273-5598 | | | |
| CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 6895 N. MILITARY TRAIL, SUITE C204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903 | | | |
| DRAWING NO. 1039 | | REV. A | |
| SHEET NO. 1 | | OF 4 | |

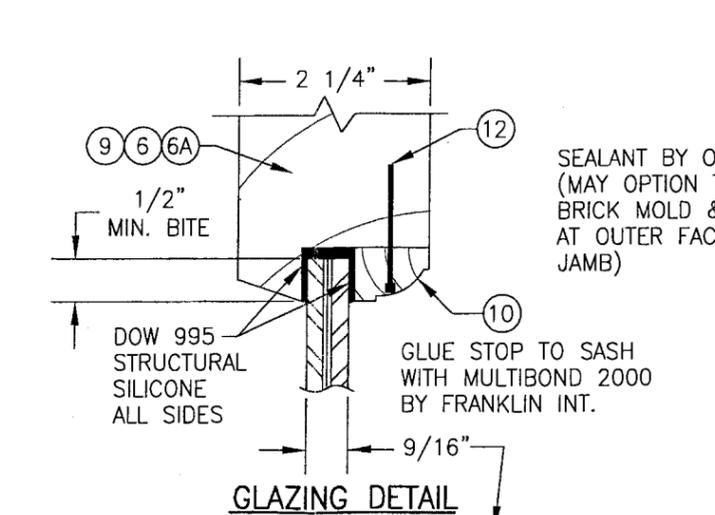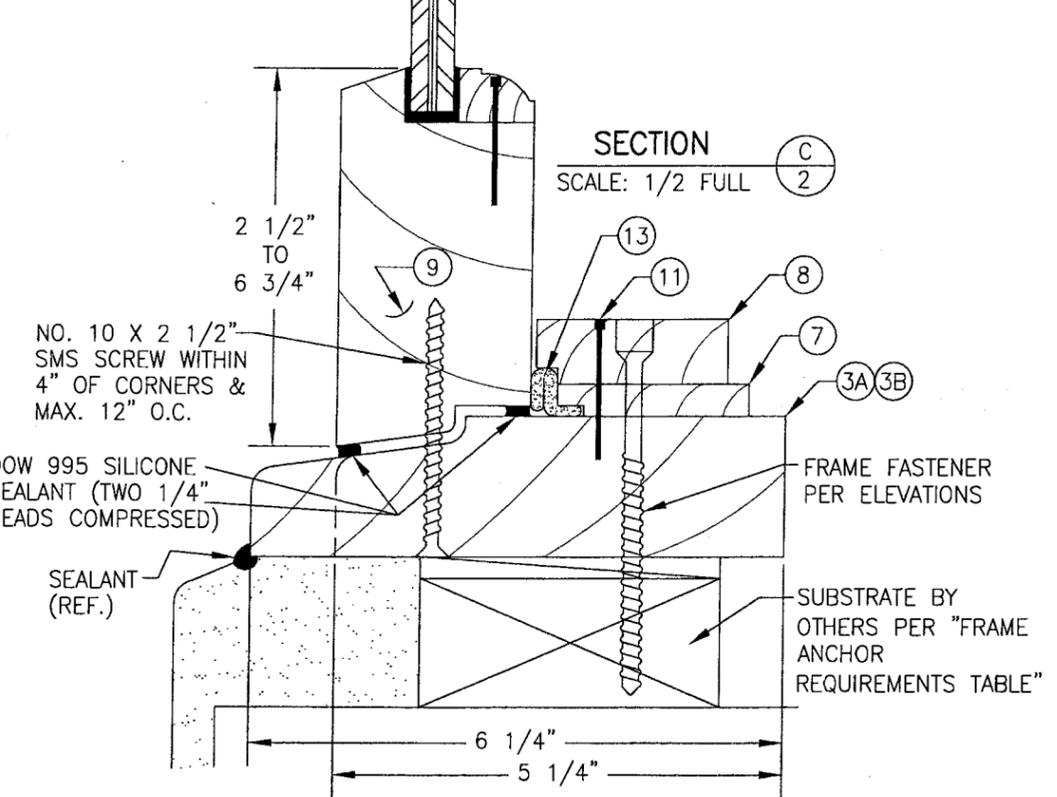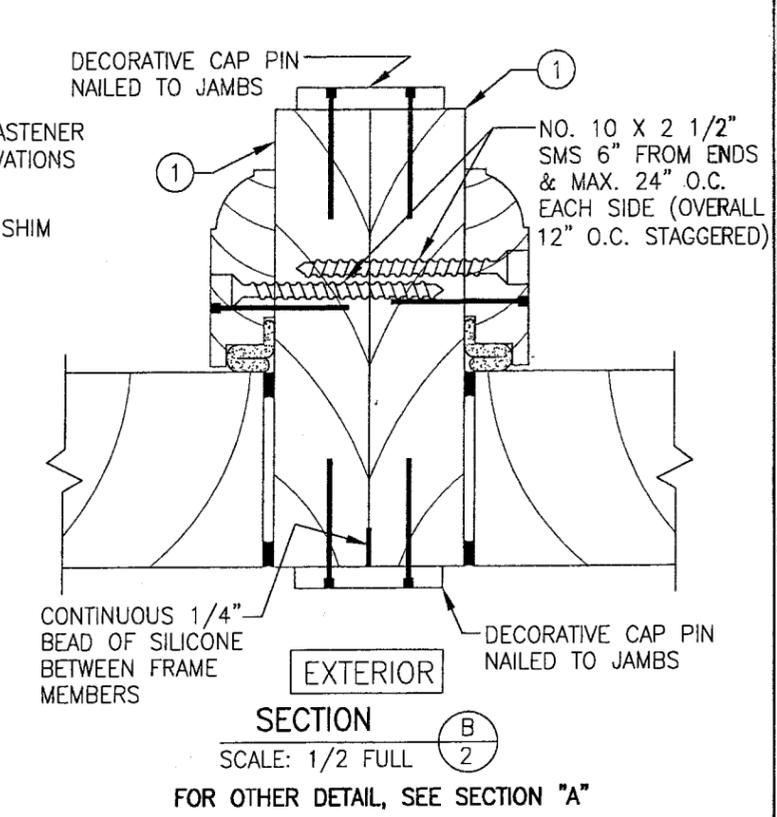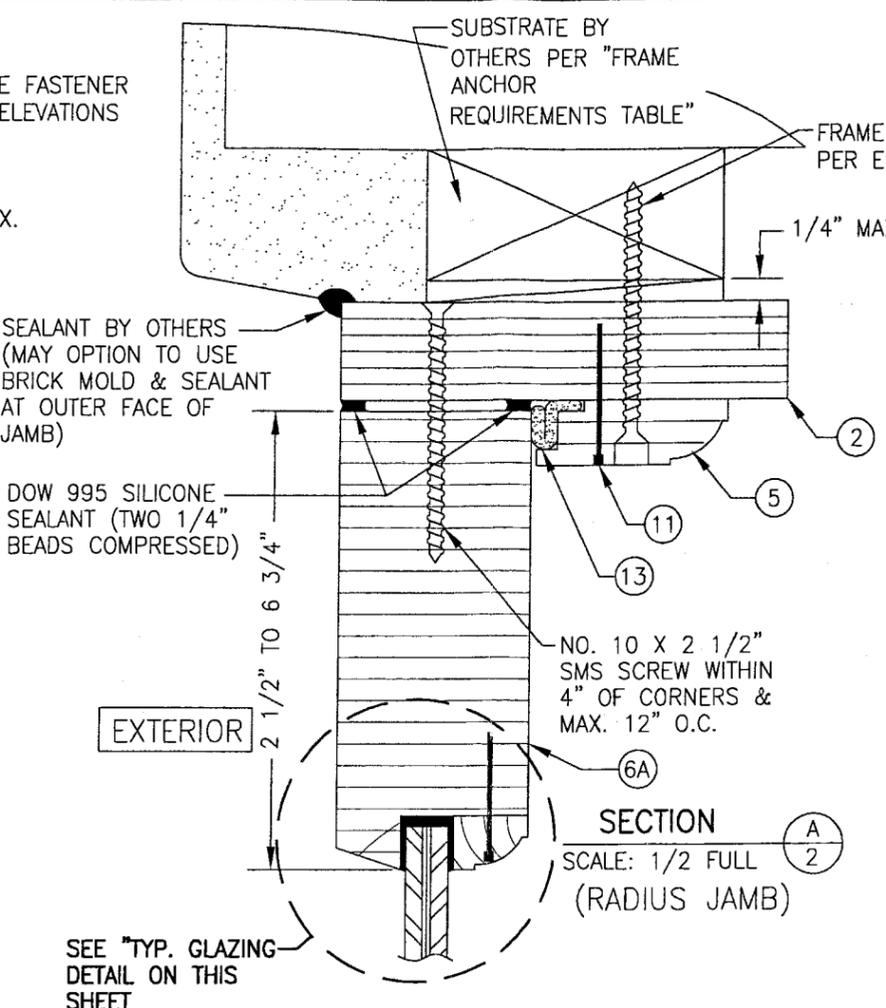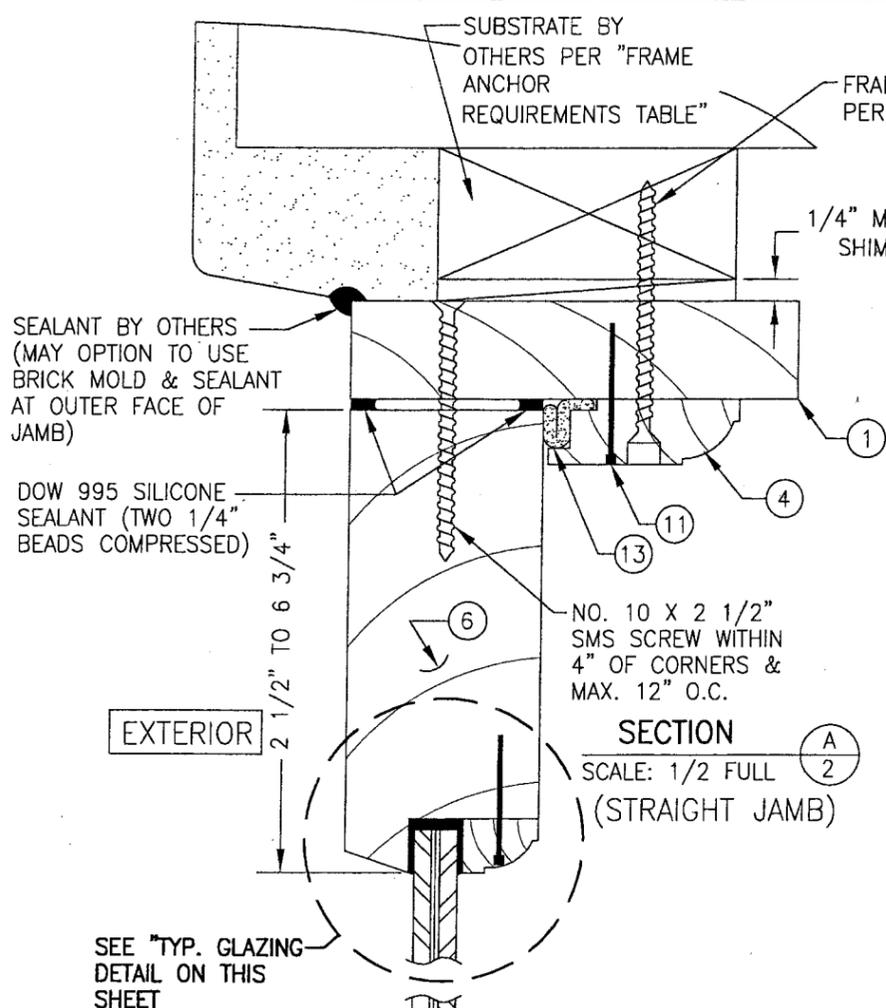

- GLASS "A": 9/16" CARDINAL SEASTORM TYPE "B" ANNEALED (1/4" AN./0.015 PVB/0.007 PET/0.075 PVB/1/4" AN.)
- GLASS "B": 9/16" CARDINAL SEASTORM TYPE "B" HEAT STRENGTHENED (1/4" HT.ST./0.015 PVB/0.007 PET/0.075 PVB/1/4" HT.ST.)
- GLASS "C": 9/16" SOLUTIA SAFLEX "HP" ANNEALED (1/4" AN/0.10 SAFLEX HP/1/4" AN)
- GLASS "D": 9/16" SOLUTIA SAFLEX "HP" HEAT STRENGTHENED (1/4" HT.ST./0.10 SAFLEX HP/1/4" HT.ST.)

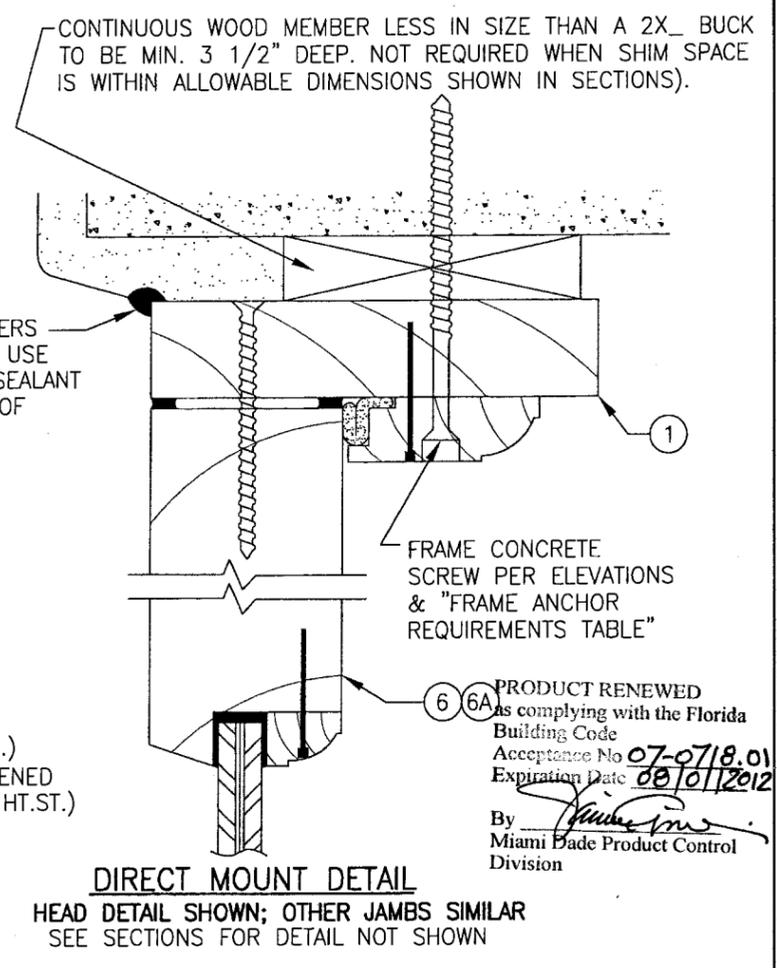

| | |
|---|-----------------------|
| DRAWN BY: W.W.S. | CHECKED BY: W.W.S. |
| PLOT: 1-2 | DATE: 02/15/02 |
| DATE | BY |
| REVISION DESCRIPTION | NO. |
| DRAWING TITLE DIRECT SASH SET MAHOGANY WOOD WINDOWS | |
| MANUFACTURER PALM CITY MILLWORK, INC. | |
| CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. | |
| PHONE: 561-775-4902 FAX: 561-773-4903 | |
| CERTIFICATION AUG 14 2007 | |
| DRAWING NO. 1039 | |
| REV. A | |
| SHEET NO. 2 OF 4 | |

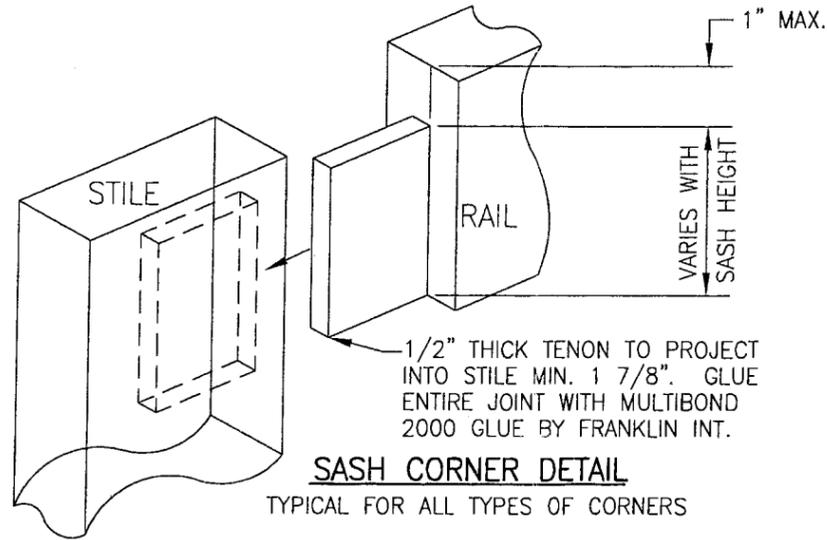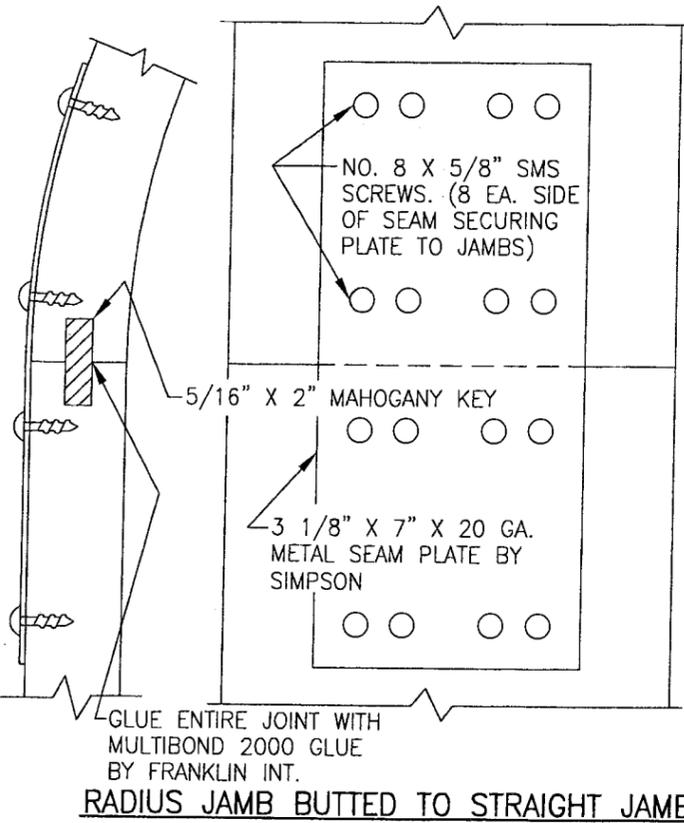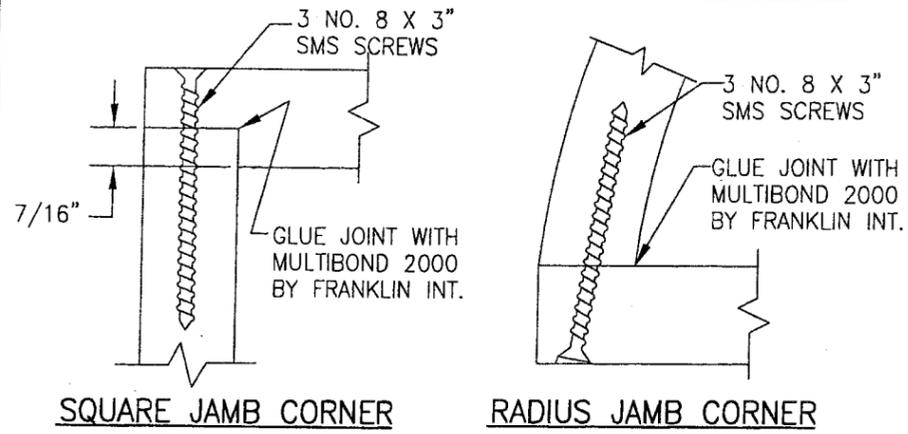

MATERIAL LIST

| NO. | DESCRIPTION | NOTES |
|-----|-----------------------------------|--------------------------------|
| 1 | 1.125" X 5.25" JAMB | MAHOGANY WOOD |
| 2 | 1.125" X 5.25" RADIAL JAMB | LAMINATED MAHOGANY |
| 3A | 2.25" X 5.1/4" SILL | MAHOGANY WOOD |
| 3B | 2.25" X 6.25" ALTERNATE SILL | MAHOGANY WOOD |
| 4 | 0.75" X 2.25" SASH STOP | MAHOGANY WOOD |
| 5 | 0.75" X 2.25" RADIAL SASH STOP | LAMINATED MAHOGANY |
| 6 | 2.25" X 2.5" TO 6.75" SASH | MAHOGANY WOOD |
| 6A | 2.25" X 2.5" TO 6.75" RADIAL SASH | LAMINATED MAHOGANY |
| 7 | 0.375" X 2.25" SILL STOP | MAHOGANY WOOD |
| 8 | 0.75" X 2.25" SILL STOP | MAHOGANY WOOD |
| 9 | 2.25" X 2.5" TO 6.75" SILL SASH | MAHOGANY WOOD |
| 10 | 0.625" X 0.75" GLAZING STOP | MAHOGANY WOOD |
| 11 | 1 1/2" LONG SASH STOP PIN NAIL | 3" FROM CORNERS & MAX. 6" O.C. |
| 12 | 1" LONG GLAZING STOP PIN NAIL | 2" FROM CORNERS & MAX. 5" O.C. |
| 13 | WEATHER SEAL | Q-LON 928 |

* WOOD USED WITH TEST UNITS WAS SELECT MAHOGANY. ALTERNATE WOOD SPECIES TO BE APPLICABLE WITH THESE WINDOWS IS SELECT RED OAK, REDWOOD, FIR, RED MAPLE, HICKORY, DOUGLAS FIR, CHERRY OR BIRCH.

DRAWN BY: W.W.S. CHECKED BY: W.W.S.
 PLOT: 1=2 DATE: 02/15/02

| NO. | REVISION DESCRIPTION | BY | DATE |
|-----|----------------------|----|------|
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |

DIRECT SASH SET MAHOGANY WOOD WINDOWS

MANUFACTURER
PALM CITY MILLWORK, INC.
 3313 S.W. 42ND AVE.
 PALM CITY, FL 34990
 800-273-5598

CONSULTANTS
W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.
 8895 N. MILITARY TRAIL, SUITE C204
 PALM BEACH GARDENS, FL 33410
 PHONE: 561-775-4902 FAX: 561-775-4903

CERTIFICATION
 AUG 14 2007
 WARREN W. SCHAEFER, P.E.
 P.E. NO. 44135

DRAWING NO. 1039 REV. A
 SHEET NO. 3 OF 4

PRODUCT RENEWED as complying with the Florida Building Code
 Acceptance No 07-0718.01
 Expiration Date 08/01/2012


By *[Signature]*
 Miami Dade Product Control Division

**ALLOWABLE DESIGN PRESSURE TABLE
FOR MULLED DIRECT SASH SET UNITS**

| MAXIMUM EFFECTIVE LOAD WIDTH (IN.) | MAXIMUM MULLION LENGTH (IN.) | ALLOWABLE PRESSURE (PSF.) | | MAXIMUM EFFECTIVE LOAD WIDTH (IN.) | MAXIMUM MULLION LENGTH (IN.) | ALLOWABLE PRESSURE (PSF.) | | | |
|------------------------------------|------------------------------|---------------------------|-----------|------------------------------------|------------------------------|---------------------------|-----------|------|------|
| | | 4 ANCHORS | 6 ANCHORS | | | 4 ANCHORS | 6 ANCHORS | | |
| | | 30 | 111 | | | 80.0 | 80.0 | 66 | 78 |
| 36 | 102 | 80.0 | 80.0 | 84 | 74.6 | 80.0 | | | |
| | 108 | 77.5 | 80.0 | 90 | 66.7 | 75.4 | | | |
| | 111 | 75.0 | 80.0 | 96 | 60.4 | 67.0 | | | |
| 42 | 90 | 80.0 | 80.0 | 102 | 55.1 | 58.1 | | | |
| | 96 | 79.7 | 80.0 | 108 | 50.7 | 50.9 | | | |
| | 102 | 73.8 | 80.0 | 111 | 47.8 | 47.8 | | | |
| | 108 | 68.7 | 74.1 | 72 | 78 | 80.0 | 80.0 | | |
| 48 | 84 | 80.0 | 80.0 | | 84 | 72.6 | 80.0 | | |
| | 90 | 79.2 | 80.0 | | 90 | 64.5 | 72.9 | | |
| | 96 | 72.6 | 80.0 | | 96 | 58.1 | 63.7 | | |
| | 102 | 67.0 | 74.6 | | 102 | 52.8 | 55.0 | | |
| 54 | 108 | 62.2 | 66.0 | | 108 | 48.0 | 48.0 | | |
| | 111 | 60.1 | 62.2 | | 111 | 45.0 | 45.0 | | |
| | 60 | 84 | 80.0 | | 80.0 | 75 | 78 | 80.0 | 80.0 |
| | | 90 | 73.8 | | 80.0 | | 84 | 72.0 | 80.0 |
| | | 96 | 67.4 | | 76.1 | | 90 | 63.7 | 72.0 |
| 102 | | 62.0 | 67.6 | | 96 | | 57.2 | 62.2 | |
| 108 | | 57.4 | 59.7 | | 102 | | 51.9 | 53.7 | |
| 111 | 55.3 | 56.3 | 108 | 46.8 | 46.8 | | | | |
| 60 | 78 | 80.0 | 80.0 | 111 | 43.9 | | 43.9 | | |
| | 84 | 77.5 | 80.0 | | | | | | |
| | 90 | 69.7 | 78.8 | | | | | | |
| | 96 | 63.4 | 71.3 | | | | | | |
| | 102 | 58.1 | 62.2 | | | | | | |
| 108 | 53.6 | 54.7 | | | | | | | |
| 111 | 51.6 | 51.6 | | | | | | | |

NOTES:

1. ALLOWABLE PRESSURE ON MULTIPLE UNITS IS CONTROLLED BY THE LESSER PRESSURE OF EITHER THIS TABLE OR THE WINDOW TABLE.
2. ALL PRESSURES IN THIS TABLE ARE FOR BOTH POS. & NEG.
3. SEE MULTIPLE WINDOW ELEVATION BELOW FOR DETERMINATION OF "EFFECTIVE LOAD WIDTH".
4. MULLION MAY BE HORIZONTAL OR VERTICAL.

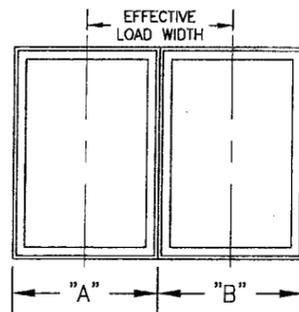

$$\text{LOAD WIDTH} = \frac{(A + B)}{2}$$

**ALLOWABLE WINDOW SIZE & DESIGN PRESSURE TABLE
(SINGLE WINDOWS)**

| MAXIMUM D.L.O. | | MAXIMUM FRAME SIZE | | | | ALLOWABLE PRESSURE | |
|----------------|----|--------------------|-------------|--------------|-------------|--|---|
| | | 2 1/2" SASH | | 6 3/4" SASH | | GLASS "A" & "C" 9/16" LAMINATED ANNEALED (PSF) | GLASS "B" & "D" 9/16" LAMINATED HEAT STRENGTHENED (PSF) |
| | | HEIGHT (IN.) | WIDTH (IN.) | HEIGHT (IN.) | WIDTH (IN.) | | |
| 65 | 59 | — | 66.5 | — | 75.0 | 80.0 | 80.0 |
| 71 | 53 | 78.5 | 60.5 | 87.0 | 69.0 | 80.0 | 80.0 |
| | 59 | | 66.5 | | 75.0 | 79.1 | 80.0 |
| 83 | 47 | 90.5 | 54.5 | 99.0 | 63.0 | 80.0 | 80.0 |
| | 53 | | 60.5 | | 69.0 | 74.6 | 80.0 |
| | 59 | | 66.5 | | 75.0 | 69.3 | 80.0 |
| 95 | 41 | 102.5 | 48.5 | 111.0 | 57.0 | 80.0 | 80.0 |
| | 47 | | 54.5 | | 63.0 | 73.2 | 80.0 |
| | 53 | | 60.5 | | 69.0 | 66.1 | 80.0 |
| | 59 | | 66.5 | | 75.0 | 60.8 | 80.0 |
| 107 | 35 | 114.5 | 42.5 | 123.0 | 51.0 | 80.0 | 80.0 |
| | 41 | | 48.5 | | 57.0 | 75.9 | 80.0 |
| | 47 | | 54.5 | | 63.0 | 65.0 | 80.0 |
| 119 | 35 | 126.5 | 42.5 | 135.0 | 51.0 | 80.0 | 80.0 |
| | 41 | | 48.5 | | 57.0 | 71.4 | 80.0 |
| | 47 | | 54.5 | | 63.0 | 59.8 | 80.0 |
| 131 | 35 | 138.5 | 42.5 | 147.0 | 51.0 | 80.0 | 80.0 |
| | 41 | | 48.5 | | 57.0 | 68.5 | 80.0 |
| 143 | 35 | 150.5 | 42.5 | 159.0 | 51.0 | 80.0 | 80.0 |

NOTES:

1. ACTUAL FRAME SIZES = (D.L.O. + 7.5") AT 2.5" SASH UNITS & (D.L.O. + 16") AT 6.75" SASH UNITS.
2. ALL PRESSURES IN TABLE ARE FOR POSITIVE & NEGATIVE DIRECTIONS.
3. HEIGHT & WIDTH MAY BE INTERCHANGED SUCH THAT LONG DIMENSION IS HORIZONTAL OR VERTICAL.

| | |
|--|-----------------------|
| DRAWN BY: W.W.S. | CHECKED BY: W.W.S. |
| PLOT: 1=2 | DATE: 02/15/02 |
| DATE | |
| BY | |
| REVISION DESCRIPTION | |
| NO. | |
| DRAWING TITLE: DIRECT SASH SET MAHOGANY WOOD WINDOWS MANUFACTURER: PALM CITY MILLWORK, INC. 3313 S.W. 42ND AVE. PALM CITY, FL 34990 800-273-5598 | |
| CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. 8895 N. MILITARY TRAIL, SUITE C204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903 | |
| CERTIFICATION: AUG 14 2007 WARREN W. SCHAEFER, P.E. P.E. NO. 44135 | |
| DRAWING NO. | REV. |
| 1039 | A |
| SHEET NO. | |
| 4 | OF 4 |

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No 07-0718.01
 Expiration Date 08/01/2012
 By *[Signature]*
 Miami Dade Product Control
 Division