



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode.com

Palm City Millwork, Inc.
3313 S.W. 42nd Ave.
Palm City, FL 34990

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series PCM-DP80/98C Wood Casement Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **PCM-DP80/98C**, titled "Casement Windows", sheets 1 through 8 of 8, dated 12/15/1998, with revision A dated 08/13/2007, prepared by W.W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

REVISION of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA # 02-1021.01** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P.E.**



Jaime D. Gascon
11/24/07

NOA No 07-0718.03
Expiration Date: November 25, 2012
Approval Date: December 20, 2007
Page 1

Palm City Millwork, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS


1. Manufacturer's die drawings and sections.
2. Drawing No. **PCM-DP80/98C**, titled "Casement Windows", Sheets 1 through 8 of 8, dated 12/15/1998, with revision A dated 08/13/2007, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.

B. TESTS

1. Test reports on: 1) Large Missile Impact Test per TAS 201-94
2) Cyclic Wind Pressure Loading per TAS 203-94
along with installation diagram of a fixed/operable (OX) outswing wood casement window, prepared by Hurricane Test Laboratory, Inc., Test report No. **HTL-0067-0901-98**, dated 08/31/1999, signed and sealed by Timothy S. Marshall, P.E.
(Submitted under previous NOA #02-1021.01)
2. Test reports on: 1) Air Infiltration Test, per TAS 202-94
2) Uniform Static Air Pressure Test, Loading per TAS 202-94.
3) Water Resistance Test, per TAS 202-94.
4) Large Missile Impact Test per TAS 201-94
5) Cyclic Wind Pressure Loading per TAS 203-94
along with installation diagram of an operable outswing wood casement window prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0067-0419-99**, dated 04/19/1999, signed and sealed by Vinu J. Abraham, P.E.
(Submitted under previous NOA #02-1021.01)
3. Test reports on: 1) Air Infiltration Test, per TAS 202-94
2) Uniform Static Air Pressure Test, Loading per TAS 202-94.
3) Water Resistance Test, per TAS 202-94.
4) Forced Entry Test, per TAS 202-94
along with installation diagram of a fixed/operable (OXX) outswing wood casement window, prepared by Hurricane Test Laboratory, Inc., Test report No. **HTL-0067-0601-97**, dated 06/02/1997, signed and sealed by Vinu J. Abraham, P.E.
(Submitted under previous NOA #02-1021.01)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by W. W. Schaefer Engineering & Consulting, P.A., dated 08/13/2007, signed and sealed by Warren W. Schaefer, P.E.
Complies with ASTM E1300-02



Jaime D. Gascon, P.E.
Chief, Product Control Division
NOA No 07-0718.03
Expiration Date: November 25, 2012
Approval Date: December 20, 2007

Palm City Millwork, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **03-0827.08** issued to Solutia, Inc. for "Solutia Interlayers" dated 03/04/2004, expiring on 03/04/2009.
2. Notice of Acceptance No. **06-1116.07**, issued to Global Security Glazing for their "**Chem.-Temp**® Chemically Strengthened Glass", approved on 02/01/2007 and expiring on 07/18/2012.

F. STATEMENTS

1. Statement letter of conformance, no financial interest and compliance dated 08/17/2007, signed and sealed by Warren Schaefer, P.E.

G. OTHER

1. Notice of Acceptance No. **02-1021.01**, issued to Palm City Millwork, Inc. for their Series PCM-DP80/98C Wood Casement Window, approved on 11/21/2002 and expiring on 11/25/2007.



Jaime D. Gascon, P.E.

Chief, Product Control Division

NOA No 07-0718.03


Expiration Date: November 25, 2012

Approval Date: December 20, 2007

ALLOWABLE DESIGN PRESSURE

**POSITIVE
70 PSF**


**NEGATIVE
80 PSF**

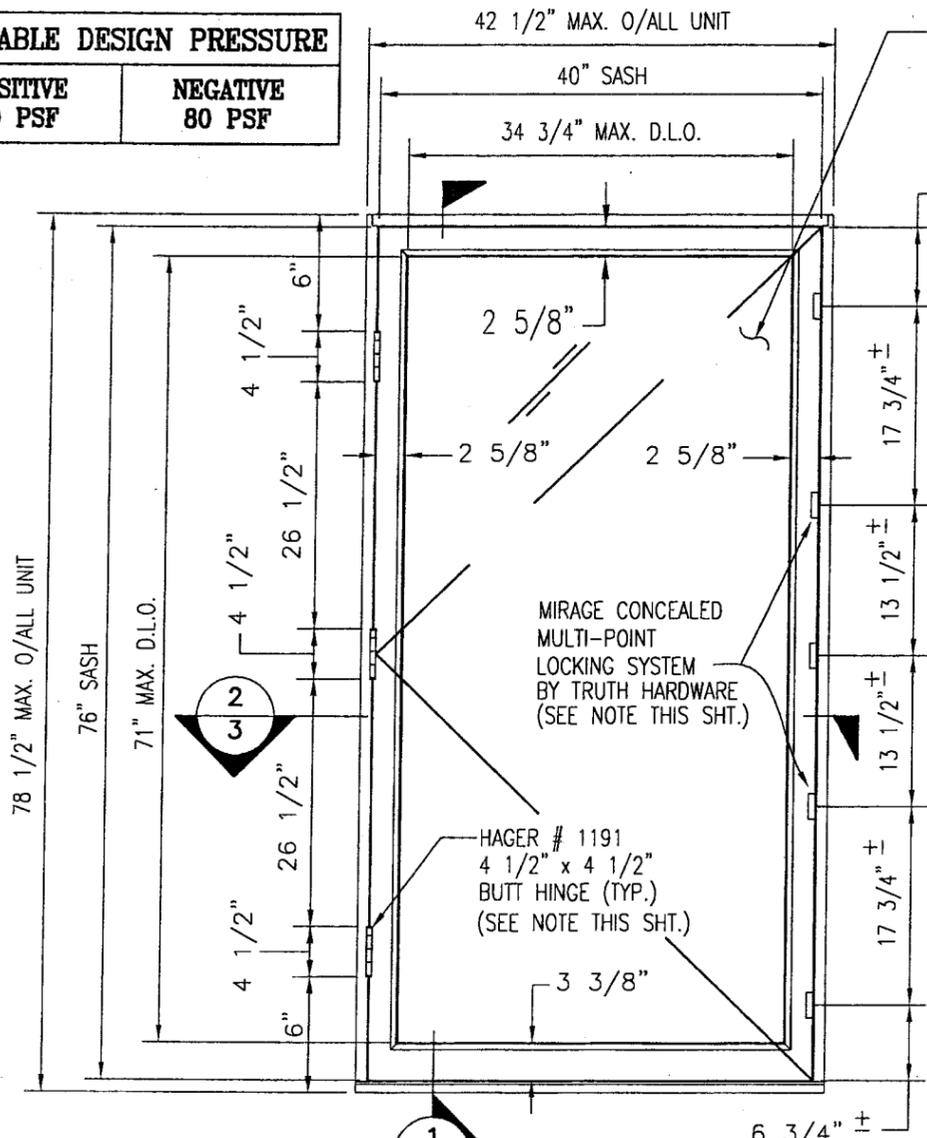

**ELEVATION @ OUTSWING
CASEMENT WINDOW
WITH BUTT HINGES**

SCALE: 3/4"=1'-0"

NOTE: UNIT SHOWN FROM EXTERIOR

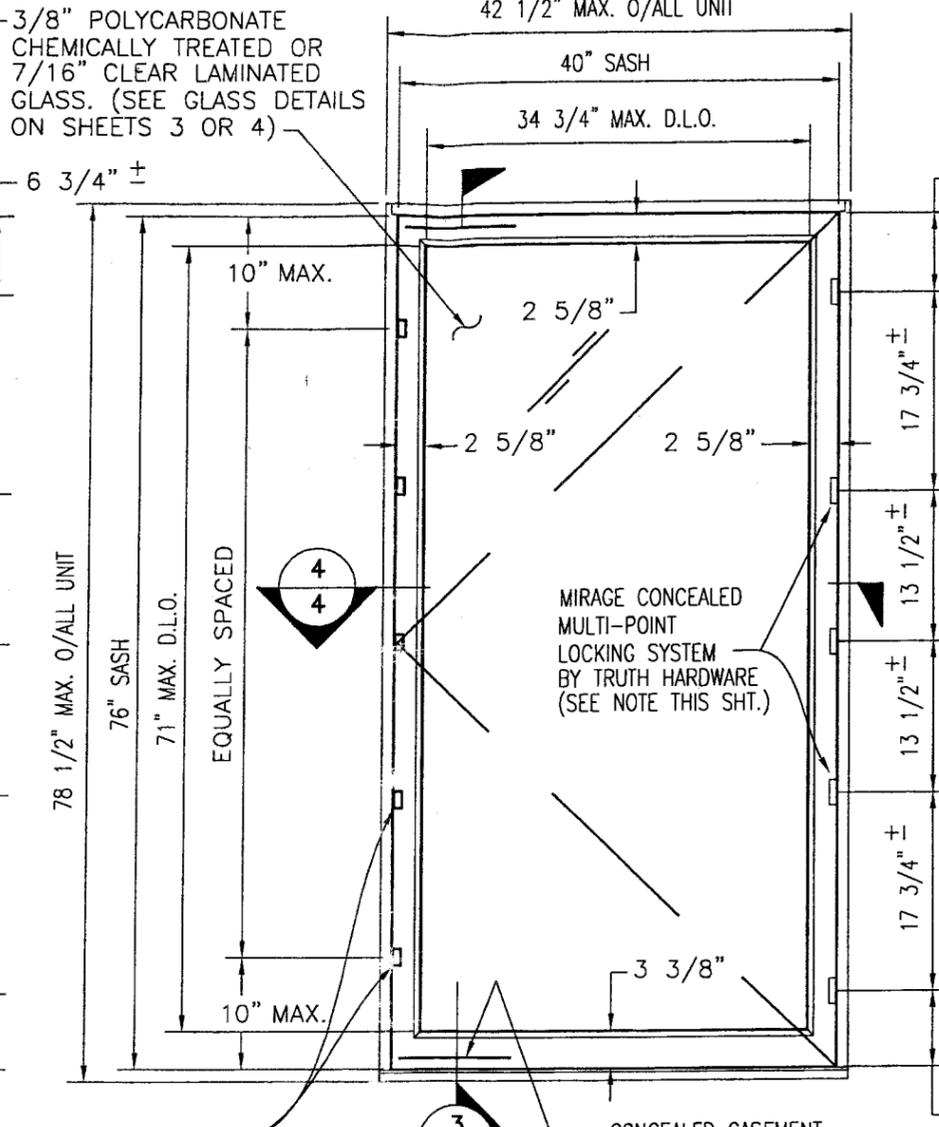


**ELEVATION @ OUTSWING
CASEMENT WINDOW
WITH SCISSOR HINGES**

SCALE: 3/4"=1'-0"

PCM 225 CONCEALED BRASS SNUBBER BY PALM CITY MILLWORK. (NUMBER OF SNUBBERS TO BE SAME AS MULTIPOINT LATCHES) (SEE NOTE THIS SHT.)

CONCEALED CASEMENT SCISSOR HINGE HAGER NO. 14-80 (TYP. TOP & BOTTOM OF WINDOW)

PRODUCT RENEWED as complying with the Florida Building Code Acceptance No. 07-0718-03 Expiration Date 11/25/2012 By [Signature] Miami Dade Product Control Division

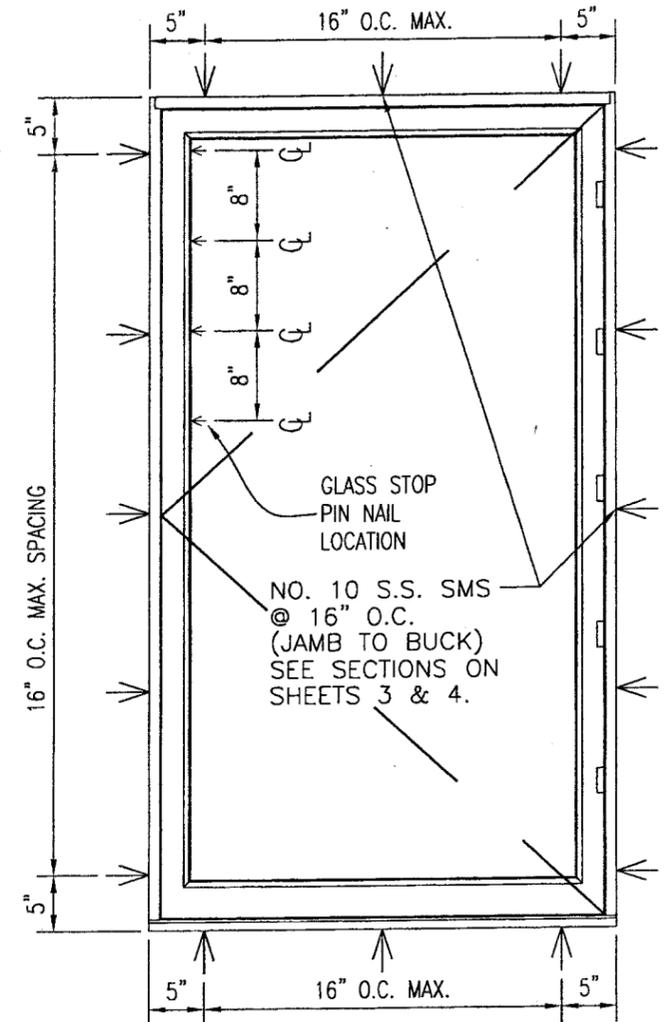

**INSTALLATION ELEVATION
SHOWING FASTENER LOCATIONS**
SCALE: 3/4"=1'-0"

NOTE: THE NUMBER OF LOCKING POINTS & SNUBBERS MAY BE REDUCED PROPORTIONAL TO REDUCTION IN WINDOW SIZE & AREA. SEE LOCK/HINGE/SNUBBER QUANTITY TABLE ON SHEET 8.

**** GENERAL NOTES ****

- THIS CASEMENT WINDOW SYSTEM HAS BEEN TESTED, ANALYZED AND APPROVED FOR DESIGN PRESSURES NOT TO EXCEED +70/-80 PSF.
- BUCKING, OPENINGS & BUCKING FASTENERS MUST BE DESIGNED & INSTALLED TO WITHSTAND WIND LOADS AS DETERMINED FOR EACH APPLICATION (NEVER TO EXCEED +70/-80 PSF)
- THIS PRODUCT HAS BEEN DESIGNED IN ACCORDANCE WITH THE 2004 FLORIDA BUILDING CODE (FBC) INCLUDING HIGH VELOCITY HURRICANE ZONES.
- ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & MAY NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS.
- THE DETAILS & SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS PROPOSED FOR WATER, AIR, IMPACT, CYCLIC & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH FLORIDA BUILDING CODE PROTOCOLS TAS 201, 202, & 203.
- ALL JAMB TO BUCKING FASTENERS MUST PENETRATE THE BUCK A MINIMUM OF 1 1/4", IF PENETRATION IS LESS THEN 1 1/4" SCREW LENGTH SHALL INCREASE AS REQUIRED.

AUG 13 2007

WARREN W. SCHAEFER, P.E.
STRUCTURAL ENGINEER
P.E. No. 44135

W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.
STRUCTURAL CONSULTING ENGINEERS
8895 N. MILITARY TRAIL, SUITE C204 PHONE: (561)775-4902
PALM BEACH GARDENS, FL 33410 FAX: (561)775-4903

REVISION	REVISION DESCRIPTION	W.W.S. BY	DATE
A	UPDATE GENERAL NOTES TO 2004 CODE COMPLIANCE		08/13/07

PALM CITY MILLWORK, INC.

3313 SW 42ND AVE P.O. BOX 1661
PALM CITY, FL 34990
(561) 288-7086 FAX (561) 288-7440

MODEL NAME: PCM-DP80/98C	DESCRIPTION: CASEMENT WINDOWS	SHEET No. 1
DATE: 12/15/98	REVISIONS: A	DADE
SCALE: AS NOTED		OF 8


ALLOWABLE DESIGN PRESSURE

POSITIVE 60 PSF	NEGATIVE 60 PSF
----------------------------	----------------------------

TYP. FOR MULTIPLE UNITS ONLY. SEE SHEET 1 FOR SINGLE UNIT PRESSURES.


NOTE:
THE NUMBER OF LOCKING POINTS & SNUBBERS MAY BE REDUCED PROPORTIONAL TO REDUCTION IN WINDOW SIZE & AREA. SEE LOCK/HINGE/SNUBBER QUANTITY TABLE ON SHEET 8.

NO. 10 x 3" S.S. SMS @ 16" O.C. & 4" FROM ENDS STAGGERED WITH SCREWS @ CASEMENT JAMB FOR OVERALL SPACING = 8" O.C. COUNTER SINK 1/8" & FINISH.

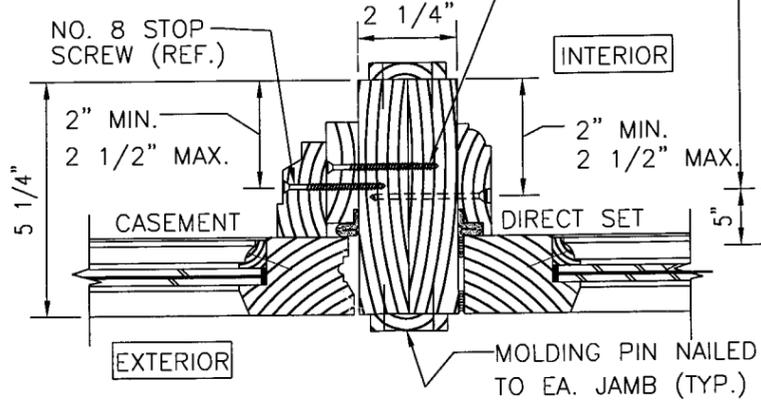

MULLION SECTION NO. 5


SCALE: 3"=1'-0"
(SIMILAR FOR CASEMENT TO CASEMENT MULLION)

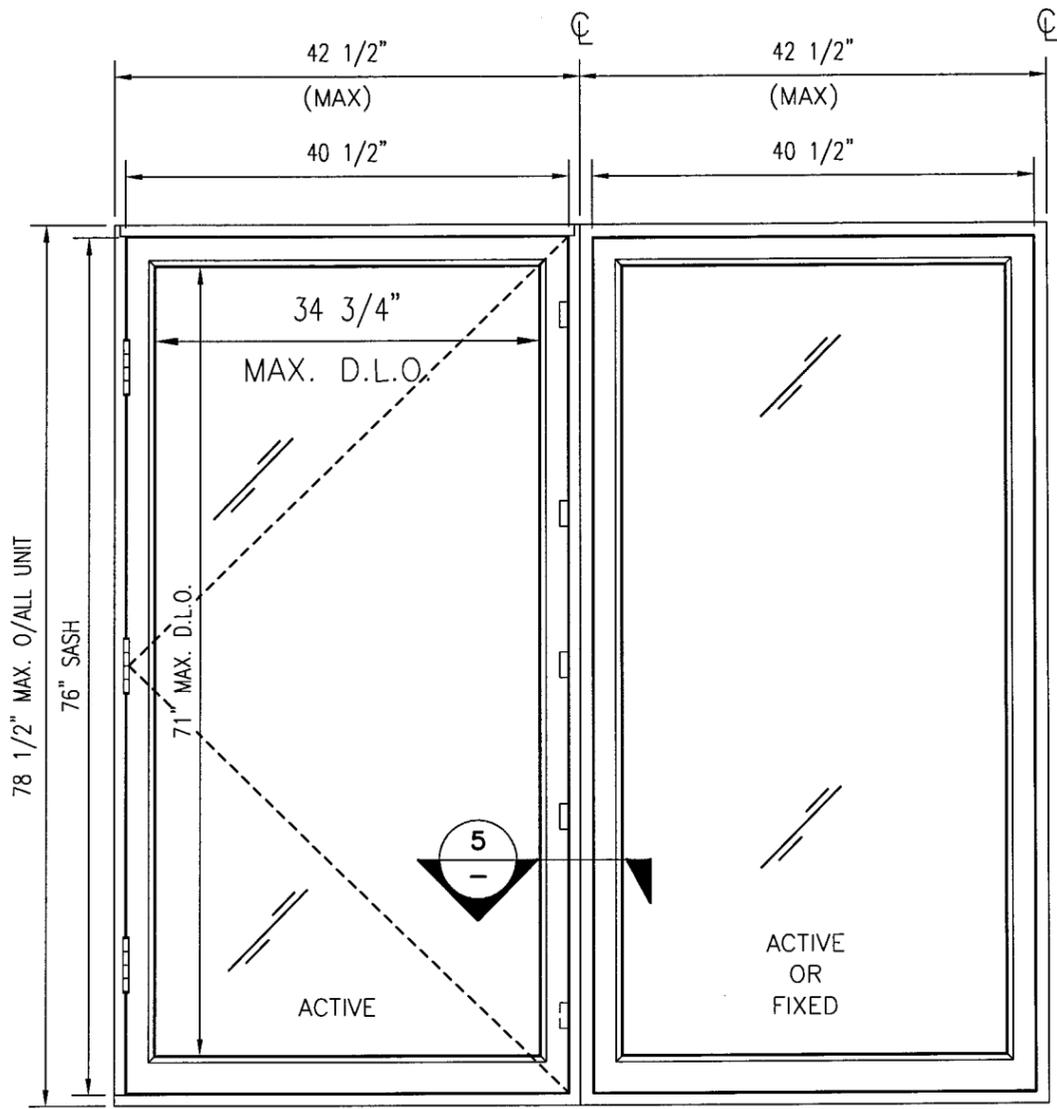

TYP. MULTIPLE WINDOW UNIT

SCALE: 3/4"=1'-0"
(SEE SINGLE UNITS ON SHEET 1 FOR ALL WINDOW INFORMATION NOT SHOWN)

NOTE: UNIT SHOWN FROM EXTERIOR

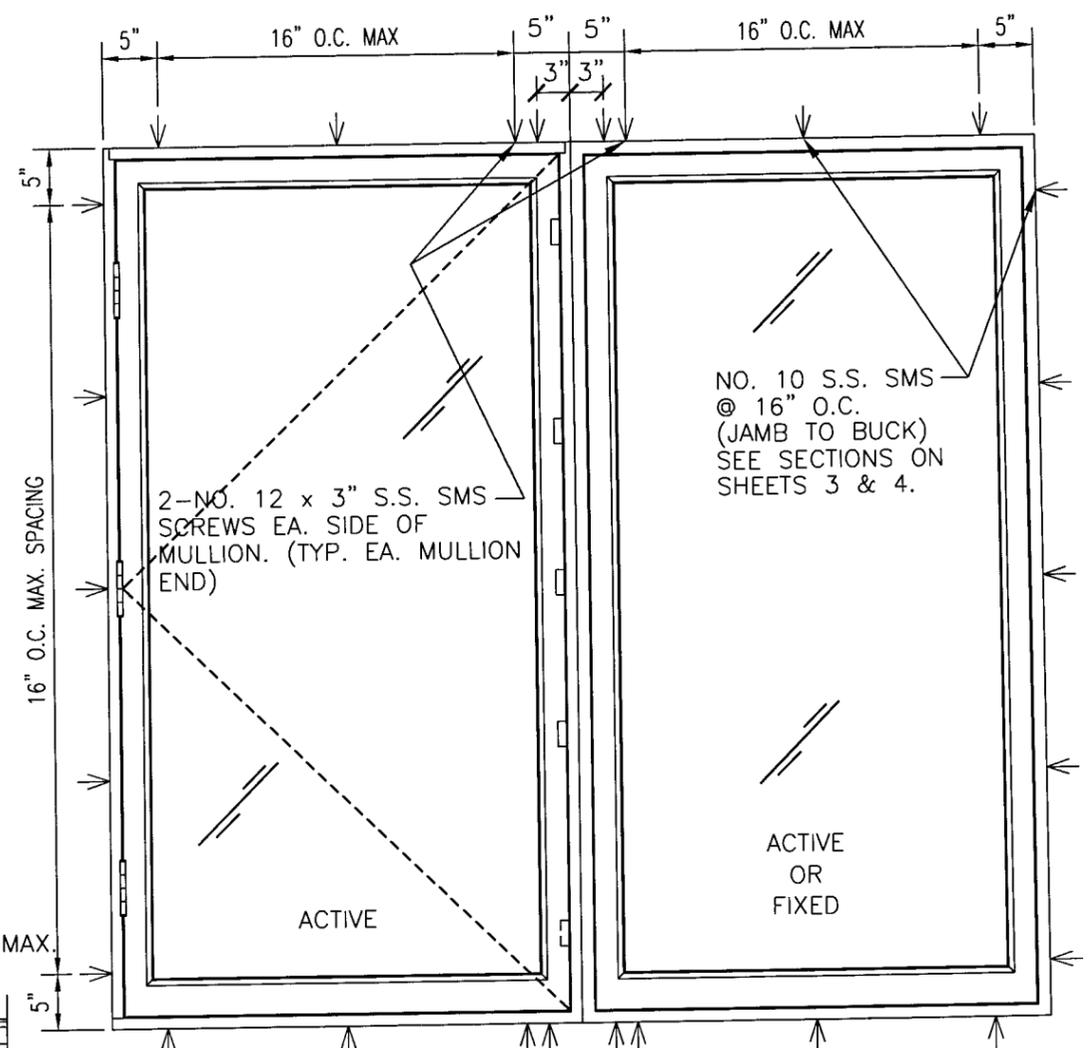

**INSTALLATION ELEVATION
SHOWING FASTENER LOCATION**

SCALE: 3/4"=1'-0"

PRODUCT RENEWED as complying with the Florida Building Code
Acceptance No. 07-0718-03
Expiration Date 1/25/2012
By *[Signature]*
Miami Dade Product Control Division



AUG 13 2007

WARREN W. SCHAEFER, P.E.
STRUCTURAL ENGINEER
P.E. No. 44135

W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.
STRUCTURAL CONSULTING ENGINEERS
8895 N. MILITARY TRAIL, SUITE C204 PHONE: (561)775-4902
PALM BEACH GARDENS, FL 33410 FAX: (561)775-4903


PALM CITY MILLWORK, INC.
3313 SW 42ND AVE P.O. BOX 1661
PALM CITY, FL 34990
(561) 288-7086 FAX (561) 288-7440

MODEL NAME: PCM-DP80/98C	DESCRIPTION: CASEMENT WINDOWS	SHEET No. 2 OF 8
DATE: 12/15/98	REVISIONS: A	
SCALE: AS NOTED	DADE	

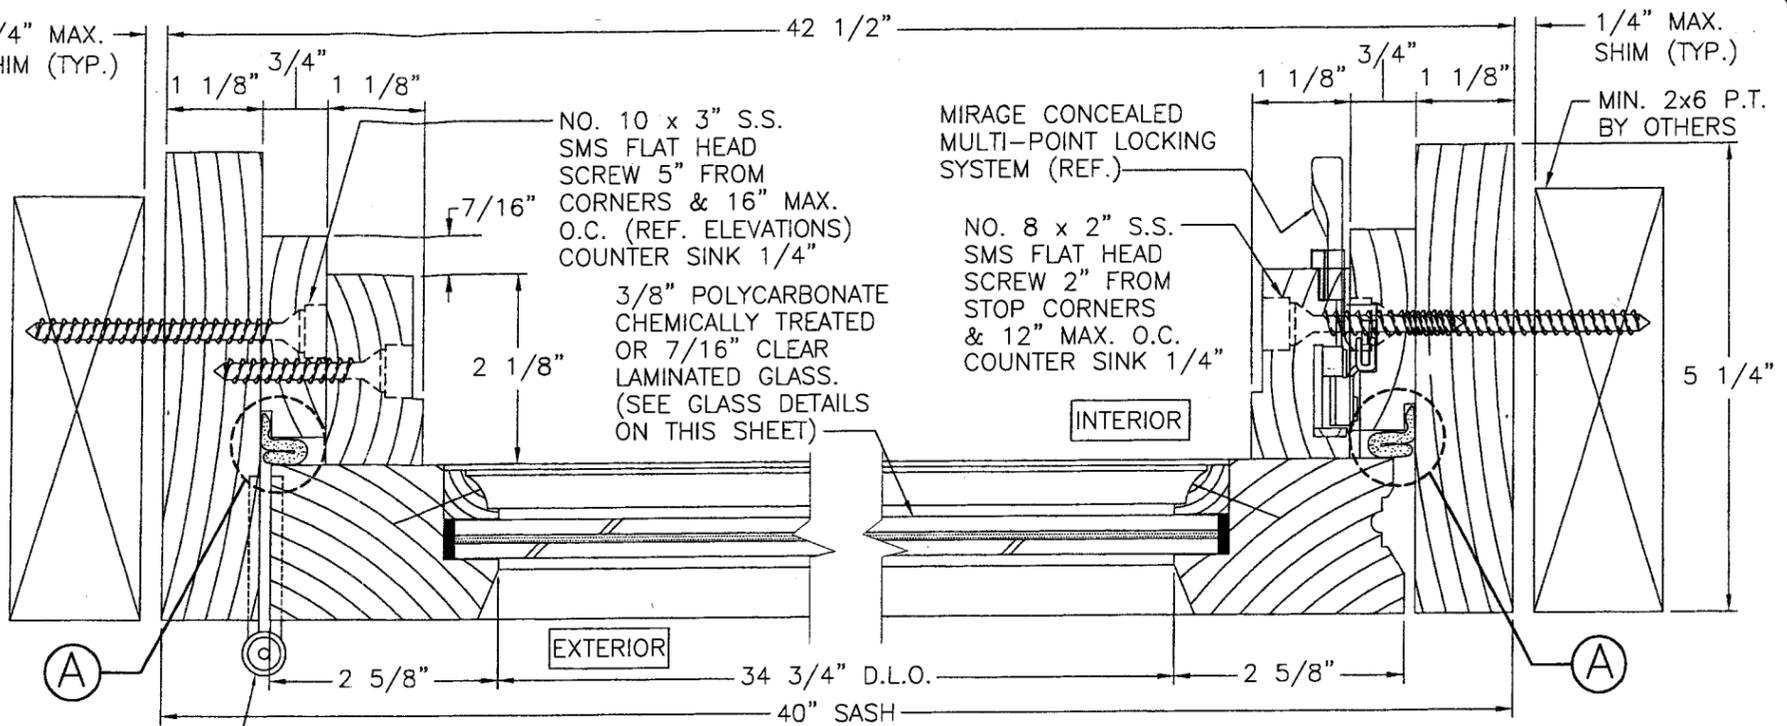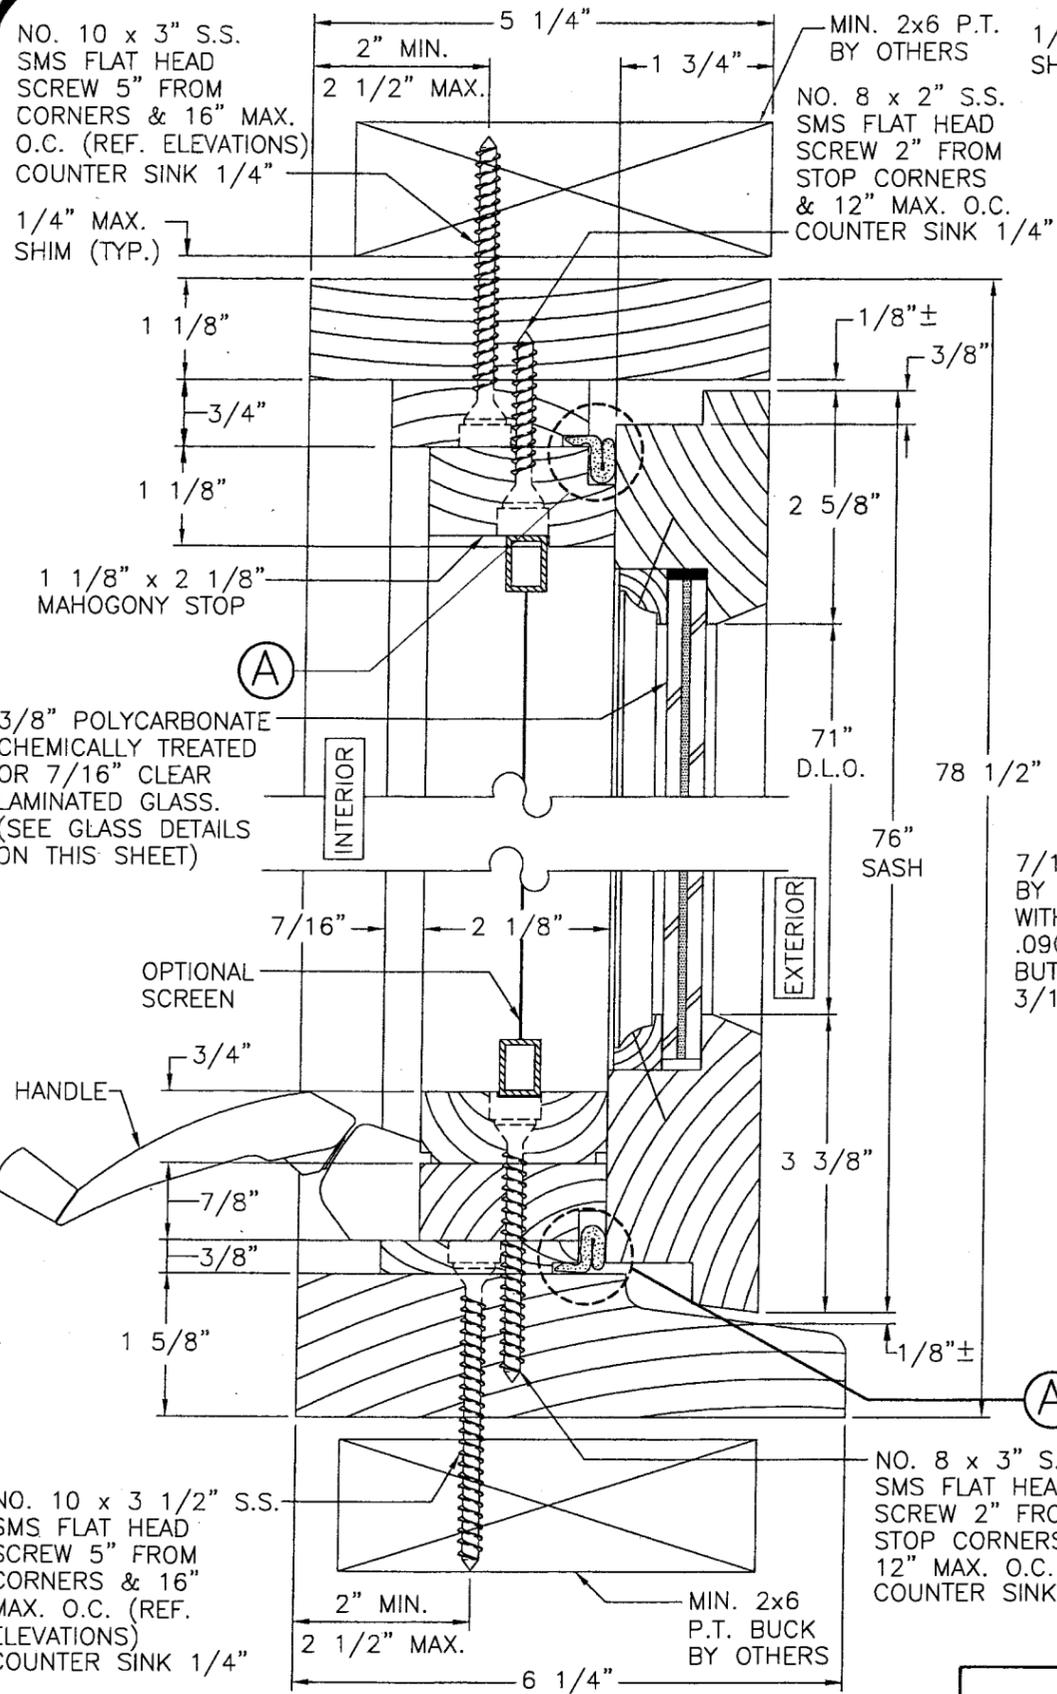


2 PLAN SECTION @ CASEMENT WINDOW
3 SCALE: HALF FULL SIZE

7/16" LAMINATED GLASS BY MONSANTO (SAFLEX) WITH 3/16" ANNEALED, .090" PVB (POLYVINYL BUTYL) INNER LAYER, 3/16" ANNEALED GLASS

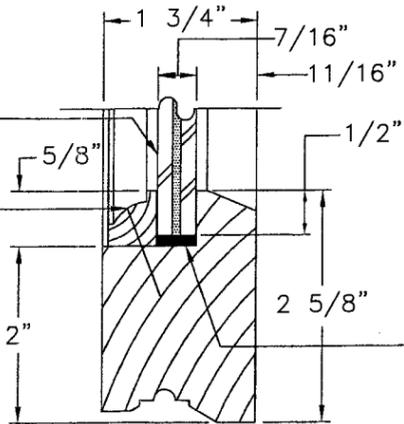

GLASS DETAIL
7/16" LAMINATED ANNEALED BY MONSANTO
SCALE: HALF FULL SIZE

1/8" CHEM-TEM CHEMICALLY TREATED GLASS

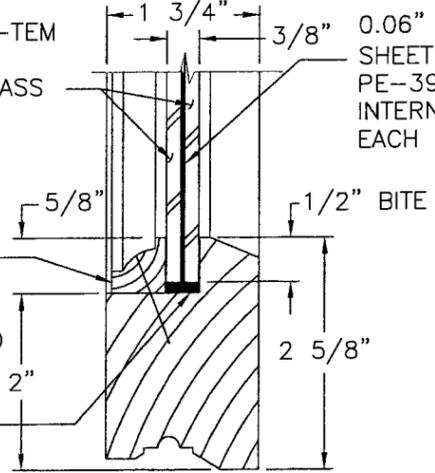

GLASS DETAIL
3/8" P-380 WIND-PANE BY GLOBE AMERADA
SCALE: HALF FULL SIZE

PRODUCT RENEWED as complying with the Florida Building Code
Acceptance No. 07-0718-03
Expiration Date 11/25/2012
By *[Signature]*
Miami Dade Product Control Division

1 VERTICAL SECTION @ CASEMENT WINDOW
3 SCALE: HALF FULL SIZE

LEGEND	
A	QEB-928 SCHLEGEL DOOR SEAL WEATHER STRIP. CELLULAR FOAM CORE, EMBOSSED POLYETHYLENE


AUG 13 2007

WARREN W. SCHAEFER, P.E.
STRUCTURAL ENGINEER
P.E. No. 44135

W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.
STRUCTURAL CONSULTING ENGINEERS
8895 N. MILITARY TRAIL, SUITE C204 PHONE: (561)775-4902
PALM BEACH GARDENS, FL 33410 FAX: (561)775-4903

PALM CITY MILLWORK, INC.
3313 SW 42ND AVE P.O. BOX 1661
PALM CITY, FL 34990
(561) 288-7086 FAX (561) 288-7440

DRAWING No./MODEL NAME PCM-DP80/98C	DESCRIPTION: CASEMENT WINDOWS	SHEET No. 3 OF 8
DATE: 12/15/98	REVISIONS: A	DADE
SCALE: AS NOTED		

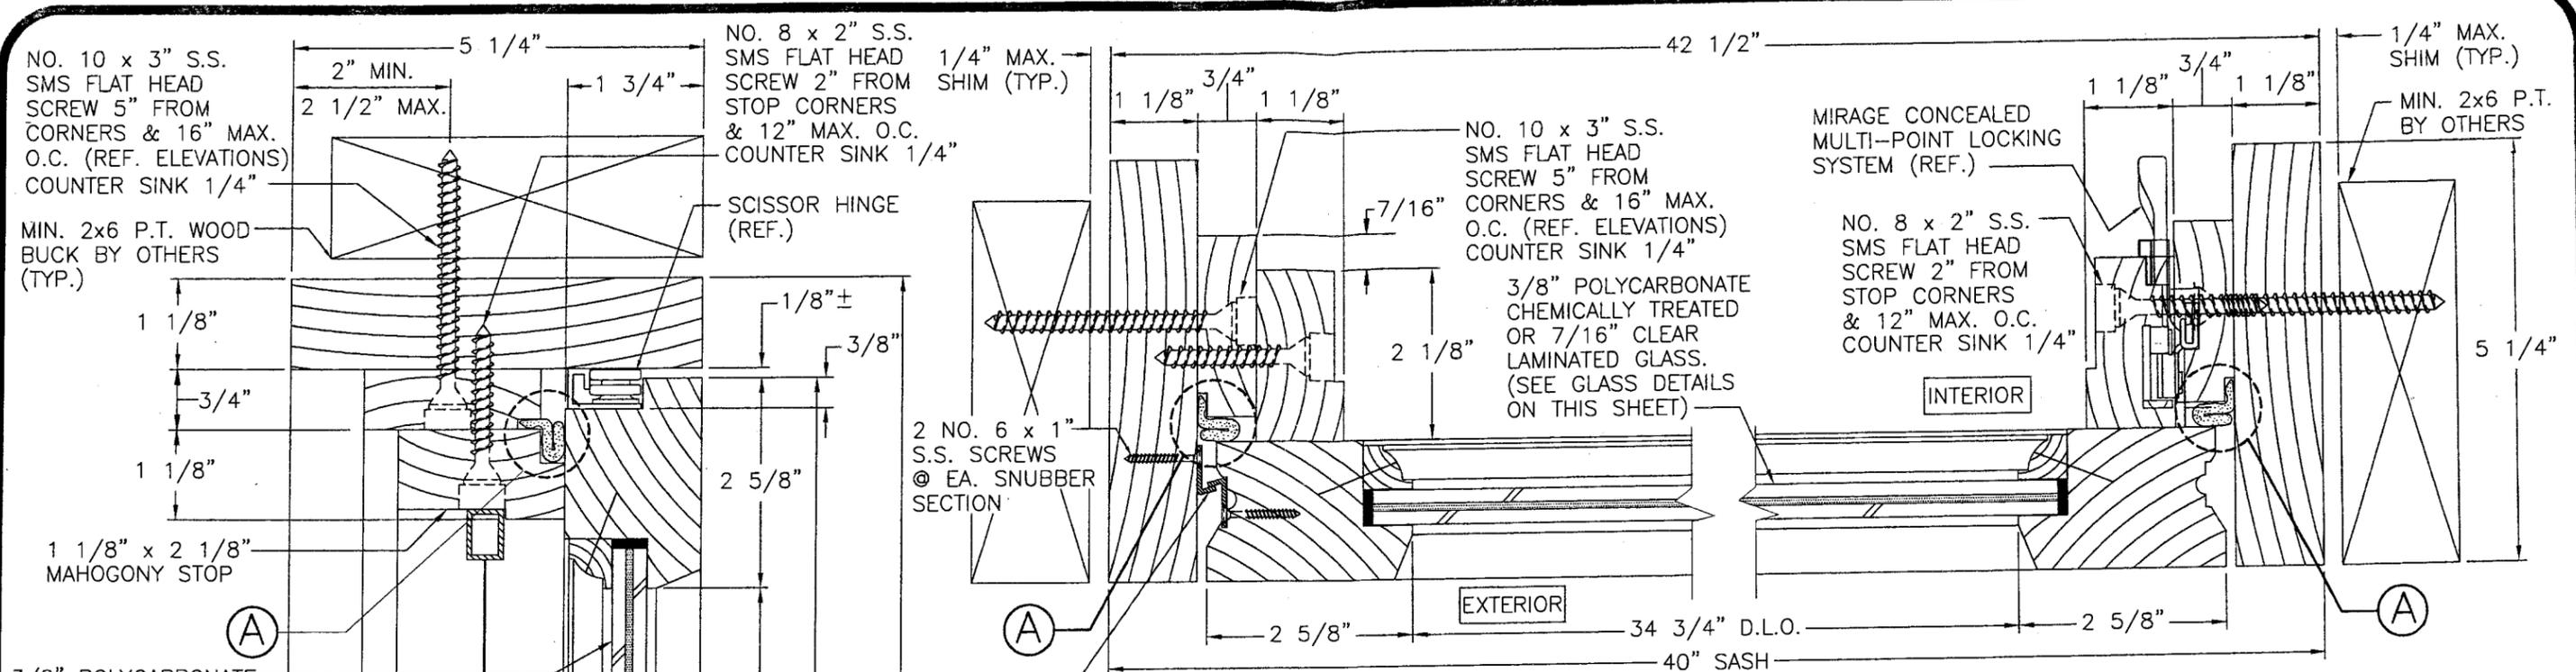

NO. 10 x 3" S.S. SMS FLAT HEAD SCREW 5" FROM CORNERS & 16" MAX. O.C. (REF. ELEVATIONS) COUNTER SINK 1/4"

MIN. 2x6 P.T. WOOD BUCK BY OTHERS (TYP.)

1 1/8" 3/4" 1 1/8"

1 1/8" x 2 1/8" MAHOGONY STOP

3/8" POLYCARBONATE CHEMICALLY TREATED OR 7/16" CLEAR LAMINATED GLASS. (SEE GLASS DETAILS ON THIS SHEET)

OPTIONAL SCREEN

HANDLE

7/8" 3/8" 1 5/8"

NO. 10 x 3 1/2" S.S. SMS FLAT HEAD SCREW 5" FROM CORNERS & 16" MAX. O.C. (REF. ELEVATIONS) COUNTER SINK 1/4"

5 1/4" 2" MIN. 2 1/2" MAX. 1 3/4"

NO. 8 x 2" S.S. SMS FLAT HEAD SCREW 2" FROM STOP CORNERS & 12" MAX. O.C. COUNTER SINK 1/4"

SCISSOR HINGE (REF.)

1/8" ± 3/8" 2 5/8"

71" D.L.O. 76" SASH

EXTERIOR

3 3/8"

1/8" ±

6 1/4" MIN. 2x6 P.T. BUCK BY OTHERS (TYP.)

1/4" MAX. SHIM (TYP.)

NO. 10 x 3" S.S. SMS FLAT HEAD SCREW 5" FROM CORNERS & 16" MAX. O.C. (REF. ELEVATIONS) COUNTER SINK 1/4"

3/8" POLYCARBONATE CHEMICALLY TREATED OR 7/16" CLEAR LAMINATED GLASS. (SEE GLASS DETAILS ON THIS SHEET)

2 NO. 6 x 1" S.S. SCREWS @ EA. SNUBBER SECTION

2 5/8" 34 3/4" D.L.O. 40" SASH

PCM 225 CONCEALED BRASS SNUBBER BY PALM CITY MILLWORK.

7/16" LAMINATED GLASS BY MONSANTO (SAFLEX) WITH 3/16" ANNEALED, .090" PVB (POLYVINYL BUTYL) INNER LAYER, 3/16" ANNEALED GLASS

GLASS STOP TO BE FASTENED WITH 1" PIN NAILS @ 8" O.C. AND WOOD GLUE

SCISSOR HINGE (REF.)

NO. 8 x 3" S.S. SMS FLAT HEAD SCREW 2" FROM STOP CORNERS 12" MAX. O.C. COUNTER SINK 1/4"

42 1/2" 1 1/8" 3/4" 1 1/8" 1 1/8" 3/4" 1 1/8" 1 1/8" 1/4" MAX. SHIM (TYP.) MIN. 2x6 P.T. BY OTHERS


MIRAGE CONCEALED MULTI-POINT LOCKING SYSTEM (REF.)

NO. 8 x 2" S.S. SMS FLAT HEAD SCREW 2" FROM STOP CORNERS & 12" MAX. O.C. COUNTER SINK 1/4"


INTERIOR

EXTERIOR

4 PLAN SECTION @ CASEMENT WINDOW SCALE: HALF FULL SIZE

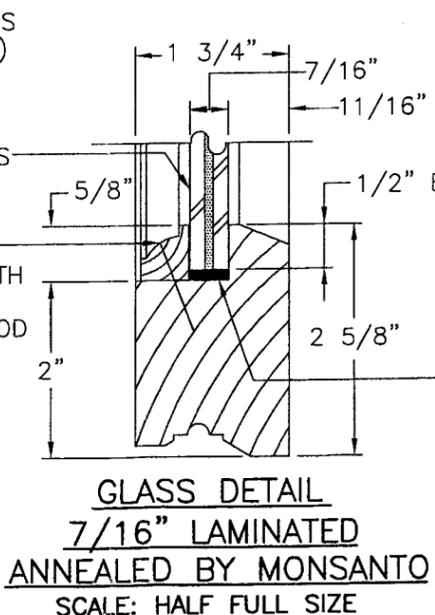

GLASS DETAIL 7/16" LAMINATED ANNEALED BY MONSANTO SCALE: HALF FULL SIZE

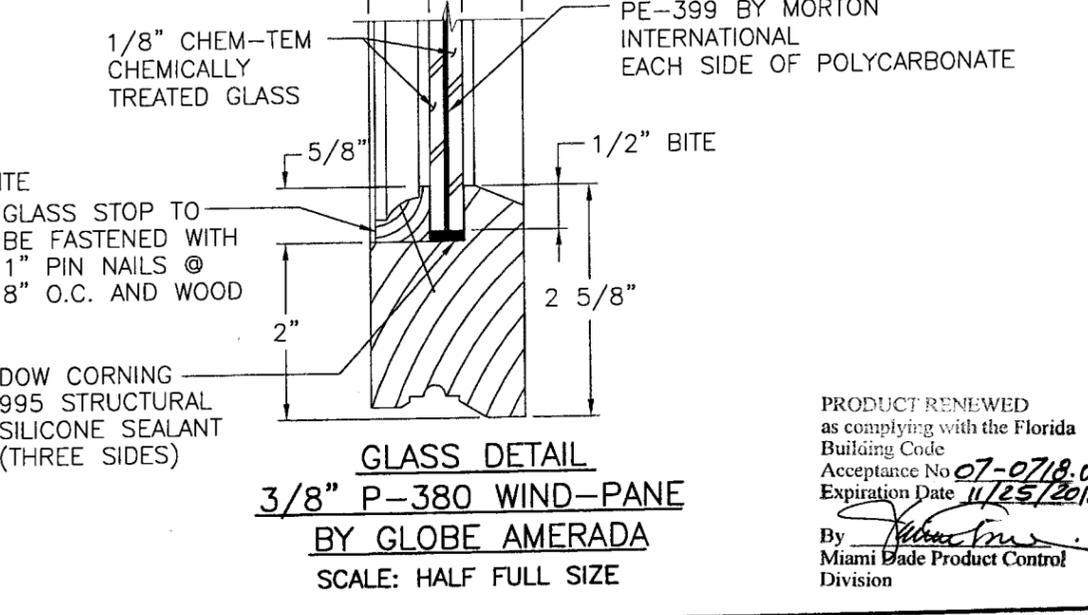

GLASS DETAIL 3/8" P-380 WIND-PANE BY GLOBE AMERADA SCALE: HALF FULL SIZE

PRODUCT RENEWED as complying with the Florida Building Code Acceptance No. 07-0718-03 Expiration Date 11/25/2012 By [Signature] Miami Dade Product Control Division


3 VERTICAL SECTION @ CASEMENT WINDOW SCALE: HALF FULL SIZE

LEGEND	
A	QEB-928 SCHLEGEL DOOR SEAL WEATHER STRIP. CELLULAR FOAM CORE, EMBOSSED POLYETHYLENE

WARREN W. SCHAEFER, P.E. STRUCTURAL ENGINEER P.E. No. 44135
 W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. STRUCTURAL CONSULTING ENGINEERS
 8895 N. MILITARY TRAIL, SUITE C204 PALM BEACH GARDENS, FL 33410 PHONE: (561) 775-4902 FAX: (561) 775-4903


PALM CITY MILLWORK, INC.
 3313 SW 42ND AVE P.O. BOX 1661
 PALM CITY, FL 34990
 (561) 288-7086 FAX (561) 288-7440

DRAWING No./MODEL NAME PCM-DP80/98C	DESCRIPTION: CASEMENT WINDOWS	SHEET No. 4 OF 8
DATE: 12/15/98	REVISIONS: A	DADE
SCALE: AS NOTED		

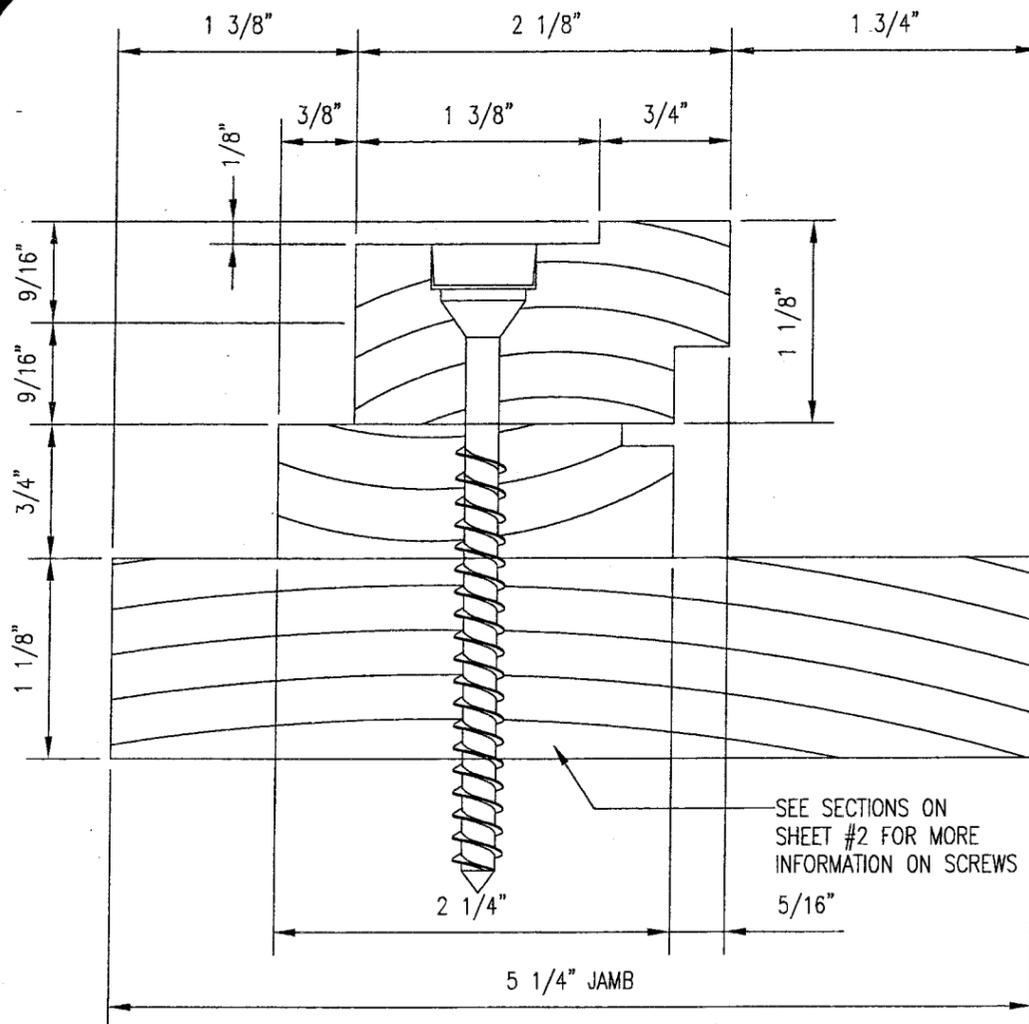


DETAIL @ JAMB & STOP W/ SCREW

SCALE: FULL SIZE

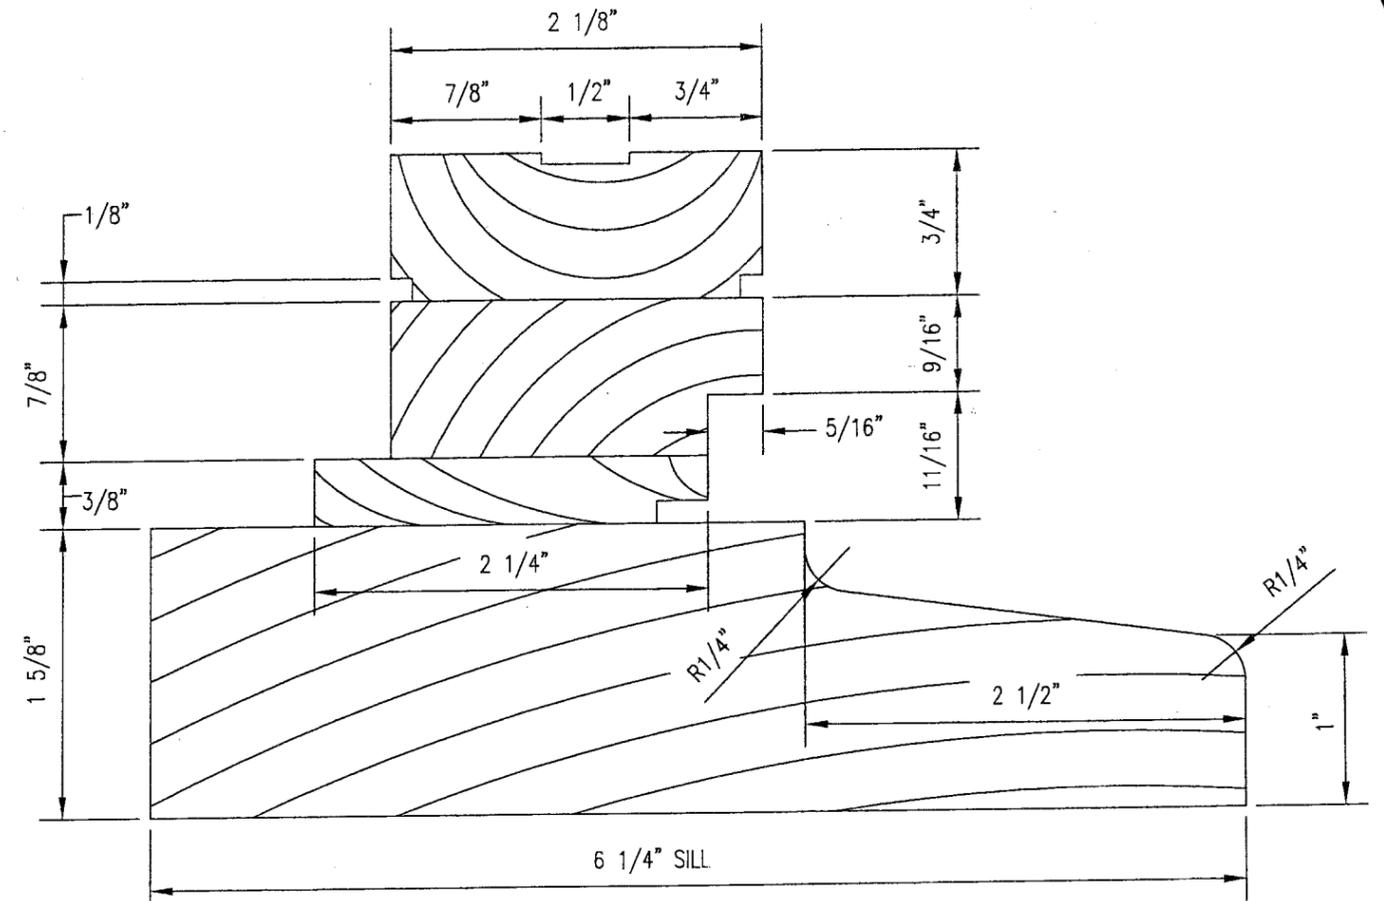


DETAIL @ CASEMENT SILL

SCALE: FULL SIZE

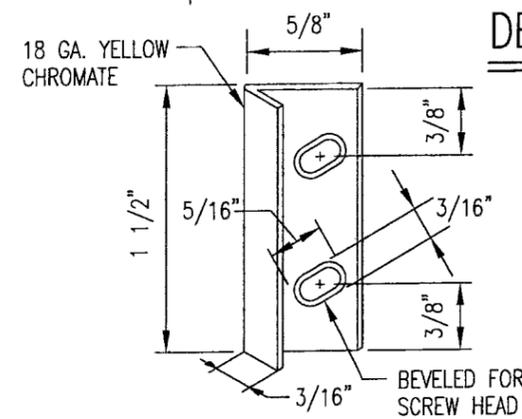


**PCM 225
BRASS SNUBBER**

SCALE: FULL SIZE

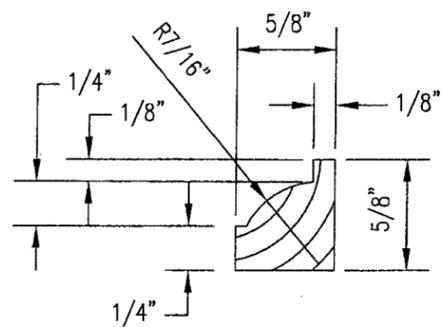

DETAIL @ GLASS STOP

SCALE: FULL SIZE

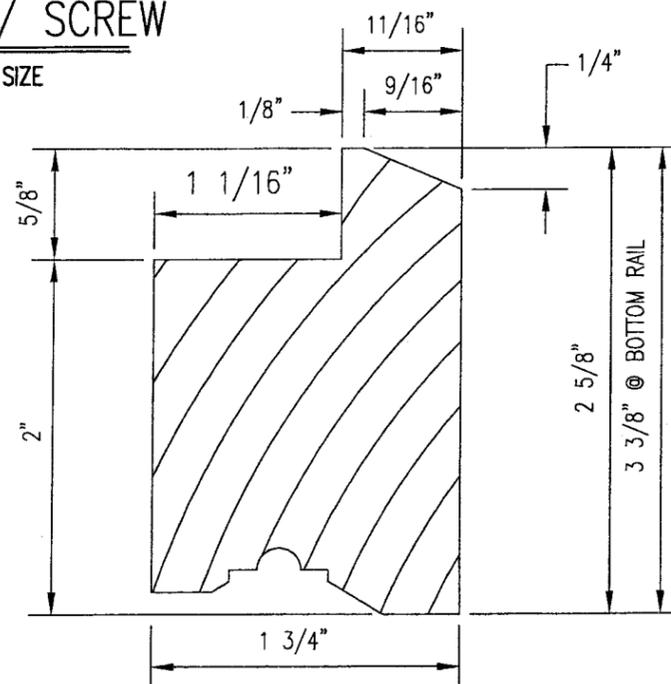

DETAIL @ STILES & RAILS

SCALE: FULL SIZE

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 07-0718-03
Expiration Date 11/25/2012
By *[Signature]*
Miami Dade Product Control
Division

AUG 13 2007


WARREN W. SCHAEFER, P.E.
STRUCTURAL ENGINEER
P.E. No. 44135

W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.
STRUCTURAL CONSULTING ENGINEERS
8895 N. MILITARY TRAIL, SUITE C204 PHONE: (561)775-4902
PALM BEACH GARDENS, FL 33410 FAX: (561)775-4903


PALM CITY MILLWORK, INC.

3313 SW 42ND AVE P.O. BOX 1661
PALM CITY, FL 34990
(561) 288-7086 FAX (561) 288-7440

MODEL NAME: PCM-DP80/98C	DESCRIPTION: CASEMENT WINDOWS	SHEET No. 5 OF 8
DATE: 12/15/98	REVISIONS: A	
SCALE: AS NOTED	DADE	

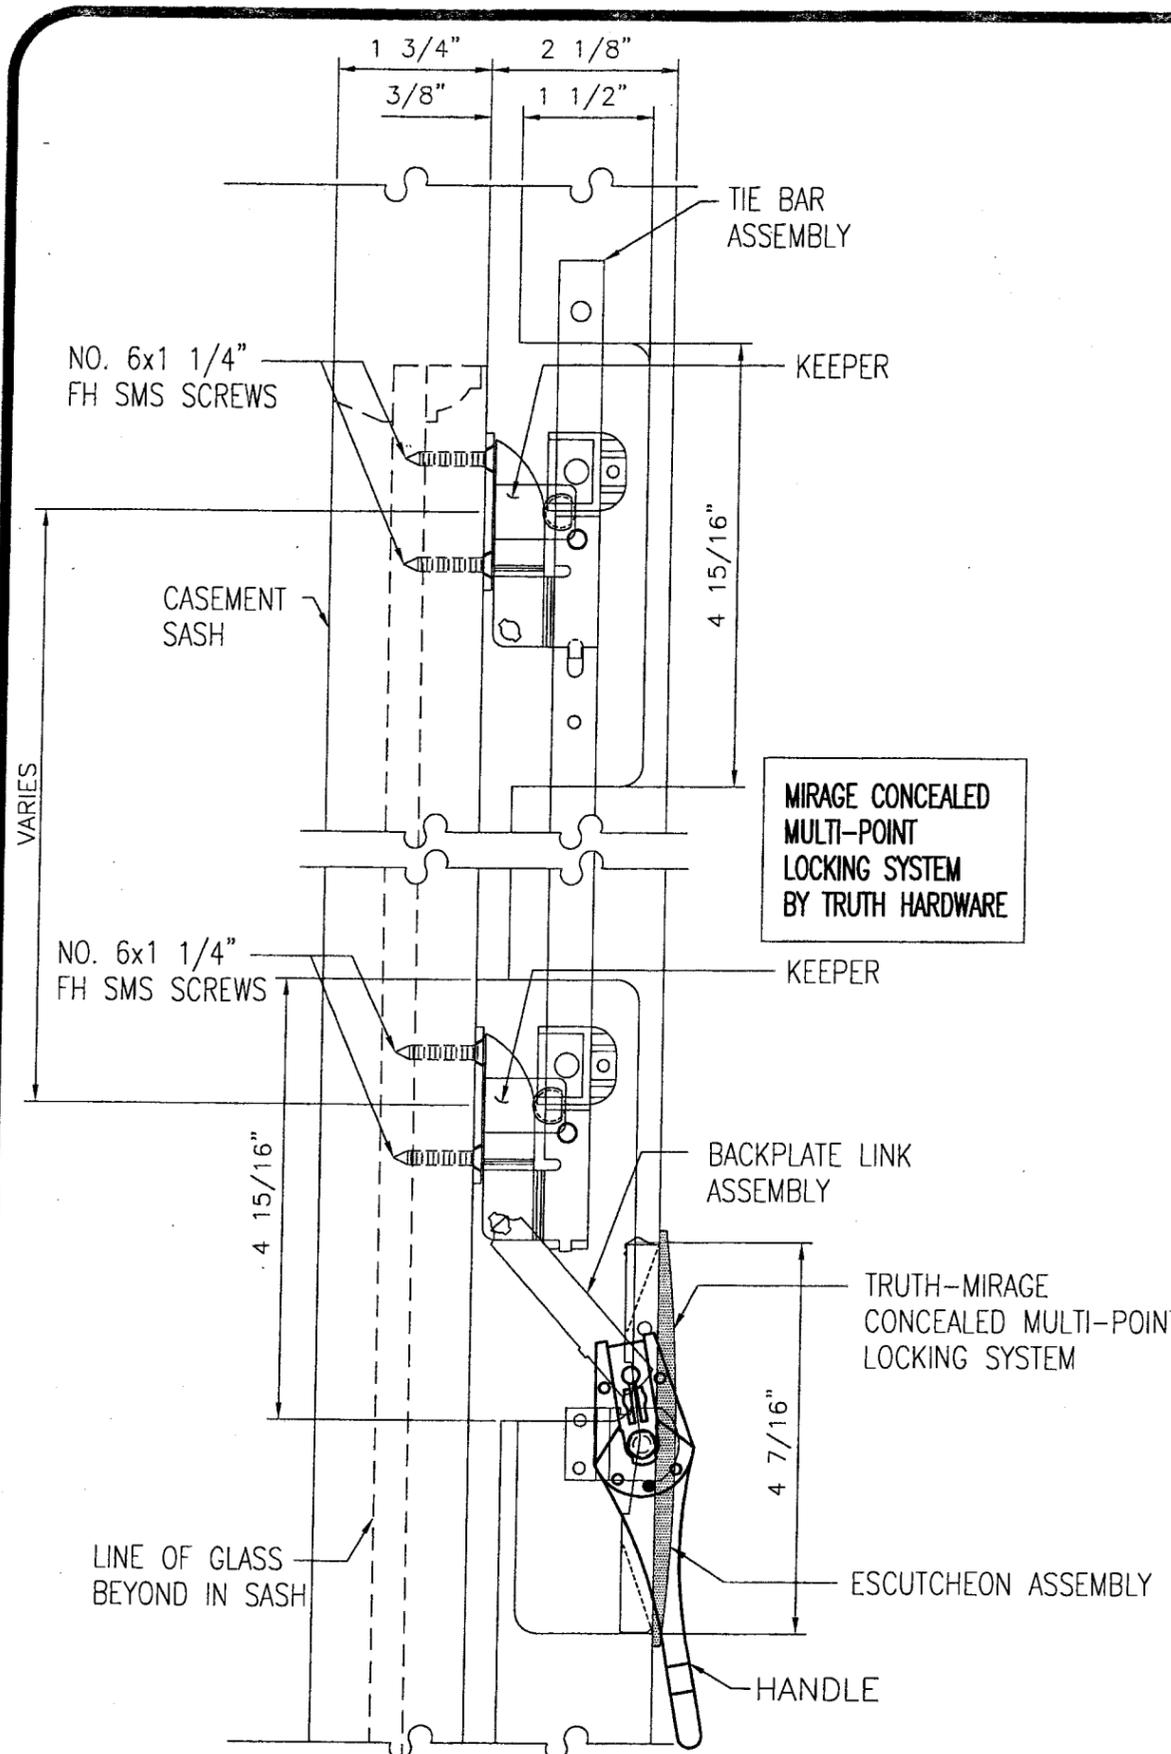


DETAIL @ CONCEALED CASEMENT SASH LOCK
 SCALE: 1/2"=1" (HALF SIZE)

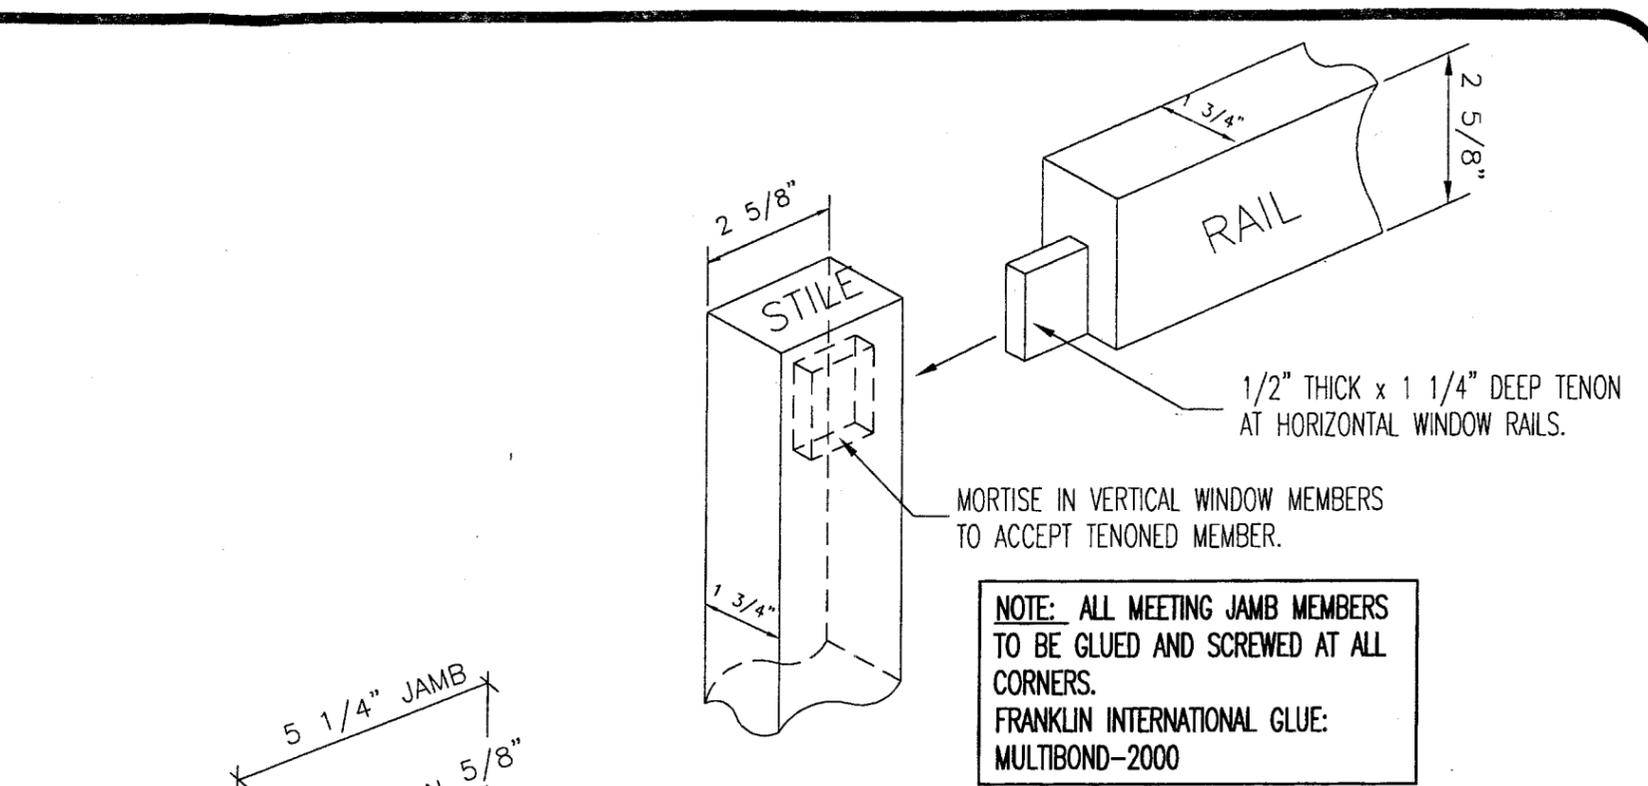

NOTE: ALL MEETING JAMB MEMBERS TO BE GLUED AND SCREWED AT ALL CORNERS. FRANKLIN INTERNATIONAL GLUE: MULTIBOND-2000

TYP. MORTISE & TENON CORNER DETAIL
 SCALE: N.T.S.

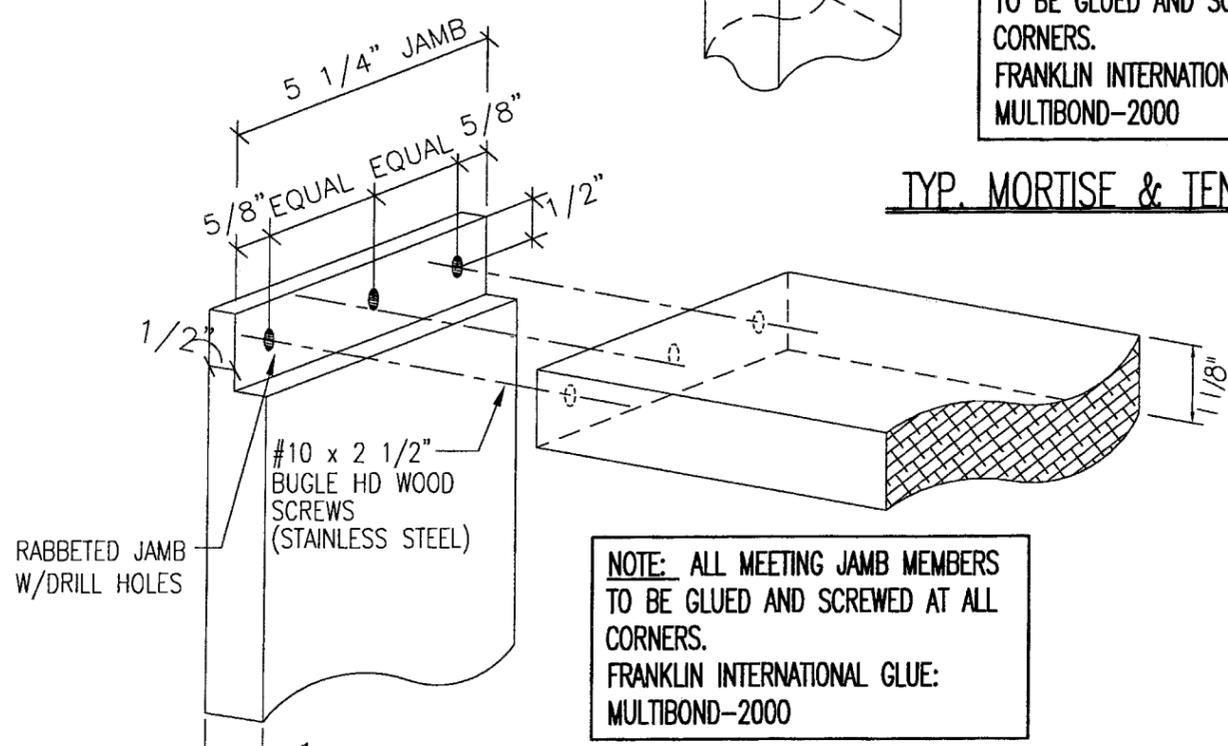

NOTE: ALL MEETING JAMB MEMBERS TO BE GLUED AND SCREWED AT ALL CORNERS. FRANKLIN INTERNATIONAL GLUE: MULTIBOND-2000

TYP. RABBETED JAMB DETAIL
 SCALE: N.T.S.

PRODUCT RENEWED as complying with the Florida Building Code
 Acceptance No. 07-0718.03
 Expiration Date 11/25/2012
 By *[Signature]*
 Miami Dade Product Control Division

AUG 13 2007

WARREN W. SCHAEFER, P.E.
 STRUCTURAL ENGINEER
 P.E. No. 44135

W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.
 STRUCTURAL CONSULTING ENGINEERS
 8895 N. MILITARY TRAIL, SUITE C204 PHONE: (561)775-4902
 PALM BEACH GARDENS, FL 33410 FAX: (561)775-4903


PALM CITY MILLWORK, INC.
 3313 SW 42ND AVE P.O. BOX 1661
 PALM CITY, FL 34990
 (561) 288-7086 FAX (561) 288-7440

MODEL NAME: PCM-DP80/98C	DESCRIPTION: CASEMENT WINDOWS	SHEET No. 6 OF 8
DATE: 12/15/98	REVISIONS: A	
SCALE: AS NOTED	DADE	

NOTE:


* THE DESIGN ENGINEER FOR BUCK ATTACHMENT TO OPENING SHALL BE AWARE THAT THE WINDOW MULLIONS TRANSFER POINT LOADS TO THE BUCK AT EACH MULLION END.

* PROPER FASTENING OF THE BUCK IN THOSE AREAS MUST BE COMPLETED TO CARRY THE POINT LOADS. (AMOUNT OF LOAD VARIES WITH WINDOW SIZE).

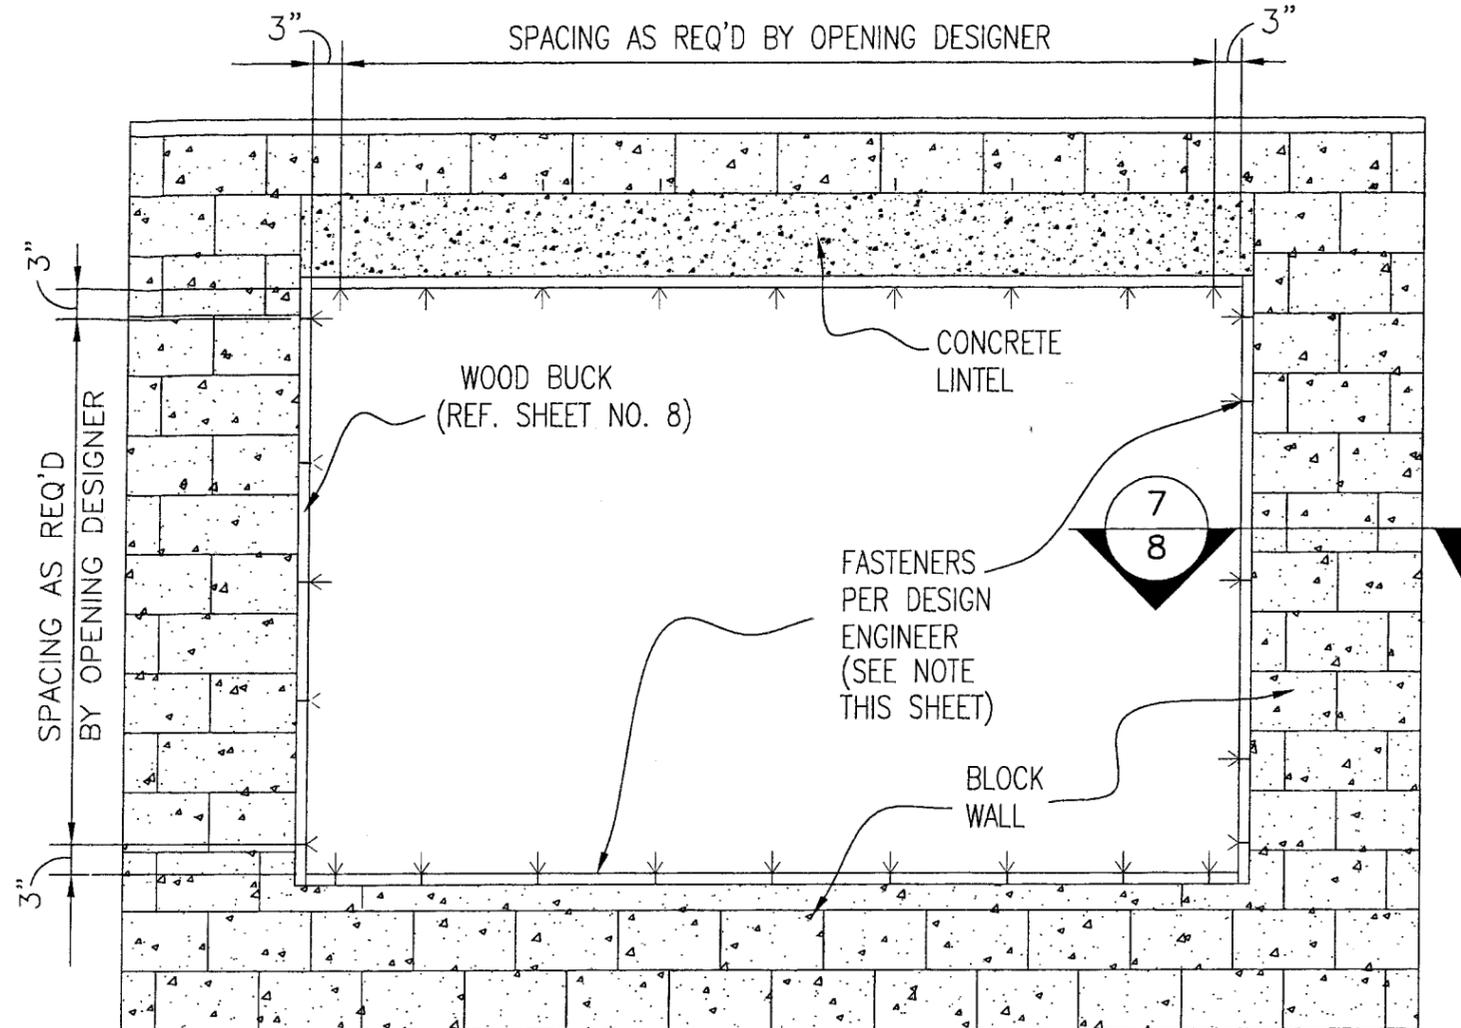

ELEVATION @ CONCRETE WALL BUCK INSTALLATION

SCALE: 1/2"=1'-0"

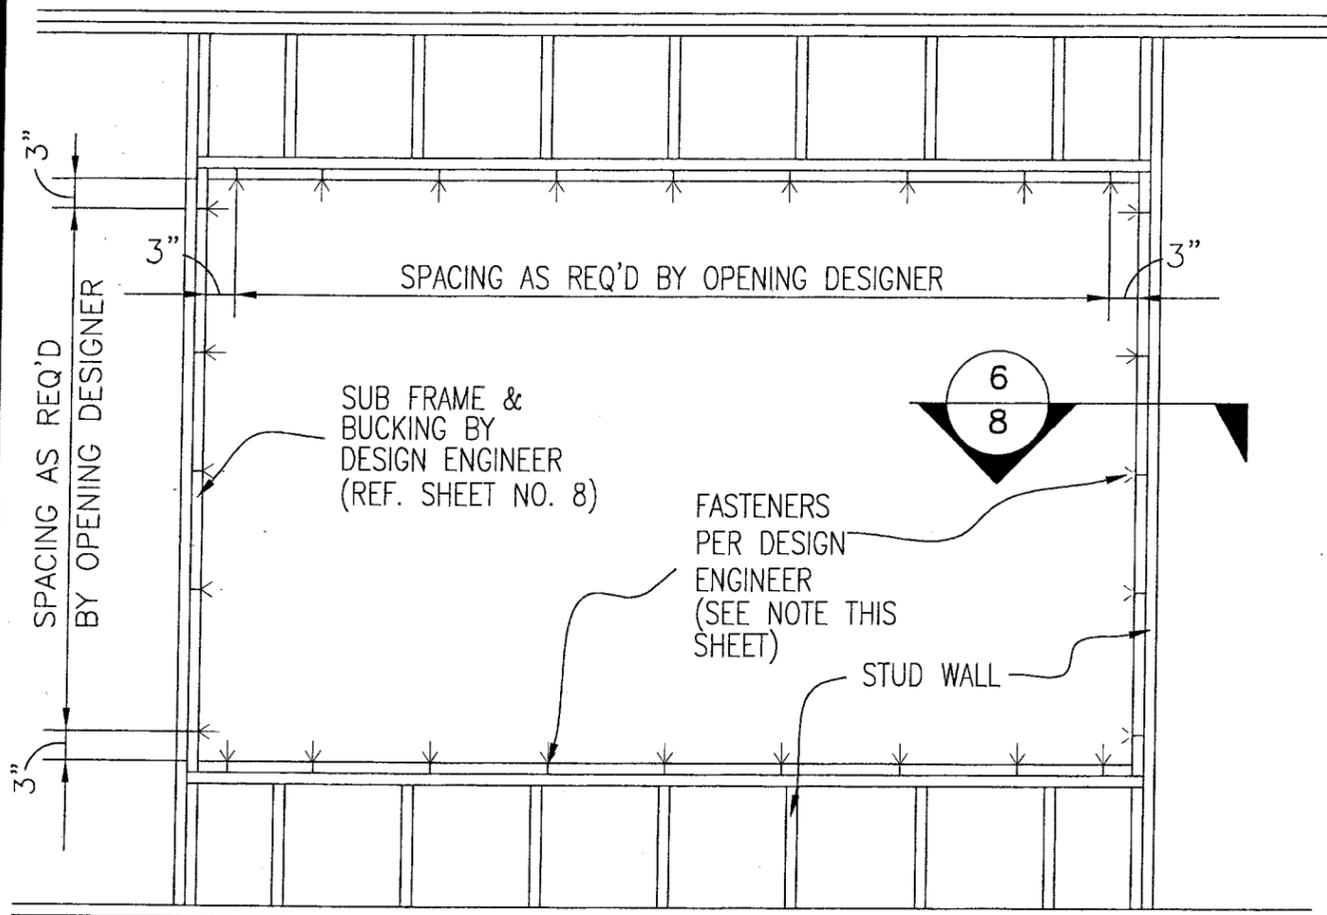

ELEVATION @ STUD WALL BUCK INSTALLATION

SCALE: 1/2"=1'-0"

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 07-0718.03
Expiration Date 11/25/2012
By *[Signature]*
Miami Dade Product Control
Division

AUG 13 2007

WARREN W. SCHAEFER, P.E.
STRUCTURAL ENGINEER
P.E. No. 44135

W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.
STRUCTURAL CONSULTING ENGINEERS
8895 N. MILITARY TRAIL, SUITE C204 PHONE: (561)775-4902
PALM BEACH GARDENS, FL 33410 FAX: (561)775-4903


PALM CITY MILLWORK, INC.
3313 SW 42ND AVE P.O. BOX 1661
PALM CITY, FL 34990
(561) 288-7086 FAX (561) 288-7440

MODEL NAME: PCM-DP80/98C	DESCRIPTION: CASEMENT WINDOWS	SHEET No. 7 OF 8
DATE: 12/15/98	REVISIONS: A	
SCALE: AS NOTED	DADE	


LOCK/HINGE/SNUBBER QUANTITY TABLE

HEIGHT O/ALL UNIT	WIDTH O/ALL UNIT	NUMBER OF LOCKS REQ'D	NUMBER OF HINGES REQ'D	NUMBER OF SNUBBERS REQ'D
36"	ALL	2	2	2
42"	30"	2	2	2
42"	36"	3	2	3
42"	42"	3	2	3
48"	18"	2	2	2
48"	24"	3	2	3
48"	42"	3	2	3
54"	36"	3	3	3
54"	42"	4	3	4
60"	30"	3	3	3
60"	42"	4	3	4
66"	24"	3	3	3
66"	36"	4	3	4
66"	42"	5	3	5
72"	24"	3	3	3
72"	30"	4	3	4
72"	36"	5	3	5
78"	30"	4	3	4
78"	42"	5	3	5

NOTE: INTERPOLATION BETWEEN VALUES IS NOT PERMITTED. USE TABLE WINDOW SIZE NEXT UP FROM THE ACTUAL SIZE TO BE CONSIDERED.

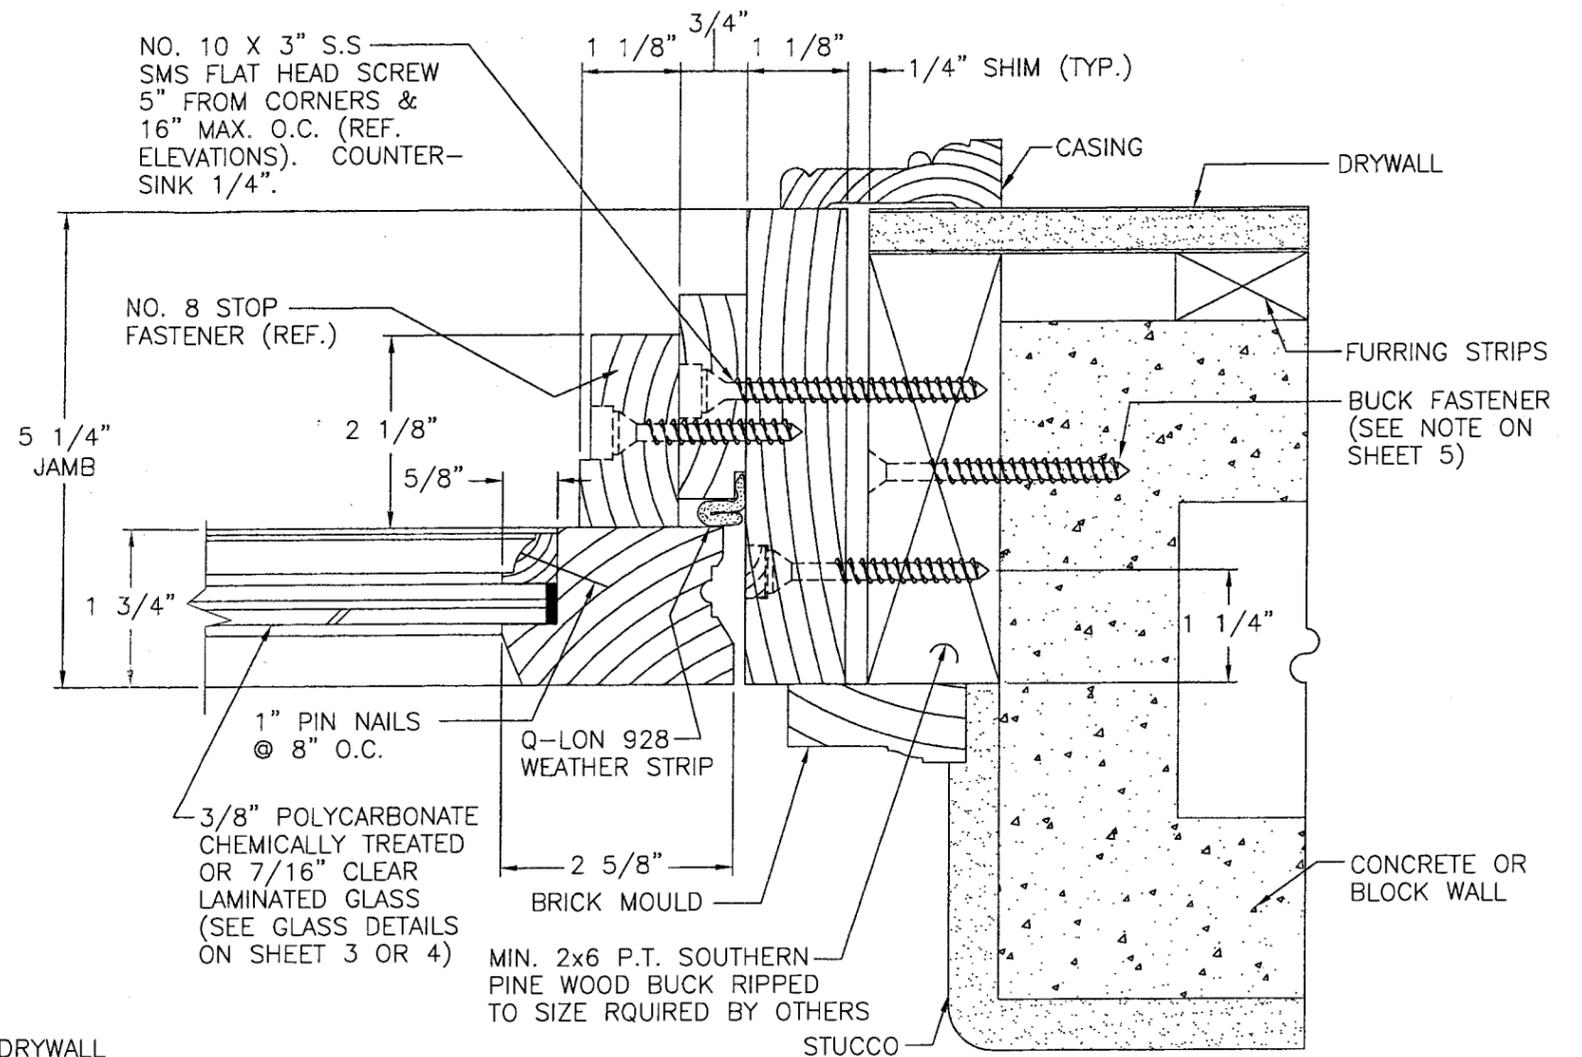

7 HORIZONTAL SECTION OF BLOCK WALL INSTALLATION
SCALE: HALF FULL SIZE

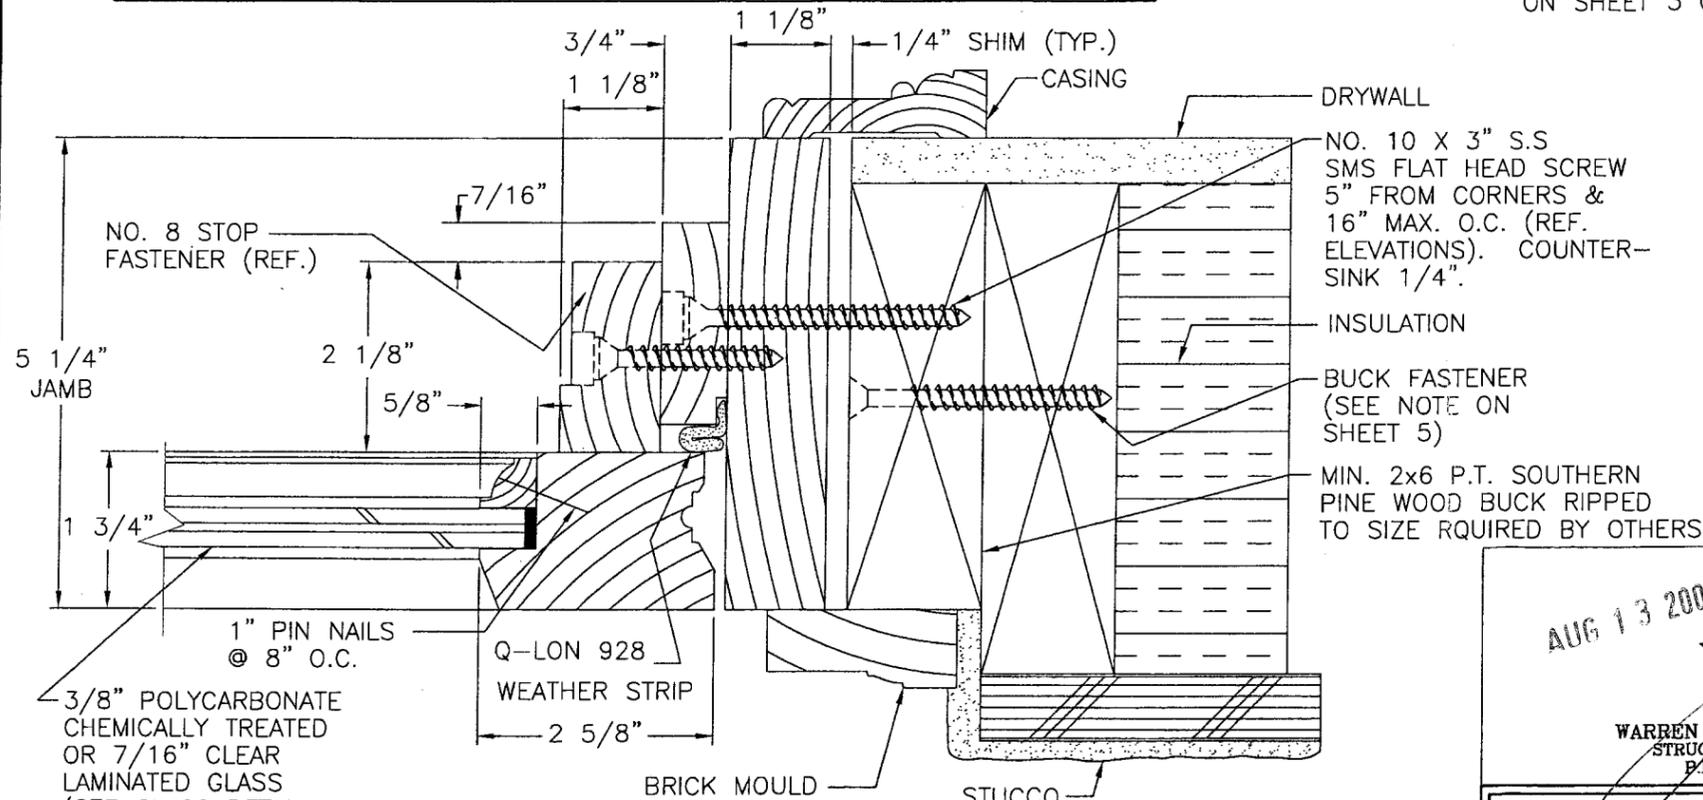

6 HORIZONTAL SECTION OF STUD WALL INSTALLATION
SCALE: HALF FULL SIZE

PRODUCT RENEWED
in compliance with the Florida
Building Code
Acceptance No. 07-0718.03
Expiration Date 11/25/2012
By *[Signature]*
Miami Dade Product Control
Division

AUG 13 2007

WARREN W. SCHAEFER, P.E.
STRUCTURAL CONSULTING ENGINEERS
P.E. No. 44135

W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.
STRUCTURAL CONSULTING ENGINEERS
8895 N. MILITARY TRAIL, SUITE C204 PHONE: (561)775-4902
PALM BEACH GARDENS, FL 33410 FAX: (561)775-4903

PALM CITY MILLWORK, INC.
3313 SW 42ND AVE P.O. BOX 1661
PALM CITY, FL 34990
(561) 288-7086 FAX (561) 288-7440

DRAWING No./MODEL NAME PCM-DP80/98C	DESCRIPTION: CASEMENT WINDOWS	SHEET No. 8 OF 8
DATE: 12/15/98	REVISIONS: A	DADE
SCALE: AS NOTED		