



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 372-6339

**NOTICE OF ACCEPTANCE (NOA)**

[www.miamidade.gov/buildingcode](http://www.miamidade.gov/buildingcode)

Jeld-Wen, Inc. (OR)  
3737 Lakeport Boulevard  
Klamath Falls, OR 97601

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION:**

**Series "Jeld-Wen STEEL" 6'8" W/E Outswing Glazed Insulated Steel Door w/wo Sidelights - N.I.**

**APPROVAL DOCUMENT:** Drawing No. S-2105, titled "Series Wood Edge Glazed Steel Outswing Door up to 9'-0" x 6'-8" with & without Sidelites", sheets 1 through 8 of 8, dated 12/13/2001 with revision D dated 10/01/2007, prepared by PTC, LLC, signed and sealed by Eric S. Nielsen, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: None Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises and renews NOA # 02-1216.09 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P.E.**



J. Gascon  
10/25/07

NOA No. 07-0731.01  
Expiration Date: August 15, 2012  
Approval Date: November 15, 2007  
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No. **S-2105**, titled "Series Wood Edge Glazed Steel Outswing Door up to 9'-0" x 6'-8" with & without Sidelites", sheets 1 through 8 of 8, dated 12/13/2001 with revision D dated 10/01/2007, prepared by PTC, LLC, signed and sealed by Eric S. Nielsen, P.E.

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, PA 202-94  
2) Uniform Static Air Pressure Test, PA 202-94  
3) Water Resistance Test, PA 202-94  
4) Forced Entry Test, PA 202-94  
along with marked-up drawings and installation diagram of DoorCraft series OXXO configuration Outswing and Inswing opaque wood edge steel door, prepared by Certified Testing Laboratories, Test Report No. **CTLA-961W**, dated 10/23/2002, signed and sealed by Ramesh C. Patel, P.E.  
*(Submitted under NOA# 02-1216.09)*
2. Test reports on 1) Air Infiltration Test, PA 202-94  
2) Uniform Static Air Pressure Test, PA 202-94  
3) Water Resistance Test, PA 202-94  
4) Forced Entry Test, PA 202-94  
along with marked-up drawings and installation diagram of DoorCraft series OXXO configuration Outswing and Inswing glazed wood edge steel door, prepared by Certified Testing Laboratories, Test Report No. **CTLA-697W**, dated 11/11/01, signed and sealed by Ramesh C. Patel, P.E. with addendum letter dated April 11, 2002 also signed and sealed by Ramesh C. Patel, P.E.  
*(Submitted under NOA# 02-1216.09)*
3. Test reports on 1) Air Infiltration Test, PA 202-94  
2) Uniform Static Air Pressure Test, PA 202-94  
3) Water Resistance Test, PA 202-94  
4) Forced Entry Test, PA 202-94  
along with marked-up drawings and installation diagram of DoorCraft series OXXO configuration Outswing and Inswing opaque wood edge steel door, prepared by Certified Testing Laboratories, Test Report No. **CTLA-697W**, dated 11/11/2001, signed and sealed by Ramesh C. Patel, P.E.  
*(Submitted under NOA# 02-1216.09)*



Jaime D. Gascon, P.E.  
Chief, Product Control Division  
NOA No. 07-0731.01  
Expiration Date: August 15, 2012  
Approval Date: November 15, 2007

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**B. TESTS** (Continuous)

4. Test reports on:

1) Tensile Test, ASTM D 638-03  
along with marked-up drawings and installation diagram of the "Trinity Lite Frame",  
prepared by Certified Testing Laboratories, Test Report No. **CTLA-1078H**, dated  
10/24/02, signed and sealed by Ramesh C. Patel, P.E. with addendum letter dated  
April 11, 2002.  
*(Submitted under NOA# 02-1216.09)*

5. Test reports on:

1) Self Ignition Test, ASTM D 1929-96  
2) Surface burning characteristics Test, ASTM E-84  
along with marked-up drawings and installation diagram, prepared by Intertek Testing  
Services, Test Report No. **ITS J9906660-001**, dated 04/08/1999, signed and sealed by  
Douglas Tucker, P.E.  
*(Submitted under NOA# 02-1216.09)*

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC-2004,  
prepared by PTC, LLC, dated 06/29/2007, signed and sealed by Eric S. Nielsen, P.E.  
**Complies with ASTM E1300-98/02**

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**


1. None

**F. STATEMENTS**

1. Statement letter of conformance, no financial interest and independence, PTC, LLC,  
dated 06/26/2007, signed and sealed by Eric S. Nielsen, P.E.

**G. OTHER**

1. Notice of Acceptance No. **02-1216.09**, issued to Jeld-Wen, Inc. (OR) for their Series  
"Wood Edge Glazed Door w/ & w/out Sidelites up to 8'4 x 6'8 Outswing", approved  
on 01/30/2003 and expiring on 08/15/2007.



Jaime D. Gascon, P.E.  
Chief, Product Control Division  
NOA No. 07-0731.01  
Expiration Date: August 15, 2012  
Approval Date: November 15, 2007

# JELD-WEN® Steel

6'-8" WOOD EDGE GLAZED STEEL OUTSWING  
DOOR UNITS WITH & WITHOUT SIDELITES

### GENERAL NOTES

- THIS PRODUCT IS DESIGNED TO COMPLY WITH THE 2004 FLORIDA BUILDING CODE (W/ 2005 & 2006 SUPPLEMENTS)
- 2X WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
- PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED PER ANCHOR LOCATION DRAWINGS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
- SEE TABLE 1 ON THIS SHEET FOR DESIGN PRESSURE RATINGS.
- THIS PRODUCT MEETS THE WATER REQUIREMENTS FOR "HVHZ" ZONES. SEE THE DESIGN PRESSURE CHART BELOW.
- DOORS AND SIDELITES REQUIRE MIAMI-DADE APPROVED IMPACT RESISTANT SHUTTERS.
- SIDELITES ARE AN OPTION AND CAN BE USED IN A SINGLE OR DOUBLE CONFIGURATION.
- A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

### RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

#### DOOR LEAF CONSTRUCTION:

**Face sheets:** 24 ga. (0.020") minimum thickness, Galvanized Steel A-525 commercial quality - AKDQ per ASTM 620 with average minimum yield strength  $F_y(\text{ave.}) = 47,575$  psi.

**Core design:** Expanded polystyrene with 1.0 to 1.25 lbs./cf density, by JELD-WEN, INC.

**Door Panel Construction:** The active and inactive panels are constructed from 24GA. (0.020" min.) galvanized steel. The face sheet tops and bottoms are bent 90° over the top and bottom rails. The top rail consists of LVL measuring 1.67" x 1.0" high. The bottom rail is rolled formed 0.021" galvanized steel measuring 1.67" wide x 1.21" high w/ a 1.645" x 3" long x 0.831" piece of pressed fiber board in the corners of the steel bottom which is butted to the side stiles & secured w/ (1) 0.5" x 2" wire staple at each corner. The sides of the face sheet are roll formed onto the LVL latch stile and Ponderosa Pine hinge stile which measure 1.67" x 1.0". The interior cavity is filled with polystyrene. The face sheets are glued to the polystyrene. The panels are routed to receive the ODL & Trinity Lite Frames. The lite frames are wet glazed on the interior. The units are glazed w/ 0.125" tempered glass.

**Fixed Sidelite Panel Const.:** The sash is constructed from 24GA. (0.020" min.) galvanized steel. The edges of the face sheet are bent 90° over the polystyrene core and glued to it. The sidelite panels are routed to receive the ODL & Trinity Lite Frames. The lite frames are wet glazed on the interior and exterior. The units are glazed w/ 0.125" tempered glass.

**Frame Construction:** The frames are constructed from Ponderosa Pine jambs measuring 1.25" wide x 4.563" deep. The head jambs are mortised and butt joined to the side jambs and attached with (3) 16GA. 2" x 7/16" crown wire staples. The units use an aluminum bump face Pemko threshold measuring 4.041" deep x 1" high. The threshold is attached to the frame with (3) 16GA. 2" x 7/16" crown wire staples.

### TABLE OF CONTENTS

SHT #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATIONS
2	VERTICAL CROSS SECTIONS AND BILL OF MATERIALS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS AND NOTES
5	ANCHORING LOCATIONS AND DETAILS
6	ANCHORING LOCATIONS AND DETAILS
7	GLAZING DETAILS
8	UNIT COMPONENTS

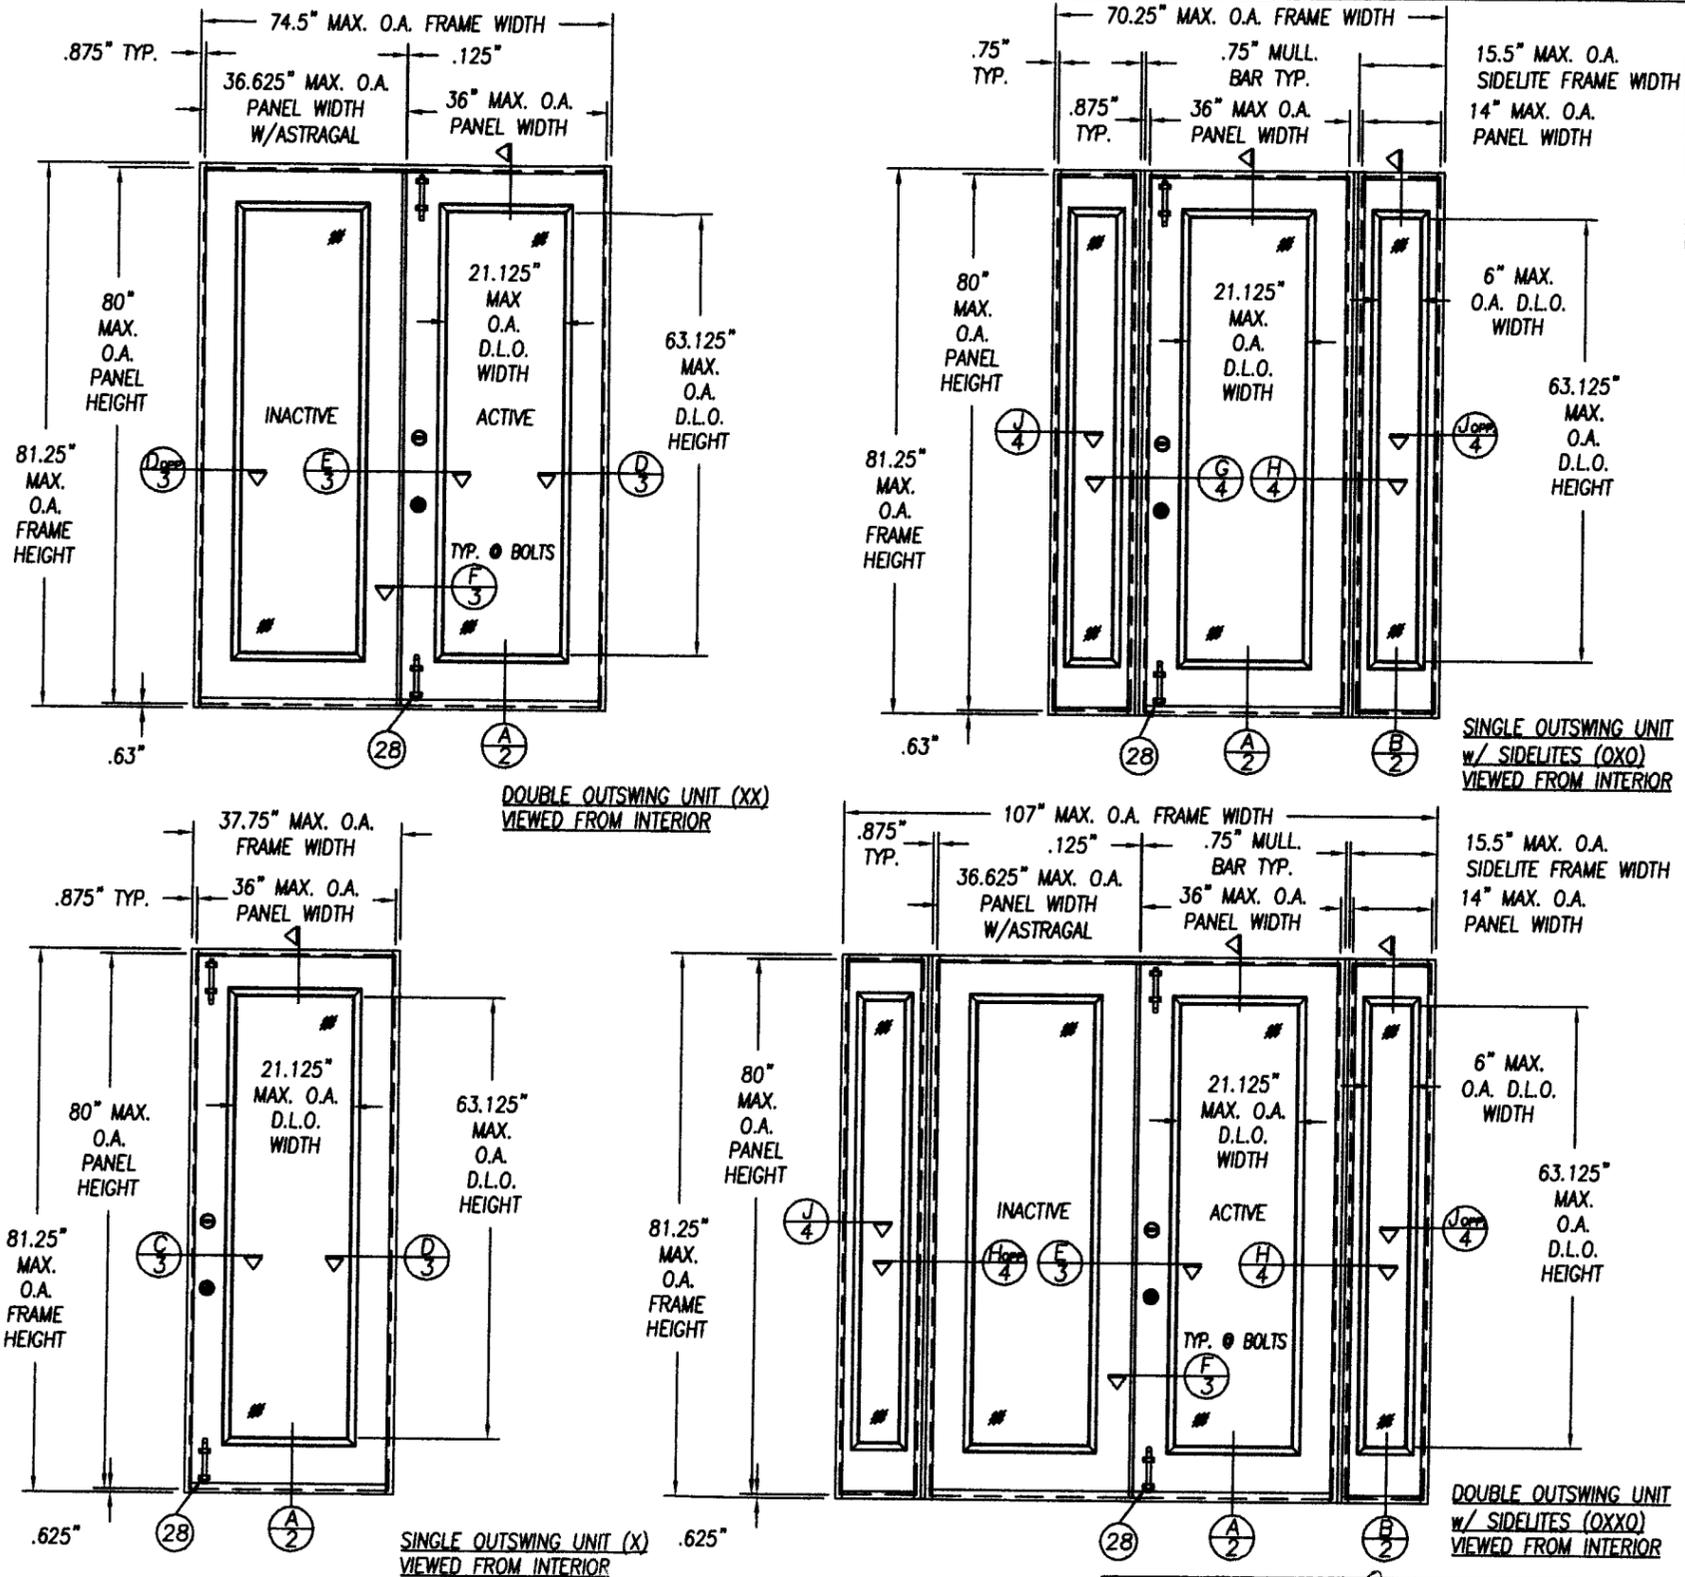


TABLE 1:

DESIGN PRESSURE RATING WHERE WATER INFILTRATION REQUIREMENT IS NEEDED		
UNIT TYPE	WITH SURFACE BOLTS	WITH OUT SURFACE BOLTS
SINGLE W/WO SIDELITES (X, OX, XO, OXO)	+65 psf -65 psf	+50 psf -50 psf
DOUBLE W/WO SIDELITES (XX, OXX, XXO, OXXO)	N/A	+50 psf -50 psf

*Eric S. Nielsen*  
Eric S. Nielsen  
Florida P. E. No. 41323  
PTC, LLC  
1535 Cogswell Street, Suite C25  
Rockledge, Florida 32955  
FBPE Certificate of Authorization NO. 25935

Prepared By:  
**PTC**  
PTC, LLC  
Phone: 321-690-1788  
Fax: 321-690-1789


PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 07-0731.01  
Expiration Date 08/15/2012  
By *[Signature]*  
Miami Dade Product Control  
Division

JELD-WEN, INC.  
3737 LAKEPORT BLVD.  
KLAMATH FALLS, OR. 97601  
PH. 541.882.3451


PRODUCT: WOOD EDGE GLAZED STEEL OUTSWING  
DOOR UP TO 9'-0" x 6'-8"  
WITH & WITHOUT SIDELITES  
PART OR ASSEMBLY:  
GENERAL NOTES AND  
TYPICAL ELEVATIONS

DATE	REVISION	BY
10/01/07	AS REQUESTED BY MIAMI-DADE	CB
06/26/07	MODIFIED TO MEET THE 2004 FBC	JWJ
10/22/02	ADDED TRINITY FRAME	ZRK
03/15/02	GENERAL REVISION	TJH
		BY

DATE: 12-13-01  
SCALE: NTS  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2105  
SHEET 1 OF 8

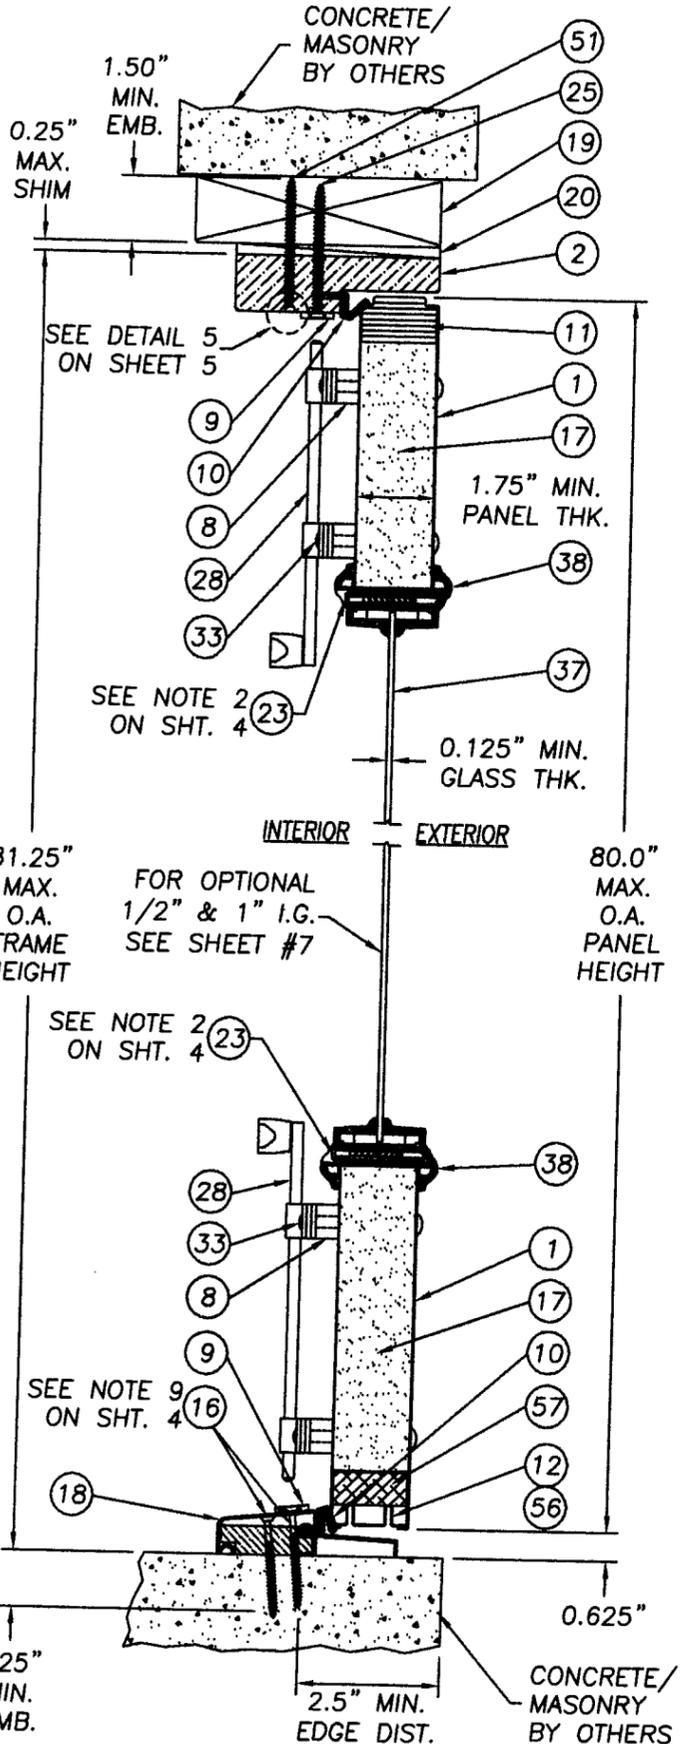

(A) VERTICAL CROSS SECTION WITH BUMP THRESHOLD

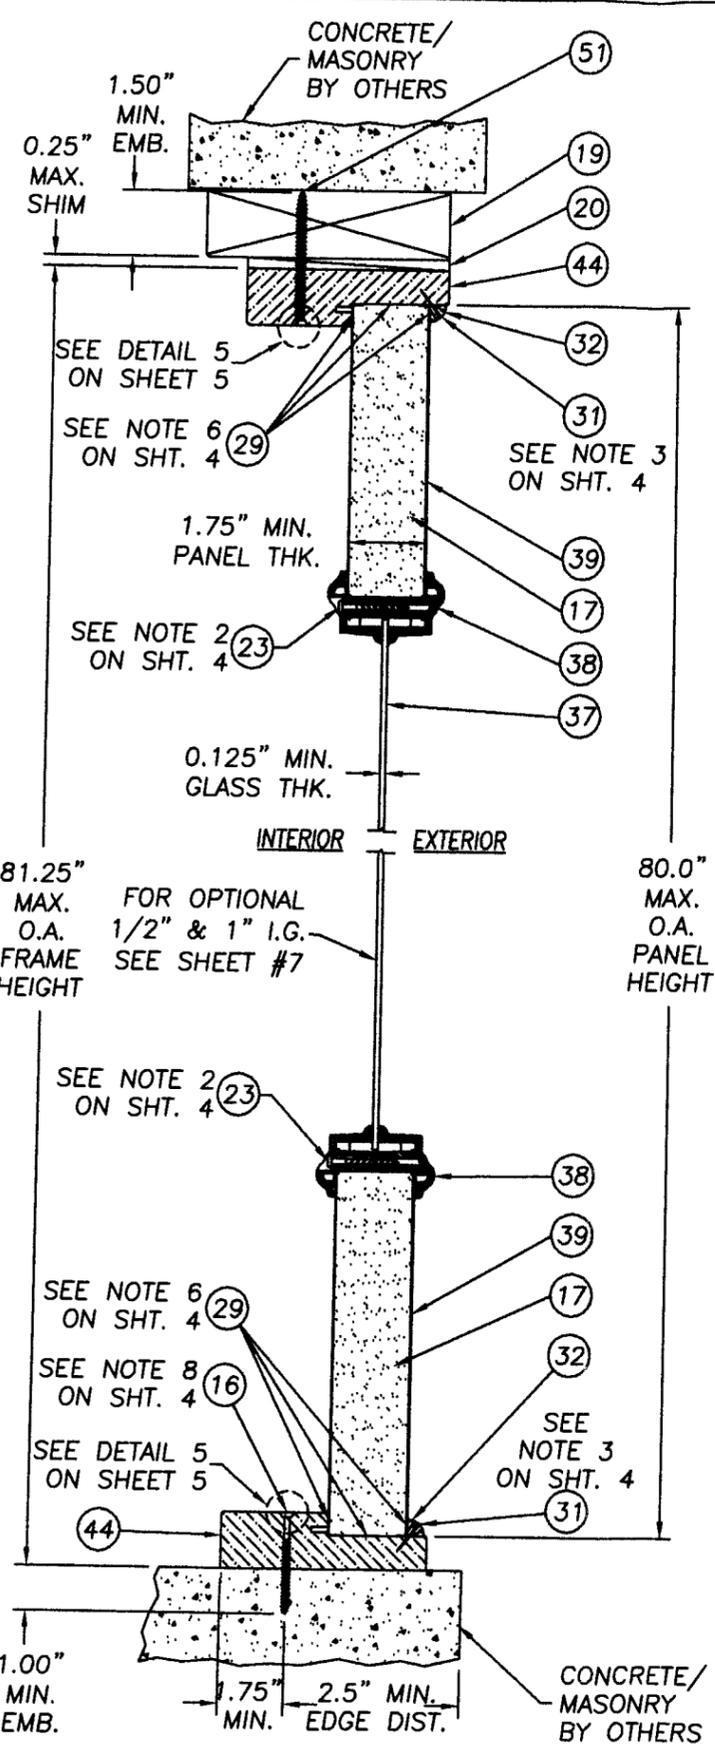

(B) VERTICAL CROSS SECTION AT SIDELITE SASH

ITEM	DESCRIPTION	MATERIAL
1	DOOR STEEL FACE SHEET 24GA. (0.020" MIN.)	STEEL
2	FRAME HEAD (FINGER JOINTED PONDEROSA PINE)	WOOD
3	FRAME HINGE JAMB (FINGER JOINTED PONDEROSA PINE)	WOOD
4	FRAME LATCH JAMB (FINGER JOINTED PONDEROSA PINE)	WOOD
5	4" x 4" BUTT HINGE 12ga. (BY HAGER)	STEEL
6	#9 x 1" PFH WOOD SCREW (HINGE TO DOOR)	STEEL
7	DOOR LATCH STILE	LVL
8	SURFACE BOLT SPACER (BY IVES)	PLASTIC
9	SURFACE BOLT STRIKE PLATE (BY IVES)	STEEL
10	COMPRESSION WEATHERSTRIP	FOAM
11	DOOR TOP RAIL	LVL
12	DOOR BOTTOM RAIL	STEEL
13	DOOR HINGE STILE	WOOD
14	#10 x 1.75" PFH WOOD SCREW	STEEL
15	LOCK BLOCK (FINGER JOINTED PONDEROSA PINE)	WOOD
16	3/16" ITW TAPCON ANCHOR W/ 1.25" MIN. EMBED.	STEEL
17	EXPANDED POLYSTYRENE (1.0 to 1.25 lb./cf DENSITY) BY JELD-WEN	FOAM
18	OUTSWING BUMP FACE THRESHOLD (BY PEMKO)	ALUMINUM
19	2x WOOD SUB BUCK	WOOD
20	SHIM (0.25" MAX. THK. HIGH DENSITY PLASTIC OR GREATER)	-
21	KWIKSET 400 SERIES KNOB	STEEL
22	KWIKSET TITAN 700 SERIES DEADBOLT (NOT SHOWN)	STEEL
23	#8 x 1.50" PLASCREW (ODL LITE FRAME)	STEEL
24	#8 x 2" PFH WOOD SCREW	STEEL
25	#8 x 2.50" PFH WOOD SCREW	STEEL
26	#10 x 1" PFH WOOD SCREW	STEEL
27	#10 x 2" PFH WOOD SCREW	STEEL
28	SURFACE BOLT (BY IVES)	STEEL
29	SILICONE CAULK (CR LAWRENCE 33 C)	SILICONE
30	GLAZING COMPOUND (QSD BY ODL)	SILICONE
31	BRAD TRIM NAIL 16GA. x .75" LONG	STEEL
32	3/8" QUARTER ROUND SIDELITE STOP	WOOD
33	.25"-20 SEX BOLT W/ .25"-20 FEMALE END x 1.75" LONG	STEEL
34	SCHLAGE KNOB SET #F51	STEEL
35	SCHLAGE DEADBOLT #B360	STEEL
36	SIDELITE STEEL FACE SHEET 24GA. (0.020" MIN. STEEL)	STEEL
37	1/8" TEMPERED GLASS (BY PPG)	GLASS
38	ODL LITE FRAME S.G. (SPARTECH POLYCOM PP5530 C13)	POLYPROP.
39	PRESSURE TREATED MULLION BAR (.75" x 4.5625" x 81.25")	P.T. WOOD
40	ALUMINUM EXTRUDED ASTRAGAL (BY IMPERIAL)	ALUMINUM
41	ASTRAGAL STRIKE PLATE (BY IMPERIAL)	STEEL
42	YALE KNOB HERITAGE SERIES	STEEL
43	YALE DEADBOLT HERITAGE SERIES (NOT SHOWN)	STEEL
44	SIDELITE FRAME HEAD, SILL AND JAMBS (FINGER JOINTED PONDEROSA PINE)	WOOD
45	LITE FRAME BY TRINITY FOR .50" I.G.U.	POLYPROP.
46	1/2" INSULATED TEMPERED GLASS (BY TRINITY/AMPAC)	GLASS
47	LITE FRAME BY TRINITY FOR 1" GLASS	POLYPROP.
48	1" INSULATED TEMPERED GLASS (BY TRINITY/AMPAC)	GLASS
49	LITE FRAME SCREW #6 x 1.50" LONG PANHEAD (BY TRINITY)	STEEL
50	GLAZING COMPOUND DOW 1199	SILICONE
51	#10 WOOD INSTALLATION SCREW W/ 1.50" MIN. EMBEDMENT	STEEL
52	DOOR LATCH STRIKE PLATE	STEEL
53	DOOR LATCH DEAD BOLT STRIKE PLATE	STEEL
54	1" INSULATED TEMPERED GLASS (BY PPG)	GLASS
55	ODL LITE FRAME 1" I.G. (SPARTECH POLYCOM PP5530 C13)	POLYPROP.
56	OPTIONAL DOOR BOTTOM RAIL	WOOD
57	CORNER BLOCKS	MDF
58	MULLION CAP (81.25" LONG)	WOOD
59	BRAD TRIM NAIL 16GA. x 1" LONG	STEEL

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 07-073.01  
 Expiration Date 08/15/2012  
 By: *[Signature]*  
 Miami Dade Product Control  
 Division

**JELD-WEN, INC.**  
 3737 LAKEPORT BLVD.  
 KLAMATH FALLS, OR. 97601  
 PH. 541.882.3451




PRODUCT: WOOD EDGE GLAZED OUTSWING  
 STEEL DOOR UP TO 9'-0" x 6'-8"  
 WITH & WITHOUT SIDELITES  
 PART OR ASSEMBLY:  
 VERTICAL CROSS SECTIONS  
 AND BILL OF MATERIALS

DATE	BY	REVISIONS
D 10/01/07	CB	AS REQUESTED BY MIAMI-DADE
C 06/26/07	JMJ	MODIFIED TO MEET THE 2004 FBC
B 10/22/02	ZRK	ADDED TRINITY FRAME
A 03/15/02	TJH	GENERAL REVISION
		REVISIONS

DATE: 12-13-01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2105  
 SHEET 2 OF 8

*[Signature]*  
 Eric S. Nielsen  
 Florida P. E. No. 41323  
 PTC, LLC  
 1535 Cogswell Street, Suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935

Prepared By:  
**PTC**  
 PTC, LLC  
 Phone: 321-690-1788  
 Fax: 321-690-1789

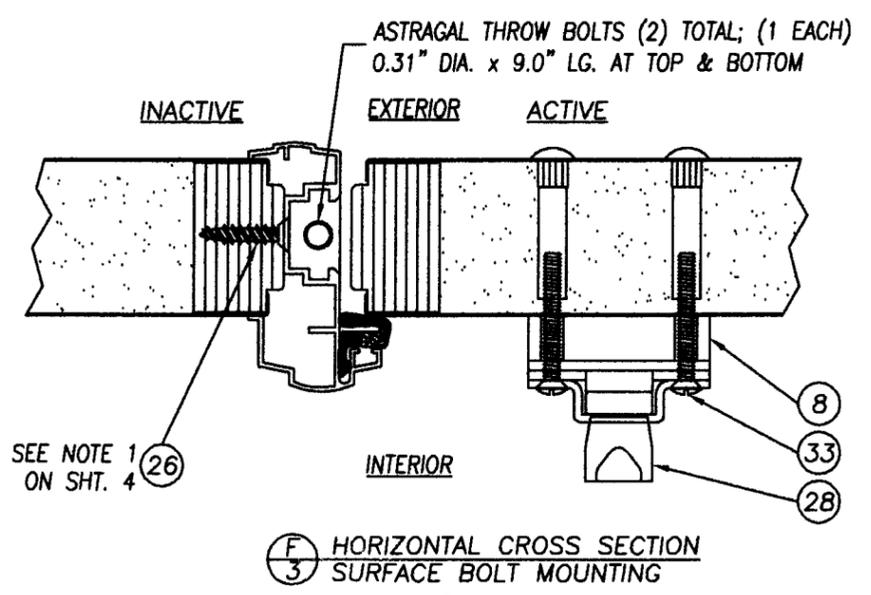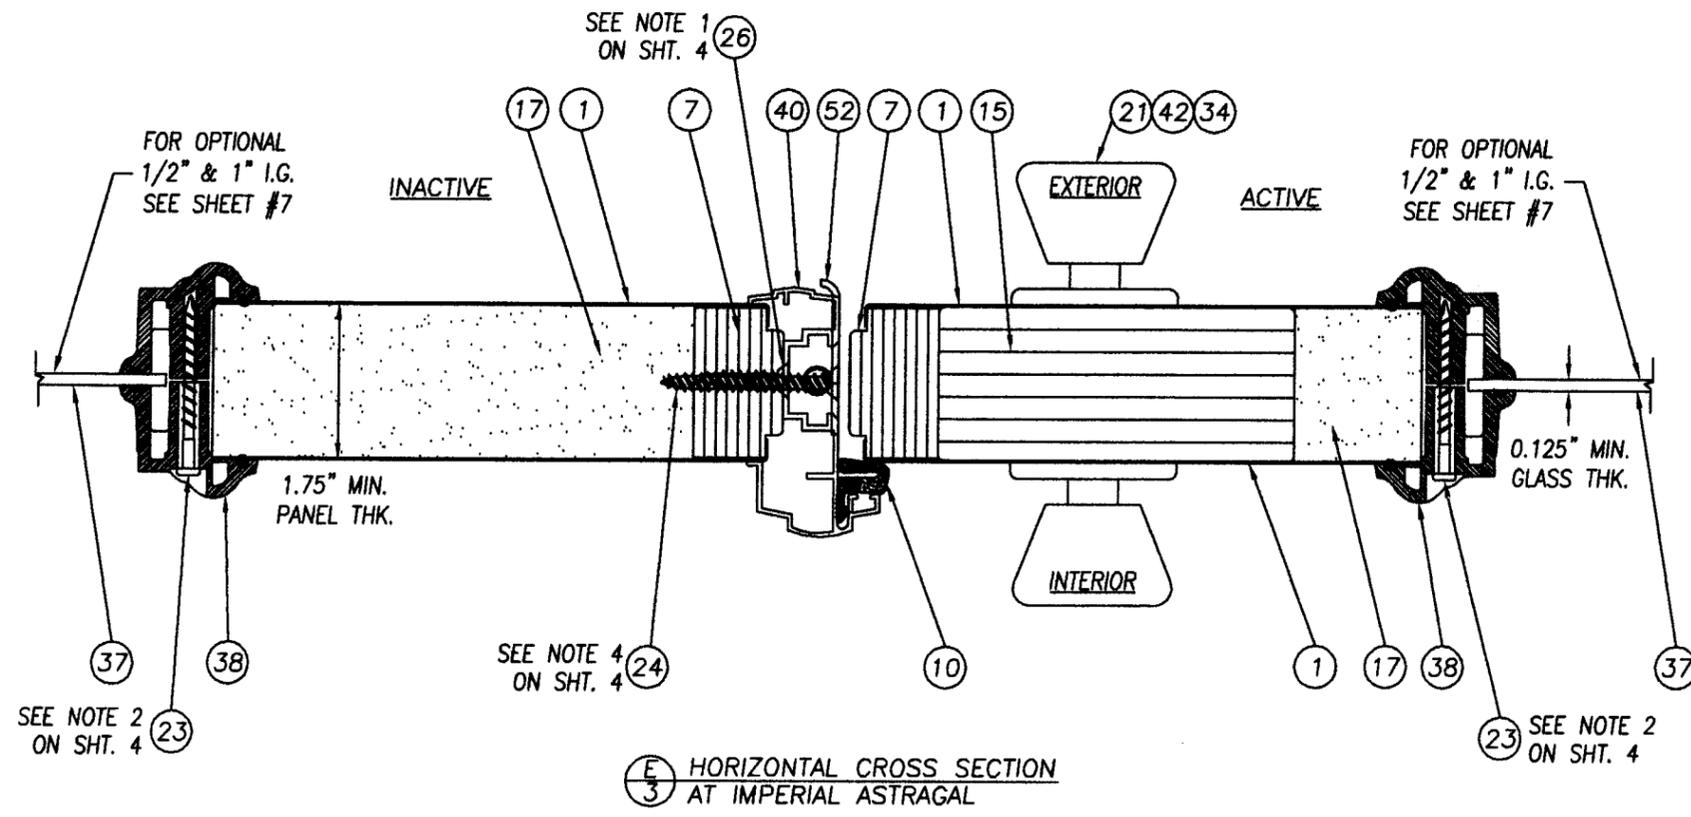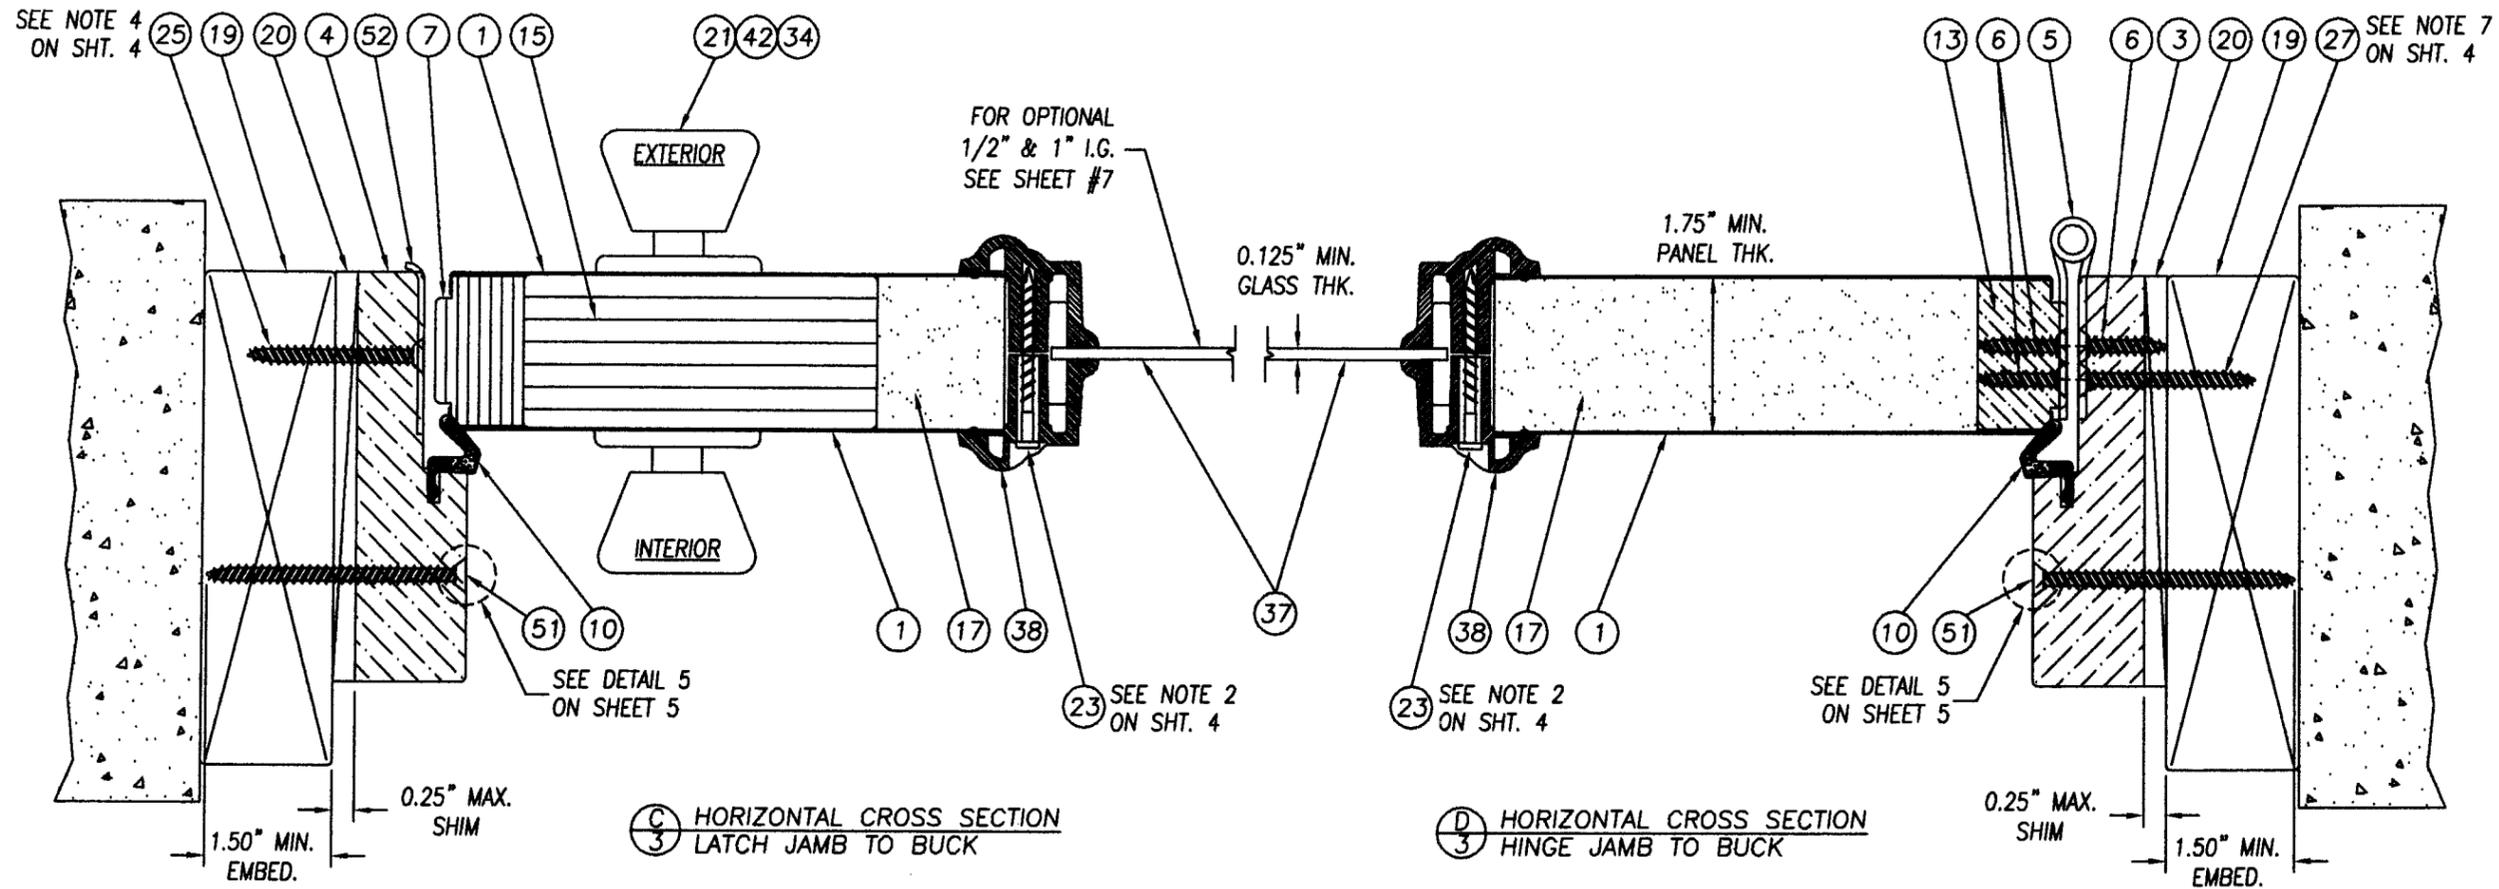

PRODUCT REVISED as complying with the Florida Building Code  
 Acceptance No. 07-0731-01  
 Expiration Date 08/15/2012  
 By: *[Signature]*  
 Miami Dade Product Control Division

JELD-WEN, INC.  
 3737 LAKEPORT BLVD.  
 KLAMATH FALLS, OR. 97601  
 PH. 541.882.3451

PRODUCT: WOOD EDGE GLAZED STEEL OUTSWING DOOR UP TO 9'-0" x 6'-8" WITH & WITHOUT SIDELITES  
 PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS

#	DATE	REVISIONS	BY
D 10/01/07		AS REQUESTED BY MIAMI-DADE	CB
C 05/26/07		MODIFIED TO MEET THE 2004 FBC	JWJ
B 10/22/02		ADDED TRINITY FRAME	ZRK
A 03/15/02		GENERAL REVISION	TJH

*[Signature]*  
 Eric S. Nielsen  
 Florida P. E. No. 41323  
 PTC, LLC  
 1535 Cogswell Street, Suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935

Prepared By:  
**PTC**  
 PTC, LLC  
 Phone: 321-690-1788  
 Fax: 321-690-1789

DATE: 12-13-01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2105  
 SHEET 3 OF 8


PRODUCT REVISED as complying with the Florida Building Code  
 Acceptance No. 07-0731-01  
 Expiration Date 08/15/2012  
 By *[Signature]*  
 Miami-Dade Product Control Division

**JELD-WEN, INC.**  
 3737 LAKEPORT BLVD.  
 KLAMATH FALLS, OR. 97601  
 PH. 541.882.3451


PRODUCT: WOOD EDGE GLAZED STEEL OUTSWING DOOR UP TO 9'-0" x 6'-8" WITH & WITHOUT SIDELITES  
 PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS AND NOTES

DATE	REVISIONS	BY
D 10/01/07	AS REQUESTED BY MIAMI-DADE	CB
C 06/26/07	MODIFIED TO MEET THE 2004 FBC	JWU
B 10/22/02	ADDED TRINITY FRAME	ZRK
A 03/15/02	GENERAL REVISION	TJH

DATE: 12-13-01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2105  
 SHEET 4 OF 8

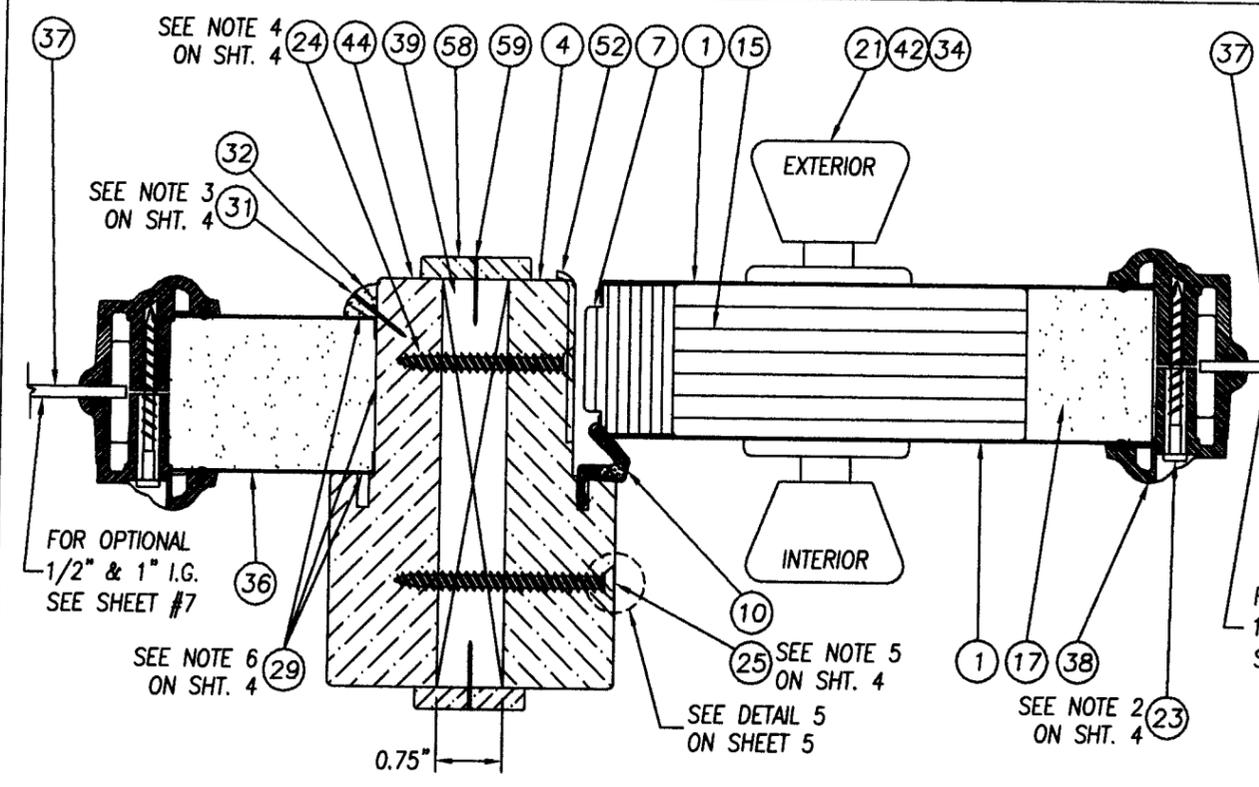


**G** HORIZONTAL CROSS SECTION AT SIDELITE TO LATCH JAMB

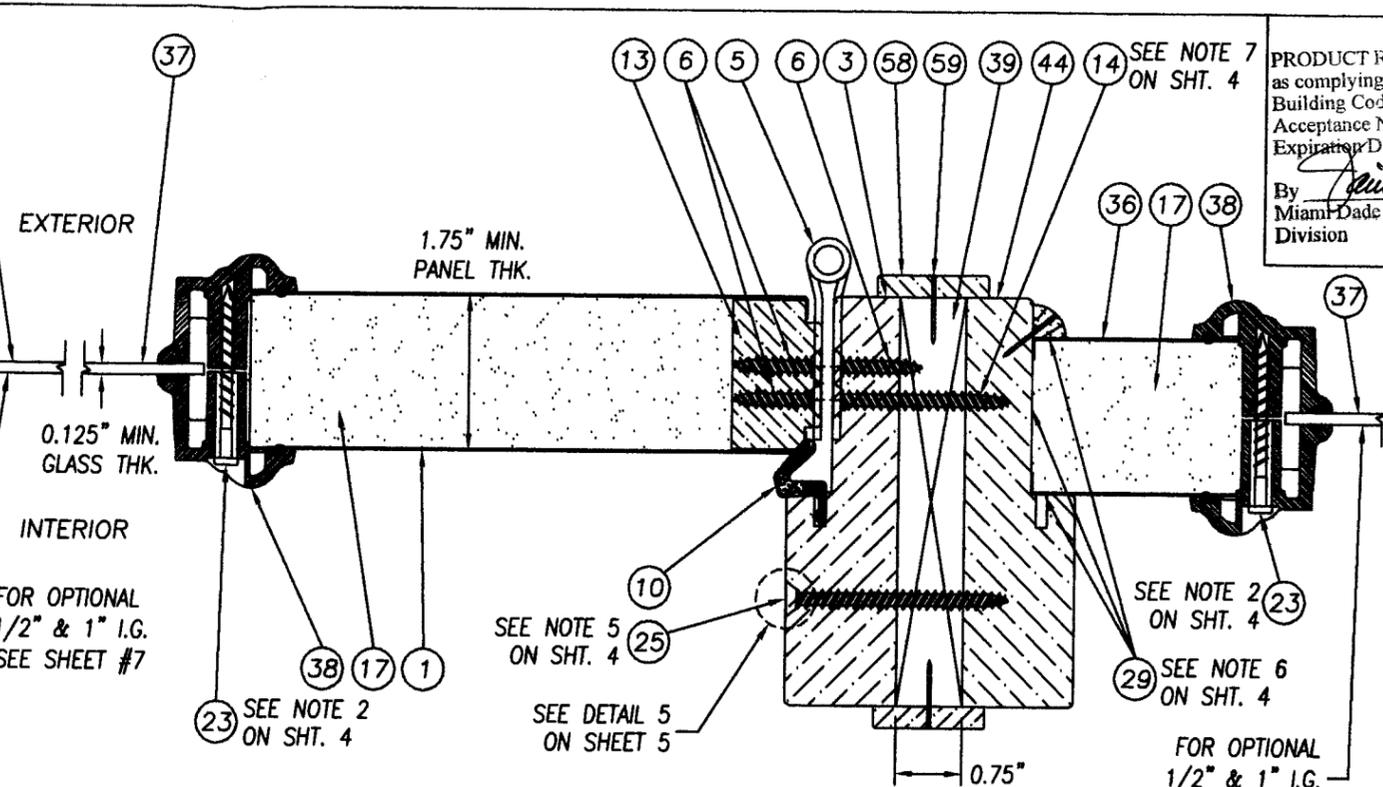

**H** HORIZONTAL CROSS SECTION AT SIDELITE TO HINGE JAMB

**NOTES:**

- SPACING FOR ITEM #26 THE #10 x 1" PFH SCREWS ATTACHING THE IMPERIAL ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS:  
 FROM THE TOP DOWN & THE BOTTOM UP: 1.0", 2.5", 4.0", 5.5", 13.0", 18.0" & 26.0".
- SPACING FOR ITEM #23 THE #8 x 1 1/2" PLASCREW IS AS FOLLOWS:  
 TOP & BOTTOM, HORIZONTALLY, FOR BOTH DOOR & SIDELITE PANELS: 3.0" IN FROM EACH CORNER, ONE IN CENTER. ON THE SIDES, VERTICALLY, FOR BOTH DOOR & SIDELITE PANELS: 3.0", 13.0", 26.0", 39.0", 52.0", & 63.0".
- SPACING FOR ITEM #31, THE 16GA. x 3/4" BRAD TRIM NAIL ATTACHING THE 3/8" QUARTER ROUND TO THE SIDELITE & ITEM #59, THE 16GA. x 1" BRAD TRIM NAIL ATTACHING THE MULLION CAP TO THE MULLION IS AS FOLLOWS:  
 TOP & BOTTOM HORIZONTALLY (FOR 3/8" QUARTER ROUND): 1.25" IN FROM EACH CORNER WITH (1) NAIL MID-SPAN. ON THE SIDES VERTICALLY: 1.25" FROM EACH END & SIX MORE EQUALLY SPACED ON THE FIELD.
- WHEN ATTACHING THE STRIKE PLATE TO THE JAMB AND BUCK USE ITEM #25, A #8 x 2 1/2" PFH WOOD SCREW. WHEN ATTACHING THE STRIKE PLATE TO THE JAMB AND SIDELITE JAMB AT THE MULLION USE ITEM #24, A #8 x 2" PFH WOOD SCREW.
- SPACING FOR ITEM #25 THE #8 x 2 1/2" PFH WOOD SCREWS ATTACHING THE JAMBS TOGETHER AT THE MULLION, IS AS FOLLOWS: 6.0" FROM EACH VERTICAL CORNER WITH (4) MORE SCREWS EQUALLY SPACED ON THE FIELD.
- THE SIDELITE PANEL IS SECURED INTO THE SIDELITE JAMB W/ ITEM #29 SILICONE CAULK ON THREE SIDES AND 3/8" QUARTER ROUNDS SECURED WITH ITEM #31 BRAD TRIM NAILS x 3/4" LONG.
- WHEN ATTACHING THE HINGE TO THE JAMB AND BUCK USE ITEM #27, A #10 x 2" PFH SCREW. WHEN ATTACHING THE HINGE TO THE JAMB AND SIDELITE JAMB AT THE MULLION USE ITEM #14, A #10 x 1 3/4" PFH WOOD SCREW.
- SPACING FOR ITEM #49 THE #6 x 1 1/2" PANHEAD SCREW (TRINITY LITEFRAME) IS AS FOLLOWS:  
 DOOR LITEFRAME FROM THE TOP DOWN VERTICALLY: 3.25", 10.625", 18.0625", 25.4375", 32.8125", 40.1875", 47.625", 55.0" & 62.375".  
 DOOR LITEFRAME TOP & BOTTOM, FROM RIGHT TO LEFT: 3.25", 11.875" & 20.375".  
 SIDELITE LITEFRAME FROM THE TOP DOWN VERTICALLY: 3.25", 18.0625", 32.8125", 47.5625" & 62.625".  
 SIDELITE LITEFRAME TOP & BOTTOM, FROM THE LEFT: (1) AT 4.4375".
- ALTERNATE CONCRETE/MASONRY INSTALLATION ANCHORS OF EQUIVALENT PERFORMANCE CHARACTERISTICS CAN BE USED UPON APPROVAL OF THE ARCHITECT OR ENGINEER OF RECORD FOR THE PROJECT OF INSTALLATION.
- USE ITEM #51 WHEN INSTALLING INTO WOOD SUBSTRATE AT HEAD & JAMBS. USE ITEM #25 WHEN INSTALLING INTO MULLIONS. USE ITEM # 16 WHEN INSTALLING INTO CONCRETE/MASONRY SUBSTRATE AT SIDELITE SILLS.

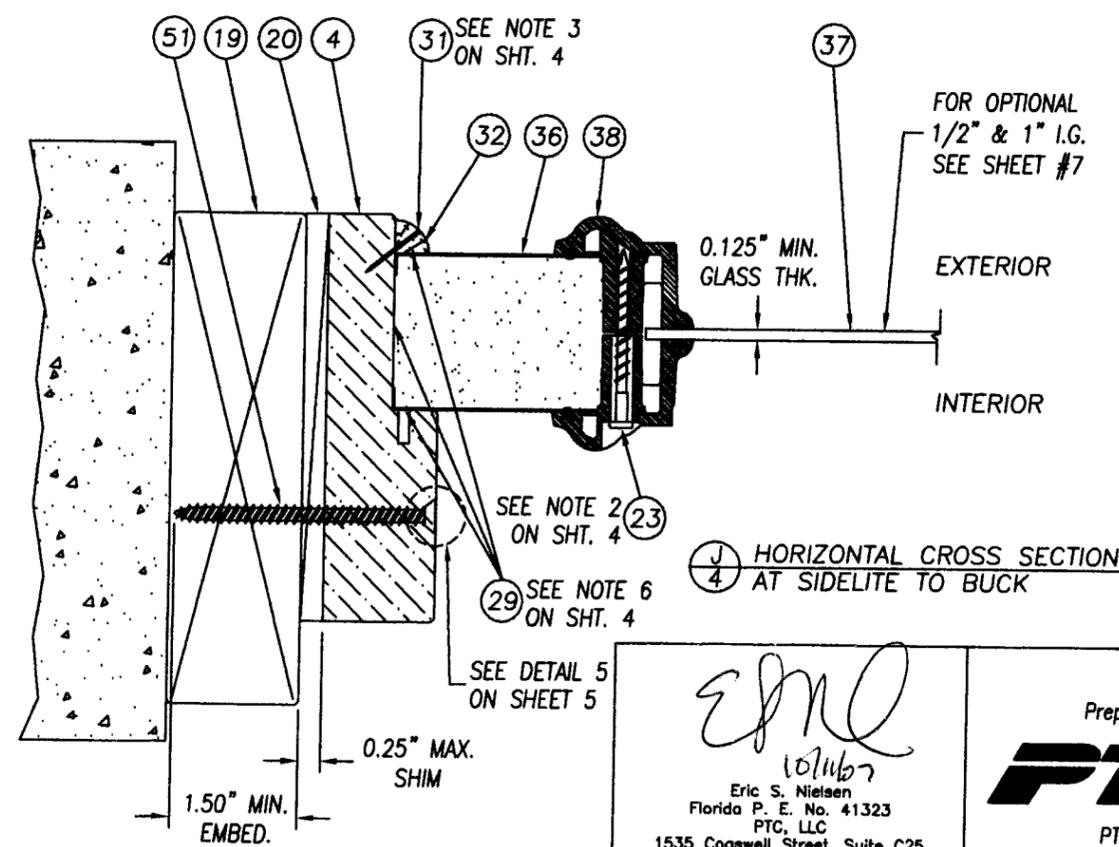

**J** HORIZONTAL CROSS SECTION AT SIDELITE TO BUCK

*[Signature]*  
 Eric S. Nielsen  
 Florida P. E. No. 41323  
 PTC, LLC  
 1535 Cogswell Street, Suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25035

Prepared By:  
**PTC**  
 PTC, LLC  
 Phone: 321-690-1788  
 Fax: 321-690-1789








PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 07-0731.01  
 Expiration Date 08/15/2012  
 By *[Signature]*  
 Miami-Dade Product Control  
 Division

**JELD-WEN, INC.**  
 3737 LAKEPORT BLVD.  
 KLAMATH FALLS, OR. 97601  
 PH. 541.882.3451

PRODUCT: WOOD EDGE GLAZED STEEL OUTSWING  
 DOOR UP TO 9'-0" x 6'-8"  
 WITH & WITHOUT SIDELITES  
 PART OR ASSEMBLY:  
 ANCHORING LOCATIONS  
 AND DETAILS

#	DATE	REVISIONS	BY
D 10/01/07		AS REQUESTED BY MIAMI-DADE	CB
C 06/26/07		MODIFIED TO MEET THE 2004 FBC	JMW
B 10/22/02		ADDED TRINITY FRAME	ZRK
A 03/15/02		GENERAL REVISION	TJH

DATE: 12-13-01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2105  
 SHEET 5 OF 8

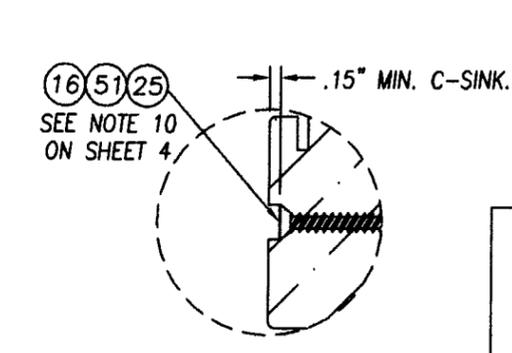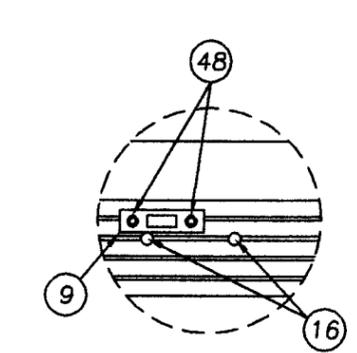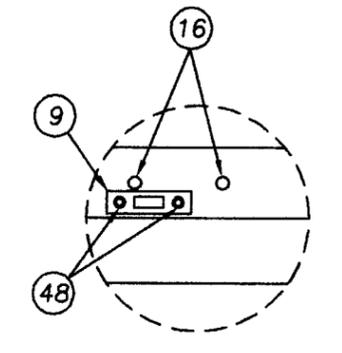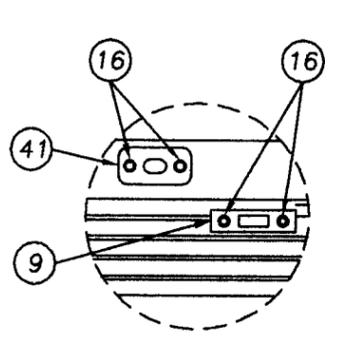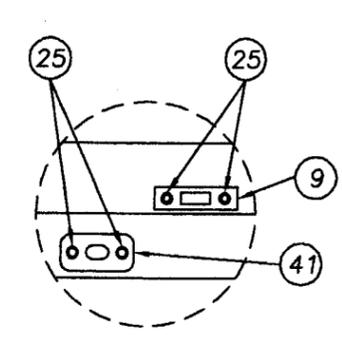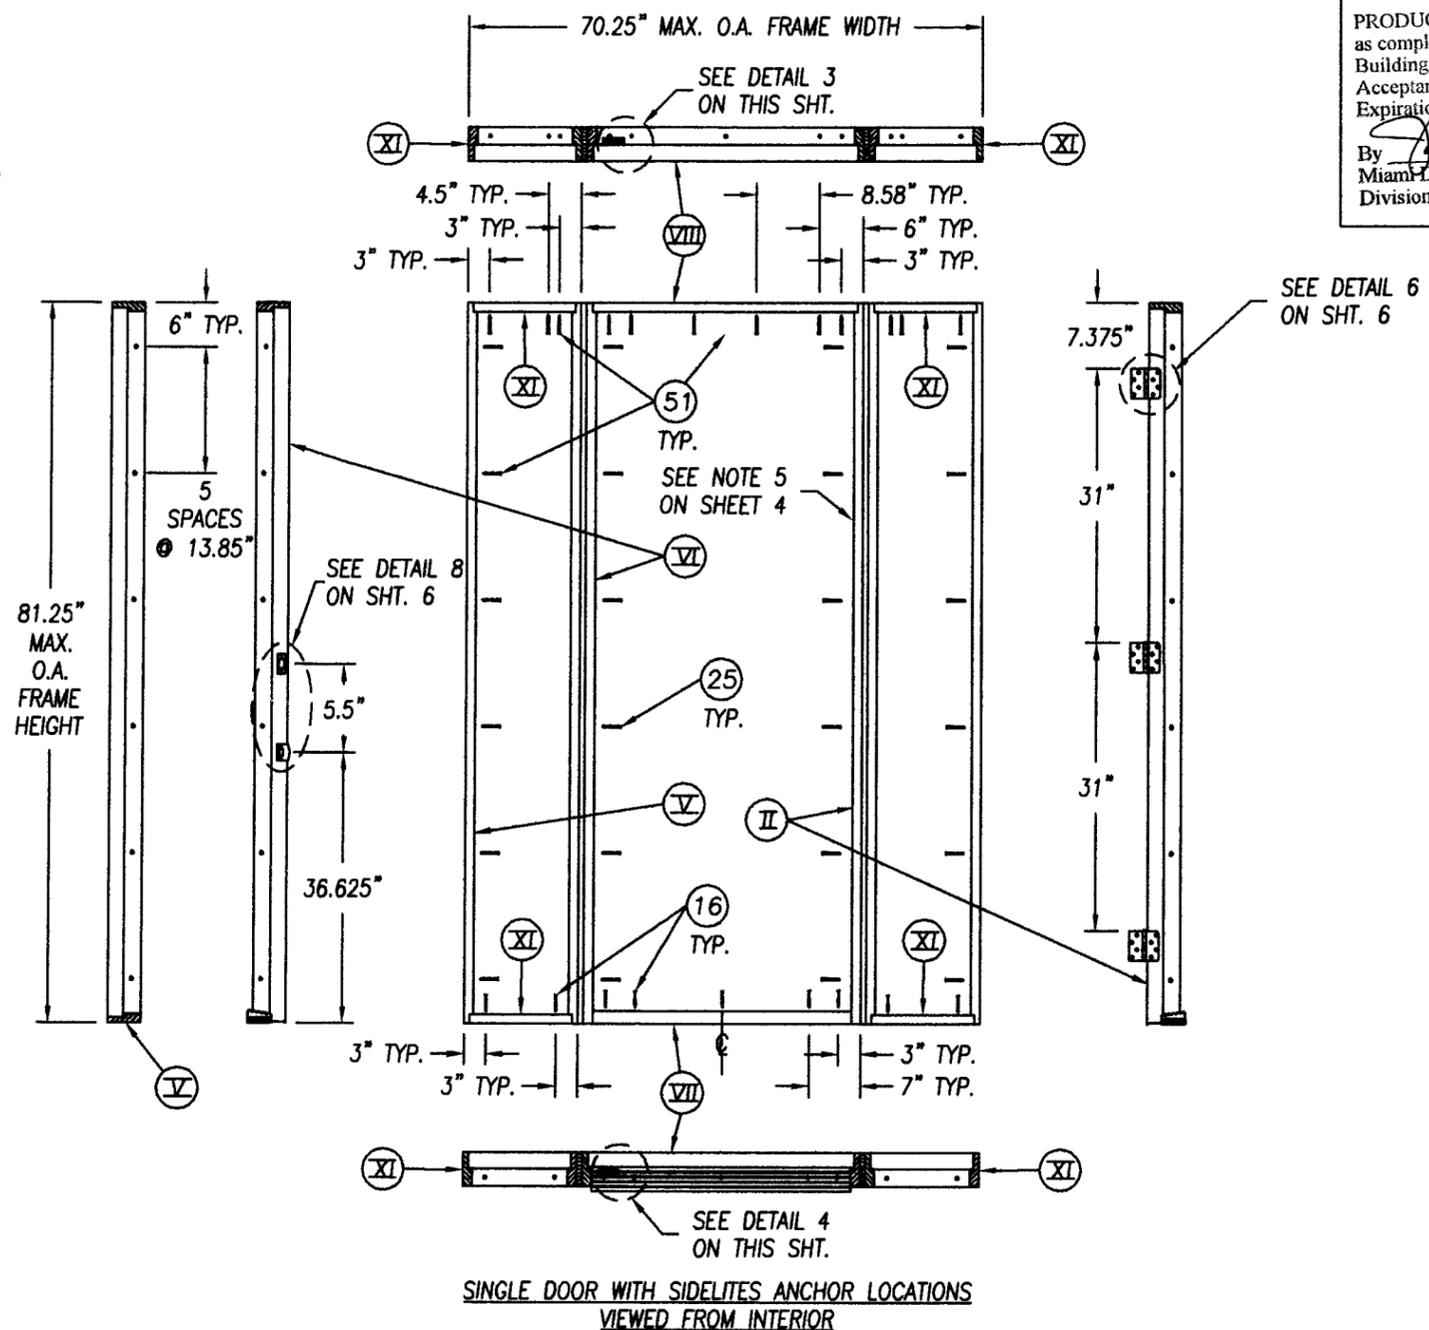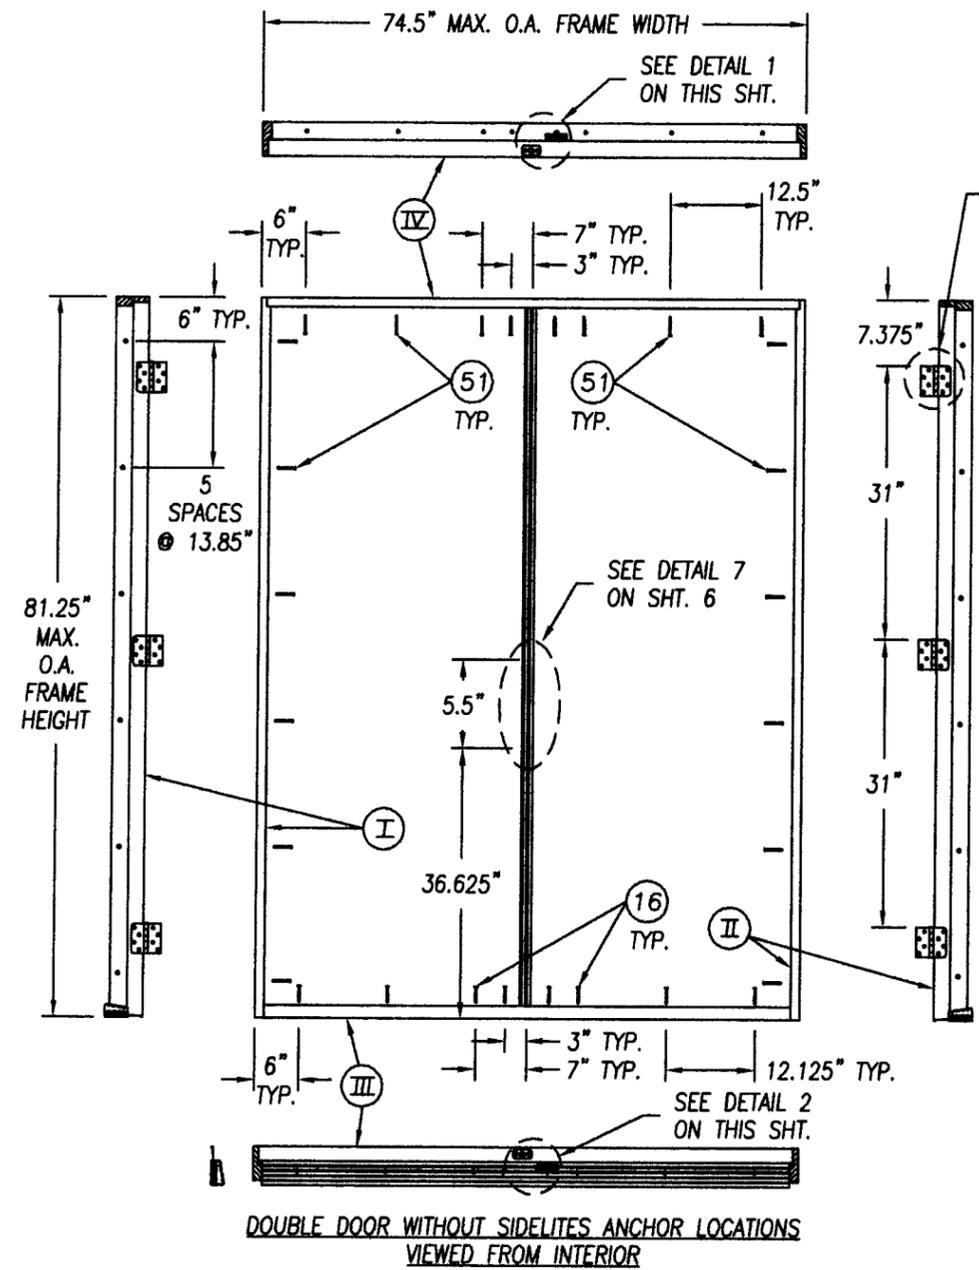

*[Signature]*  
 Eric S. Nielsen  
 Florida P. E. No. 41323  
 PTC, LLC  
 1535 Cogswell Street, Suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935

Prepared By:  
**PTC**  
 PTC, LLC  
 Phone: 321-690-1788  
 Fax: 321-690-1789




PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No 07-0731.01  
 Expiration Date 08/15/2012  
 By *[Signature]*  
 Miami Dade Product Control  
 Division

**JELD-WEN, INC.**  
 3737 LAKEPORT BLVD.  
 KLAMATH FALLS, OR. 97601  
 PH. 541.882.3451


PRODUCT: WOOD EDGE GLAZED STEEL OUTSWING  
 DOOR UP TO 9'-0" x 6'-8"  
 WITH & WITHOUT SIDELITES  
 PART OR ASSEMBLY: GLAZING DETAILS

DATE	REVISIONS	BY
D 10/01/07	AS REQUESTED BY MIAMI-DADE	CB
C 06/26/07	MODIFIED TO MEET THE 2004 FBC	JWJ
B 10/22/02	ADDED TRINITY FRAME	ZRK
A 03/15/02	GENERAL REVISION	TJH


DATE:	12-13-01
SCALE:	N.T.S.
DWG. BY:	WLN
CHK. BY:	RW
DRAWING NO.:	S-2105
SHEET	7 OF 8

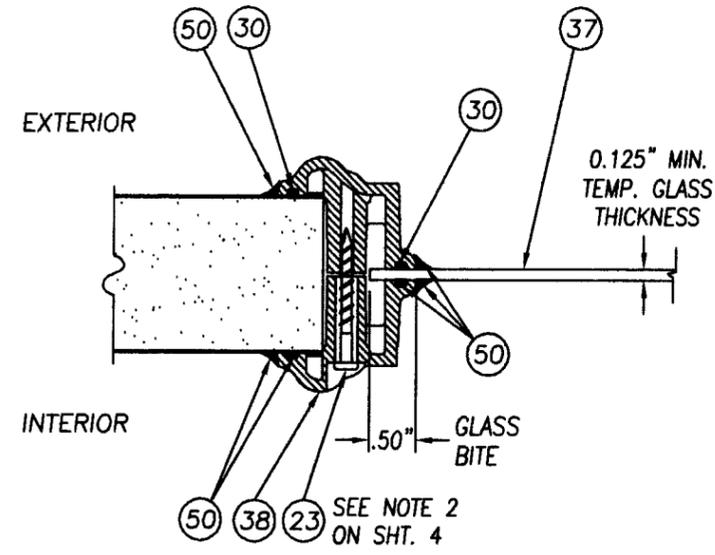


38 GLAZING DETAIL ODL LITE FRAME  
 SINGLE PANE 1/8" TEMPERED GLASS  
 W/ 1/2" MIN. GLASS BITE  
 SPARTECH  
 POLYCOM PP 5530 C13

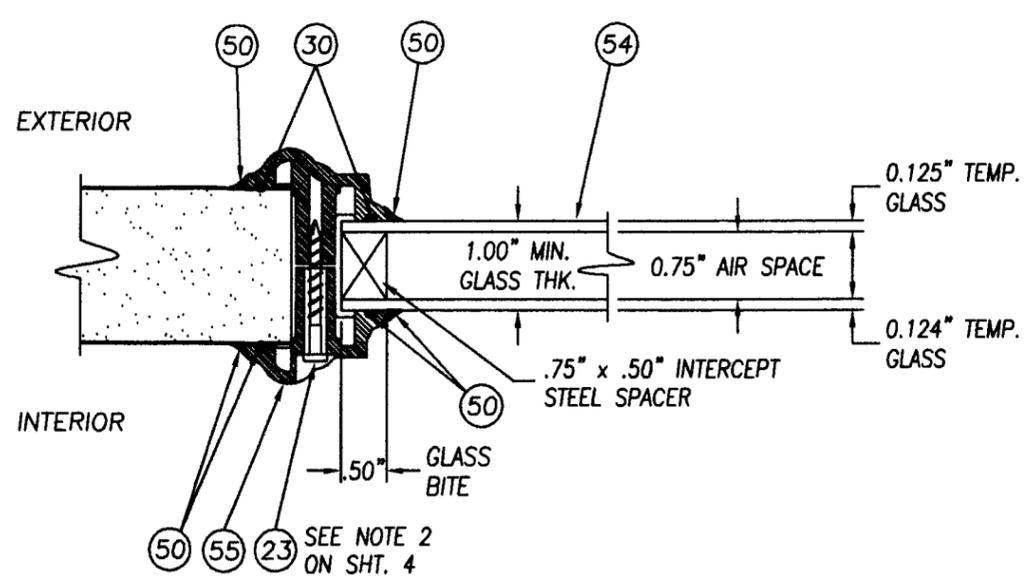

55 GLAZING DETAIL ODL LITE FRAME 1"  
 I.G.U. W/ 1/8" TEMPERED GLASS  
 W/ 1/2" MIN. GLASS BITE  
 SPARTECH  
 POLYCOM PP 5530 C13

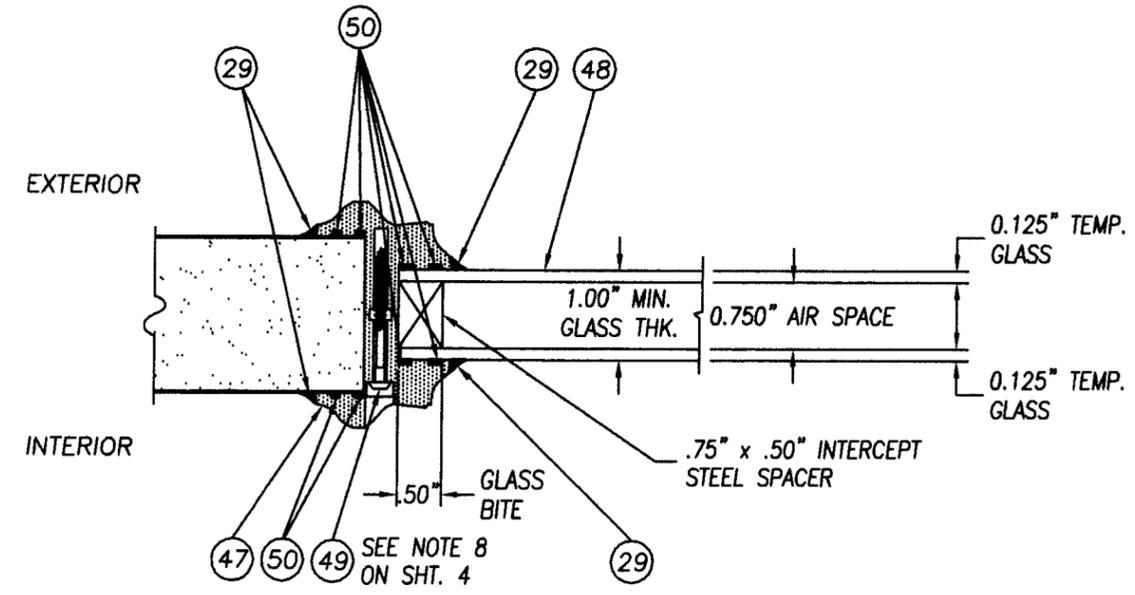


47 GLAZING DETAIL TRINITY LITE FRAME  
 1" INSULATED TEMPERED GLASS  
 W/ 1/2" MIN. GLASS BITE  
 LUPOY EU-5007

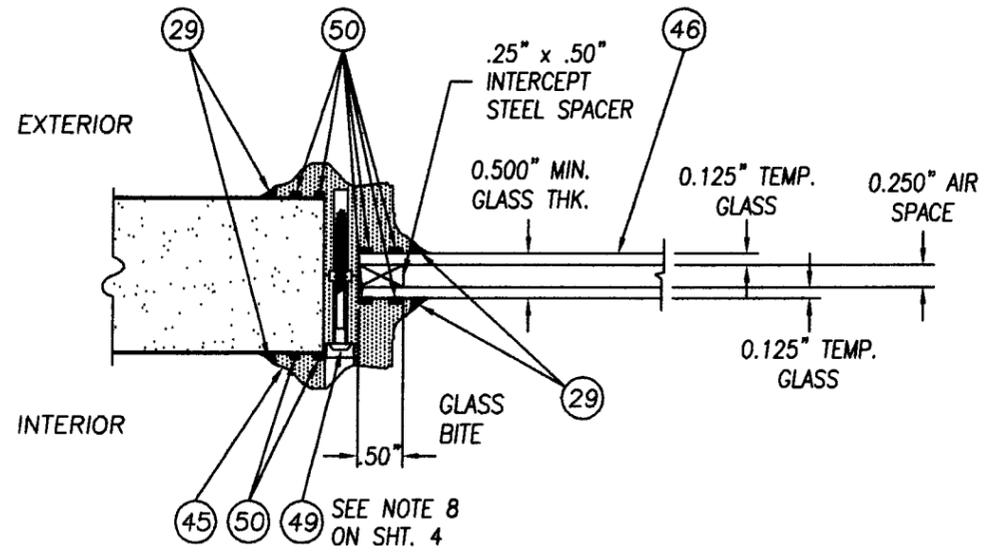




45 GLAZING DETAIL TRINITY LITE FRAME  
 1/2" INSULATED TEMPERED GLASS  
 W/ 1/2" MIN. GLASS BITE  
 LUPOY EU-5007

*[Signature]*  
 Eric S. Nielsen  
 Florida P. E. No. 41323  
 PTC, LLC  
 1535 Cogswell Street, Suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25935

Prepared By:  
**PTC**  
 PTC, LLC  
 Phone: 321-690-1788  
 Fax: 321-690-1789

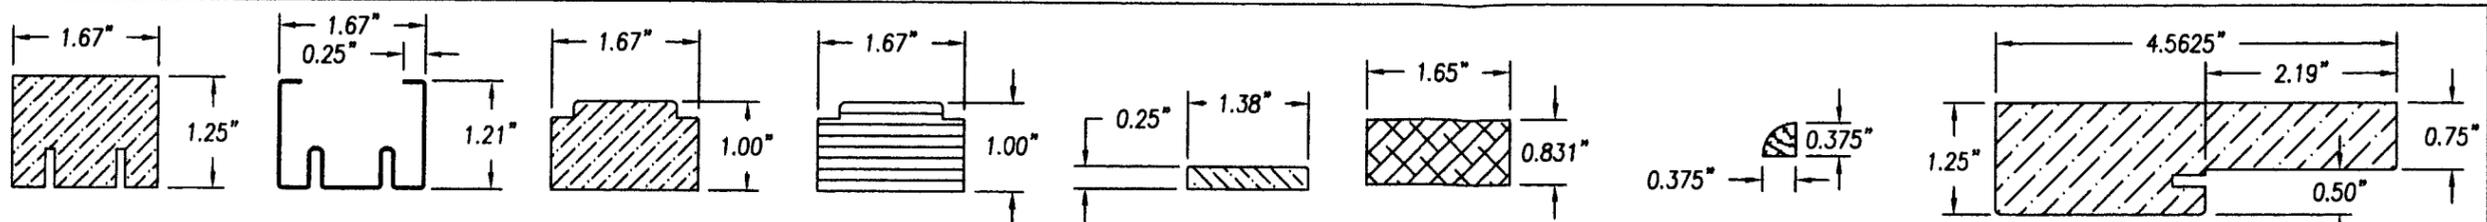

PRODUCT REVISED as complying with the Florida Building Code  
 Acceptance No. 07-0731.01  
 Expiration Date 08/15/2012  
 By: *[Signature]*  
 Miami-Dade Product Control Division

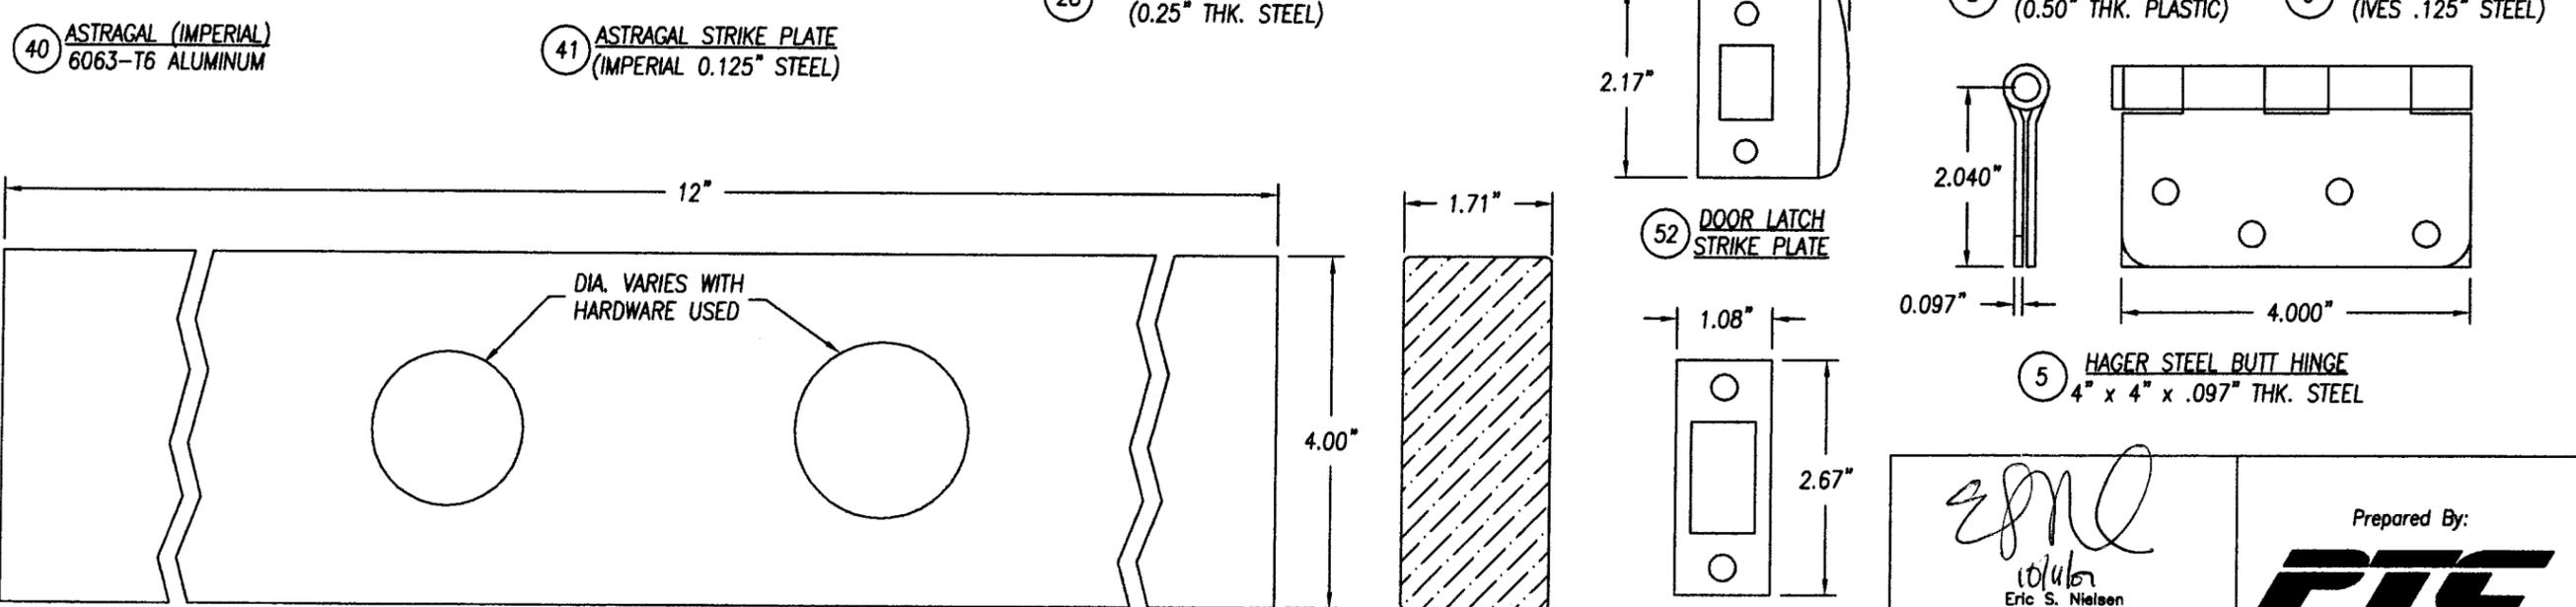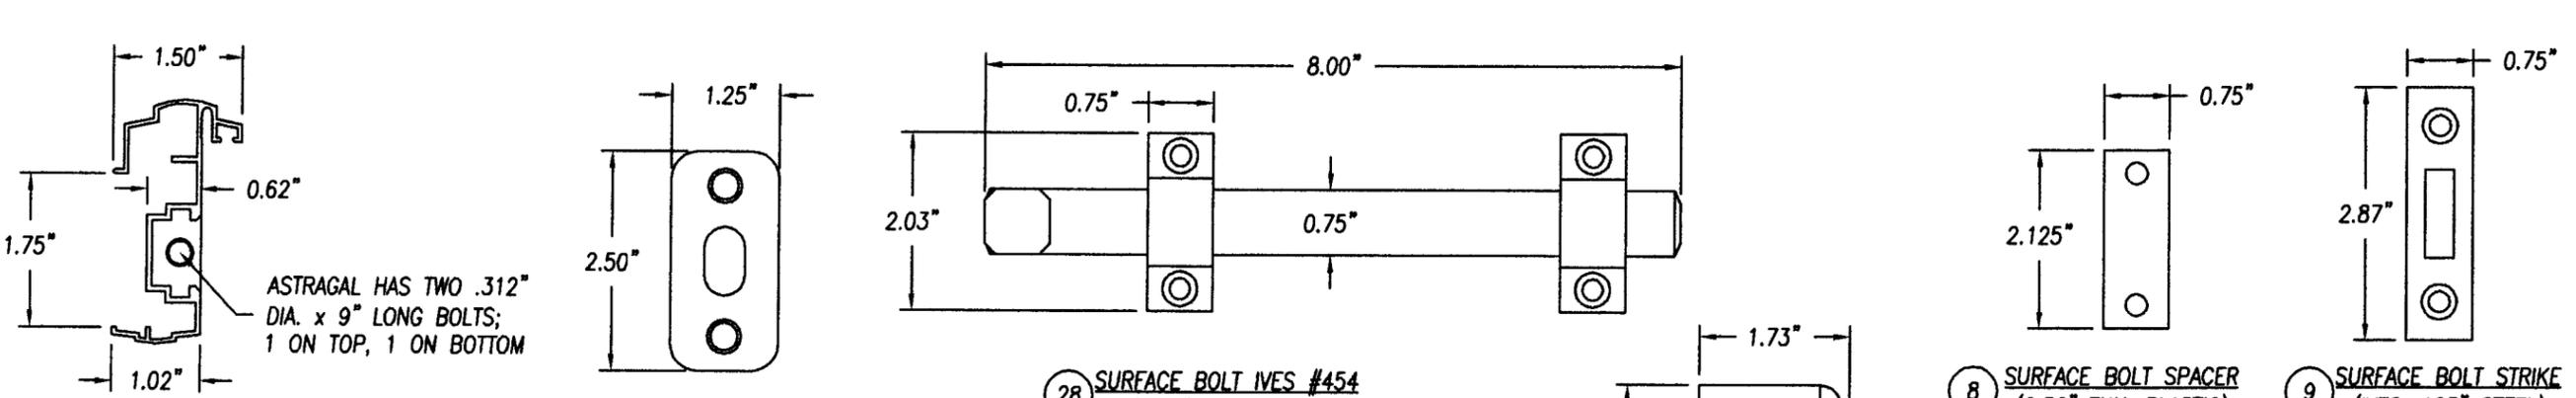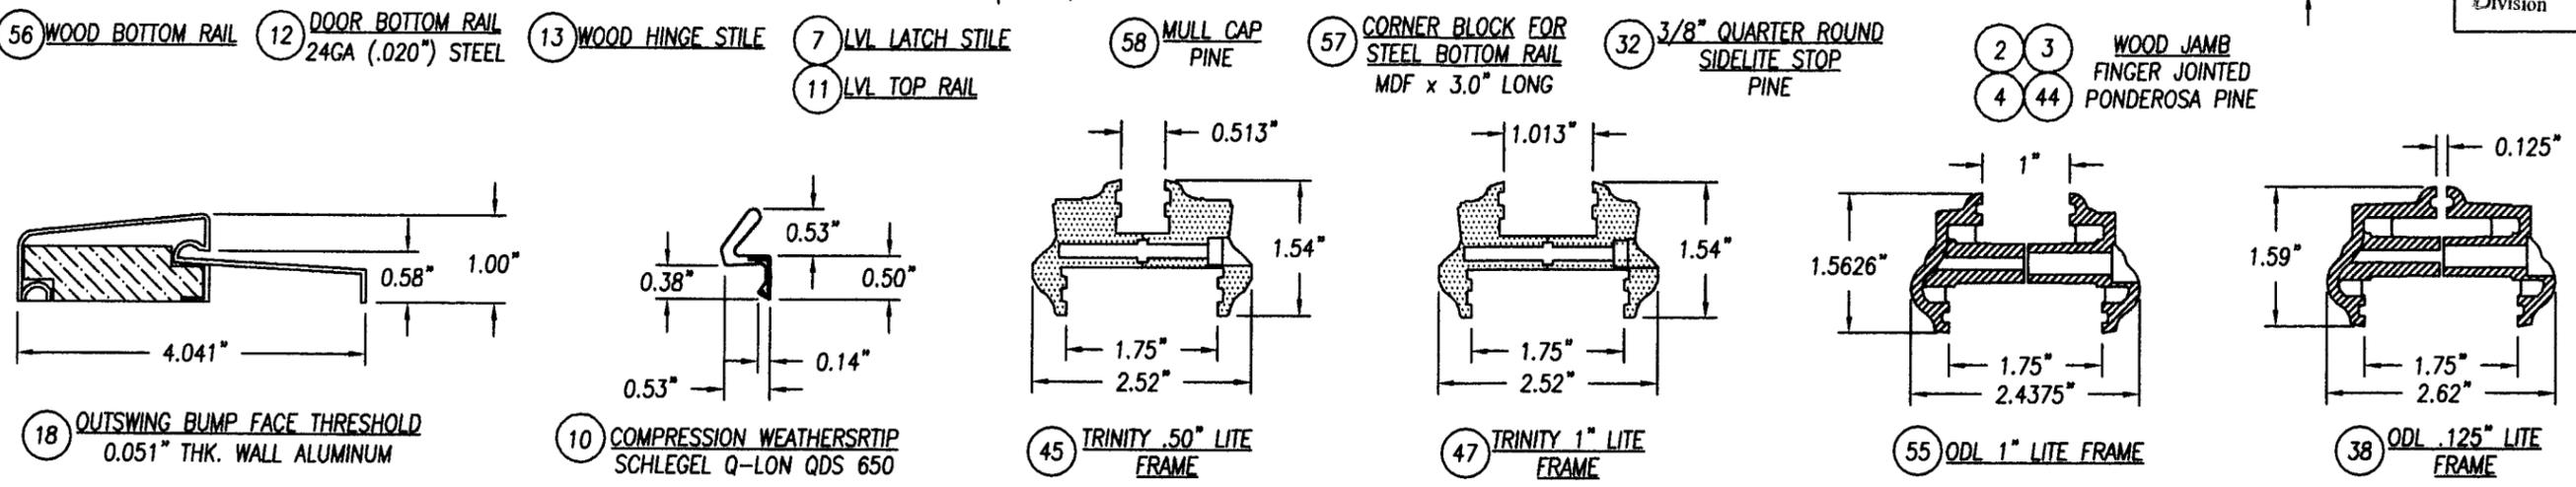

JELD-WEN, INC.  
 3737 LAKEPORT BLVD.  
 KLAMATH FALLS, OR 97601  
 PH. 541.882.3451

PRODUCT: WOOD EDGE GLAZED STEEL OUTSWING DOOR UP TO 9'-0" x 6'-8" WITH & WITHOUT SIDELITES  
 PART OR ASSEMBLY:  
 UNIT COMPONENTS

REV	DATE	BY	REVISIONS
D	10/01/07	CB	AS REQUESTED BY MIAMI-DADE
C	06/26/07	JMW	MODIFIED TO MEET THE 2004 FBC
B	10/22/02	ZRK	ADDED TRINITY FRAME
A	03/15/02	TJH	GENERAL REVISION

*[Signature]*  
 Eric S. Nielsen  
 Florida P. E. No. 41323  
 PTC, LLC  
 1535 Cogswell Street, Suite C25  
 Rockledge, Florida 32955  
 FBPE Certificate of Authorization NO. 25835

Prepared By:  
**PTC**  
 PTC, LLC  
 Phone: 321-690-1788  
 Fax: 321-690-1789

DATE: 12-13-01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2105  
 SHEET 8 OF 8