



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

Jeld-Wen, Inc. (OR)
3737 Lakeport Boulevard
Klamath Falls, OR 97601

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 6'8" W/E Inswing Glazed Steel Door w/wo Sidelites-NI

APPROVAL DOCUMENT: Drawing No. S-2195, titled "Series Wood Edge Glazed Inswing Steel Door Units, Up to 5' -11" x 6' -8" with and without Sidelites", sheets 1 through 7 of 7, dated 12/14/2001 with revision D dated 07/06/2007, prepared by PTC, LLC, dated 07/19/2007, signed and sealed by Eric S. Nielsen, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

REVISION of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA renews NOA # 02-1211.16 and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P.E.**



J. Gascon
12/13/07

NOA No. 07-0731.03
Expiration Date: August 15, 2012
Approval Date: December 20, 2007
Page 1

Jeld-Wen, Inc. (OR)

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **S-2195**, titled "Series Wood Edge Glazed Inswing Steel Door Units, Up to 5'-11"x 6'-8" with and without Sidelites", sheets 1 through 7 of 7, dated 12/14/2001 with revision D dated 07/06/2007, prepared by PTC, LLC, dated 07/19/2007, signed and sealed by Eric S. Nielsen, P.E.

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per PA 202-94
 - 2) Uniform Static Air Pressure Test, Loading per PA 202-94
 - 3) Water Resistance Test, per PA 202-94
 - 4) Forced Entry Test, per PA 202-94along with marked-up drawings and installation diagram of Outswing and Inswing steel edge glazed steel door, prepared by Certified Testing Laboratories, Test Report No. **CTLA-697W**, date 11/11/2001, signed and sealed by Ramesh Patel, P.E.
(Submitted under NOA# 02-1211.16)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by PTC, LLC, dated 07/09/2007, signed and sealed by Eric S. Nielsen, P.E.
Complies with ASTM E 1300-02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. None

F. STATEMENTS

1. Statement letter of conformance, no financial interest and compliance, dated 07/16/2007 by PTC, LLC, signed and sealed by Eric S. Nielsen, P.E.
2. Laboratory addendum letter for Test Report no. **CTLA-697W**, issued by Certified Testing Laboratories, dated 04/11/2002, signed and sealed by Ramesh Patel, P.E.
(Submitted under NOA# 02-1211.16)
3. Laboratory compliance letter for Test Report no. **CTLA-697W**, issued by Certified Testing Laboratories, dated 11/11/2001, signed and sealed by Ramesh Patel, P.E.
(Submitted under NOA# 02-1211.16)

G. OTHER

1. Notice of Acceptance No. **02-1211.16**, issued to Jeld-Wen, Inc. (OR) for their Series "Inswing Glazed Wood Edge Door Units, Up to 5'-11"x 6'-8", approved on 01/30/2003 and expiring on 08/15/2007.



Jaime D. Gascon, P.E.
Chief, Product Control Division
NOA No. 07-0731.03

Expiration Date: August 15, 2012
Approval Date: December 20, 2007

JELD-WEN® Steel

6'-8" INSWING WOOD EDGE GLAZED STEEL DOOR
UNITS W/ & W/O SIDELITES

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 07-9731.03
Expiration Date 08/15/2012
By *[Signature]*
Miami-Dade Product Control
Division

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE 2004 FLORIDA BUILDING CODE (WITH 2005 & 2006 SUPPLEMENTS)
2. WOOD BUCKS BY OTHERS, MUST BE PROPERLY ANCHORED TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED PER ANCHOR LOCATION DRAWINGS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. SEE TABLE 1 ON THIS SHEET FOR DESIGN PRESSURE RATING.
5. THIS PRODUCT DOES NOT MEET THE WATER REQUIREMENTS FOR "HVHZ" ZONES WHEN USING THE SLOPED ADJUSTABLE ALUMINUM THRESHOLD. SEE THE DESIGN PRESSURE CHART BELOW.
6. DOOR & SIDELITES REQUIRE MIAMI-DADE APPROVED IMPACT RESISTANT SHUTTERS.
7. SIDELITES ARE AN OPTION.

RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

COMPONENT CONSTRUCTIONS:

Face sheets: 24 ga. (0.020") minimum thickness, Galvanized Steel A-525 commercial quality - AKDQ per ASTM 620 with an average minimum yield strength $F_y(\text{ave.}) = 47,575$ psi.

Core design: Expanded polystyrene with 1.0 to 1.25 lbs./cf density, by JELD-WEN, INC.


Door Panel Construction: The Door panels are constructed from 24GA. (0.020" min.) galvanized steel. The face sheet tops and bottoms are bent 90° over the top and bottom rails. The top rail consists of LVL measuring 1.67" x 1.0" high. The bottom rail is rolled formed 0.021" galvanized steel measuring 1.67" wide x 1.21" high w/ a 1.645" x 3" long x 0.831" piece of pressed fiber board in the corners of the steel bottom which is butted to the side stiles & secured w/ (1) 0.5" x 2" wire staple at each corner. The sides of the face sheet are roll formed onto the LVL latch stile and Ponderosa Pine hinge stile which measure 1.67" x 1.0". The interior cavity is filled with polystyrene. The face sheets are glued to the polystyrene. The panels are routed to receive the ODL & Trinity Lite Frames. The lite frames are wet glazed on the interior. The units are glazed w/ 0.125" tempered glass.

Fixed Sidelite Panel Const.: The sash is constructed from 24GA. (0.020" min.) galvanized steel. The edges of the face sheet are bent 90° over the polystyrene core and glued to it. The sidelite panels are routed to receive the ODL & Trinity Lite Frames. The lite frames are wet glazed on the interior and exterior. The units are glazed w/ 0.125" tempered glass. The lite frames are sealed w/ QSD flazing compound on the exterior.


Frame Construction: The frames are constructed from finger jointed Ponderosa Pine jambs measuring 1.25" wide x 4.5625" deep. The head jambs are mortised and butt joined to the side jambs and attached with (3) 16GA. 2" x 7/16" crown wire staples. The units used a sloped adjustable aluminum bump face threshold measuring 4.562" deep x 1.173" high. The threshold is attached to the frame with (3) 16GA. 2" x 7/16" crown wire staples.

TABLE OF CONTENTS

SHT #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATIONS
2	VERTICAL CROSS SECTIONS AND BILL OF MATERIALS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS AND NOTES
5	ANCHORING LOCATIONS AND DETAILS
6	GLAZING OPTION DETAILS
7	UNIT COMPONENTS

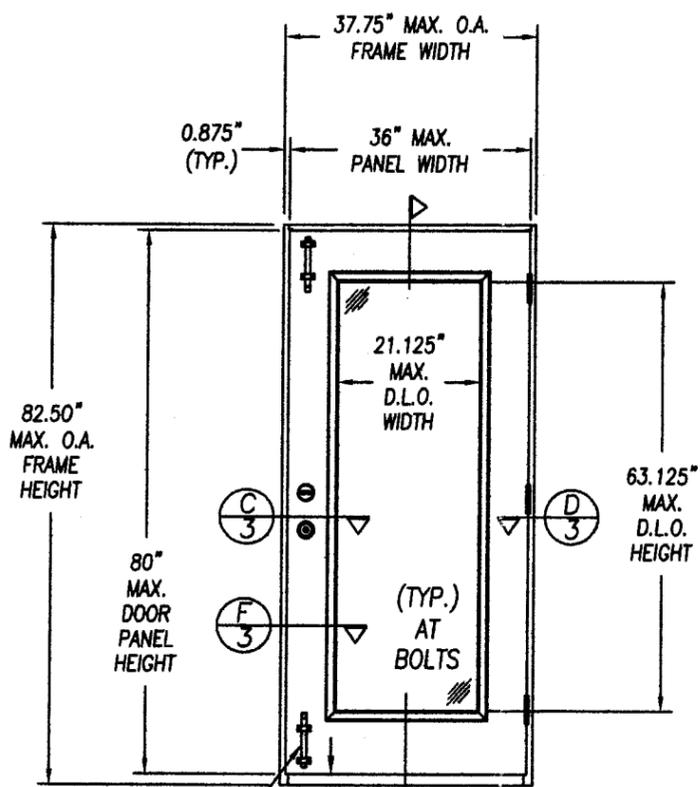

(TYP.) ON ALL DOORS.
MOUNT ON INTERIOR,
TOP AND BOTTOM.
7
SINGLE INSWING UNIT (X)
VIEWED FROM INTERIOR

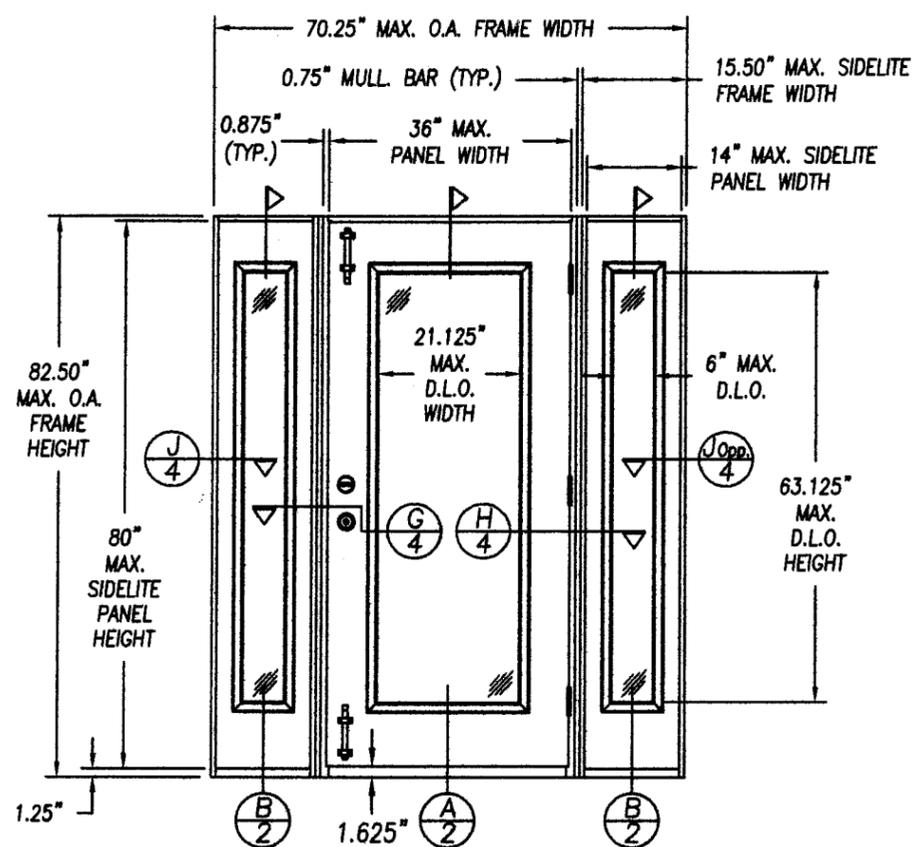

(TYP.) ON ALL DOORS.
MOUNT ON INTERIOR,
TOP AND BOTTOM.
SINGLE INSWING UNIT w/ SIDELITES (OXO)
VIEWED FROM INTERIOR

TABLE 1:

*DESIGN PRESSURE RATING WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED	W/ SURFACE BOLTS	W/O SURFACE BOLTS
	W/ ADJUSTABLE SILL	
SINGLE DOOR W/WO SIDELITES (X, OX, XO, OXO)	+65 psf -65 psf	+50 psf -50 psf

*CAN BE USED WHERE OVERHANG REQUIREMENTS MEET THE 2004 FBC SECTION R 4410.2.3.2.1

[Signature]
7/19/07
Eric S. Nielsen
Florida P. E. No. 41323
PTC, LLC
1535 Cogswell Street, Suite C25
Rockledge, Florida 32955
FBPE Certificate of Authorization NO. 25935


Prepared By:
PTC
PTC, LLC
Phone: 321-690-1788
Fax: 321-690-1789

DATE: 12/14/01
SCALE: N.T.S.
DWG. BY: JWJ
CHK. BY: S. SAFFELL
DRAWING NO.: S-2195
SHEET 1 OF 7

JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR. 97601
PH. 541.892.3451

PRODUCT: WOOD EDGE GLAZED INSWING STEEL DOOR, UP TO 5'-11" x 6'-8" WITH AND WITHOUT SIDELITES
PART OR ASSEMBLY:
GENERAL NOTES AND TYPICAL ELEVATIONS

#	DATE	REVISIONS	BY
D	7-06-07	MODIFIED TO MEET THE 2004 FBC	JWJ
C	10-22-02	ADDED TRINITY FRAME	ZRK
B	6-17-02	GENERAL REVISION	RW
A	3-15-02	GENERAL REVISION	TJH

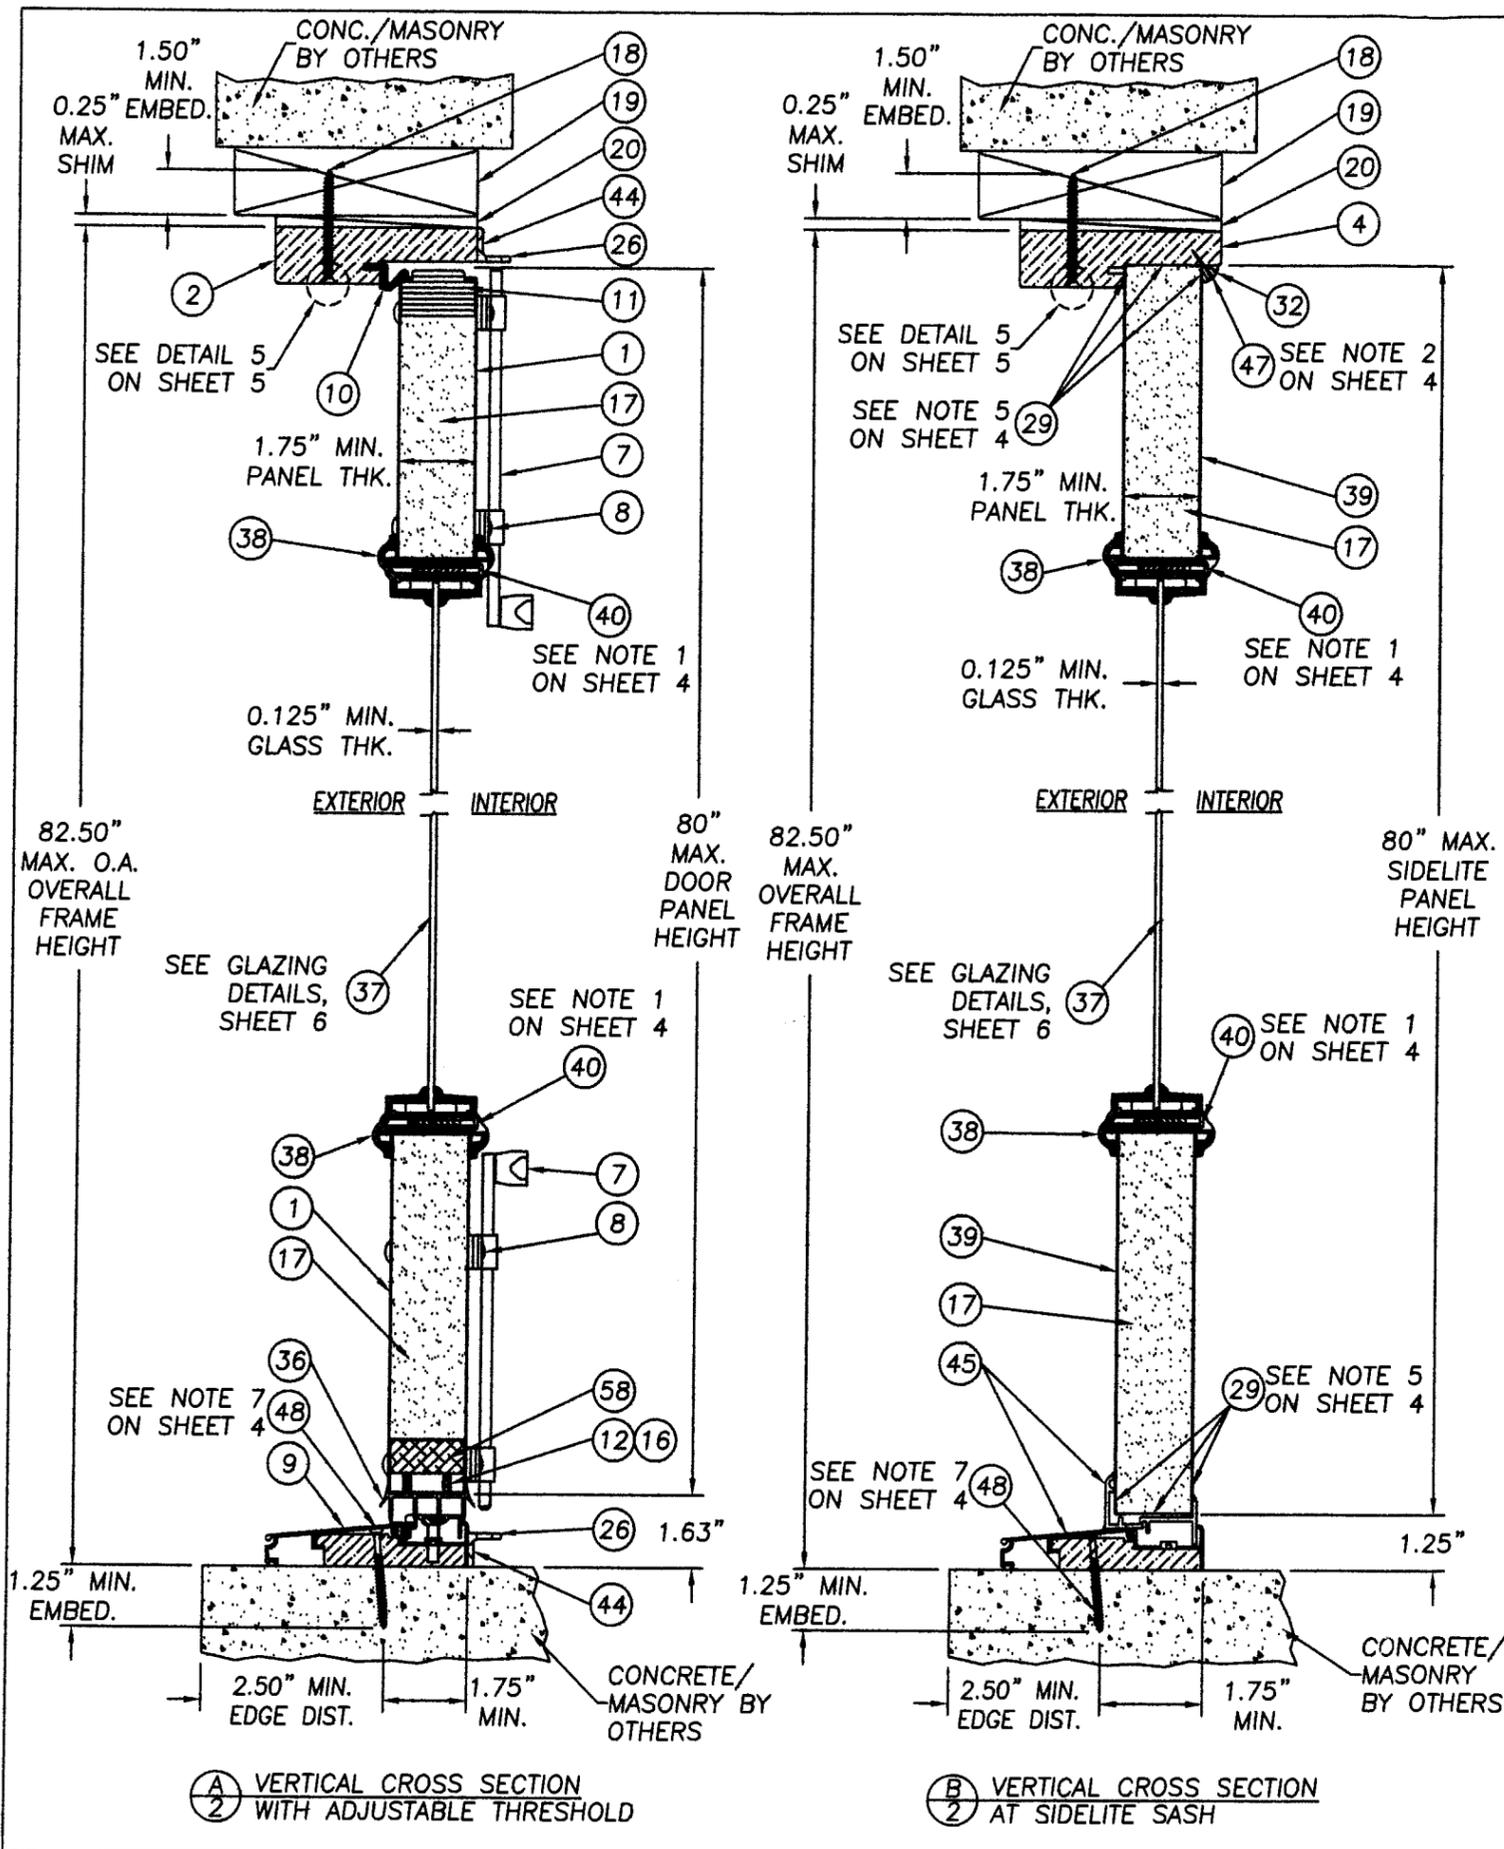

ITEM	DESCRIPTION	MATERIAL
1	DOOR STEEL FACE SHEET 24GA. (0.020" MIN.)	STEEL
2	FRAME HEAD (FINGER JOINTED PONDEROSA PINE)	WOOD
3	FRAME HINGE JAMB (FINGER JOINTED PONDEROSA PINE)	WOOD
4	SIDELITE FRAME: HEAD, SILL, AND JAMBS (FINGER JOINTED PONDEROSA PINE)	WOOD
5	4" x 4" BUTT HINGE 12ga. (BY HAGER)	STEEL
6	#9 x 1" PFH WOOD SCREW (HINGE TO DOOR)	STEEL
7	IVES SURFACE BOLT #454	STEEL
8	.25"-20 SEX BOLT W/ .25"-20 FEMALE END x 1.75" LONG	STEEL
9	ADJUSTABLE INSWING THRESHOLD (BY IMPERIAL)	ALUMINUM
10	COMPRESSION WEATHERSTRIP	FOAM
11	DOOR TOP RAIL	LVL
12	DOOR BOTTOM RAIL	STEEL
13	DOOR HINGE STILE (FINGER JOINTED PONDEROSA PINE)	WOOD
14	#10 x 1.75" PFH WOOD SCREW	STEEL
15	LOCK BLOCK	WOOD
16	OPTIONAL DOOR BOTTOM RAIL	WOOD
17	EXPANDED POLYSTYRENE (1.0 to 1.25 lb./cf DENSITY) BY JELD-WEN	FOAM
18	#10 WOOD INSTALLATION SCREW W/ 1.50" MIN. EMBEDMENT	STEEL
19	2x WOOD SUB BUCK (BY OTHERS)	WOOD
20	SHIM (0.25" MAX. THK. HIGH DENISTY PLASTIC OR GREATER)	-
21	KWIKSET 400 SERIES KNOB	STEEL
22	KWIKSET TITAN 700 SERIES DEADBOLT (NOT SHOWN)	STEEL
23	DOOR LATCH STILE	LVL
24	#8 x 2" PFH WOOD SCREW	STEEL
25	#8 x 2.50" PFH WOOD SCREW	STEEL
26	SURFACE BOLT STRIKE ANGLE (BY IVES)	STEEL
27	BRAD TRIM NAIL 16GA. X 1" LONG	STEEL
28	LITE FRAME SCREW #6 X 1.50" LONG PAN HEAD (BY TRINITY)	STEEL
29	SILICONE CAULK (CR LAWRENCE 33 C)	SILICONE
30	GLAZING COMPOUND (QSD BY ODL)	SILICONE
31	MULLION CAP (82.50" LONG)	WOOD
32	3/8" QUARTER ROUND SIDELITE STOP	WOOD
33	GLAZING COMPOUND DOW 1199	SILICONE
34	SCHLAGE KNOB SET #F51	STEEL
35	SCHLAGE DEADBOLT #B360 (NOT SHOWN)	STEEL
36	INSWING VINYL DOOR BOTTOM SWEEP	VINYL
37	1/8" TEMPERED GLASS (BY PPG)	GLASS
38	ODL LITE FRAME .125" S.G. (SPARTECH POLYCOM PP5530 C13)	POLYPROP.
39	SIDELITE STEEL FACE SHEET 24GA. (0.020" MIN. STEEL)	STEEL
40	#8 x 1.50" PLASCREW (ODL LITE FRAME)	STEEL
41	PRESSURE TREATED MULLION BAR (.75" x 4.5625" x 82.50")	WOOD
42	YALE KNOB HERITAGE SERIES	STEEL
43	YALE DEADBOLT HERITAGE SERIES (NOT SHOWN)	STEEL
44	#10 x 1" PAN HEAD SHEETMETAL SCREW	STEEL
45	SIDELITE THRESHOLD WITH SEAL BOOT (BY IMPERIAL)	ALUM./VINYL
46	#10 x 2" PFH WOOD SCREW	STEEL
47	BRAD TRIM NAIL 16GA. x .75" LONG	STEEL
48	3/16" ITW TAPCON ANCHOR W/ 1.25" MIN. EMBEDMENT	STEEL
49	FRAME LATCH JAMB (FINGER JOINTED PONDEROSA PINE)	WOOD
50	DOOR LATCH STRIKE PLATE	STEEL
51	DOOR LATCH DEAD BOLT STRIKE PLATE	STEEL
52	1" INSULATED TEMPERED GLASS (BY PPG)	GLASS
53	ODL LITE FRAME 1" I.G. (SPARTECH POLYCOM PP5530 C13)	POLYPROP.
54	1/2" INSULATED TEMPERED GLASS (BY TRINITY/AMPAC)	GLASS
55	LITE FRAME FOR .50" I.G.U. (BY TRINITY)	POLYPROP.
56	1" INSULATED TEMPERED GLASS (BY TRINITY/AMPAC)	GLASS
57	LITE FRAME FOR 1" I.G.U. (BY TRINITY)	POLYPROP.
58	CORNER BLOCKS	MDF

PRODUCT RENEWED as complying with the Florida Building Code
 Acceptance No. 07-0731.03
 Expiration Date 08/15/2012
 By: *[Signature]*
 Miami Dade Product Control Division

JELD-WEN, INC.
 3737 LAKEPORT BLVD.
 KLAMATH FALLS, OR. 97601
 PH. 541.882.3451

PRODUCT: WOOD EDGE GLAZED INSWING STEEL DOOR, UP TO 5'-11" x 6'-8" WITH & WITHOUT SIDELITES
 PART OR ASSEMBLY: VERTICAL CROSS SECTIONS AND BILL OF MATERIALS

	JWJ	ZRK	RW	TJH	BY
D 7-06-07	MODIFIED TO MEET THE 2004 FBC				
C 10-22-02	ADDED TRINITY FRAME				
B 6-17-02	GENERAL REVISION				
A 3-15-02	GENERAL REVISION				
#					

[Signature]
 Eric S. Nielsen
 Florida P. E. No. 41323
 PTC, LLC
 1535 Cogswell Street, Suite C25
 Rockledge, Florida 32955
 FBPE Certificate of Authorization NO. 25935

Prepared By:
PTC
 PTC, LLC
 Phone: 321-690-1788
 Fax: 321-690-1789

DATE: 12/14/01
 SCALE: N.T.S.
 DWG. BY: JWJ
 CHK. BY: S. SAFFELL
 DRAWING NO.: S-2195
 SHEET 2 OF 7

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 07-0731-03
 Expiration Date 08/15/2012
 By *[Signature]*
 Miami Dade Product Control
 Division

JELD-WEN, INC.
 3737 LAKEPORT BLVD.
 KLAMATH FALLS, OR. 97601
 PH. 541.882.3451


PRODUCT: WOOD EDGE GLAZED INSWING
 STEEL DOOR, UP TO 5'-11" x 6'-8"
 WITH & WITHOUT SIDELITES
 PART OR ASSEMBLY:
 HORIZONTAL CROSS SECTIONS

DATE	REVISIONS	BY
D 7-06-07	MODIFIED TO MEET THE 2004 FBC	JWJ
C 10-22-02	ADDED TRINITY FRAME	ZRK
B 6-17-02	GENERAL REVISION	WR
A 3-15-02	GENERAL REVISION	TJH

DATE:	12/14/01
SCALE:	N.T.S.
DWG. BY:	JWJ
CHK. BY:	S. SAFFELL
DRAWING NO.:	S-2195
SHEET	3 OF 7

[Signature]
 Eric S. Nielsen
 Florida P. E. No. 41323
 PTC, LLC
 1535 Cogswell Street, Suite C25
 Rockledge, Florida 32955
 FBPE Certificate of Authorization NO. 25935


Prepared By:
PTC
 PTC, LLC
 Phone: 321-690-1788
 Fax: 321-690-1789

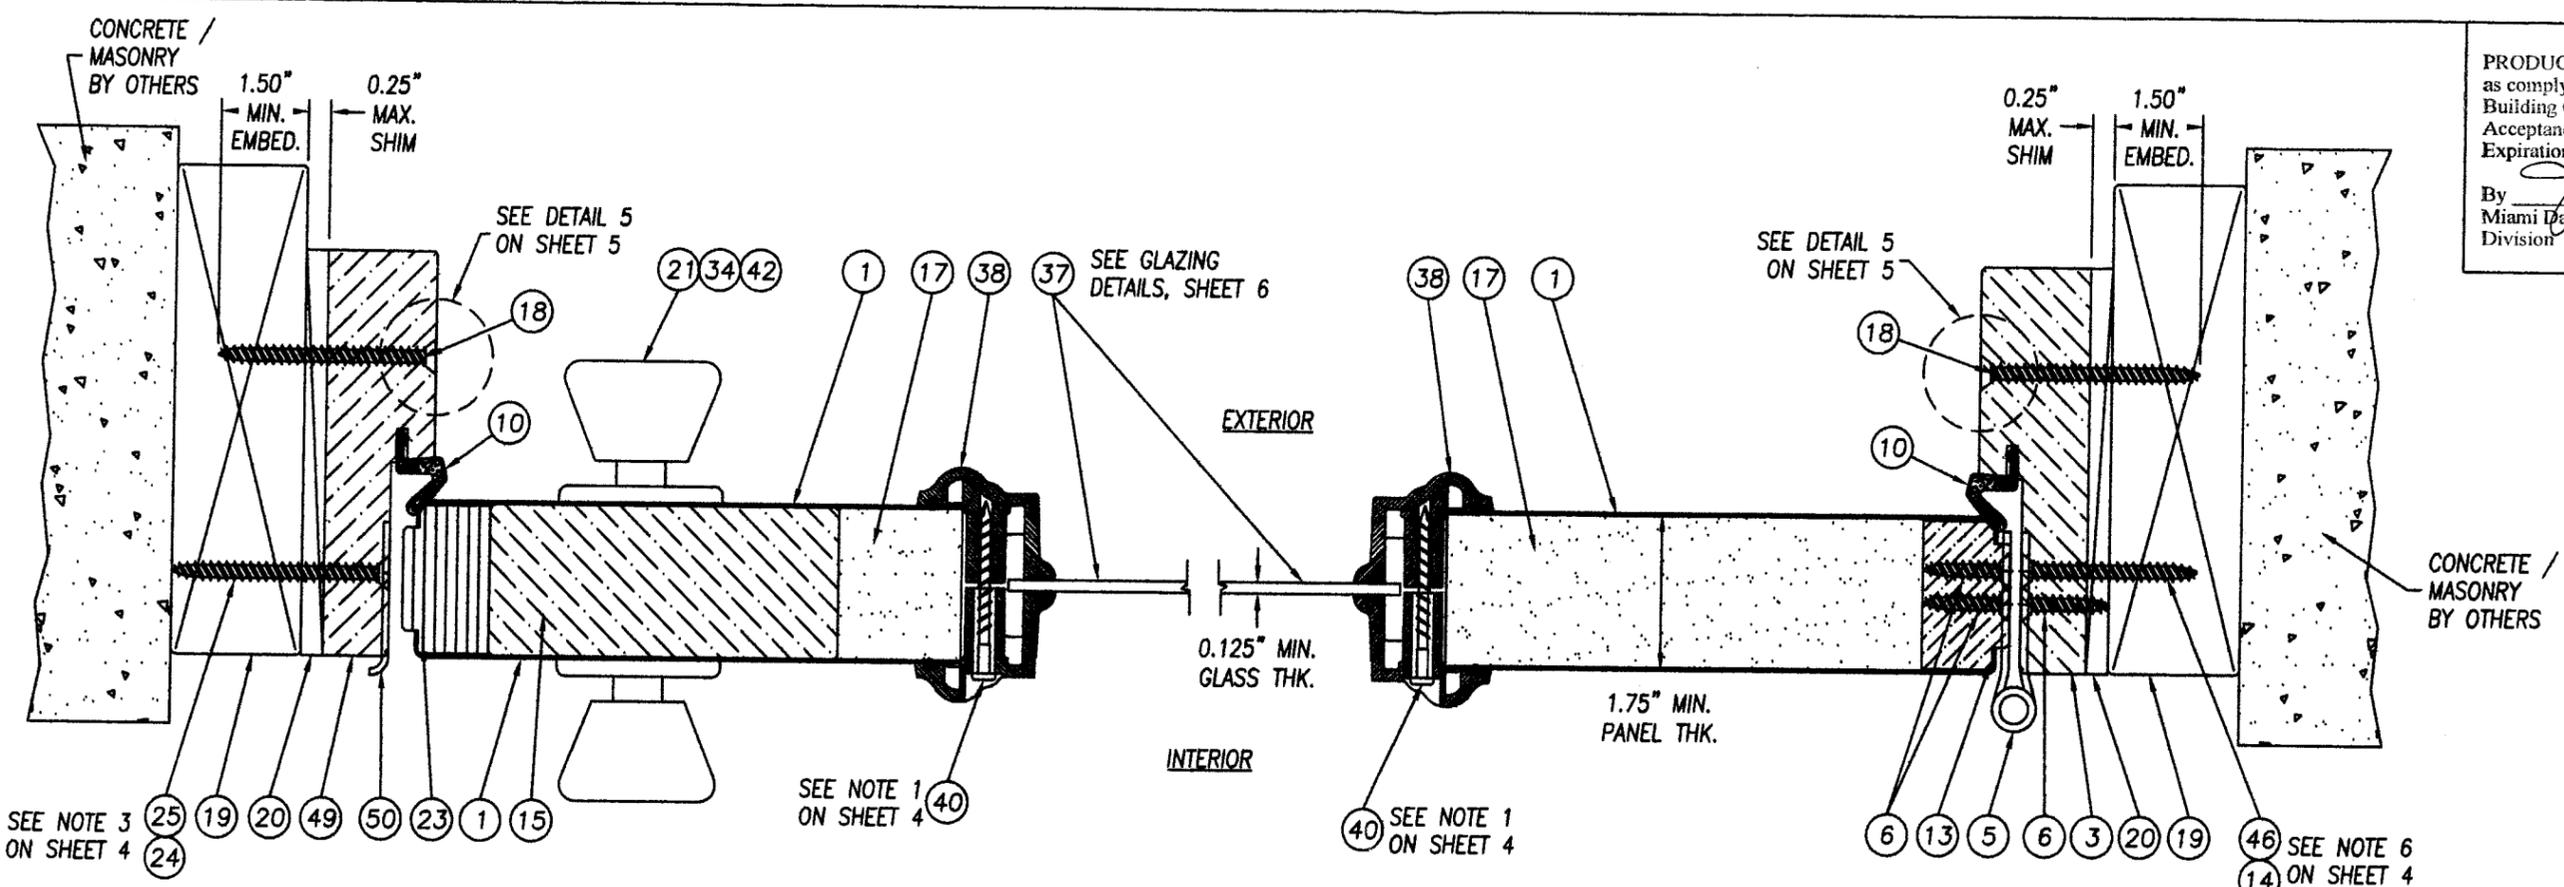

C HORIZONTAL CROSS SECTION
3 FRAME LATCH JAMB TO BUCK

EXTERIOR
 INTERIOR

D HORIZONTAL CROSS SECTION
3 FRAME HINGE JAMB TO BUCK

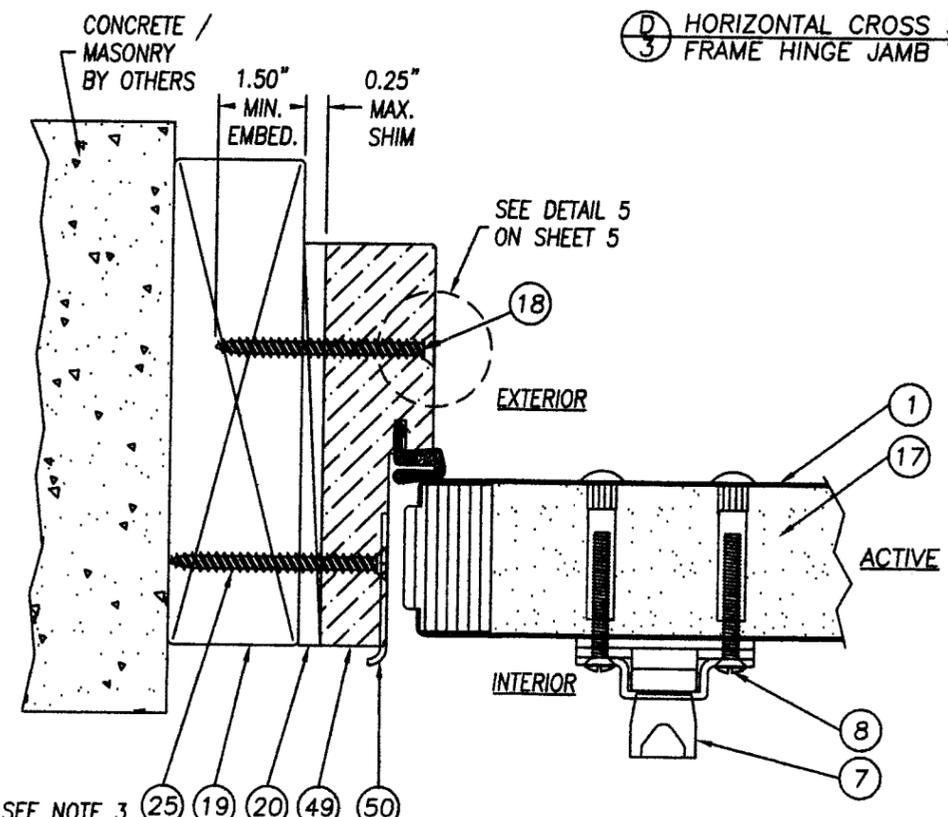

E HORIZONTAL CROSS SECTION
3 SURFACE BOLT MOUNTING

SEE NOTE 3
 ON SHEET 4


SEE NOTE 1
 ON SHEET 4

SEE NOTE 1
 ON SHEET 4

SEE NOTE 6
 ON SHEET 4

SEE NOTE 3
 ON SHEET 4

ACTIVE

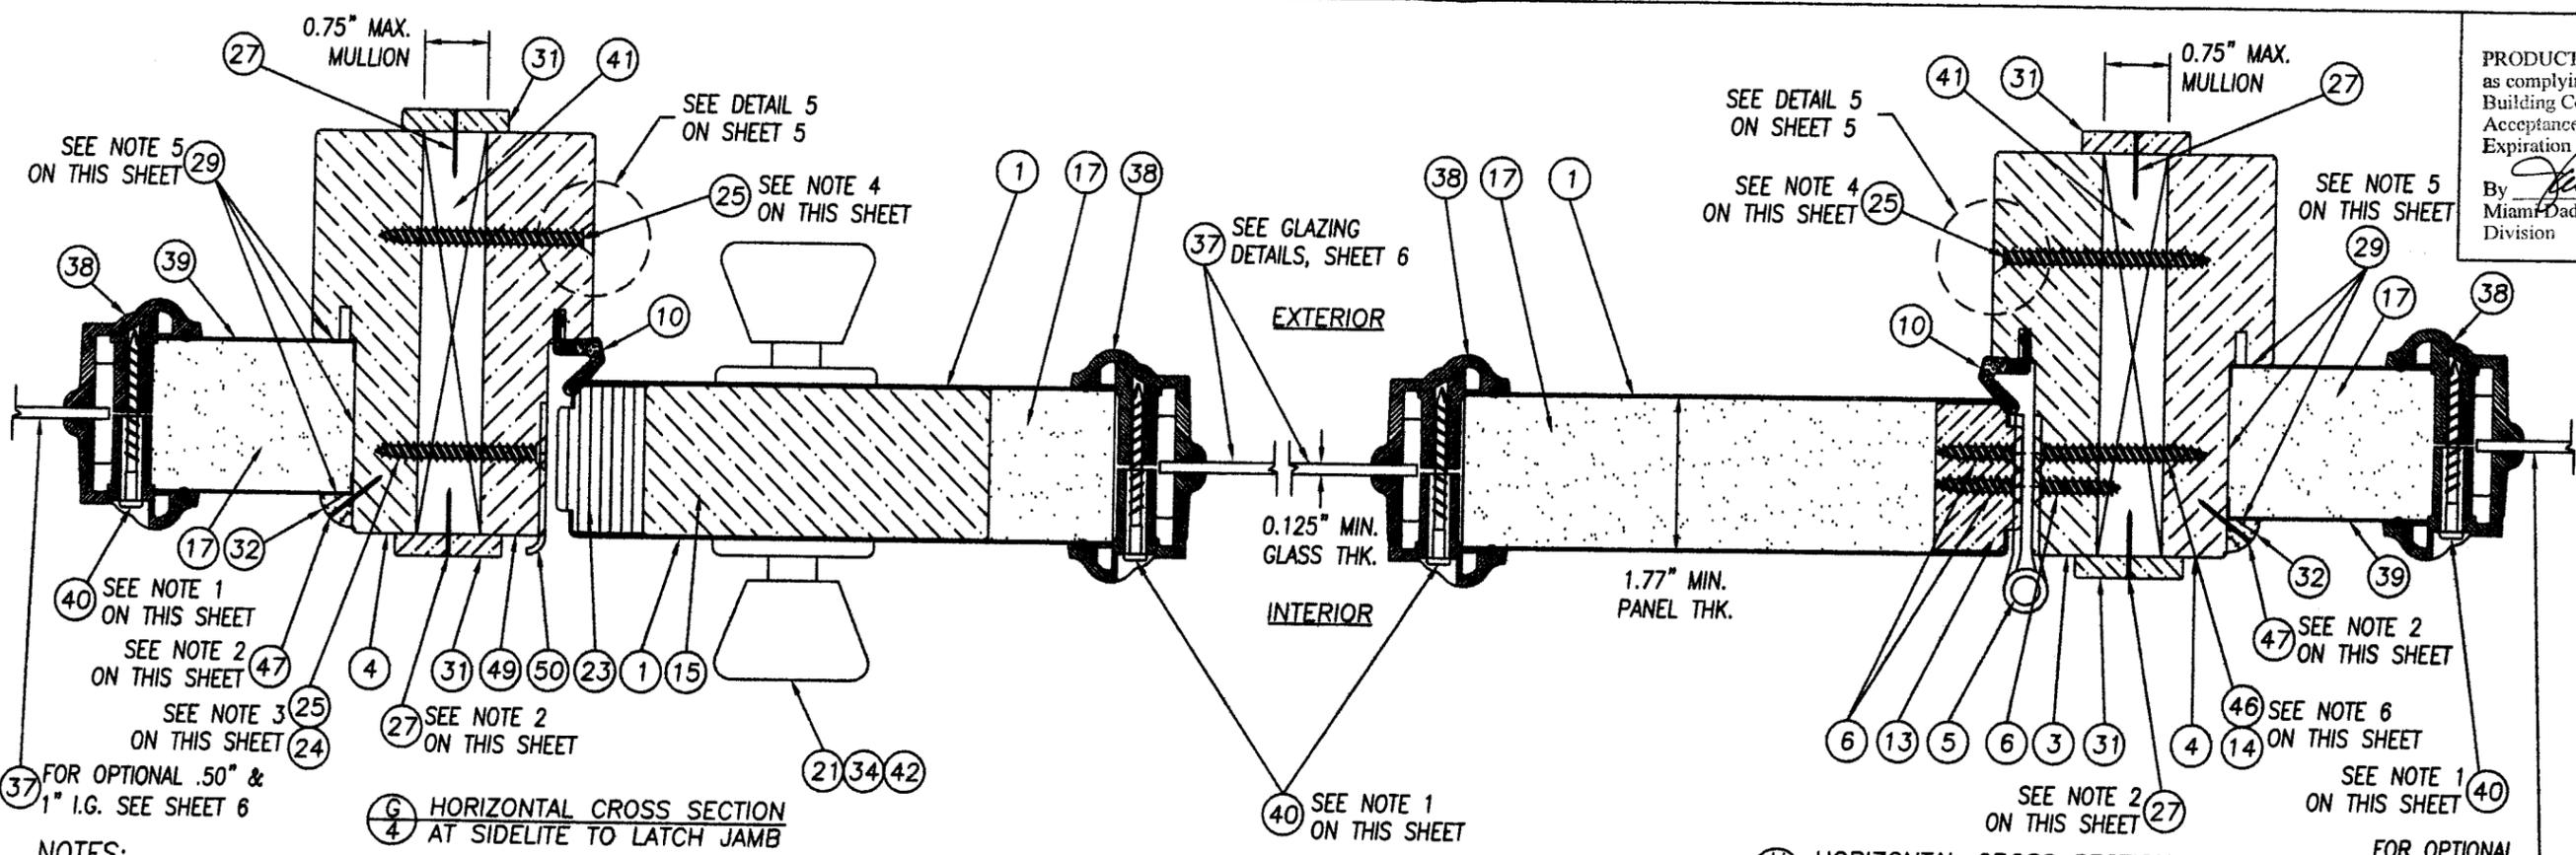

PRODUCT RENEWED as complying with the Florida Building Code Acceptance No. 07-0731.03 Expiration Date 08/15/2012
 By *[Signature]*
 Miami-Dade Product Control Division


JELD-WEN, INC.
 3737 LAKEPORT BLVD.
 KLAMATH FALLS, OR. 97601
 PH. 541.882.3451

PRODUCT: WOOD EDGE GLAZED INSWING STEEL DOOR, UP TO 5'-11" x 6'-8" WITH & WITHOUT SIDELITES
 PART OR ASSEMBLY:
 HORIZONTAL CROSS SECTIONS AND NOTES

REV	DATE	BY	REVISIONS
D	7-06-07	JWJ	MODIFIED TO MEET THE 2004 FBC
C	10-22-02	ZRK	ADDED TRINITY FRAME
B	6-17-02	RW	GENERAL REVISION
A	3-15-02	TJH	GENERAL REVISION

DATE:	12/14/01
SCALE:	N.T.S.
DWG. BY:	JWJ
CHK. BY:	S. SAFFELL
DRAWING NO.:	S-2195
SHEET	4 OF 7

- NOTES:**
- SPACING FOR ITEM #40 THE #8 x 1 1/2" PLASCREW IS AS FOLLOWS:
 TOP & BOTTOM HORIZONTALLY, DOOR & SIDELITE PANEL: 3.0" IN FROM EACH CORNER, ONE IN CENTER.
 FROM TOP DOWN ON THE SIDES: 3.0", 13.0", 26.0", 39.0", 52.0" & 63.0".
 - SPACING FOR ITEM #47 THE 16GA. x 3/4" BRAD TRIM NAIL ATTACHING THE QUARTER ROUND TO THE SIDELITE FRAME AND ITEM # 27 THE 16GA. X 1" BRAD TRIM NAIL ATTACHING THE MULLION CAP TO THE MULLION BAR VERTICALLY, IS AS FOLLOWS:
 TOP HORIZONTALLY: 1.25" IN FROM EACH CORNER WITH (1) NAIL MID-SPAN.
 VERTICALLY: 1.25" FROM EACH END & SIX MORE EQUALLY SPACED ON THE FIELD.
 - WHEN ATTACHING THE STRIKE PLATES TO THE JAMB AND BUCK USE ITEM #25, A #8 x 2 1/2" PFH WOOD SCREW.
 WHEN ATTACHING THE STRIKE PLATES TO THE JAMB AND SIDELITE JAMB AT THE MULLION USE ITEM #24, A #8 x 2" PFH WOOD SCREW.
 - SPACING FOR ITEM #25 THE #8 x 2 1/2" PFH WOOD SCREWS ATTACHING THE JAMBS TOGETHER AT THE MULLION, IS AS FOLLOWS: 6.0" FROM EACH VERTICAL CORNER WITH (4) MORE SCREWS EQUALLY SPACED ON THE FIELD.
 - THE SIDELITE PANEL IS SECURED INTO THE SIDELITE JAMB WITH ITEM #29 SILICONE CAULK ON THREE SIDES AND 3/8" QUARTER ROUNDS SECURED WITH ITEM #47 BRAD TRIM NAILS x 3/4" LONG.
 - WHEN ATTACHING THE HINGE TO THE JAMB AND BUCK USE ITEM #46, A #10 x 2" PFH SCREW. WHEN ATTACHING THE HINGE TO THE JAMB AND SIDELITE JAMB AT THE MULLION USE ITEM #14, A #10 x 1 3/4" PFH WOOD SCREW.
 - ALTERNATE CONCRETE/MASONRY INSTALLATION ANCHORS OF EQUIVALENT PERFORMANCE CHARACTERISTICS CAN BE USED UPON APPROVAL OF THE ARCHITECT OR ENGINEER OF RECORD FOR THE PROJECT OF INSTALLATION.
 - SPACING FOR ITEM #49 THE #6 x 1 1/2" PANHEAD SCREW (TRINITY LITEFRAME) IS AS FOLLOWS:
 DOOR LITEFRAME FROM THE TOP DOWN VERTICALLY: 3.25", 10.625", 18.0625", 25.4375", 32.8125", 40.1875", 47.625", 55.0" & 62.375".
 DOOR LITEFRAME TOP & BOTTOM, FROM RIGHT TO LEFT: 3.25", 11.875" & 20.50".
 SIDELITE LITEFRAME FROM THE TOP DOWN VERTICALLY: 3.25", 18.0625", 32.8125", 47.5625" & 62.625".
 SIDELITE LITEFRAME TOP & BOTTOM, FROM THE LEFT: (1) AT 4.4375".

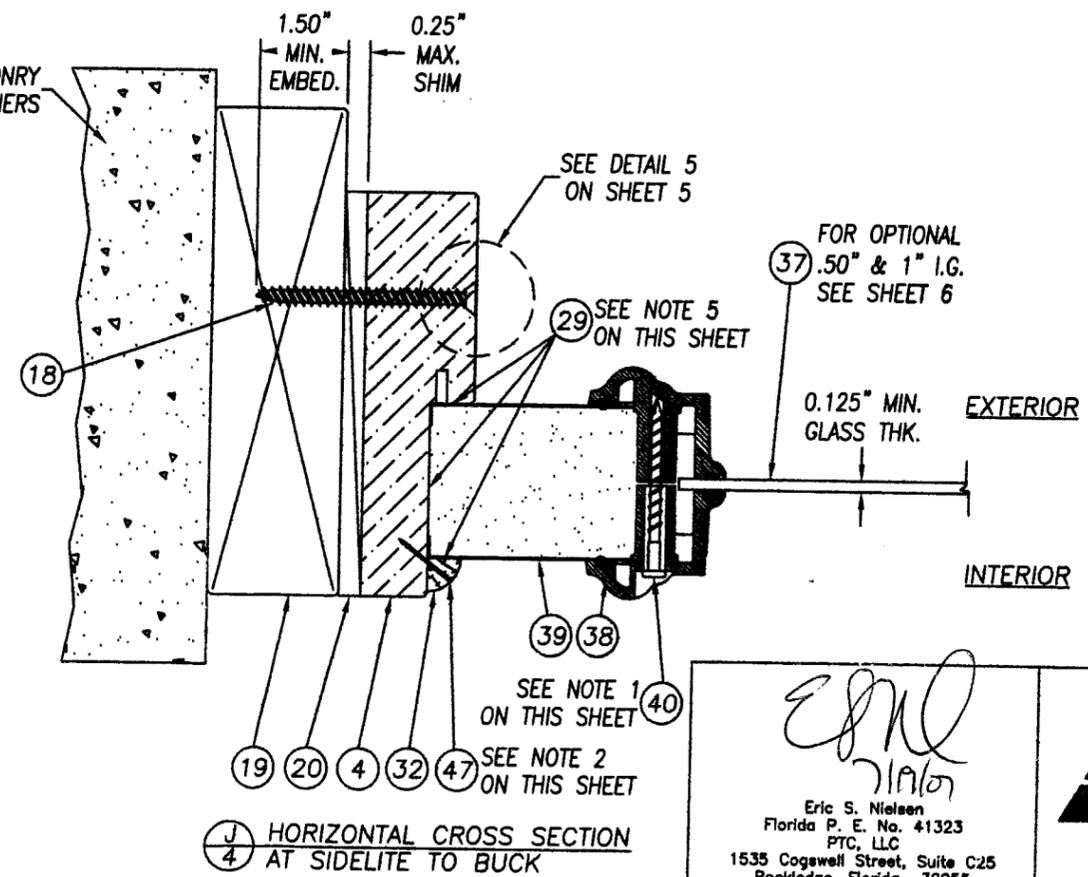

[Signature]
 Eric S. Nielsen
 Florida P. E. No. 41323
 PTC, LLC
 1535 Cogswell Street, Suite C25
 Rockledge, Florida 32955
 FBPE Certificate of Authorization NO. 25935

Prepared By:
PTC
 PTC, LLC
 Phone: 321-690-1788
 Fax: 321-690-1789








PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 07-0731.03
 Expiration Date 08/15/2012
 By *[Signature]*
 Miami Dade Product Control
 Division

JELD-WEN, INC.
 3737 LAKEPORT BLVD.
 KLAMATH FALLS, OR. 97601
 PH. 541.882.3451

PRODUCT: WOOD EDGE GLAZED INSWING
 STEEL DOOR, UP TO 5'-11" x 6'-8"
 WITH & WITHOUT SIDELITES
 PART OR ASSEMBLY:
 ANCHORING LOCATIONS
 AND DETAILS

REV	DATE	BY	REVISIONS
D	7-06-07	JWJ	MODIFIED TO MEET THE 2004 FBC
C	10-22-02	ZRK	ADDED TRINITY FRAME
B	6-17-02	RW	GENERAL REVISION
A	3-15-02	TJH	GENERAL REVISION

DATE:	12/14/01
SCALE:	N.T.S.
DWG. BY:	JWJ
CHK. BY:	S. SAFFELL
DRAWING NO.:	S-2195
SHEET	5 of 7

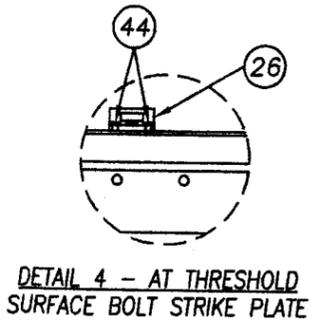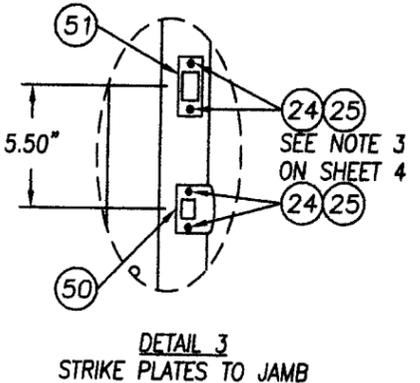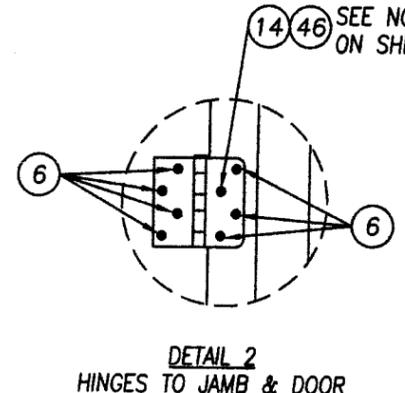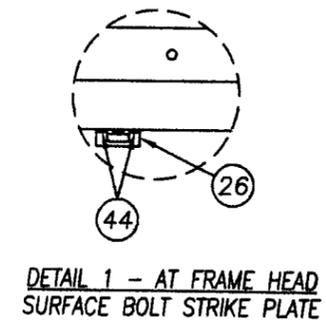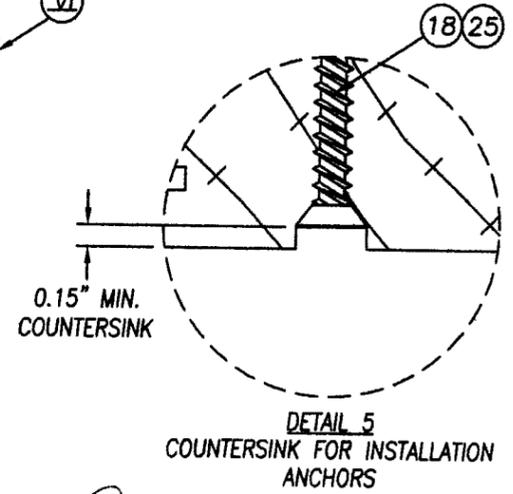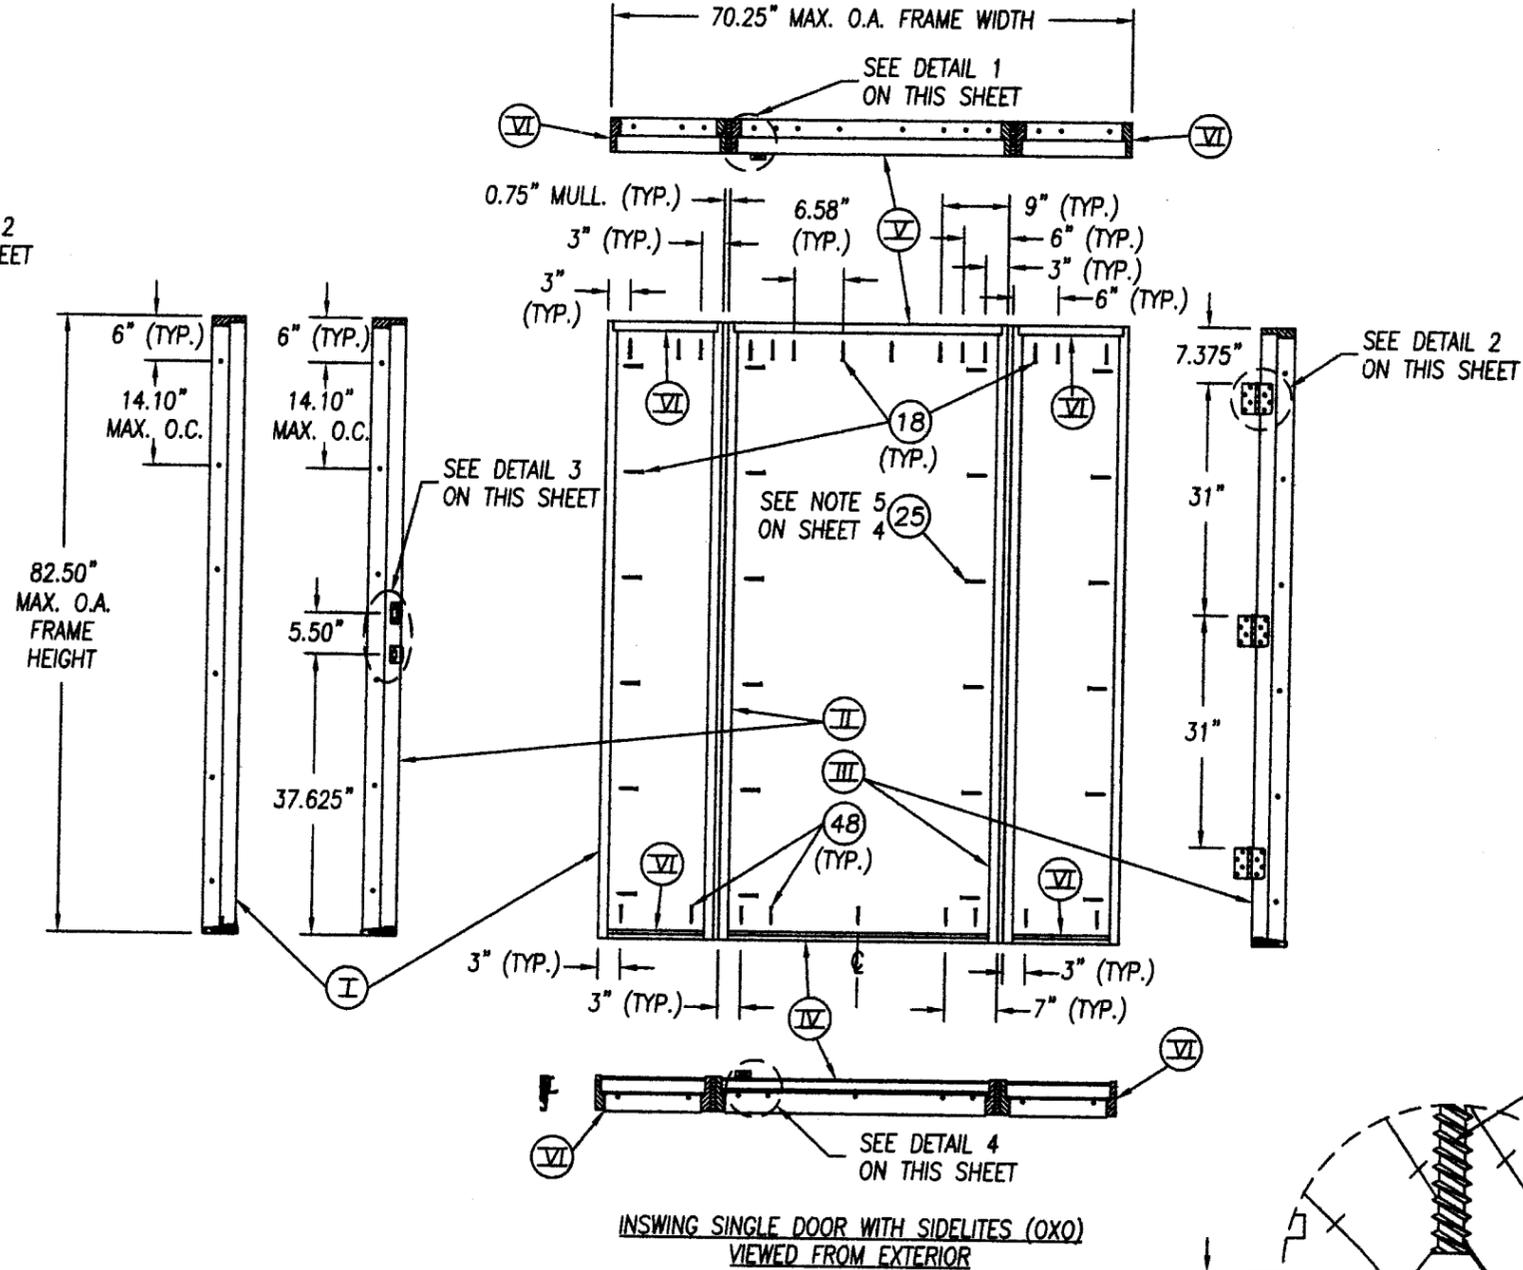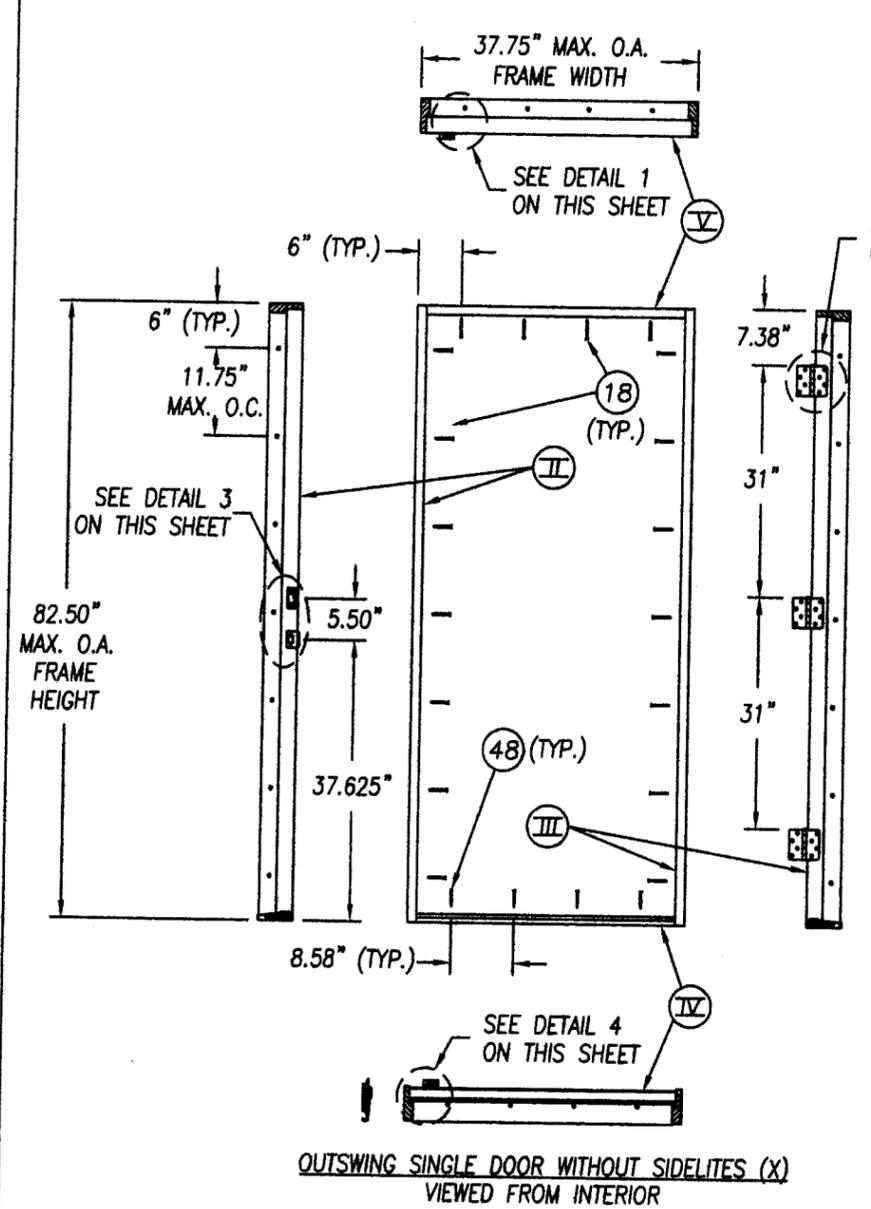

[Signature]
 Eric S. Nielsen
 Florida P. E. No. 41323
 PTC, LLC
 1535 Cogswell Street, Suite C25
 Rockledge, Florida 32955
 FBPE Certificate of Authorization NO. 25935

Prepared By:
PTC
 PTC, LLC
 Phone: 321-690-1788
 Fax: 321-690-1789


PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 07-0731.03
 Expiration Date 08/15/2012
 By *[Signature]*
 Miami Dade Product Control
 Division

JELD-WEN, INC.
 3737 LAKEPORT BLVD.
 KLAMATH FALLS, OR. 97601
 PH. 541.882.3451


PRODUCT: WOOD EDGE GLAZED INSWING
 STEEL DOOR, UP TO 5'-11" x 6'-8"
 WITH & WITHOUT SIDELITES
 PART OR ASSEMBLY:
 GLAZING DETAILS

	JWJ	ZRK	RW	TJH	BY
D	7/06/07	MODIFIED TO MEET THE 2004 FBC			
C	10/22/02	ADDED TRINITY FRAME			
B	6/17/02	GENERAL REVISION			
A	3/15/02	GENERAL REVISION			
#					


DATE:	12-14-01
SCALE:	N.T.S.
DWG. BY:	JWJ
CHK. BY:	S. SAFFELL
DRAWING NO.:	S-2195
SHEET	6 OF 7

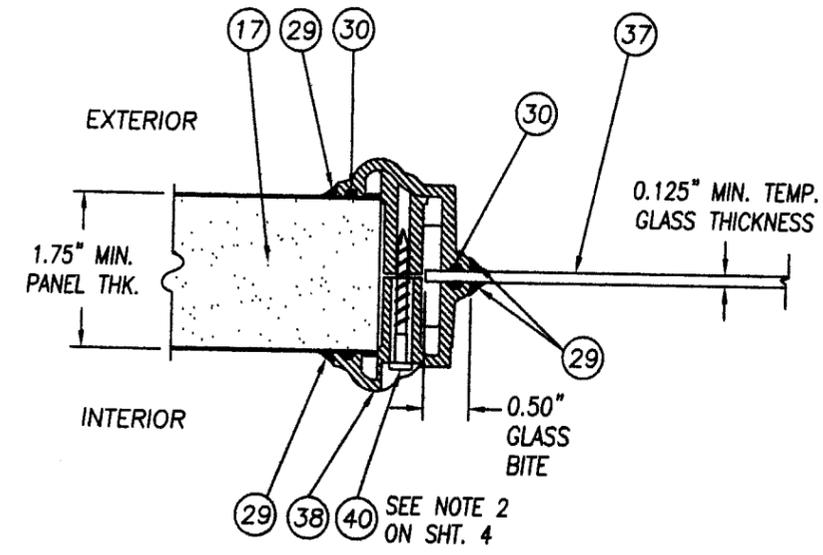


GLAZING DETAIL 1
 ODL LITE FRAME SINGLE PANE .125"
 TEMPERED GLASS
 SPARTECH
 POLYCOM PP 5530 C13
 (38)

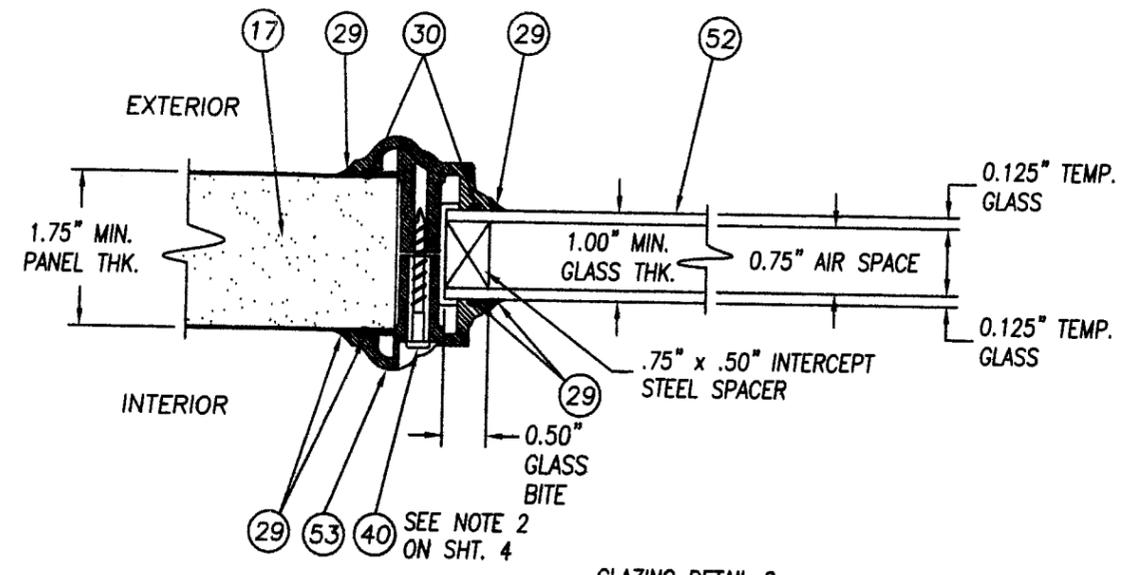

GLAZING DETAIL 2
 ODL LITE FRAME
 1" I.G.U. W/ .125" TEMPERED GLASS
 SPARTECH
 POLYCOM PP 5530 C13
 (53)

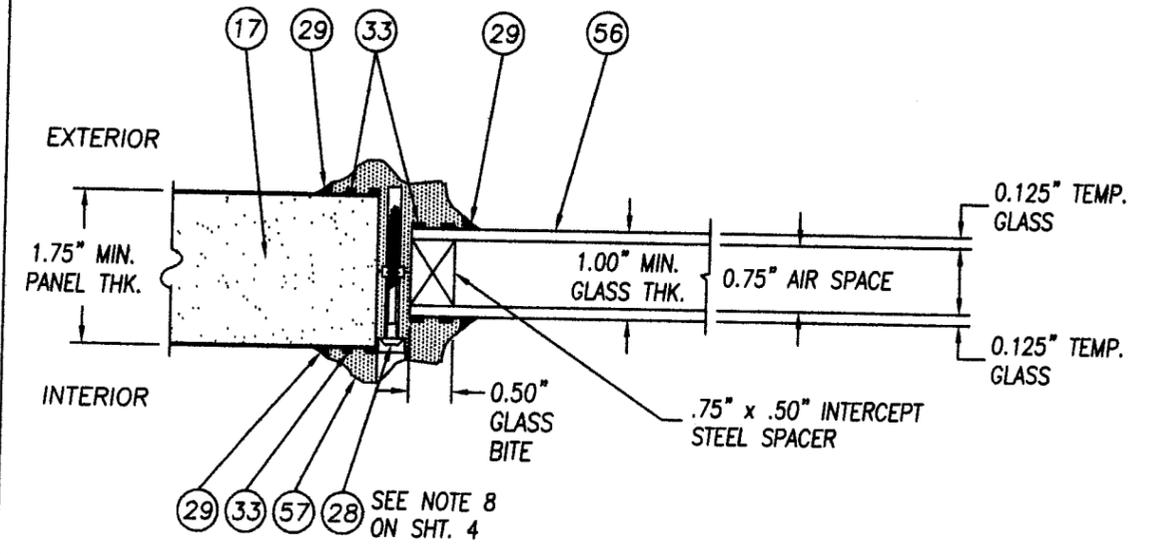


GLAZING DETAIL 3
 TRINITY LITE FRAME
 1" INSULATED TEMPERED GLASS
 LUPOY EU-5007
 (57)

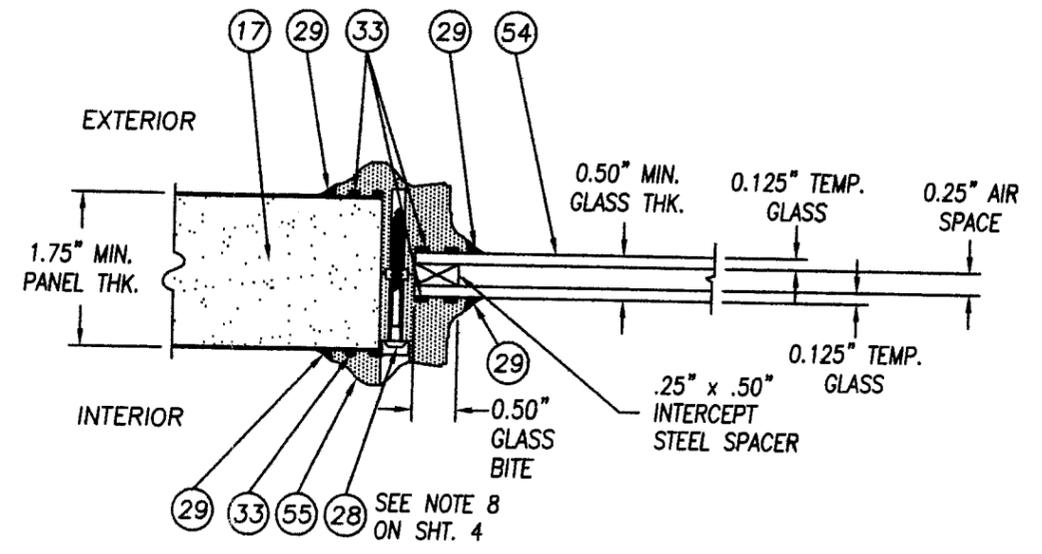


GLAZING DETAIL 4
 TRINITY LITE FRAME
 .50" INSULATED TEMPERED GLASS
 LUPOY EU-5007
 (55)

[Signature]
 Eric S. Nielsen
 Florida P. E. No. 41323
 PTC, LLC
 1535 Cogswell Street, Suite C25
 Rockledge, Florida 32955
 FBPE Certificate of Authorization NO. 29935


Prepared By:
PTC
 PTC, LLC
 Phone: 321-690-1788
 Fax: 321-690-1789

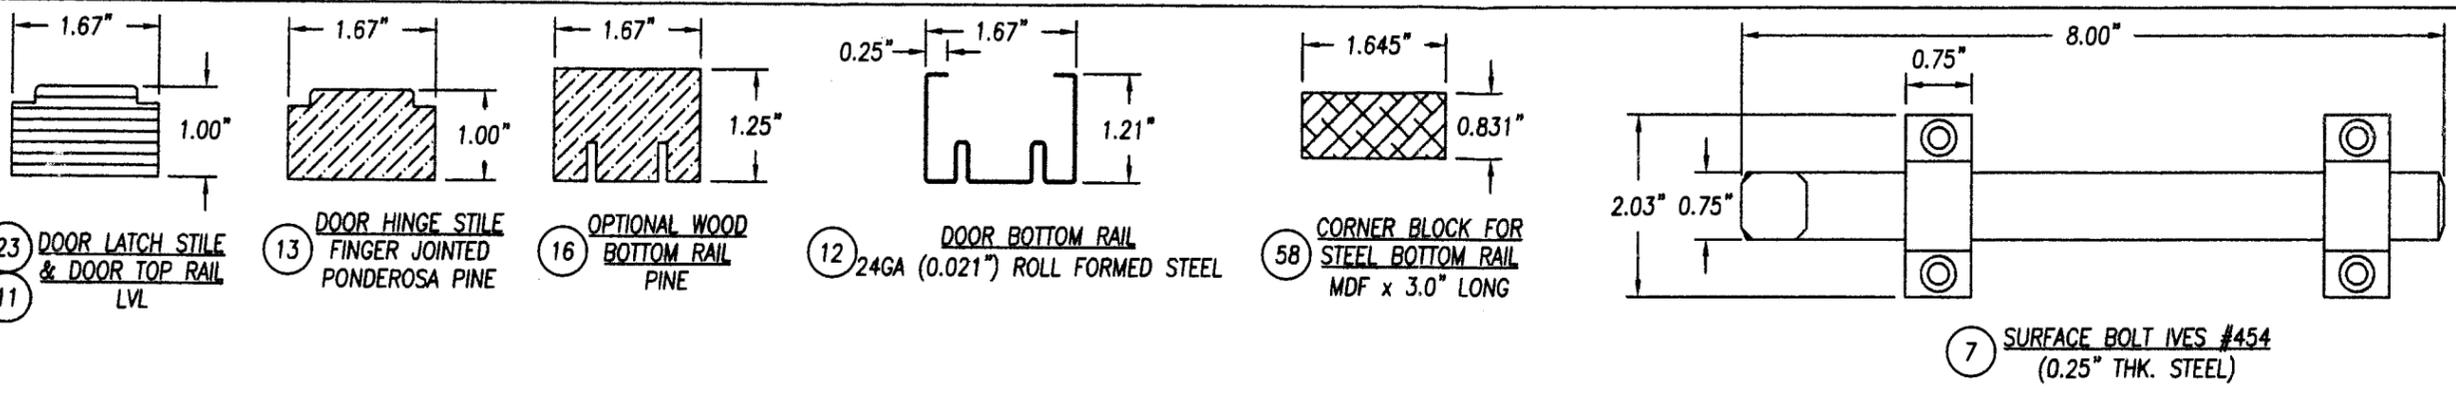


PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. **07-0731.03**
 Expiration Date **08/15/2012**
 By *[Signature]*
 Miami/Dade Product Control
 Division

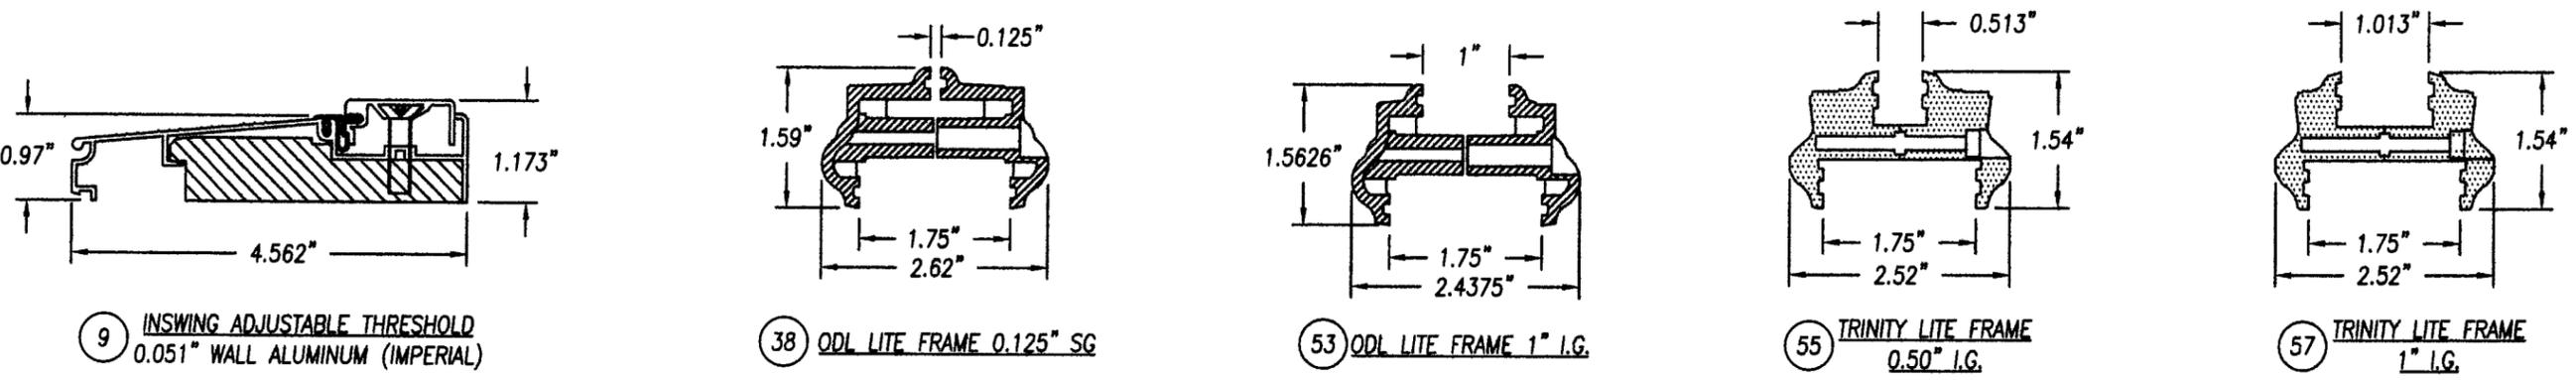

JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR. 97601
PH. 541.882.3451

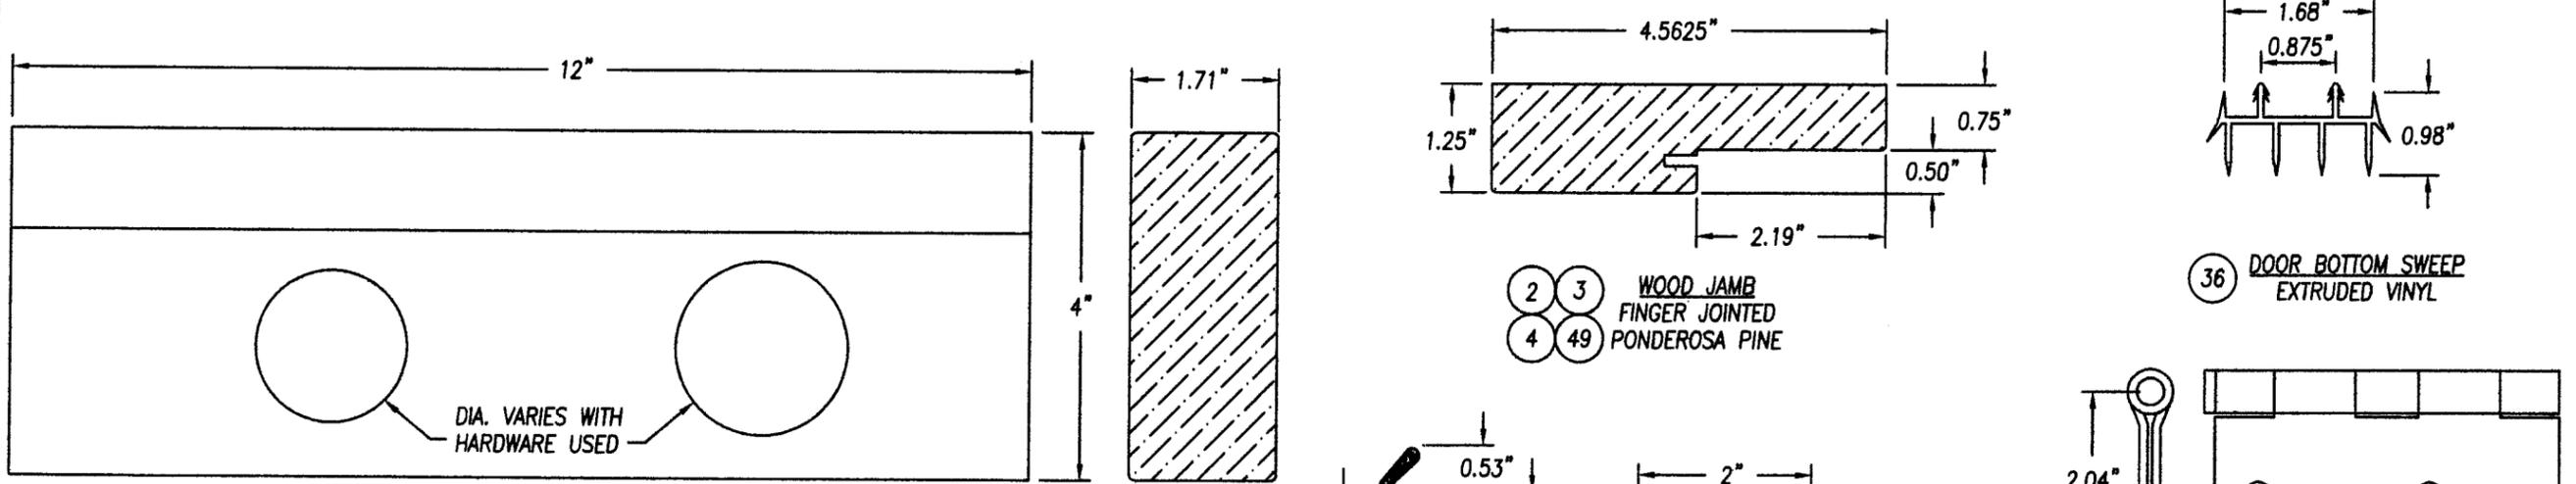

PRODUCT: WOOD EDGE GLAZED INSWING
 STEEL DOOR, UP TO 5'-11\"/>

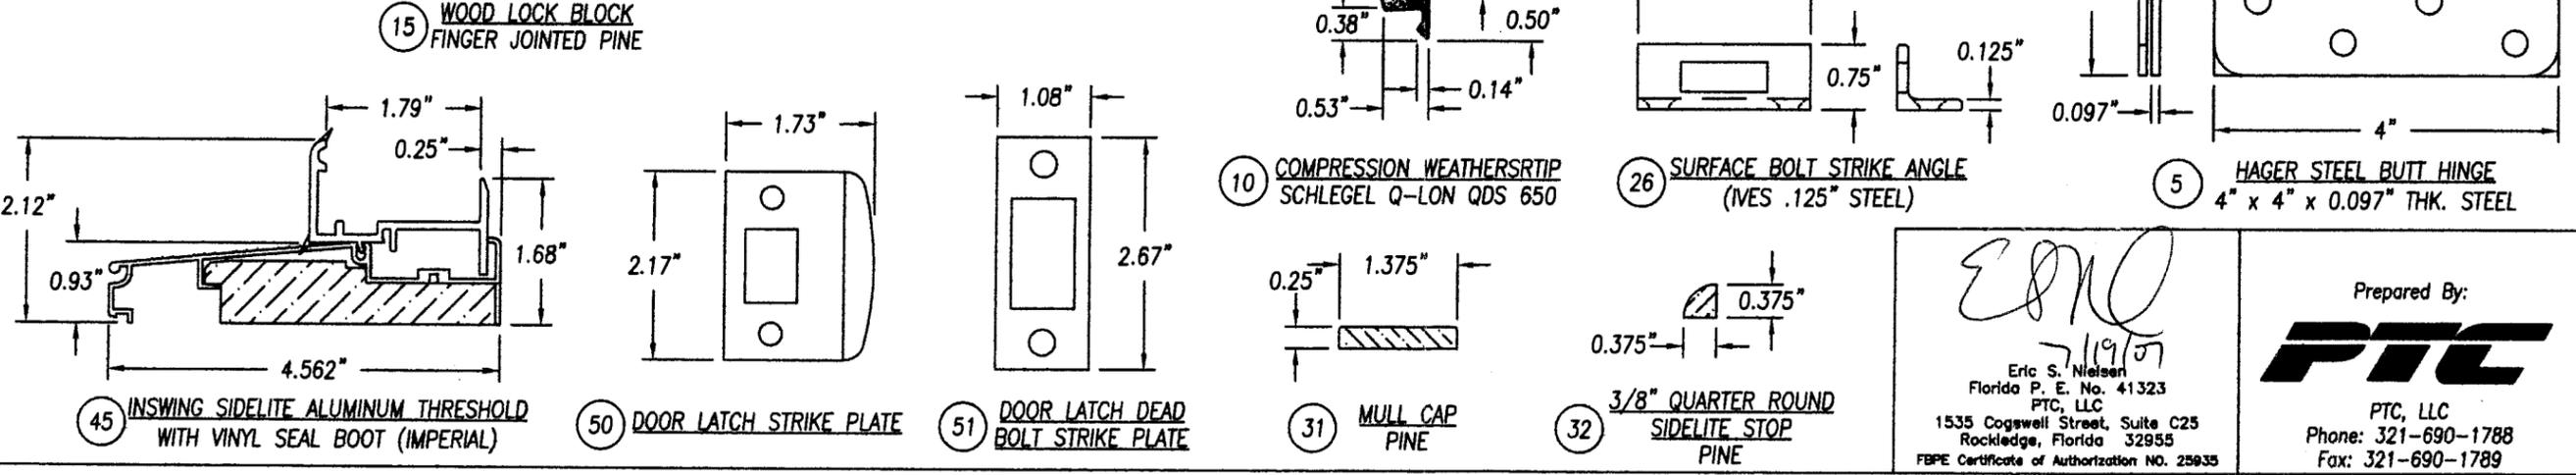

PART OR ASSEMBLY:		UNIT COMPONENTS	
#	DATE	REVISIONS	DATE
D	7-06-07	MODIFIED TO MEET THE 2004 FBC	
C	10-22-02	ADDED TRINITY FRAME	
B	6-17-02	GENERAL REVISIONS	
A	3-15-02	GENERAL REVISIONS	

[Signature]
 Eric S. Nielsen
 Florida P. E. No. 41323
 PTC, LLC
 1535 Cogswell Street, Suite C25
 Rockledge, Florida 32955
 FBPE Certificate of Authorization NO. 25933

Prepared By:
PTC
 PTC, LLC
 Phone: 321-690-1788
 Fax: 321-690-1789

DATE: 12/14/01
 SCALE: N.T.S.
 DWG. BY: JWJ
 CHK. BY: S. SAFFELL
 DRAWING NO.: S-2195
 SHEET 7 OF 7