



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.maimidade.gov/buildingcode

EFCO Corporation
1000 County Road
Monett, MO 65708

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "810-I" Outswing Aluminum Casement Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **1081**, titled "Series 810-I Large Missile Impact Casement Window", Sheets 1 through 5 of 5, dated 2/27/02, with revision A2 dated 02/11/08, prepared by W.W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved" or the Product Control Seal, unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises and renews NOA # 02-0410.05** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 07-0817.07
Expiration Date: November 07, 2012
Approval Date: March 20, 2008
 Page 1

EFCO Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS (continued)

1. Notice of Acceptance No. **02-0916.04** issued to Viracon, Inc. for their "**Laminate with Polyvinyl Butryal Interlayer**", dated 05/22/03, expiring on 04/14/08.
2. Notice of Acceptance No. **03-0916.02** issued to Glasslam NGI Inc. for their "**Glasslam Safety- Plus Laminated Glass**" dated 10/23/03, expiring on 09/09/08.
3. Notice of Acceptance No. **02-1205.03** issued to Security Impact Glass Holding LLC for their "**SAF-GLAS Polycarbonate Laminate**", dated 01/02/03, expiring on 12/16/07.

F. STATEMENTS

1. Statement letter of conformance, dated 2/19/08, signed and sealed by Warren Schaefer, P.E.
2. Statement letter of no financial interest, dated 2/19/08, signed and sealed by Warren Schaefer, P.E.
3. Laboratory compliance letter for Test Report no. **HTL01085** issued by Hurricane Test Laboratory, dated 3/15/02, signed and sealed by Vinu J. Abraham, P.E.
(Submitted under NOA# 02-0410.05)

G. OTHER

1. Notice of Acceptance No. **02-0410.05**, issued to EFCO Corporation for their Series "810-I Aluminum **Casement Window**", approved on 11/07/02 and expiring on 11/07/07.



Manuel Perez, P.E.
Product Control Examiner
NOA No. 07-0817.07

Expiration Date: November 07, 2012
Approval Date: March 20, 2008

EFCO Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **1081**, titled "Series 810-I Large Missile Impact Casement Window", Sheets 1 through 5 of 5, dated 2/27/02, with revision A2 dated 02/11/08, prepared by W.W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per PA 202-94
2) Large Missile Impact Test per PA 201-94
3) Cyclic Wind Pressure Loading per PA 203-94

along with marked-up drawings and installation diagram of an aluminum casement window (spec.#7), prepared by Hurricane Test Laboratory, Test Report No. **0046-1116-01**, dated 11/26/01, signed and sealed by Vinu J. Abraham, P.E.

(Submitted under NOA# 02-0410.05)

2. Test reports on: 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
4) Small Missile Impact Test per PA 201-94
5) Cyclic Wind Pressure Loading per PA 203-94
6) Forced Entry Test, per PA 202-94

along with marked-up drawings and installation diagram of an aluminum casement window (spec. #1,2,3,4,5,7) prepared by Hurricane Test Laboratory, Test Report No. **0046-0101-02**, dated 12/26/01, signed and sealed by Vinu J. Abraham, P.E.

(Submitted under NOA# 02-0410.05)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by W.W. Schaefer Engineering & Consulting, P.A., dated 03/04/02, revised on 02/19/08 signed and sealed by Warren W. Schaefer, P.E.
Complies with ASTM E1300-02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).


Manuel Perez, P.E.
Product Control Examiner


NOA No. 07-0817.07

Expiration Date: November 07, 2012

Approval Date: March 20, 2008

HINGE QUANTITY TABLE	
WINDOW HEIGHT	QUANTITY REQUIRED
GREATER THAN 43"	3
43" AND SMALLER	2

LOCK/KEEPER QUANTITY TABLE	
WINDOW HEIGHT	QUANTITY REQUIRED
55 1/2" TO 72"	4
38 3/4" TO 55 3/8"	3
SMALLER THAN 38 3/4"	2

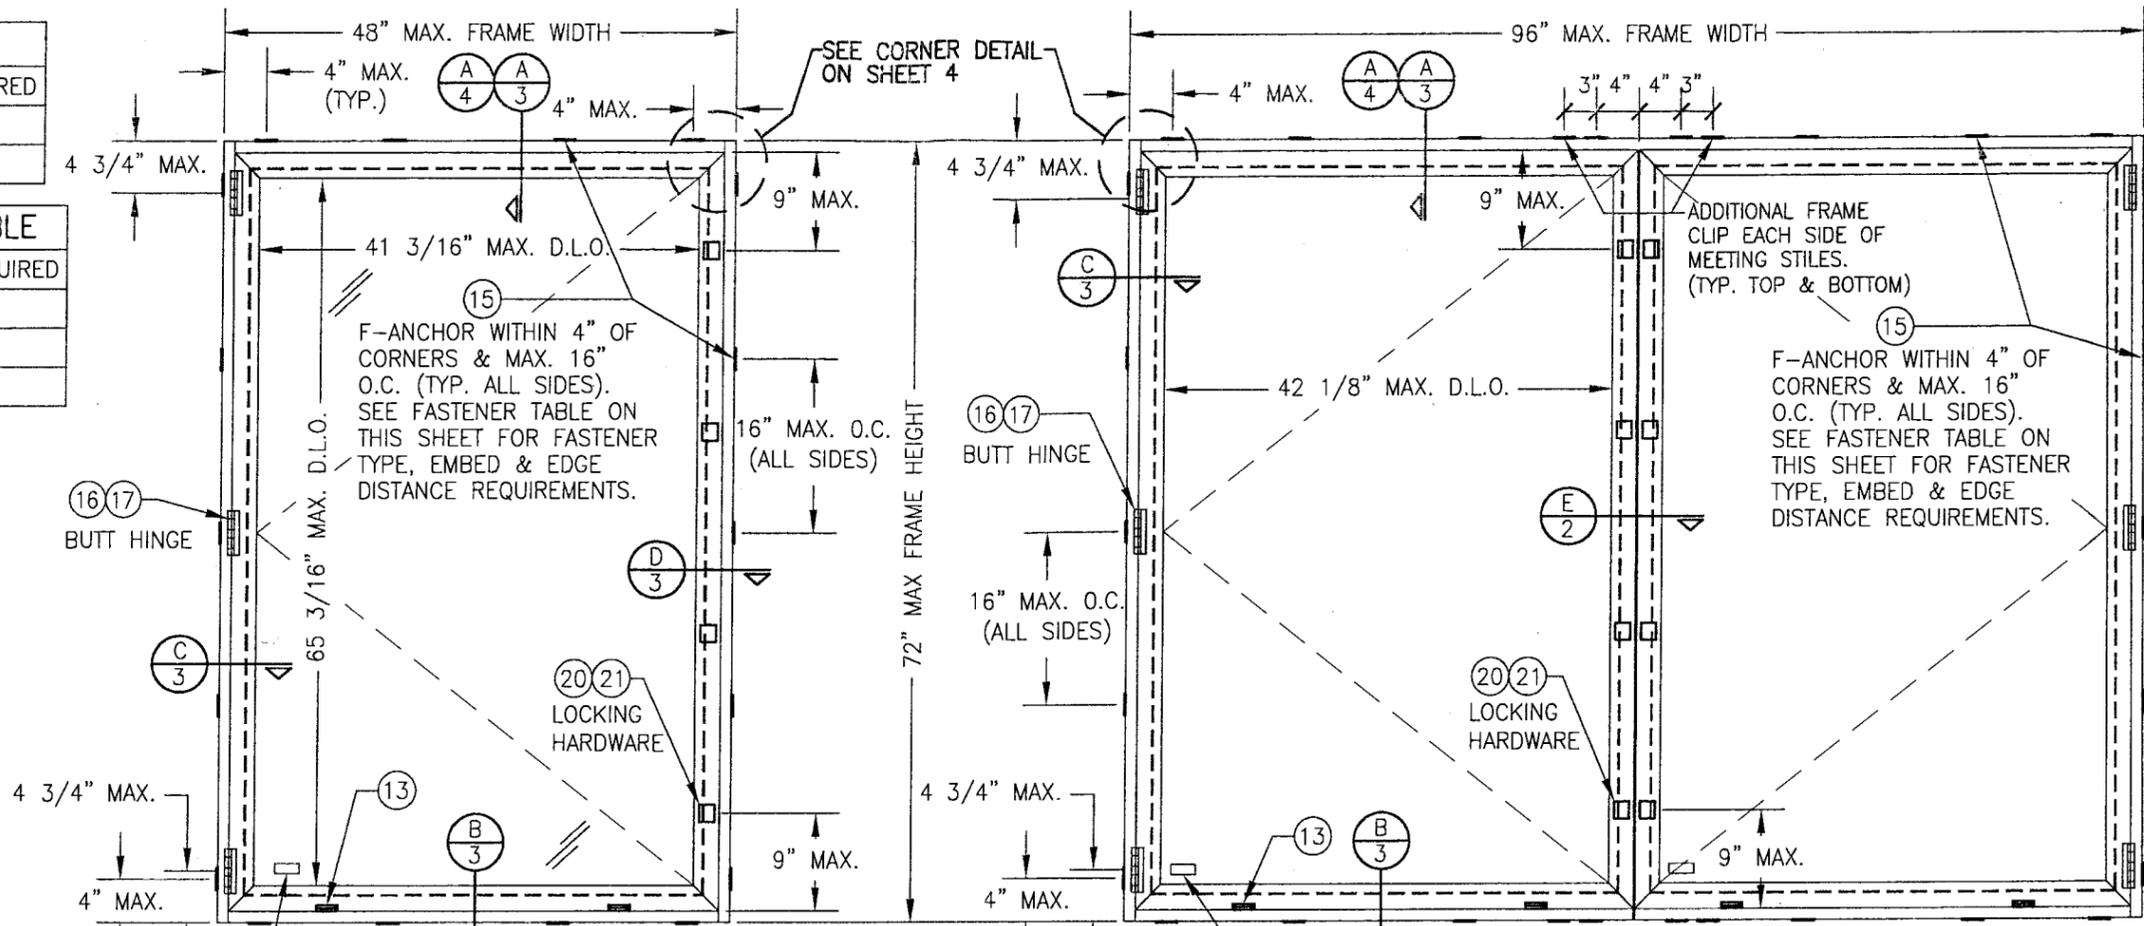

**EXTERIOR ELEVATION:
SINGLE OPERABLE CASEMENT WINDOW**
SCALE: 3/4"=1'-0"

**EXTERIOR ELEVATION:
DOUBLE OPERABLE CASEMENT WINDOW**
SCALE: 3/4"=1'-0"

ALLOWABLE DESIGN LOAD	
POSITIVE	NEGATIVE
90 PSF	100 PSF

THE FOLLOWING LABEL SHALL BE PLACED AT THE INNER BOTTOM RIGHT CORNER OF THE WINDOW:
EFCO CORPORATION, MONETT MISSOURI
MIAMI-DADE COUNTY PRODUCT CONTROL APPROVED
LARGE MISSILE IMPACT UNIT

GENERAL NOTES


1. THESE WINDOW SYSTEMS HAVE BEEN TESTED, ANALYZED AND APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN THE "ALLOWABLE DESIGN LOADS" TABLE(S).
2. BUCKING, OPENINGS & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
3. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & SHALL NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS.
4. THE DETAILS & SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS TESTED & PROPOSED FOR WATER, AIR, IMPACT, CYCLIC & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH THE 2004 & 2007 FLORIDA BUILDING CODE PROTOCOLS TAS-201, 202 & 203 FOR LARGE MISSILE IMPACT WINDOWS.
5. THESE WINDOW SYSTEMS HAVE BEEN DESIGNING IN ACCORDANCE WITH THE 2004 & 2007 FLORIDA BUILDING CODE (FBC) INCLUDING HIGH VELOCITY HURRICANE ZONES (HVHZ).
6. IMPACT SHUTTERS ARE NOT REQUIRED WITH THESE WINDOWS.
7. ALL ANCHORS SHALL BE INSTALLED AS SPECIFIED ON THESE DRAWINGS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
8. ALL FRAME ANCHORS SECURING WINDOW/DOOR FRAME TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
9. MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004 & 2007 FLORIDA BUILDING CODE SECTION 2003.8.4.
10. DETERMINE THE POSITIVE & NEGATIVE DESIGN LOADS TO USE WHEN REFERENCING THESE DOCUMENTS IN ACCORDANCE WITH THE GOVERNING CODE & GOVERNING WIND VELOCITY. FOR WIND LOAD CALCULATIONS IN ACCORDANCE WITH THE 2004 FLORIDA BUILDING CODE, A DIRECTIONALITY FACTOR OF $K_d = 0.85$ SHALL BE USED.
11. NO INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS PRODUCT. WIND LOAD DURATION FACTOR $C_d = 1.6$ WAS USED FOR WOOD SCREW DESIGN.
12. ALL SUBSTRATE SHALL HAVE THE FOLLOWING MINIMUM REQUIREMENTS.
 - a) ALL CONCRETE SUBSTRATE SHALL BE MIN. 3000 PSI.
 - b) ALL WOOD SUBSTRATE SHALL BE MIN. $G = 0.55$ DENSITY.
 - c) ALL METAL STUD SUBSTRATE SHALL BE MIN. 18 GA. $F_y = 33$ ksi.
 - d) ALL STRUCTURAL STEEL SUBSTRATE SHALL BE MIN. 12 GA. $F_y = 36$ ksi.

CLIP FASTENER REQUIREMENTS TABLE				
OPENING TYPE (SUBSTRATE)	CLIP TO OPENING FASTENER TYPE	NO. FASTENERS PER CLIP INTO SUBSTRATE	MINIMUM EMBEDMENT	MINIMUM EDGE DIST.
WOOD	NO. 12 SMS SCREW	2	1 1/4"	1"
MIN. 18 GA. STUD	NO. 12 TEK SCREW	2	FULL	1/2"
MIN. 12 GA. STRUCTURAL STEEL	NO. 12 TEK SCREW	2	FULL	1/2"
CMU/CONCRETE	(1) 1/4" CONCRETE SCREW	2	1 1/4"	2"

(1) CONCRETE SCREWS SHALL BE ELCO OR ITW RAMSET/RED HEAD TAPCONS, HILTI KWIK-CON II OR POWERS RAWL TAPPER (HARDENED STEEL OR S.S.).

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. **07-0817.07**
Expiration Date **NOV. 7, 2012**
By *Manuel Perez*
Miami Dade Product Control Division

DRAWN BY: J.C.F.		CHECKED BY: W.W.S.	
PLOT: 1-16		DATE: 02/27/02	
DATE	BY	REVISION DESCRIPTION	NO.
02/11/08	WRM	REMOVE SMALL MISSILE CONDITIONS	A1
02/11/08	WRM	UPDATE TO 2004 CODE COMPLIANT	A2
DRAWING TITLE: SERIES 810-1 LARGE MISSILE IMPACT CASEMENT WINDOW			
CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.		MANUFACTURER: EFCO CORPORATION	
8885 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903		1000 COUNTY ROAD, P.O. BOX 609 MONETT, MO 65708-0609 800-221-4169	
CERTIFICATION: FEB 20 2008	WARREN W. SCHAEFER, P.E. P.E. NO. 44135	DRAWING NO. 1081	REV. A
		SHEET NO. 1 OF 5	

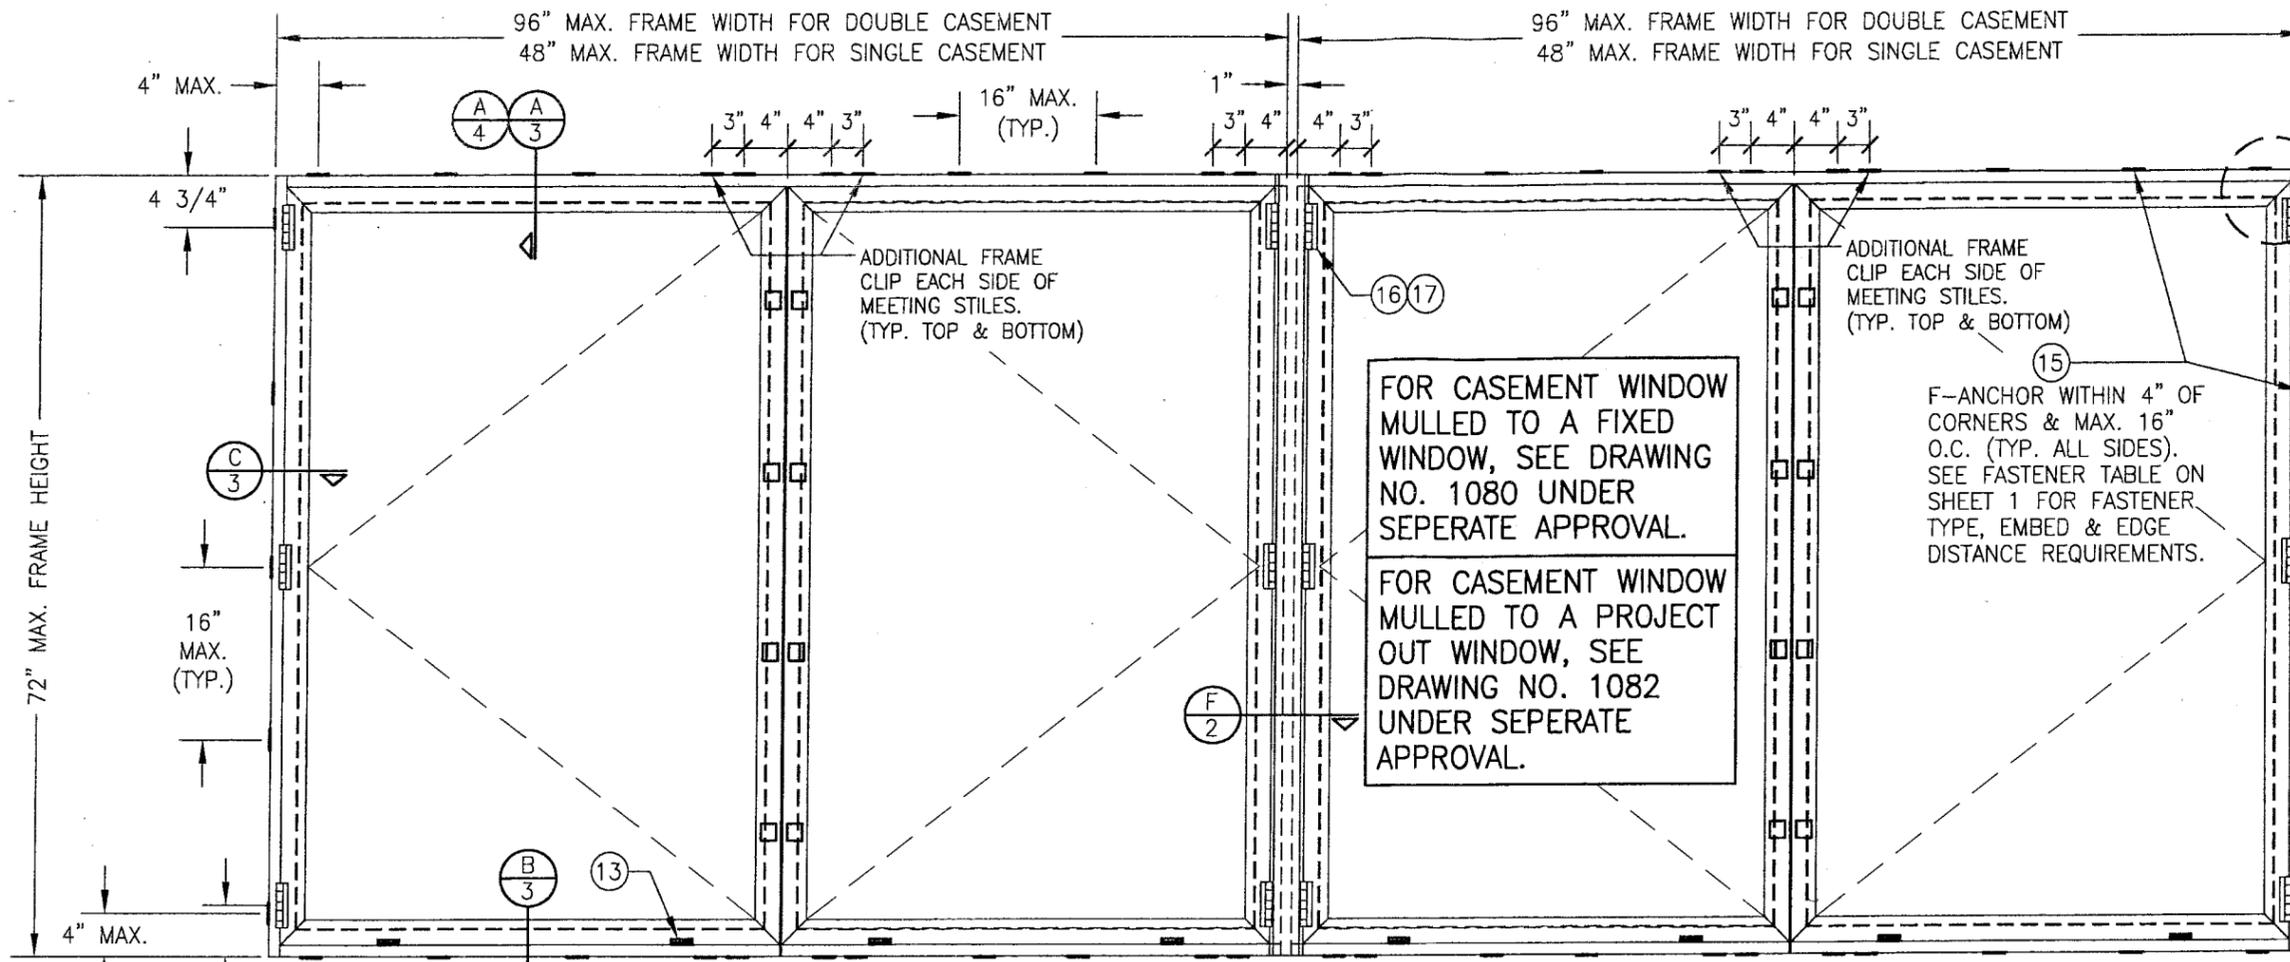

SEE "CORNER DETAILS" ON SHEET 4.

FOR CASEMENT WINDOW MULLED TO A FIXED WINDOW, SEE DRAWING NO. 1080 UNDER SEPERATE APPROVAL.


FOR CASEMENT WINDOW MULLED TO A PROJECT OUT WINDOW, SEE DRAWING NO. 1082 UNDER SEPERATE APPROVAL.

EXTERIOR ELEVATION
CASEMENT MULLED TO CASEMENT
 (TYP. FOR DOUBLE & SINGLE CASEMENTS)
 SCALE: 3/4"=1'-0"

MORE THAN 2 WINDOWS MAY BE STACKED HORIZONTALLY
 (SEE OTHER ELEVATIONS ON SHEET 1 FOR DETAIL NOT SHOWN)


NO. 6-18 X 3/8" PL PH SMS 4" FROM ENDS & MAX. 16" O.C.

NO. 12-11 X 3/4" PL PH SMS 4" FROM ENDS & MAX. 16" O.C.

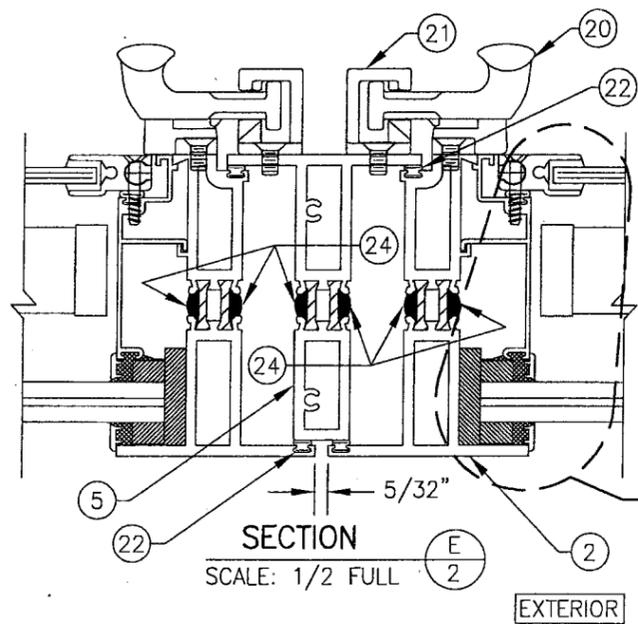

SECTION
 SCALE: 1/2 FULL
 (E) 2

SEE "GLAZING DETAILS" ON SHEET 5




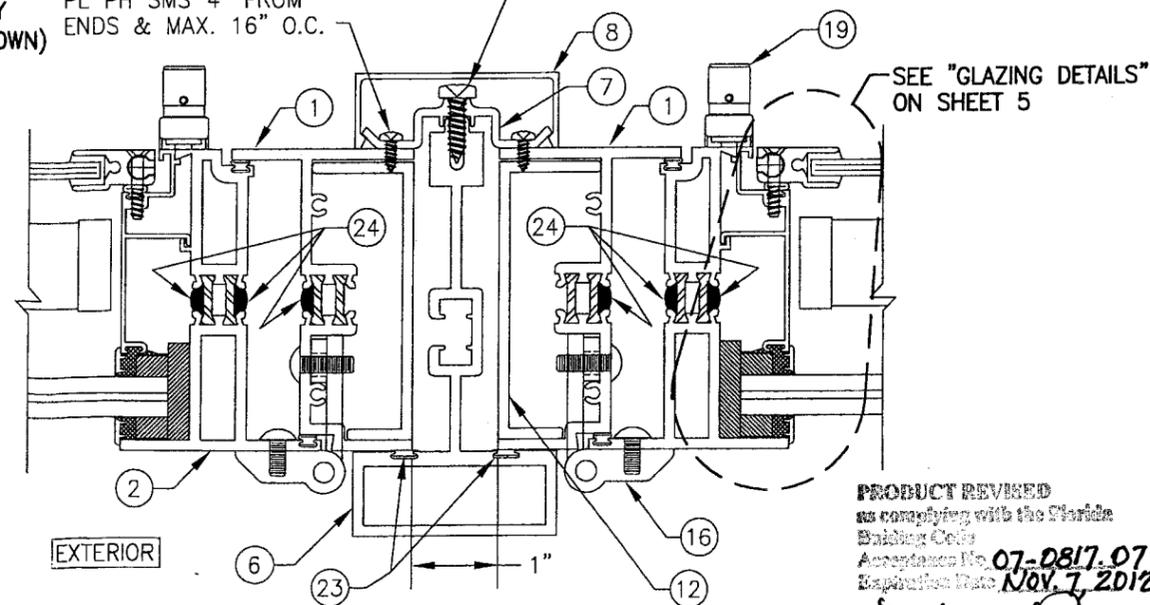


SECTION
 SCALE: 1/2 FULL
 (F) 2

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 07-0817.07
 Expiration Date Nov. 7, 2012
 By *Maureen Perez*
 Miami Code Product Control
 Division






DRAWN BY: J.C.F.		CHECKED BY: W.W.S.	
PLOT: 1=16		DATE: 02/27/02	
DATE	BY	REVISION DESCRIPTION	NO.
DRAWING TITLE: SERIES 810-I LARGE MISSILE IMPACT CASEMENT WINDOW			
CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.		MANUFACTURER: EFCO CORPORATION	
8895 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903		1000 COUNTY ROAD, P.O. BOX 609 MONETT, MO 65708-0609 800-221-4169	
CERTIFICATION: FEB 20 2008			
DRAWING NO. 1081		REV. A	
SHEET NO. 2 OF 5			

DRAWN BY: J.C.F.	CHECKED BY: W.W.S.
PLOT: 1=2	DATE: 02/27/02
DATE	BY
REVISION DESCRIPTION	NO.
DRAWING TITLE SERIES 810-1 LARGE MISSILE IMPACT CASEMENT WINDOW	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.	
MANUFACTURER EFCO CORPORATION	
1000 COUNTY ROAD, P.O. BOX 609 MONETT, MO 65708-0609 800-221-4169	
8895 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903	

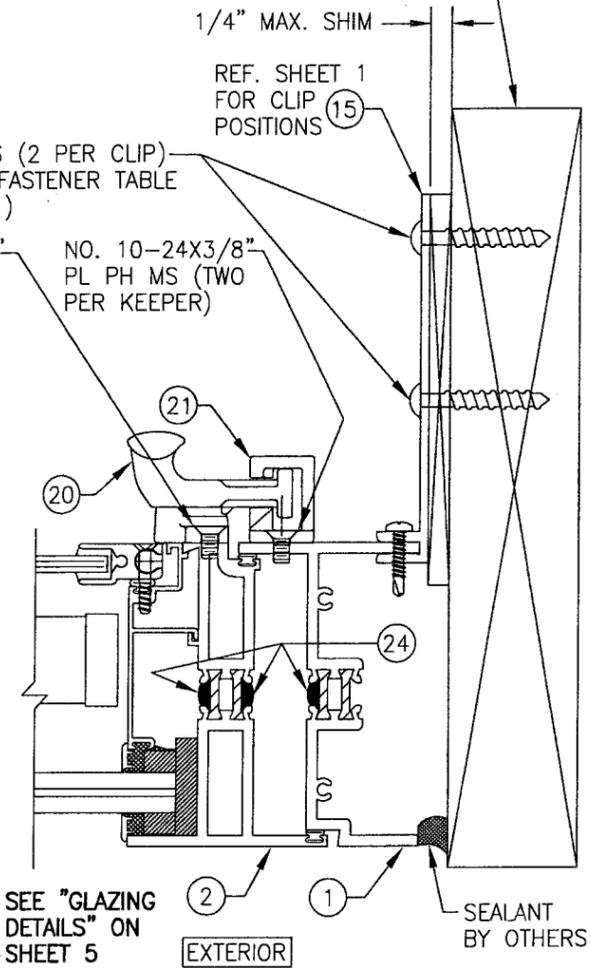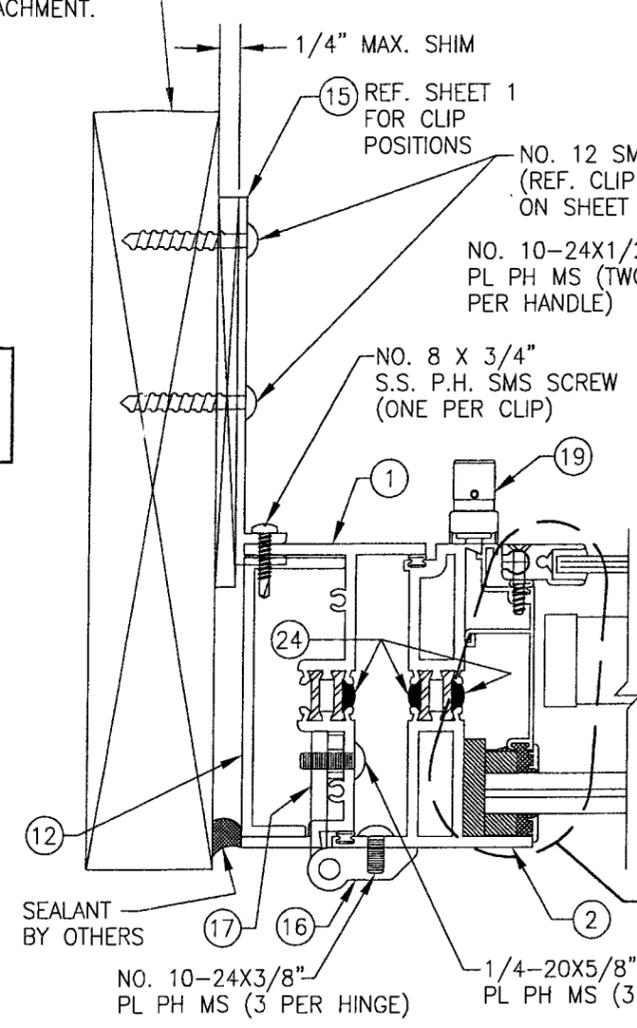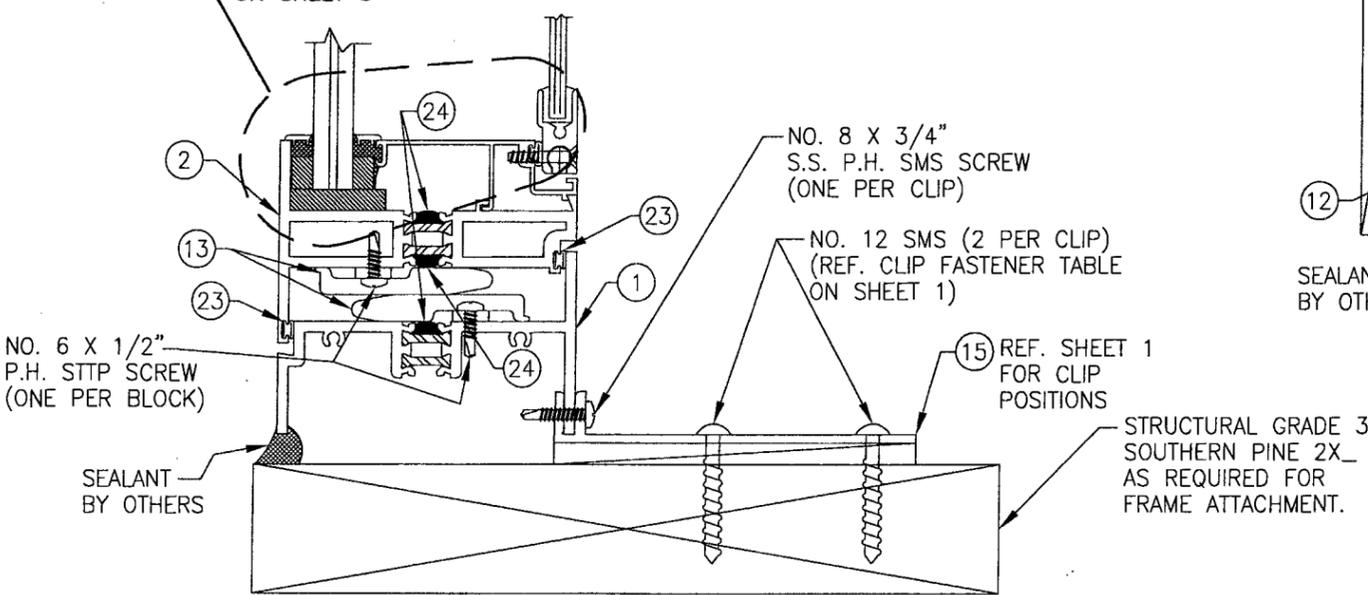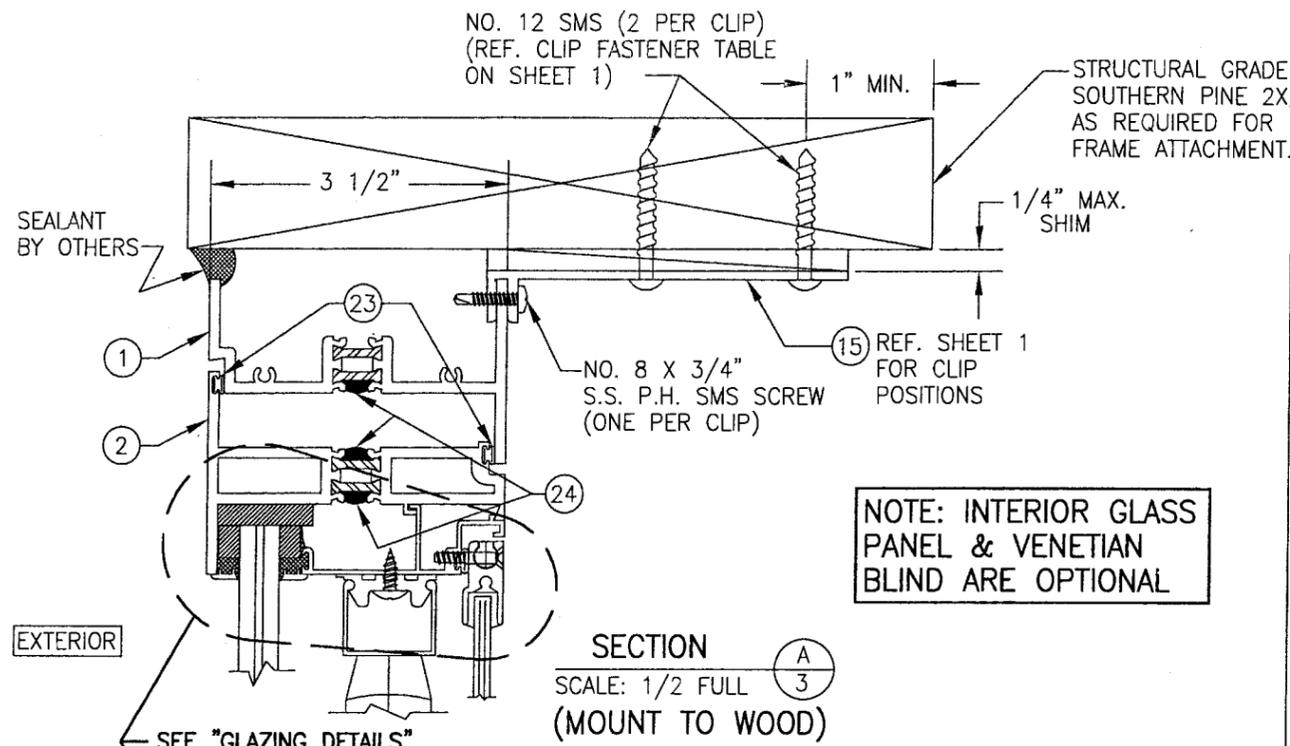

PRODUCT REVIEWED
as required by the Florida
Building Code
07-0817.07
Nov. 7, 2012
Manuel Perez
Product Control
Division


CERTIFICATION FEB 20 2008	WARREN W. SCHAEFER, P.E. P.E. NO. 44135
DRAWING NO. 1081	REV. A
SHEET NO. 3 OF 5	

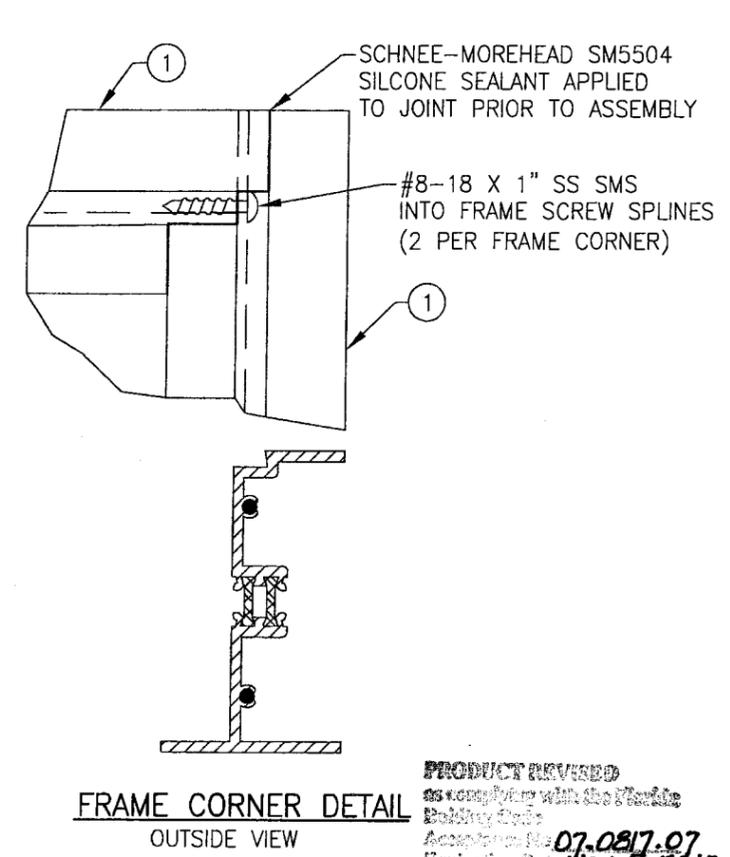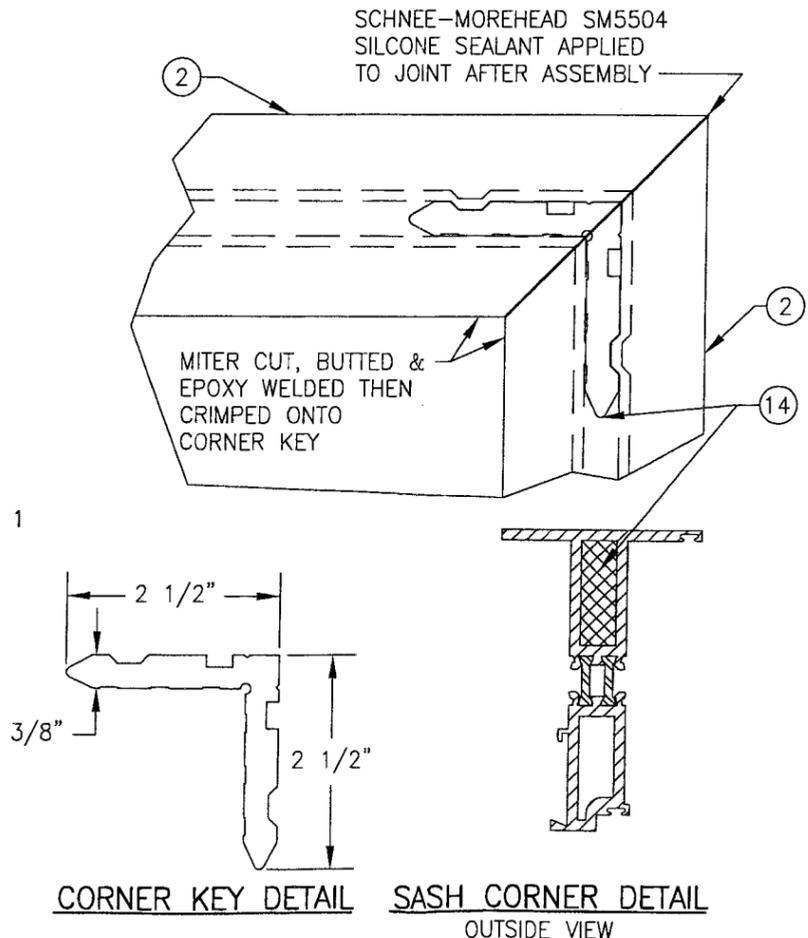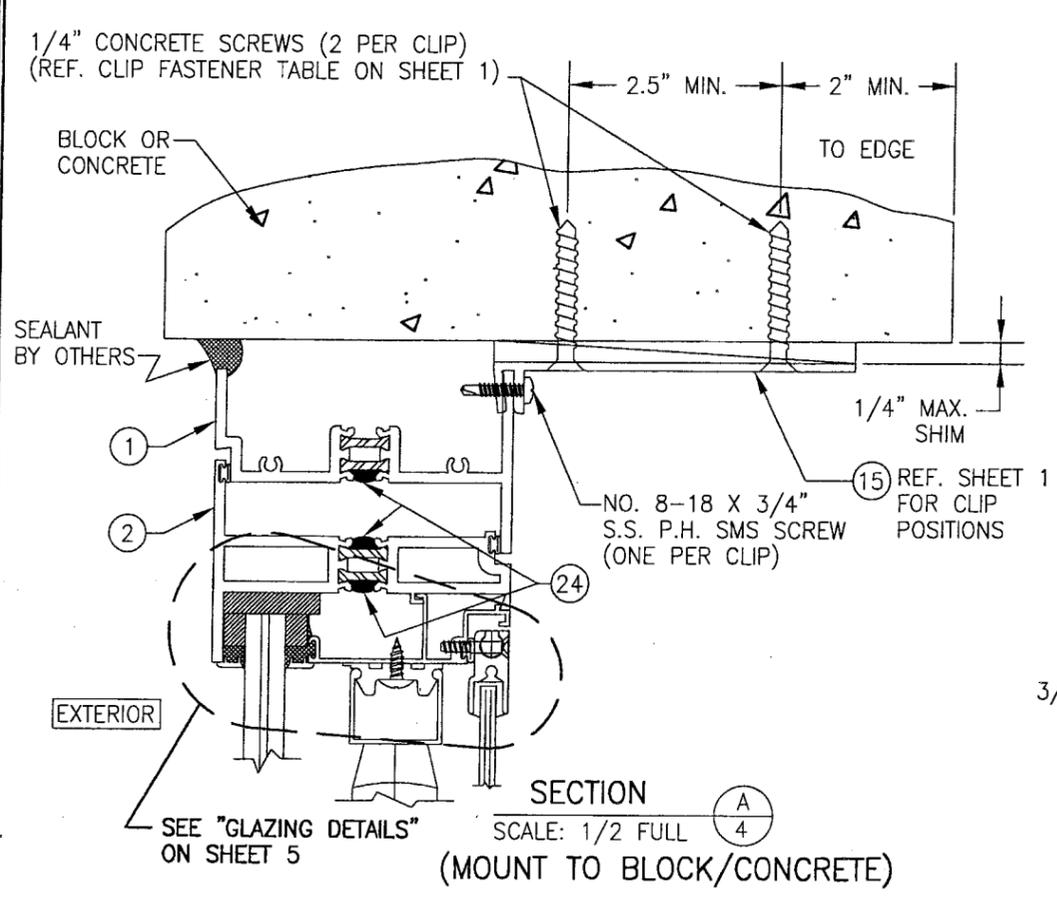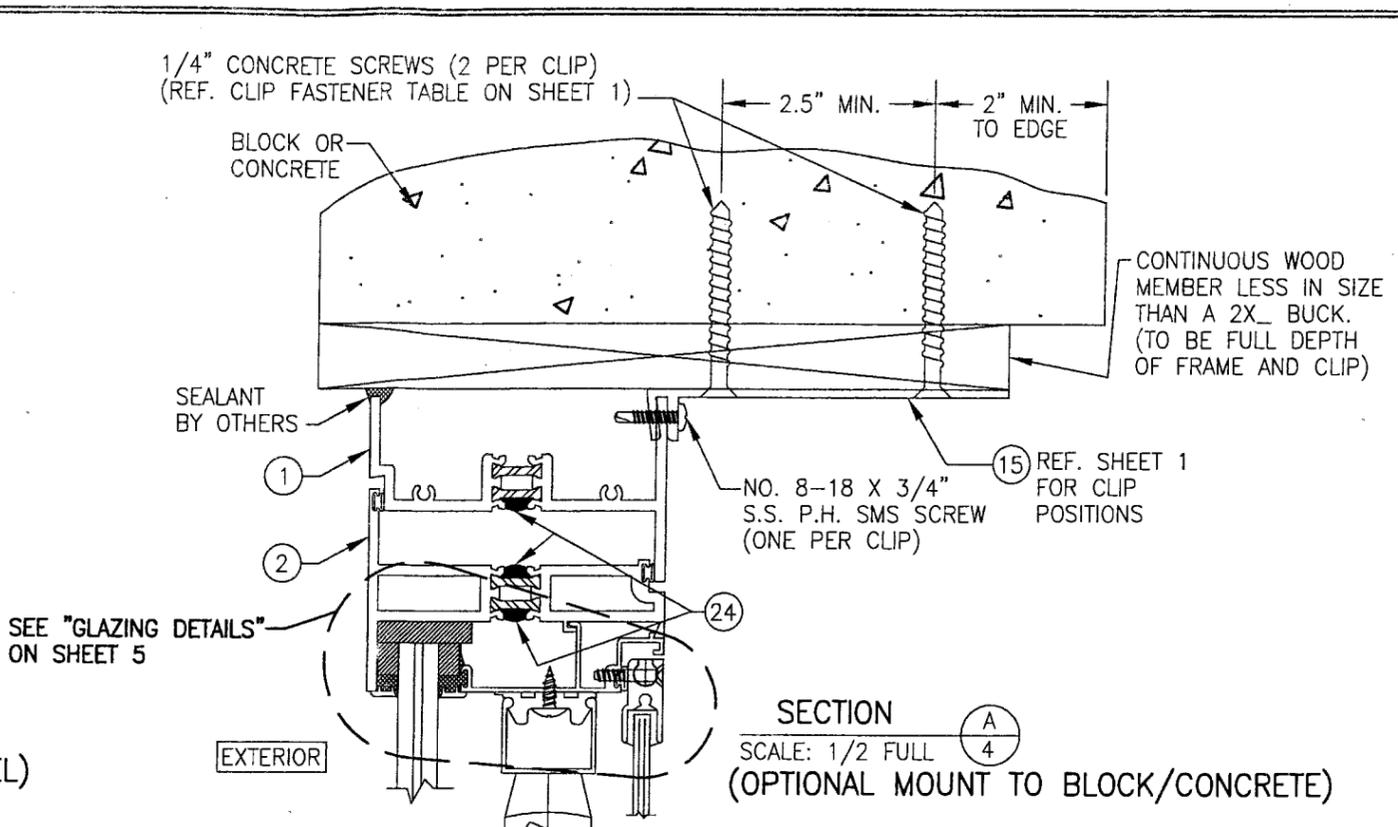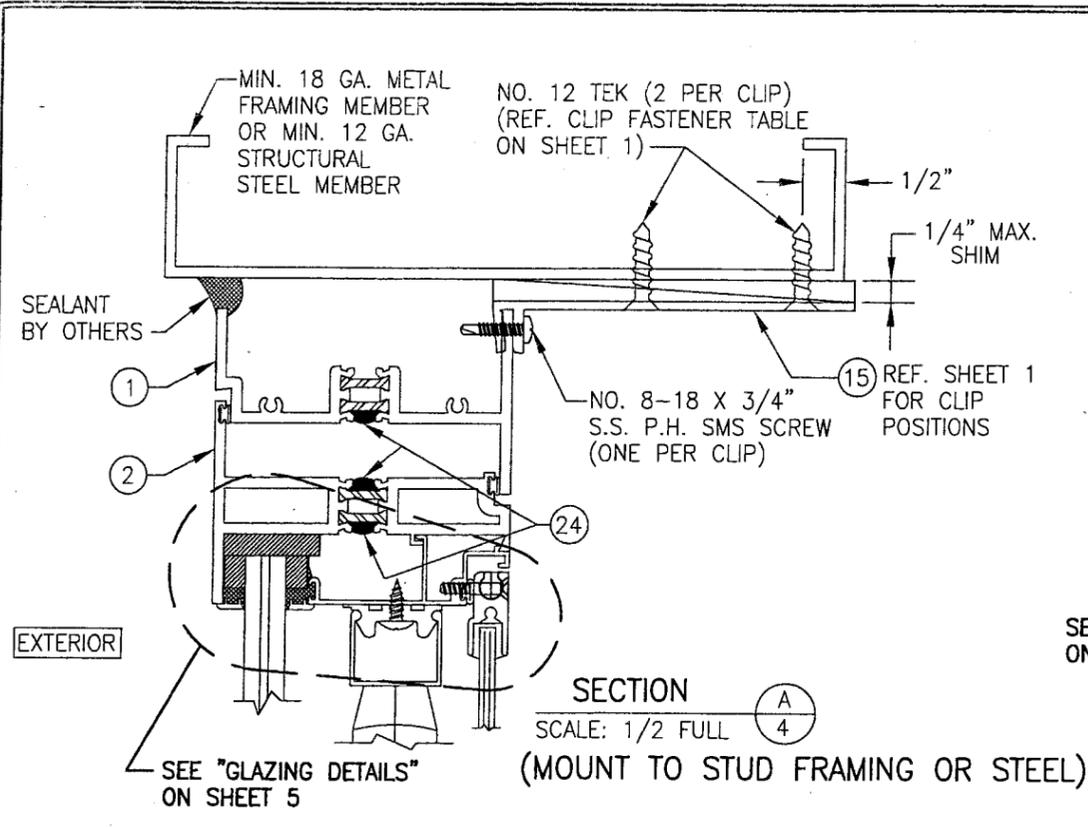

PRODUCT REVISED as complete with the Florida Building Code Acceptance Date 07.08.17.07 Nov. 7, 2012

By *Manuel Perez*


DRAWN BY: J.C.F.		CHECKED BY: W.W.S.	
PLOT: 1=2		DATE: 02/27/02	
NO.	REVISION DESCRIPTION	DATE	BY
DRAWING TITLE: SERIES 810-I LARGE MISSILE IMPACT CASEMENT WINDOW			
CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.		MANUFACTURER: EFCO CORPORATION	
8885 N. MILITARY TRAIL, SUITE C-204 PALM BEACH GARDENS, FL 33410 PHONE: 561-775-4902 FAX: 561-775-4903		1000 COUNTY ROAD, P.O. BOX 609 MONETT, MO 65708-0609 800-221-4169	
CERTIFICATION: <i>Manuel Perez</i>	DATE: FEB 20 2008	DRAWING NO. 1081	REV. A
SHEET NO. 4		OF 5	

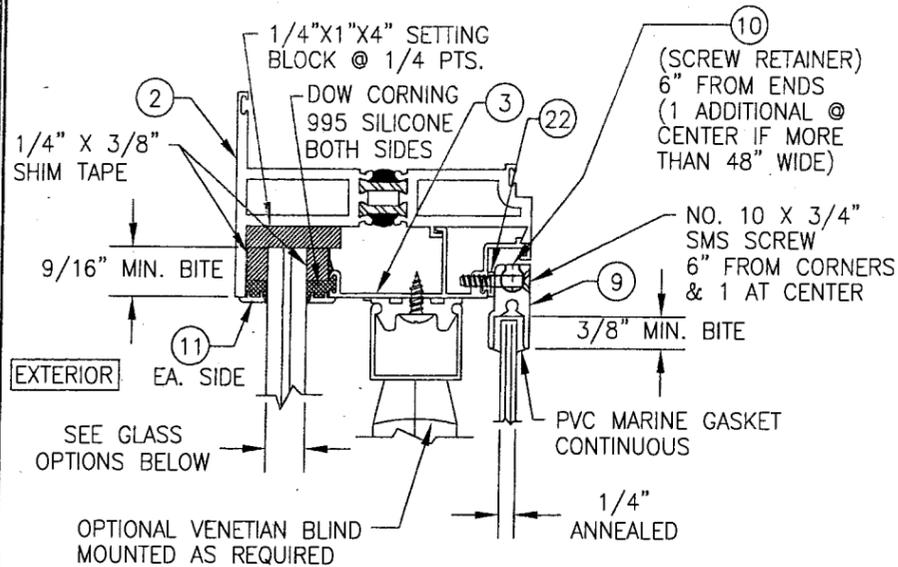


GLAZING DETAIL

GLASS OPTIONS

GLASS OPTION 1: 5/8" VIRACON STORM GUARD:
 (1/4" AN./0.10" SOLUTIA SAFLEX HP/ 1/4" AN.)
 GLASS OPTION 2: 5/8" NEBULA GLASSLAM SAFETY-PLUS:
 (1/4" AN./0.060" RESIN/0.010" PET/0.060" RESIN/ 1/4" AN.)
 GLASS OPTION 3: 9/16" SECURITY IMPACT GLASS
 SAF-GLAS: (1/4" HT. ST./0.015" SIG ADHESIVE/0.070"
 POLYCARB./0.015" SIG ADHESIVE/ 1/4" HT. ST.)

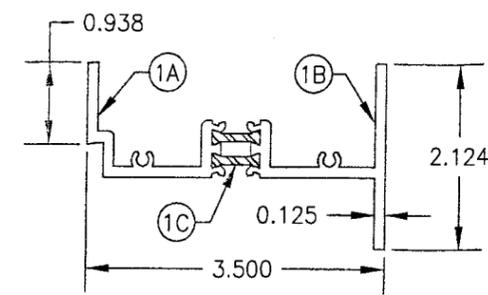


1 CASEMENT WINDOW FRAME ASSEMBLY

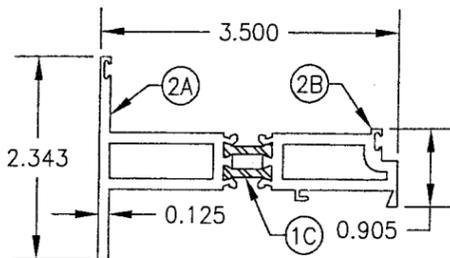


2 CASEMENT WINDOW SASH ASSEMBLY

ITEM #	PART	ITEM DESCRIPTION	MANUFACTURER/NOTES
PARTS			
1A	8019	FRAME EXTERIOR MEMBER	EFCO; 6063-T6 ALUMINUM
1B	8020	FRAME INTERIOR MEMBER	EFCO; 6063-T6 ALUMINUM
1C	LAA3	INSULBAR STRUT	ENSINGER PLASTICS
2A	8504	SASH EXTERIOR MEMBER	EFCO; 6063-T6 ALUMINUM
2B	8503	SASH INTERIOR MEMBER	EFCO; 6063-T6 ALUMINUM
3	EJ51	INT. GLAZING STOP	EFCO; 6063-T6 ALUMINUM
5A	8258	MEETING RAIL INTERIOR MEMBER	EFCO; 6063-T6 ALUMINUM
5B	8261	MEETING RAIL EXTERIOR MEMBER	EFCO; 6063-T6 ALUMINUM
6	1303	MULLION	EFCO; 6063-T6 ALUMINUM
7	EG78	MULLION CLIP	EFCO; 6063-T6 ALUMINUM
8	EG79	MULLION COVER	EFCO; 6063-T6 ALUMINUM
9	ER65	INTERNAL PANEL FRAME (OPTIONAL)	EFCO; 6063-T6 ALUMINUM
10	HMB7	INTERNAL PANEL SCREW RETAINER	EFCO; 6063-T6 ALUMINUM
11	LB00	GLAZING CAP	EFCO; RIGID VINYL
12	8888	HINGE SUPPORT	EFCO; 6063-T6 ALUMINUM
13	HB47	LIFT BLOCK	EFCO; NYLON
14	2878	CORNER KEY	EFCO; 6063-T6 ALUMINUM
15	1880	F-ANCHOR	EFCO; 6063-T6 ALUMINUM
HARDWARE			
16	2933	HINGE (SASH SIDE)	EFCO; 6063-T6 ALUMINUM
17	2935	HINGE (FRAME SIDE)	EFCO; 6063-T6 ALUMINUM
18	HA15	HINGE SHIM	EFCO; 6063-T6 ALUMINUM
19	5005/5006	VENETIAN BLIND TILT KNOB (OPTIONAL)	EFCO; 6063-T6 ALUMINUM
20	HU41/HU42	CAM HANDLE	BRONZE CRAFT (MANGANESE ALLOY)
21	HK10	CAM HANDLE KEEPER	BRONZE CRAFT (MANGANESE ALLOY)
SEALS & SEALANTS			
22	WVB4	CONT. VINYL BULB SEAL	65 DUROMETER
23	WA04	CONT. VINYL BULB SEAL	73 DUROMETER
24	-	INSULBAR SEALANT (CONTINUOUS)	COLOR DOW 795

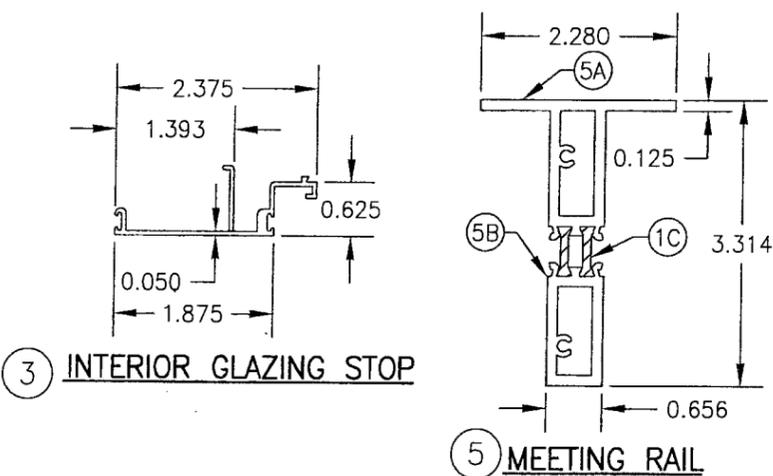


3 INTERIOR GLAZING STOP


5 MEETING RAIL

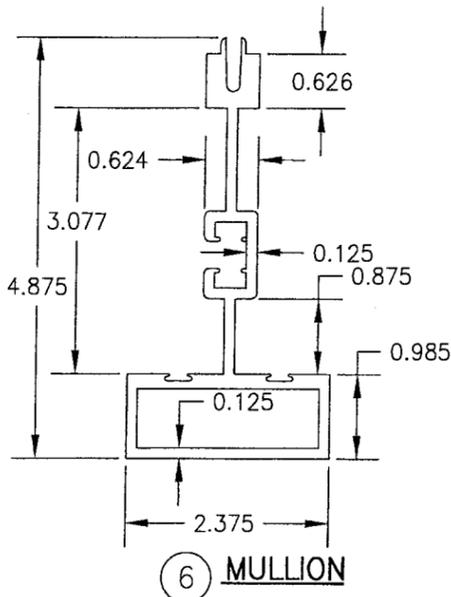


6 MULLION

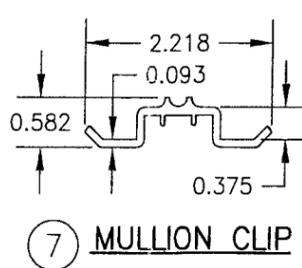


7 MULLION CLIP



8 MULLION COVER

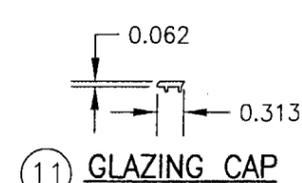

11 GLAZING CAP

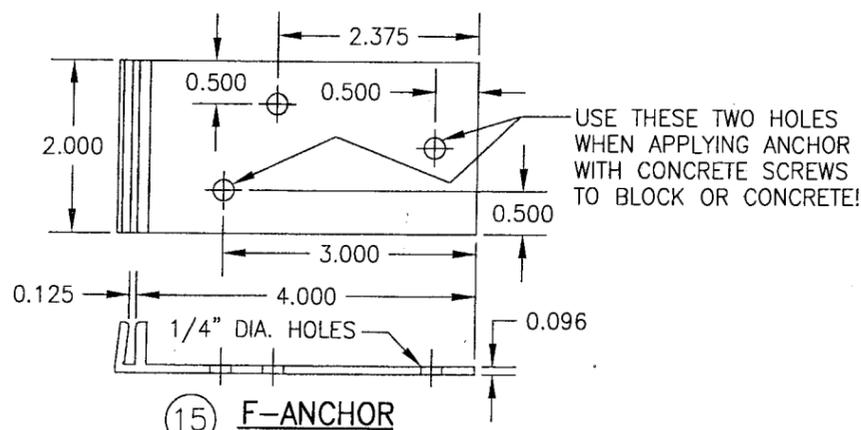

15 F-ANCHOR

DRAWING TITLE: **SERIES 810-1 LARGE MISSILE IMPACT CASEMENT WINDOW**

CONSULTANTS: **W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.**
 8895 N. MILITARY TRAIL, SUITE C-204
 PALM BEACH GARDENS, FL 33410
 PHONE: 561-775-4902 FAX: 561-775-4903

DRAWN BY: J.C.F. CHECKED BY: W.W.S.
 PLOT: 1=2 DATE: 02/27/02

REVISION DESCRIPTION: NO. 1

MANUFACTURER: **EFCO CORPORATION**
 1000 COUNTY ROAD, P.O. BOX 609
 MONETT, MO 65708-0609
 800-221-4169

CERTIFICATION: **FEB 20 2012**
 WARREN W. SCHAEFER, P.E.
 P.E. NO. 44135

PRODUCT REVISED as complying with the Florida Building Code
 Acceptance No. **07-0817.07**
 Expiration Date **NOV. 7, 2012**

By **Maurel Perry**
 Miami Dade Product Control Division

DRAWING NO. **1081** REV. **A**
 SHEET NO. **5** OF **5**