



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908
www.buildingcodeonline.com

NOTICE OF ACCEPTANCE (NOA)

E.S. Windows, LLC
10653 NE Quaybridge Ct.
Miami, Fl.33138

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "6100" Aluminum Sliding Glass Doors w/ reinforcements-SMI

APPROVAL DOCUMENT: Drawing No. **W07-26**, titled "series -6100 Alum Sliding Glass Door(SMI)", sheets 1 through 9 of 9, prepared by Al-Farooq Corporation, dated 04-04-07 and last revised on Jul 16, 2007, signed and sealed by Dr. Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Small Missile Impact Resistant

Limitation:1. OC min spacing of Elco Tapcon anchor clusters at head =2.312" & clusters at sill =3.0"

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 07-0411.12 consists of this page 1 and evidence page as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**

NOA No 07-0828.08
Expiration Date: June 14, 2012
Approval Date: October 04, 2007
Page 1



7/12/17

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS (transferred from file # 07-0411.12)

1. Manufacturer's die drawings and sections.
2. Drawing No. **W07-26**, titled "series -6100 Alum Sliding Glass Door(SMI)", sheets 1 through 9 of 9, prepared by Al-Farooq Corporation, dated 04-04-07 and last revised on Jul 16, 2007, signed and sealed by Dr. Humayoun Farooq, P.E.
(Note: the revision consists of an add-on sill)

B. TESTS (transferred from file # 07-0411.12)

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Small Missile Impact Test, per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading, per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of aluminum SGD, prepared by Fenestration Testing Laboratories, Test Report No. **FTL- 5076(FTL06165)**, dated 02/22/07, **FTL- 5157(FTL061116)**, dated 02/14/07 and **FTL- 5158(FTL06115)** dated 02/13/07, all signed and sealed by Michael Wenzel, P.E.

(The test report No. **FTL- 5076** has been revised an addendum letter dated July 10, 2007, issued by Fenestration testing lab, signed & sealed by Carlos S. Roinda, P. E.)

C. CALCULATIONS (transferred from file # 07-0411.12)

1. Anchor verification calculations and structural analysis, prepared by Al Farooq Corporation, dated 04/09/07 signed and sealed by Dr. Humayoun Farooq, P.E.
2. Glazing complies w/ ASTM E-1300-02

D. QUALITY ASSURANCE BY:

1. Miami-Dade County Building Code Compliance Office (BCCO)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **05-1208.02** issued to E.I. DuPont DeNemours for "Butacite PVB Interlayer", expiring on 12-11-2010

F. STATEMENTS

1. Addendum letter dated July 10, 2007, issued by Fenestration testing lab, signed & sealed by Carlos S. Roinda, P. E.
2. Statement letter of conformance and "No financial interest", dated 07/13/07, signed and sealed by Dr. Humayoun Farooq, P.E.
3. Statement letter of conformance and "No financial interest", dtd 04/03/07, signed and sealed by Dr. Humayoun Farooq, P.E. (transferred from file # 07-0411.12)
4. Laboratory compliance statements, part of the above referenced test reports.

G. OTHER

1. This NOA revises NOA # 07-0411.12, expiring June 14, 2012.

Ishaq I. Chanda


Ishaq I. Chanda, P.E.

Product Control Examiner


NOA No 07-0828.08

Expiration Date: June 14, 2012


Approval Date: October 04, 2007

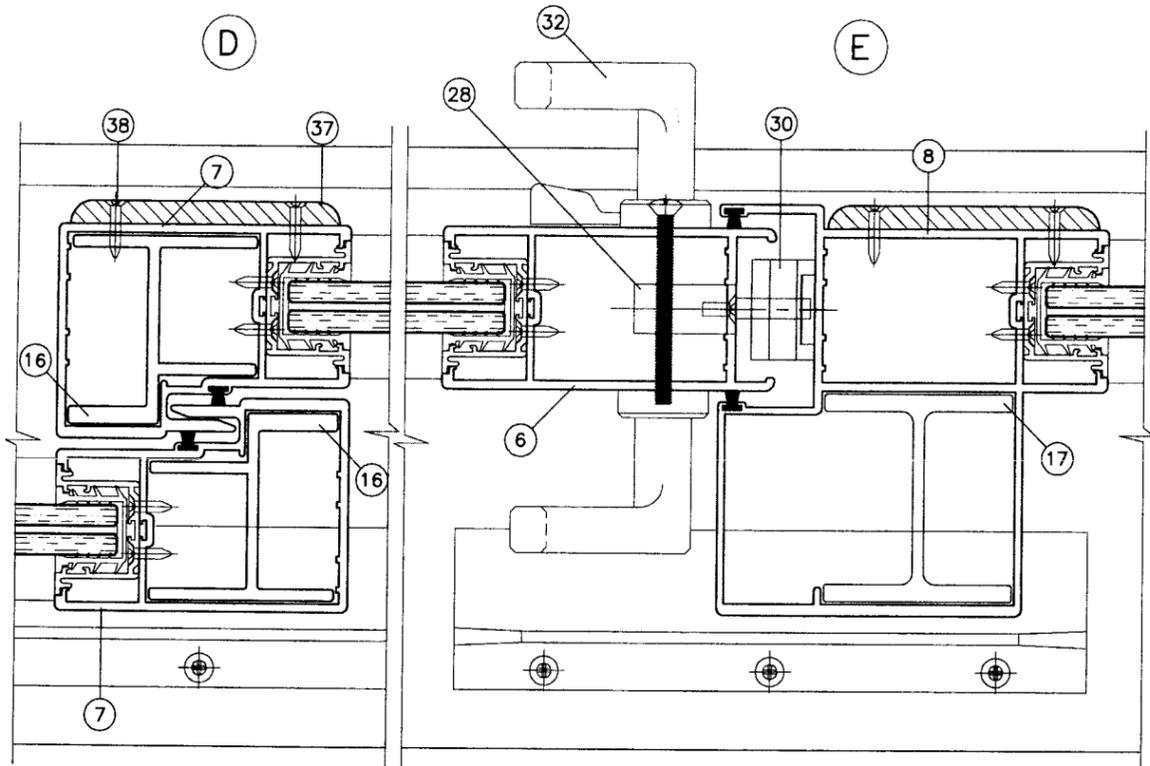

ALUM REINFORCING

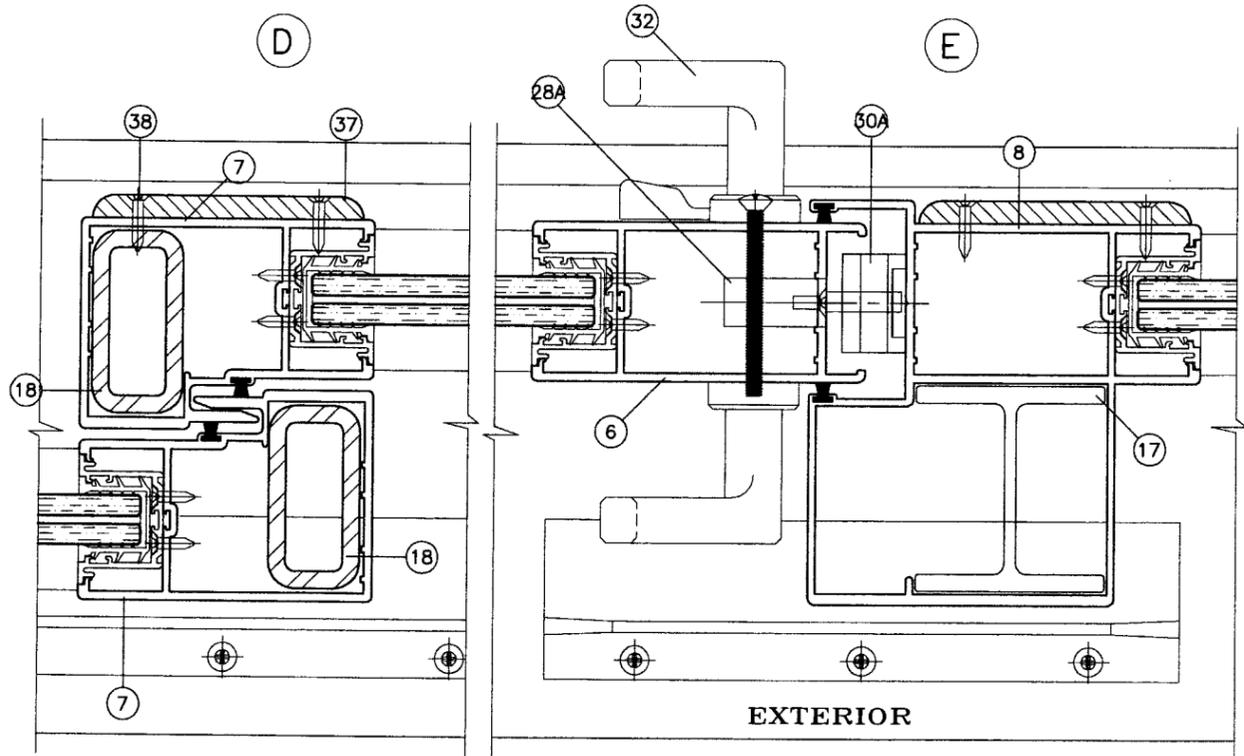

STEEL REINFORCING

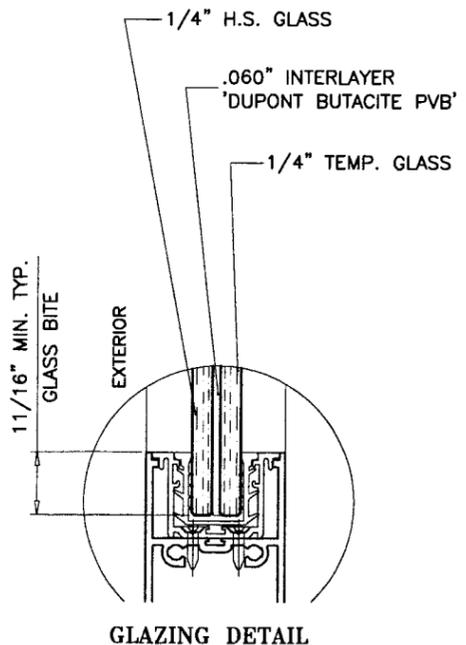

GLAZING DETAIL

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-02 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

DESIGN LOAD CAPACITY - PSF						
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	ALUM REINFOR'G		STEEL REINFOR'G		
		EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	
36	80	85.0	140.0	85.0	110.0	
40		85.0	140.0	85.0	110.0	
44		85.0	140.0	85.0	110.0	
48		85.0	140.0	85.0	110.0	
50		85.0	140.0	85.0	110.0	
53		85.0	140.0	85.0	110.0	
56		85.0	140.0	85.0	110.0	
60		85.0	100.0	85.0	110.0	
36	96	85.0	140.0	85.0	110.0	
40		85.0	136.4	85.0	110.0	
44		85.0	127.4	85.0	110.0	
48		85.0	120.0	85.0	110.0	
50		85.0	100.0	85.0	110.0	
53		85.0	100.0	85.0	110.0	
56		85.0	100.0	85.0	110.0	
60		85.0	100.0	85.0	110.0	
36	102	85.0	100.0	85.0	110.0	
40		85.0	100.0	85.0	110.0	
44		85.0	100.0	85.0	110.0	
48		85.0	100.0	85.0	110.0	
50		85.0	100.0	85.0	110.0	
53		85.0	100.0	85.0	110.0	
56		85.0	100.0	85.0	110.0	
36	108	85.0	100.0	85.0	110.0	
40		85.0	100.0	85.0	110.0	
44		85.0	100.0	85.0	110.0	
48		85.0	100.0	85.0	110.0	
50		85.0	99.9	85.0	110.0	
53		85.0	96.0	85.0	110.0	
56			85.0	100.0	85.0	110.0
36	114	85.0	100.0	85.0	110.0	
40		85.0	100.0	85.0	110.0	
44		85.0	100.0	85.0	110.0	
48		85.0	96.0	85.0	110.0	
50		85.0	93.2	85.0	108.2	
53			85.0	100.0	85.0	110.0
56			85.0	100.0	85.0	110.0
36	120	85.0	100.0	85.0	110.0	
40		85.0	100.0	85.0	110.0	
44		85.0	96.2	85.0	110.0	
48		85.0	90.0	85.0	104.5	

* THESE SIZES QUALIFY FOR +85.0, -110.0 PSF
USING 5/16" TAPCONS AT SILL CLUSTERS ONLY.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 07-0828-08
Expiration Date: JUNE 14, 2012
By: *Shag I. Chank*
Miami Date Product Control
Division


Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

JUL 16 2007





af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W07-26ES

SERIES-6100 ALUM SLIDING GLASS DOOR (S.M.I.)
E.S. WINDOWS
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL. (305) 640-9857 FAX. (305) 593-2074

revisions:	no	date	description
	A	07.12.07	NO CHANGE THIS SHEET
date:	04-04-07	scale:	1/2" = 1"
dr. by:	HAMID	chk. by:	
drawing no.	W07-26		
sheet 2 of	9		

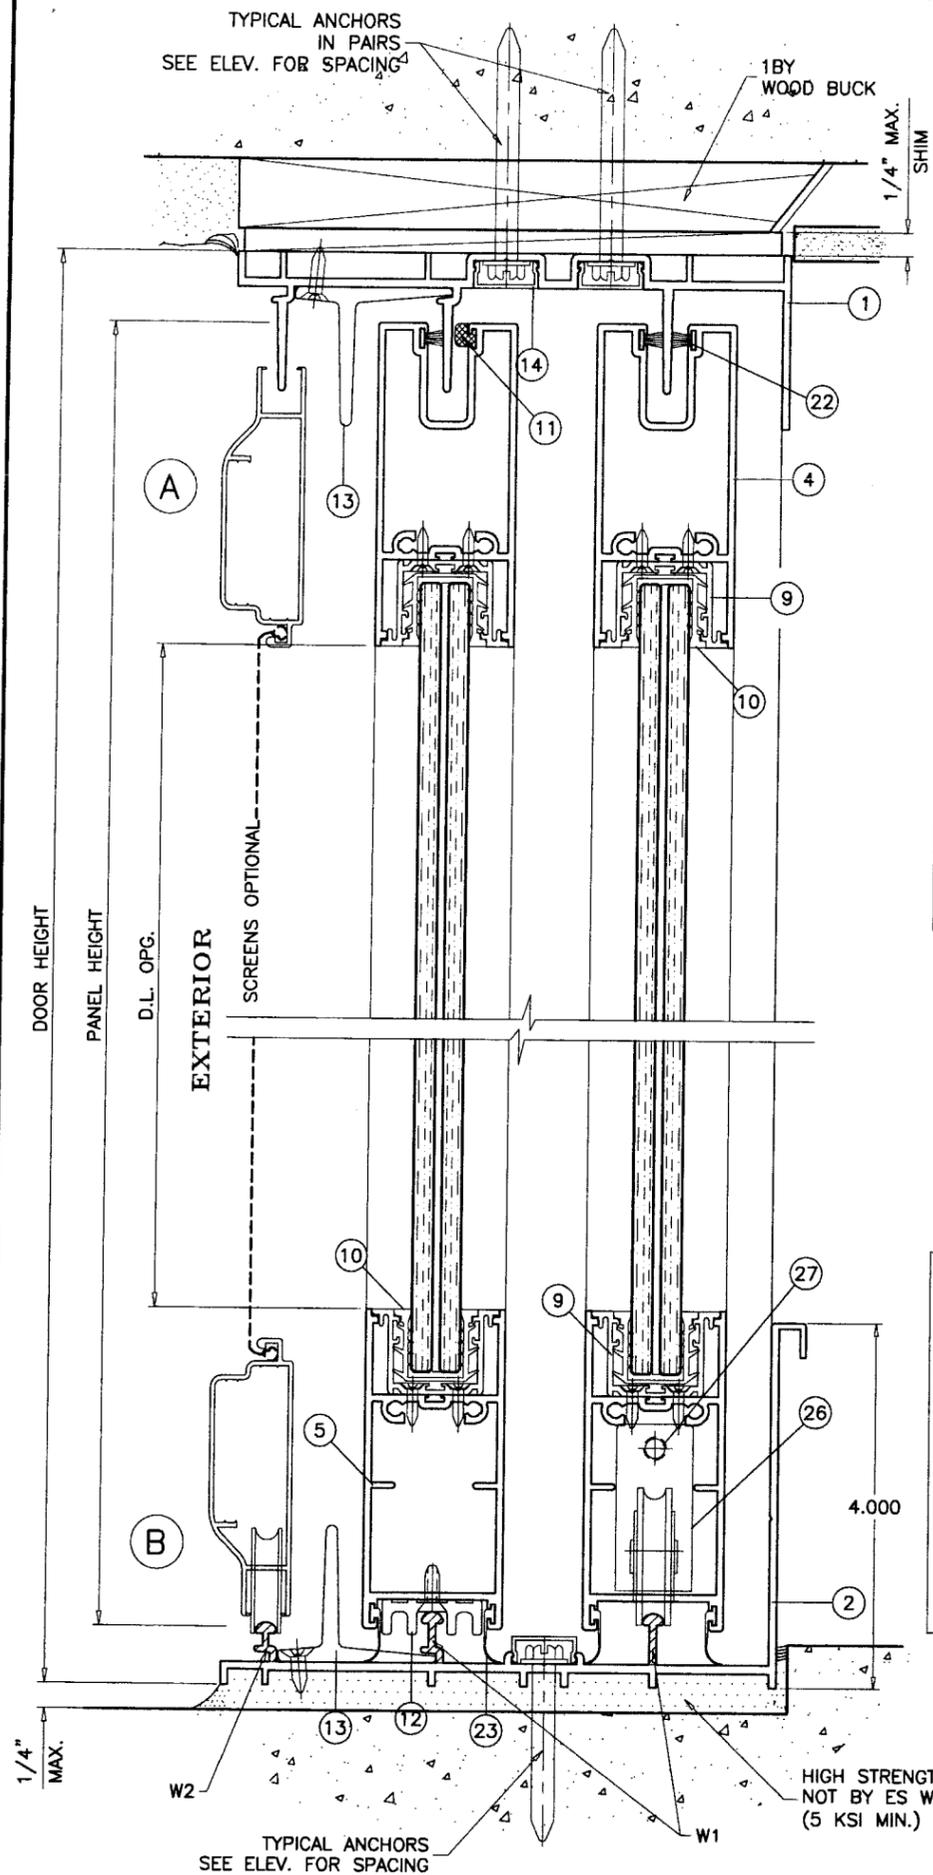

WOOD BUCKS AND METAL STRUCTURE NOT BY E.S. WINDOWS MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

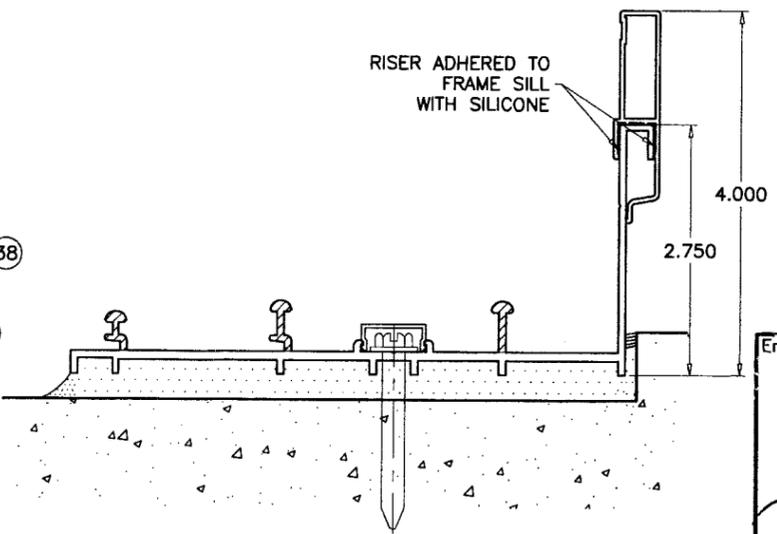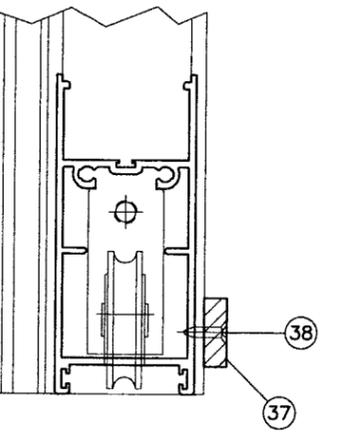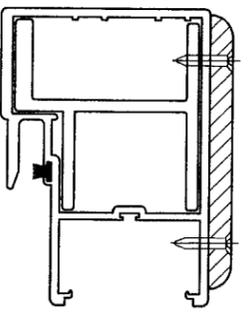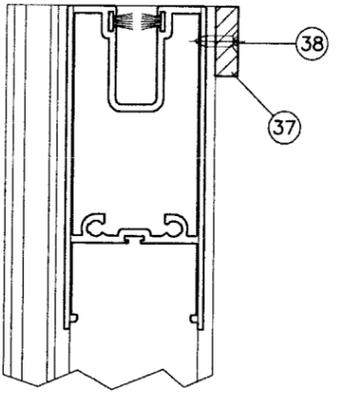

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
1/4" TAPCONS OR 5/16" TAPCONS
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-3/4" MIN. EMBED INTO CONC. OR MASONRY
1/4" TEKS OR SELF DRILLING SCREWS
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#12 SMS OR SELF DRILLING SCREWS
 INTO DADE COUNTY APPROVED MULLIONS
 (NO SHIM SPACE)

MIN. EDGE DISTANCES
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD & SILL = fc' = 3000 PSI MIN.
 MASONRY BLOCK AT JAMBS = fm' = 1500 PSI MIN.

SEALANT:
 ALL JOINTS AND FRAME CONNECTIONS SEALED WITH
 WHITE/ALUMINUM COLORED SILICONE.

WEEPHOLES:
 W1 = 2-5/8" LONG WEEP NOTCH AT EACH END
 W2 = 1" LONG WEEP NOTCH AT EACH END

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 07-082808
 Expiration Date June 14, 2012
 by *Shah I. Khan*
 Miami Dade Product Control
 Division

Engr: DR. HUMAYOON FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

[Signature]
 JUL 16 2007





af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W07-26ES

SERIES-6100 ALUM SLIDING GLASS DOOR (S.M.I.)
E.S. WINDOWS
 5220 N.W. 72 AVE. BAY #4
 MIAMI, FL. 33166
 TEL. (305) 640-9857 FAX. (305) 593-2074

revisions:	no	date	description
	A	07.12.07	SILL W/ RISER ADDED

date:	04-04-07
scale:	1/2" = 1"
dr. by:	HAMID
chk. by:	

drawing no.	W07-26
sheet	3 of 9

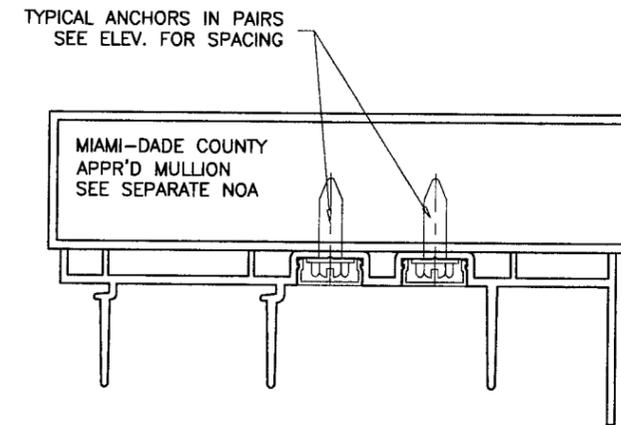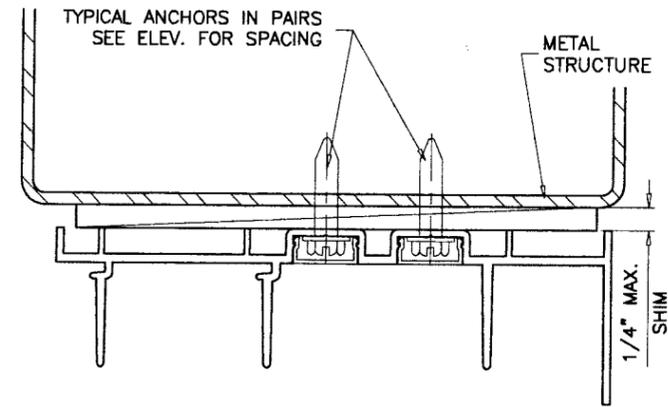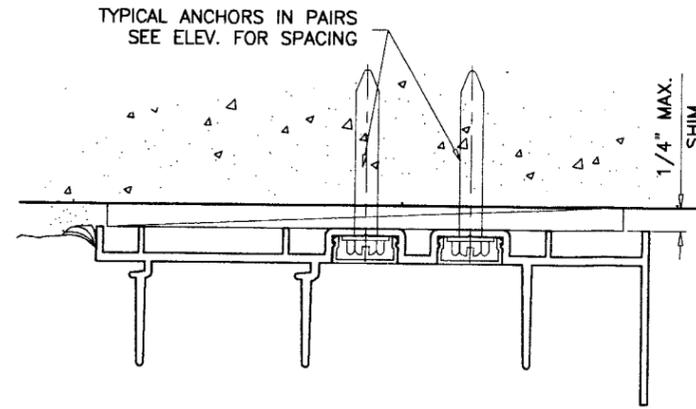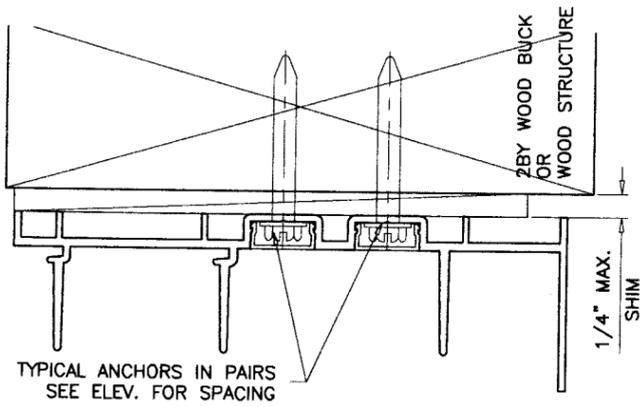

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 07-0829-08
 Expiration Date JUNE 14, 2011
 By Ishag I. Chanda
 Miami Dade Product Control
 Division

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 18557
 C.A.N. 3538
 JUL 16 2007


af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W07-26ES

SERIES-6100 ALUM SLIDING GLASS DOOR (S.M.I.)
E.S. WINDOWS
 5220 N.W. 72 AVE. BAY #4
 MIAMI, FL. 33166
 TEL. (305) 640-9857 FAX. (305) 593-2074

revisions:	no	date	by	description	NO CHANGE THIS SHEET
	A	07.12.07			


date: 04-04-07
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W07-26
 sheet 4 of 9

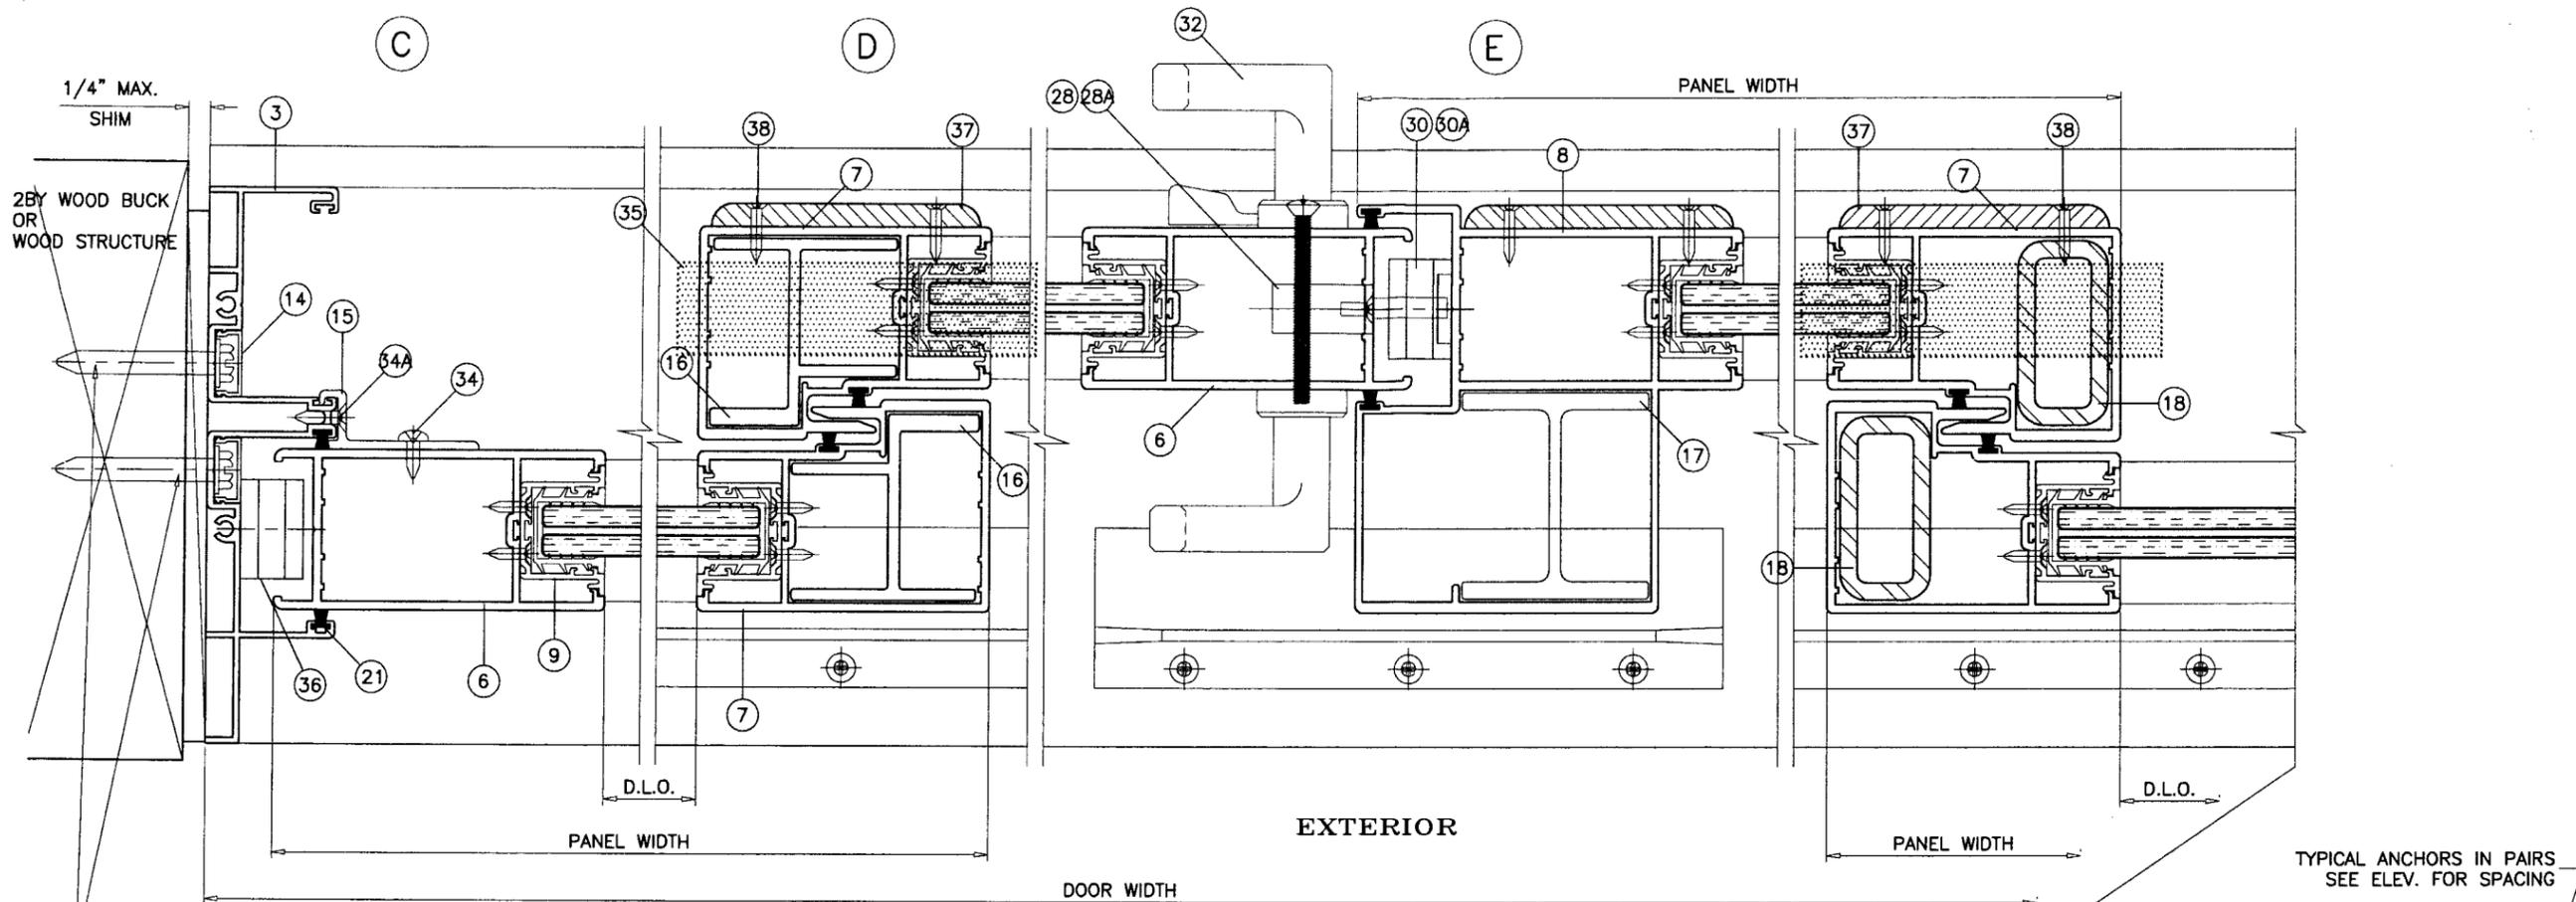

EXTERIOR

SEE SHEET 2 FOR REINFORCING DETAILS

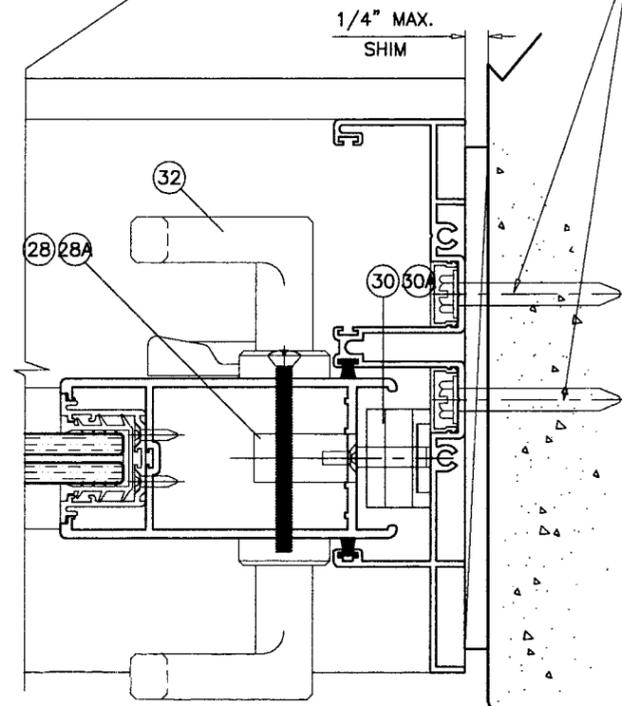

Engr: DR. HJ MAYOON FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

JUL 16 2007

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 07-0828-08
Expiration Date JUNE 14, 2012
By Ishag I. Chanda
Miami Dade Product Control
Division

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W07-26ES

SERIES-6100 ALUM SLIDING GLASS DOOR (S.M.I.)
E.S. WINDOWS
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL. (305) 640-9857 FAX. (305) 593-2074

revisions:	no	date	by	description
	A	07.12.07		NO CHANGE THIS SHEET

date: 04-04-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W07-26
sheet 5 of 9

afc

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W07-26ES

SERIES-6100 ALUM SLIDING GLASS DOOR (S.M.I.)


E.S. WINDOWS
 5220 N.W. 72 AVE. BAY #4
 MIAMI, FL. 33166
 TEL. (305) 640-9857 FAX. (305) 593-2074

no	date	description	by
A	07.12.07	NO CHANGE THIS SHEET	

date: 04-04-07
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W07-26

sheet 6 of 9

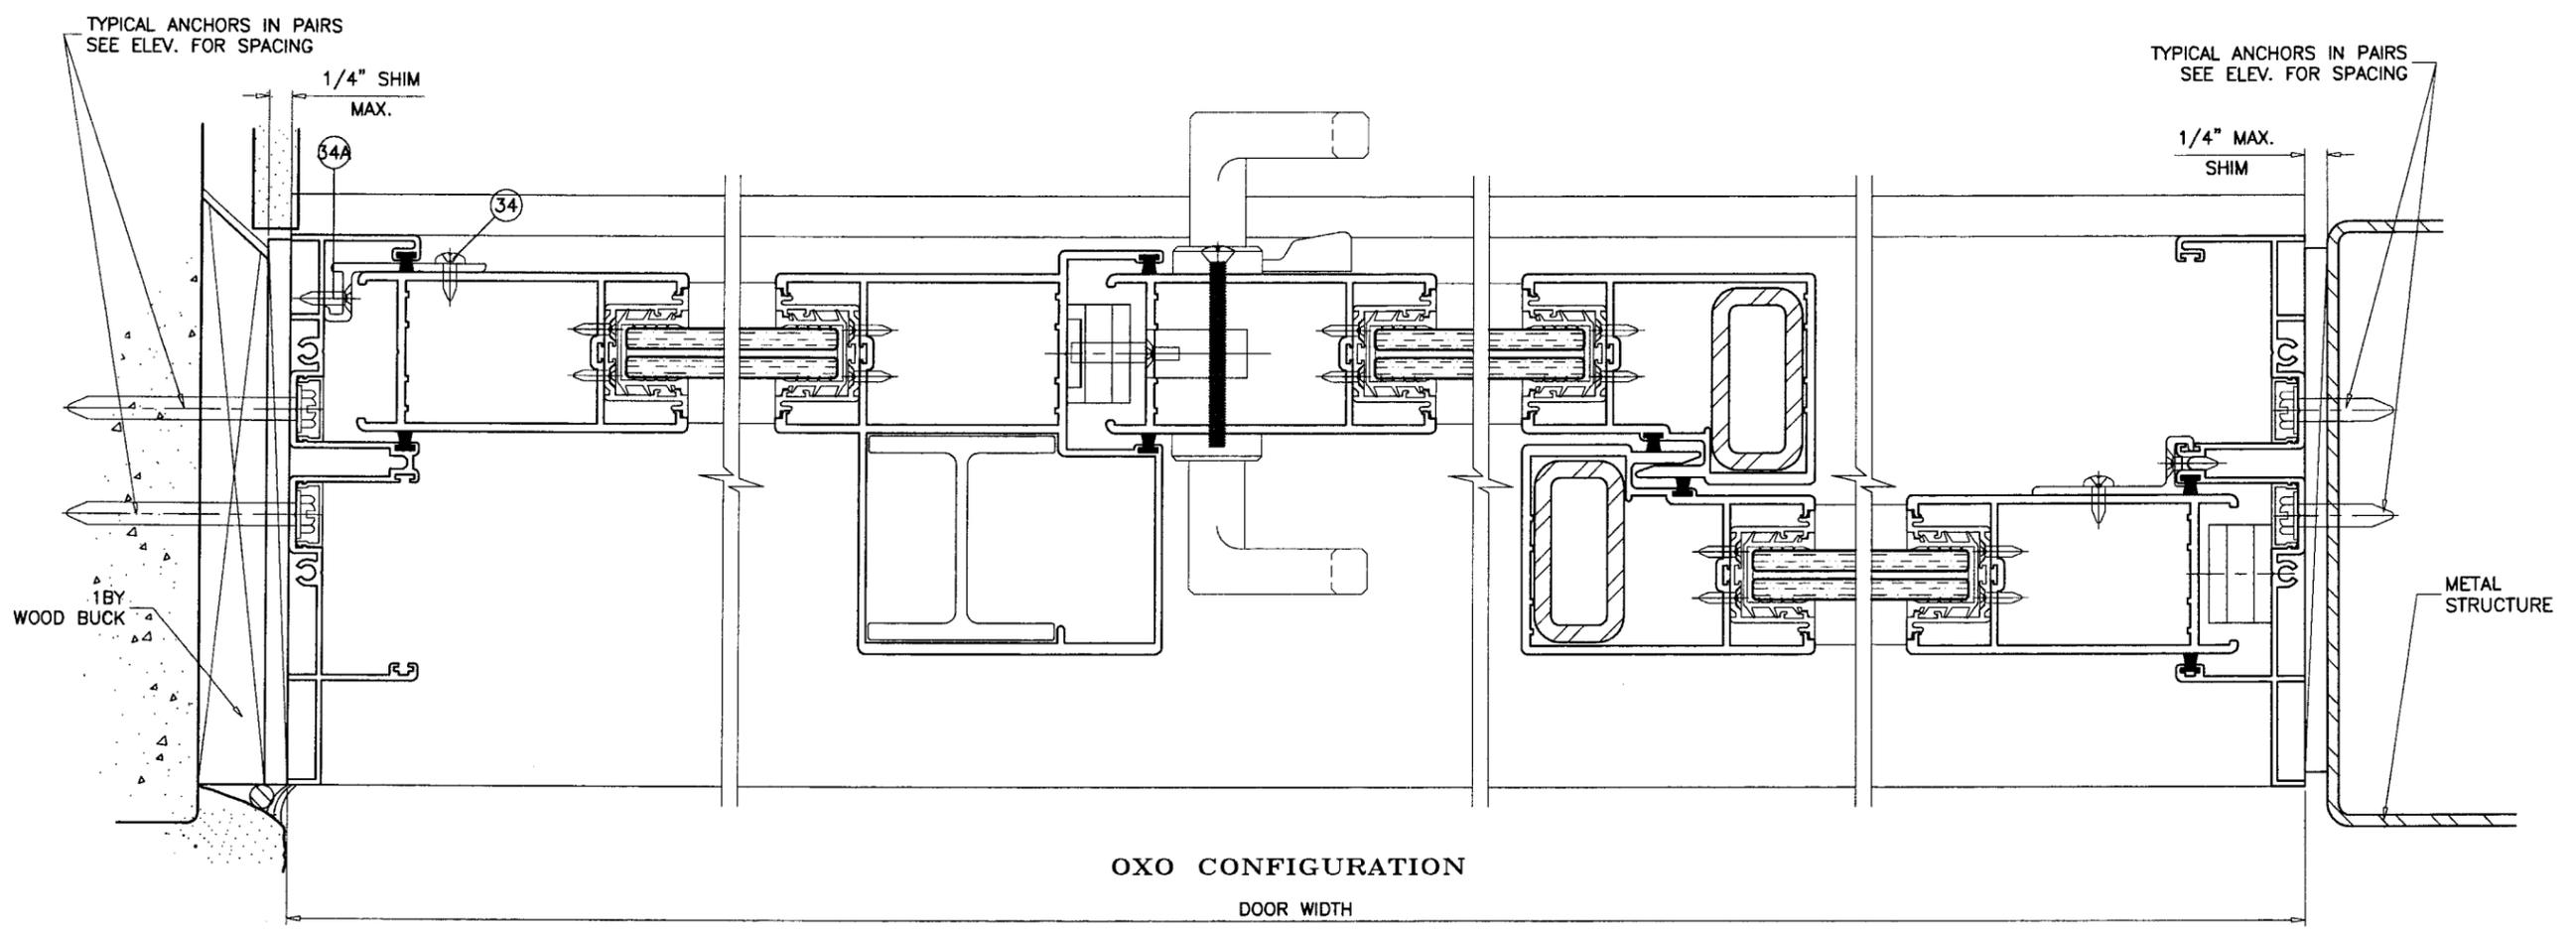

SEE SHEET 2 FOR REINFORCING DETAILS

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 07-0828-08
 Expiration Date JUNE 14, 2012
 By Ishag I. Chaudh
 Miami Dade Product Control
 Division

Engr. DR. HUMAYOON FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

[Signature]

JUL 16 2007

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	ES6001	1	FRAME HEAD	6005-T5	-
2	ES6023	1	FRAME SILL - 4"	6005-T5	-
2A	ES6002	1	ALT. FRAME SILL - 2-3/4"	6005-T5	-
3	ES6003	1	FRAME JAMB	6063-T6	-
4	ES6004	2/ PANEL	TOP RAIL	6063-T6	-
5	ES6005	2/ PANEL	BOTTOM RAIL	6063-T6	-
6	ES6006	AS REQD.	LOCK STILE	6063-T6	-
7	ES6007	AS REQD.	INTERLOCK	6063-T6	-
8	ES6008	AS REQD.	FEMALE ASTRAGAL	6063-T6	-
9	ES6009	AS REQD.	GLAZING ADAPTER	6063-T6	-
10	ES6018	AS REQD.	GLAZING GASKET	NEOPRENE	-
11	ES6016	4/ PANEL	PANEL GUIDE (TOP ONLY)	CELCON	-
12	ES6015	2/ PANEL	FIXED PANEL BOTTOM GUIDE	6063-T6	SECURE W/ (2) #10 FH SMS
13	ES6010	2/ PANEL	RETAINER CLIP, 6" LONG	6005-T5	AT MTG. RAIL HEAD & SILL ENDS
14	ES6011	2/ JAMB	JAMB SCREW COVER	6063-T5	OPTIONAL
15	ES6014	3/ FIX. PANEL	FIXED PANEL CLIP	6063-T6	AT 7" FROM EACH END AND AT MIDSPAN
16	ES6012	AS REQD.	INTERLOCK STIFFENER	6063-T6	-
17	ES6013	AS REQD.	ASTRAGAL STIFFENER	6063-T6	-
18	1" X 2" X 3/16"	AS REQD.	STEEL TUBE REINFORCING	-	TO BE PAINTED
21	W222521K	AS REQD.	STILE & JAMB W'STRIPPING	-	ULTRAFAB
22	W223221K	AS REQD.	TOP RAIL W'STRIPPING	-	ULTRAFAB
23	ES6027	AS REQD.	BOTTOM RAIL W'STRIPPING	VINYL	GLASS PANELS
24	#10X1-1/2" PH SMS	8/ PANEL	PANEL ASSY SCREWS	-	-
25	#10X1-1/2" PH SMS	2/ CORNER	FRAME ASSY SCREWS	-	-
26	1939-7585-55	2/ MOV. PANEL	GLASS PANEL ROLLER ASSY.	ST. STEEL	1-1/4" O.D. WHEELS
27	1/4-20 X 3/4" PH MS	1/ ROLLER	ROLLER INST. SCREWS	-	-
28	2300-10SS	1/ MOV. PANEL	STD. MORTISE LOCK	ST. STEEL	-
28A	2468T-00	1/ MOV. PANEL	MULTI POINT MORTISE LOCK	ST. STEEL	WITH 2448 TRIM PLATE
29	#6-32 X 1/2" FH SMS	2/ LOCK	LOCK INSTALLATION SCREW	ST. STEEL	-
30	ES6017-1	1/ LOCK	LOCK KEEPER (STD. LOCK)	PLATED STEEL	-
30A	2447-00	1/ LOCK	LOCK KEEPER (MULTI POINT LOCK)	ST. STEEL	-
31	#10 X 5/8" PH SMS B	2/ LOCK	LOCK KEEPER MOUNT. SCREW (STD. LOCK)	ST. STEEL	-
31A	#10 X 3/4" PH SMS B	4/ LOCK	LOCK KEEPER MOUNT. SCREW (MULTI POINT LOCK)	ST. STEEL	-
32	#623Z	1/ LOCK	INTERIOR AND EXTERIOR PULL	-	(3) #6-32 X 1/2" FH MS, ST. STEEL
34	#10X1/2" PH SMS	2/ CLIP	FIXED PANEL CLIP FASTENER	ST. STEEL	-
34A	#8X1" FH SMS	2/ CLIP	FIXED PANEL CLIP FASTENER	ST. STEEL	-
35	-	AS REQD.	1"X4" LONG SELF ADHESIVE PILE PAD	WOOLPILE	AT HEAD AND SILL
36	-	AS REQD.	PANEL BUMPER	NEOPRENE	-
37	ES6019	AS REQD.	RESTRAINING PLATE	NYLON	AT TOP & BOTT. INTERLOCKS & ASTRAGAL
38	#8 X 5/8" FH SMS	2/ PLATE	RESTRAINING PLATE FASTENER	-	-
39	ES6028	AS REQD.	SILL RISER	6063-T5	-

LATCHES:
 ITEMS 28A AND 30A USED FOR DOORS WITH STEEL REINFORCING ONLY
 ITEMS 28 AND 30 USED FOR ALL OTHER DOORS.

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 07-0528.08
 Expiration Date JUNE 14, 2012
 By Ishaq I. Chanda
 Miami Dade Product Control
 Division


Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

JUL 16 2007


af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W07-26ES

SERIES-6100 ALUM SLIDING GLASS DOOR (S.M.I.)
E.S. WINDOWS
 5220 N.W. 72 AVE. BAY #4
 MIAMI, FL. 33166
 TEL. (305) 640-9857 FAX. (305) 593-2074


revisions:	no	date	by	description
	A	07.12.07		SILL W/ RISER ADDED
date:	04-04-07			
scale:	1/2" = 1"			
dr. by:	HAMID			
chk. by:				
drawing no.	W07-26			
sheet	7 of 9			

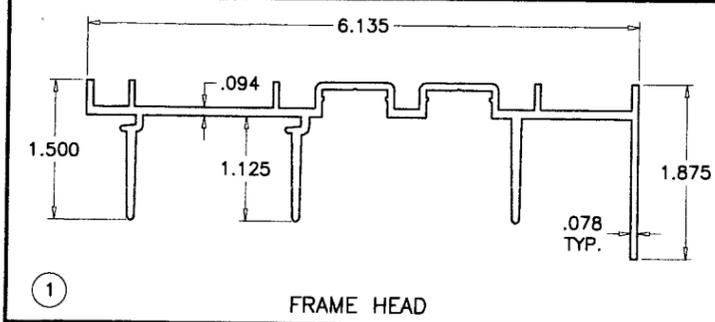


1 FRAME HEAD

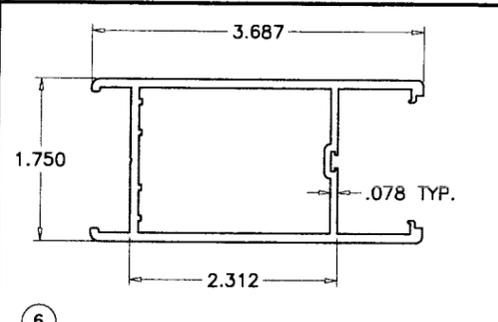


6 LOCK STILE

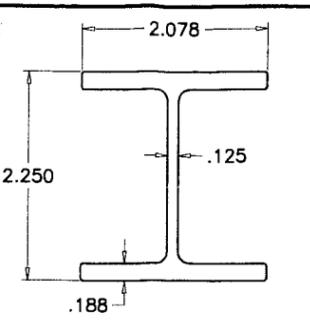


17 ASTRAGAL STIFFENER

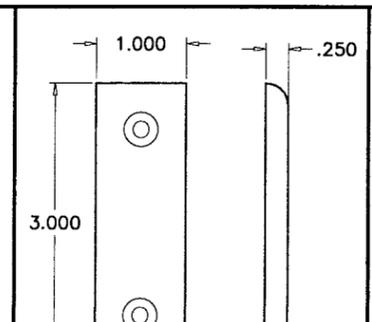


37 RESTRAINING PLATE

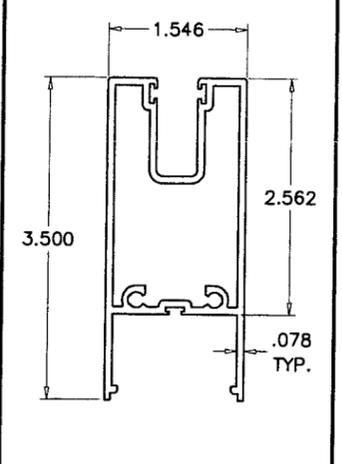


4 PANEL TOP RAIL

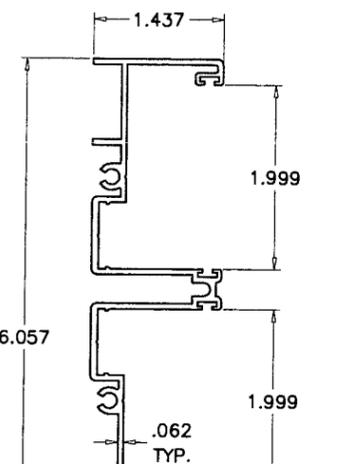


3 FRAME JAMB

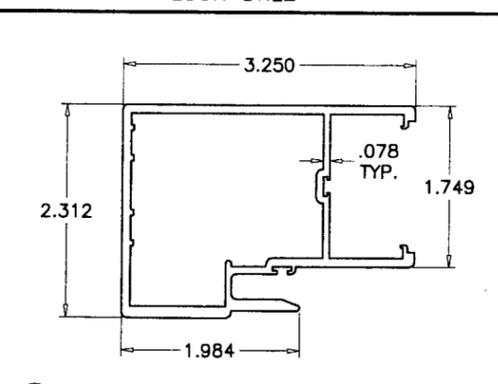


7 INTERLOCK STILE

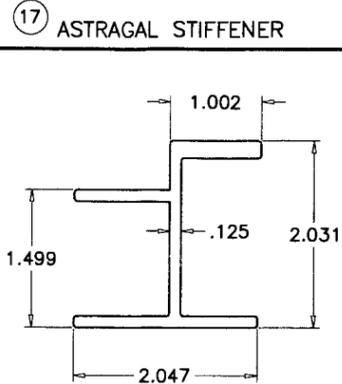


16 INTERLOCK STIFFENER

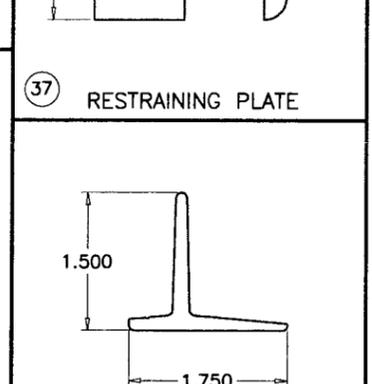


13 RETAINER CLIP

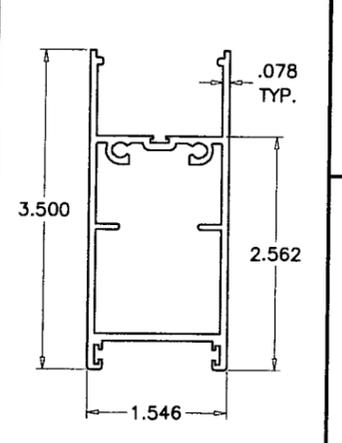


5 PANEL BOTTOM RAIL

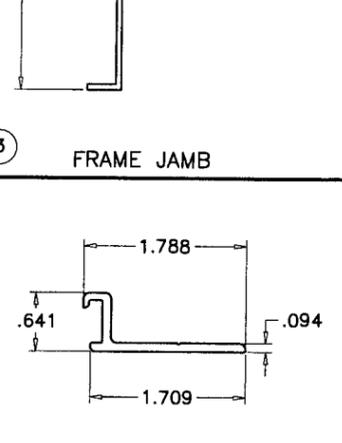


15 FIXED PANEL CLIP

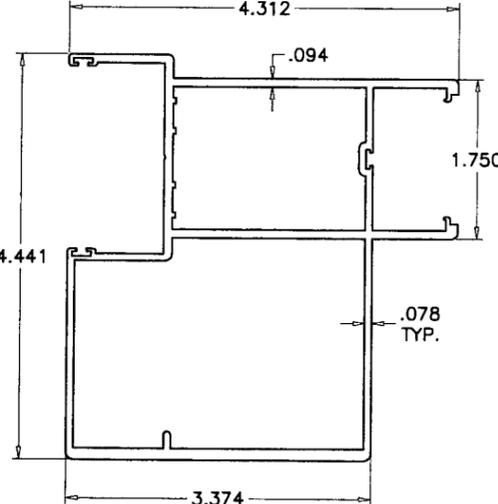


8 ASTRAGAL STILE

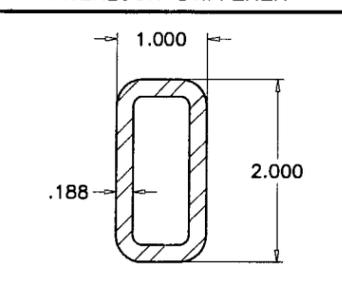


11 INTERLOCK REINFORCING

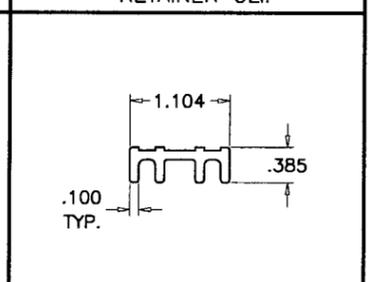


12 FIX. PANEL BOTTOM GUIDE

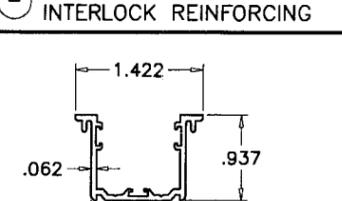


9 GLAZING ADAPTER

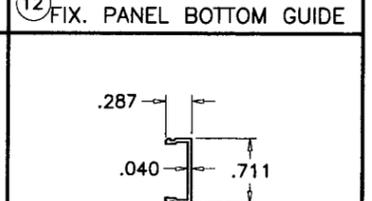


14 SCREW COVER

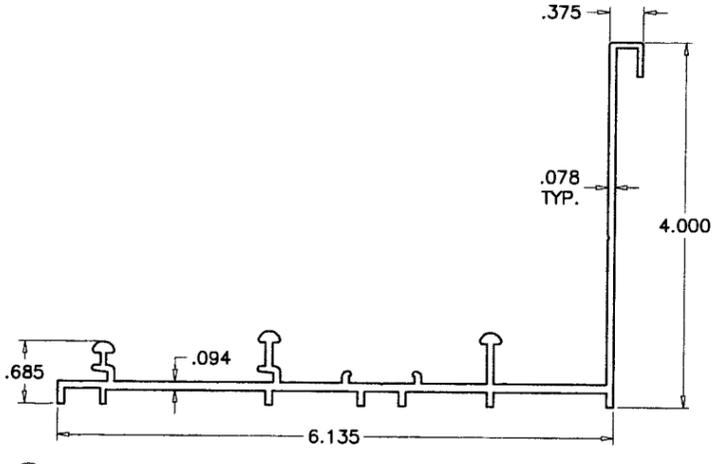

2 FRAME SILL

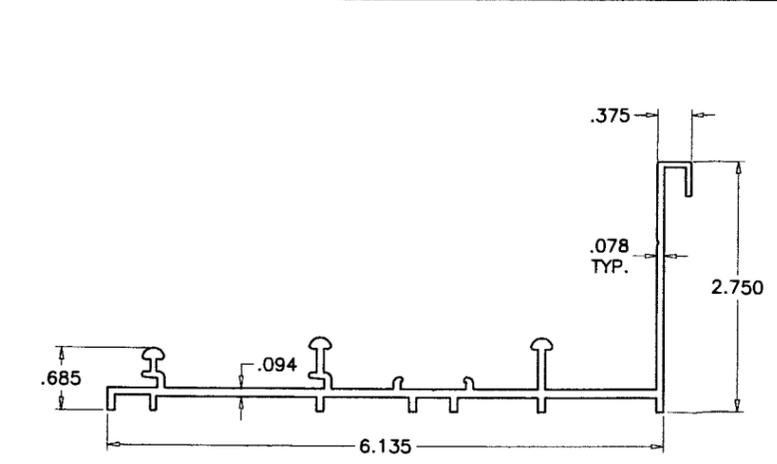

2A ALT. FRAME SILL

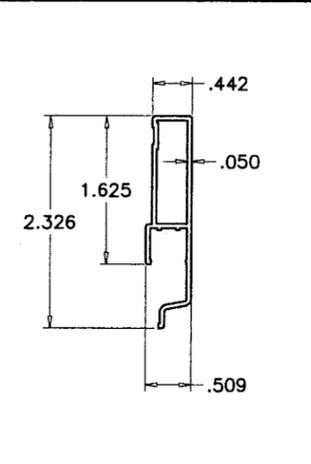

39 SILL RISER

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

[Signature]

JUL 16 2007

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 07-0626-08
Expiration Date JUNE 14, 2012
By *[Signature]*
Miami Dade Product Control
Division


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W07-26ES

SERIES-6100 ALUM SLIDING GLASS DOOR (S.M.I.)
E.S. WINDOWS
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL. (305) 640-9857 FAX. (305) 593-2074


no	date	by	description
A	07.12.07	SILL W/ RISER ADDED	

date: 04-04-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


drawing no.
W07-26
sheet 8 of 9

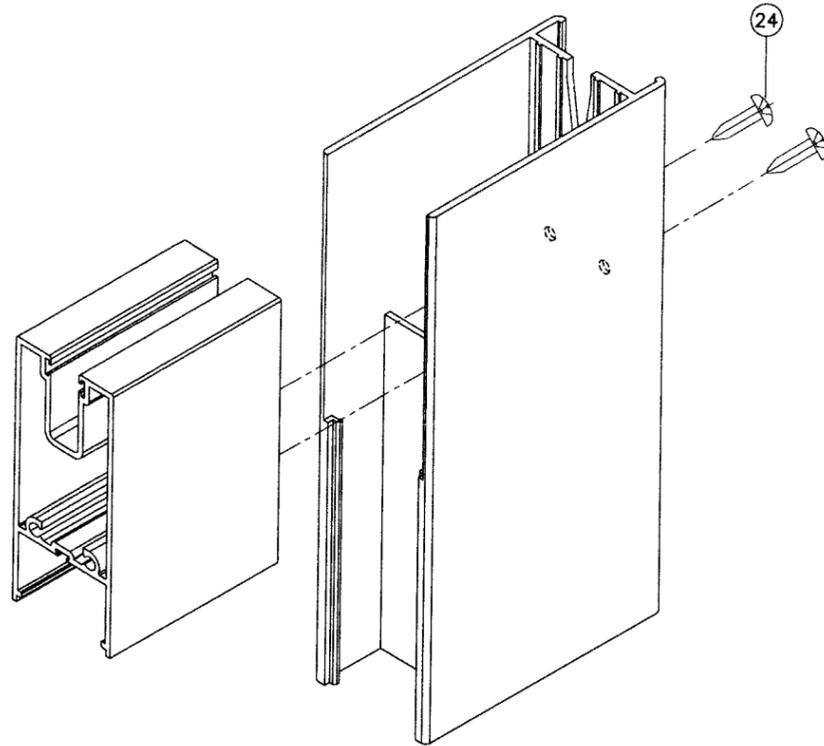


PANEL TOP CORNER

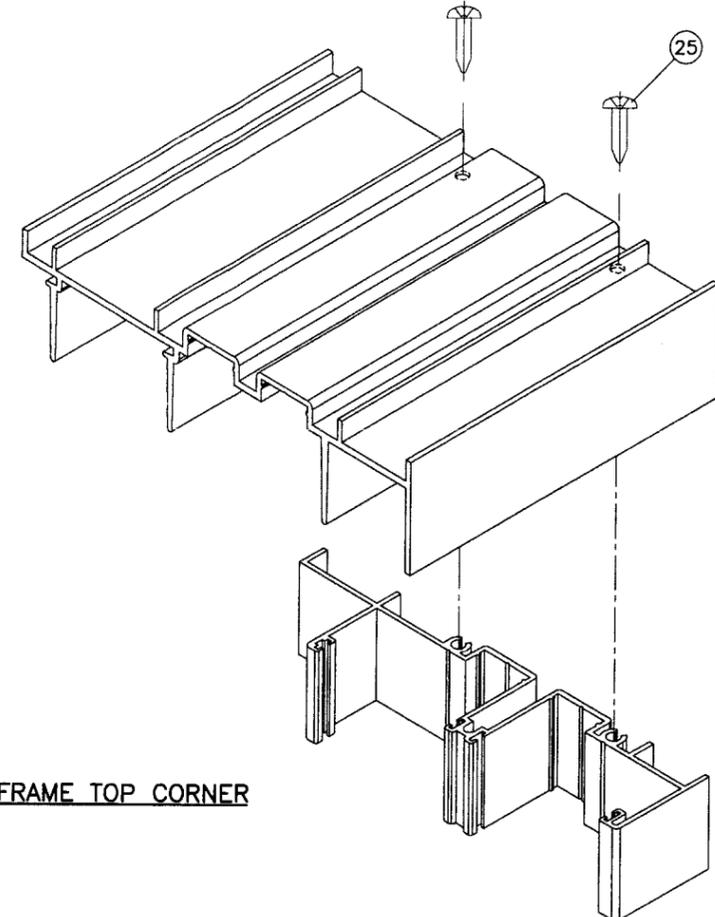

FRAME TOP CORNER

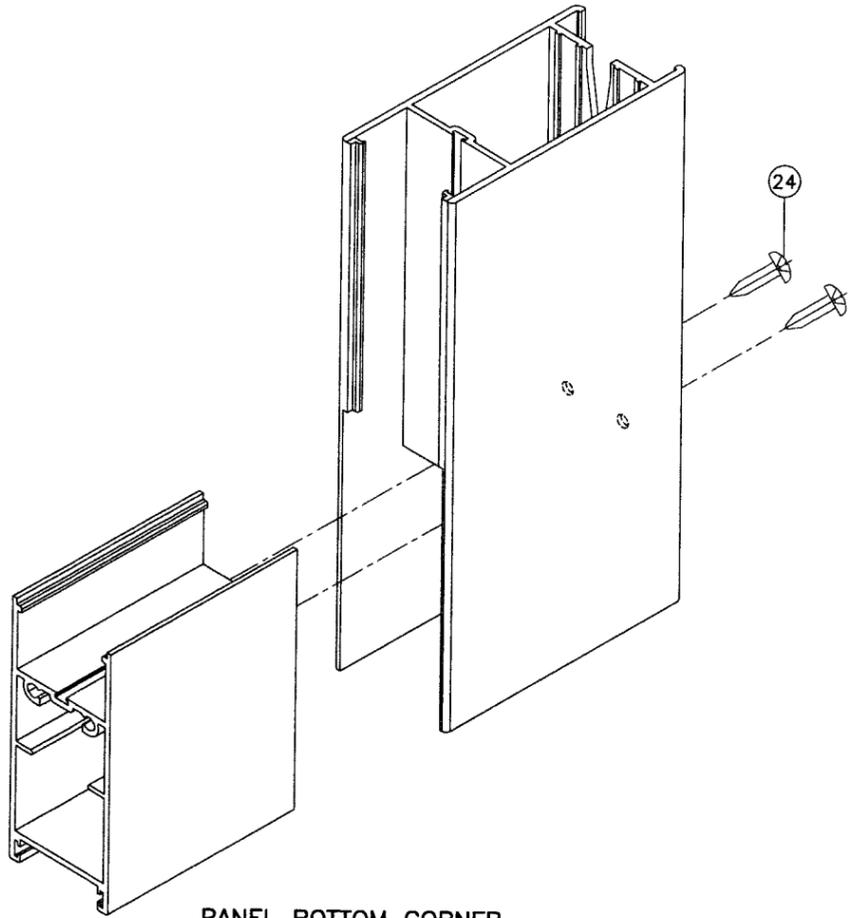

PANEL BOTTOM CORNER

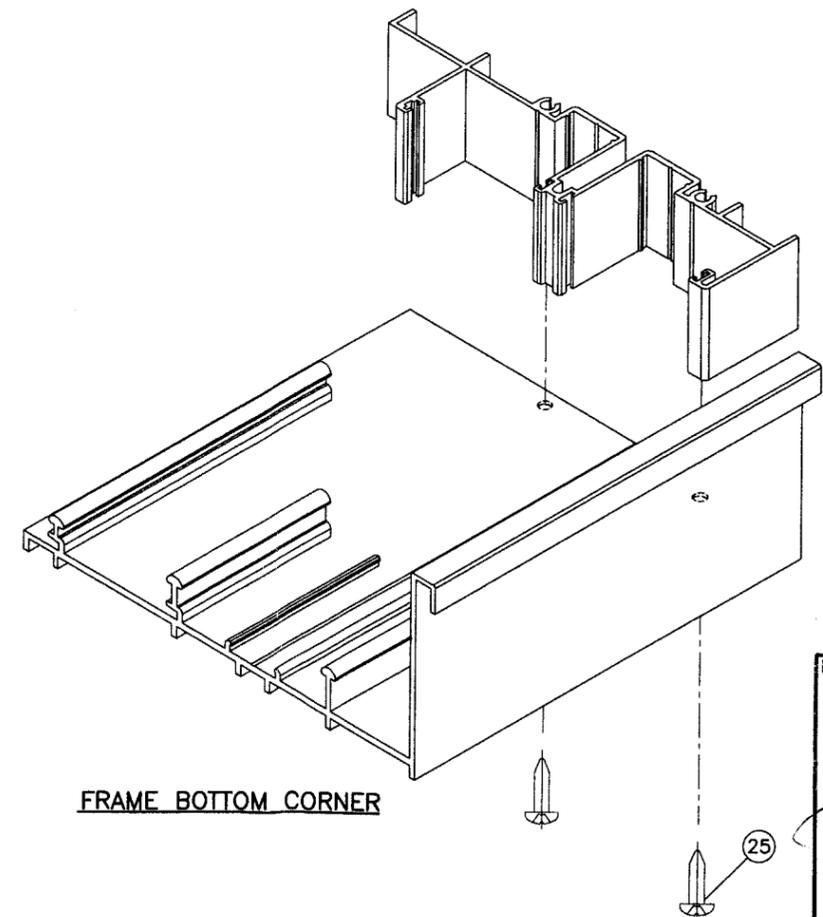

FRAME BOTTOM CORNER

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 07-0829-08
 Expiration Date June 14, 2012
 By Shag I. Choudhury
 Miami Dade Product Control
 Division

Engr: DR. HUMAYOON FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538
 JUL 16 2007

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W07-26ES

SERIES-6100 ALUM SLIDING GLASS DOOR (S.M.I.)
E.S. WINDOWS
 5220 N.W. 72 AVE. BAY #4
 MIAMI, FL. 33166
 TEL. (305) 640-9857 FAX. (305) 593-2074

revisions:	no	date	by	description
	A	07.12.07		NO CHANGE THIS SHEET

date: 04-04-07
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W07-26
 sheet 9 of 9