



MIAMI-DADE COUNTY, FLORIDA
 METRO-DADE FLAGLER BUILDING
 140 WEST FLAGLER STREET, SUITE 1603
 MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 372-6339
www.miamidade.gov/buildingcode

**BUILDING CODE COMPLIANCE OFFICE (BCCO)
 PRODUCT CONTROL DIVISION
 NOTICE OF ACCEPTANCE (NOA)**

**AWP, LLC
 8130 NW 74th Avenue
 Medley, FL 33166**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Impact View" Aluminum Fixed Window - L.M.I.

APPROVAL DOCUMENT: Drawing No. **W03-39**, titled "Impact View Alum. Fixed Wdw. (L.M.I.)", sheets 1 through 6 of 6, prepared by Al-Farooq Corporation, dated 06/10/03, with revision "C", dated 07/12/07, signed, sealed and dated 10/05/07 by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # **03-0710.01** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 07-0829.01
 Expiration Date: March 04, 2009
 Approval Date: February 07, 2008
 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W03-39**, titled "Impact View Alum. Fixed Wdw. (L.M.I.)", sheets 1 through 6 of 6, prepared by Al-Farooq Corporation, dated 06/10/03, with revision "C", dated 07/12/07, signed, sealed and dated 10/05/07 by Humayoun Farooq, P.E.

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of aluminum fixed windows, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3467**, dated March 31, 2003, signed and sealed by Joseph C. Chan, P.E.

"Submitted under NOA# 03-0710.01"

2. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of aluminum fixed windows, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3553**, dated March 31, 2003, signed and sealed by Joseph C. Chan, P.E.

"Submitted under NOA# 03-0710.01"

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by Al-Farooq Corporation, dated 07/16/07, signed and sealed by Humayoun Farooq, P.E.
Complies with ASTM E1300-02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).


Manuel Perez, P.E.
Product Control Examiner
NOA No. 07-0829.01

Expiration Date: March 04, 2009
Approval Date: February 07, 2008

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their “**Saflex III Clear or colored interlayer**” dated 05/04/06, expiring on 05/21/11.
2. Notice of Acceptance No. **03-1117.05** issued to Surface Specialties, Inc. for their “**Uvekols – a Laminate Glass Component**” dated 01/29/04, expiring on 02/08/09.

F. STATEMENTS

1. Statement letter of conformance, dated July 10, 2007, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated July 10, 2007, signed and sealed by Humayoun Farooq, P.E.
3. Statement letter of compliance, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL- 3467**, dated 04/11/03, signed and sealed by Joseph C. Chan, P.E.
4. Asset purchase agreement dated November 03, 2006, signed by Mr. Manuel Valladares and Mr. Leon Silverstein.





G. OTHER

1. Notice of Acceptance No. **03-0710.01**, issued to Yale Ogron Windows and Doors, Inc. for their Series “**Impact View Aluminum Fixed Window**”, approved on 03/04/04 and expiring on 03/04/09.




Manuel Perez, P.E.
Product Control Examiner
NOA No. 07-0829.01

Expiration Date: March 04, 2009
Approval Date: February 07, 2008

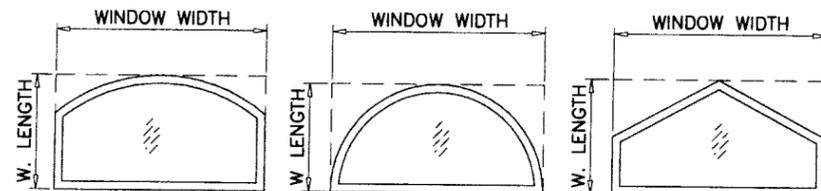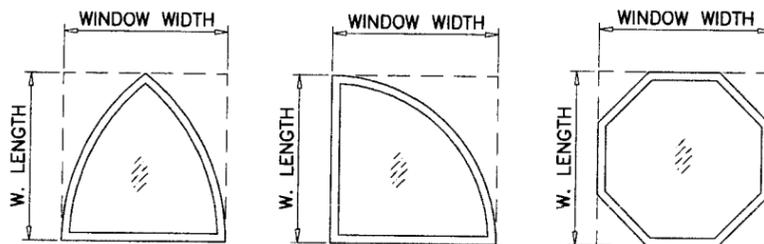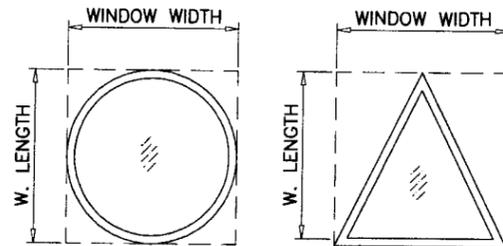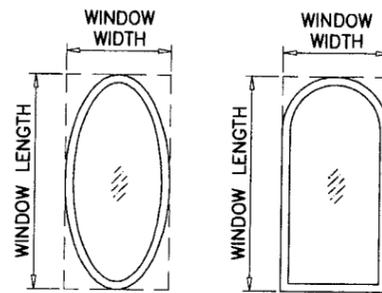

ALLOWABLE LOADS FOR ALTERNATE SHAPES AS SHOWN ABOVE OR SIMILAR CAN BE VERIFIED BY INSCRIBING PICTURE WINDOW SHAPE WITHIN SQUARE OR RECTANGLE AS SHOWN IN DOTTED LINES AND OBTAINING ALLOWABLE LOADS FROM THOSE SHAPES.

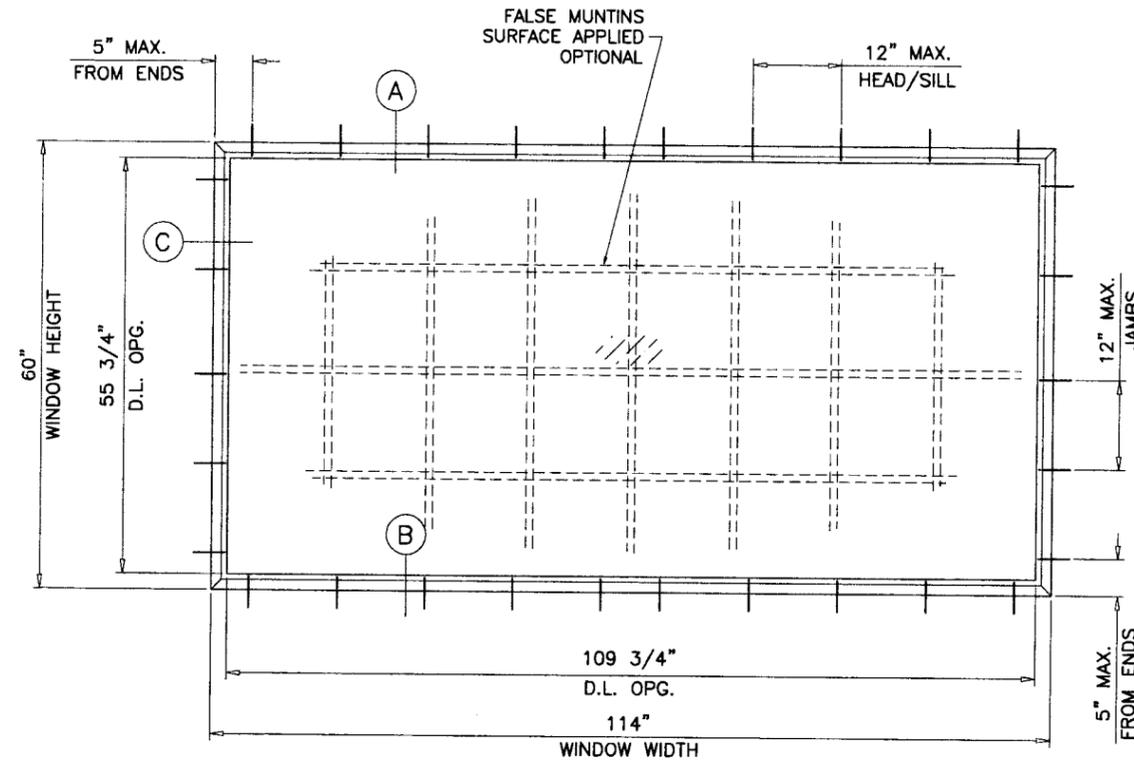

TYPICAL ELEVATION
TESTED UNIT

IMPACT VIEW ALUMINUM FIXED WINDOW

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIXED/FIXED OR FIXED WITH OTHER MIAMI-DADE COUNTY APPR'D WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

DESIGN LOAD RATING FOR THESE WINDOWS TO BE AS PER CHARTS ON SHEETS 2 & 3.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004 FLORIDA BLDG. CODE SECTION 2003.8.4.

THESE WINDOWS ARE RATED FOR LARGE MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

OCT 05 2007

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 07-0829.01
Expiration Date 03/04/2009

By *Manuel Perez*
Miami Dade Product Control
Division

afc
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W03-39YO


IMPACT VIEW ALUM FIXED WDW. (L.M.I.)
AWP, LLC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	description
A	11.06.03	NO CHANGE THIS SHEET
B	01.23.04	NOTES REV.
C	07.12.07	UPDATED FOR 2004 FBC, NAME REV.

date: 06-10-03
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:


drawing no.
W03-39
sheet 1 of 6

DESIGN LOAD CAPACITY - PSF													
WINDOW DIMS.		GLASS TYPE 'A'				GLASS TYPE 'B'				GLASS TYPE 'C'			
		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'	
WIDTH	LENGTH	EXT.(+)	INT.(-)										
19-1/8"	26"	50.0	50.0	50.0	50.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		50.0	50.0	50.0	50.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		50.0	50.0	50.0	50.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
53-1/8"		50.0	50.0	50.0	50.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
19-1/8"	38-3/8"	50.0	50.0	50.0	50.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		50.0	50.0	50.0	50.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		50.0	50.0	50.0	50.0	64.9	64.9	64.9	64.9	80.0	80.0	80.0	80.0
53-1/8"		50.0	50.0	50.0	50.0	62.5	62.5	62.5	62.5	79.6	79.6	80.0	80.0
19-1/8"	50-5/8"	50.0	50.0	50.0	50.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		50.0	50.0	50.0	50.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		50.0	50.0	50.0	50.0	64.9	64.9	64.9	64.9	80.0	80.0	80.0	80.0
53-1/8"		47.4	47.4	47.4	47.4	47.4	47.4	47.4	47.4	73.6	73.6	80.0	80.0
19-1/8"	63"	50.0	50.0	50.0	50.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		50.0	50.0	50.0	50.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		50.0	50.0	50.0	50.0	64.9	64.9	64.9	64.9	75.6	75.6	80.0	80.0
53-1/8"		45.2	45.2	45.2	45.2	45.2	45.2	45.2	45.2	64.3	64.3	80.0	80.0
19-1/8"	74-1/4"	50.0	50.0	50.0	50.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		50.0	50.0	50.0	50.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		50.0	50.0	50.0	50.0	64.9	64.9	64.9	64.9	70.4	70.4	80.0	80.0
53-1/8"		45.2	45.2	45.2	45.2	45.2	45.2	45.2	45.2	57.3	57.3	80.0	80.0

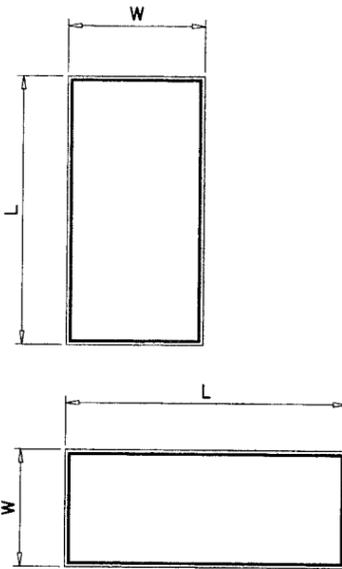

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED
VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-02 (3 SEC. GUSTS).

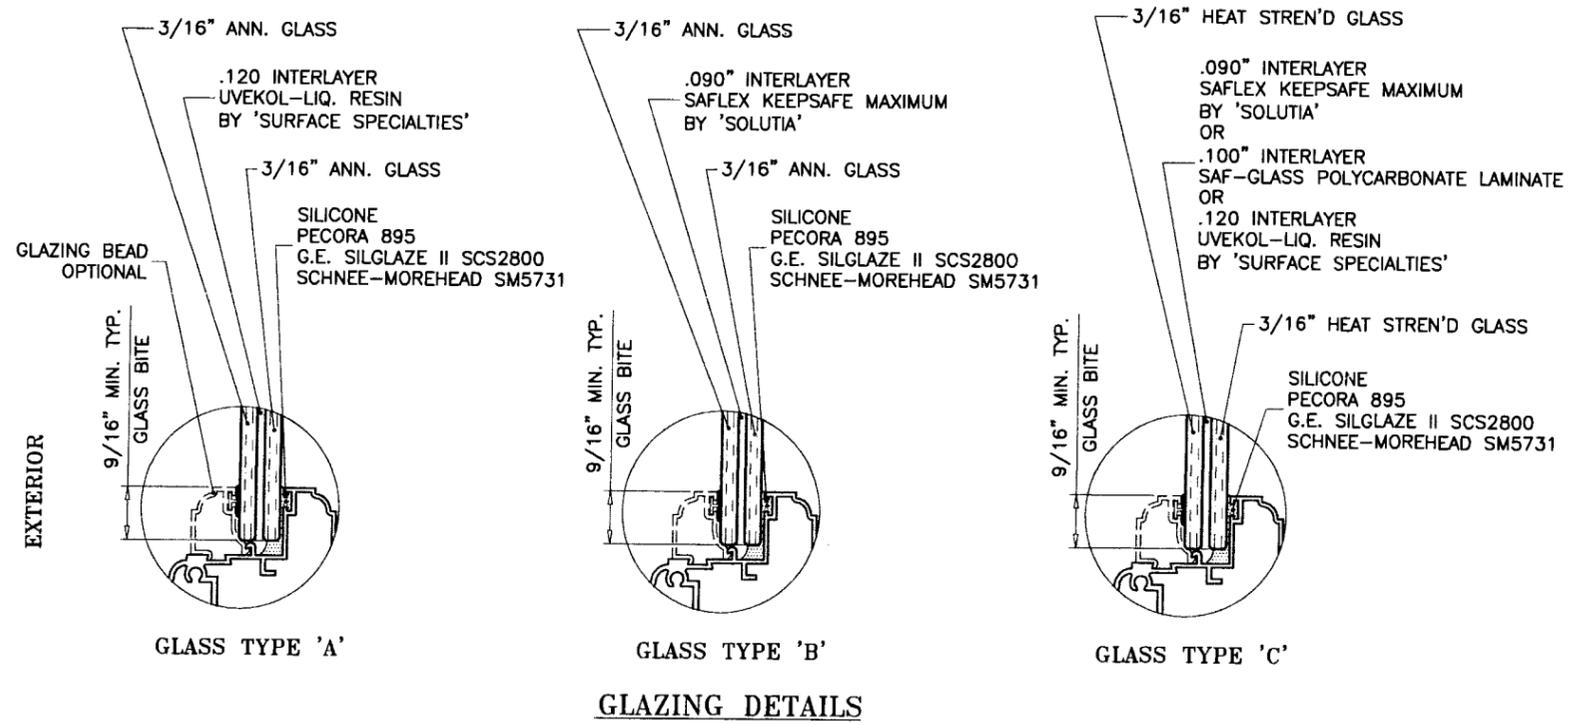

Engr. DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

OCT 05 2007

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 07-0829.01
Expiration Date 03/04/2009

By *Manuel Lopez*
Miami Dade Product Control
Division

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

IMPACT VIEW ALUM FIXED WDW. (L.M.I.)

AWP, LLC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no.	date	description
A	11.06.03	NO CHANGE THIS SHEET
B	01.23.04	LOAD CHART REV.
C	07.12.07	UPDATED FOR 2004 FBC. NAME REV.


date: 06-10-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no. **W03-39**
sheet 2 of 6

DESIGN LOAD CAPACITY - PSF

WINDOW DIMS.		GLASS TYPE 'A'				GLASS TYPE 'B'				GLASS TYPE 'C'			
		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'	
WIDTH	LENGTH	EXT.(+)	INT.(-)										
36"	48"	50.0	50.0	50.0	50.0	66.7	66.7	66.7	66.7	76.8	76.8	80.0	80.0
42"		50.0	50.0	50.0	50.0	57.1	57.1	50.0	50.0	73.1	73.1	80.0	80.0
48"		50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	72.0	72.0	80.0	80.0
54"		50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	72.0	72.0	80.0	80.0
60"		50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	60.0	60.0	80.0	80.0
66"		50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	61.7	61.7	80.0	80.0
72"		50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	54.0	54.0	80.0	80.0
36"	60"	50.0	50.0	50.0	50.0	66.7	66.7	66.7	66.7	68.6	68.6	80.0	80.0
42"		50.0	50.0	50.0	50.0	57.1	57.1	50.0	50.0	63.3	63.3	80.0	80.0
48"		50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	60.0	60.0	80.0	80.0
54"		44.4	44.4	44.4	44.4	44.4	44.4	44.4	44.4	58.2	58.2	80.0	80.0
60"		40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	57.6	57.6	80.0	80.0
66"		40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	57.6	57.6	80.0	80.0
72"		40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	49.4	49.4	80.0	80.0
36"	72"	50.0	50.0	50.0	50.0	64.0	64.0	66.7	66.7	64.0	64.0	80.0	80.0
42"		50.0	50.0	50.0	50.0	57.1	57.1	50.0	50.0	58.1	58.1	80.0	80.0
48"		50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	54.0	54.0	80.0	80.0
54"		44.4	44.4	44.4	44.4	44.4	44.4	44.4	44.4	51.2	51.2	80.0	80.0
60"		40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	49.4	49.4	80.0	80.0
66"		36.4	36.4	36.4	36.4	36.4	36.4	36.4	36.4	48.3	48.3	72.7	72.7
72"		33.3	33.3	33.3	33.3	33.3	33.3	33.3	33.3	48.0	48.0	66.7	66.7
36"	84"	50.0	50.0	50.0	50.0	61.1	61.1	66.7	66.7	61.1	61.1	80.0	80.0
42"		50.0	50.0	50.0	50.0	54.9	54.9	50.0	50.0	54.9	54.9	80.0	80.0
48"		50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.4	50.4	80.0	80.0
54"		44.4	44.4	44.4	44.4	44.4	44.4	44.4	44.4	47.2	47.2	80.0	80.0
60"		40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	44.8	44.8	80.0	80.0
66"		-	-	-	-	-	-	-	-	43.1	43.1	72.7	72.7
72"		-	-	-	-	-	-	-	-	42.0	42.0	66.7	66.7
36"	96"	50.0	50.0	50.0	50.0	59.1	59.1	64.8	64.8	59.1	59.1	80.0	80.0
42"		50.0	50.0	50.0	50.0	52.7	52.7	50.0	50.0	52.7	52.7	80.0	80.0
48"		48.0	48.0	50.0	50.0	48.0	48.0	50.0	50.0	48.0	48.0	80.0	80.0
54"		44.4	44.4	44.4	44.4	44.4	44.4	44.4	44.4	44.5	44.5	80.0	80.0
60"		-	-	-	-	-	-	-	-	41.9	41.9	80.0	80.0
66"		-	-	-	-	-	-	-	-	39.9	39.9	72.7	72.7
36"	108"	50.0	50.0	50.0	50.0	57.6	57.6	63.2	63.2	57.6	57.6	80.0	80.0
42"		50.0	50.0	50.0	50.0	51.1	51.1	50.0	50.0	51.1	51.1	80.0	80.0
48"		46.3	46.3	50.0	50.0	46.3	46.3	50.0	50.0	46.3	46.3	80.0	80.0
54"		-	-	-	-	-	-	-	-	42.7	42.7	80.0	80.0
60"		-	-	-	-	-	-	-	-	39.9	39.9	80.0	80.0
36"	114"	50.0	50.0	50.0	50.0	60.0	60.0	62.5	62.5	60.0	60.0	80.0	80.0
42"		50.0	50.0	50.0	50.0	53.1	53.1	50.0	50.0	53.1	53.1	80.0	80.0
48"		48.0	48.0	50.0	50.0	48.0	48.0	50.0	50.0	48.0	48.0	80.0	80.0
54"		-	-	-	-	-	-	-	-	44.1	44.1	80.0	80.0
60"		-	-	-	-	-	-	-	-	41.1	41.1	80.0	80.0
36"	120"	50.0	50.0	50.0	50.0	56.5	56.5	61.9	61.9	56.5	56.5	80.0	80.0
42"		49.9	49.9	50.0	50.0	49.9	49.9	-	-	49.9	49.9	80.0	80.0
48"		-	-	-	-	-	-	-	-	45.0	45.0	80.0	80.0
54"		-	-	-	-	-	-	-	-	41.3	41.3	80.0	80.0
36"	132"	50.0	50.0	50.0	50.0	55.6	55.6	60.9	60.9	55.6	55.6	80.0	80.0
42"		-	-	-	-	-	-	-	-	48.9	48.9	80.0	80.0
48"		-	-	-	-	-	-	-	-	44.0	44.0	80.0	80.0
36"	144"	50.0	50.0	50.0	50.0	54.9	54.9	60.2	60.2	54.9	54.9	80.0	80.0
42"		-	-	-	-	-	-	-	-	48.2	48.2	80.0	80.0

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-02 (3 SEC. GUSTS).

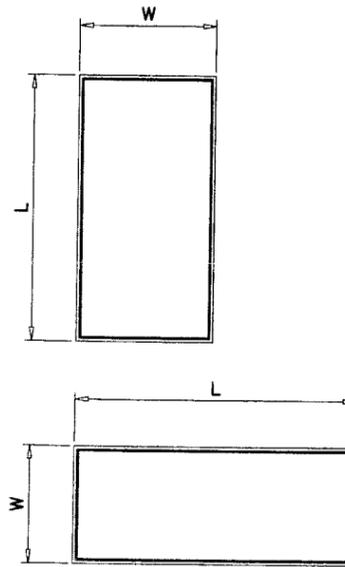

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED
VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

OCT 05 2007

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 07-0829.01
Expiration Date 03/04/2009

By *Manuel Perez*
Miami Dade Product Control
Division





a f c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W03-39YO

IMPACT VIEW ALUM FIXED WDW. (L.M.I.)
AWP, LLC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	description
A	11.06.03	NO CHANGE THIS SHEET
B	01.23.04	LOAD CHART REV.
C	07.12.07	UPDATED FOR 2004 FBC, NAME REV.

date: 06-10-03
scale: -
dr. by: HAMID
chk. by:

drawing no.
W03-39
sheet 3 of 6

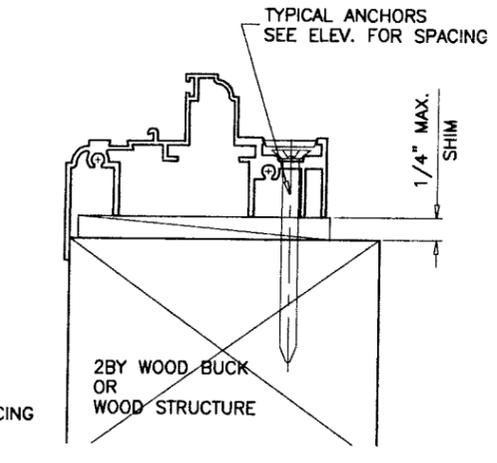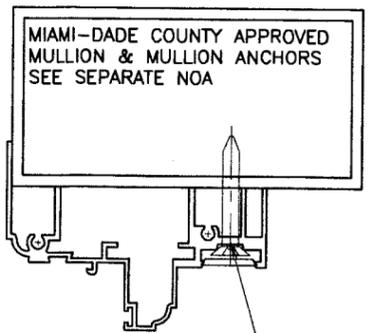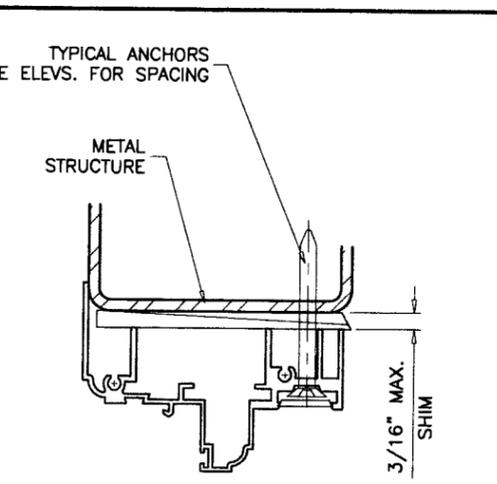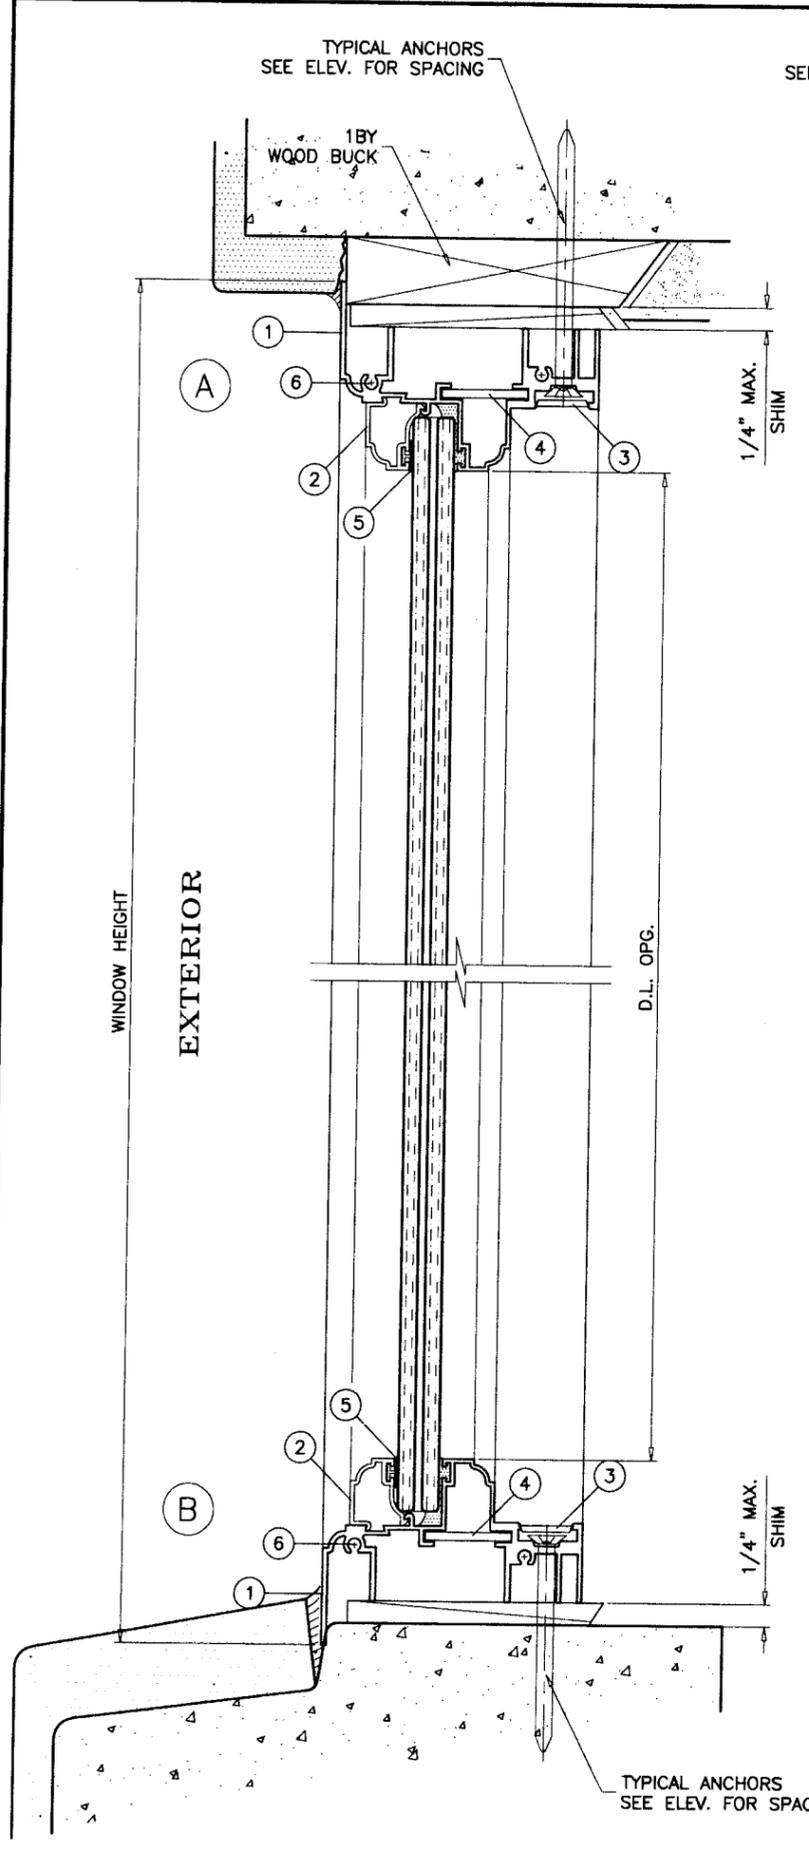

WOOD BUCKS AND METAL STRUCTURE NOT BY YALE OGRON
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A' - 3/16" TAPCONS
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

TYPE 'B' - 1/4" TAPCONS
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

3/16" TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#10 SMS OR SELF DRILLING SCREWS
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS
 (NO SHIM SPACE)

ANCHOR EDGE DISTANCES
 INTO CONCRETE AND MASONRY = 1-1/4" MIN.
 INTO WOOD STRUCTURE = 3/4" MIN.
 INTO METAL STRUCTURE = 1/2" MIN.

SEALANTS:
 FRAME CORNERS AND INSTALLATION SCREWS SEALED WITH
 GE SILICONE SEALANT.

Engr. DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

OCT 05 2007

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 07-0829-01
 Expiration Date 03/04/2009
 By *Maunul Porey*
 Miami Dade Product Control
 Division

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W03-39YO




IMPACT VIEW ALUM FIXED WDW. (L.M.I.)
 AWP, LLC.
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

no	date	description
A	11.06.03	NO CHANGE THIS SHEET
B	01.23.04	ANCHORS REV.
C	07.12.07	UPDATED FOR 2004 FBC, NAME REV.

date: 06-10-03
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W03-39

sheet 4 of 6

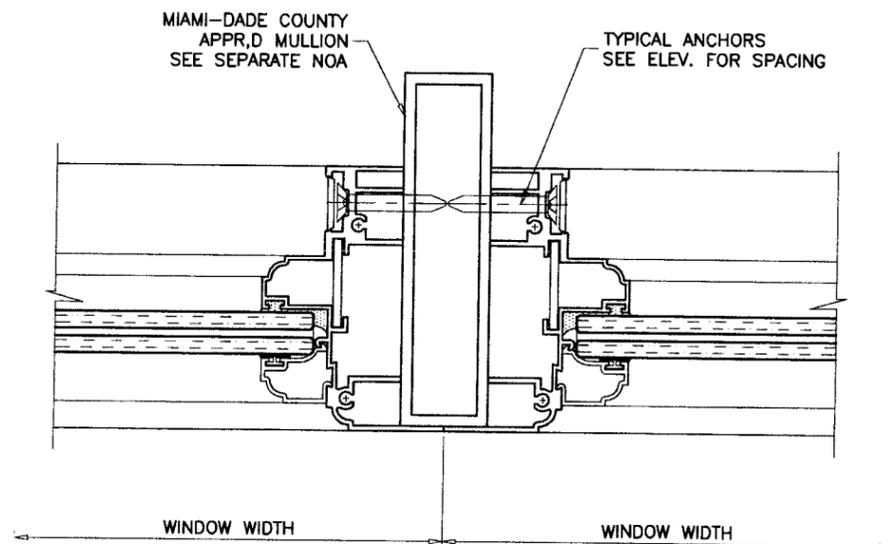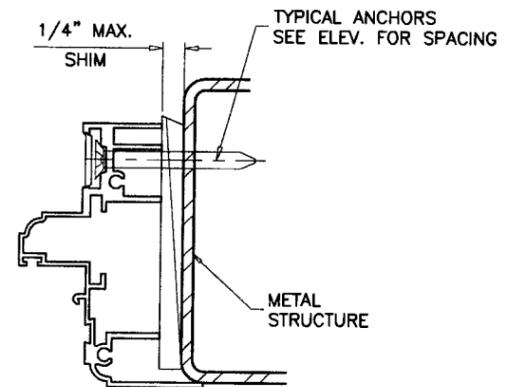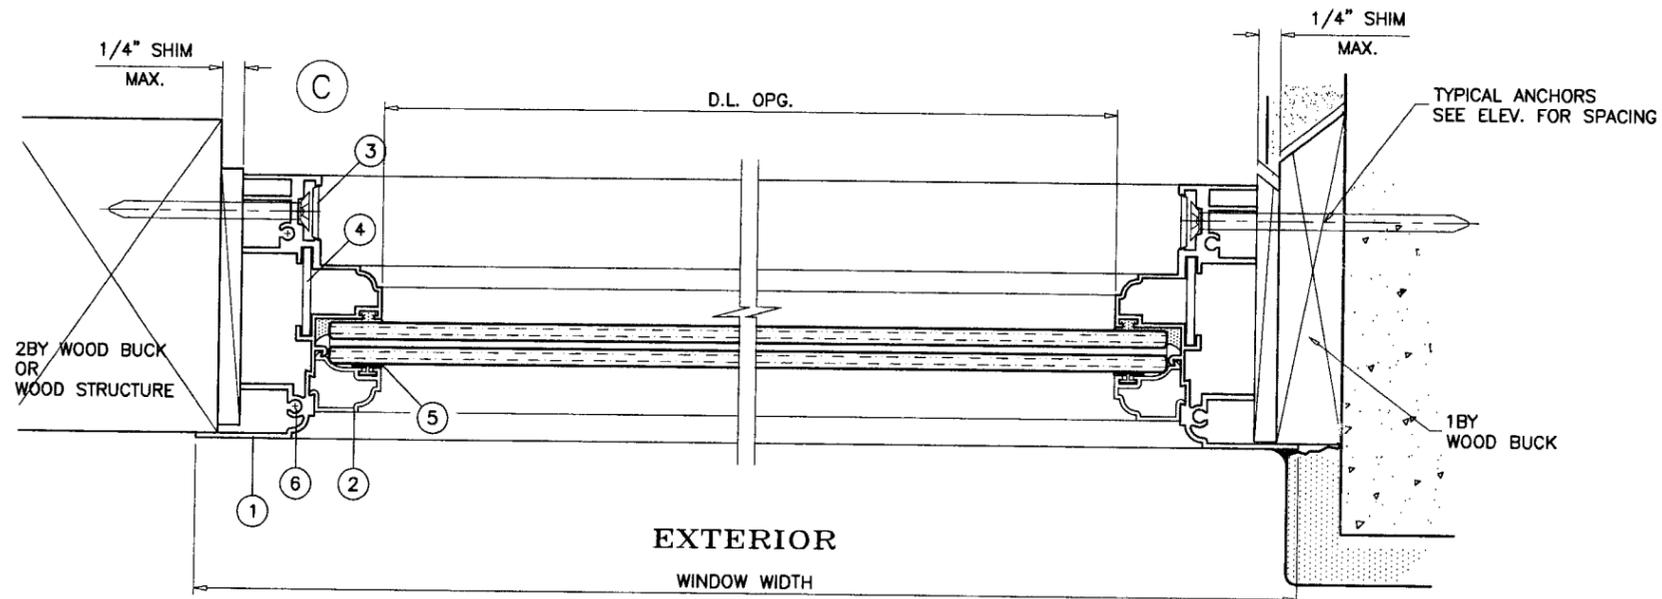

Engr: DR. HUMAYOON FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

H

OCT 05 2007

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 07-0829.01
 Expiration Date 03/04/2009

By *Muhammad Dera*
 Miami Dade Product Control
 Division

afc

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 12395 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\W03-39YO

IMPACT VIEW ALUM FIXED WDW. (L.M.I.)

AWP, LLC.
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309


revisions:

no	date	description
A	11.06.03	NO CHANGE THIS SHEET
B	01.23.04	ANCHORS REV.
C	07.12.07	UPDATED FOR 2004 FBC, NAME REV.


date: 06-10-03
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W03-39

sheet 5 of 6

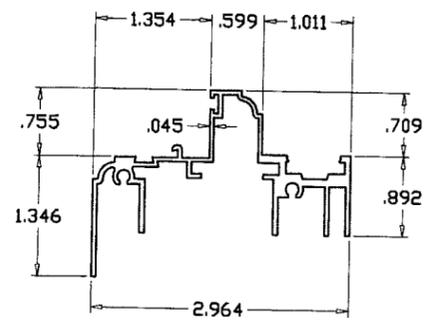


WINDOW FRAME




GLAZING BEAD

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	YE-68	4	WINDOW FRAME	6063-T5	-
2	YE-1405	AS REQD.	GLAZING STOP (OPTIONAL)	6063-T5	-
3	YE-816	4	COVER PLATE	6063-T5	-
4	YH-1465	4	FRAME CORNER KEY	6063-T5	-
5	YH-622	AS REQD.	GLAZING VINYL	VINYL	SULLIVAN
6	YF-10	2/ CORNER	FRAME ASSEMBLY SCREWS	-	#8 X 1" PH SMS

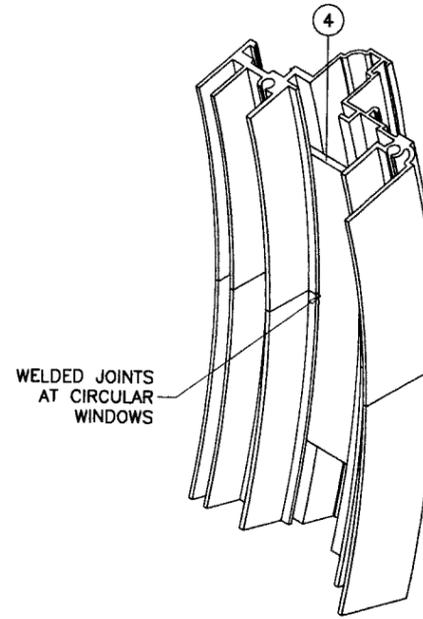

CIRCULAR WINDOWS

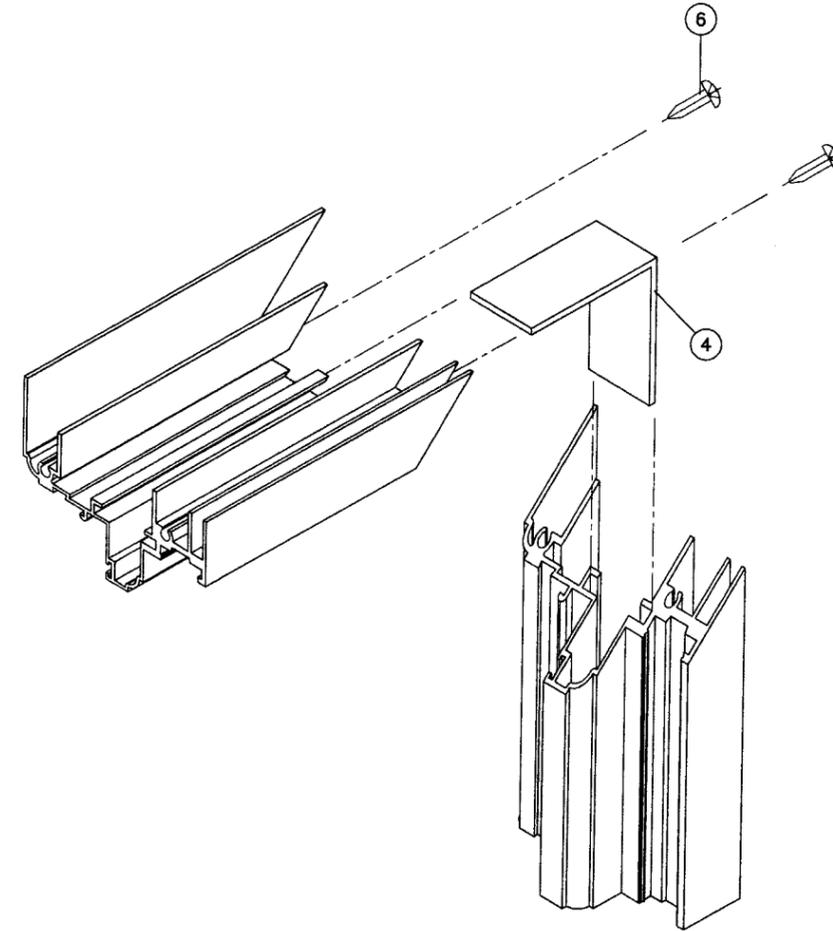

RECT. OR SQUARE WINDOWS

TYP. CORNER DETAILS

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

[Signature]
OCT 05 2007

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 07-0829.01
Expiration Date 03/04/2009

By *[Signature]*
Miami Dade Product Control
Division

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W03-39YO

IMPACT VIEW ALUM FIXED WDW. (L.M.I.)
AWP, LLC.
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	by	description
A	11.06.03		FRAME ALLOY REV.
B	01.23.04		NO CHANGE THIS SHEET
C	07.12.07		UPDATED FOR 2004 FBC, NAME REV.

date: 06-10-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W03-39