



MIAMI-DADE COUNTY, FLORIDA
 METRO-DADE FLAGLER BUILDING
 140 WEST FLAGLER STREET, SUITE 1603
 MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 372-6339
www.miamidade.gov/buildingcode

BUILDING CODE COMPLIANCE OFFICE (BCCO)
 PRODUCT CONTROL DIVISION
NOTICE OF ACCEPTANCE (NOA)

Zeluck Incorporated
5300 Kings Highway
Brooklyn, NY 11234

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "H-7025 Mahogany" Wood Sliding Glass Doors – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W97-33**, titled "H-7025 Mahogany Wood Sliding Glass Door (L.M.I.)", sheets 1 through 7 of 7, dated 10/27/97 with revision **G** dated 01/11/08, prepared by Al-Farooq Corporation, signed and sealed by Yiping Wang, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises and renews** NOA # **06-0919.06** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 07-0919.07
 Expiration Date: September 28, 2012
 Approval Date: March 06, 2008
 Page 1


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W97-33**, titled "H-7025 Mahogany Wood Sliding Glass Door (L.M.I.)", sheets 1 through 7 of 7, dated 10/27/97 with revision **G** dated 01/11/08, prepared by Al-Farooq Corporation, signed and sealed by Yiping Wang, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of a wood sliding glass door, prepared by Architectural Testing, Inc., Test Report No. **ATI-72408.01-109-18**, dated April 10, 2007, signed and sealed by Michael D. Stremmel, P.E.
2. Test reports on: 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
4) Large Missile Impact Test per PA 201-94
5) Cyclic Wind Pressure Loading per PA 203-94
6) Forced Entry Test, per PA 202-94
along with marked-up drawings and installation diagram of a French sliding glass door, prepared by Architectural Testing, Inc., Test Report No. **ATI-01-30935.01**, dated May 01, 1998, signed and sealed by Allen N. Reeves, P.E.
(Submitted under NOA# 06-0919.06)
3. Test reports on: 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
4) Large Missile Impact Test per PA 201-94
5) Cyclic Wind Pressure Loading per PA 203-94
6) Forced Entry Test, per PA 202-94
Along with marked-up drawings and installation diagram of a French sliding glass door, prepared by Architectural Testing, Inc., Test Report No. **ATI-19714**, dated May 13, 1997, signed and sealed by Allen N. Reeves, P.E.
(Submitted under NOA# 06-0919.06)

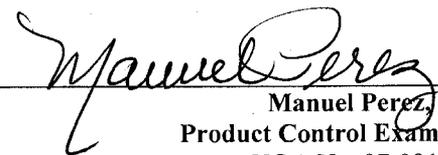

Manuel Perez, P.E.
Product Control Examiner
NOA No. 07-0919.07

Expiration Date: September 28, 2012
Approval Date: March 06, 2008

Zeluck Incorporated

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by Al-Farooq Corporation, dated 09/11/07, signed and sealed by Humayoun Farooq, P.E.
Complies with ASTM E1300-02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "**Saflex III G Clear or colored interlayer**" dated 05/04/06, expiring on 05/21/11.


F. STATEMENTS

1. Statement letter of conformance, dated August 29, 2007, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated August 29, 2007, signed and sealed by Humayoun Farooq, P.E.
3. Laboratory compliance letter for Test Report no. **ATI-72408.01-109-18**, issued by Architectural Testing, Inc., dated August 08, 2007, signed and sealed by Michael D. Stremmel, P.E.

G. OTHER

1. Notice of Acceptance No. **06-0919.06**, issued to Zeluck Incorporated or their Series "H-7025 Mahogany Wood Sliding Glass Doors", approved on 10/20/06 and expiring on 09/28/07.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 07-0919.07
Expiration Date: September 28, 2012
Approval Date: March 06, 2008

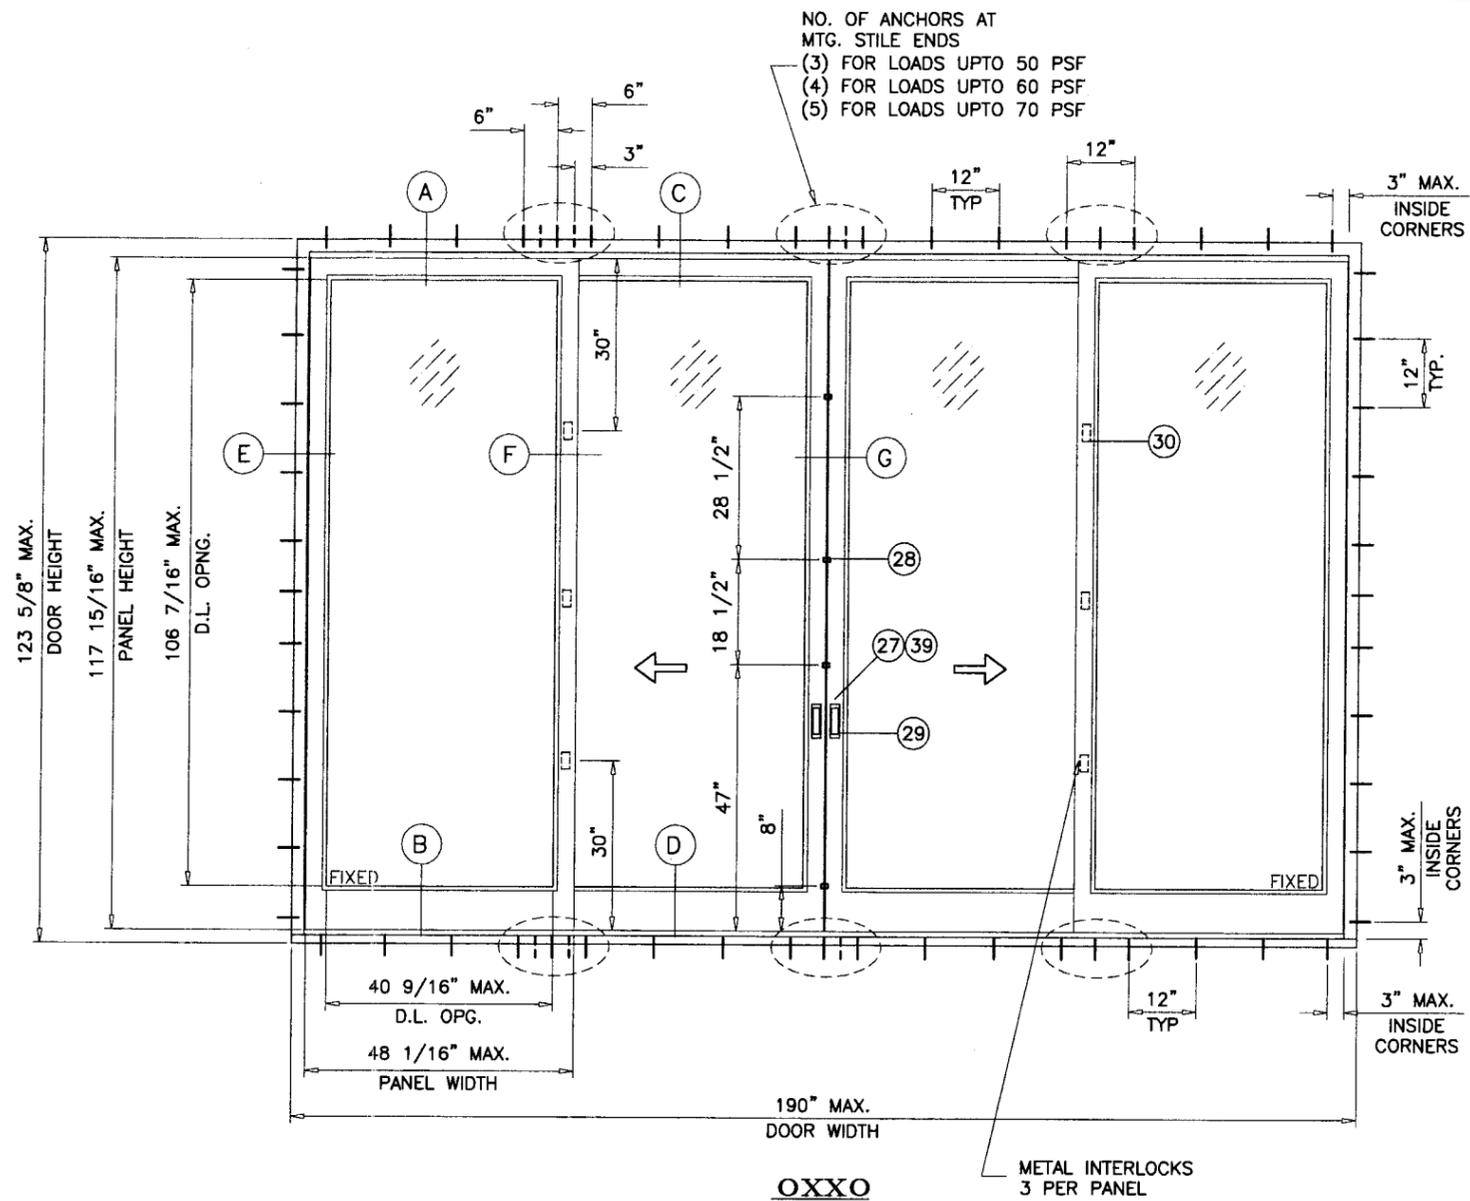

NO. OF ANCHORS AT
MTG. STILE ENDS
(3) FOR LOADS UPTO 50 PSF
(4) FOR LOADS UPTO 60 PSF
(5) FOR LOADS UPTO 70 PSF

TYPICAL ELEVATION
TESTED UNIT

DOORS GLAZED WITH LAMINATED GLASS RATED FOR
LARGE MISSILE IMPACT AND REQUIRE NO SHUTTERS.

H7025 MAHOGANY WOOD SLIDING GLASS DOOR

SEE SHEET 2 FOR DESIGN LOAD CAPACITY.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION (REV. 2005)
INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER
LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS
EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS
ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF
ANCHORS INTO WOOD ONLY.

Engr: YIPING WANG
STRUCTURES
FLA. PE # 55983
C.A.N. 3538

JAN 14 2008

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 07-0919.07
Expiration Date 09/28/2012
By: *Manuel*
Miami Dade Product Control
Division







AL-FAROQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-9978
COMP-ANL W97-33Z1-NEW

H7025 MAHOGANY WOOD SLIDING GLASS DOOR (L.M.I.)
ZELUCK INCORPORATED
5300 KINGS HIGHWAY
BROOKLYN, N.Y. 11234-9011
TEL. (718) 251-8060 FAX. (718) 531-2564

no	date	description
C	12.14.99	GENERAL REVISION
D	1.06.00	HEIGHTS REDUCED SHEETS 3.4.5
E	08.07.06	UPDATED FOR 2004 FBC
F	09.06.07	ANCHOR CHART ADDED
G	01.11.08	REV. PER BCCO COMMENTS

date: 10-27-97
scale: 3/8"=1'-0"
dr. by: HAMID
chk. by:


drawing no.
W97-33
sheet 1 of 7

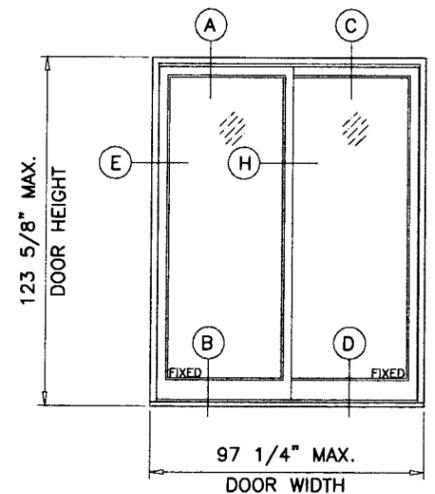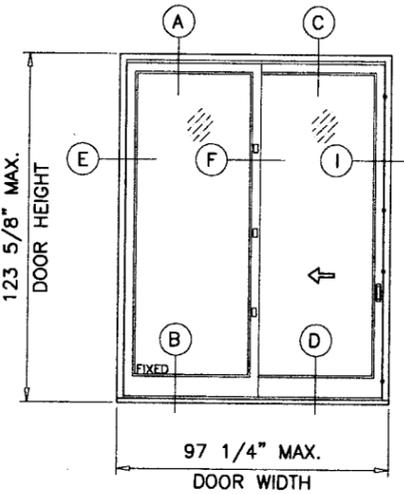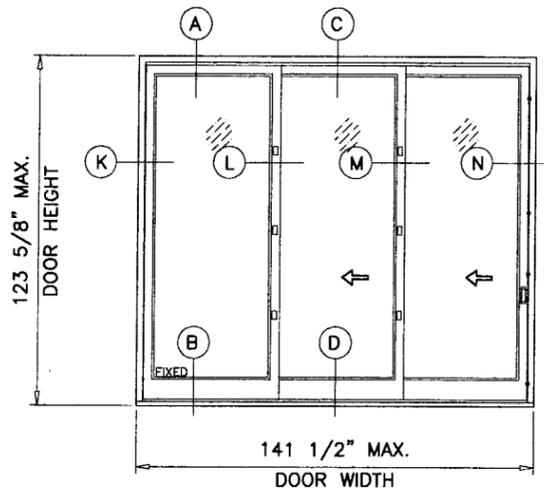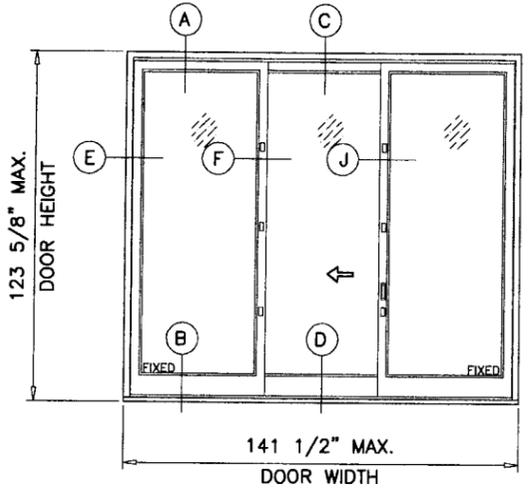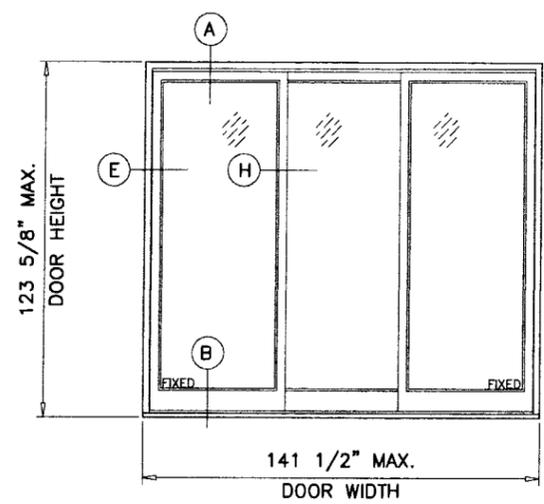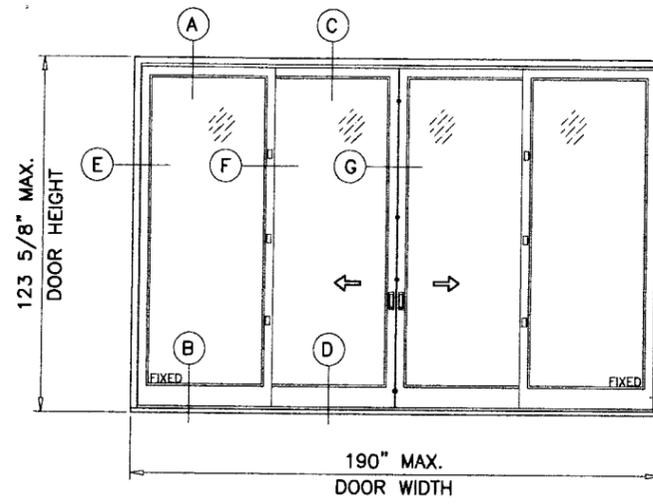


APPROVED CONFIGURATIONS

DESIGN LOAD CAPACITY - PSF			
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT NOMINAL INCHES	GLASS TYPE 'A'	
		EXT.(+)	INT.(-)
36	108	60.0	60.0
48	120	50.0	50.0


DESIGN LOAD CAPACITY - PSF			
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT NOMINAL INCHES	GLASS TYPE 'B'	
		EXT.(+)	INT.(-)
48	124	60.0	75.0

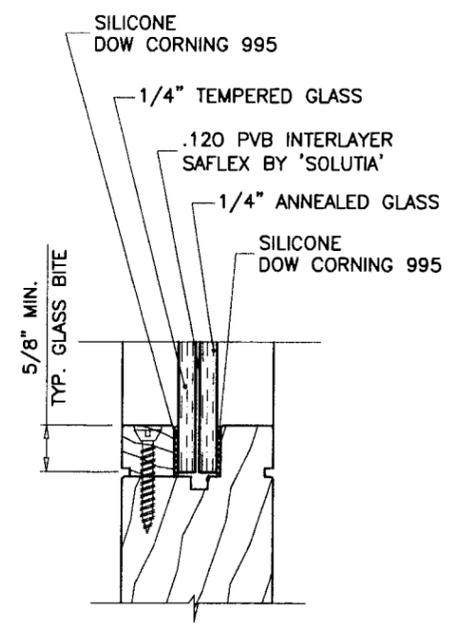

GLASS TYPE 'A'
9/16" OVERALL GLASS

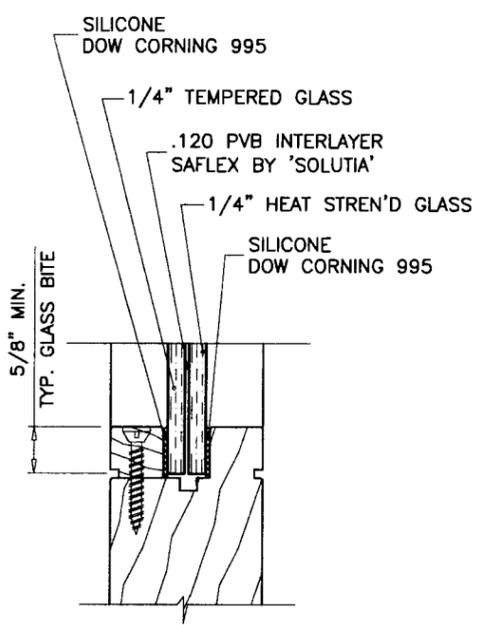

GLASS TYPE 'B'
9/16" OVERALL GLASS

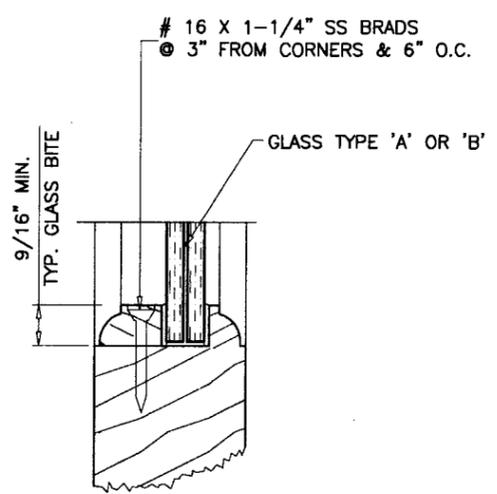

ALTERNATE
GLAZING STOP

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-02 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Engr: YIPING WANG
STRUCTURES
FLA. PE # 55983
C.A.N. 3538

Yiping Wang
JAN 14 2008

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. *07-0919.07*
Expiration Date *09/28/2012*
By *Mamuel*
Miami/Dade Product Control
Division

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W97-33Z1-NEW



H7025 MAHOGANY WOOD SLIDING GLASS DOOR (L.M.I.)
ZELUCK INCORPORATED
5300 KINGS HIGHWAY
BROOKLYN, N.Y. 11234-9011
TEL. (718) 251-8060 FAX. (718) 531-2564

revisions:	
no	date by description
E	08.07.06 UPDATED FOR 2004 FBC
F	09.06.07 NEW GLASS ADDED, CHART REV.
G	01.11.08 REV. PER BCCO COMMENTS

date: 10-27-97
scale: 3/8"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W97-33

sheet 2 of 7

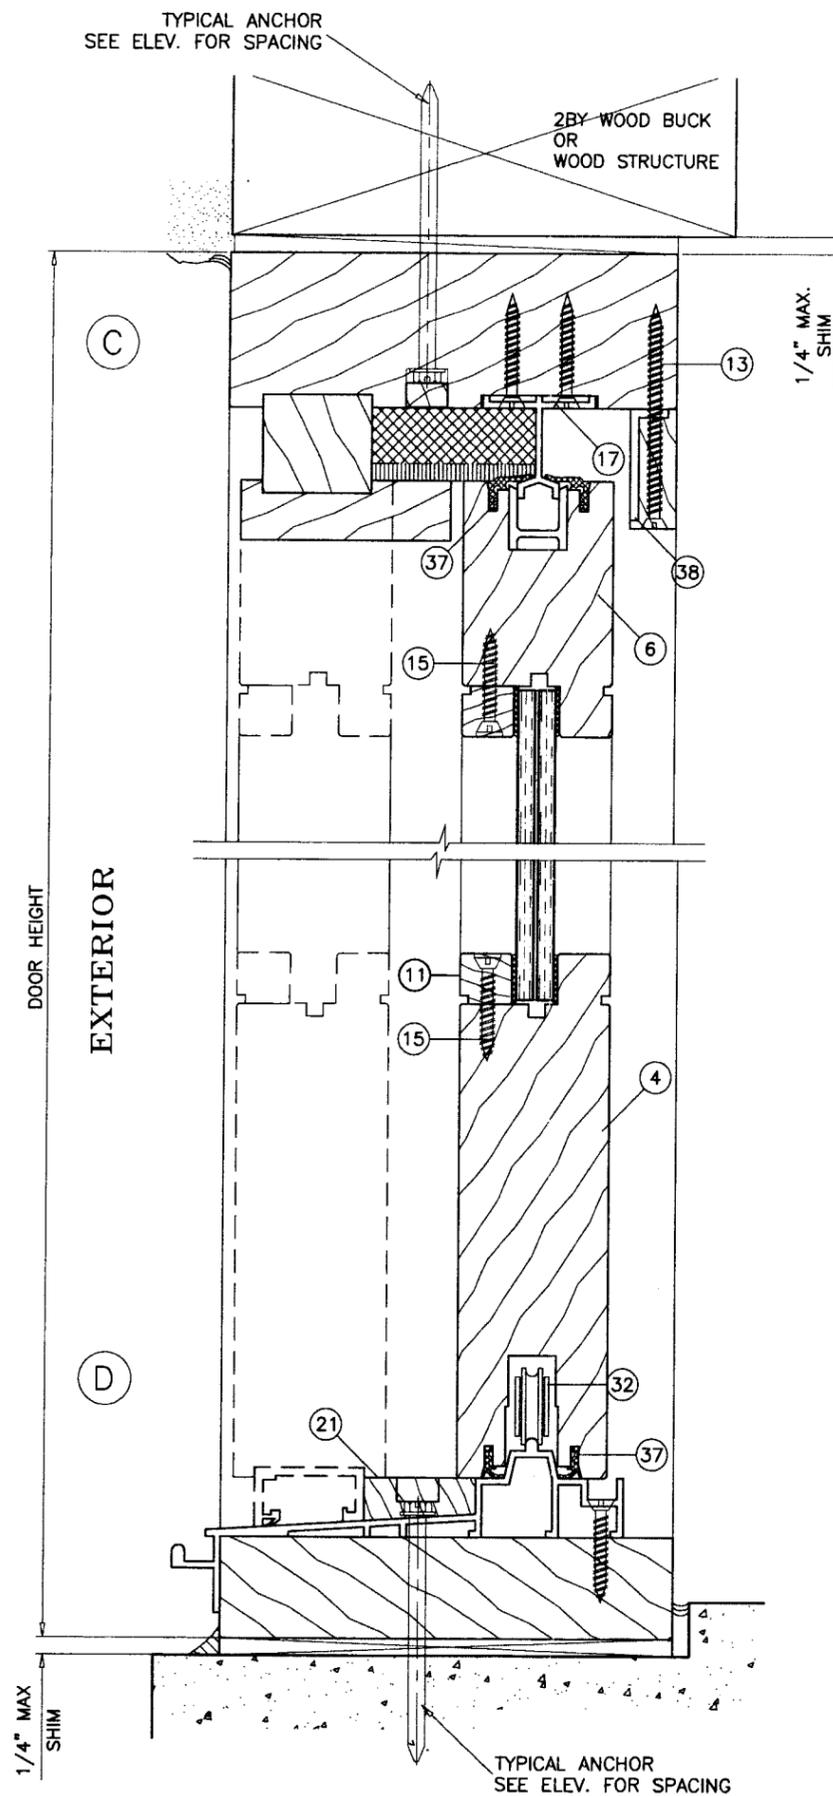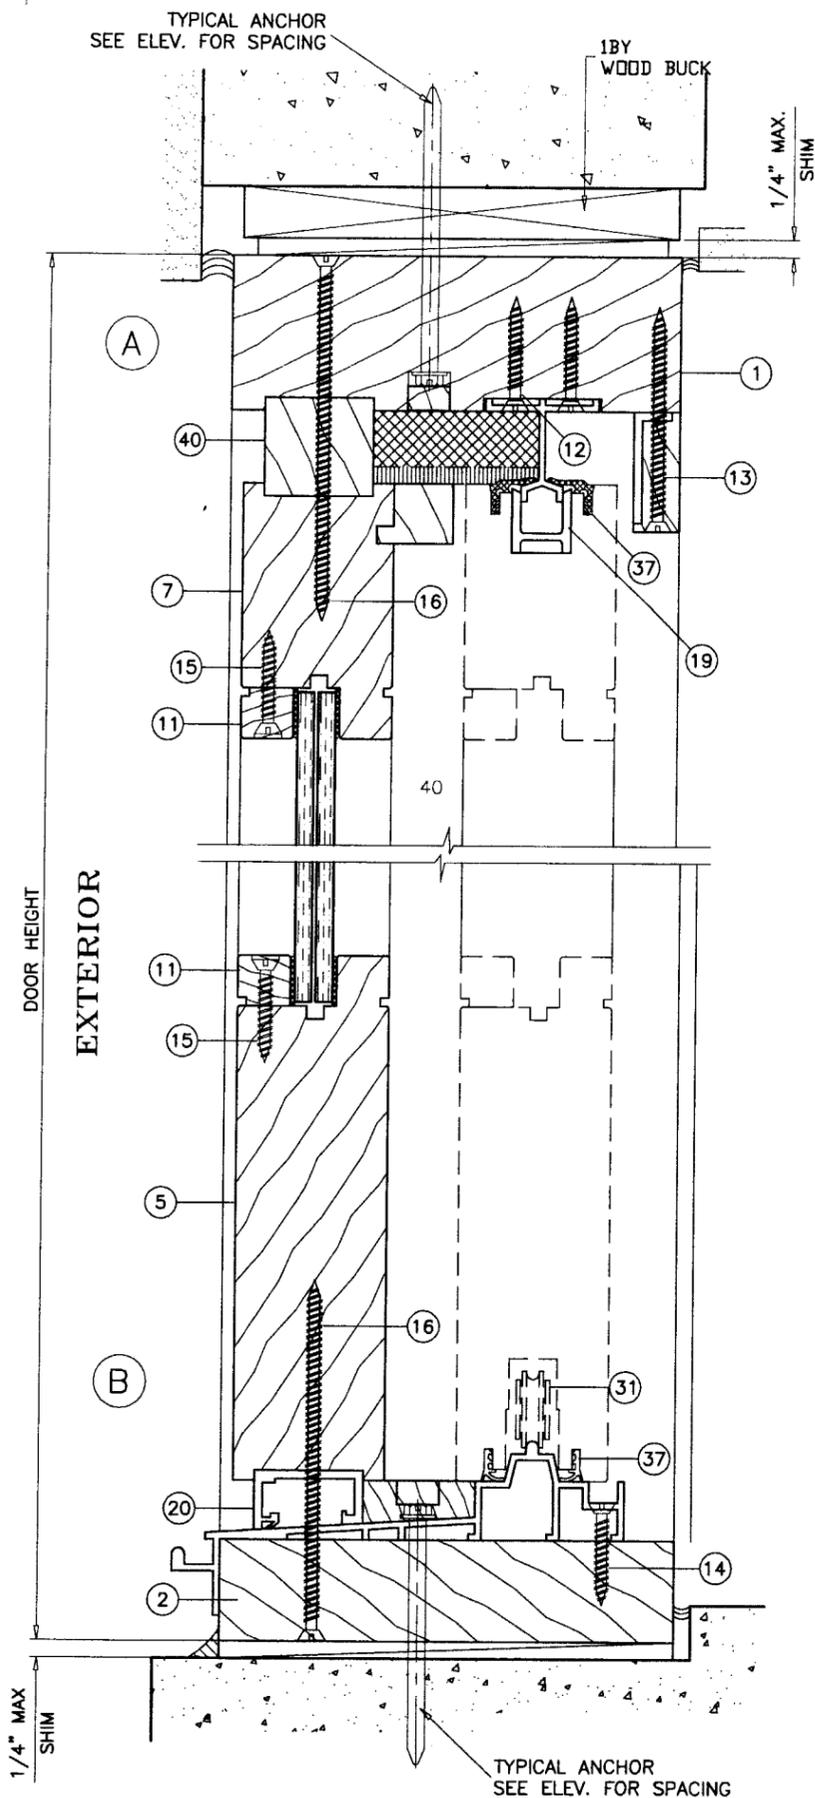

WOOD BUCKS NOT BY ZELUCK INC.
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

3/8" LAG SCREWS
INTO WOOD STRUCTURES
2" MIN. PENETRATION INTO WOOD

1/4" TAPCONS
INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD
THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/2" MIN. EMBED INTO CONC. OR MASONRY

DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/4" MIN.
INTO WOOD STRUCTURE = 1-1/2" MIN.

SEALANT:

FRAME CORNERS, TOP AND BOTTOM RAILS OF FIXED PANELS
INTERIOR & EXTERIOR THRESHOLD, SILL SPACER UNDER FIXED
PANELS AND INTERIOR AND EXTERIOR OF GLAZING TO BE SEALED
WITH SILICONE SEALANT.

4 POINT LOCKING SYSTEM @ 9/0 DOORS

METAL KEEPERS AND SLIDE LOCKS AT
(8", 47", 65-1/2" AND 94" FROM BOTTOM)

4 POINT LOCKING SYSTEM @ 10/4 DOORS

METAL KEEPERS AND SLIDE LOCKS AT
(8", 47", 71-1/2" AND 111-1/4" FROM BOTTOM)

Engr: YIPING WANG
STRUCTURES
FLA. PE # 55983
C.A.N. 3538

Yiping Wang

JAN 14 2008

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 07-0919.07
Expiration Date 07/28/2012

By *Muhammad Saeed*
Miami Dade Product Control
Division

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-8978
COMP-ANL\W97-33ZI-NEW


H7025 MAHOGANY WOOD SLIDING GLASS DOOR (L.M.I.)
ZELUCK INCORPORATED
5300 KINGS HIGHWAY
BROOKLYN, N.Y. 11234-9011
TEL. (718) 251-8060 FAX. (718) 531-2564

revisions:	no	date	by	description
	E	08.07.06		UPDATED FOR 2004 FBC
	F	09.06.07		NO CHANGE THIS SHEET
	G	01.11.08		NO CHANGE THIS SHEET


date: 10-27-97
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W97-33


sheet 3 of 7

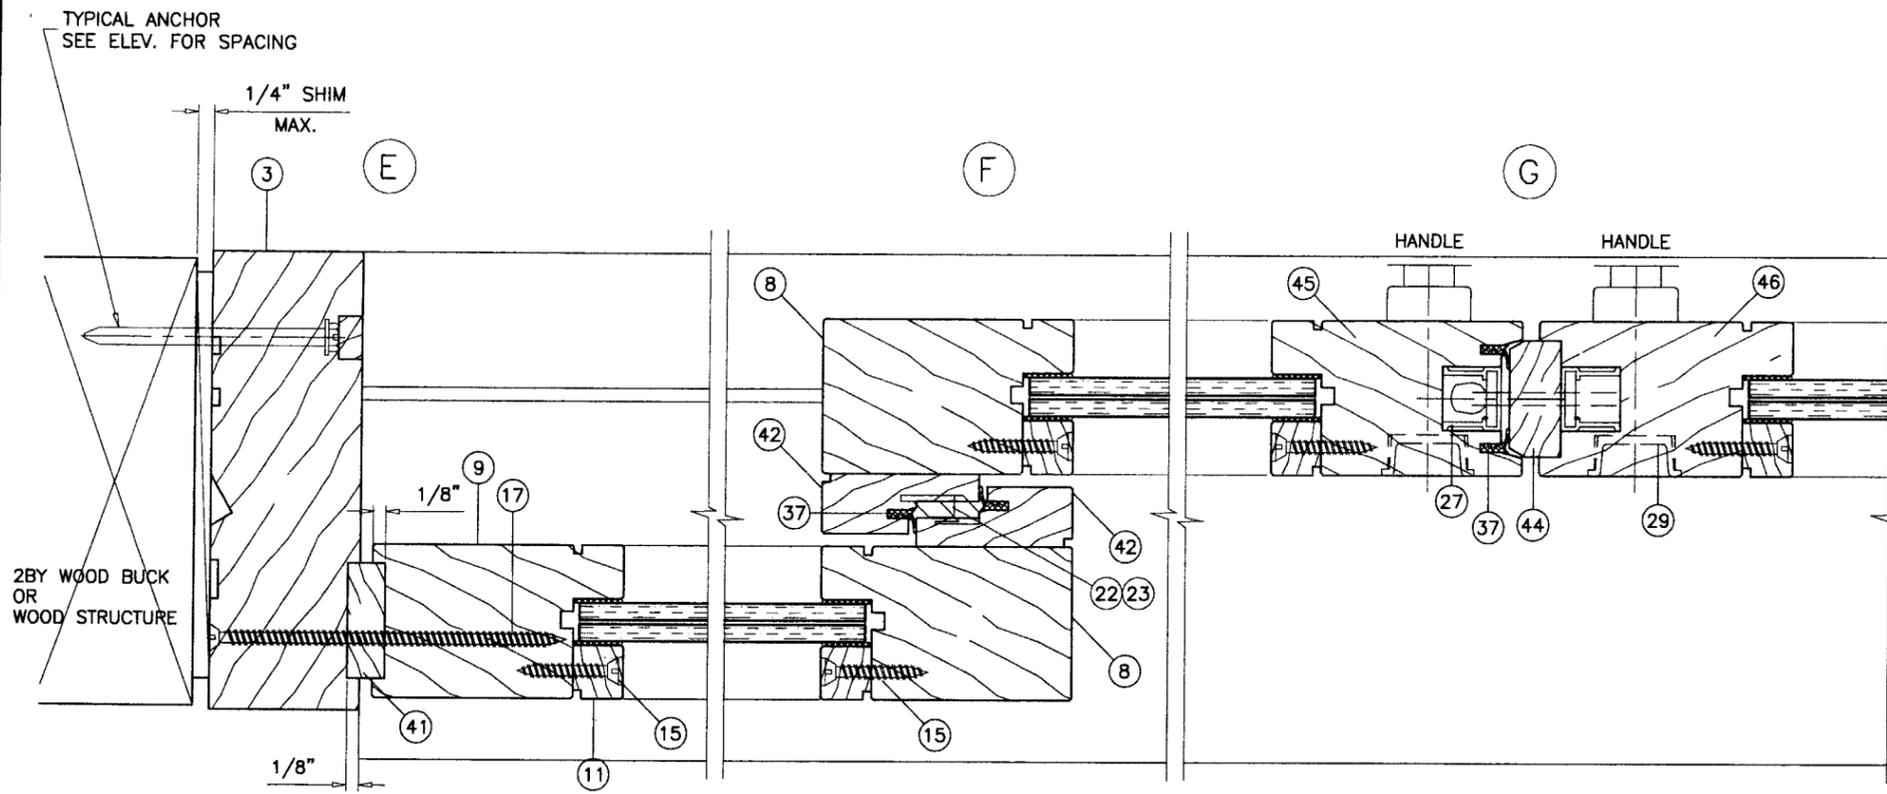

EXTERIOR

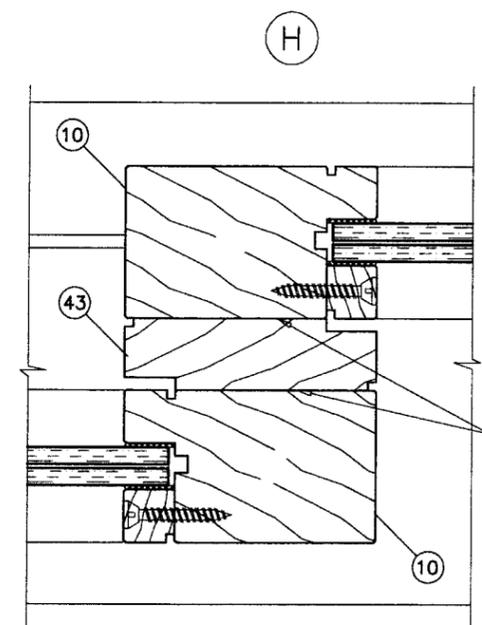

PHENYL RESORCINOL
WATER PROOF ADHESIVE

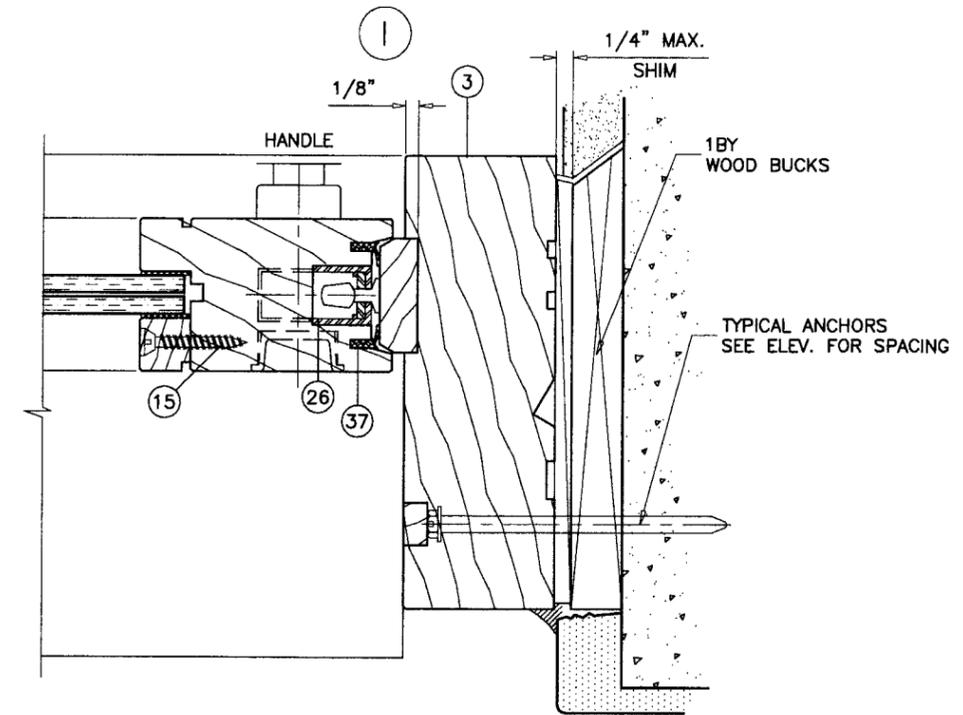

Engr: YIPING WANG
STRUCTURES
FLA. PE # 55983
C.A.N. 3538

Yiping Wang
JAN 14 2008

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. *07-0919-07*
Expiration Date *07/18/2012*

By *Manuel Silva*
Miami/Dade Product Control
Division

afc
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W97-33ZI-NEW

H7025 MAHOGANY WOOD SLIDING GLASS DOOR (L.M.I.)
ZELUCK INCORPORATED
5300 KINGS HIGHWAY
BROOKLYN, N.Y. 11234-9011
TEL. (718) 251-8060 FAX. (718) 531-2564

revisions:

no	date	by	description
E	08.07.06		UPDATED FOR 2004 FBC
F	09.06.07		NO CHANGE THIS SHEET
G	01.11.08		NO CHANGE THIS SHEET

date: 10-27-97
scale: 3/8" = 1"
dr. by: HAMID
chk. by:


drawing no.
W97-33
sheet 4 of 7

revisions:	no	date	by	description
	E	08.07.06		UPDATED FOR 2004 FBC
	F	09.06.07		NO CHANGE THIS SHEET
	G	01.11.08		NO CHANGE THIS SHEET

date:	10-27-97
scale:	3/8" = 1"
dr. by:	HAMID
chk. by:	




















drawing no.
W97-33

sheet 5 of 7

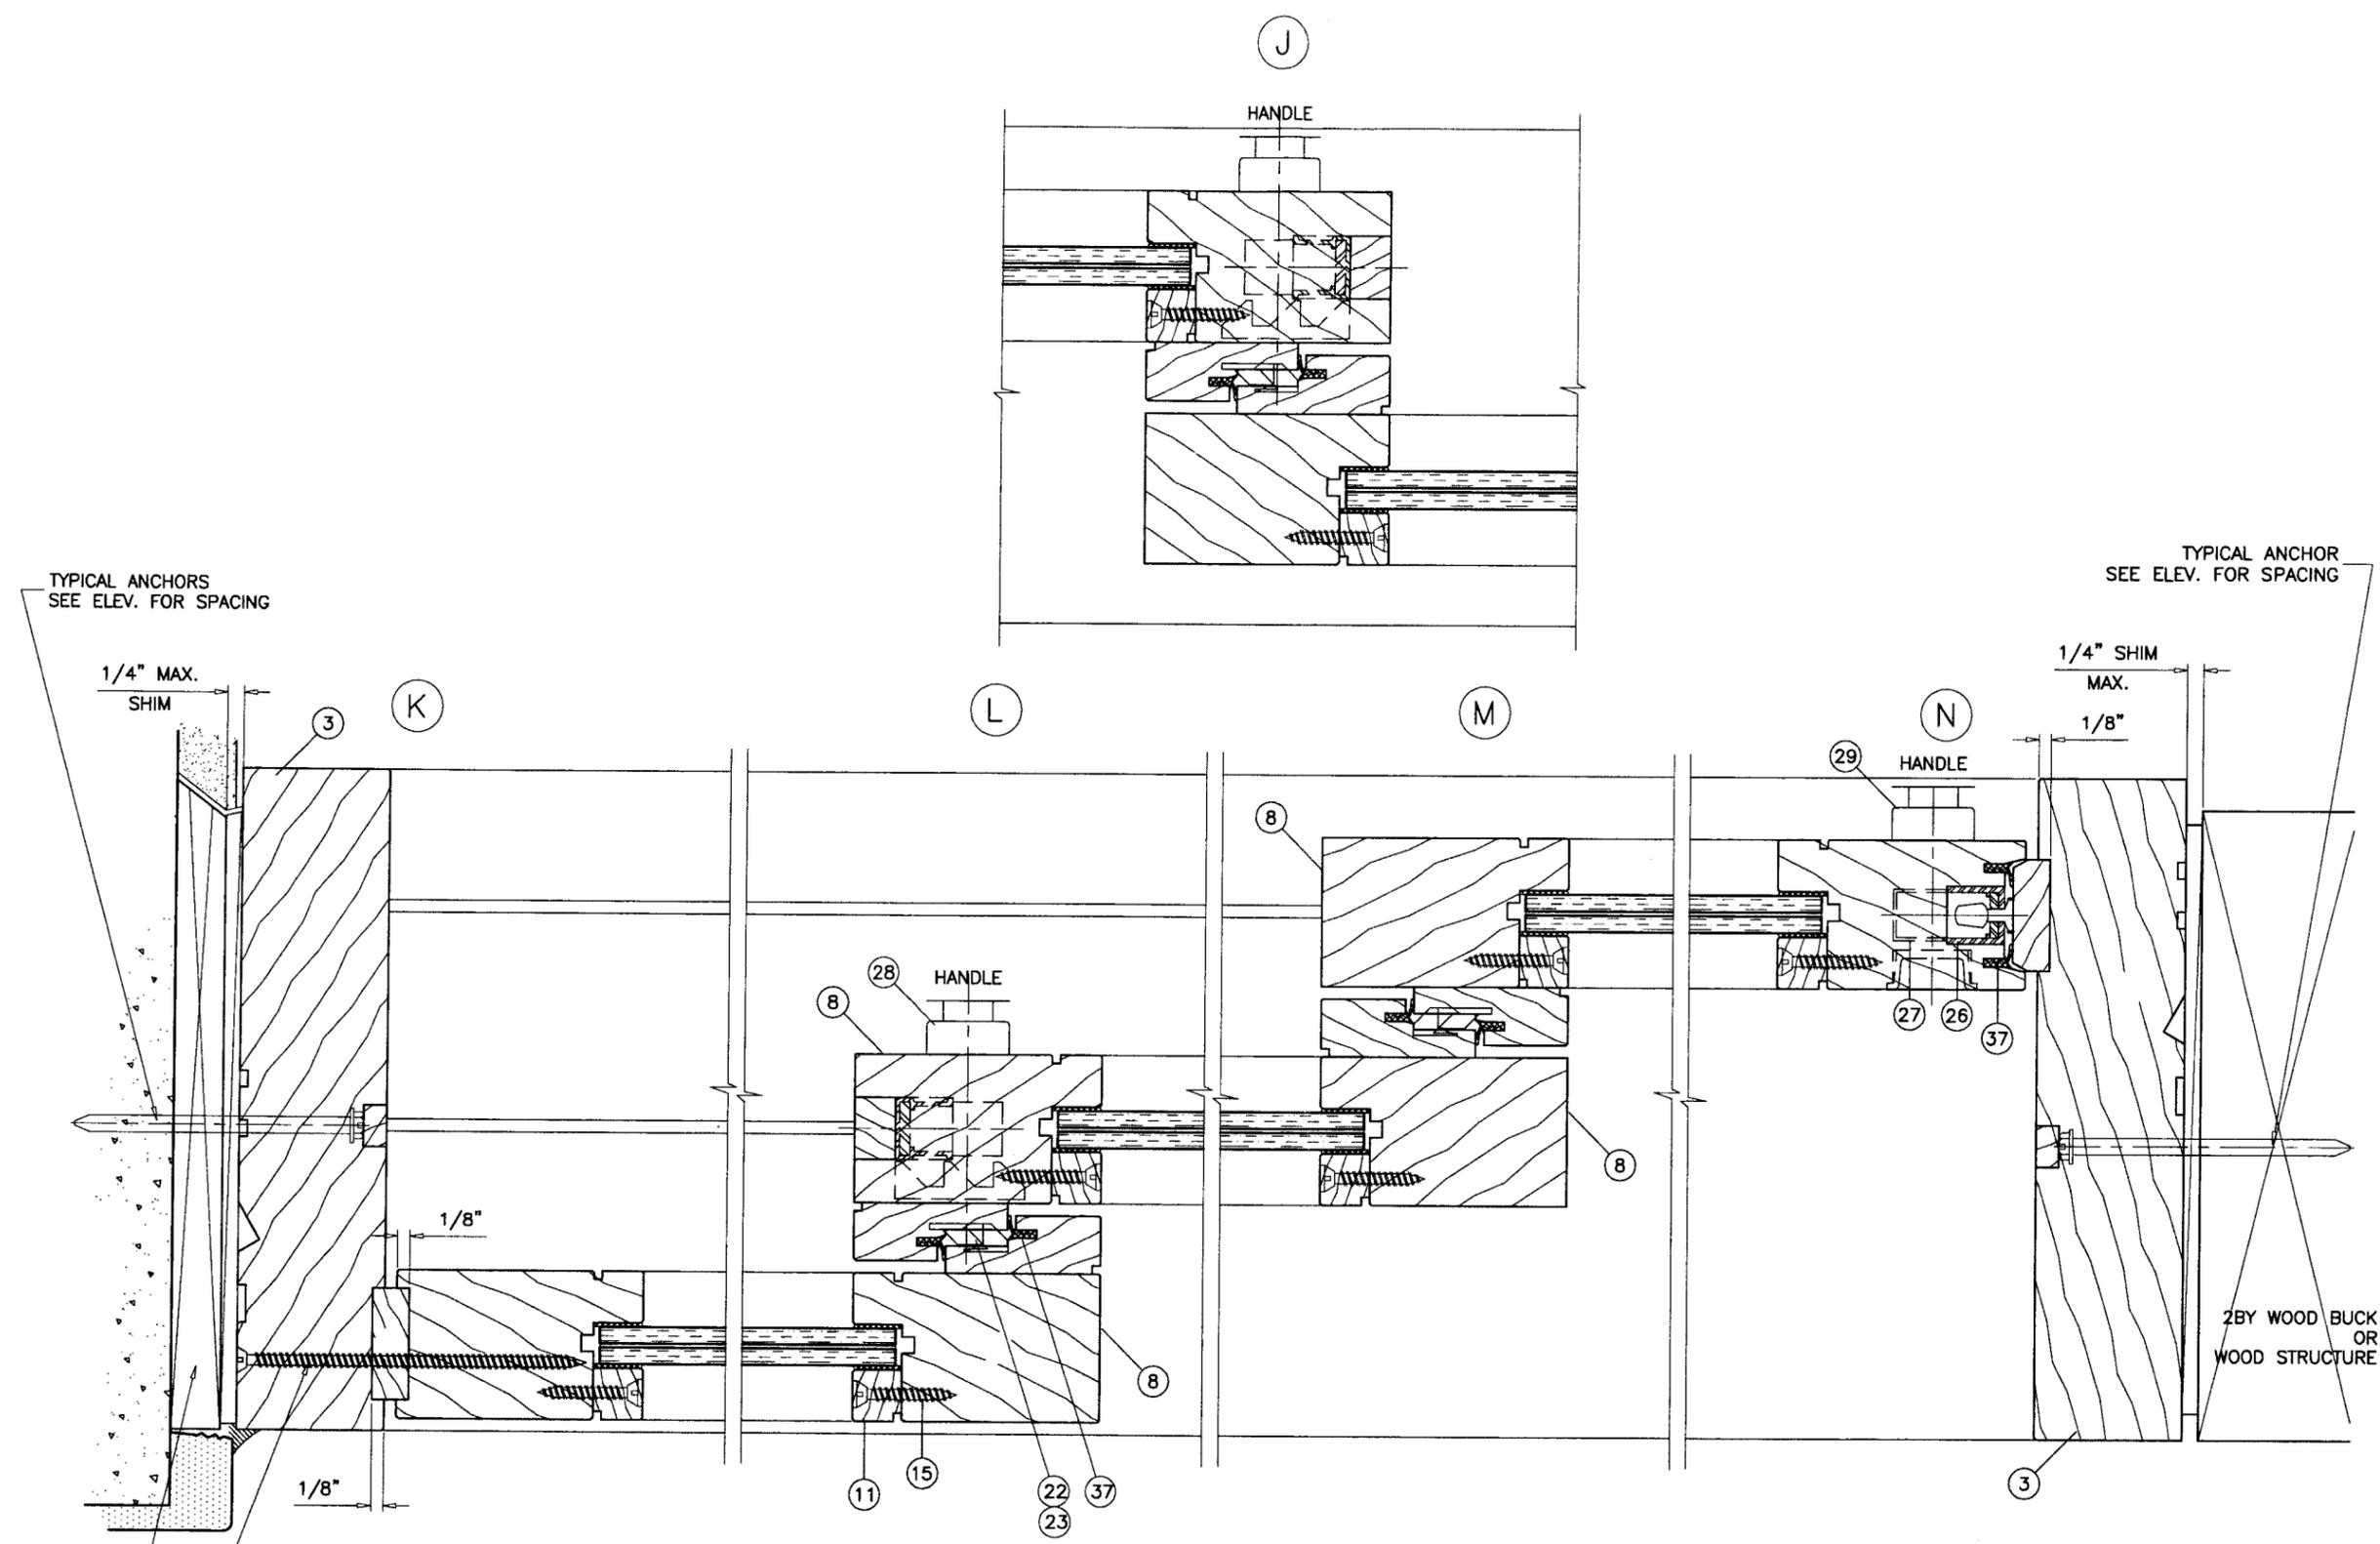

Engr: YIPING WANG
 STRUCTURES
 FLA. PE # 55983
 C.A.N. 3538
 07-09-07
 07/28/2012
 By *Maubel*
 Miami Dade Product Control
 Division
JAN 14 2008

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. *07-09-07*
 Expiration Date *07/28/2012*
 By *Maubel*
 Miami Dade Product Control
 Division

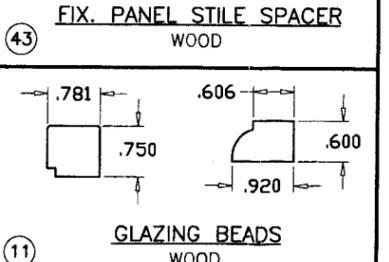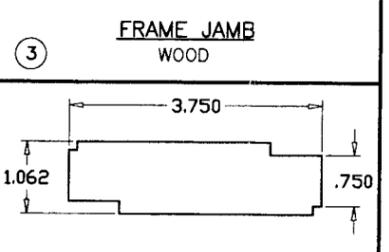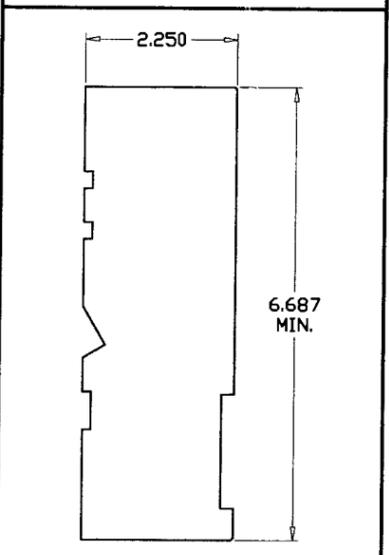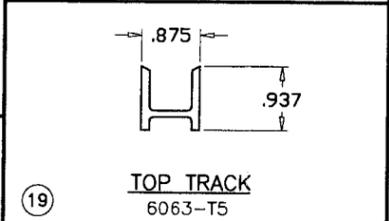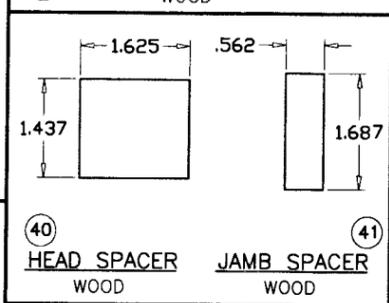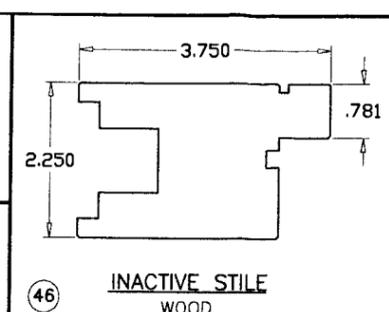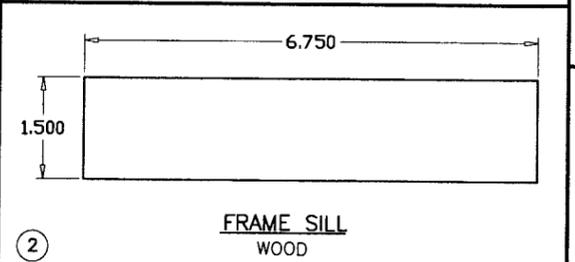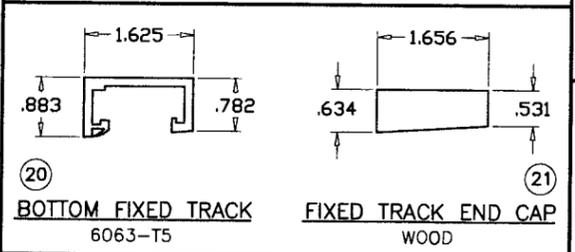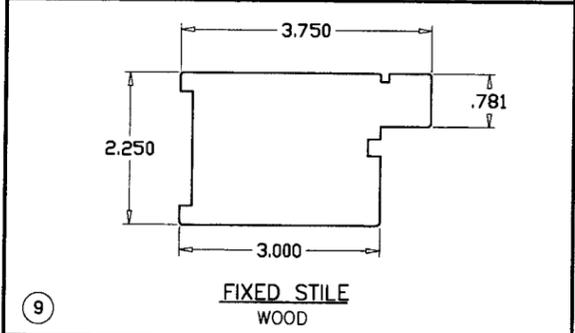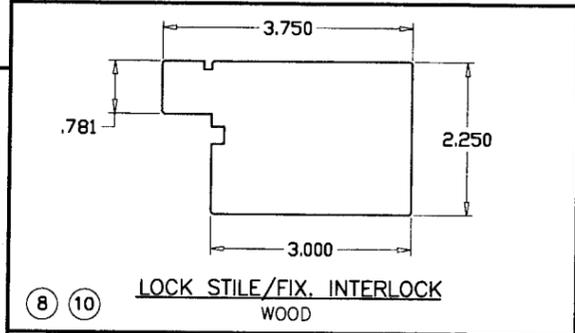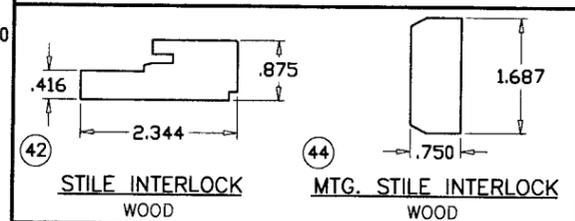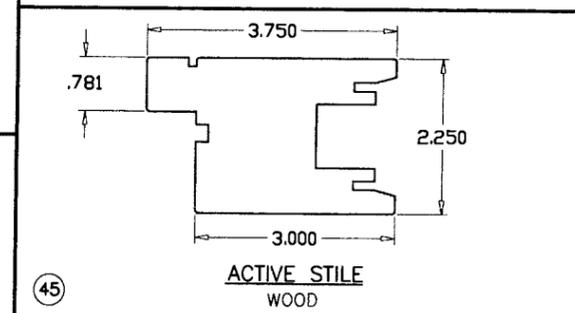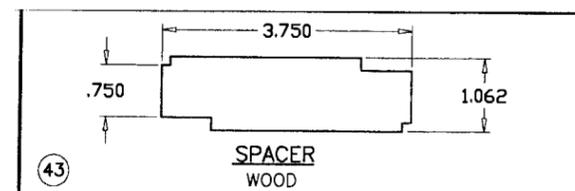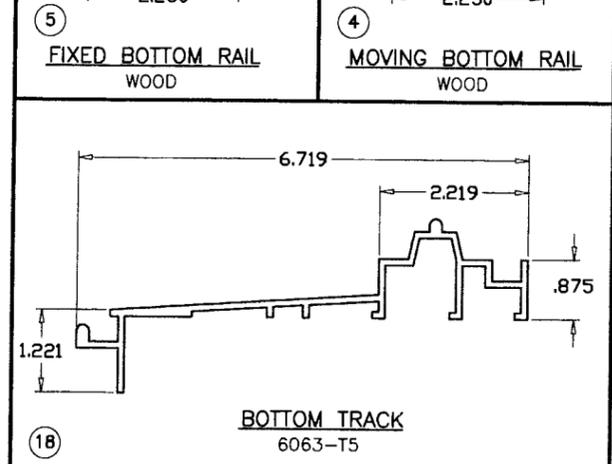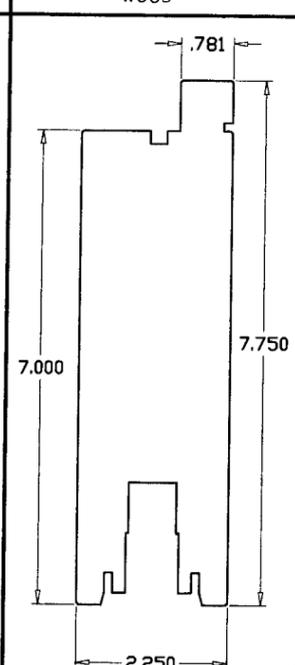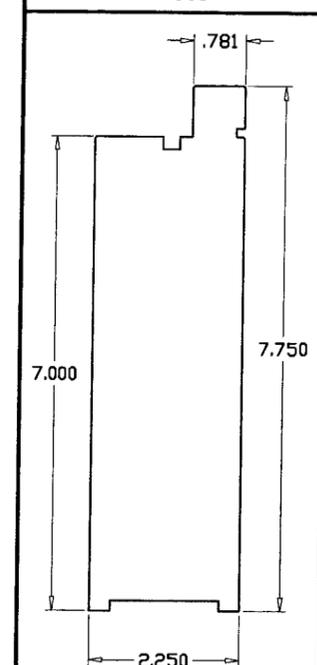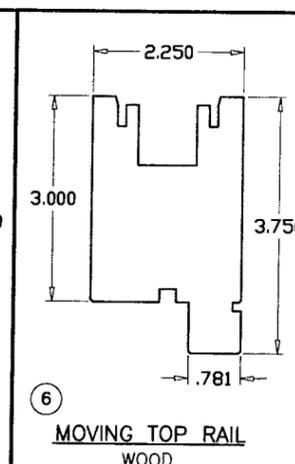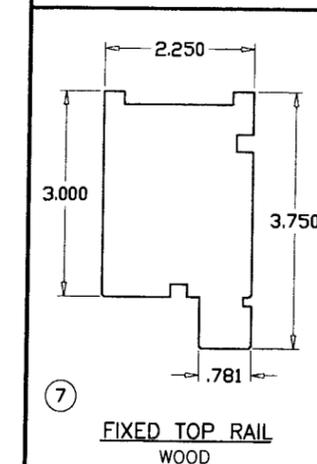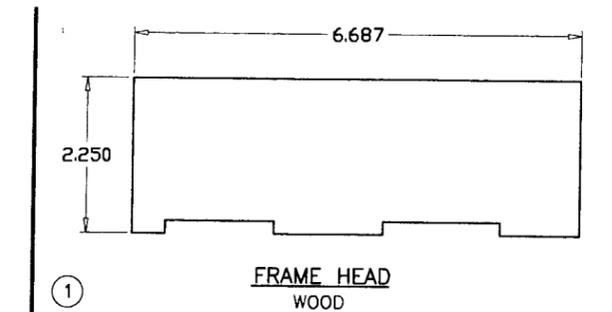

ITEM NO.	QTY.	DESCRIPTION	REMARKS
1	1	WOOD FRAME HEAD	
2	1	WOOD FRAME SILL	
3	2	WOOD FRAME JAMB	
4	-	WOOD MOVING HORIZ. BOTT. RAIL	(1) @ BOTT. OF EA. MOVING PANEL
5	-	WOOD FIXED HORIZ. BOTT. RAIL	(1) @ BOTT. OF EA. FIXED PANEL
6	-	WOOD TOP MOVING RAIL	(1) @ TOP OF EA. MOVING PANEL
7	-	WOOD TOP FIXED RAIL	(1) @ TOP OF EA. FIXED PANEL
8	-	WOOD LOCK STILE	(1) @ EA. MOVING PANEL
9	-	WOOD FIXED STILE	(1) @ EA. FIXED PANEL
10	-	WOOD FIXED INTERLOCK	(1) @ EA. FIXED PANEL
11	AS REQ'D	WOOD GLAZING BEAD	2 @ EA. VERT & HOR. STILE
12	-	# 8 X 1-1/4" SST. SCREWS	@ 8" O.C.
13	-	# 8 X 2-1/2" DRYWALL SCREWS	@ 18" O.C.
14	-	# 8 X 1-1/2" SST. SCREWS	@ 12" O.C.
15	-	# 8 X 1-1/2" WOOD SCREWS	@ 10" O.C.
16	-	# 8 X 4" DRYWALL SCREWS	@ 6" O.C.
17	-	# 8 X 4" DRYWALL SCREWS	@ 12" O.C.
18	1	ALUMINUM BOTTOM TRACK	6063-T5, AGB #727.173.602
19	1	ALUMINUM TOP TRACK	6063-T5, AGB #727.270.601
20	2	BOTTOM FIXED TRACK	6063-T5, AGB #727.370.300
21	2	BOTTOM FIXED TRACK END CAP	NEOPRENE, AGB #727.120.31
22	2	BOOTOM INTERLOCK SEAL	NEOPRENE, AGB #727.120.22.56
23	2	TOP INTEERLOCK SEAL	NEOPRENE, AGB #727.120.30.56
24	AS REQ'D	BOTTOM FRAME FASRENERS, ST'L	ZINC CHRMT'D, AGB #727.120.027
25	AS REQ'D	TOP FRAME FASTENERS, ST'L	ZINC CHRMT'D, AGB #727.120.023
26	2	DOOR STOP	NEOPRENE, AGB #727.120.13
27	2	DOOR LOCKING GEAR, ST'L	ZINC CHRMT'D, AGB #727.120.02
28	4	SECONDARY DOOR LCK'G BOLTS	ZINC CHRMT'D, AGB #727.120.13
29	2	ALUM. DOOR HANDLE & PULL	AGB #744.02.02
30	AS REQ'D	MIDDLE LOCK, ST'L	ZINC CHRMT'D, AGB #727.120.014
31	2	FRONT ROLLER, ST'L/DELTRIN	ZINC CHRMT'D, AGB #727.250
32	2	REAR ROLLER, ST'L/DELTRIN	ZINC CHRMT'D, AGB #727.251
33	2	CONNECTING BAR, ST'L/DELTRIN	ZINC CHRMT'D, AGB #727.120.150
34	2	REAR BOTTOM DOOR COVER	NEOPRENE, AGB #727.120.32
35	2	REAR TOP DOOR COVER	NEOPRENE, AGB #727.120.09
36	2	FRONT TOP DOOR COVER	NEOPRENE, AGB #727.120.04
37	16	DOOR WEATHERSTRIPPING	NEOPRENE, AGB #727.2.200
38	2	ALUMINUM ANGLE @ FRAME HEAD	6063-T5, HADCO #12x125
39	2	DOOR GEAR EXTENSION	ZINC CHRMT'D, AGB #727.500.02
40	AS REQD.	WOOD SPACER AT FIXED PANEL HEAD	-
41	AS REQD.	WOOD SPACER AT FIXED PANEL JAMB	-
42	AS REQD.	WOOD STILE INTERLOCK	-
43	AS REQD.	WOOD SPACER FIX. PANEL STILE	-
44	AS REQD.	WOOD MTG. STILE INTERLOCK	-
45	AS REQD.	WOOD ACTIVE STILE	-
46	AS REQD.	WOOD INACTIVE STILE	-

TYPICAL WOOD-HONDURES MAHOGANY LUMBER

Eng: YIPING WANG
STRUCTURES
FLA. PE # 55983
C.A.N. 3538

Yiping Wang
JAN 14 2008

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 07-0919.07
Expiration Date 09/28/2012

By *Manuel Perez*
Miami Dade Product Control
Division

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W97-33Z1-NEW


H7025 MAHOGANY WOOD SLIDING GLASS DOOR (L.M.I.)
ZELUCK INCORPORATED
5300 KINGS HIGHWAY
BROOKLYN, N.Y. 11234-9011
TEL. (718) 251-8060 FAX. (718) 531-2564

revisions:	no	date	by	description
	E	08.07.06		UPDATED FOR 2004 FBC
	F	09.06.07		NO CHANGE THIS SHEET
	G	01.11.08		REV. PER BCCO COMMENTS

date: 10-27-97
scale: 3/8" = 1"
dr. by: HAMID
chk. by:


drawing no.
W97-33

sheet 6 of 7

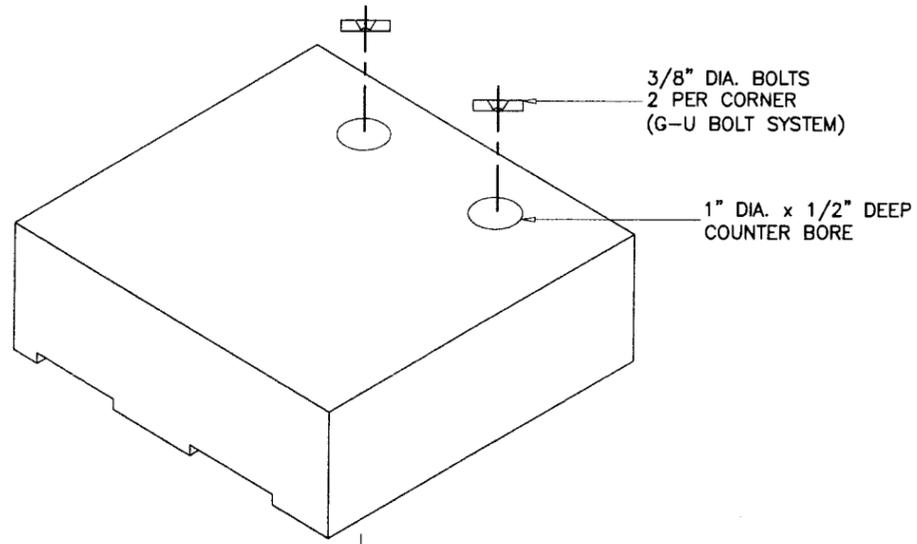


FRAME TOP CORNER

FRAME CORNERS SEALED
WITH 'SIKAFLEX 1A' SEALANT

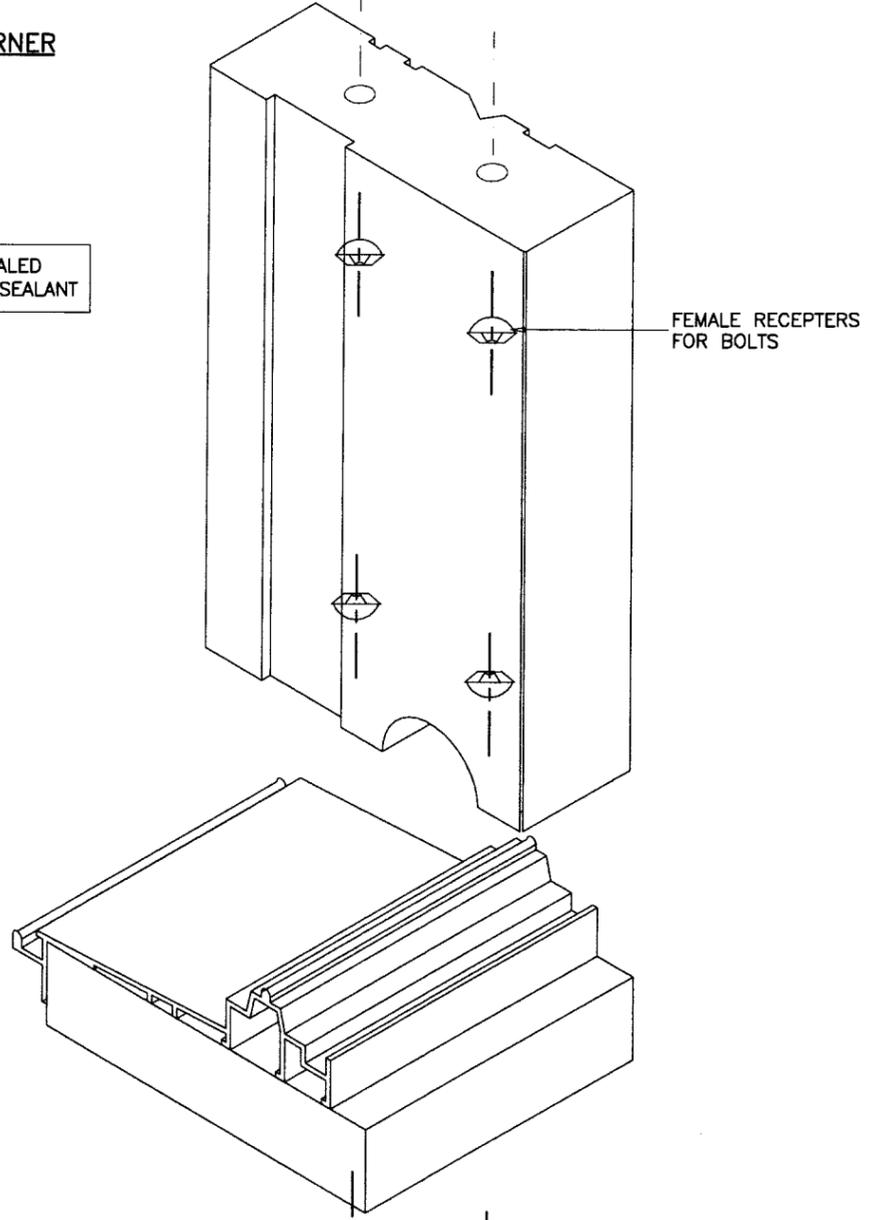


FRAME BOTTOM CORNER

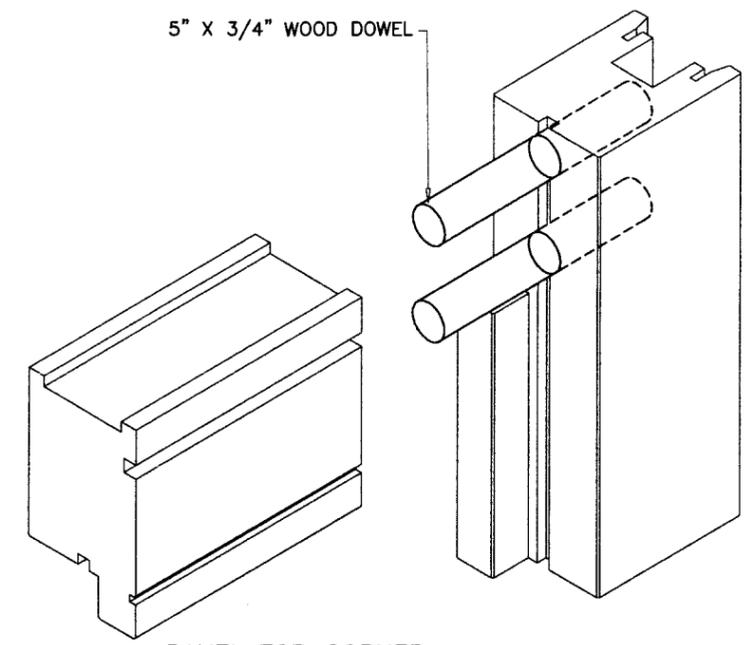

PANEL TOP CORNER

PANEL CORNERS & DOWELS SEALED/GLUED WITH
'PHENYL RESORCINOL' WATER PROOF ADHESIVE

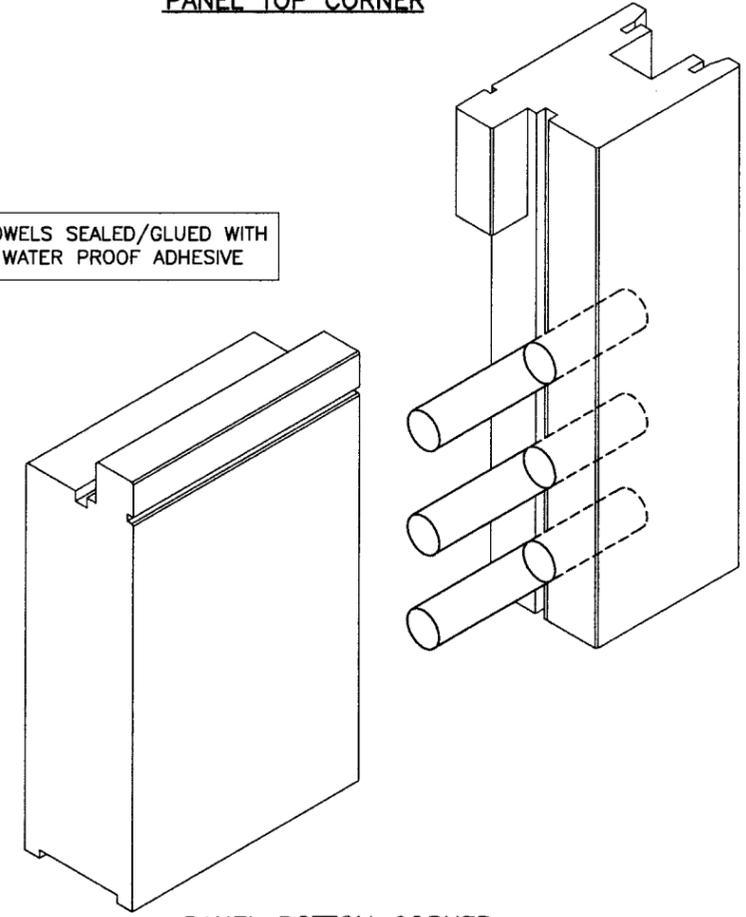

PANEL BOTTOM CORNER

Engr: YIPING WANG
STRUCTURES
FLA. PE # 55983
C.A.N. 3538

Yiping Wang

JAN 14 2008

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. *07-0919.07*
Expiration Date *09/28/2012*

By *Manuel...*
Miami Dade Product Control
Division

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W97-33Z1-NEW

H7025 MAHOGANY WOOD SLIDING GLASS DOOR (L.M.I.)

ZELUCK INCORPORATED
5300 KINGS HIGHWAY
BROOKLYN, N.Y. 11234-9011
TEL. (718) 251-8060 FAX. (718) 531-2564

no	date	description
E	08.07.06	UPDATED FOR 2004 FBC
F	09.06.07	NO CHANGE THIS SHEET
G	01.11.08	NO CHANGE THIS SHEET

date: 10-27-97
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W97-33
sheet 7 of 7