



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

Miami Wall Systems, Inc.
701 West 25 Street
Hialeah, FL 33010

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 101 Aluminum Window Wall System – S.M.I.

APPROVAL DOCUMENT: Drawing No.MWS-101, titled “Window Wall Series 101”, sheets 1 through 6 of 6, dated 11/03/1998, with revision # 2 dated 12/19/2006, prepared by manufacturer, signed and sealed by Sifang Zhao, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 06-1121.19** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 07-1105.10
Expiration Date: December 02, 2008
Approval Date: January 03, 2008

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **MWS-101**, Sheets 1 through 6 of 6, titled "Window Wall Series 101", prepared by manufacturer, dated 11/03/1998 with revision # 2 dated 12/19/2006, signed and sealed by Sifang Zhao, P.E.

B. TESTS

1. Test report on: 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
4) Small Missile Impact Test per PA 201-94
5) Cyclic Wind Pressure Test per PA 203-94

Along with marked-up drawings and installation diagram of an aluminum window wall system with a heavy duty mullion, prepared by Fenestration Testing Laboratory Inc., Test Report No. **FTL-1779**, dated Aug. 28, 1997, signed and sealed by Gilbert Diamond, P.E.

(Submitted under NOA#06-1121.19)

2. Test report on: 1) Uniform Static Air Pressure Test, Loading per PA 202-94.
2) Small Missile Impact Test per PA 201-94
3) Cyclic Wind Pressure Test per PA 203-94

Along with marked-up drawings and installation diagram of an aluminum window wall system with a light duty mullion, prepared by Fenestration Testing Laboratory Inc., Test Report No. **FTL-1784**, dated Aug. 28, 1997, signed and sealed by Gilbert Diamond, P.E.

(Submitted under NOA#06-1121.19)

3. Test report on: 1) Uniform Static Air Pressure Test, Loading per PA 202-94.
2) Small Missile Impact Test per PA 201-94
3) Cyclic Wind Pressure Test per PA 203-94

Along with marked-up drawings and installation diagram of an alum. window wall system with a non-reinforced mullion, prepared by Fenestration Testing Laboratory Inc., Test Report No. **FTL-1785**, dated Aug. 28, 1997, signed and sealed by Gilbert Diamond, P.E.

(Submitted under NOA#06-1121.19)



Manuel Perez, P.E.
Product Control Examiner
NOA No. 07-1105.10

Expiration Date: December 02, 2008

Approval Date: January 03, 2008

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS (Continuous)

4. Test reports on:
- 1) Air Infiltration Test, per ASTM E283
 - 2) Uniform Static Air Pressure Test, Loading per ASTM E330
 - 3) Water Resistance Test, per ASTM E547/E331
 - 4) Small Missile Impact Test ball bearings,
 - 5) Cyclic Wind Pressure Loading per 4,500 cycles.
 - 6) Forced Entry Test, per AAMA 1303.5-1975

along with marked-up drawings and installation diagram of an aluminum sliding glass door with reinforcement, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-2454, 2463, 2468, 2469 and 2470**, dated October 04, 1999 and October 11, 1999, signed and sealed by Aldo Pablo Gonzalez, P.E.
(Submitted under NOA#06-1121.19)

C. CALCULATIONS

1. Anchor Calculations and structural analysis, complying with FBC-2004, prepared by Xcel Engineering Corp., dated 11/14/2006 and revised on 12/18/2006, signed and sealed by Sifang Zhao, P.E.
Complies with ASTM E1300-02
(Submitted under NOA#06-1121.19)

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "Saflex III **Clear or colored interlayer**" dated 05/04/2006, expiring on 05/21/2011.

F. STATEMENTS

1. Statement letter of conformance, no financial interest and compliance, dated 11/14/2006, signed and sealed by Sifang Zhao, P.E.
2. Laboratory compliance letter for Test Report no. **FTL-1779, 1784 and 1785**, issued by Fenestration Testing Laboratory, Inc., dated September 26, 1997, signed and sealed by Fredrick D. Shaffer, P.E.
3. Testing agreement letter, dated 10/08/2007, between Fenestration Testing Laboratory (FTL) and Miami Wall Systems, Inc., issued and signed by Jorge Valdes (Fenestration Testing Laboratory).

G. OTHER


1. Notice of Acceptance No. **06-1121.19**, issued to Miami Wall Systems, Inc. for their Series 101 Aluminum Fixed Window Wall System – S.M.I., approved on 01/11/2007 and expiring on 12/02/2007.
2. One year conditional approval, subjected to successful verification test.

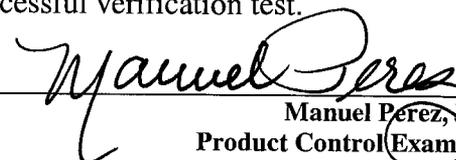
Manuel Perez, P.E.


Product Control Examiner
NOA No. 07-1105.10

Expiration Date: December 02, 2008


Approval Date: January 03, 2008

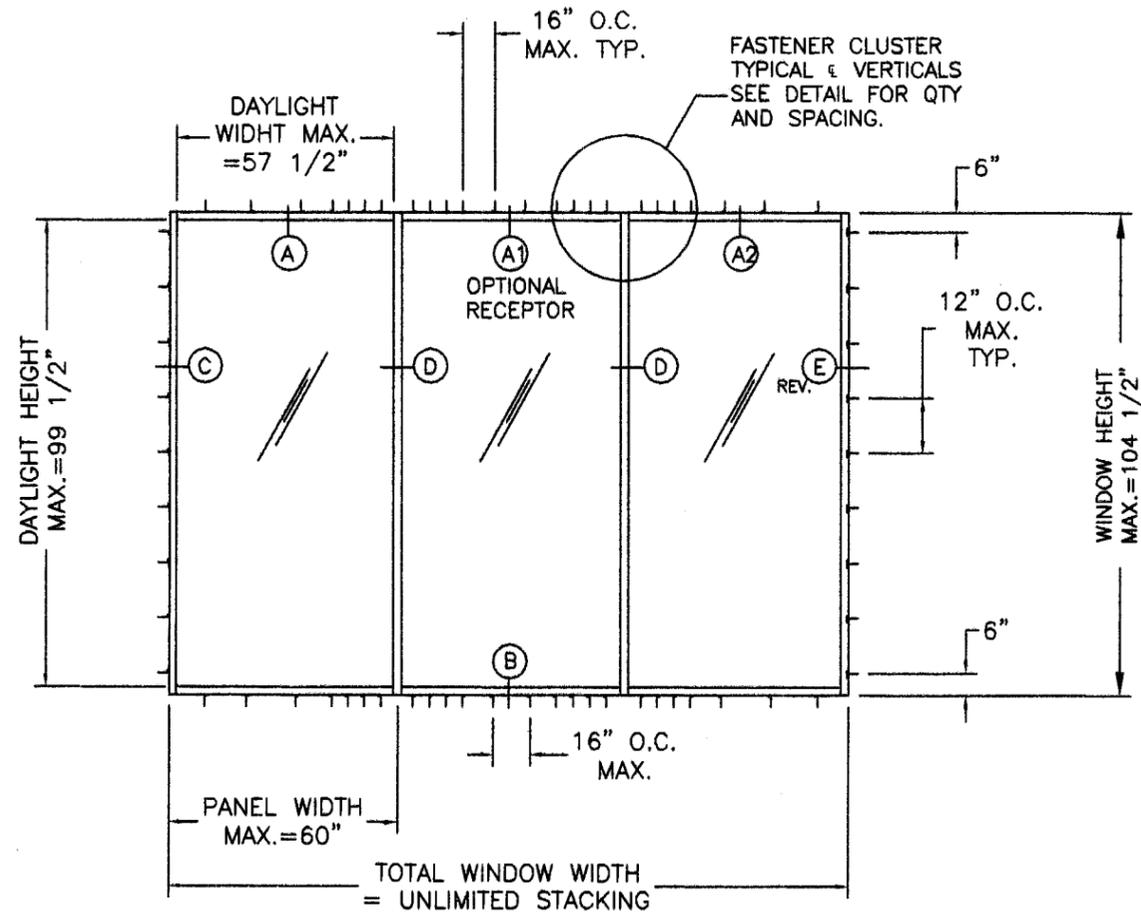

TYPICAL ELEVATION

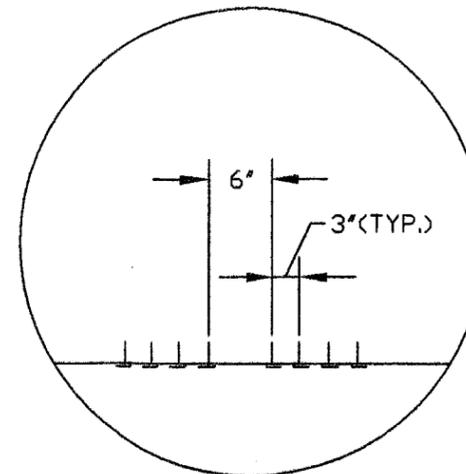

TYPICAL INSTALLATION HOLES CLUSTER @ ε OF ALL VERTICALS, HEAD & SILL. USE CLUSTER OF (8)

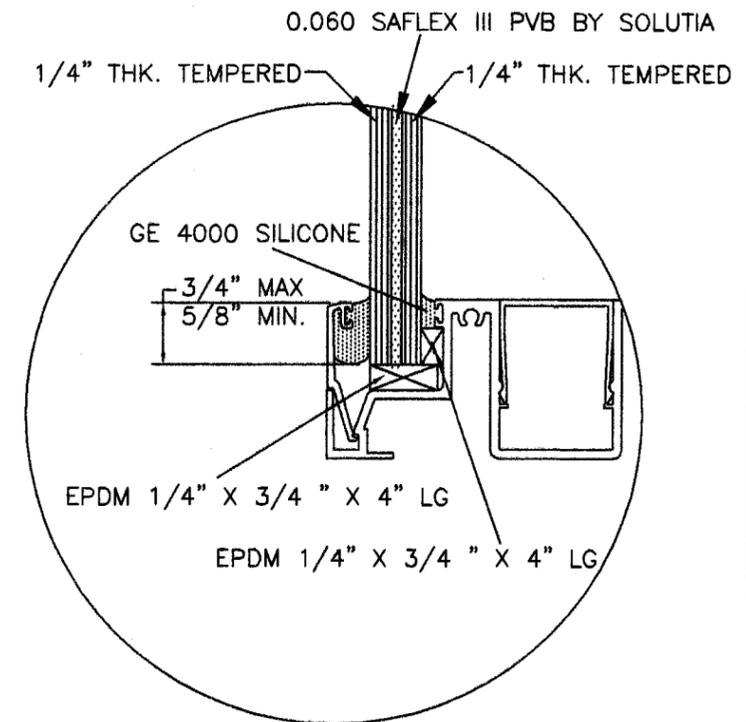

TYPICAL GLAZING DETAIL

MIAMI WALL SYSTEMS, INC.

SERIES 101
ALUMINUM WINDOW WALL SYSTEM
BASED ON FTL #'S: 1779; 1784; 1785 (SMALL MISSILE IMPACT)
GLASS: 9/16" LAMINATED
D.P. 110.0; 100.0; 60.0 PSF (POSITIVE & NEGATIVE)
W.T.P.: 20 PSF

GENERAL NOTES:

- (1) FRAME HEAD AND SILL USE SAME FASTENER SPACING.
- (2) MAX. PANEL SIZE: 60 "x104 1/2"
- (3) SMALL MISSILE IMPACT (SMI): UNIT TO BE INSTALLED ABOVE 30 FT ABOVE THE GRADE

DWG.No.	DESIGNATION	REINFORCEMENT	LOCATION	TEST REPORT	DESIGN PRESSURE
MWS-101, SHEET 2	NO REINFORCEMENT	NONE	NONE	FTL #1785	+60, -60 psf
MWS-101, SHEET 3	LIGHT REINFORCEMENT	1/4" STEEL BAR *	VERT. MULL	FTL #1784	+100, -100 psf
MWS-101, SHEET 4	HEAVY REINFORCEMENT	(2) 1/2x2 1/2" STEEL BAR*	VERT. MULL	FTL #1779	+110, -110 psf

*NOTE: ALL REINFORCEMENTS MEMBERS ARE FULL LENGTH

NOA LABEL

Miami Wall Systems 701 W. 25th Street Hialeah, Fl, 33010	Lab Test # Approval Type Product Series Impact	FTL-1785, 1784, 1779 Dade Co. NOA 06-1121.19 101 Fixed Small Missile SHUTTERS NOT REQUIRED
--	---	--

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 06-1121.19
Expiration Date DEC. 2, 2007
By Manuel Perez
Miami/Dade Product Control
Division

XCEL ENGINEERING CORP.
7785 NW 56 Street
Miami, Fl 33166
(305) 772 5023
CAN (EB) 9324

DEC 19 2006

Sifang Zhao Fla PE# 50685

Miami Wall Systems, Inc.
701 West 25th Street
Hialeah, Florida, 33010
Phone: (305) 888-2300 Fax: (305) 888-3058

WINDOW WALL SERIES 101

WALL ELEVATION REINFORCEMENT SUMMARY GENERAL NOTES

NO.	DATE	DESCRIPTION
1	11/13/06	UPDATE TO 2004 BUILDING CODE
2	12/19/06	PER BIDD COMMENTS

revisions:

date: 11/3/06	scale: HAF	design by: L.G.	drawn by: L.G.	checked by: G.L.
---------------	------------	-----------------	----------------	------------------




drawing no. **MWS-101**

sheet 1 of 6


1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5' FROM EA. END AND A CLUSTER OF (8) @ VERT. MULL. AND BALANCE 16" O.C. (TYP.) SEE ELEVATION ON SHEET 1 FOR DETAILS

1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5' FROM EA. END AND A CLUSTER OF (8) @ VERT. MULL. AND BALANCE 16" O.C. (TYP.) SEE ELEVATION ON SHEET 1 FOR DETAILS

1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5' FROM EA. END AND A CLUSTER OF (8) @ VERT. MULL. AND BALANCE 16" O.C. (TYP.) SEE ELEVATION ON SHEET 1 FOR DETAILS

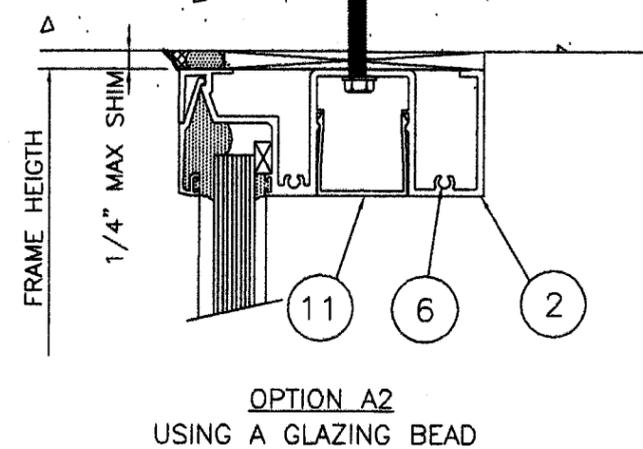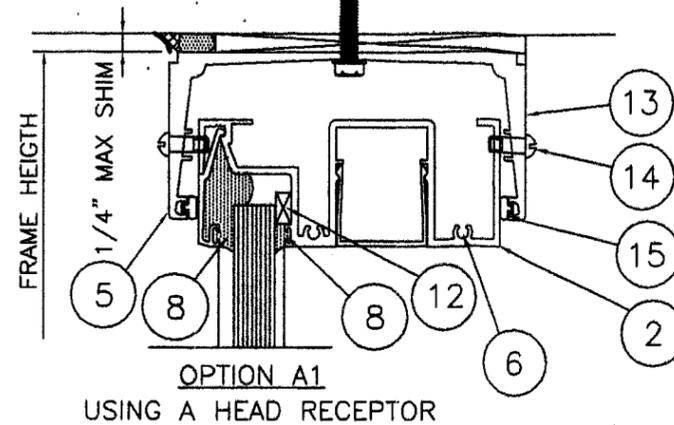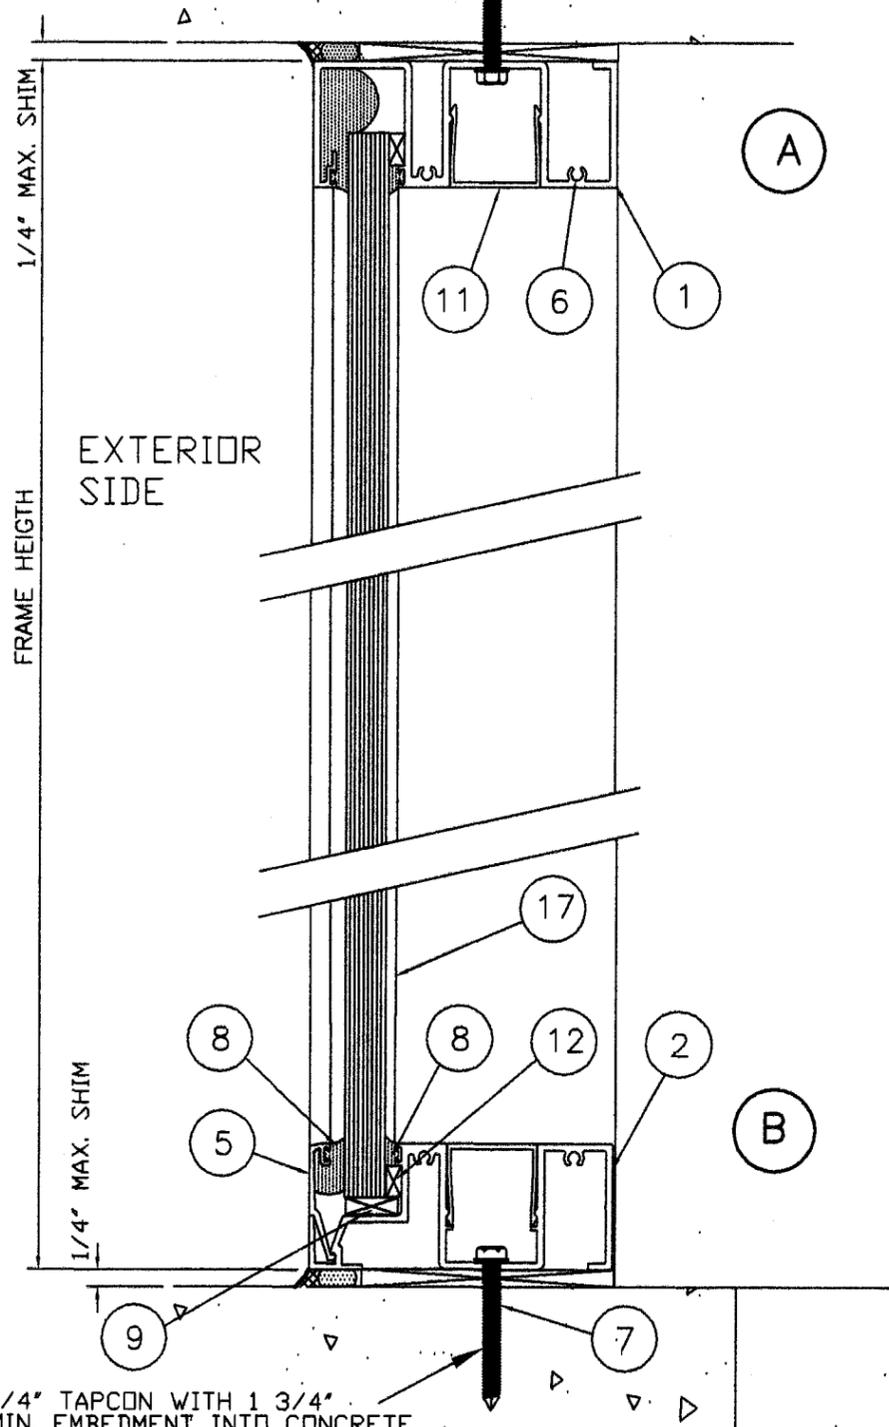

1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 6' FROM ENDS AND 12" O.C. (TYP.)

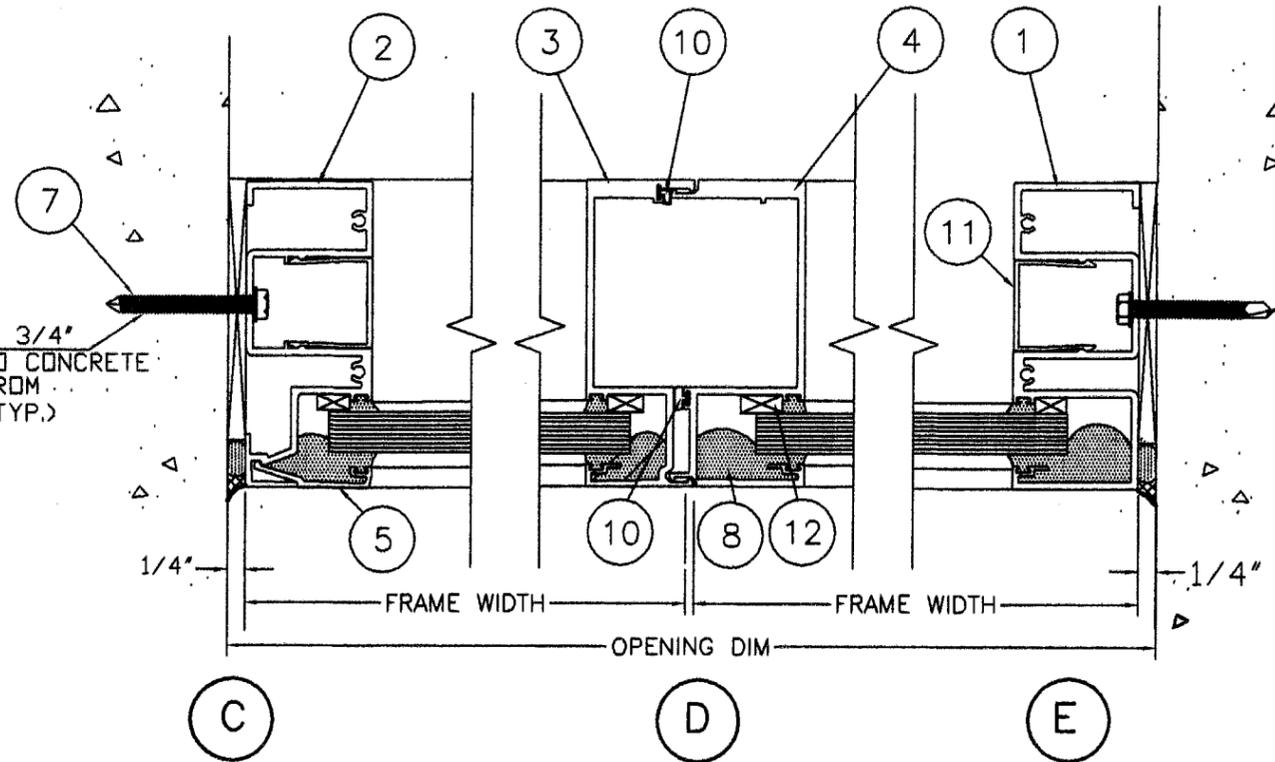

1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5' FROM EA. END AND A CLUSTER OF (8) @ VERT. MULL. AND BALANCE 16" O.C. (TYP.) SEE ELEVATION ON SHEET 1 FOR DETAILS

GLASS: 1/4" TEMP - .060 PVB - 1/4" TEMP

TEST#	DESIGNATION	D.P. (PSF)	W.T.P.
FTL# 1785	NO REINFORCEMENT	+60.0 -60.0	20.0 PSF

PRODUCT RENEWED as complying with the Florida Building Code Acceptance No. 07-1105.10 Expiration Date 12/02/2008
By *Mauricio Perez*
Miami Dade Product Control Division

PRODUCT RENEWED as complying with the Florida Building Code Acceptance No. 06-1121.19 Expiration Date DEC 2, 2007
By *Mauricio Perez*
Miami Dade Product Control Division

XCEL ENGINEERING CORP.
7785 NW 56 Street
Miami, FL 33166
(305) 772 5023
CAN (EB) 9524

DEC 19 2006

Sifang Zhao Fla PE# 50685

Miami Wall Systems, Inc.
701 West 25th street
Hialeah, Florida. 33010
Phone: (305) 888-2300 Fax: (305) 888-3058

WINDOW WALL SERIES 101
WALL ELEVATION
REINFORCEMENT SUMMARY
GENERAL NOTES

no.	date	description
1	11/13/06	UPDATE TO 2004 BUILDING CODE

date: 11/3/06
scale: HALF
design by: L.G.
drawn by: L.G.
checked by: G.L.




drawing no.
MWS-101

sheet 2 of 6


1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5" FROM EA. END AND A CLUSTER OF (8) @ VERT. MULL. AND BALANCE 16" O.C. (TYP.) SEE ELEVATION ON SHEET 1 FOR DETAILS

1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5" FROM EA. END AND A CLUSTER OF (8) @ VERT. MULL. AND BALANCE 16" O.C. (TYP.) SEE ELEVATION ON SHEET 1 FOR DETAILS

1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5" FROM EA. END AND A CLUSTER OF (8) @ VERT. MULL. AND BALANCE 16" O.C. (TYP.) SEE ELEVATION ON SHEET 1 FOR DETAILS

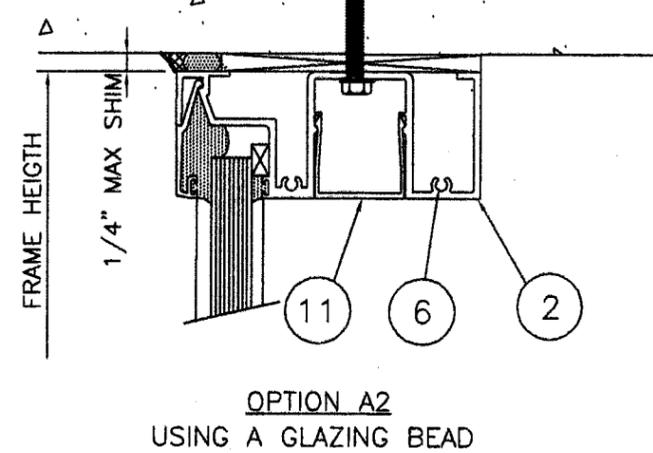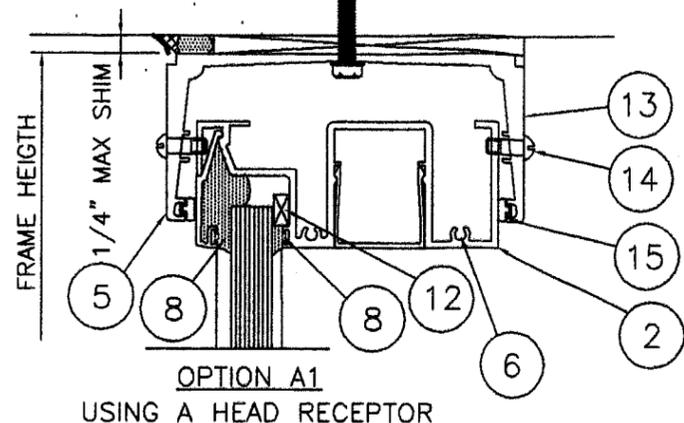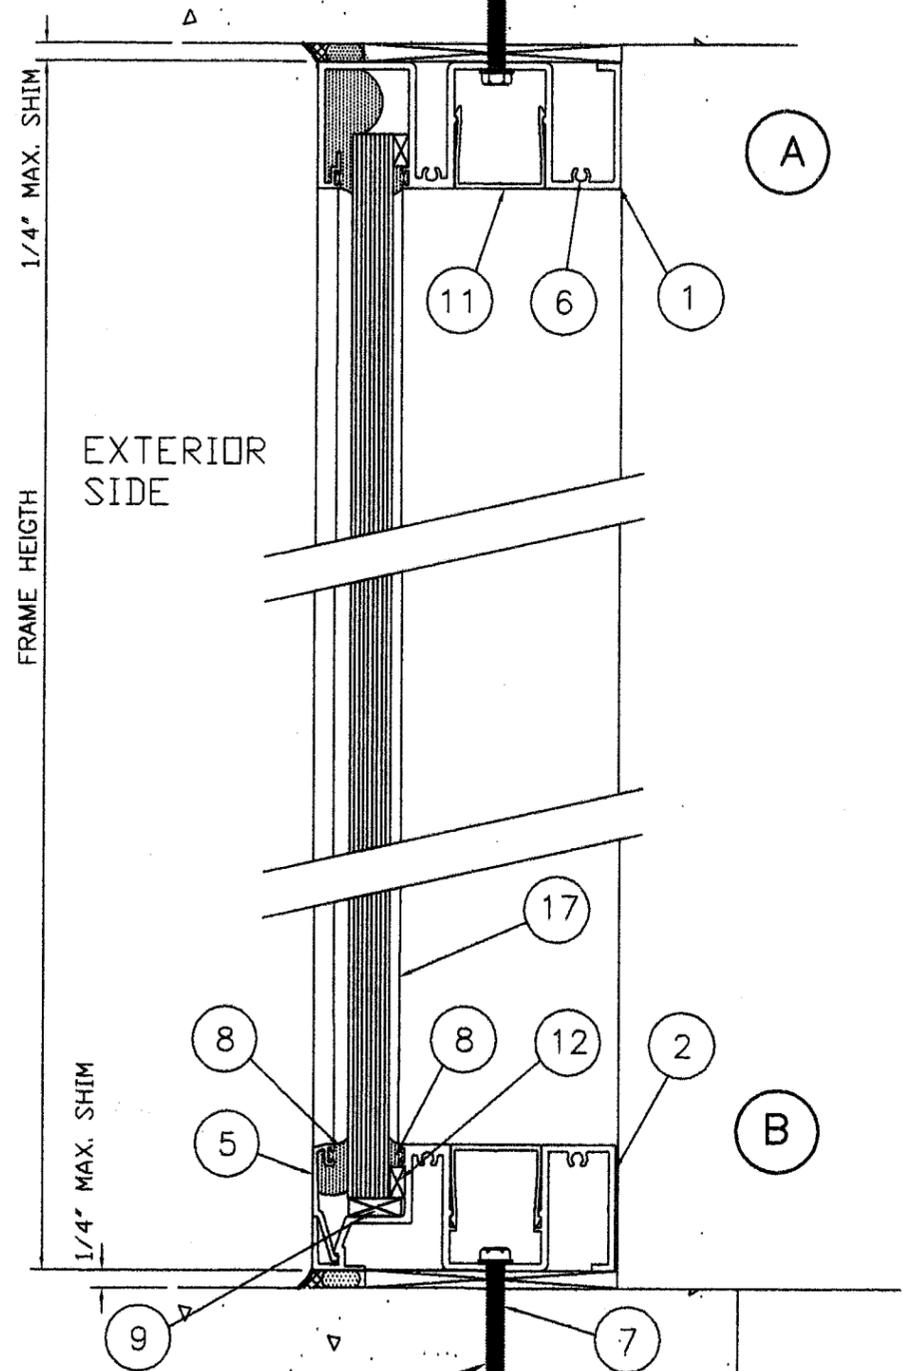

1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 6" FROM ENDS AND 12" O.C. (TYP.)

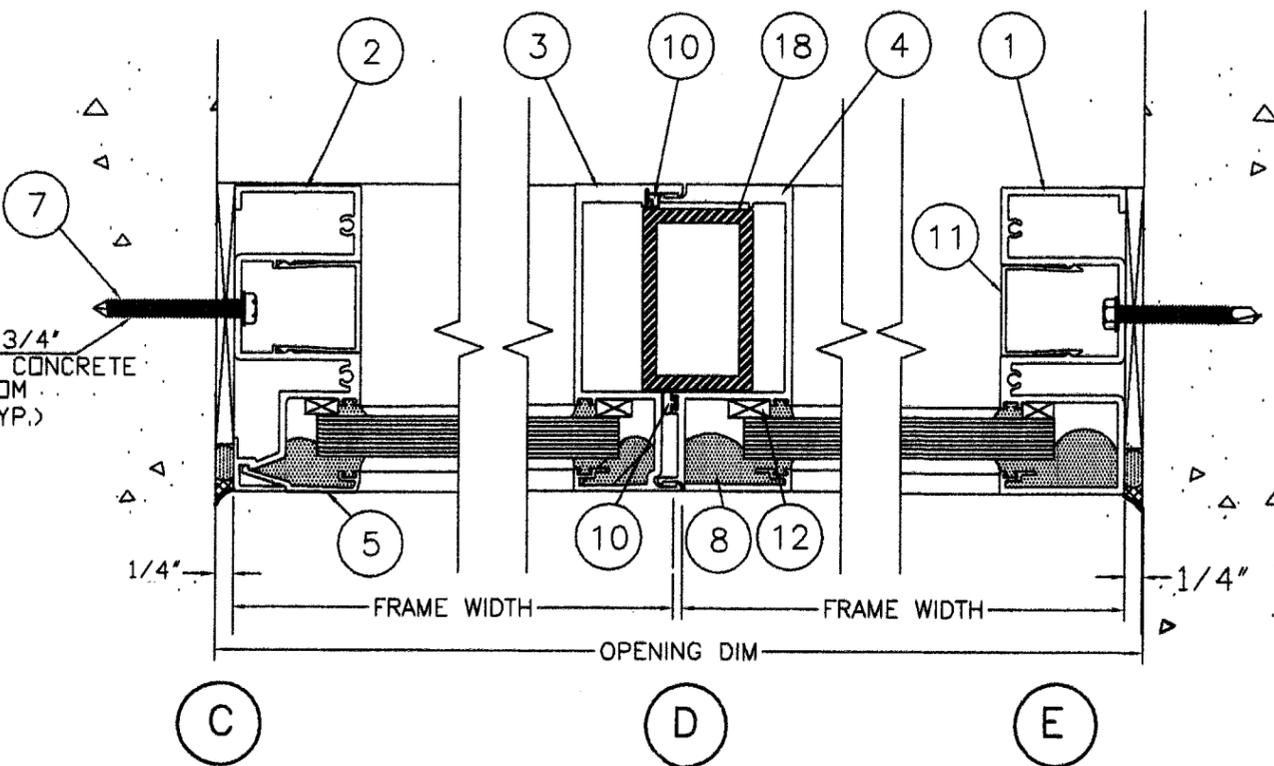

1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5" FROM EA. END AND A CLUSTER OF (8) @ VERT. MULL. AND BALANCE 16" O.C. (TYP.) SEE ELEVATION ON SHEET 1 FOR DETAILS

GLASS: 1/4 TEMP - .060 PVB - 1/4" TEMP

TEST#	DESIGNATION	D.P. (PSF)	W.T.P.
FTL# 1784	LIGHT REINFORCEMENT	+100.0 -100.0	20.0 PSF

PRODUCT RENEWED as complying with the Florida Building Code
 Acceptance No. 06-112119
 Expiration Date Dec 2, 2007
 By: *Manuel Perez*
 Miami Code Product Control Division

XCEL ENGINEERING CORP.
 7785 NW 56 Street
 Miami, FL 33166
 (305) 772 5025
 CAN (EB) 9324

DEC 19 2006
 Sifang Zhao Fla PE# 50685

Miami Wall Systems, Inc.
 701 West 25th Street
 Hialeah, Florida, 33010
 Phone: (305) 888-2300 Fax: (305) 888-3058

WINDOW WALL SERIES 101
 WALL ELEVATION
 REINFORCEMENT SUMMARY
 GENERAL NOTES

Revisions:

NO.	DATE	DESCRIPTION
1	11/13/06	UPDATE TO 2004 BUILDING CODE

date: 11/13/06
 scale: HALF
 design by: L.G.
 drawn by: L.G.
 checked by: G.L.




drawing no.
 MWS-101

sheet 3 of 6


1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5" FROM EA. END AND A CLUSTER OF (8) @ VERT. MULL. AND BALANCE 16" O.C. (TYP.) SEE ELEVATION ON SHEET 1 FOR DETAILS

1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5" FROM EA. END AND A CLUSTER OF (8) @ VERT. MULL. AND BALANCE 16" O.C. (TYP.) SEE ELEVATION ON SHEET 1 FOR DETAILS

1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5" FROM EA. END AND A CLUSTER OF (8) @ VERT. MULL. AND BALANCE 16" O.C. (TYP.) SEE ELEVATION ON SHEET 1 FOR DETAILS

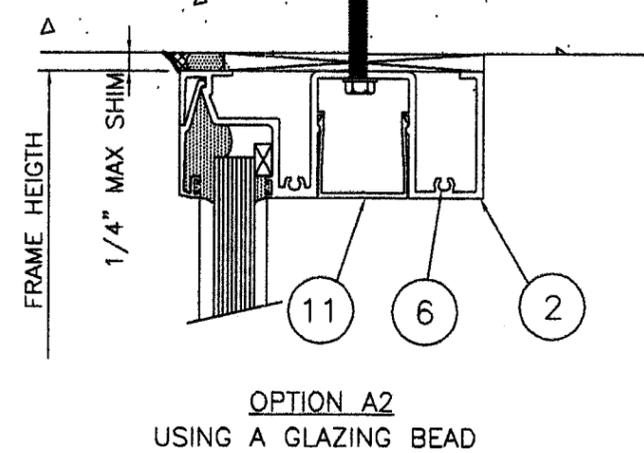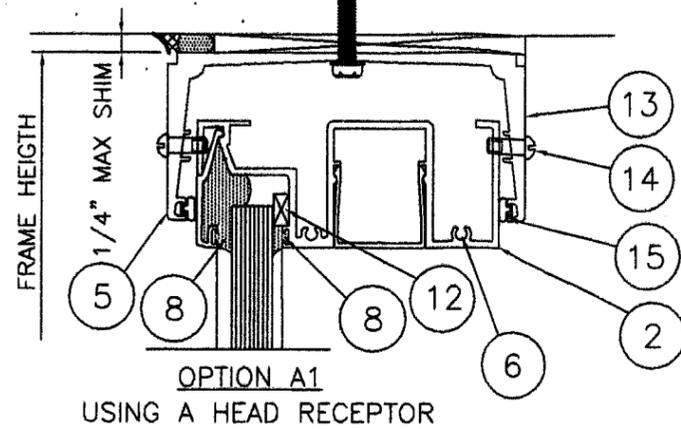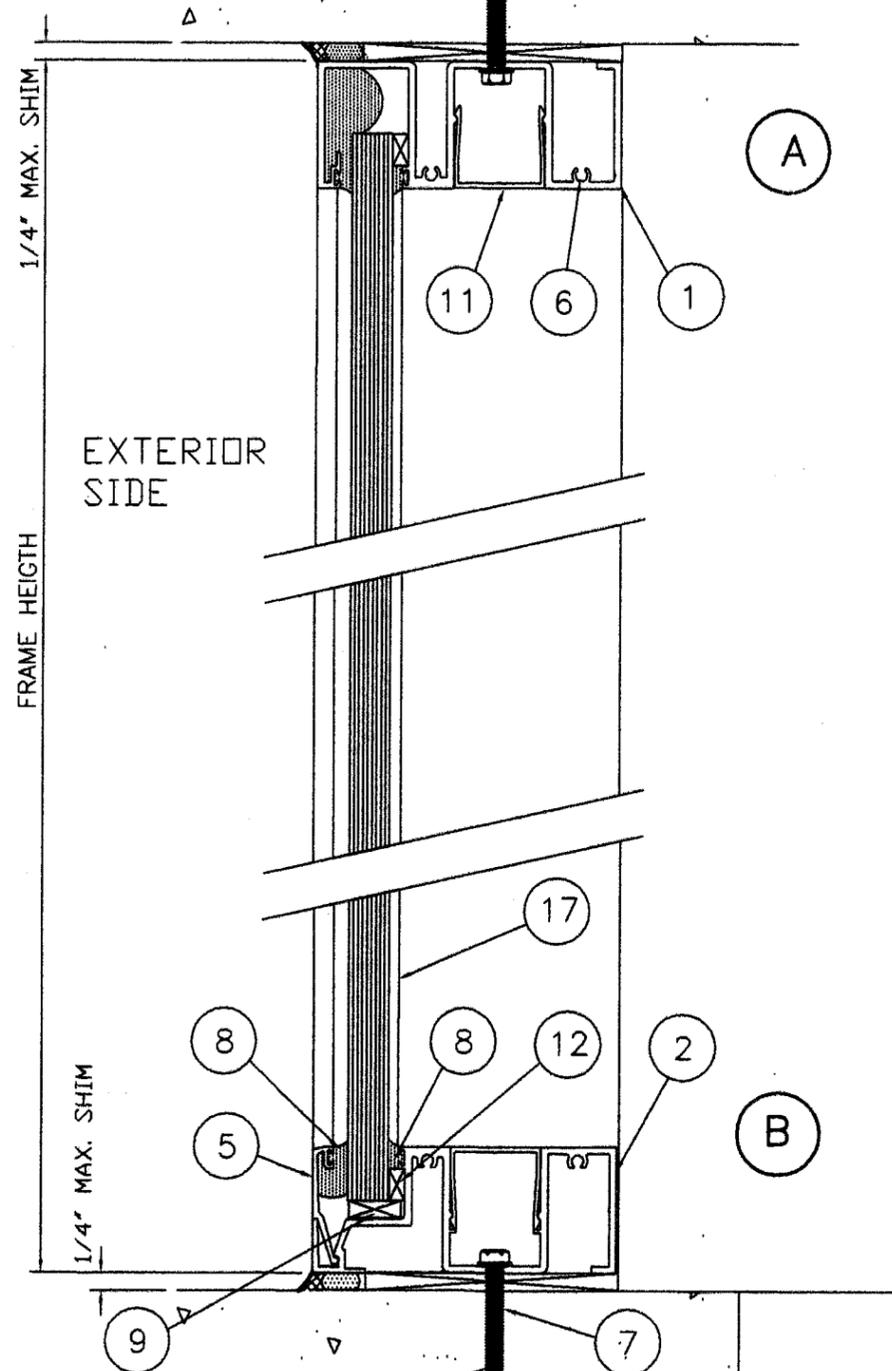

1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 6" FROM ENDS AND 12" O.C. (TYP.)

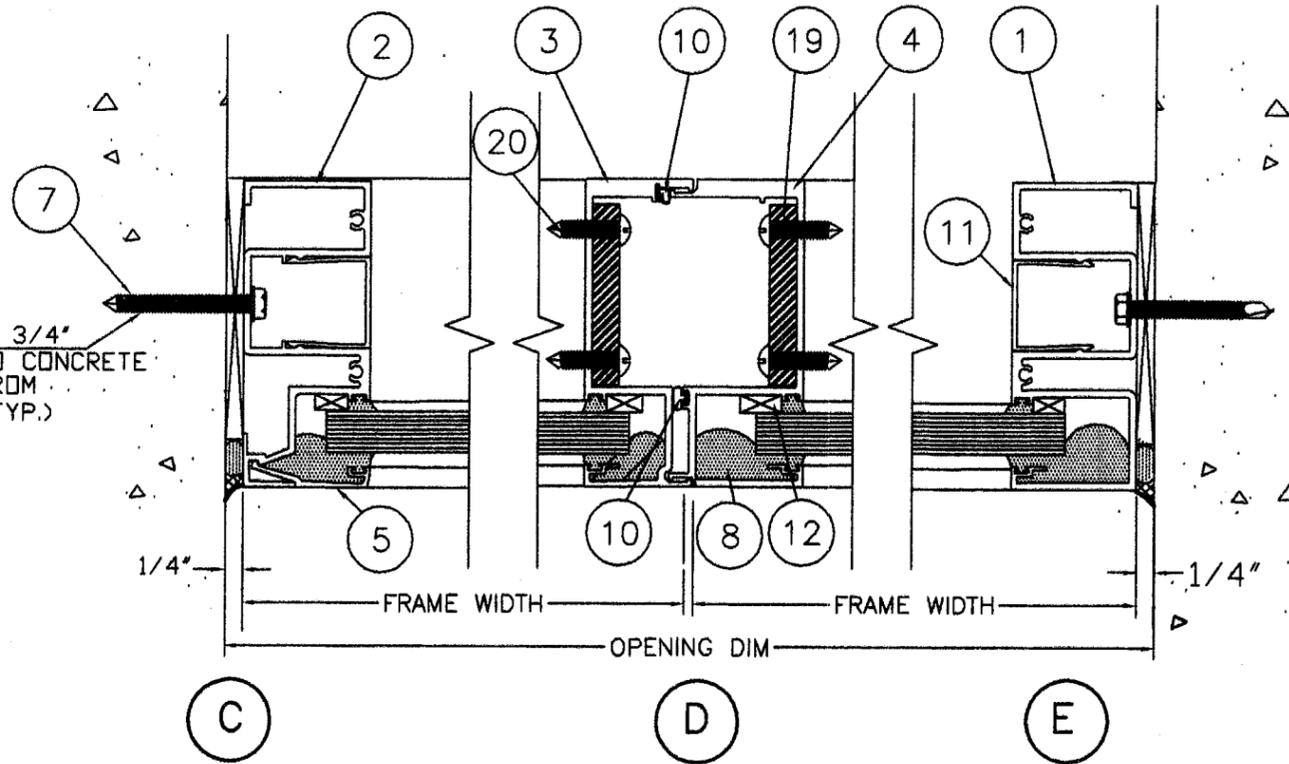

1/4" TAPCON WITH 1 3/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5" FROM EA. END AND A CLUSTER OF (8) @ VERT. MULL. AND BALANCE 16" O.C. (TYP.) SEE ELEVATION ON SHEET 1 FOR DETAILS

GLASS: 1/4 TEMP - .060 PVB - 1/4" TEMP

TEST#	DESIGNATION	D.P. (PSF)	W.T.P.
FTL# 1779	HEAVY REINFORCEMENT	+110.0 -110.0	20.0 PSF

PRODUCT RENEWED as complying with the Florida Building Code
 Acceptance No 07-1105.10
 Expiration Date 12/02/2008
 By Manuel Perez
 Miami/Dade Product Control Division

PRODUCT RENEWED as complying with the Florida Building Code
 Acceptance No 06-1121.19
 Expiration Date DEC 2, 2007
 By Manuel Perez
 Miami/Dade Product Control Division

XCEL ENGINEERING CORP.
 7785 NW 56 Street.
 Miami, FL 33166
 (305) 772 5023
 CAN (EB) 9324

DEC 19 2006

Sifang Zhao Fla PE# 50685

Miami Wall Systems, Inc.
 701 West 25th Street
 Hialeah, Florida 33010
 Phone: (305) 888-2300 Fax: (305) 888-3058

WINDOW WALL SERIES 101

WALL ELEVATION REINFORCEMENT SUMMARY GENERAL NOTES

no	date	description
1	11/13/06	UPDATE TO 2004 BUILDING CODE


date: 11/13/06	scale: HALF	design by: L.G.	drawn by: L.G.	checked by: C.L.
----------------	-------------	-----------------	----------------	------------------

drawing no. MWS-101


sheet 4 of 6

MATERIALS LIST


ITEM NO.	DESCRIPTION	REQ'D	PART NO.	COMMENTS
1	HEAD /SILL /JAMB	1	101-206	
2	HEAD /SILL /JAMB	1	100-201	
3	FEMALE VERT. MULL.	1	101-205	
4	MALE VERT. MULL.	1	101-204	
5	GLAZING BEAD	FULL DIM.	101-202	
6	FRAME ASSEMBLY SCREW	8		10 X 1 SMS
7	INSTALLION FASTENER	AS REQ'D		1/4" TAPCON
8	GLAZING SILICONE	AS REQ'D		GE 4000
9	SETTING BLOCK	2 PER LITE		1/4" X 3/4" X 4" LG
10	BULB VYNIL	SNG'L ROW	G-119-A	VERT. MULL.
11	FASTENER COVER	FULL DIM.	101-007	
12	GLASS SPACER	AS REQ'D		3/16" X 1/2" 2"
13	HEAD RECEPTOR FASTENER	1		
14	FRAME HEAD RECEPTOR	AS REQ'D	101-010	14 X 1 SMS
15	VYNIL BULB	DB'L ROW	G-117	HEAD RECEPTOR
16				
17	GLASS			9/16 LAMI. (SEE PAGE1)
18	STEEL TUBE (LIGHT REINFORC.)	1 PER MULL.		1 1/2" X 2 1/2" X 3/16" X HEIGHT
19	STEEL BAR (HEAVY REINFORC.)	2 PER MULL.		1/2" X 2 1/2" X HEIGHT
20	FASTENER	4 PER BAR		14 X 1 SMS

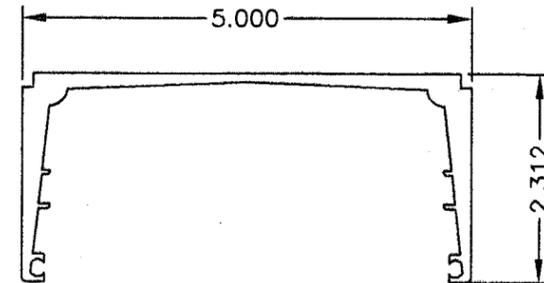


13 HEAD RECEPTOR DIE# 101-010
MATERIAL: ALUMINUM
ALLOY: 6005-T5
TIPICAL WALL: .100"-.188"




5 GLAZING BEAD DIE #101-202
MATERIAL: ALUMINUM
ALLOY: 6063-T6
TIPICAL WALL: .062




11 FRAME JAMB COVER DIE# 101-007
MATERIAL: ALUMINUM
ALLOY: 6063-T6
TIPICAL WALL: .050"

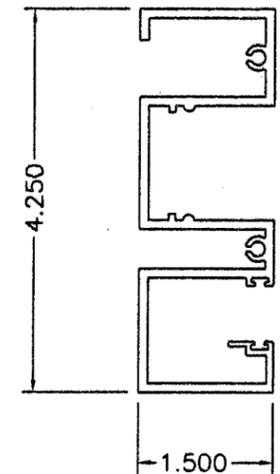


1 FRAME JAMB DIE# 101-206
MATERIAL: ALUMINUM
ALLOY: 6063-T5
TIPICAL WALL: .100"

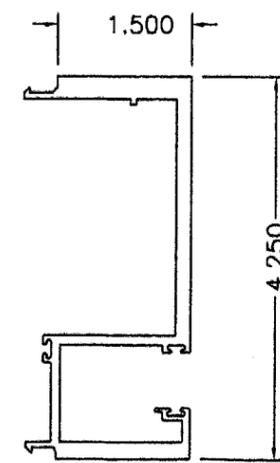

4 MALE VERT. MULLION DIE# 101-204
MATERIAL: ALUMINUM
ALLOY: 6063-T5
TIPICAL WALL: .100"

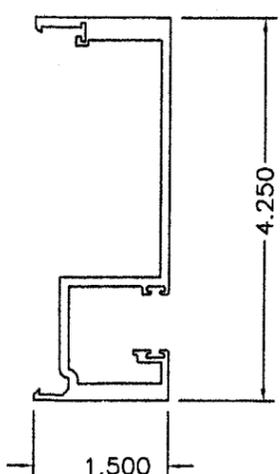

3 FEMALE VERT. MULLION DIE# 101-205
MATERIAL: ALUMINUM
ALLOY: 6063-T5
TIPICAL WALL: .100"

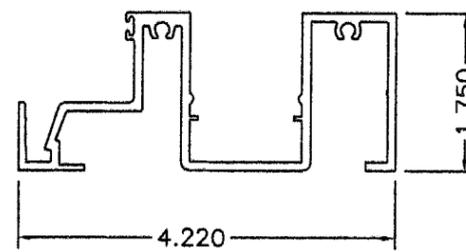

2 FRAME SILL DIE# 101-201
MATERIAL: ALUMINUM
ALLOY: 6063-T5
TIPICAL WALL: .094"
PRODUCT RENEWED as complying with the Florida Building Code
Acceptance No 07-1105.10
Expiration Date 12/02/2008
By *Manuel Pera*
Miami Dade Product Control Division

PRODUCT RENEWED as complying with the Florida Building Code
Acceptance No 06-1121-19
Expiration Date DEC 2, 2007
By *Manuel Pera*
Miami Dade Product Control Division

XCEL ENGINEERING CORP.
7785 NW 56 Street.
Miami, FL 33166
(305) 772 5023
CAN (EB) 9324

DEC 19 2006
Sifang Zhao Fla PE# 50685

Miami Wall Systems, Inc.
701 West 25th street
Hialeah, Florida. 33010
Phone: (305) 888-2300 Fax: (305) 888-3058

WINDOW WALL SERIES 101
BILL OF MATERIAL
EXTRUSION SUMMARY

NO	DATE	DESCRIPTION
1	11/13/08	UPDATING TO 2004 BUILDING CODE

date: 11/13/08	scale: N/A	design: by: L.C.	drawn: by: L.C.	checked: by: G.L.
----------------	------------	------------------	-----------------	-------------------

drawing no.
MWS-101
sheet 5 of 6

ASSY. SCREW
ITEM #6

FRAME TOP CORNER

#14x1" PH SMS
ITEM #20
(HEAVY REINFORCEMENT ONLY)

REINFORM'T BAR
ITEM #19
(HEAVY REINFORCEMENT ONLY)

ASSY. SCREW
ITEM #6

#14x1" PH SMS
ITEM #20

FRAME BOTTOM CORNER

FRAME TOP CORNER

SHOP APPLIED SEALANT
THE INSIDE PERIMETER OF
JAMB DURING ASSEMBLY

ASSY. SCREW
ITEM #6

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No **07-1105.10**
Expiration Date **12/02/2008**
By *Manuel Perez*
Miami Dade Product Control
Division

ASSY. SCREW
ITEM #6

SHOP APPLIED SEALANT
THE INSIDE PERIMETER OF
JAMB DURING ASSEMBLY

FRAME BOTTOM CORNER

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No **06-1121.19**
Expiration Date **Dec 2, 2007**
By *Manuel Perez*
Miami Dade Product Control
Division

XCEL ENGINEERING CORP.
7785 NW 56 Street.
Miami, FL 33166
(305) 772 5023
CAN (EB) 9324

DEC 19 2006
Sifang Zhao Fla PE# 50685

Miami Wall Systems, Inc.
701 West 25th street
Hialeah, Florida. 33010
Phone: (305) 888-2300 Fax: (305) 888-3058



WINDOW WALL SERIES 101

CORNER DETAIL

no	date	description
1	11/13/06	UPDATE TO 2004 BUILDING CODE

date: 11/13/06	scale: HALF	design by: L.G.	drawn by: L.G.	checked by: C.L.
----------------	-------------	-----------------	----------------	------------------

drawing no.
MWS-101

sheet 6 of 6