



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**NOTICE OF ACCEPTANCE (NOA)**

[www.buldingcodeonline.com](http://www.buldingcodeonline.com)

**YKK AP America, Inc.**  
332 Firetower Road  
Dublin, GA 31021

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "YOW 225H Non-Thermal" Outswing Aluminum Casement Window – S.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **W06-59**, titled "YOW 225H Non Thermal Alum. Casement Wdw. (S.M.I.)", sheets 1 through 7 of 7, dated 09/23/06 with revision "A" dated 09/17/07, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises NOA # 06-1016.06 and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 07-1114.06  
Expiration Date: December 14, 2011  
Approval Date: February 04, 2009  
Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **W06-59**, Sheets 1 through 7 of 7, titled "YOW 225H Non Thermal Alum. Casement Wdw. (S.M.I.)", dated 09/23/06 with revision "A" dated 09/17/07, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E.

**B. TESTS**

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of a non-thermal aluminum outswing casement window (specimen #1) and project-out window (specimen #2), prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-G231-0607-07**, specimens 1 & 2, dated 06/25-27/07, signed and sealed by Vinu J. Abraham, P. E.

2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Small Missile Impact Test per FBC, TAS 201-94  
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
7) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an aluminum outswing casement window, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0231-1019-05**, Elev. A & B dated 10/28/05, Elev. C dated 11/03/05-11/09/05 and Elev. D dated 11/04/05-01/18/06, signed and sealed by Vinu J. Abraham, P. E. *(Submitted under previous NOA #06-1016.06)*

3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an aluminum project-out window, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0231-1019-05**, Elev. E dated 10/28/05-11/04/05 and Elev. O dated 11/08/05-01/18/06, signed and sealed by Vinu J. Abraham, P. E. *(Submitted under previous NOA #06-1016.06)*

  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 07-1114.06

Expiration Date: December 14, 2011  
Approval Date: February 04, 2009

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

4. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Small Missile Impact Test per FBC, TAS 201-94  
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of aluminum fixed window, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0231-1019-05**, Elev. F dated 10/28/05-01/23/06, Elev. G dated 10/28/05-01/24/06, Elev. H dated 11/07/05, Elev. I dated 01/23/06-01/26/06, Elev. J dated 10/28/05-01/25/06, Elev. J1 dated 11/07/05-01/24/06, Elev. K dated 11/01/05, Elev. L & M dated 10/31/05-01/20/06, and Elev. N dated 11/07/05-01/18/06, signed and sealed by Vinu J. Abraham, P. E

*(Submitted under previous NOA #06-1016.06)*

5. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
2) Large Missile Impact Test per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of an aluminum fixed window, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0231-0316-06**, Elev. H dated 03/27/06-03/28/06, signed & sealed by Vinu J. Abraham, P. E.  
*(Submitted under previous NOA #06-1016.06)*

**C. CALCULATIONS**


1. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by Al-Farooq Corporation, dated 09/13/06 and revised on 10/4/07, signed and sealed by Humayoun Farooq, P.E.  
**Complies with ASTM E1300-02**

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **08-0520.08** issued to Solutia Inc. for their "**Vanceva Composites Glass Interlayer**" dated 7/17/2008, expiring on 12/11/2013.  
2. Notice of Acceptance No. **05-1208.02** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Butacite PVB, Interlayer**" dated 01/05/06, expiring on 12/11/10.  
3. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "**Saflex III G Clear or colored interlayer**" dated May 04, 2006, expiring on May 21, 2011.

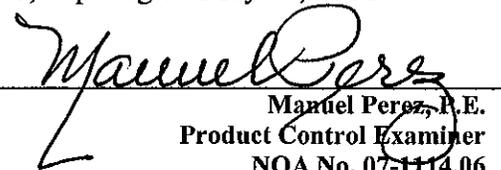  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 07-1114.06

Expiration Date: December 14, 2011  
Approval Date: February 04, 2009


**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**


**F. STATEMENTS**

1. Statement letter of conformance, dated October 8, 2007, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated September 20, 2007, signed and sealed by Humayoun Farooq, P.E.
3. Laboratory compliance letter for Test Reports No. **HTL-G231-0607-07**, issued by Hurricane Test Laboratory, LLC, dated October 23, 2008, signed by Jose E. Colon, E.I., Operations Manager.
4. Laboratory compliance letter for Test Reports No. **HTL-0231-1019-05** and **HTL-0231-0316-06**, issued by Hurricane Test Laboratory, LLC, dated April 18, 2006, signed and sealed by Vinu J. Abraham, P.E.


**G. OTHER**

1. Notice of Acceptance No. **06-1016.06**, issued to YKK AP America, Inc. for their Series YOW 225H Non-Thermal Aluminum Casement Window – S.M.I., approved on 12/14/06 and expiring on 12/14/11.

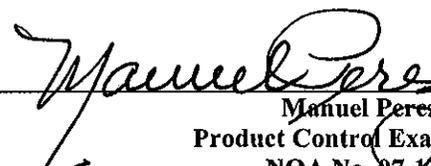
  
\_\_\_\_\_  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 07-1114.06  
Expiration Date: December 14, 2011  
Approval Date: February 04, 2009

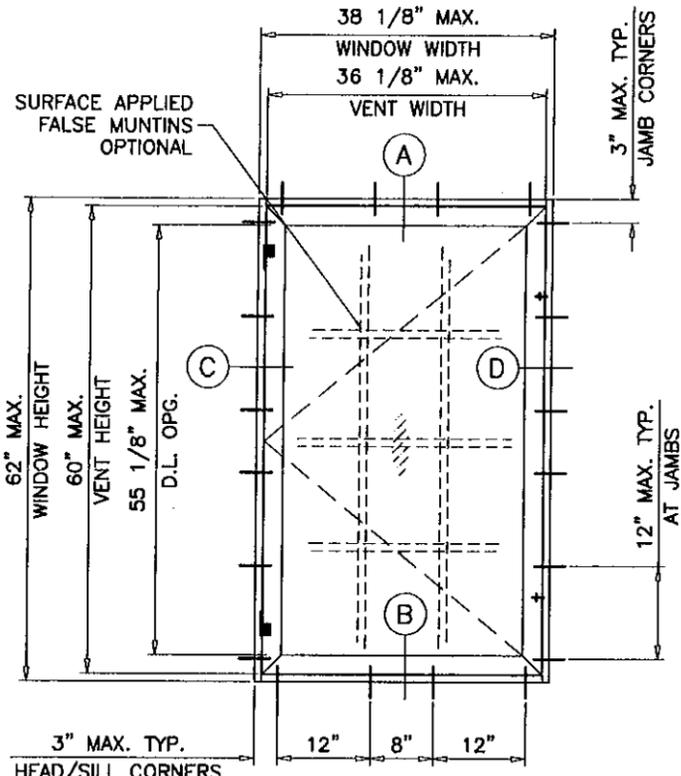

**SINGLE VENT WDW.**

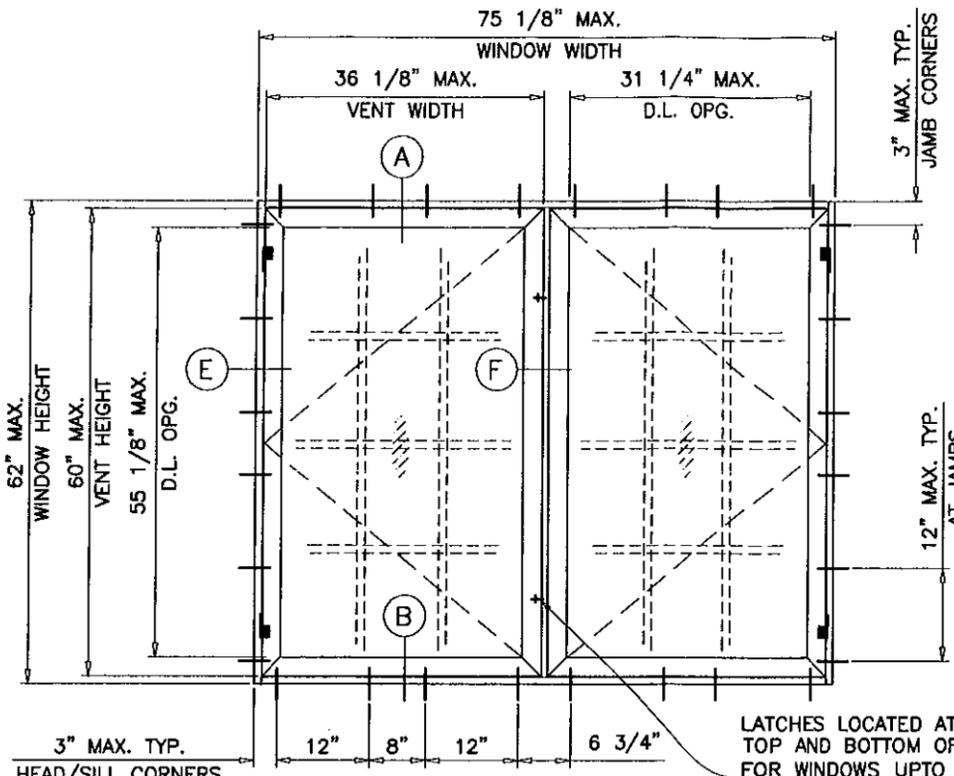

**DUAL VENT WDW.**

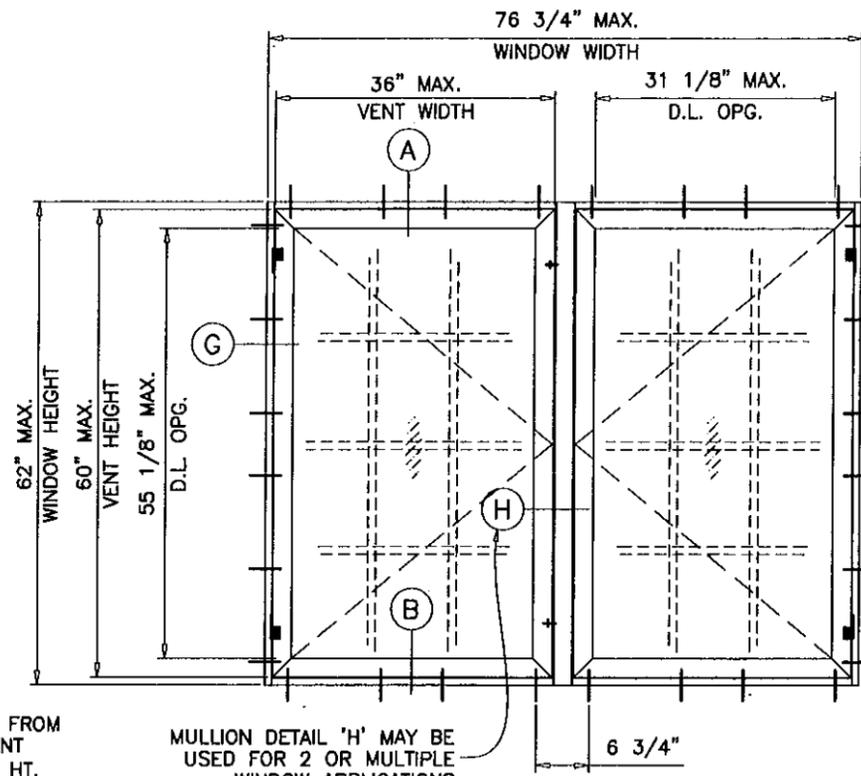

**SIDE BY SIDE WDWS.**


LATCHES LOCATED AT 8" FROM TOP AND BOTTOM OF VENT FOR WINDOWS UP TO 31" HT. USE ONE LATCH AT MIDSPAN OF VENT SIDE

MULLION DETAIL 'H' MAY BE USED FOR 2 OR MULTIPLE WINDOW APPLICATIONS


**YOW 225H**

**NON THERMAL ALUMINUM CASEMENT WINDOWS**


APPROVAL APPLIES TO SINGLE VENT WINDOWS OR DUAL VENT WINDOWS USING INTEGRAL IMPOST.



ALSO TOP AND BOTTOM COMBINATIONS OF FIXED AND CASEMENT WINDOWS USING INTEGRAL IMPOST.



ALSO TO SIDE BY SIDE COMBINATIONS OF CASEMENT/FIXED, CASEMENT/CASEMENT OR WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN.

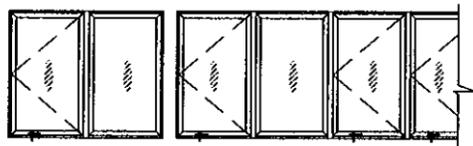

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.


ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2004 FLORIDA BLDG. CODE SECTION 2003.8.4.

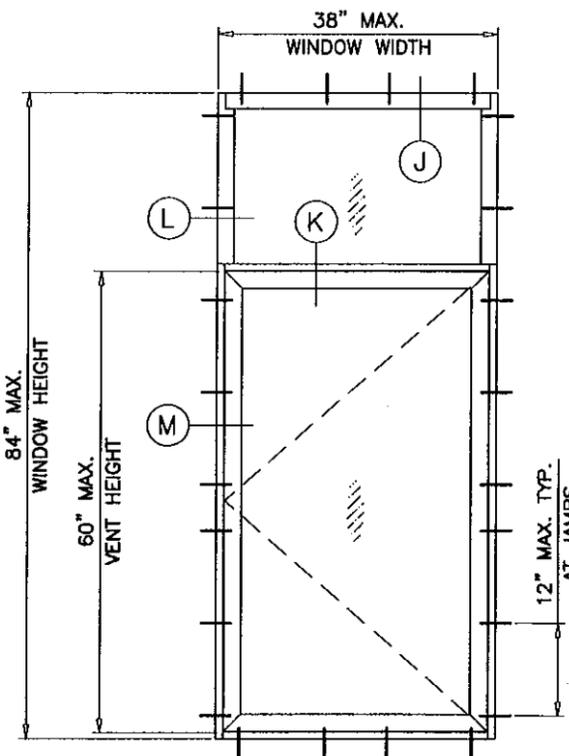

**FIXED/CASEMENT WDWS.**

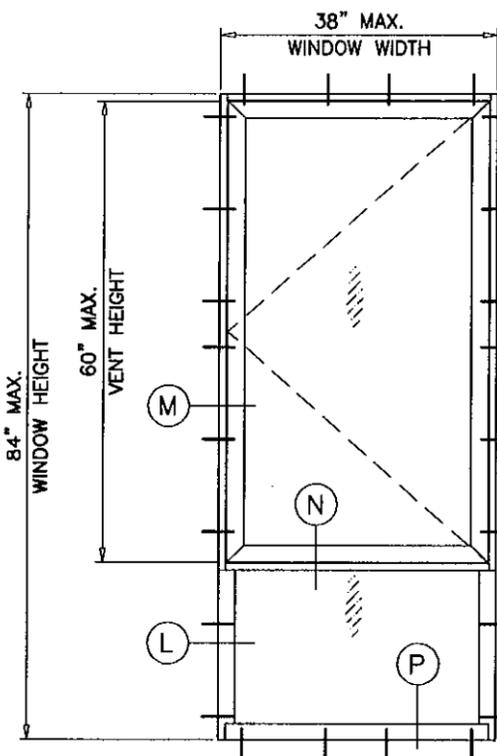

**CASEMENT/FIXED WDWS.**

THESE WINDOWS ARE RATED FOR SMALL MISSILE IMPACT. MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS ARE REQUIRED FOR INSTALLATIONS UP TO 30 FT. OF GRADE. SHUTTERS NOT REQD. FOR INSTALLATIONS ABOVE 30 FT. OF GRADE.

MAXIMUM DESIGN LOAD RATING = + 65.0 PSF  
(FOR SIZES SHOWN OR SMALLER) - 65.0 PSF

**LAMINATED GLASS  
SMALL MISSILE IMPACT**

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

OCT 23 2007

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 07-1114.06  
Expiration Date Dec. 14, 2011  
By: *Mauro P...*  
Miami Dade Product Control  
Division

**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W06-59YK






YOW 225H NON THERMAL ALUM CASEMENT WDW. (S.M.I.)  
**YK AP AMERICA INC.**  
332 FIRETOWER ROAD  
DUBLIN, GEORGIA 31021  
TEL. (478) 277-1955 FAX (478) 277-1978

no	date	description
A	09.17.07	GENERAL REVISION

date: 09-23-06  
scale: 1/2" = 1'-0"  
dr. by: HAMID  
chk. by:

drawing no. **W06-59**  
sheet 1 of 7



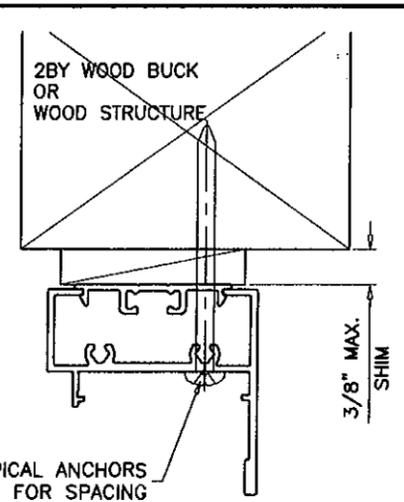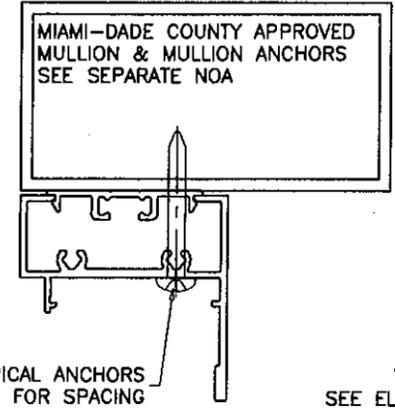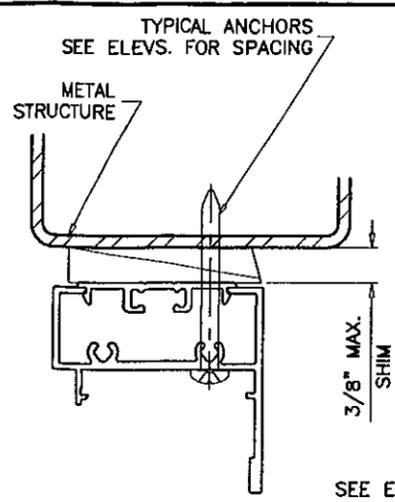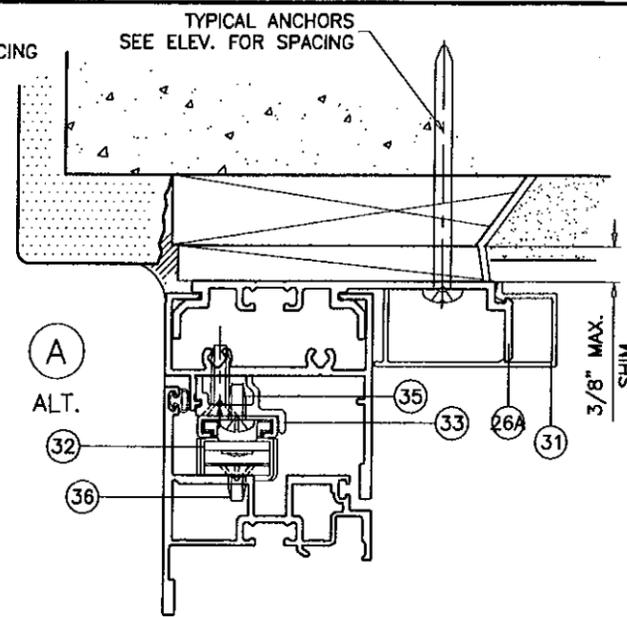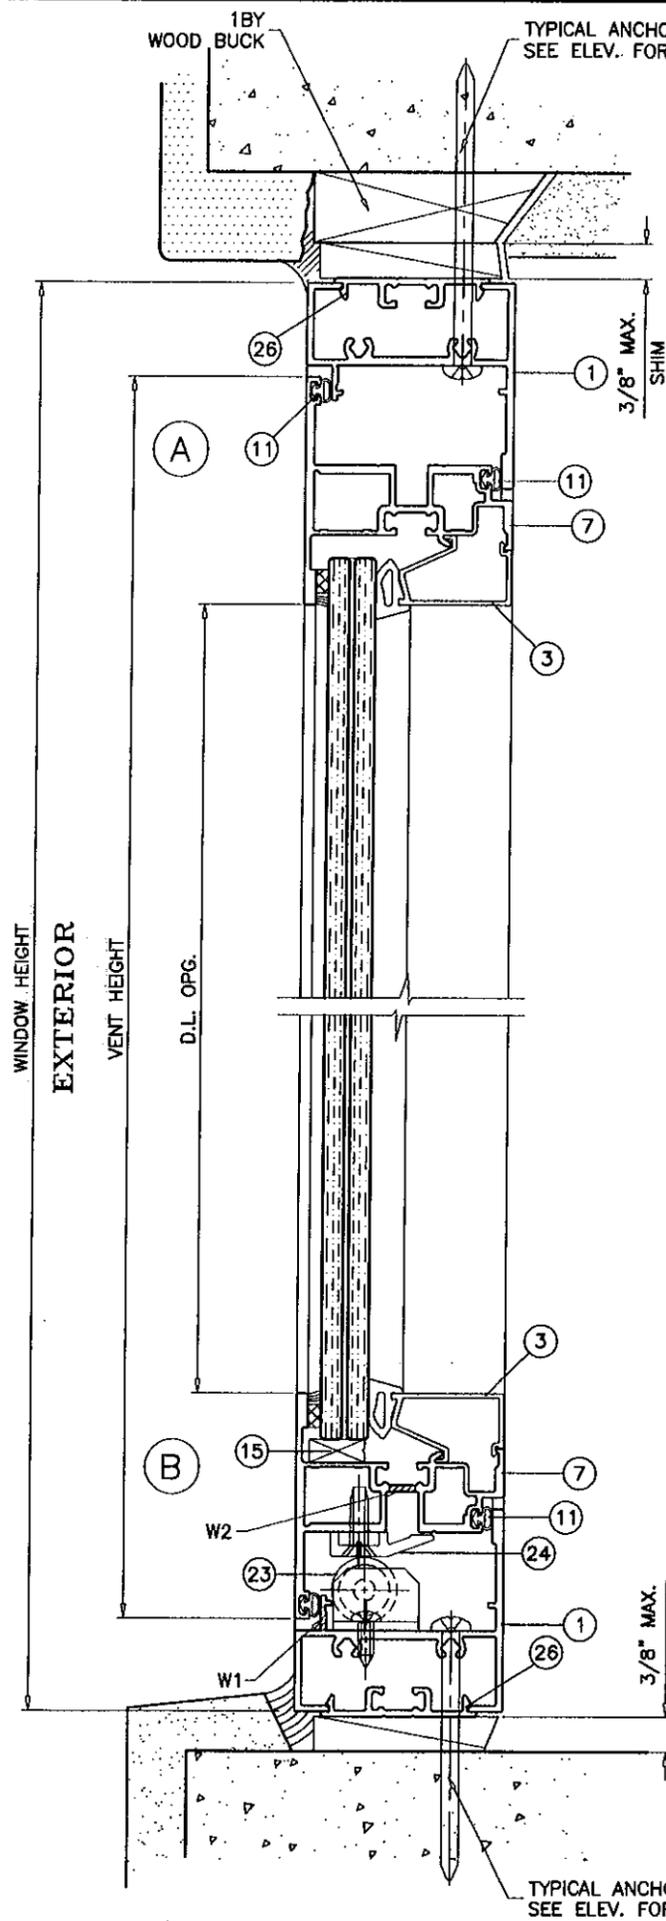

STRAP ANCHOR CLIP CAN BE USED AT ALL ANCHORAGE CONDITIONS.

WOOD BUCKS AND METAL STRUCTURE NOT BY YKK AMERICA INC. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

**TYPICAL ANCHORS:** SEE ELEV. FOR SPACING

**1/4" TAPCONS**

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES  
1-1/2" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONC. OR MASONRY  
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

DIRECTLY INTO CONC. OR MASONRY  
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

**1/4" DIA. TEKS/DRIL-FLEX SELF DRILLING SCREWS**


INTO METAL STRUCTURES  
STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)  
ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)  
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

**#12 SMS OR SELF DRILLING SCREWS**

INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")  
(NO SHIM SPACE)

**TYPICAL EDGE DISTANCE**

INTO CONCRETE AND MASONRY = 2" MIN.  
INTO WOOD STRUCTURE = 1" MIN.  
INTO METAL STRUCTURE = 1/2" MIN.

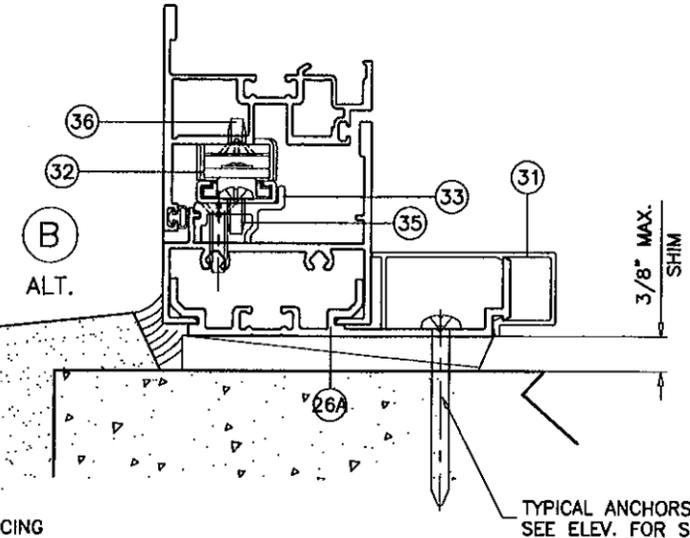

Engr. DR. HUMAYOON FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538  
OCT 23 2007

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 07-1114.06  
Expiration Date DEC 14 2011  
By *Manuel Perez*  
Miami-Dade Product Control  
Division



**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL W06-59YKK

YOW 225H NON THERMAL ALUM CASEMENT WDW. (S.M.I.)  
**YKK AP AMERICA INC.**  
332 FIRETOWER ROAD  
DUBLIN, GEORGIA 31021  
TEL. (478) 277-1955 FAX (478) 277-1978


no.	date	by	description
A	09.17.07		GENERAL REVISION

date: 09-23-06  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:


drawing no.  
**W06-59**  
sheet 3 of 7

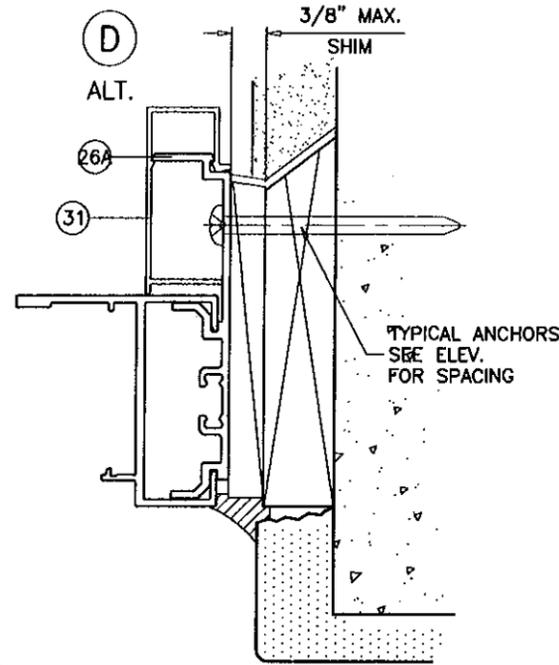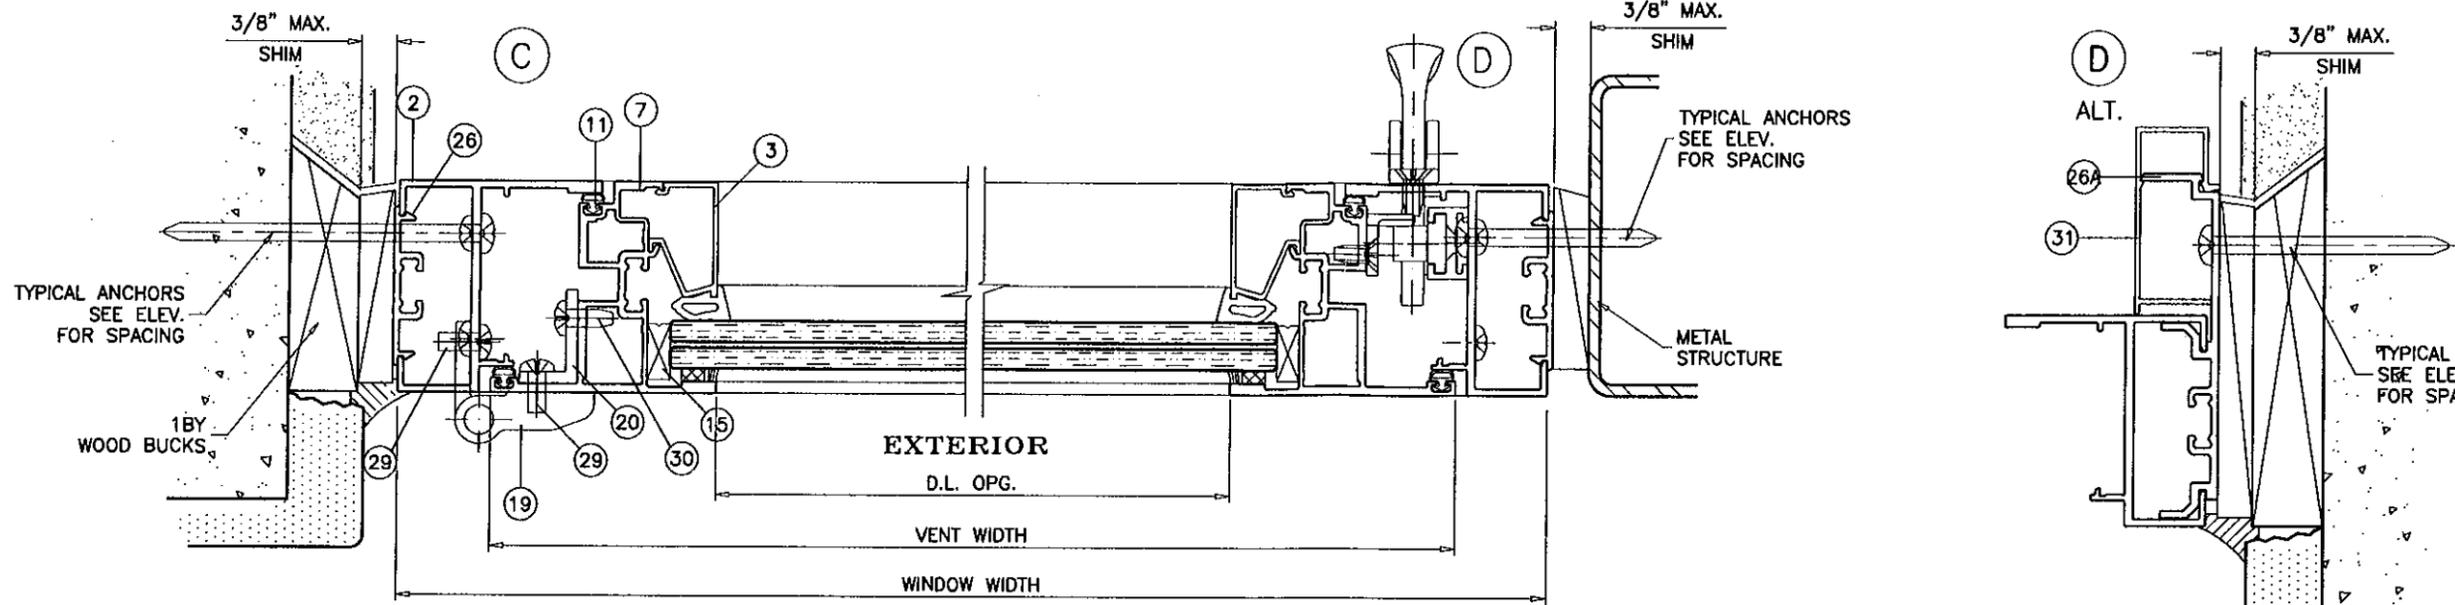

SINGLE VENT WINDOWS

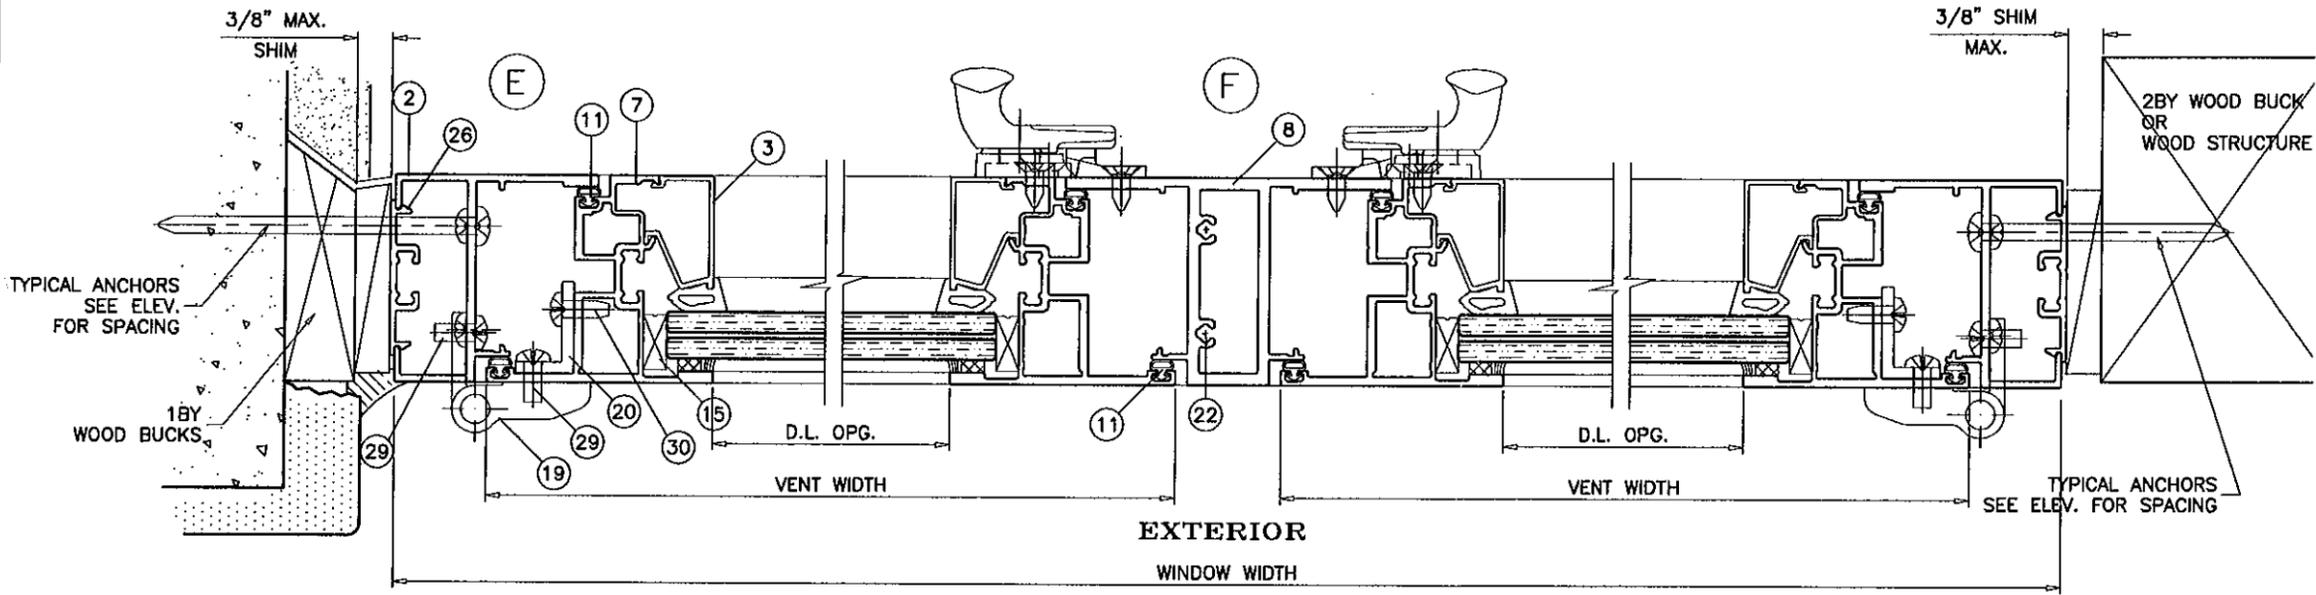

DUAL VENT WINDOWS

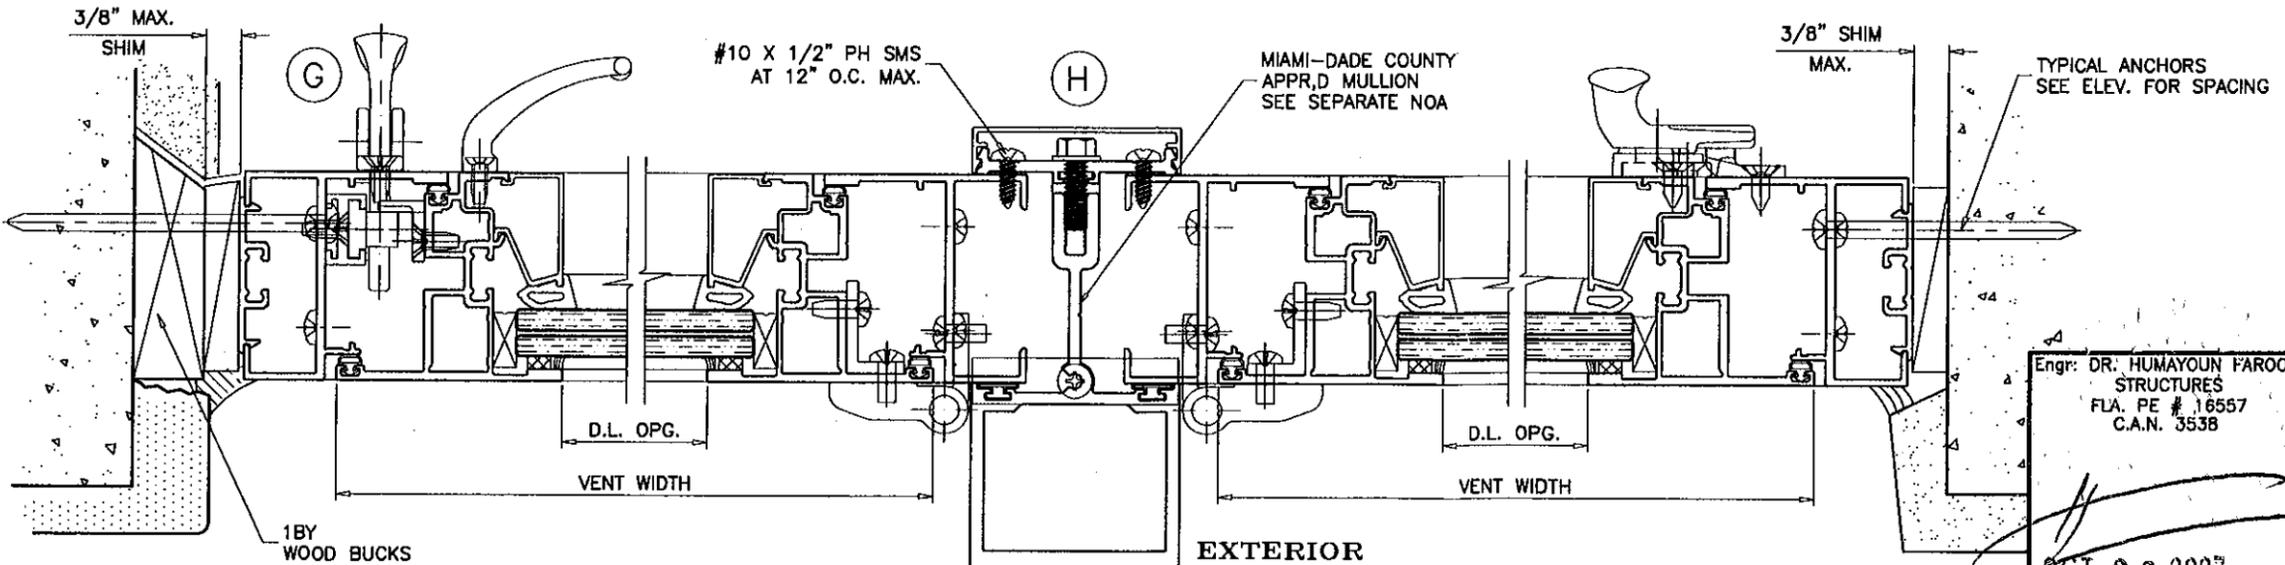

SIDE BY SIDE WINDOWS

**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL (305) 264-8100 FAX (305) 262-6978  
 COMP-ANL W06-59YKK

YOW 225H NON THERMAL ALUM CASEMENT WDW. (S.M.I.)  
**YKK AP AMERICA INC.**  
 332 FIRETOWER ROAD  
 DUBLIN, GEORGIA 31021  
 TEL (478) 277-1955 FAX (478) 277-1978

no	date	description
A	09.17.07	GENERAL REVISION

Engr: DR. HUMAYOON FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 C.A.N. 3538




PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 07-1114.06  
 Expiration Date, DEC. 14, 2011  
 By *Mauro Jerez*  
 Miami-Dade Product Control  
 Division

OCT 23 2007

date: 09-23-06  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W06-59**

sheet 4 of 7

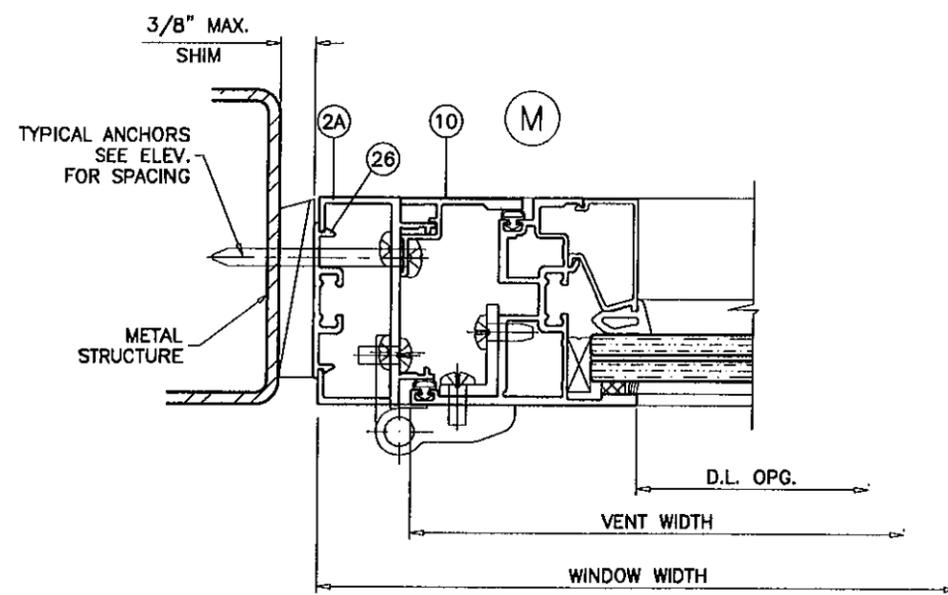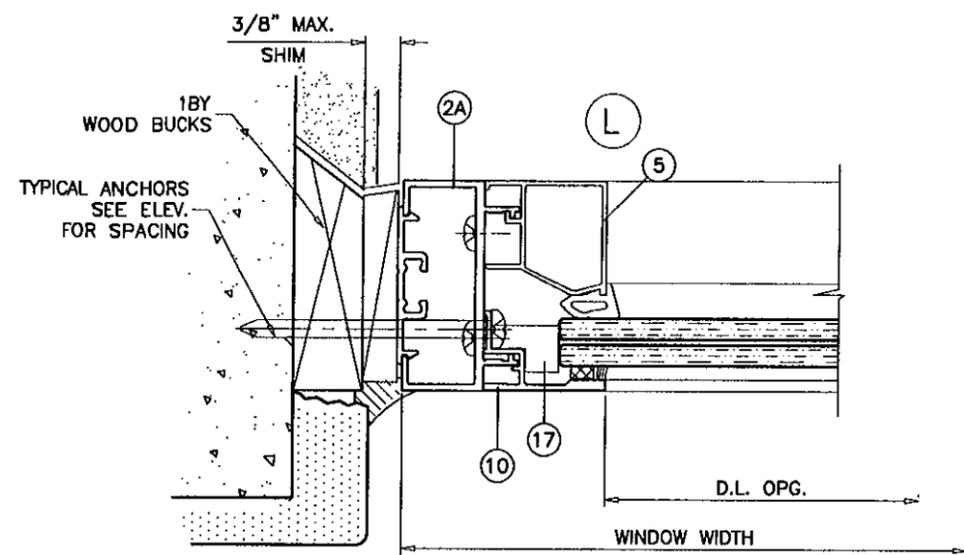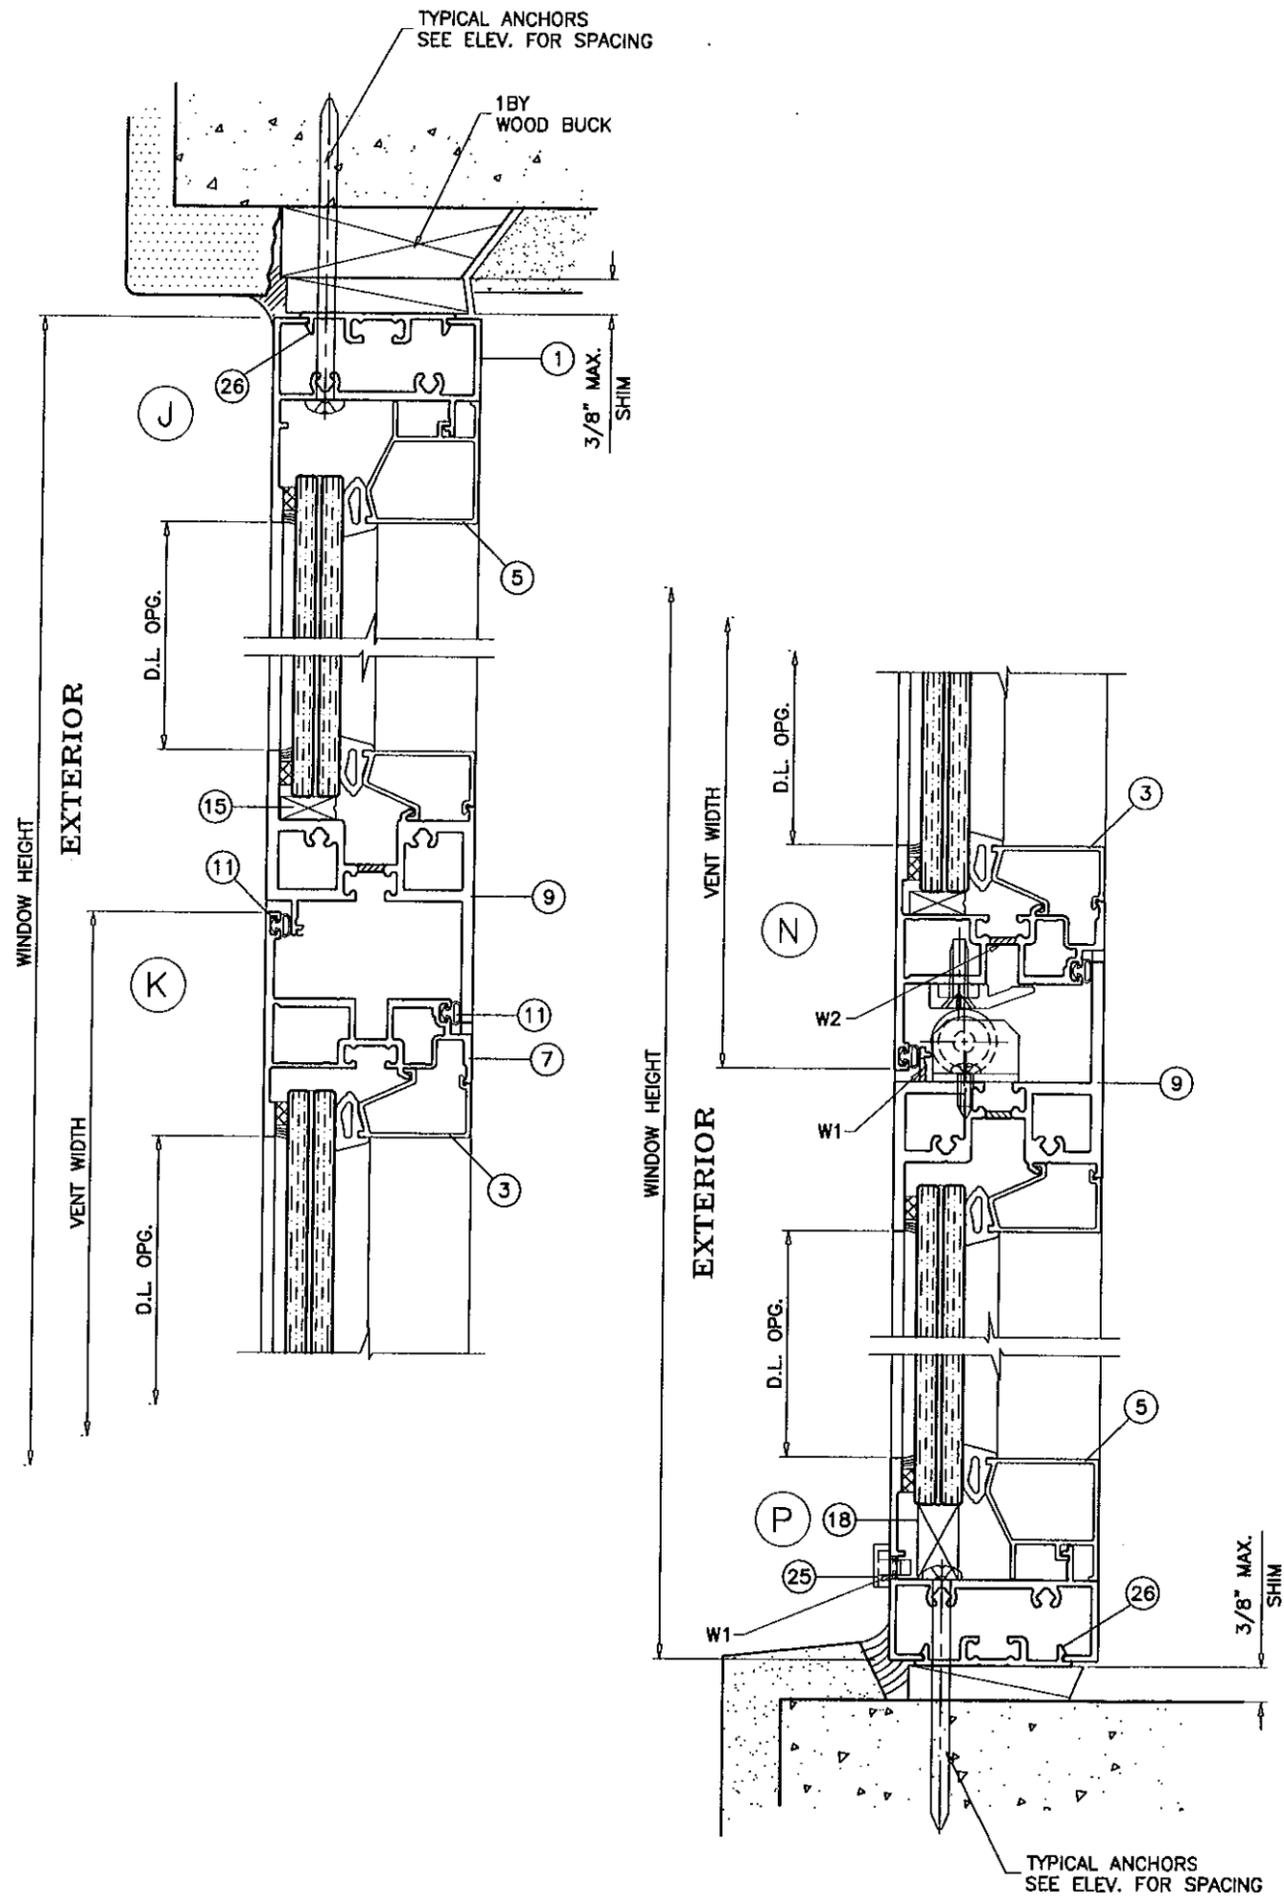

Engr: DR. HUMAYOON FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 C.A.N. 3538

OCT 23 2007

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 07-1114.06  
 Inspection Date, Dec. 14, 2011

By: *Manuel Ferriz*  
 District Trade Product Control  
 Division

**af c**

**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL W06-59YKK

YOW 225H NON THERMAL ALUM CASEMENT WDW. (S.M.I.)


**YKK AP AMERICA INC.**  
 332 FIRETOWER ROAD  
 DUBLIN, GEORGIA 31021  
 TEL.(478) 277-1955 FAX(478) 277-1978

no	date	by	description
A	09.17.07		GENERAL REVISION


date: 09-23-06  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W06-59**


sheet 5 of 7

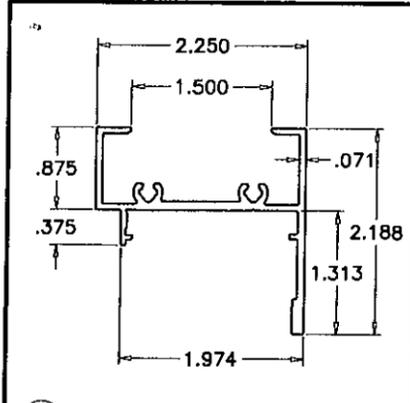


① FRAME HEAD/SILL

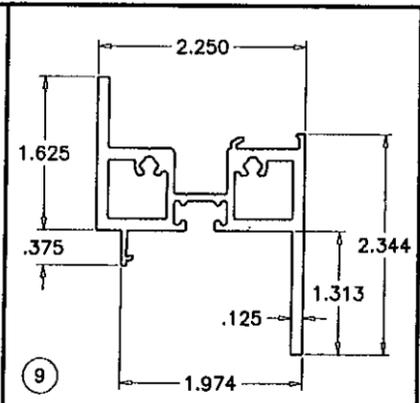


⑨ HORIZ. IMPOST (X/O OR O/X)

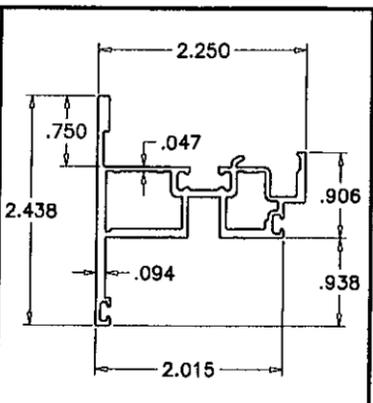


⑦ VENT STILE

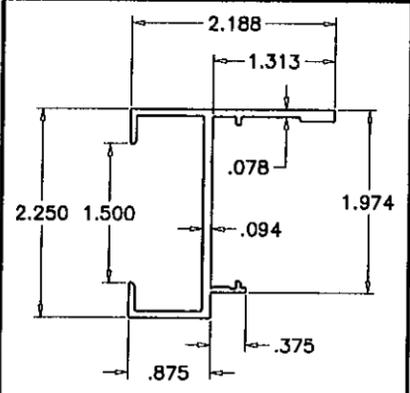


② FRAME JAMB (VENT)

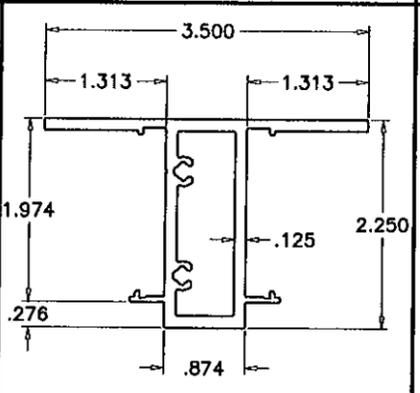


⑧ VERTICAL IMPOST

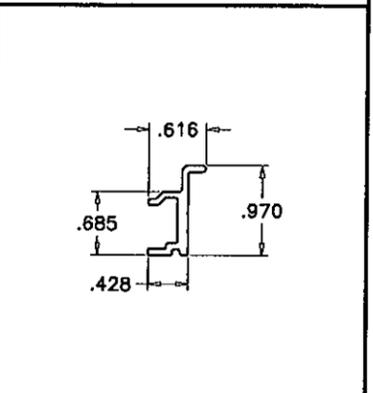


③③ HINGE BASE

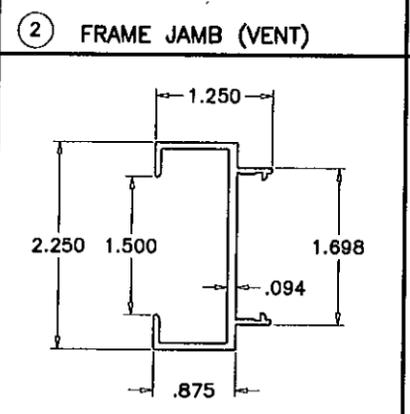


②A FRAME JAMB (FIX. LITE)

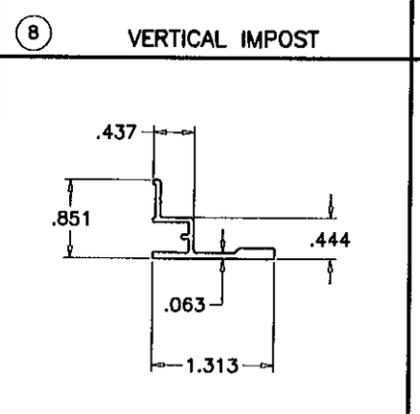


⑩ EXTERIOR GLAZING LEG

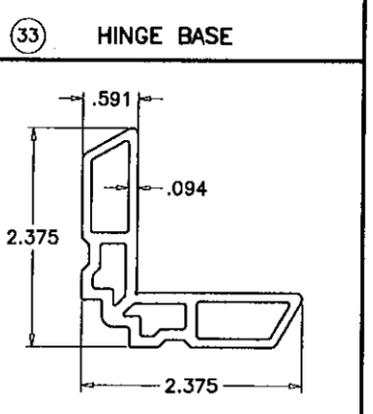


⑪ ⑪A CORNER BLOCK

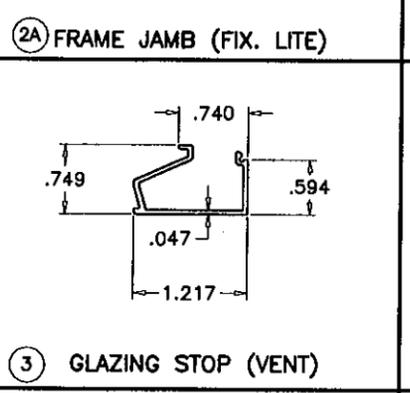


③ GLAZING STOP (VENT)

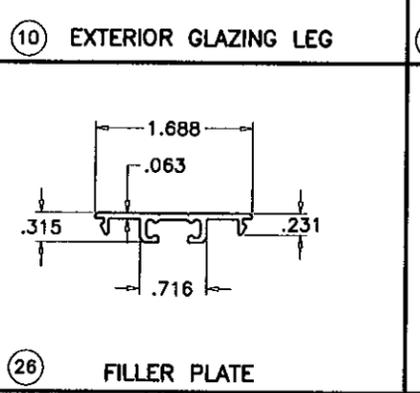


⑫ FILLER PLATE

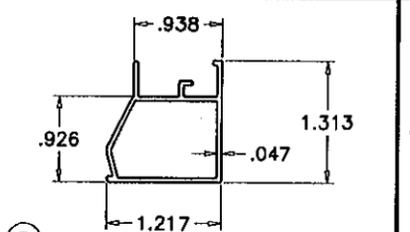

⑤ GLAZING STOP (FIX. HEAD/SILL)

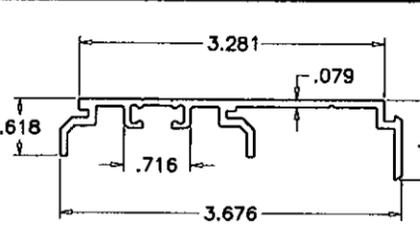

⑫A STRAP ANCHOR CLIP

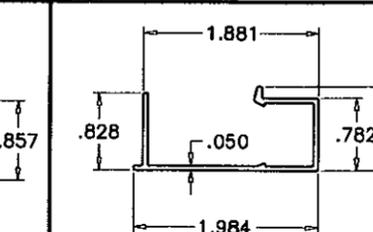

⑬ STRAP ANCHOR COVER

Engr: DR. HUMAYOON FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

OCT 23 2007

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 07-1114.06  
Expiration Date DEC. 14, 2011

By: *Mauro*  
Miami Trade Product Control  
Division

**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W06-59YKX


YOW 225H NON THERMAL ALUM CASEMENT WDW. (S.M.I.)  
**YK AP AMERICA INC.**  
332 FIRETOWER ROAD  
DUBLIN, GEORGIA 31021  
TEL (478) 277-1955 FAX (478) 277-1978

no	date	by	description
A	09.17.07		GENERAL REVISION


date: 09-23-06  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W06-59**

sheet 6 of 7

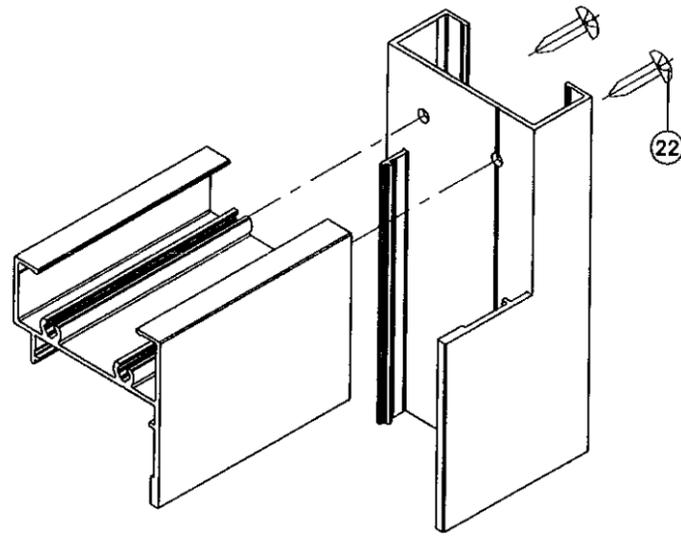

FRAME CORNER

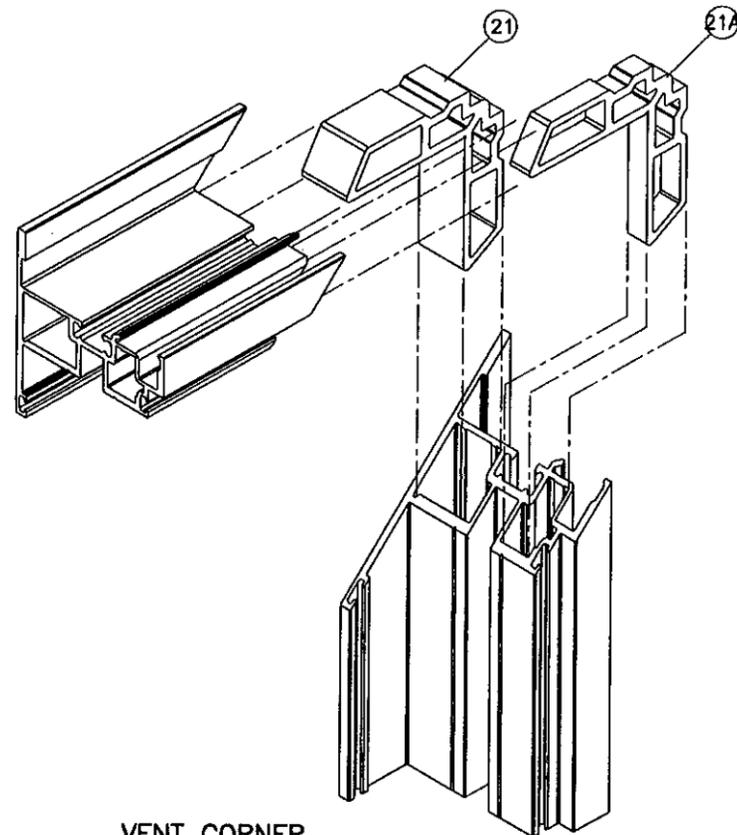

VENT CORNER

ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPLIER/REMARKS
1	E9-4536	2/ WDW	FRAME HEAD/SILL	6063-T5	YKK AP AMERICA INC.
2	E9-4537	2/ WDW	FRAME JAMB (VENT)	6063-T5	YKK AP AMERICA INC.
2A	E9-4538	AS REQD.	FRAME JAMB (FIX. LITE)	6063-T5	YKK AP AMERICA INC.
3	E9-4548	4/ WDW	GLAZING STOP (VENT)	6063-T5	YKK AP AMERICA INC.
5	E9-4549	4/ WDW	GLAZING STOP (FIX. LITE)	6063-T5	YKK AP AMERICA INC.
7	E9-4534	4/ WDW	VENT STILE	6063-T5	YKK AP AMERICA INC.
8	E9-4539	AS REQD.	VERT. IMPOST (XX)	6063-T5	YKK AP AMERICA INC.
9	E9-4570	AS REQD.	HORIZ. IMPOST (X/O OR O/X)	6063-T5	YKK AP AMERICA INC.
10	E9-4513	AS REQD.	EXTERIOR GLAZING LEG	6063-T5	YKK AP AMERICA INC.
11	E2-0625	AS REQD.	BULB WEATHERSTRIPPING	PVC	YKK AP AMERICA INC.
12	E2-0051	AS REQD.	BULB W'STRIPPING AT MULLION	PVC	YKK AP AMERICA INC.
13	E2-0672	AS REQD.	WEDGE GASKET	EPDM	-
14	E2-0670	AS REQD.	BACKER TAPE FOR 1/8" F.C.	POLYURETHANE	-
15	E2-0737	AS REQD.	SETTING BLOCKS/SIDE BLOCKS (VENT)	EPDM	1/4" X 19/32" X 4" LONG
17	E2-0653	AS REQD.	SIDE BLOCKS (FIX. LITE)	EPDM	-
18	E2-0652	AS REQD.	SETTING BLOCKS (FIX. LITE)	EPDM	1/2" X 7/8" X 4" LONG
19	E1-1714/1715	2/ VENT	BUTT HINGES AT 7-1/2" FROM EACH END	6063-T5	-
20	E1-1723	1/ HINGE	HINGE ANGLE	6063-T5	-
21	E1-1786	1/ CORNER	CORNER BLOCK, .684" LONG	6063-T5	YKK AP AMERICA INC.
21A	E1-1787	1/ CORNER	CORNER BLOCK, .292" LONG	6063-T5	YKK AP AMERICA INC.
22	#10 X 1"	2/ CORNER	FRAME ASSEMBLY SCREWS	STEEL	PH SMS
23	K-10639	1/ VENT	GUIDE ROLLER ASSEMBLY	-	SECURED TO SILL W/ (2) #8 X 1/2" PH SMS
24	E1-1713	1/ VENT	GUIDE ROLLER BASE	-	SECURED TO VENT W/ (2) #10 3/4" FH SMS
25	E3-1127	1/ WDW	WEEP COVER	NYLON	AT WEEP SLOTS (AT FIXEO ONLY)
26	E9-4566	AS REQD.	FILLER PLATE, 3" LONG AT ANCHOR LOCATIONS	6063-T5	YKK AP AMERICA INC.
26A	E9-4529	AS REQD.	STRAP ANCHOR, 4-1/2" LONG @ ANCHOR LOCATIONS	6063-T5	YKK AP AMERICA INC.
29	#10 X 7/16"	3/ HASP	HINGE INSTALLATION SCREWS	-	PH MS
30	#10 X 1/2"	3/ ANGLE	HINGE ANGLE SCREWS	-	PH SMS
31	E9-8431	AS REQD.	STRAP ANCHOR COVER	6063-T5	YKK AP AMERICA INC.
32	4K-14208	2/ VENT	16", 4-BAR SCISSOR HINGE	-	YKK AP AMERICA INC.
33	E1-1781	2/ VENT	HINGE BASE	6063-T5	SECURED TO JAMB W/ (3) #10 X 3/4" FH SMS
35	#10 X 3/8"	3/ HINGE	HINGE INSTALLATION SCREWS	-	PH SMS
36	#10 X 3/8"	3/ HINGE	HINGE INSTALLATION SCREWS	-	FH SMS

Engr: DR. HUMAYOUN, FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 07-1114-06  
Expiration Date DEC 13, 2011  
By: *M. H. H. H.*  
Miami/Dade Product Control  
Division

OCT 23 2007

**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL (305) 264-8100 FAX (305) 262-6878  
COMP-ANL/W06-59YKK

YOW 225H NON THERMAL ALUM CASEMENT WDW. (S.M.I.)  
**YKK AP AMERICA INC.**  
332 FIRETOWER ROAD  
DUBLIN, GEORGIA 31021  
TEL(478) 277-1955 FAX(478) 277-1978

revisions:	no	date	by	description
	A	09.17.07		GENERAL REVISION

date: 09-23-06  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W06-59**  
sheet 7 of 7