



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339

www.miamidade.gov/buldingcode

NOTICE OF ACCEPTANCE (NOA)

BASF Wall Systems, Inc.
3550 St. Johns Bluff Rd, South
Jacksonville, FL 32224

Scope: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Senerflex Wall System-S.M.I.

APPROVAL DOCUMENT: Drawing No. none, titled "Typical Details for Senerflex Wall System over Dens Glass Gold Frame (Small Missile)", sheets 1 through 3, prepared by Senergy LLC, dated 09/28/98 with latest revision dated 04/26/07, signed and sealed by Walter A. Tillit Jr., P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA # 06-1101.04 and consists of this page 1, Evidence Page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



[Signature] 12/18/07

NOA No. 07-1203.08
Expiration Date: November 5, 2008
Approval Date: January 10, 2008
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. none, titled "Typical Details for Senerflex Wall System over Dens Glass gold Frame (Small Missile)", sheets 1 through 3, prepared by Senergy LLC, dated 09/28/98, with latest revision dated 04/26/0, signed and sealed by Walter A. Tillit Jr., P.E.
(Submitted under NOA # 07-1203.08)

B. TESTS

1. Test report on Cyclic Load Test per PA 203 and Static Air Pressure Test per PA 202 on "Senerflex Small Missile Assembly", prepared by Hurricane Test Laboratory, Inc, report # 0152-0222-98, dated 03/27/98, signed and sealed by T. S. Marshall, PE.
(Submitted under NOA # 99-1005.05)

C. CALCULATIONS


1. None

D. MATERIAL CERTIFICATIONS

1. Product Control Notice of Acceptance No. 95-0626.01 issued to Apache Products Co. on 01/11/96.
2. Product Control Notice of Acceptance No. 96-0131.02, issued to Allied Foam Products, Inc. on 06/19/97.
(Submitted under NOA # 99-1005.05)

E. STATEMENTS

1. Letter dated 05/01/07 of 2004 Florida Building Code compliance and no financial interest prepared by Tilteco Inc., signed by Walter A. Tillit, Jr. P.E.
2. Letter dated 03/23/07 by Hurricane Testing Laboratory, LLC stating that the laboratory has been contracted to perform required testing for the renewal of the product signed by Monica Reum.
(Submitted under NOA # 07-1203.08)

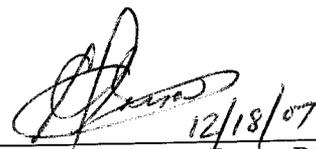

12/18/07

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No 07-1203.08

Expiration Date: November 5, 2008
Approval Date: January 10, 2008

SENERGY

DATE: 9/28/98

Page 1 of 3

Typical Details for Senerflex Wall System over Dens Glass Gold Frame (Small Missile)

REVISIONS DATES

1/10/00
4/26/07



TILLIT TESTING & ENGINEERING COMPANY
6355 NW 36th STREET, STE. 305
MIAMI, FLORIDA 33166
FL E.B. LICENSE No. 0006719

ENGINEER'S: NAME NUMBER & DISCIPLINE

WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
FL. LIC. NO. 44167

Walter A. Tillit Jr.
MA: 01 2007

FOR OFFICE USE

07-1203-08
11/5/2008
[Signature]


3550 St Johns Bluff Rd South
Jacksonville, FL 32224
800-221-9255
www.senergy.co

APPLICATION NOTES

- 1) "ALLIED FOAM" OR "APACHE" EPS HAS A DENSITY OF 1 PCF AND IT SHALL BE APPLIED HORIZONTALLY IN A RUNNING BOND PATTERN STAGGERING VERTICAL JOINTS AND CORNERS.
- 2) SENERFLEX BASE COAT IS MIXED AT TIME OF USE WITH PORTLAND CEMENT (1 TO 1 BY WEIGHT) AND WATER WITH PADDLE AND DRILL TO A HOMOGENEOUS CONSISTENCY.
- 3) FLEXGUARD 4 IS A GLASS FIBER, OPEN WEAVE REINFORCING FABRIC THAT WEIGHS 4.2 OZ/SQUARE YARD. EDGES SHALL BE LAPPED BY 2 1/2 INCHES.
- 4) SENERFLEX FINISH IS AN ACRYLIC BASED TEXTURE EXTERIOR COATING READY MIXED FROM THE FACTORY. IT IS APPLIED WITH A STAINLESS STEEL TROWEL AND FLOATED TO A DESIRED TEXTURE.

GENERAL NOTES

- 1) THIS SYSTEM HAS BEEN DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 2004 EDITION AND ITS LATEST SUPPLEMENTS.
- 2) THIS SYSTEM HAS BEEN TESTED IN ACCORDANCE WITH MIAMI-DADE COUNTY PROTOCOL TAS-201, TAS-202 & TAS-203 FOR SMALL MISSILE IMPACT, STRUCTURAL AND CYCLIC TESTING.
- 3) THIS SYSTEM SHALL BE APPLIED BY A LICENSED PLASTERING CONTRACTOR FOLLOWING THIS NOTICE OF ACCEPTANCE, THE RECOMMENDATIONS OF SENERGY INC. AND THE APPLICABLE SECTION OF THE SOUTH FLORIDA BUILDING CODE.
- 4) THE ENGINEER AND/OR ARCHITECT OF RECORD FOR EACH PROJECT USING THIS SYSTEM SHALL SIZE ALL STUD FRAMING TO ENSURE CONFORMANCE WITH STUD DEFLECTION AND STRESS LIMITATIONS AS REQUIRED BY GOVERNING CODE AND THIS DOCUMENT.
- 5) ALL STUDS USED WITH THIS SYSTEM SHALL BE COMPLETELY SHEATHED AT THE INTERIOR FLANGE OR BRIDGED AT MAXIMUM EVERY 5 FT. OF STUD LENGTH OR AS SPECIFIED BY THE MANUFACTURER.
- 6) ALL STEEL STUDS SHALL BE STRUCTURAL WITH 1 5/8" MIN FLANGE WIDTH AND HAVE A MINIMUM YIELD STRENGTH OF 33000 PSI
- 7) DETAILS ON SHEET 2 & 3 OF 3 ARE TYPICAL AND SHOW INTENT TO PREVENT WATER INFILTRATION INTO AND BEHIND THE SYSTEM. ALTERNATE DETAILS AND SPECIFIC CONDITIONS NOT COVERED BY THE TYPICAL DETAILS ARE THE RESPONSIBILITY OF THE LICENSED DESIGN PROFESSIONAL IN CONSULTATION WITH SENERGY, INC.

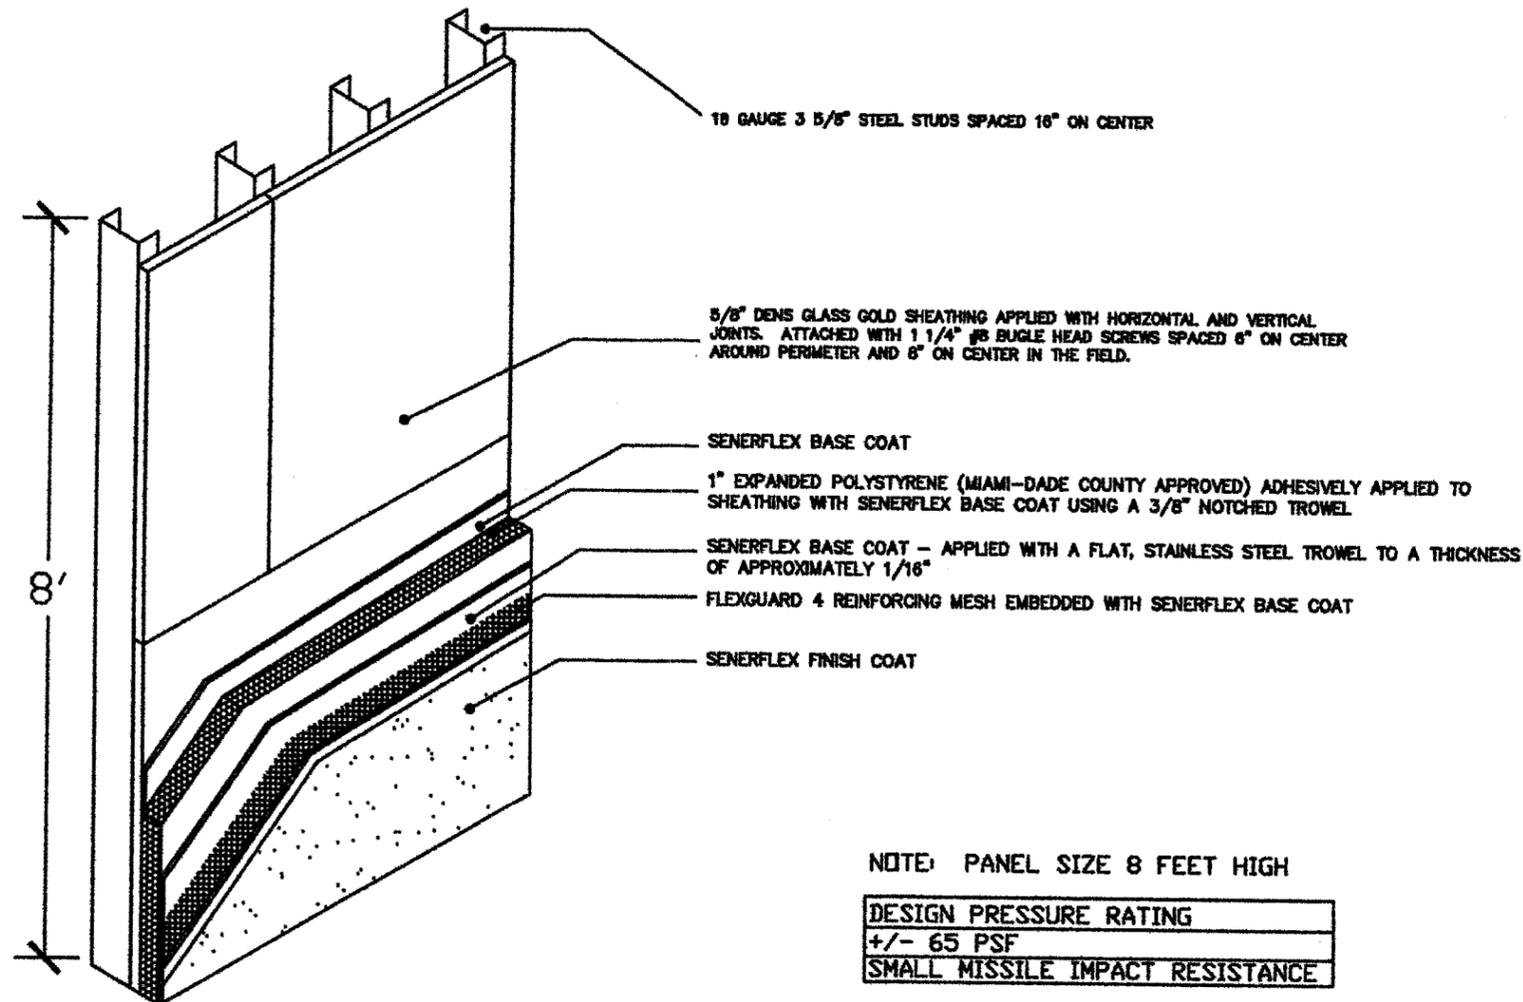

NOTE: PANEL SIZE 8 FEET HIGH

DESIGN PRESSURE RATING
+/- 65 PSF
SMALL MISSILE IMPACT RESISTANCE

PRODUCT RENEWED
to comply with the Florida
Building Code 06-1101-04
Acceptance No. 11/5/07
Expiration Date
By *M. Shaker*
Miami Dade Product Control
Division

SENERGY

DATE: 1/10/00 Page 2 of 3

Typical Details for Senerflex Wall System over Dens Glass Gold Frame (Small Missile)

REVISIONS DATES

4/26/07



TILLIT TESTING & ENGINEERING COMPANY
6355 NW 36th STREET, STE. 305
MIAMI, FLORIDA 33166
FL E.B. LICENSE No. 0006719

ENGINEER'S: NAME NUMBER & DISCIPLINE

WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
FL. LIC.NO. 44167


Walter A. Tillit Jr.

MAY 01 2007


FOR OFFICE USE

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 07-1203.08
Expiration Date 11/15/2008
By *[Signature]*
Miami Trade Product Control
Division


3550 St Johns Bluff Rd South
Jacksonville, FL 32224
904-221-9255
www.senergy.co

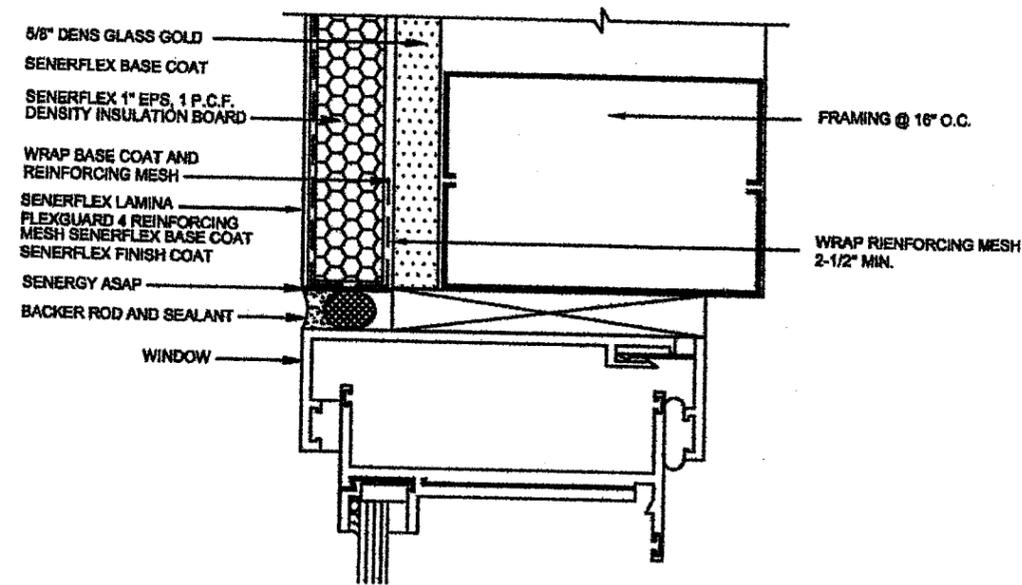


WINDOW JAMB DETAIL (FLUSH)

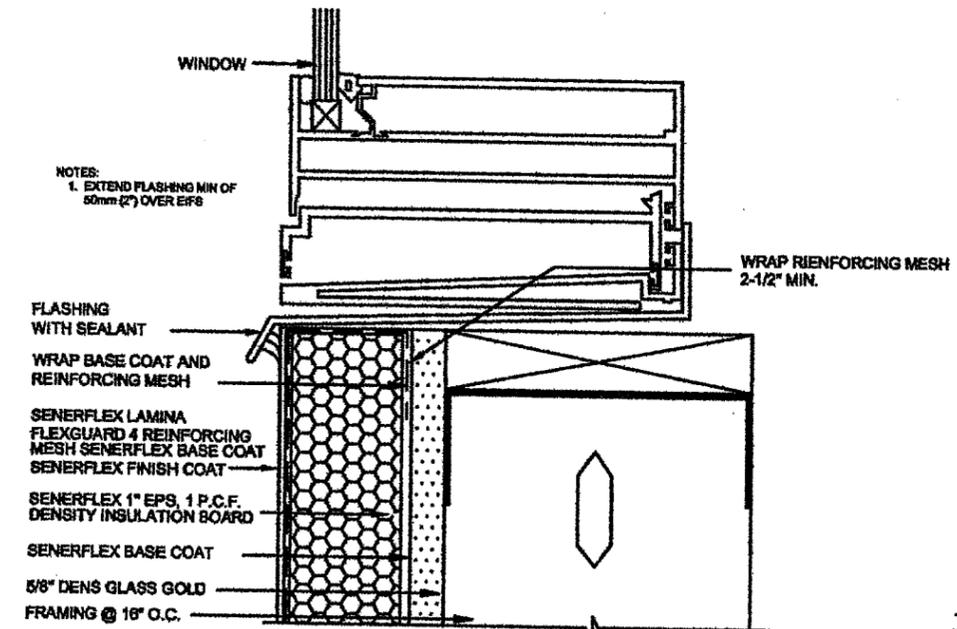

WINDOW SILL DETAIL (FLUSH)

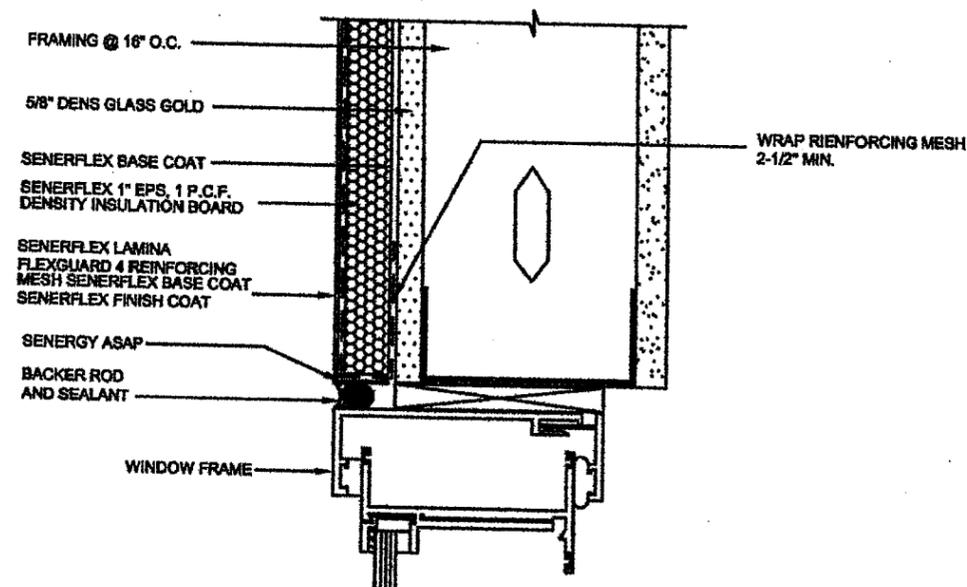

TYPICAL WINDOW HEAD (FLUSH)

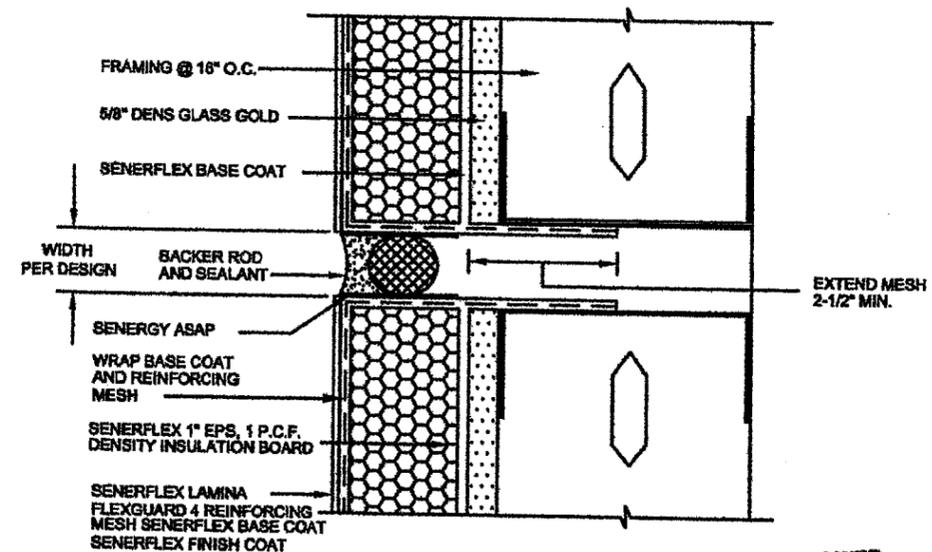

EXPANSION JOINT DETAIL

NOTE: SENERGY ASAP IS APPLIED TO SENERFLEX BASE COAT IN SEALANT JOINTS PRIOR TO APPLICATION OF SEALANT SYSTEM

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 06-1101-04
Expiration Date 11/15/07
By *[Signature]*
Miami Trade Product Control
Division

SENERGY

DATE: 1/10/00 Page 3 of 3

Typical Details for Senerflex Wall System over Dens Glass Gold Frame (Small Missile)

REVISIONS	DATES
	4/28/07

4/28/07



TILLIT TESTING & ENGINEERING COMPANY
6355 NW 36th STREET, STE. 305
MIAMI, FLORIDA 33166
FL E.B. LICENSE No. 0006719

ENGINEER'S: NAME NUMBER & DISCIPLINE

WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
FL. LIC. NO. 44167


[Signature]

MAY 01 2007


FOR OFFICE USE

07-1203.08
11/5/2008
[Signature]

3550 St Johns Bluff Rd South
Jacksonville, FL 32224
800-221-9255
www.senergy.cc

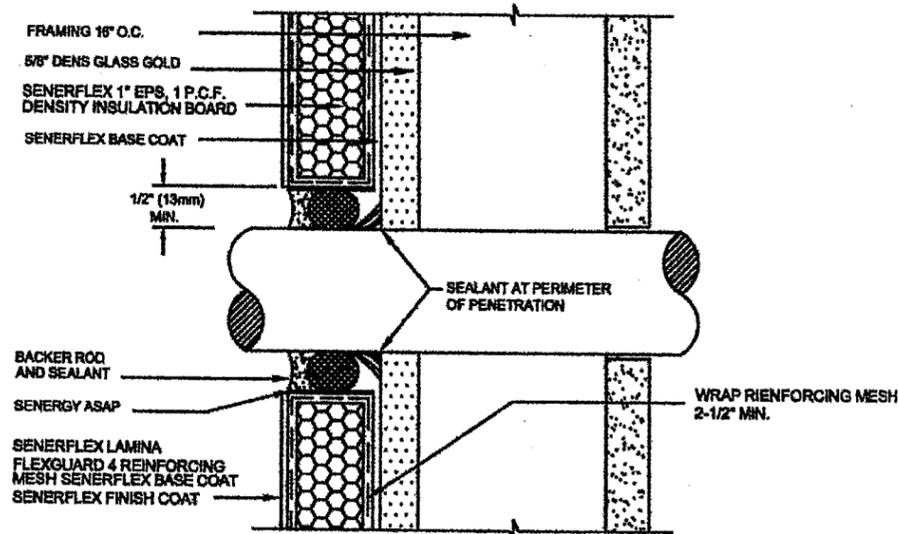


TYPICAL PIPE PENETRATION

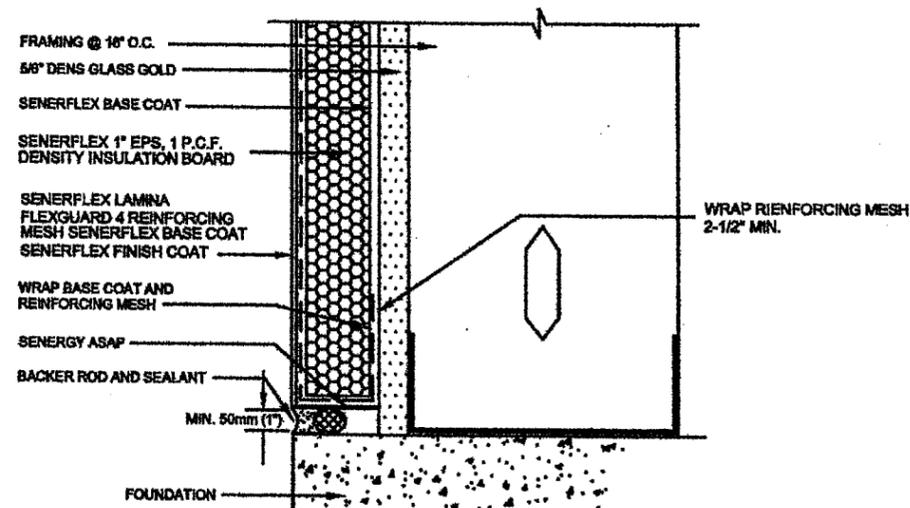

TERMINATION AT FOUNDATION (FLUSH)

NOTE: SENERGY ASAP IS APPLIED TO SENERFLEX BASE COAT IN SEALANT JOINTS PRIOR TO APPLICATION OF SEALANT SYSTEM

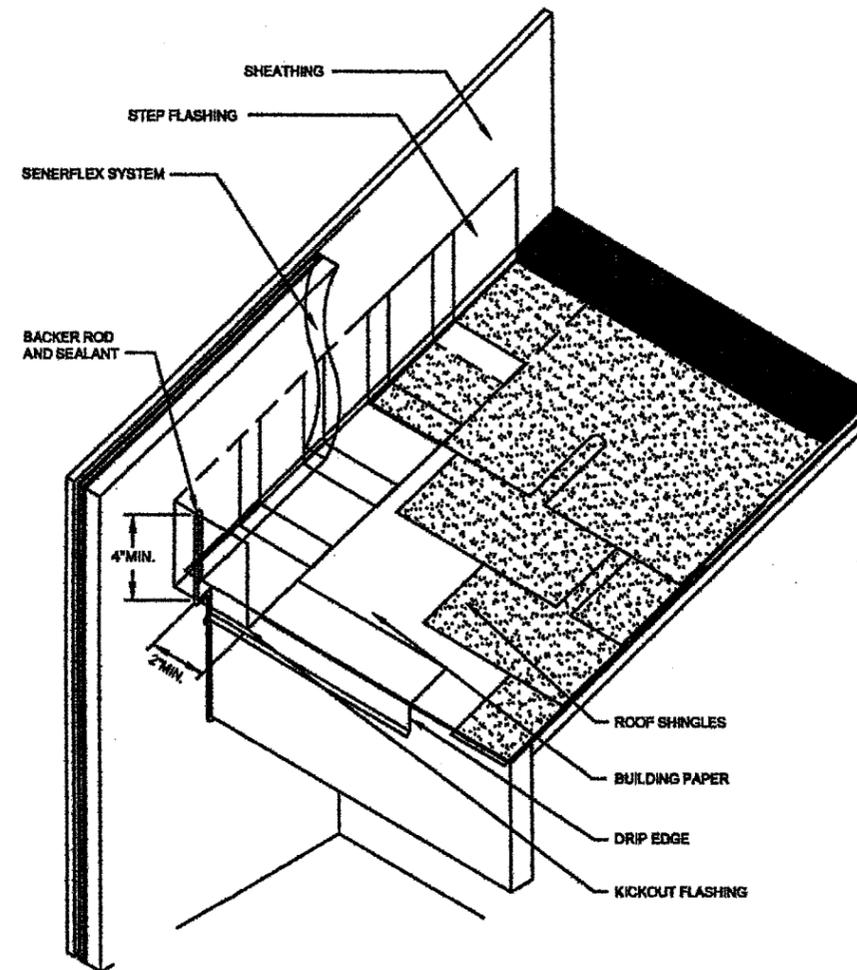

NOTE:

1. KICKOUT FLASHING MUST BE ANGLED 100° MIN. TO ALLOW FOR PROPER DRAINAGE.
2. KICKOUT FLASHING SEAMS MUST BE SOLDERED OR SEALED WITH APPROPRIATE SEALANT.
3. TERMINATE SENERFLEX SYSTEM 1" (25mm) MIN. ABOVE ROOF
4. ROOFING DETAIL SHALL COMPLY WITH CHAPTER 15 OF THE F.B.C.

KICKOUT FLASHING DETAIL

PRODUCT RENEWED
as complying with the Florida
Building Code 06-1101.04
Acceptance No. 11/2007
Expiration Date
By *[Signature]*
Miami Dade Product Control
Division