



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING

140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov

VP Buildings, Inc.
1140 West Mountain Street
Kernersville, NC 27284

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: 0.026" (min.) Galvalume Steel Standing Seam Roof (SSR) Panel

APPROVAL DOCUMENT: Drawing No. VP SSR Roof Submittal, titled "VP SSR Roof Submittal", sheets 1 through 8 of 8, prepared by VP Buildings, Inc., signed and sealed by Charles A. Haslebacher, P.E., dated September 21, 1999, last revision #3 dated February 18, 2003, sheet 1 of 8, and revision #2 dated November 4, 1999, sheets 2 through 8 of 8, bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each panel shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 03-0206.13** and consists of this page 1, evidence submitted pages E-1 & E-2 as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**



Helmy A. Makar
 05/29/2008

NOA No. 08-0303.04
Expiration Date: 04/24/2009
Approval Date: 05/29/2008
Page 1

VP Buildings, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 99-0719.05

A. DRAWINGS

1. *Drawing number VP SSR Roof Submittal, titled "VP SSR ROOF SUBMITAL ", dated September 21, 1999, last revision #2 dated November 4, 1999, sheets 1 through 8 of 8, signed and sealed by Larry Marshall, P.E.*

B. TESTS

1. *Resistance to wind driven rain, per PA 100-95, prepared by Architectural Testing Inc., Report No. 01-33389.02, dated 06/22/99, signed and sealed by Allen N. Reeves, P.E.*
2. *Test report on Large Missile Impacts, per PA 201-94, prepared by Architectural Testing Inc., Report No. 01-33389.04, dated 06/22/99, signed and sealed by Allen N. Reeves, P.E.*
3. *Susceptibility to leakage test in accordance with Miami-Dade County Protocol PA 114 Appendix G, prepared by Architectural Testing Inc., Report No. 01-33389.05, dated 06/22/99, signed and sealed by Allen N. Reeves, P.E.*
4. *Test report on Uniform static air pressure loading, per ASTM E 1592, prepared by Architectural Testing Inc., Report No. 01-33389.07, dated 06/23/99, signed and sealed by Allen N. Reeves, P.E.*
5. *Test report on Salt Spray Testing, per ASTM B117-90, prepared by Architectural Testing Inc., Report No. 01-33389.08, dated 06/23/99, signed and sealed by Allen N. Reeves, P.E.*
6. *Test report on Accelerated Testing of Coating 2000 hours per ASTM G23, prepared by Architectural Testing Inc., Report No. 01-33389.09, dated 09/23/99, signed and sealed by Allen N. Reeves, P.E.*

C. CALCULATIONS

1. *Calculation titled "Section properties calculated for 24 ga. SSR Panel in accordance with AISI Cold Formed Steel Design Manual 1996" dated July 13, 1999, signed and sealed by Larry Marshall, P.E.*
2. *Calculation titled "Section properties calculated for 24 ga. SSR Panel in accordance with AISI Cold Formed Steel Design Manual 1996 Calculation Verified by Alternate" dated July 13, 1999, signed and sealed by Larry Marshall, P.E.*

D. MATERIAL CERTIFICATIONS

1. *Mill Certified Test Report issued by Bethlehem Steel Corporation, dated 05/06/98, with chemical composition and mechanical properties of galvalume steel.*
2. *Tensile Test Report No. 01-33389.01, prepared by Architectural Testing Inc., Report No. 01-33389.01, dated 03/11/99, signed and sealed by Allen N. Reeves, P.E.*



Helmy A. Makar, P.E., M.S.
Product Control Examiner
NOA No. 08-0303.04
Expiration Date: 04/24/2009
Approval Date: 05/29/2008

VP Buildings, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #03-0206.13

A. DRAWINGS

1. *Drawing No. VP SSR Roof Submittal, titled "VP SSR Roof Submittal", sheets 1 through 8 of 8, prepared by VP Buildings, Inc., signed and sealed by Charles A. Haslebacher, P.E., dated September 21, 1999, last revision #3 dated February 18, 2003, sheet 1 of 8, and revision #2 dated November 4, 1999, sheets 2 through 8 of 8.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. MATERIAL CERTIFICATIONS

1. *None.*

E. STATEMENTS

1. *Letter issued by VP Buildings, Inc., dated February 18, 2003, signed and sealed by Charles A. Haslebacher, P.E., stating that the only change is update General Note numbers 1 & 2 to reference the Florida Building Code and ASCE 7-98.*

3. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. *None.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE


1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS


1. *None.*



Helmy A. Makar, P.E., M.S.
Product Control Examiner
NOA No. 08-0303.04
Expiration Date: 04/24/2009
Approval Date: 05/29/2008

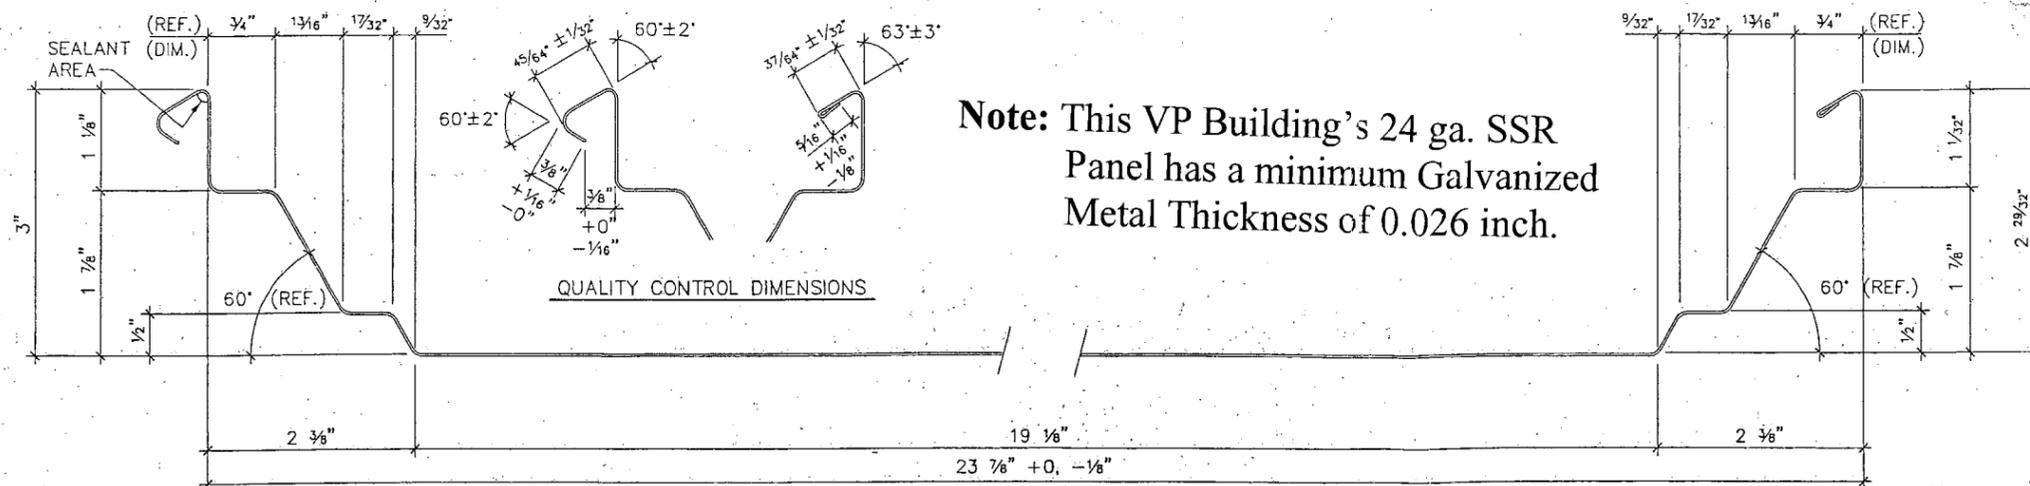

PANEL CROSS SECTION

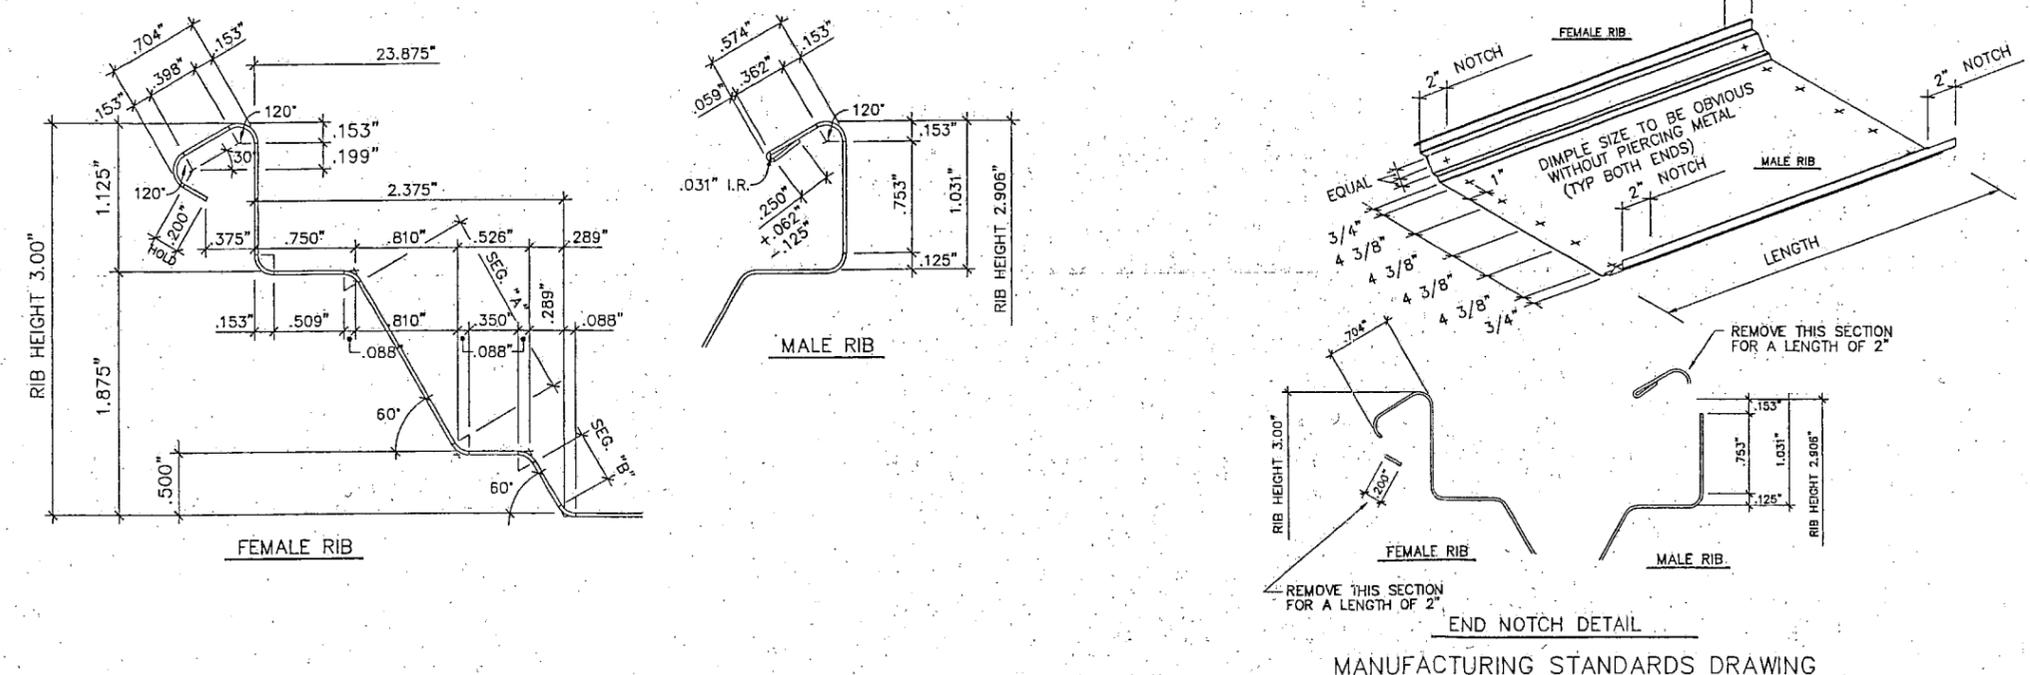

MANUFACTURING STANDARDS DRAWING

REFERENCED FROM DWG. NO. MS-101

- GENERAL NOTES**
- APPLICATION OF THE SSR ROOF PANEL HAS BEEN DESIGNED IN ACCORDANCE WITH THE MIAMI-DADE COUNTY, 2001 Florida Building Code / ASCE7-98 CODE.
 - Design Wind Load shall comply with the 2001 Florida Building Code & ASCE7-98 with a Basic Wind Speed of 146 mph.**
 - ALL SSR ROOF PANELS SHALL BE GALVALUME STEEL SHEETS, 24GA. CONFORMING TO ASTM A-792 (Fy = 50 ksi), WITH A COATING DESIGNATION OF Z55, THAT INCLUDES A NOMINAL COATING WEIGHT OF 0.5 OZ PER SQ. FT. BOTH SIDES. THIS GALVALUME COATING DESIGNATION MAY OR MAY NOT BE SILICONE POLYESTER OR XXL COATED.
 - ALL SCREWS TO BE HEX WASHER HEAD (HWH), CORROSION RESISTANT, SELF-DRILLING SCREWS AS MANUFACTURED BY BUILDEX PART NUMBERS 1414, 1175, 1153 AND 1151.
 - ROOF PANEL'S MANUFACTURER'S LABEL SHALL BE PLACED ON BOTTOM OF EACH PANEL. THE LABEL SHALL READ AS FOLLOWS: "VP BUILDINGS, INC., MEMPHIS, TN, MIAMI-DADE COUNTY PRODUCT CONTROL APPROVED".
 - INSTALLATION OF A 24GA. SSR PANEL, SHALL BE ON STEEL SUPPORTS THAT ARE NOT LESS THAN 0.065 INCHES THICK, WITH THE SIZE OF FASTENERS AND THEIR LOCATIONS AS INDICATED ON THE APPROVED DRAWINGS.
 - THE 24GA. SSR PANEL, SHALL BE USED IN ROOF CONSTRUCTION, INSTALLED AS INDICATED ON THE ATTACHED APPROVED DETAIL DRAWINGS WHICH INCLUDE:
 - DETAILS OF ALL PANEL MATERIAL PROPERTIES AND PANEL CROSS SECTIONS WITH DIMENSIONS.
 - ASSEMBLY DETAILS THAT INDICATE ALL FASTENER TYPES, SIZES, SPACING, AND WHERE ARE TO BE INSTALLED.
 - MAXIMUM SPAN OF INSTALLED PANEL AND DESIGN PRESSURE BASED ON THE PANEL'S DESIGN ALLOWABLES SHOWN IN A TABLE ON THESE APPROVED DRAWINGS.

Handwritten signature
2-18-03

Charles A. Haslebach, P.E.
Florida PE Reg No. 53553
VP Buildings, Inc.
1140 West Mountain Street
Kernersville, NC 27284


TABLE OF MAXIMUM DESIGN PRESSURE RATING "W" (P.S.F.) BASED ON ROOF SYSTEM ASSEMBLY REQUIREMENTS

PURLIN SPACING	PANEL CLIP SPACING	SUB-PURLIN REQUIRED?	SEAM CLAMP REQUIRED?	ALLOWABLE GRAVITY PRESSURE	ALLOWABLE UPLIFT PRESSURE
3'-5 1/8"	1'-8 9/16"	YES	NO	37.5	50
2'-6"	1'-3"	YES	YES	37.5	136
1'-8 9/16"	1'-8 9/16"	NO	NO	37.5	50
1'-3"	1'-3"	NO	YES	37.5	136

PRODUCT RENEWED
as complying with the Florida Building Code
Acceptance No. 08-0303.04
Expiration Date 04/24/2009
By *Helmut A. Meier*
Miami Dade Product Control Division

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 03-0206.13
Expiration Date 04/24/2008
By *Helmut A. Meier*
Miami Dade Product Control Division

DWG. NO.	VP SSR ROOF SUBMITAL
SHEET NO.	1 OF 8
DATE	02/18/03
REV. NO. 1	REV. DATE. 10/20/99
REV. NO. 2	REV. DATE. 11/04/99
REV. NO. 3	REV. DATE. 02/18/03

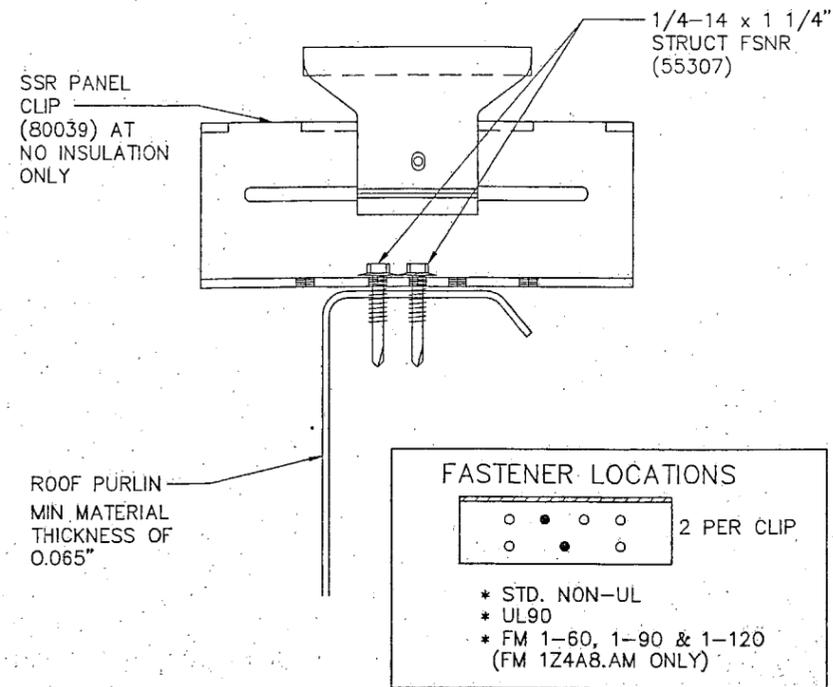


SSR PANEL CLIP ATTACHMENT

RC01A6

NO INSULATION ON PURLINS

RC01A6V4 R 02/20/98

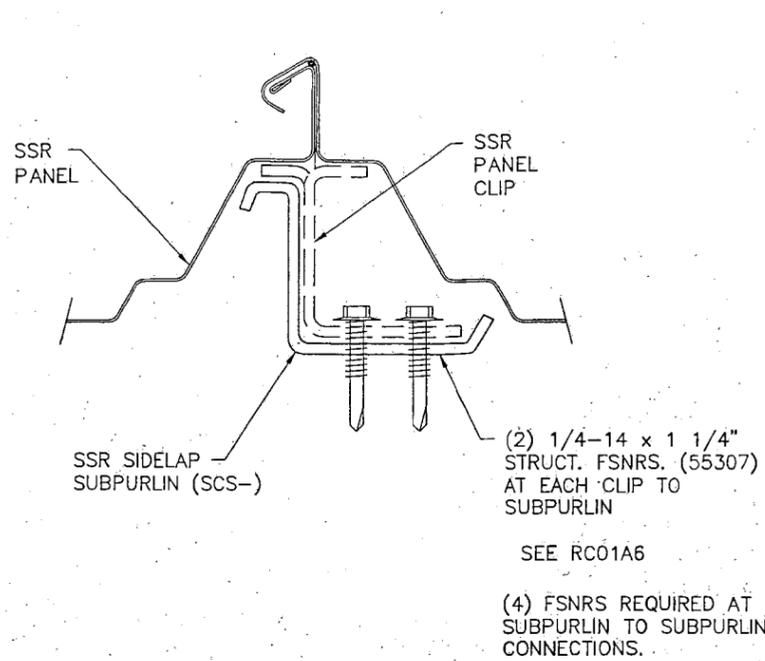


SSR CLIP ATTACHMENT AT ROOF FIELD

RC01Q1

W/ SIDELAP SUBPURLIN

RC01Q1V1 12/09/94

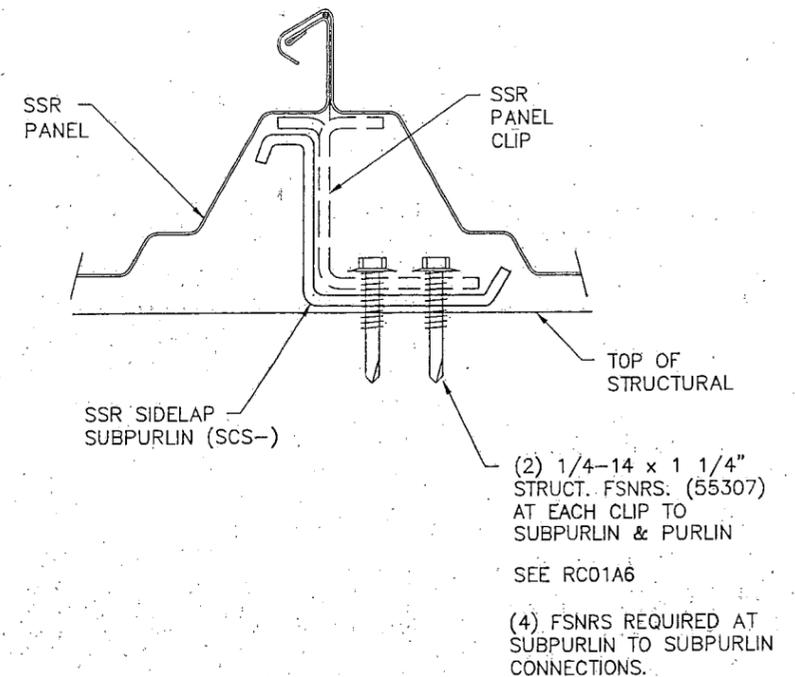

SSR CLIP ATTACHMENT AT ROOF FIELD

RC01R1

W/ SIDELAP SUBPURLIN OVER PURLIN

RC01R1V1 12/09/94

SSR PANEL CLIP ATTACHMENT AT THE ROOF'S FIELD AREA


PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No 08-0303.04
 Expiration Date 04/24/2009
 By Helmut A. Meier
 Miami Dade Product Control
 Division

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 03-0206.13
 Expiration Date 04/24/2008
 By Helmut A. Meier
 Miami Dade Product Control
 Division


[Handwritten Signature]
 2-18-03

Charles A. Haslebacher, P.E.
 Florida PE Reg No. 53553
 VP Buildings, Inc.
 1140 West Mountain Street
 Kernersville, NC 27284

DWG. NO.	VP SSR ROOF SUBMITAL
SHEET NO.	3 OF 8
DATE	09/21/99
REV. NO. 1	REV. DATE. 10/20/99
REV. NO. 2	REV. DATE. 11/04/99

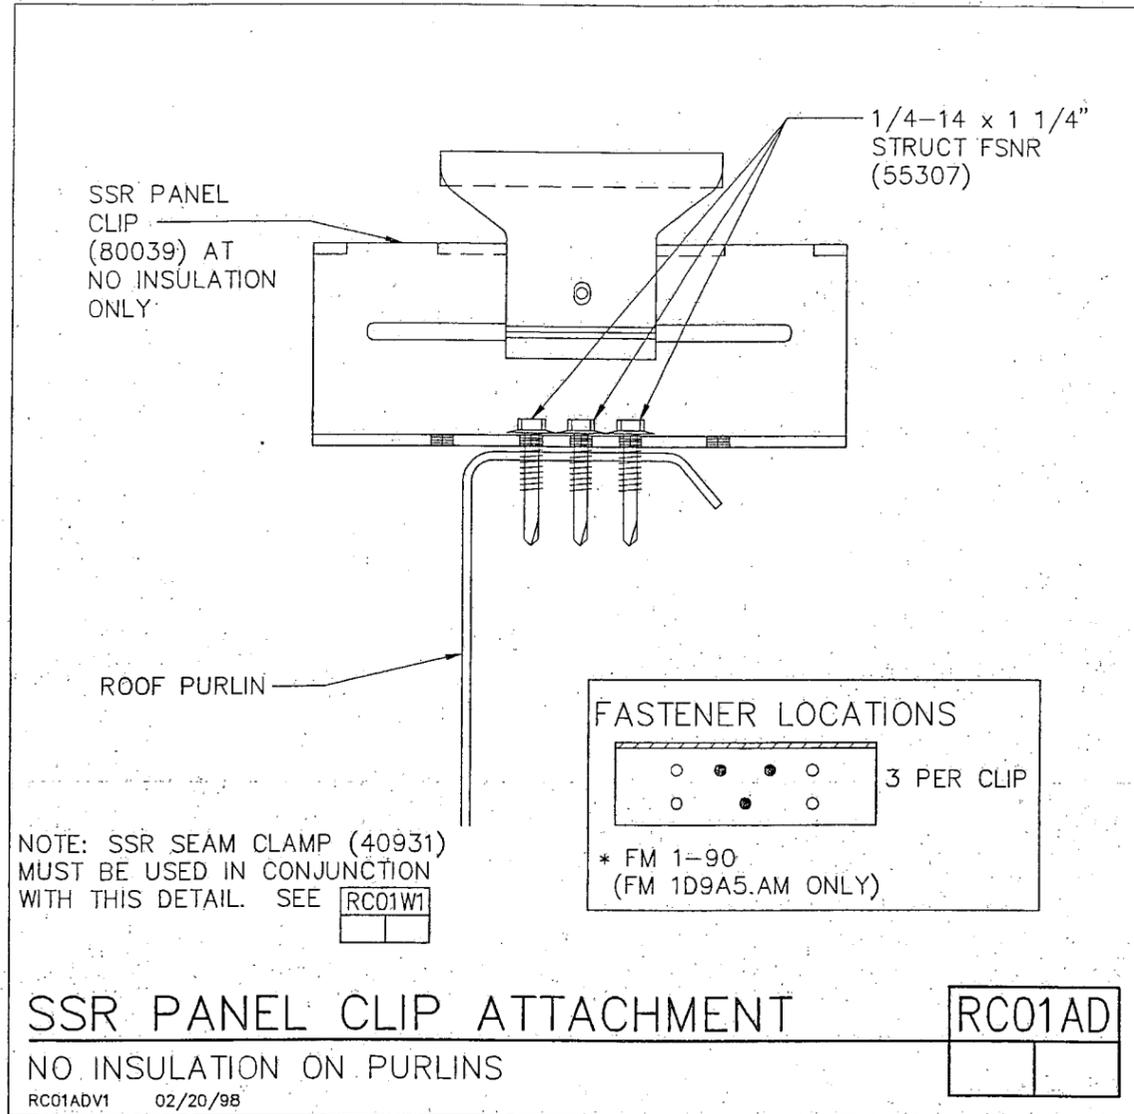

SSR PANEL CLIP ATTACHMENT AT THE ROOF'S PERIMETER OR CORNER AREA

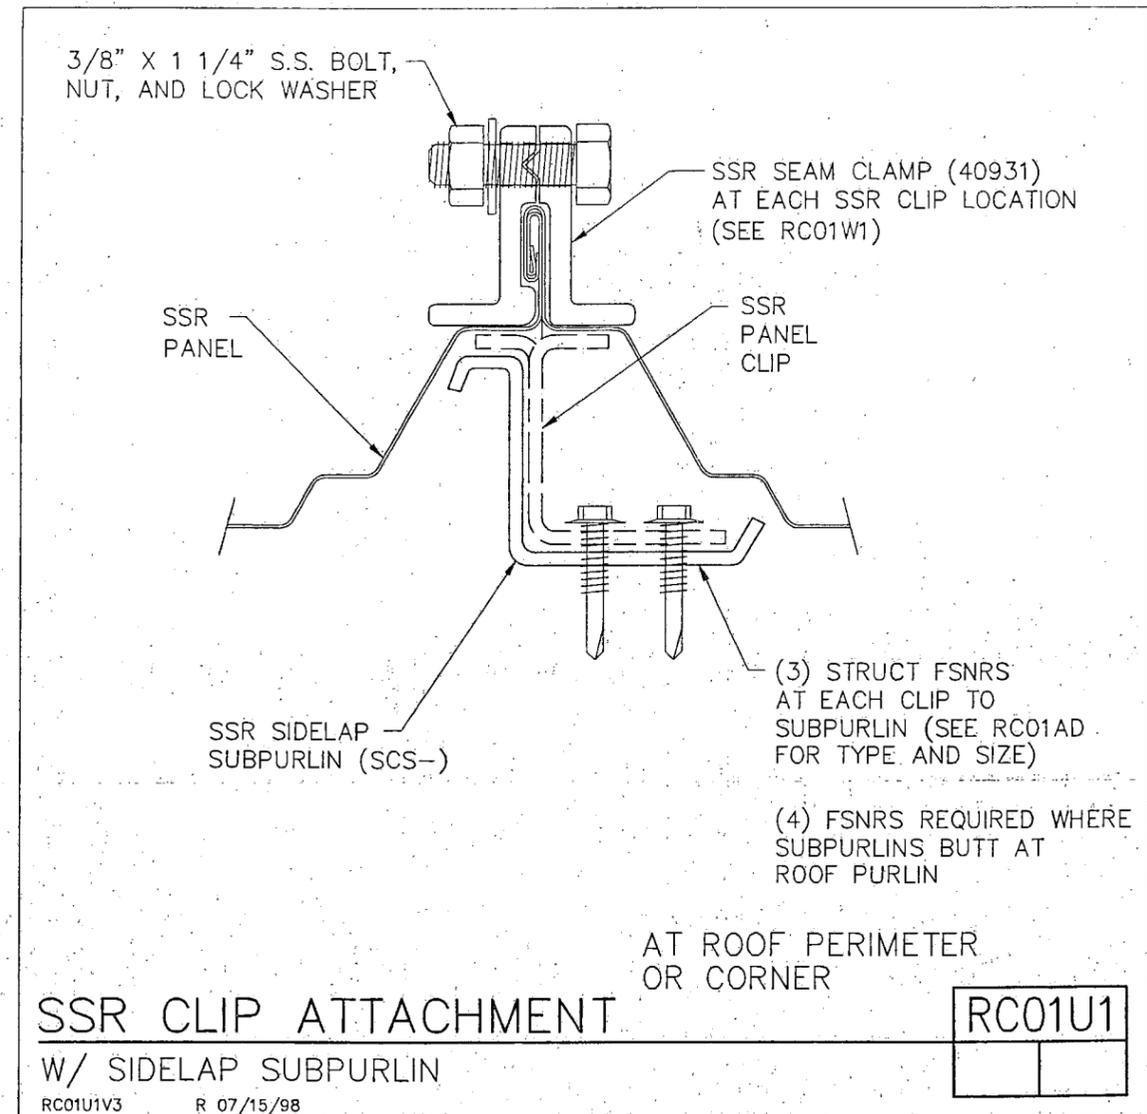


PRODUCT RENEWED
as complying with the Florida Building Code
Acceptance No 08-0303.04
Expiration Date 04/24/2009
By *Charles A. Haslebacher*
Miami Dade Product Control Division

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 03-0206.13
Expiration Date 04/24/2008
By *Charles A. Haslebacher*
Miami Dade Product Control Division

Charles A. Haslebacher
2-15-10


Charles A. Haslebacher, P.E.
Florida PE Reg No. 53553
VP Buildings, Inc.
1140 West Mountain Street
Kernersville, NC 27284

DWG. NO. VP_SSR ROOF SUBMITAL	
SHEET NO. 4 OF 8	
DATE 09/21/99	
REV. NO. 1	REV. DATE: 10/20/99
REV. NO. 2	REV. DATE: 11/04/99

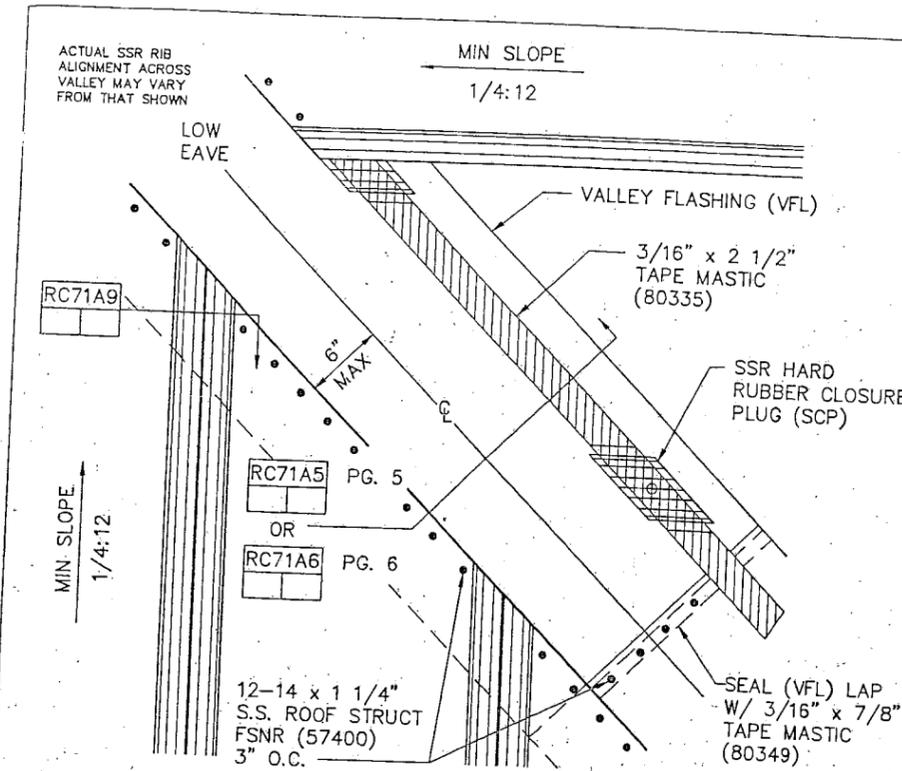

SSR VALLEY FLASHING


RC71A1

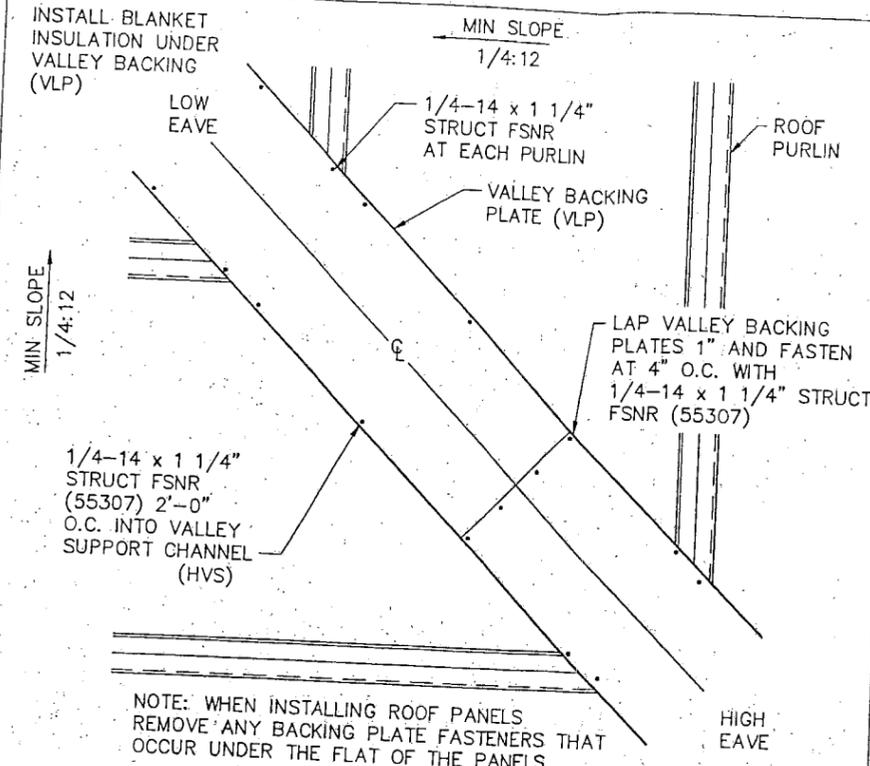

VALLEY FRAMING

W/ BLANKET INSULATION


RS71A2

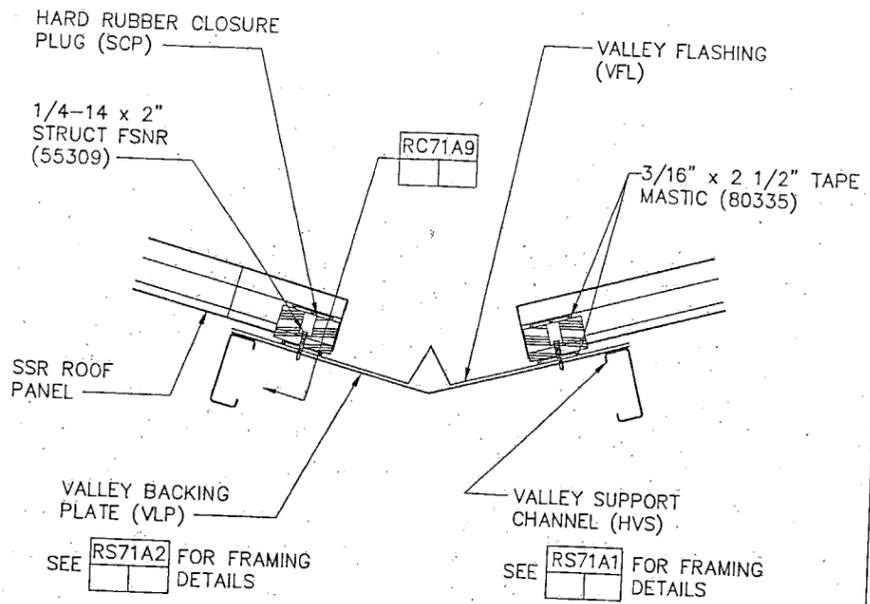

SSR VALLEY FLASHING


W/ BLANKET INSULATION

RC71A5

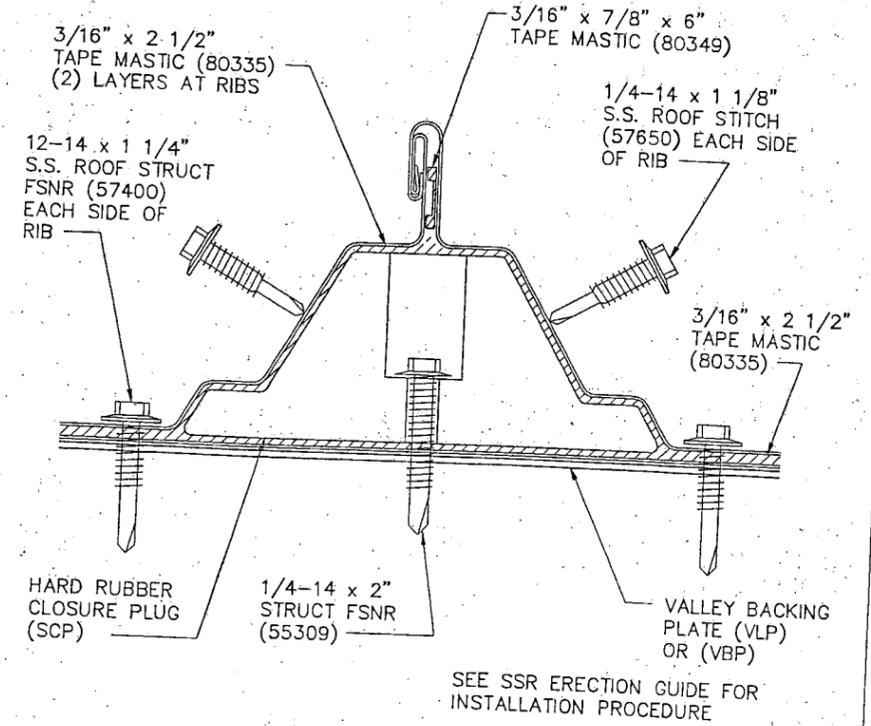

SSR RIB AT VALLEY

RC71A9

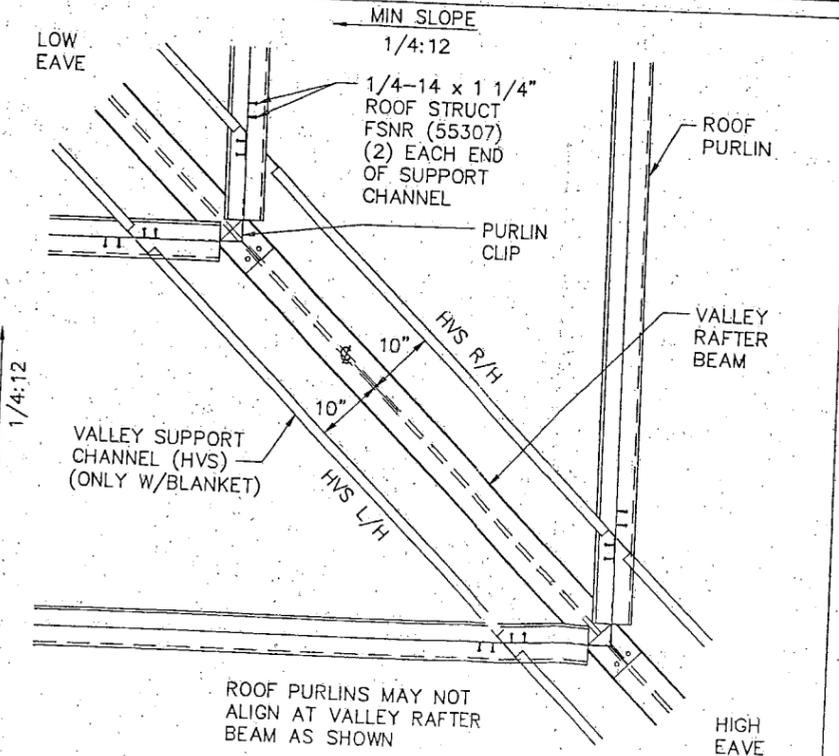

VALLEY FRAMING

W/ BLANKET INSULATION

RS71A1

VALLEY ASSEMBLY DETAILS

PRODUCT RENEWED
 as complying with the Florida Building Code
 Acceptance No 08-0303.04
 Expiration Date 04/24/2009
 By Helmut A. Meier
 Miami Dade Product Control Division

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 03-0206.13
 Expiration Date 04/24/2008
 By Helmut A. Meier
 Miami Dade Product Control Division

Handwritten signature and date: Helmut A. Meier 02-11-09

Charles A. Haslebach, P.E.
 Florida PE Reg No. 53553
 VP Buildings, Inc.
 1140 West Mountain Street
 Kernersville, NC 27284

DWG. NO.	VP SSR ROOF SUBMITAL
SHEET NO.	5 OF 8
DATE	09/21/99
REV. NO. 1	REV. DATE 10/20/99
REV. NO. 2	REV. DATE 11/12/99


RC71A9V2 R 07/01/92

RC71A1V2 R 03/01/90

RS71A2V2 R 03/01/90


RC71A5V4 R 07/15/98

RS71A1V4 R 08/23/99

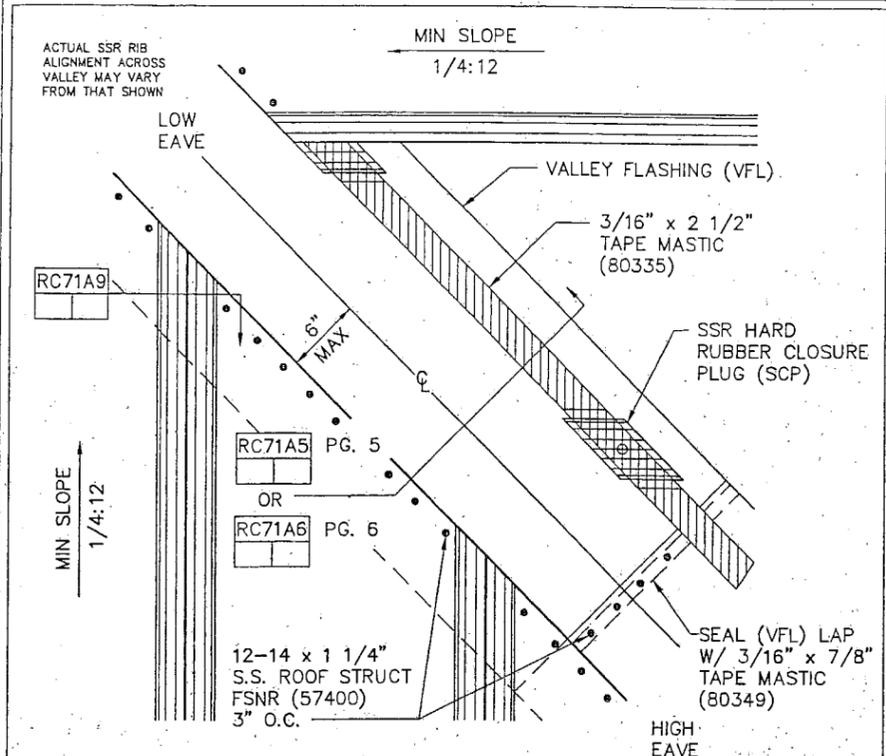

SSR VALLEY FLASHING RC71A1


RC71A1V2 R 03/01/90

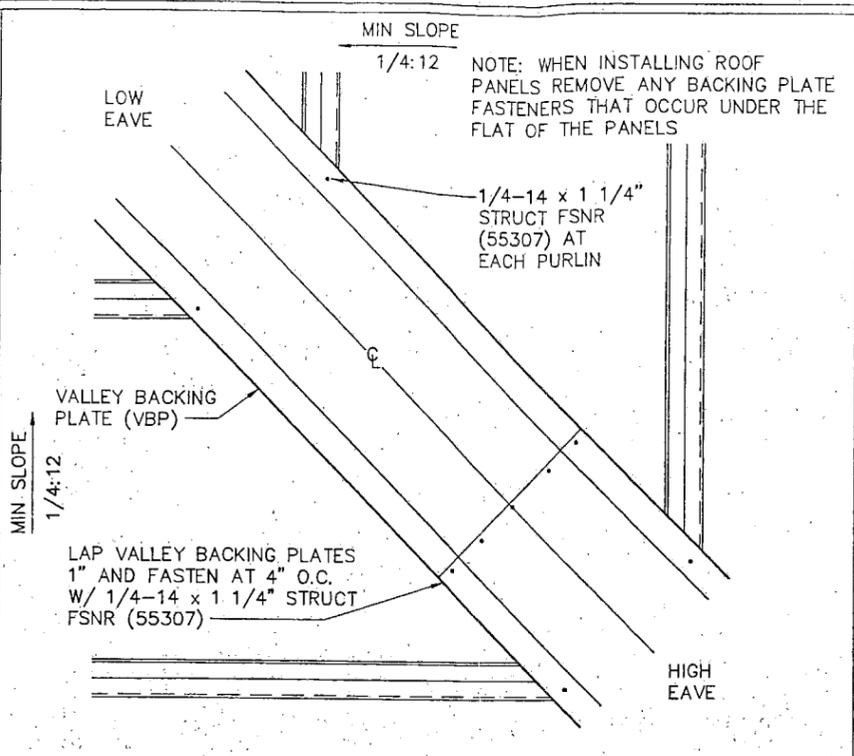

VALLEY FRAMING RS71A3

W/ THERMAL BLOCK, SUPERBLOCK, OR RIGID BOARD.


RS71A3V2 R 03/01/90

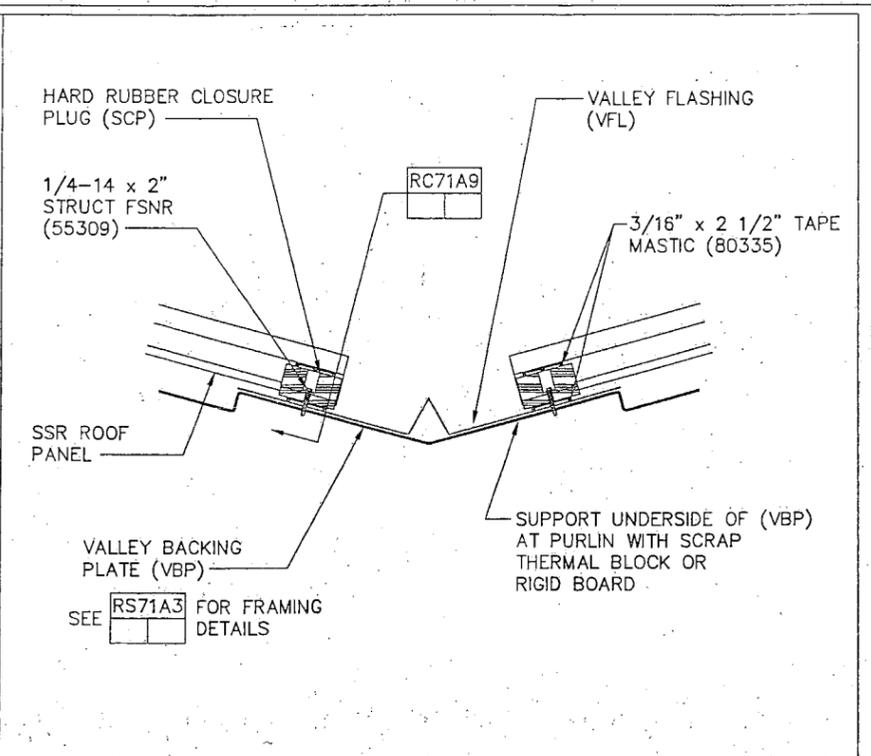

SSR VALLEY FLASHING RC71A6

W/ T. BLOCK, S. BLOCK, RIGID BD. INS.

RC71A6V4 R 07/15/98

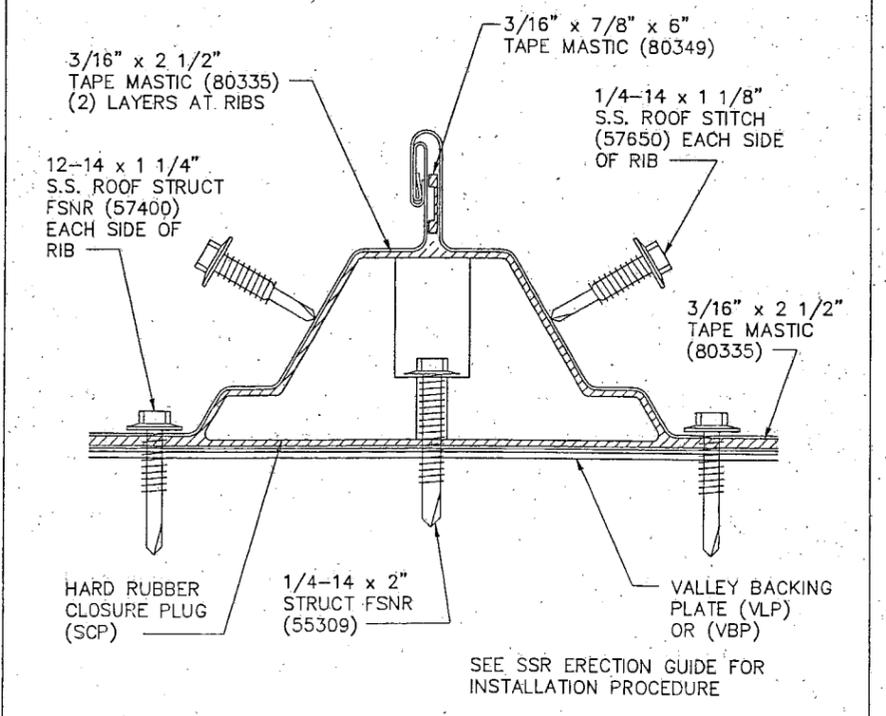

SSR RIB AT VALLEY RC71A9

RC71A9V2 R 07/01/92

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 08-0303.04
 Expiration Date 04/24/2009
 By *Helmut A. Mahr*
 Miami Dade Product Control
 Division

Charles A. Haslebacher
 2-18-07


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 03-0206.13
 Expiration Date 04/24/2008
 By *Helmut A. Mahr*
 Miami Dade Product Control
 Division

Charles A. Haslebacher, P.E.
 Florida PE Reg No. 53553
 VP Buildings, Inc.
 1140 West Mountain Street
 Kernersville, NC 27284

DWG. NO.	VP SSR ROOF SUBMITAL
SHEET NO.	6 OF 8
DATE	09/21/99
REV. NO. 1	REV. DATE. 10/20/99
REV. NO. 2	REV. DATE. 11/04/99

PANEL MAY BE ERECTED LEFT TO RIGHT OR RIGHT TO LEFT (LEFT TO RIGHT SHOWN)

SEE RC02A1 FOR ENDLAP SECTION
SEE RC02A2 FOR FASTENER & MASTIC LOCATION

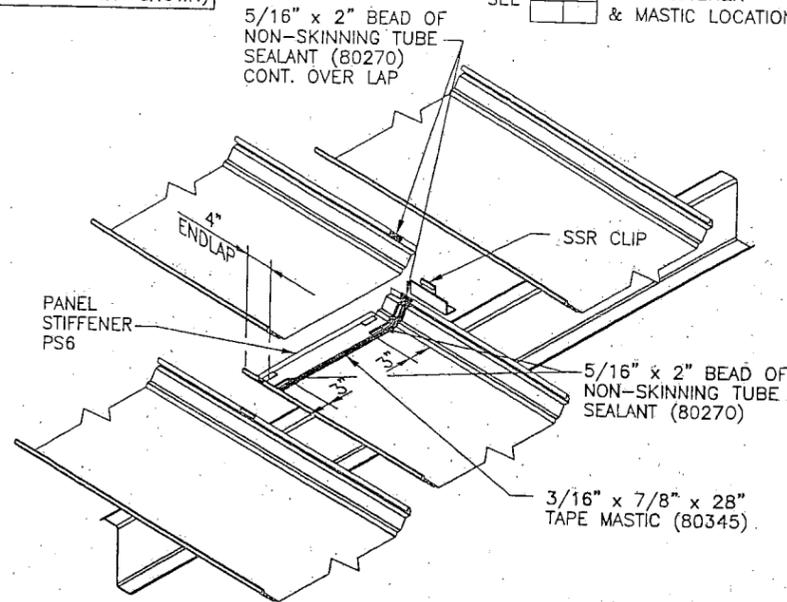


SSR STAGGERED PANEL ENDLAP

PLAN VIEW
RC02A3V1 04/01/99

RC02A3

SEE RC02A1 FOR PANEL LOCATION AT ENDLAP

PANEL MAY BE ERECTED LEFT TO RIGHT OR RIGHT TO LEFT (LEFT TO RIGHT SHOWN)

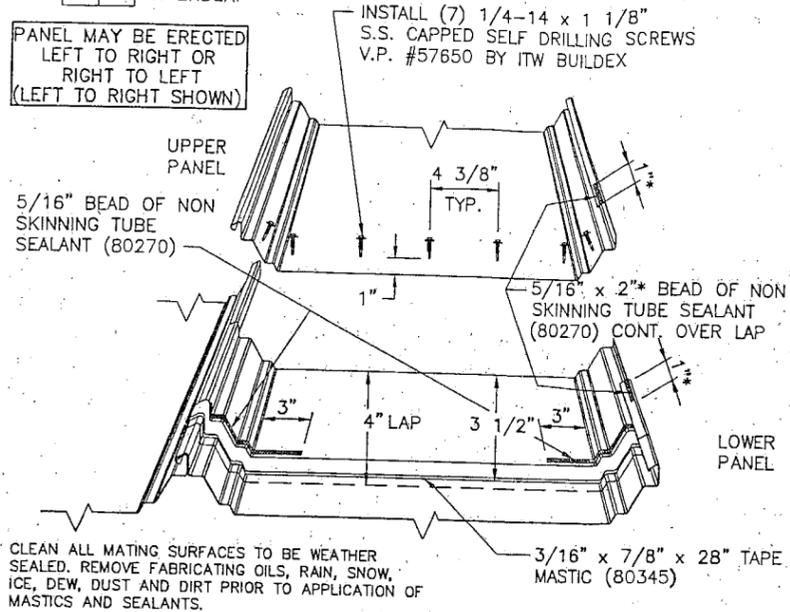


SSR PANEL STAGGERED ENDLAP FASTENER AND MASTIC PATTERN

RC02A2V3 R 04/01/99

RC02A2


SEE RC02A2 FOR MASTIC AND FASTENER PATTERNS

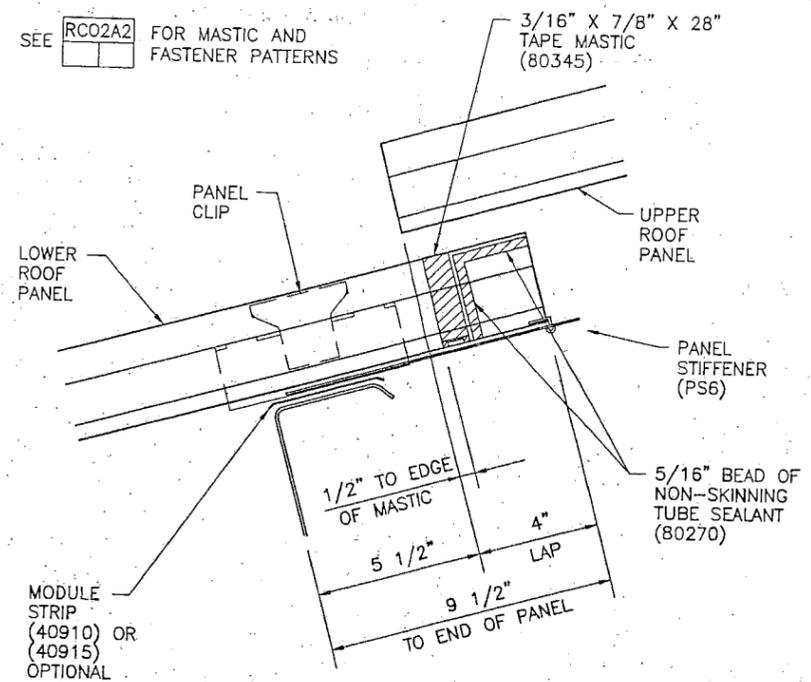

SSR ROOF PANEL ENDLAP ON PURLINS

RC02A1V3 R 04/01/99

RC02A1

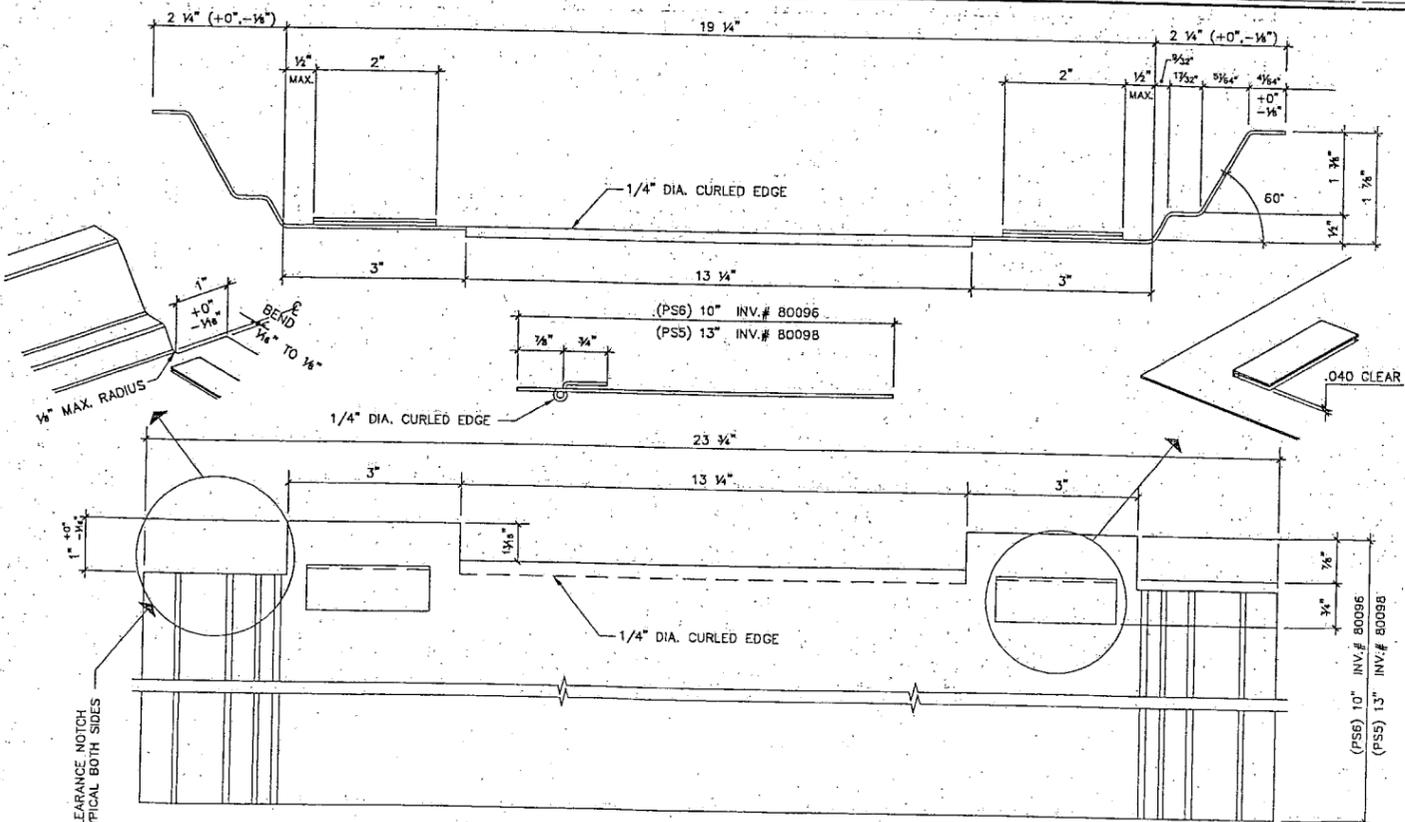

REFERENCE FROM DWG. NO. MS-080

MATERIAL: 18 GA. GALVANIZED
INV. # 80096 WT. 3.6#
INV. # 80098 WT. 4.7#

MANUFACTURING STANDARDS DRAWING
PANEL STIFFENERS #80096 & 80098

ROOF PANEL ENDLAP DETAILS

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 08-0303.04
Expiration Date 04/24/2009
By Helmut A. Meier
Miami Dade Product Control
Division


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 03-0206.13
Expiration Date 04/24/2008
By Helmut A. Meier
Miami Dade Product Control
Division

* 2-1" BEADS LAID
END TO END.

DWG. NO.	VP SSR ROOF SUBMITAL
SHEET NO.	7 OF 8
DATE	09/21/99
REV. NO. 1	REV. DATE. 10/20/99
REV. NO. 2	REV. DATE. 11/04/99

Charles A. Haslebacher
2-15-03

Charles A. Haslebacher, P.E.
Florida PE Reg No. 53553
VP Buildings, Inc.
1140 West Mountain Street
Kernersville, NC 27284

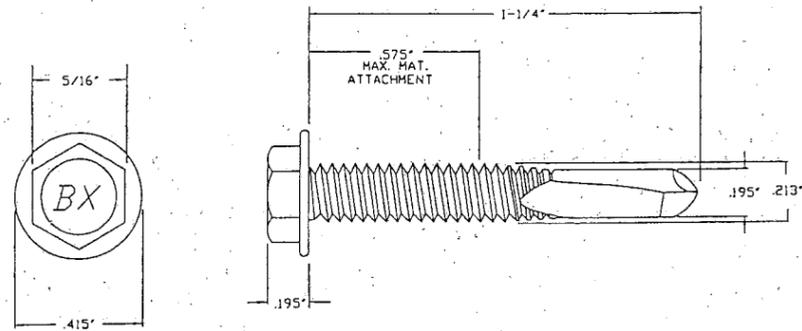


VP Buildings
3200 Players Club Circle
Memphis, TN 38125

SPECIFICATIONS: (REF. Q.S. 101.34)

1. DRILL TIME: 10 SECONDS MEAN, .250 PLATE
2. TAPPING TORQUE: 100 IN. LBS. MAX
3. PULLOUT: 3600 LBS. AVE. MIN. J87 (3/16)
4. SHEAR: (FASTENER) 2090 LBS. AVE. MIN.
5. HEAT TREAT Q.S. 303.2

DRAWN BY:	R.J.M.	DATE:	4-23-97
CHKD.	<i>RJM</i>	APPR.	<i>BRT</i>
MATERIAL:	1022 CARBON STEEL		
CAP. PART #:	NONE		
WASHER PART #:	NONE		
WASHER MAT'L:	NONE		
FINISH:	CLIMASEAL Q.S. 301.5		

ITW BUILDDEX		
A DIVISION OF ILLINOIS TOOL WORKS, INC. 1249 WEST BETH HAVEN AVENUE ITASCAR, ILLINOIS 60143		
SIZE:	12-24 X 1-1/4"	
TYPE:	HVH TEKS/4.5	
BASE/HFG. PART #:	1414	REGISTERED
BUILDDEX PART #:	1414000	ISO 9002




1. SOCKET STABILIZING SHELF
PATENT# 4,759,672
2. DOUBLE HEMMED FIT
PATENT# 4,460,300
3. DETENT
.313-.315 ACROSS FLATS

DRAWN BY:	R.J.M.	DATE:	11-19-98
CHKD.	<i>DS</i>	APPR.	<i>BRT</i>
MATERIAL:	1022 CARBON STEEL		
CAP. PART #:	1255		
WASHER PART #:	1614		
WASHER MAT'L:	EPDM		
FINISH:	CLIMASEAL Q.S. 301.5		

ITW BUILDDEX		
A DIVISION OF ILLINOIS TOOL WORKS, INC. 1249 WEST BETH HAVEN AVENUE ITASCAR, ILLINOIS 60143		
SIZE:	1/4-14 X 1-1/8"	
TYPE:	300 SERIES SS SCOTS HVH TEKS/1	
BASE/HFG. PART #:	1027	REGISTERED
BUILDDEX PART #:	1175000	ISO 9002

- SPECIFICATIONS: (REF. Q.S. 101.31)
1. DRILL TIME: 4 SECONDS MEAN, 14 GA.
 2. TAPPING TORQUE: 110 IN. LBS. MAX
 3. PULLOUT: 725 LBS. AVE. MIN. 18 GA.
 4. SHEAR: (FASTENER) 2470 LBS. AVE. MIN.
 5. HEAT TREAT Q.S. 303.3

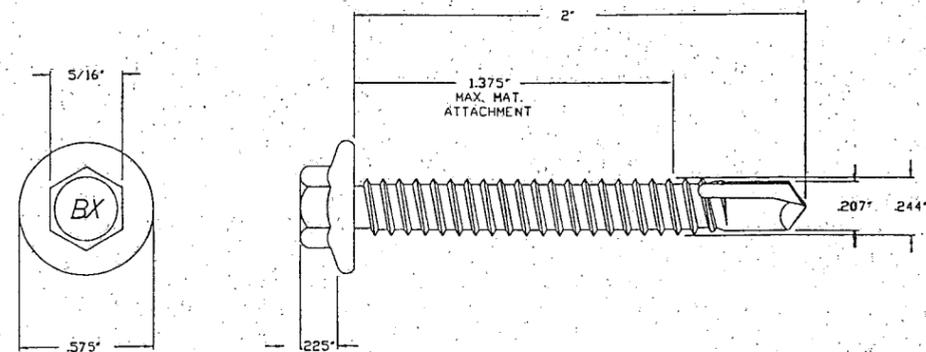


VP Buildings
3200 Players Club Circle
Memphis, TN 38125

SPECIFICATIONS: (REF. Q.S. 101.30)


1. DRILL TIME: 7 SECONDS MEAN, .187 PLATE
2. TAPPING TORQUE: 100 IN. LBS. MAX
3. PULLOUT: 800 LBS. AVE. MIN. 16 GA.
4. SHEAR: (FASTENER) 2470 LBS. AVE. MIN.
5. HEAT TREAT Q.S. 303.2

DRAWN BY:	R.J.M.	DATE:	10-14-98
CHKD.	<i>RJM</i>	APPR.	<i>BRT</i>
MATERIAL:	1022 CARBON STEEL		
CAP. PART #:	NONE		
WASHER PART #:	NONE		
WASHER MAT'L:	NONE		
FINISH:	CLIMASEAL Q.S. 301.5		

ITW BUILDDEX		
A DIVISION OF ILLINOIS TOOL WORKS, INC. 1249 WEST BETH HAVEN AVENUE ITASCAR, ILLINOIS 60143		
SIZE:	1/4-14 X 2"	
TYPE:	CLIP SCREW TEKS/3	
BASE/HFG. PART #:	1153	REGISTERED
BUILDDEX PART #:	1153000	ISO 9002



DRAWN BY:	R.J.M.	DATE:	10-14-98
CHKD.	<i>RJM</i>	APPR.	<i>BRT</i>
MATERIAL:	1022 CARBON STEEL		
CAP. PART #:	NONE		
WASHER PART #:	NONE		
WASHER MAT'L:	NONE		
FINISH:	CLIMASEAL Q.S. 301.5		

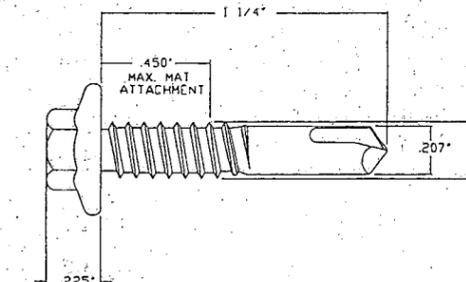

VP Buildings
3200 Players Club Circle
Memphis, TN 38125

ITW BUILDDEX		
A DIVISION OF ILLINOIS TOOL WORKS, INC. 1249 WEST BETH HAVEN AVENUE ITASCAR, ILLINOIS 60143		
SIZE:	1/4-14 X 1-1/4"	
TYPE:	CLIP SCREW TEKS/3	
BASE/HFG. PART #:	1151	REGISTERED
BUILDDEX PART #:	1151000	ISO 9002

- SPECIFICATIONS: (REF. Q.S. 101.30)
1. DRILL TIME: 7 SECONDS MEAN, .187 PLATE
 2. TAPPING TORQUE: 100 IN. LBS. MAX
 3. PULLOUT: 800 LBS. AVE. MIN. 16 GA.
 4. SHEAR: (FASTENER) 2470 LBS. AVE. MIN.
 5. HEAT TREAT Q.S. 303.2

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 03-0206.13
Expiration Date 04/24/2008
By *Heung A. Mak*
Miami Dade Product Control
Division

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 08-0303.04
Expiration Date 04/24/2009
By *Heung A. Mak*
Miami Dade Product Control
Division

[Handwritten signature]
10-15-00

Charles A. Haslebacher, P.E.
Florida PE Reg No. 53553
VP Buildings, Inc.
1140 West Mountain Street
Kernersville, NC 27284

DWG. NO.	VP SSR ROOF SUBMITAL		
SHEET NO.	8 OF 8		
DATE:	09/21/99		
REV. NO. 1	REV. DATE:	10/20/99	
REV. NO. 2	REV. DATE:	11/04/99	